


PRC  
APERTURE  
CARD

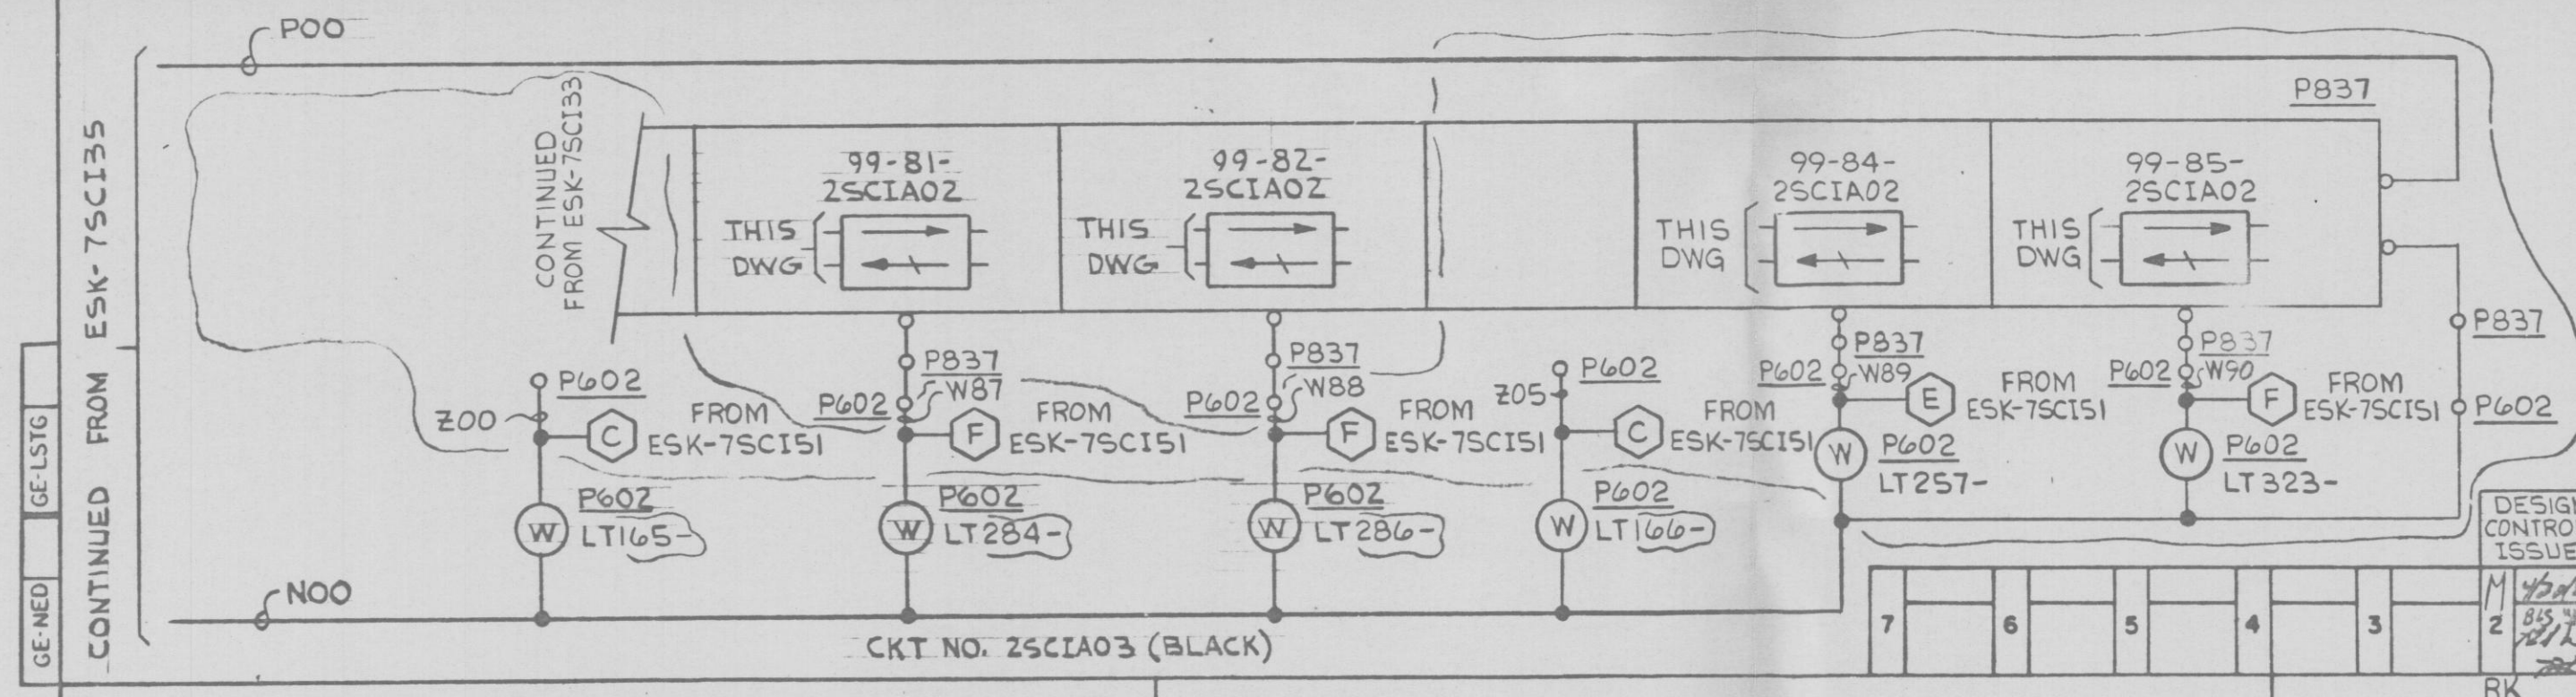

- NOTES:
1. ALL EQUIPMENT LOCATED AT P859  
UNLESS OTHERWISE NOTED.
  2. ☒ - INDICATES HATCH PENETRATION
  3. SEE VENDOR DWG NO. 32141, S & W FILE NO.  
0003-050-040-057.

NUCLEAR SAFETY RELATED  
QA CAT I,II

DC ELEM DIAG MISC DC CKTS  
OFF NORMAL STATUS DISPLAY  
NINE MILE POINT NUCLEAR STATION-UNIT 2  
NIAGARA MOHAWK POWER CORPORATION  
Stone & Webster Engineering Corporation

12177-ESK-7SCI40