


GE-1516
GE-1516
GE-1516

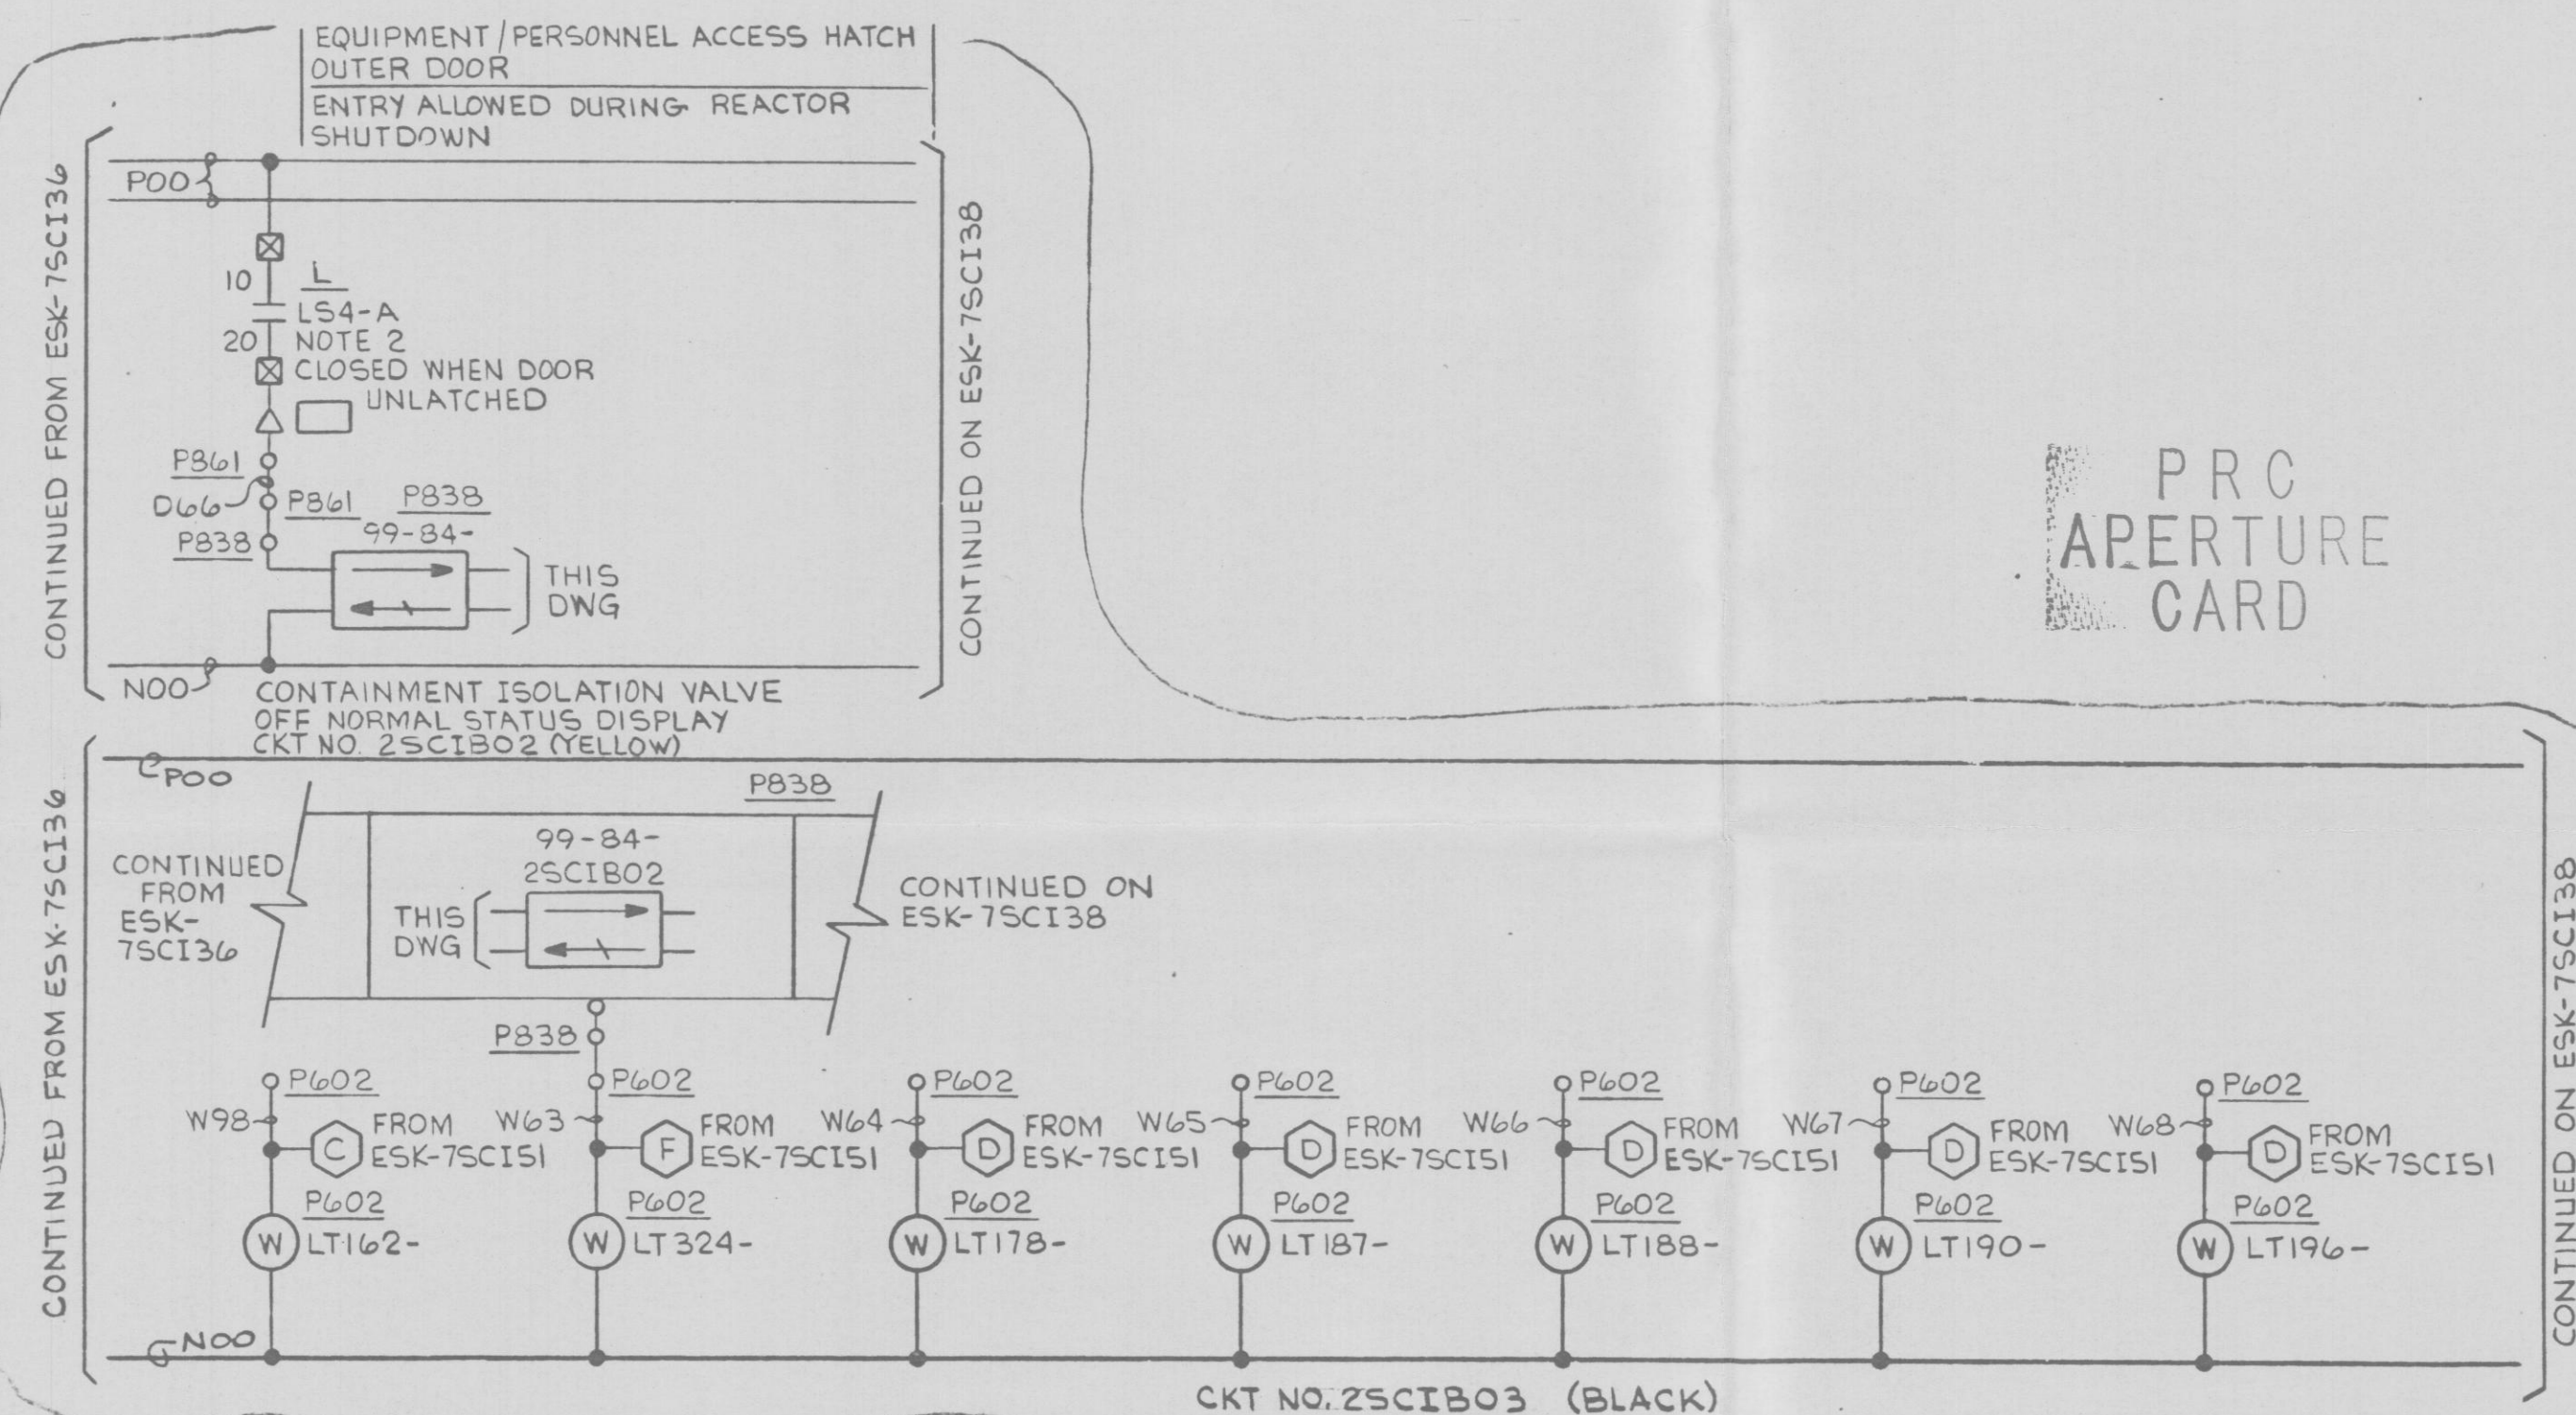

PRC
APERTURE
CARD

NOTES:

1. ☒ - INDICATES HATCH PENETRATION.
2. SEE VENDOR DWG. 32121 S&W FILE NO. 0003.050-040-053.

NUCLEAR SAFETY RELATED
QA CAT. I, II

DC ELEM DIAG-MISC DC CIRCUITS
OFF-NORMAL-STATUS DISPLAY
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION

STONE & WHITEN ENGINEERING CORPORATION

12177-ESK-7SCI37

DESIGN
CONTROL
ISSUE

PGCC

APM/RK

4 3312.4

7	6	5	4	3
---	---	---	---	---

D