


PRC
APERTURE
CARD

CONTAINMENT ISOLATION V OFF-NORMAL STATUS DISPLAY CKT 2SCIA02 (GREEN)

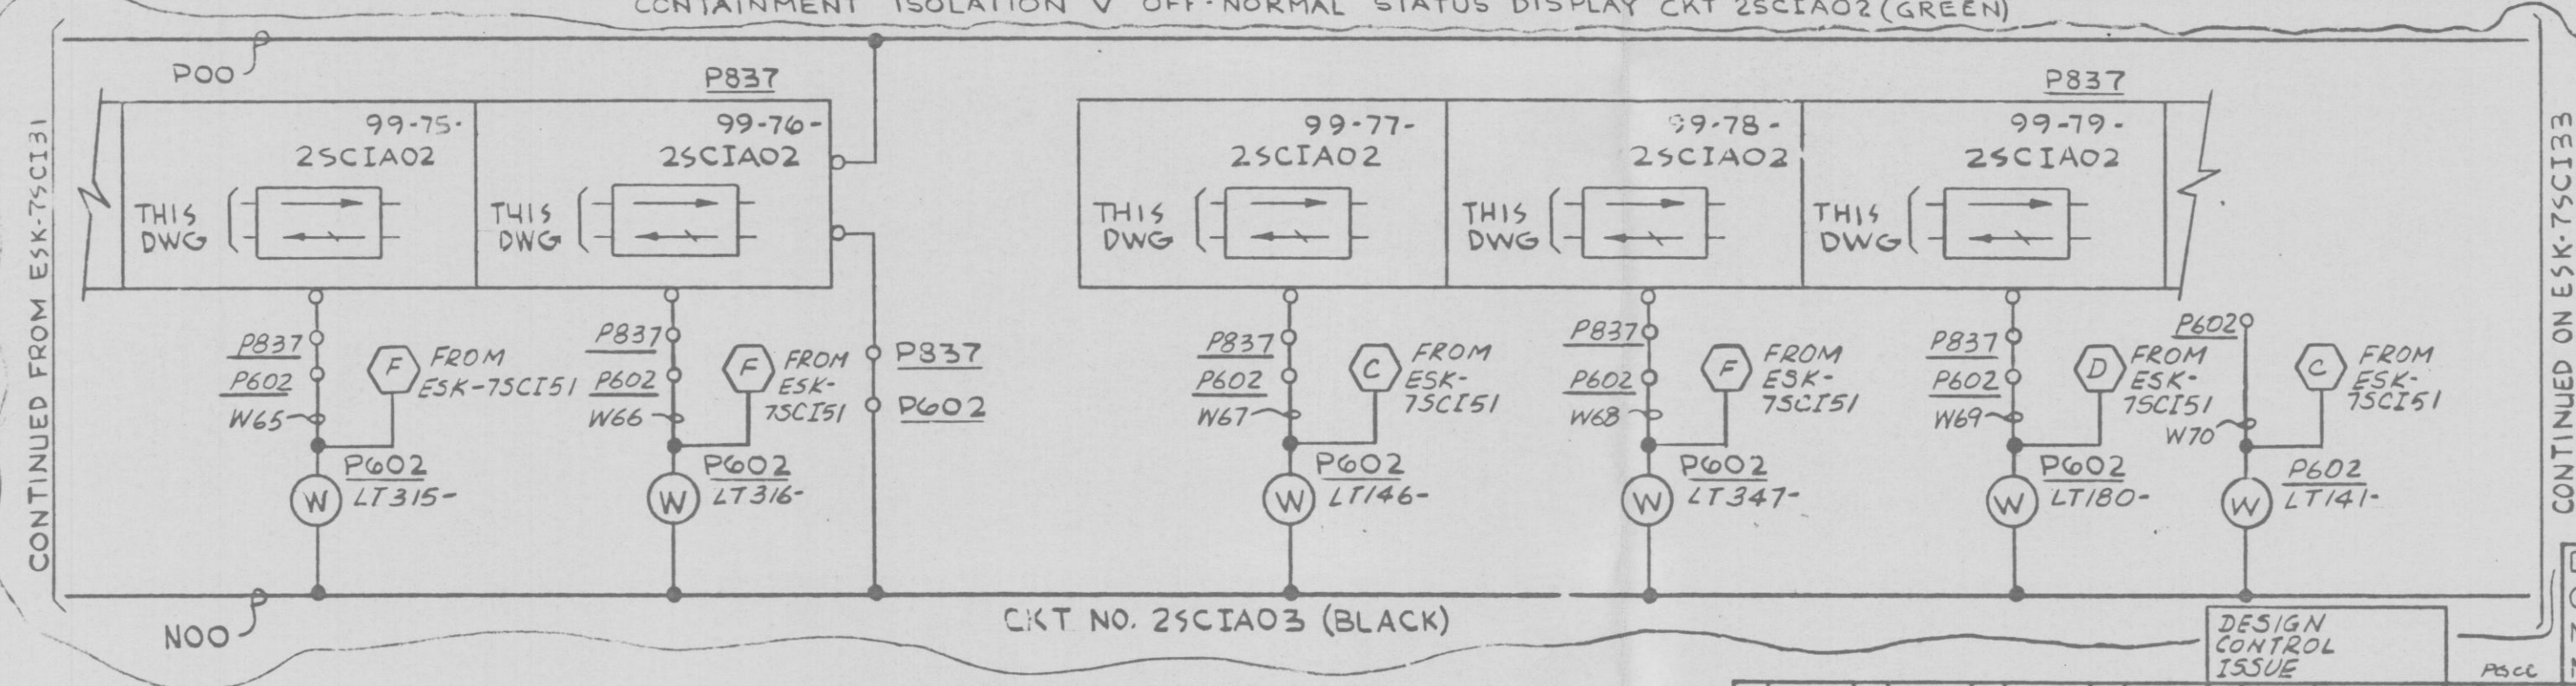

CKT NO. 2SCIA03 (BLACK)

NOTES:
1. □ - INDICATES DRYWELL PENETRATION

NUCLEAR SAFETY RELATED
QA CAT I, II

DC ELEM DIAG-MISC DC CKTS
OFF-NORMAL STATUS DISPLAY
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION

DESIGN CONTROL ISSUE
4/30/81
INCORP EDCR G40390 G40392

APM/DM

12177-ESK-7SCI32

GE-NEO
GE-LSTG

D