



RCIC TURBINE STEAM LEAD ISOL VALVE 2ICS*MOV128(E51-F063) VALVE NORMALLY OPEN CLOSES FOR ISOLATION	RBCLW TO RECIRC PUMP B COOLERS INBD 130L V 2CCP*MOV94B VALVE NORMALLY OPEN CLOSES FOR ISOLATION	CONTAINMENT SPRAY VALVE 2RHS*MOV25B(E12-F017B) VALVE NORMALLY CLOSED CLOSED FOR ISOLATION	RHR "B" SUPPRESSION POOL SPRAY VALVE 2RHS*MOV33B(E12-F021B) VALVE NORMALLY CLOSED CLOSED FOR ISOLATION	SHUTDOWN CLG INJECTION BYPASS VALVE 2RHS*MOV67B(E12-F099B) VALVE NORMALLY CLOSED CLOSED FOR ISOLATION
---	---	---	--	---

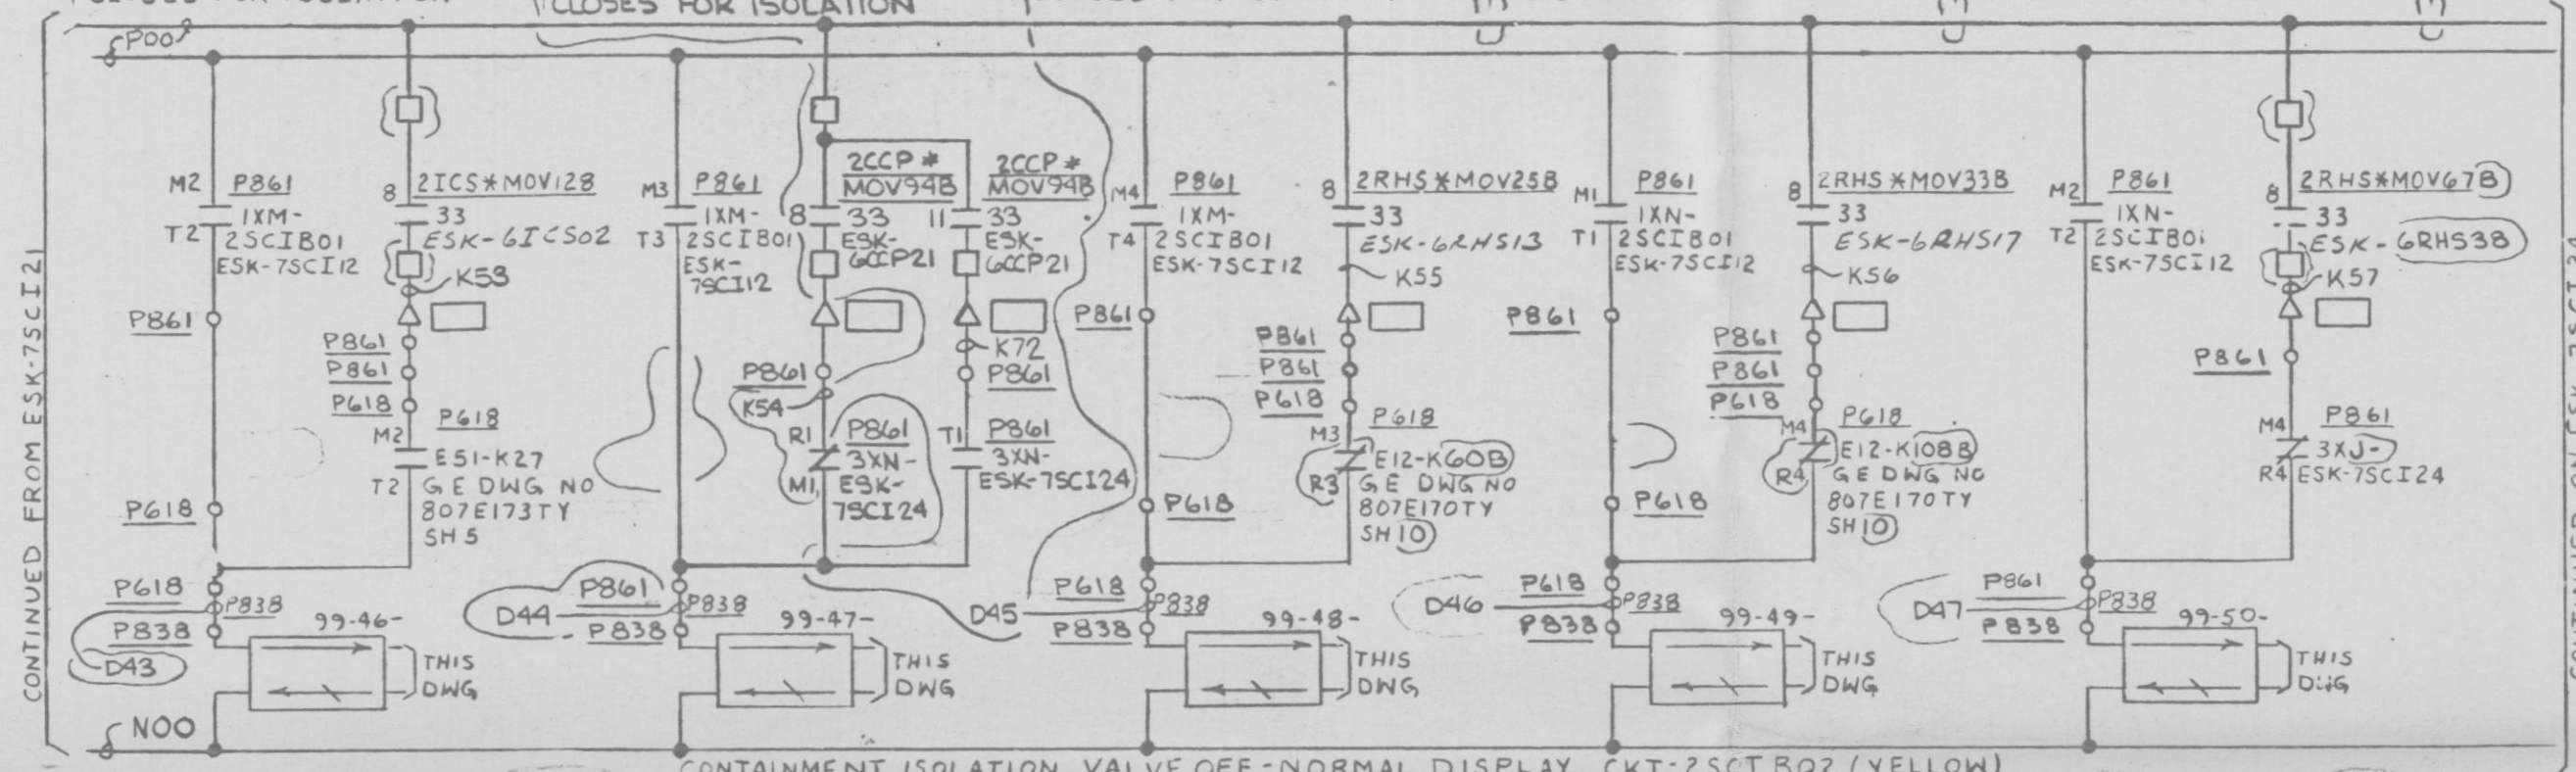

CONTAINMENT ISOLATION VALVE OFF-NORMAL DISPLAY, CKT-2SCIB02 (YELLOW)

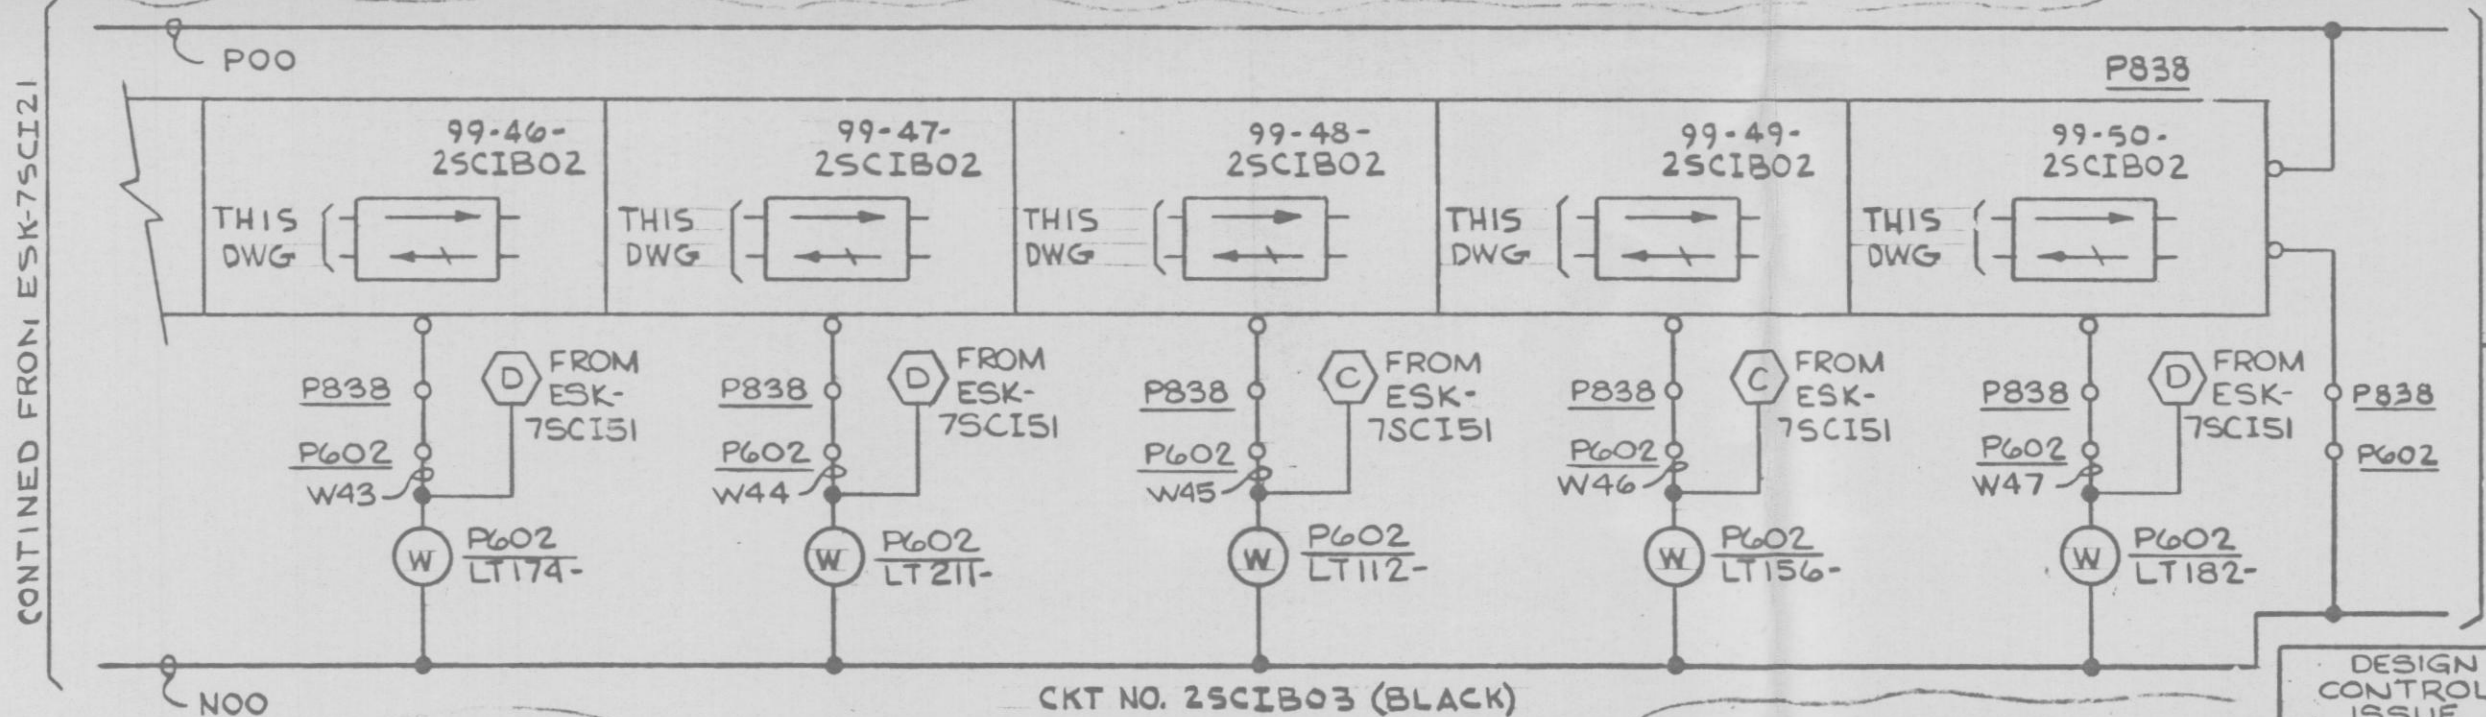

CKT NO. 2SCIB03 (BLACK)

NOTES:
1 □ - INDICATES DRYWELL PENETRATION

PRC
APERTURE
CARD

NUCLEAR SAFETY RELATED
QA CAT I, II

DC ELEM DIAG-MISC DC CIRCUITS
OFF-NORMAL STATUS DISPLAY
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION

STONE & WEBSTER ENGINEERING CORPORATION

12177-ESK-7SCI22

DESIGN
CONTROL
ISSUE
4/30/81
INCORP
840390
240343
APM/EP

REV PSCC
2
1-11-78
PSCC/STW
RSC
KALACS
12/21/81

PGCC
1
6-9-77
PSCC/STW
RSC
KALACS
12/21/81

4 5518.4

D