

CONTINUED FROM
ESK-7SCI14

CONTINUED ON
ESK-7SCI16

PRC
APERTURE
CARD


- NOTES:
1. □ - INDICATES DRYWELL PENETRATION.
 2. ▣ - INDICATES SUPPRESSION CHAMBER PENETRATION.

NUCLEAR SAFETY RELATED
QA CAT I, II


DC ELEM DIAG - MISC DC CIRCUITS
OFF-NORMAL-STATUS DISPLAY
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION

12177-ESK-7SCI15

GE-NED ✓ GE-LS16

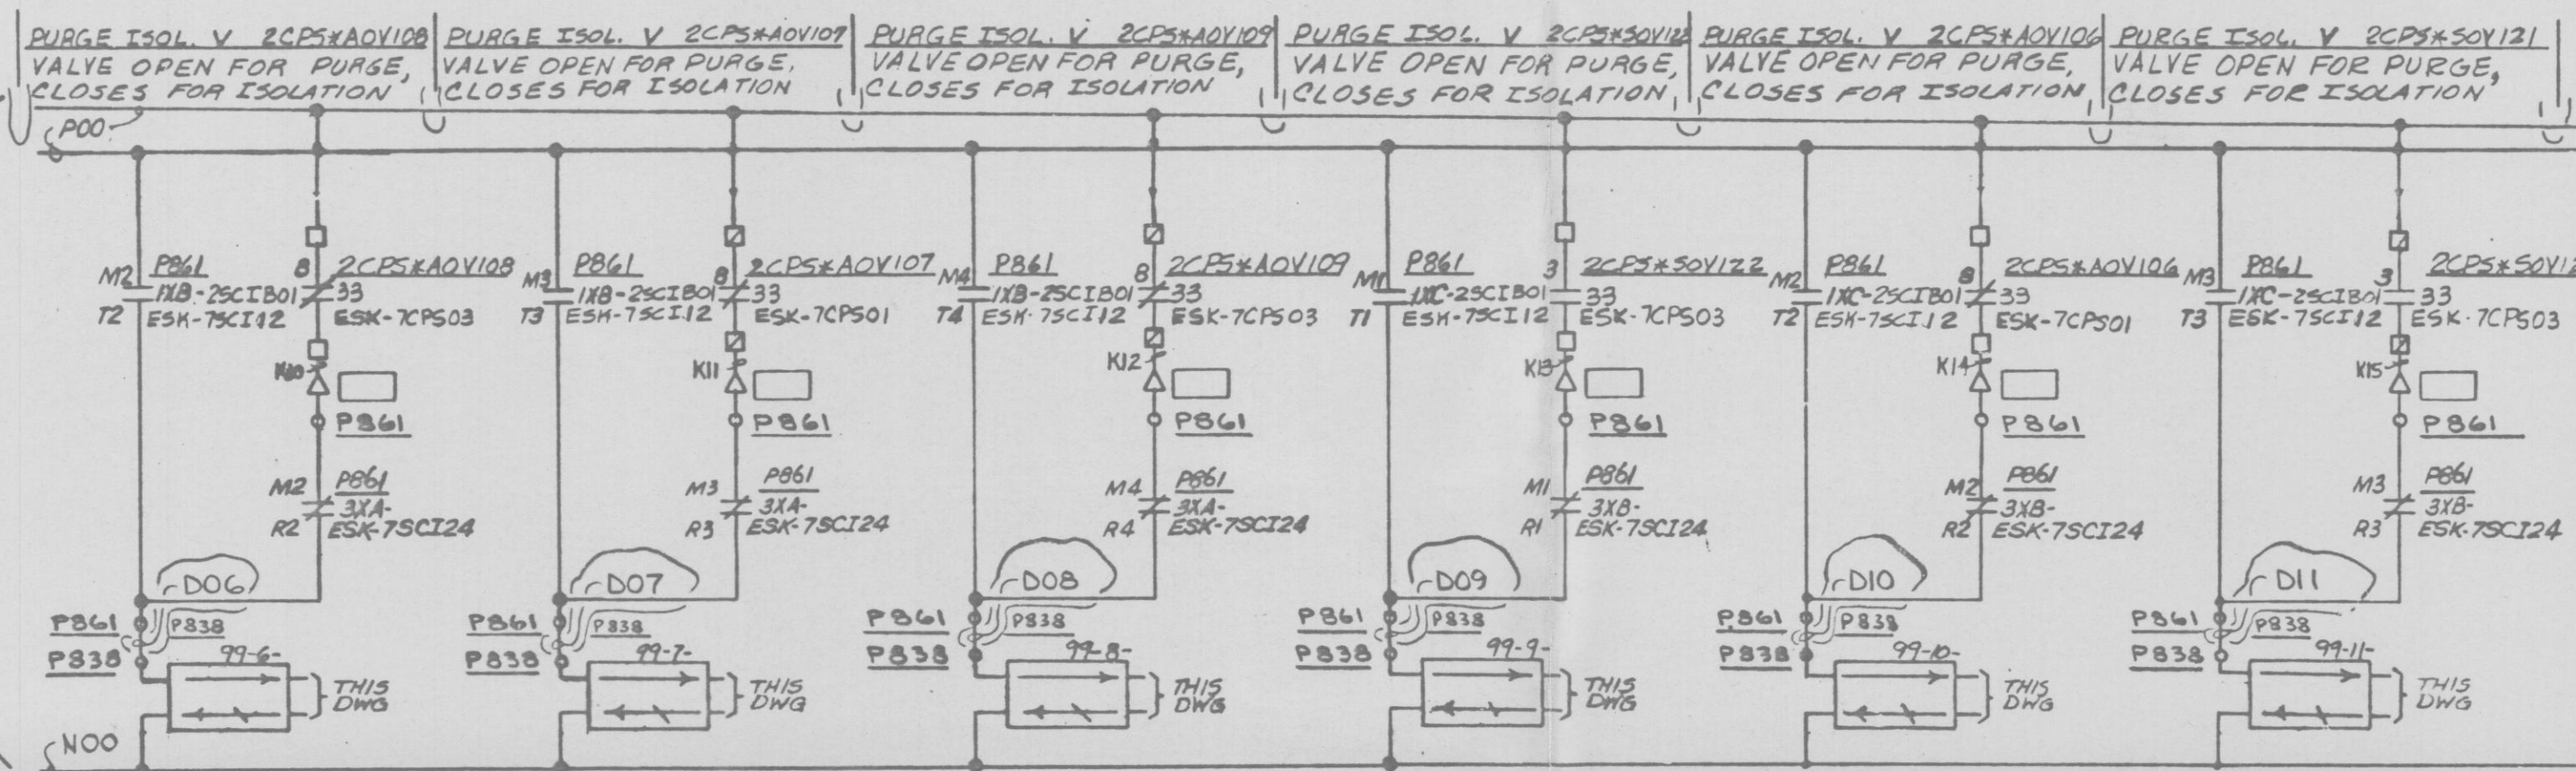

CONTAINMENT ISOLATION VALVE OFF-NORMAL-STATUS DISPLAY CKT 25CIB02 (YELLOW)

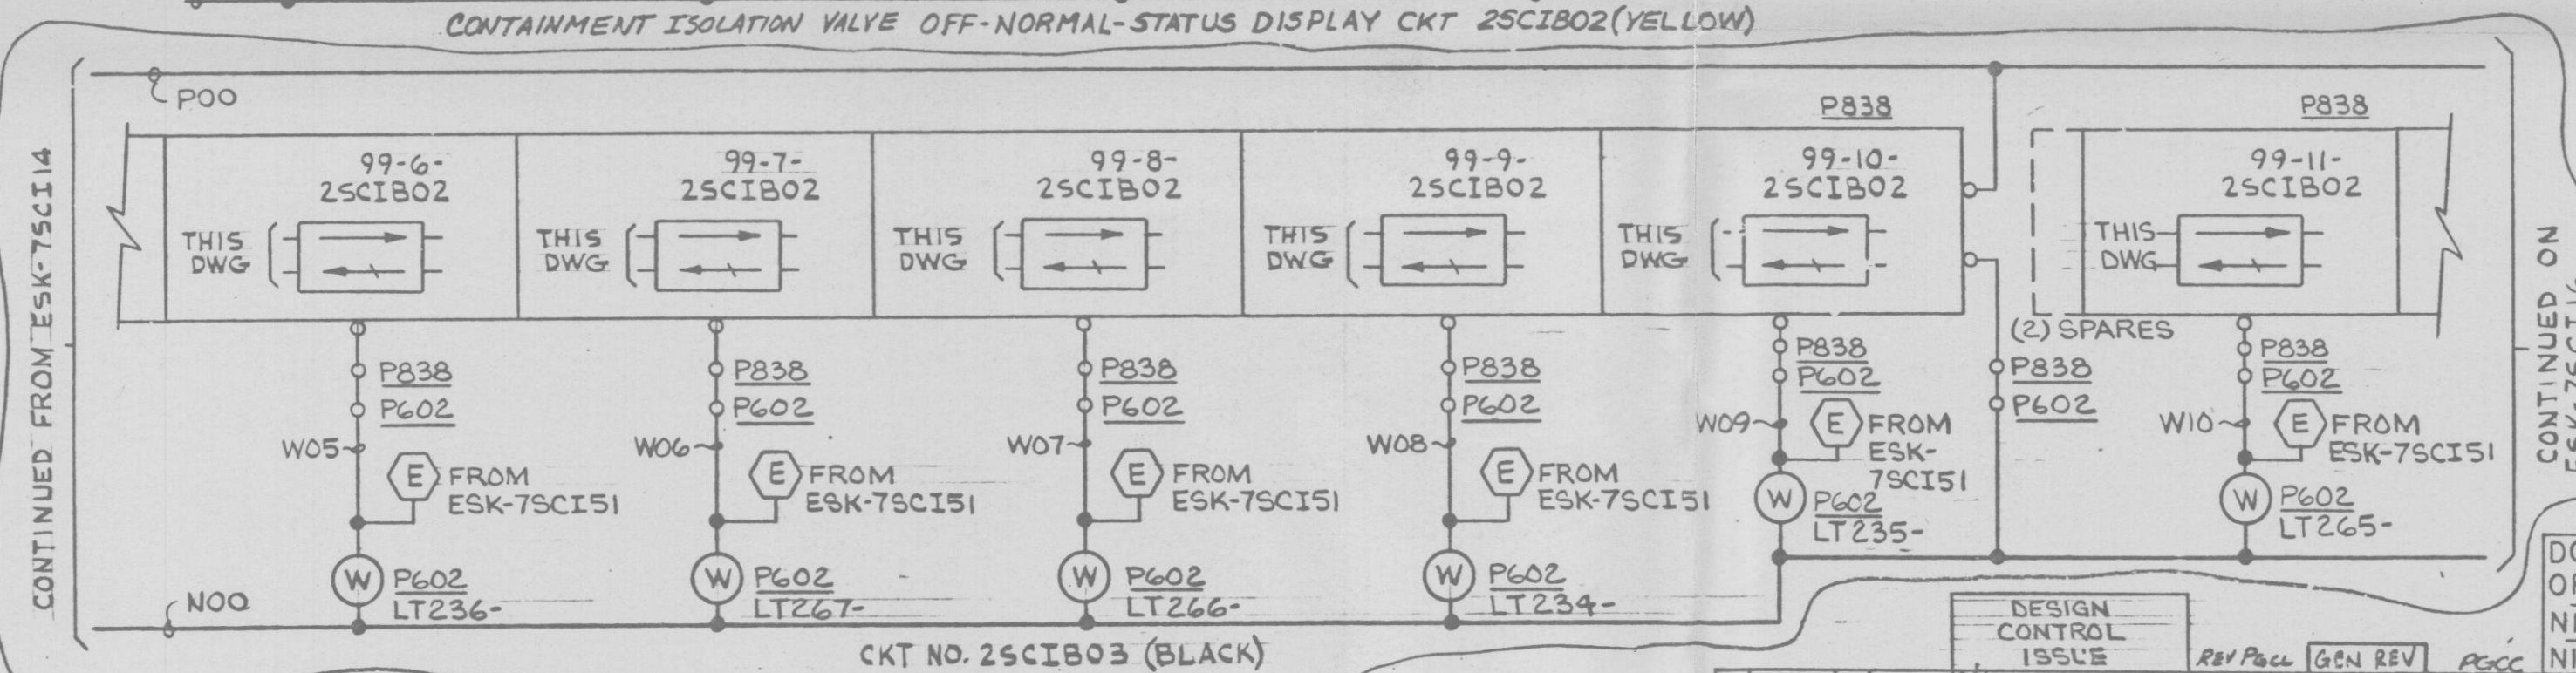

DESIGN
CONTROL
ISSUE

REV	DATE	BY	CHKD	APPV
1	4/30/81	M		
2	5/11/81	M		
3	5/11/81	M		
4	5/11/81	M		

REV	DATE	BY	CHKD	APPV
1	4/30/81	M		
2	5/11/81	M		
3	5/11/81	M		
4	5/11/81	M		

REV P602 GEN REV P602