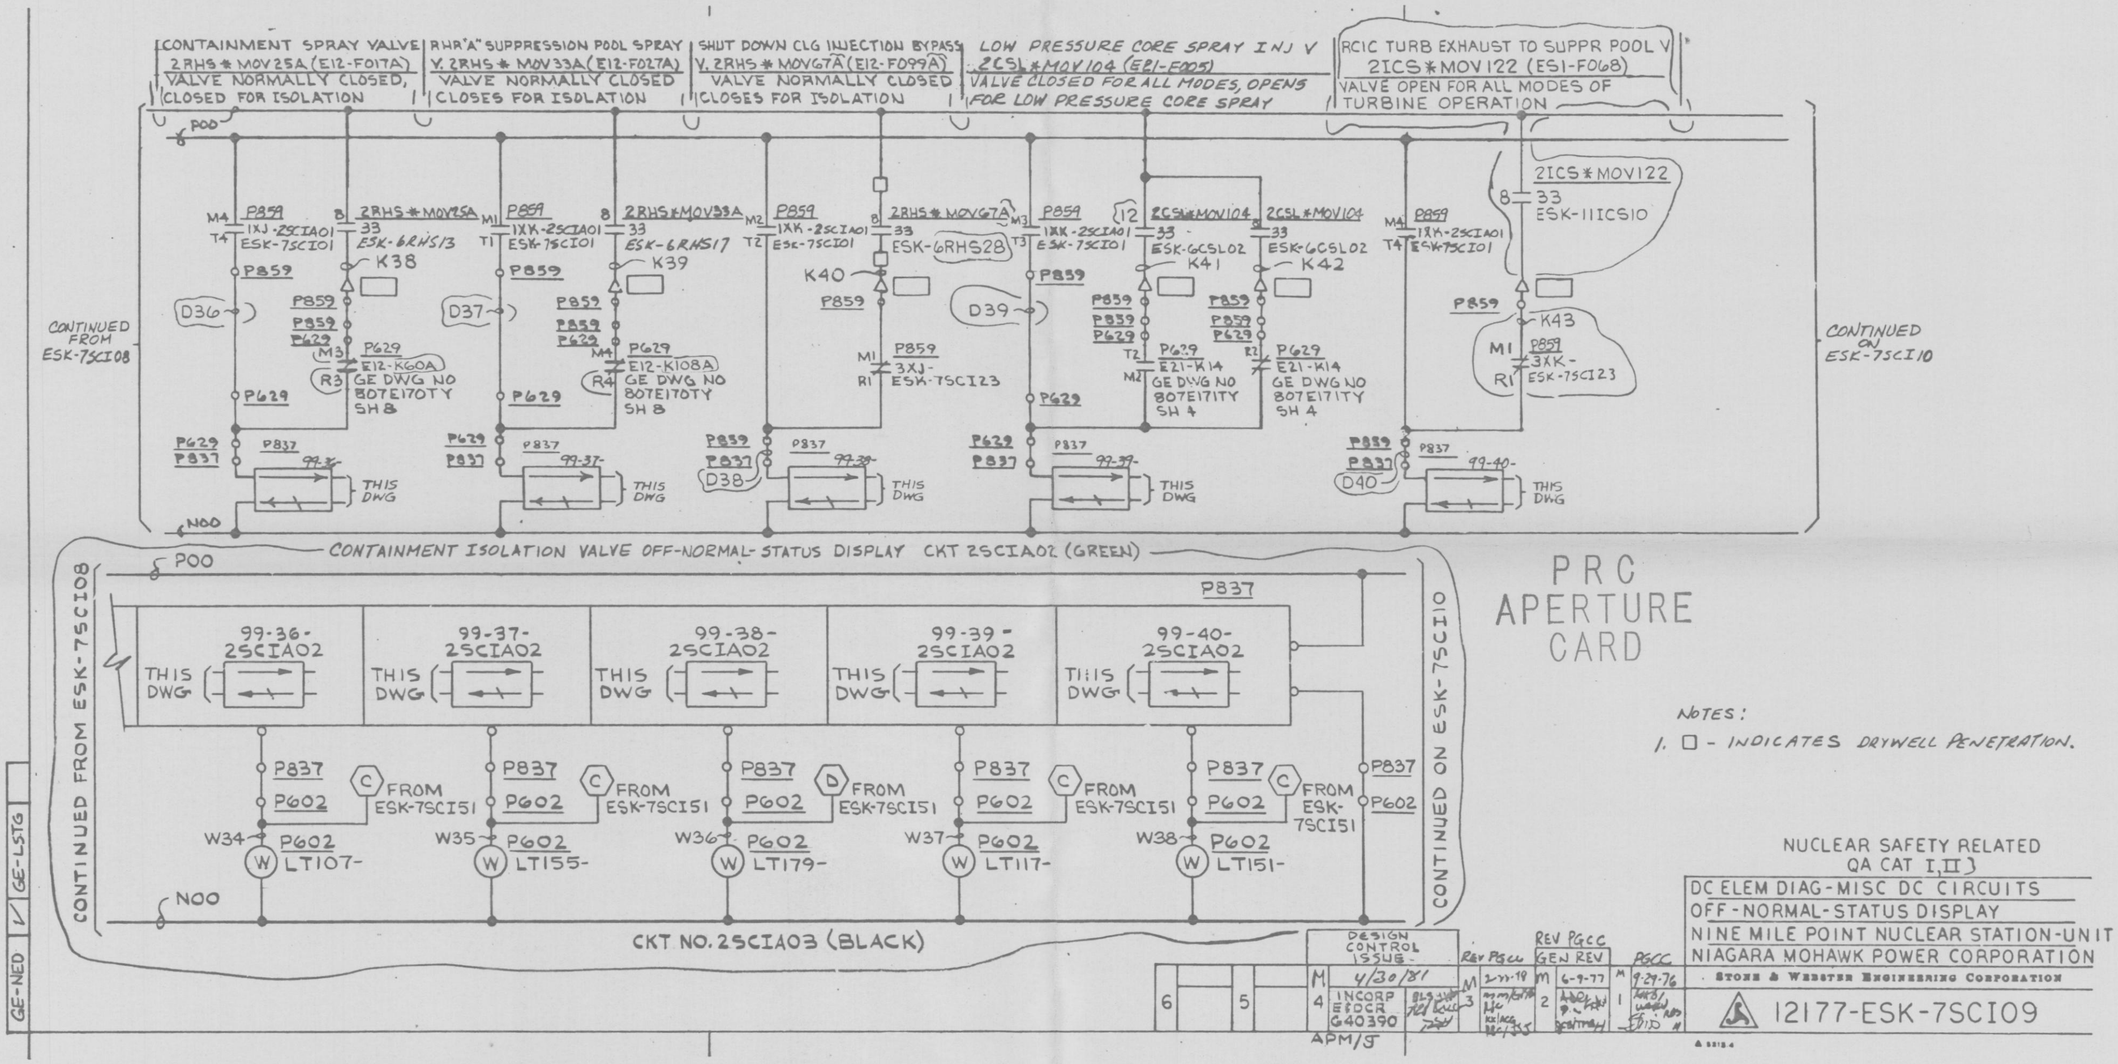

PRC APERTURE CARD

NOTES:
1. □ - INDICATES DRYWELL PENETRATION.

NUCLEAR SAFETY RELATED
QA CAT I, II)

DC ELEM DIAG-MISC DC CIRCUITS
OFF-NORMAL-STATUS DISPLAY
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION
STONE & WEBSTER ENGINEERING CORPORATION

12177-ESK-7SCI09

DESIGN CONTROL ISSUE	REV PGCC	REV PGCC GEN REV	PGCC
M 4/30/81	M 2-11-19	m 6-9-77	M 9-29-76
4 INCORP EDCR G40390	3	2	1

APM/S

D