


CONTINUED FROM ESK-75C106

CONTINUED ON ESK-75C108

PRC APERTURE CARD

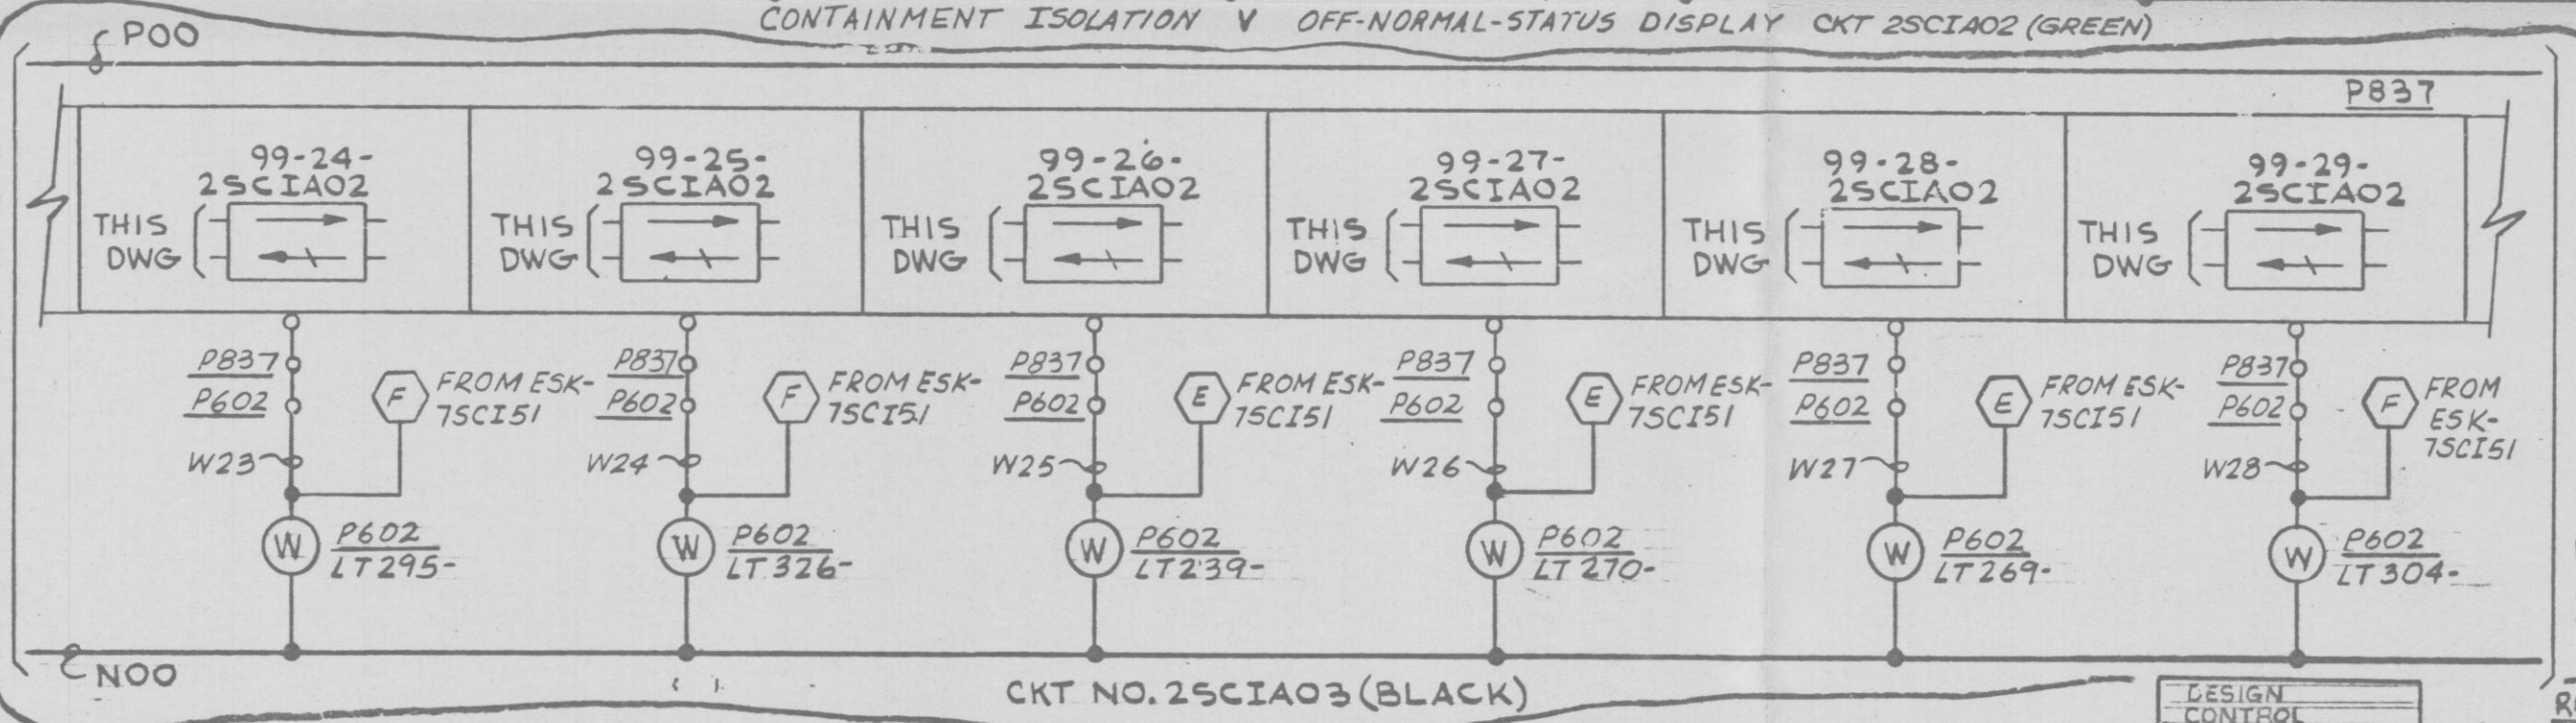

CONTINUED FROM ESK-75C106

CONTINUED ON ESK-75C108

NOTES:  
1. ☐ - INDICATES DRYWELL PENETRATION  
2. ☒ - INDICATES SUPPRESSION CHAMBER PENETRATION

NUCLEAR SAFETY RELATED  
QA CAT I, II

DC ELEM DIAG-MISC DC CIRCUITS  
OFF-NORMAL-STATUS DISPLAY  
NINE MILE POINT NUCLEAR STATION-UNIT 2  
NIAGARA MOHAWK POWER CORPORATION

STONE & WEBSTER ENGINEERING CORPORATION

12177-ESK-75C107

DESIGN	REV	DATE	BY	CHK	APP
CONTROL	1	4/24/81	M		
ISSUE	2	2-12-78	M		
INCORP	3	6-9-77	M		
EDR	4	7-29-76	M		
940390					
APM/DM					

D