



CONT'D FROM SH 1

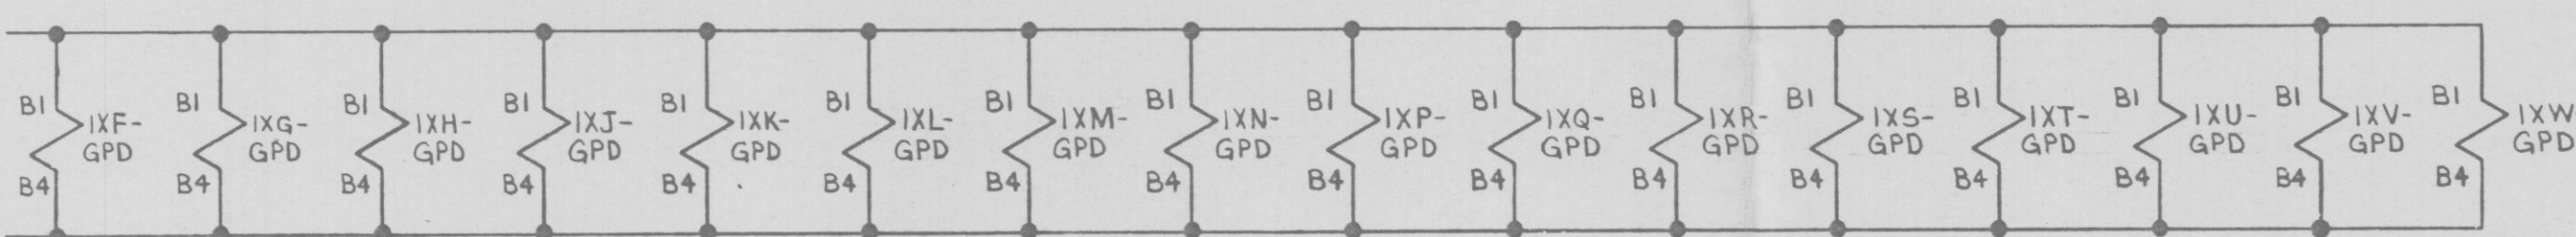

CONTAINMENT ISOLATION VALVE OFF NORMAL STATUS DISPLAY CKT-NO. 2SC1ACI (GREEN)

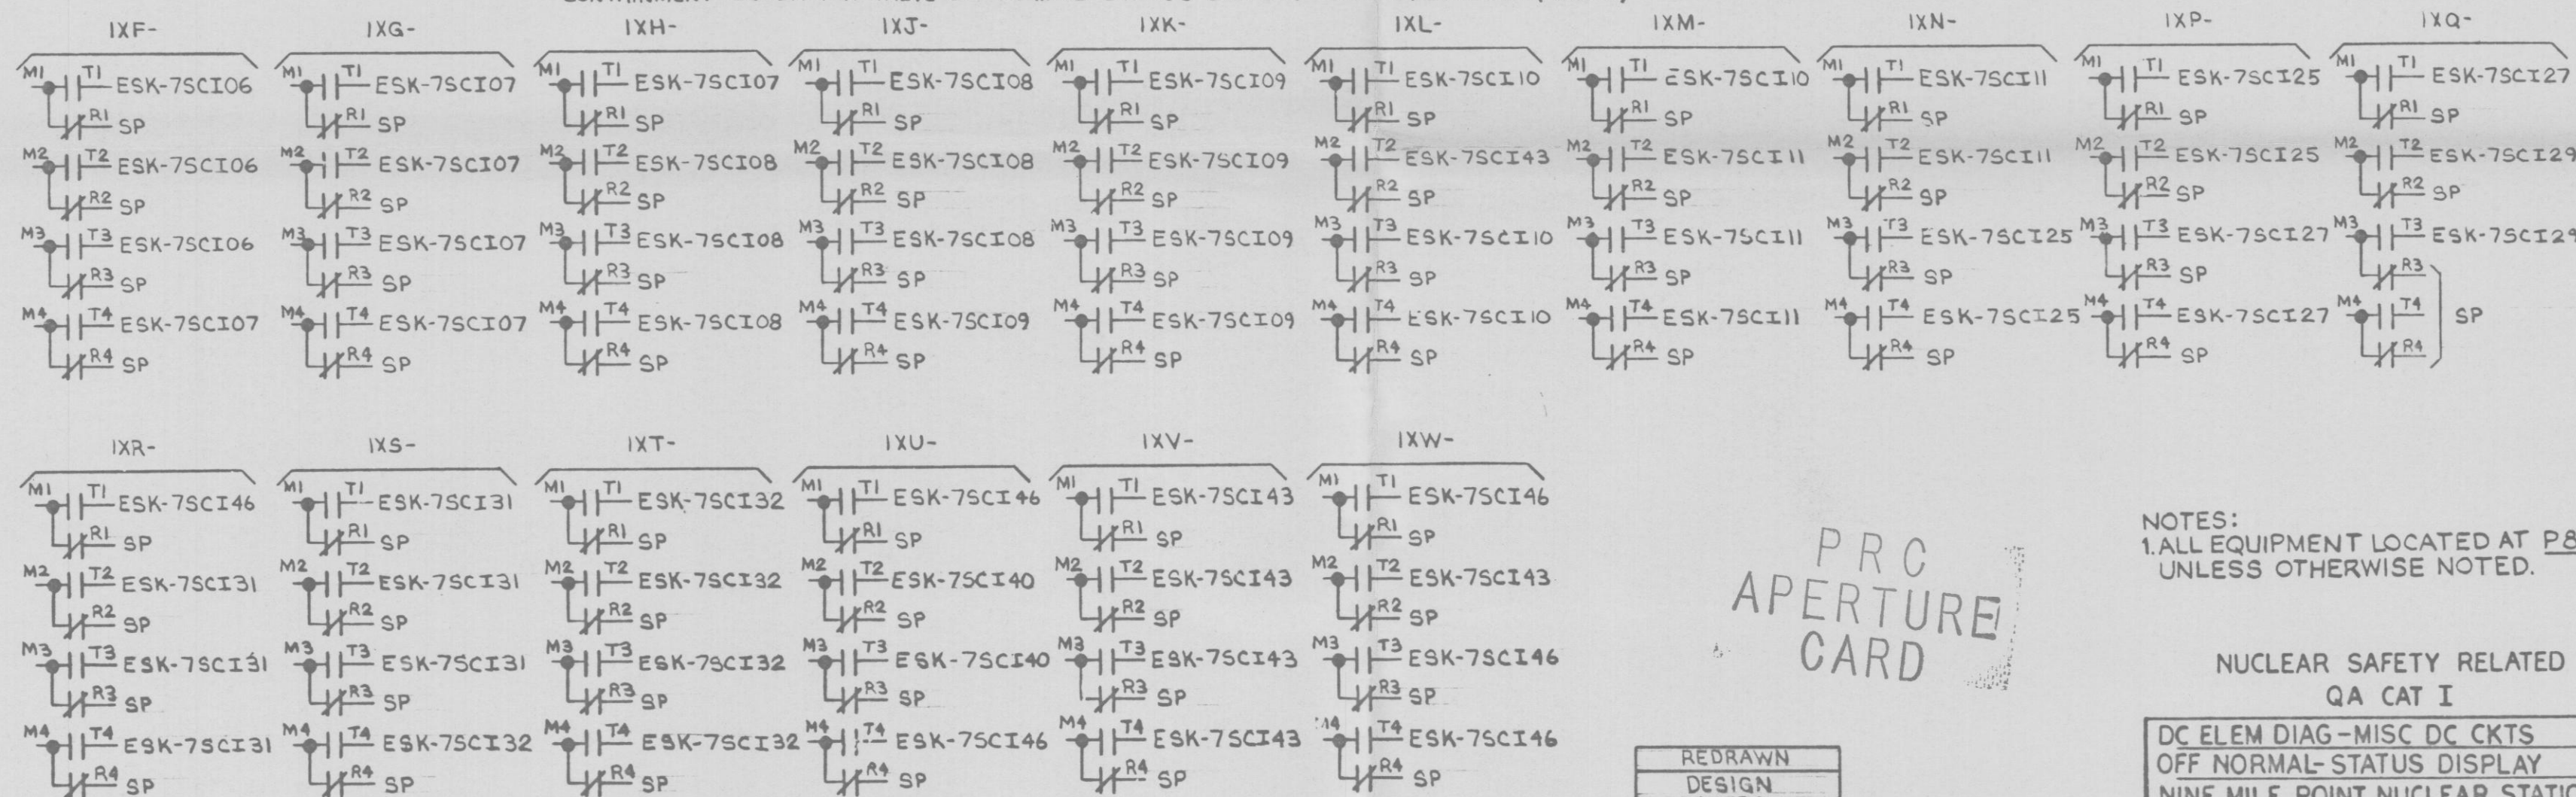

PRC
APERTURE
CARD

NOTES:
1. ALL EQUIPMENT LOCATED AT P859
UNLESS OTHERWISE NOTED.

NUCLEAR SAFETY RELATED
QA CAT I

DC ELEM DIAG-MISC DC CKTS
OFF NORMAL-STATUS DISPLAY
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION
STONE & WEBSTER ENGINEERING CORPORATION

12177-ESK-7SCI01 SH
2 OF 2

REDRAWN
DESIGN
CONTROL
ISSUE

4/2/81
INCORP EDCR
Q40088
Q40298

6	5	4	3	2	1
---	---	---	---	---	---

RM

4 1118 4

GE-15TG
GE-NED