


GE LSTG	33	VALVE POSITION FULL OPEN FULL CLOSED	FUNCTION			
			2IAS*SOVX181	2IAS*SOVY181	2IAS*SOVX186	2IAS*SOVY186
1	—	—	RED LIGHT	RED LIGHT	RED LIGHT	RED LIGHT
2	—	—	GREEN LIGHT	GREEN LIGHT	GREEN LIGHT	GREEN LIGHT
3	—	—	SP	SP	SP	SP
4	—	—	SP	SP	SP	SP

PRC  
APERTURE  
CARD

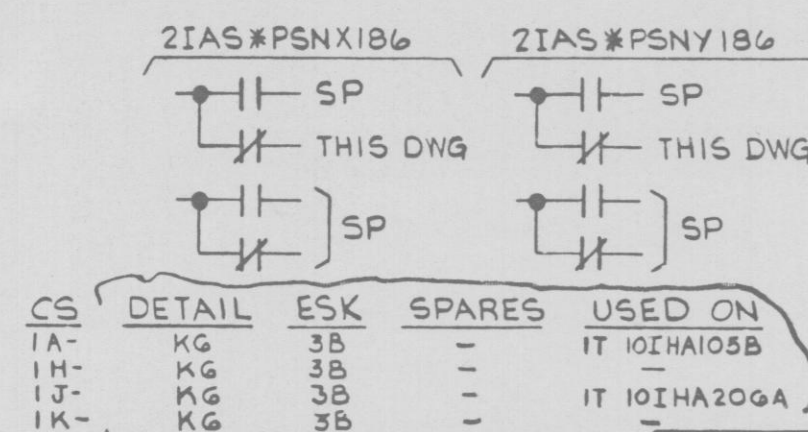

- NOTES:
- LOGIC DIAGRAM LSK-12-16
  - ASSOCIATED VALVE OPENS WHEN SOV IS ENERGIZED

NUCLEAR SAFETY RELATED  
QA CAT I

AC ELEM DIAG-MISC AC CKTS  
ADS HDR FLOW SPLY VALVES (DIV I, DIV II)  
NINE MILE POINT NUCLEAR STATION-UNIT 2  
NIAGARA MOHAWK POWER CORPORATION  
STONE & WEBSTER ENGINEERING CORPORATION  
12177-ESK-7IAS09

CS	DETAIL	ESK	SPARES	USED ON
1A-	KG	3B	—	IT 10IHA105B
1H-	KG	3B	—	—
1J-	KG	3B	—	IT 10IHA20GA
1K-	KG	3B	—	—

DESIGN CONTROL	DESIGN CONTROL
ISSUE 2	ISSUE 1
5-21-82	12/1/80
ECN-014	ECN-014
018, 025	018, 025

D