



CONTINUED FROM ESK-7IASO2

DIV I INSTR AIR ISOL VALVES POWER FAILURE

DIV I PRI CONTAINMENT MANUAL ISOLATION CIRCUIT

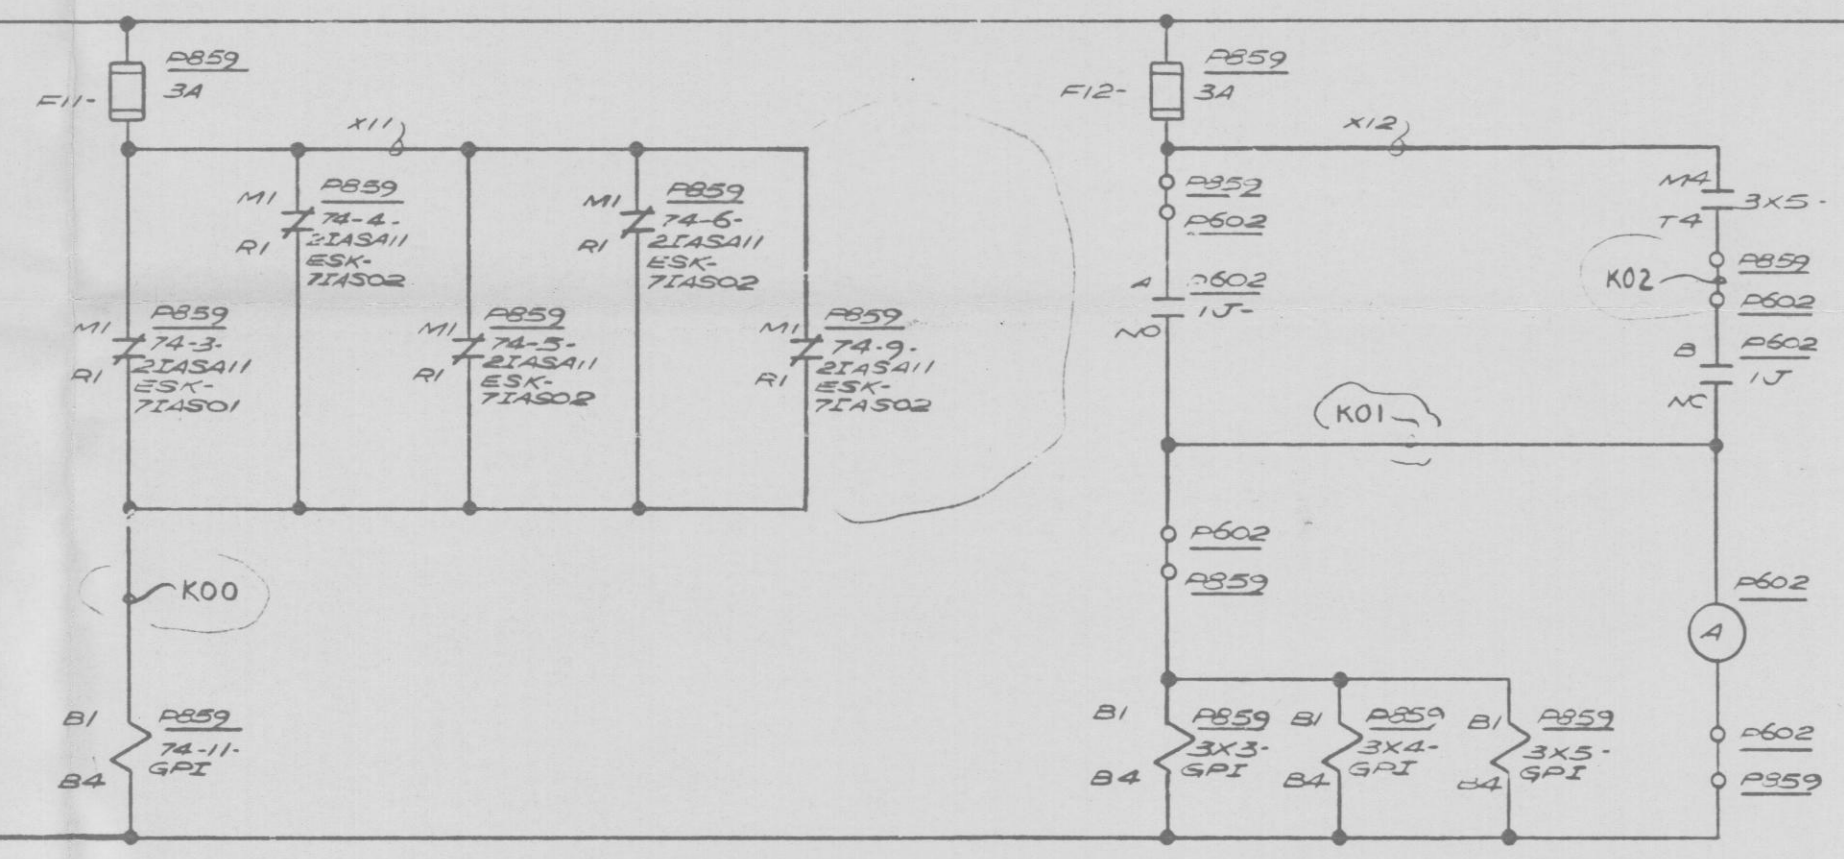

PRIMARY CONTAINMENT ISOL VALVES DIV I CKT-2IASA11 (GREEN)

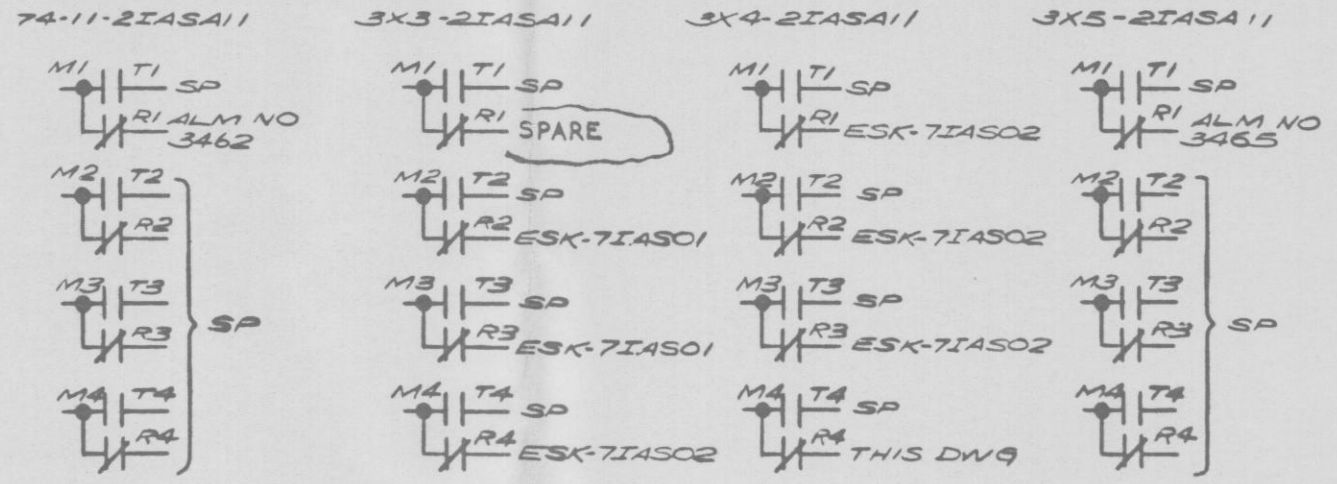

NOTE:
1 LOGIC DIAG LSK 12-1

PRC
APERTURE
CARD

RELEASED FOR PGCC FABRICATION ONLY

CS	DETAIL	ESK	SPARES	USED ON
1H-	"H5"	3B	1B, 2T	
1J-	"AN"	3F		
	DESIGN CONTROL ISSUE 2	DESIGN CONTROL ISSUE	20V PALL	PGCC
6	M 5-24-82	M 10/1/80	M 4-4-78	M 2-4-77
	ECN-014, 022, 025	M 11-5-11	M 10/1/80	M 10/1/80

NUCLEAR SAFETY RELATED
QA CAT I

AC ELEM DIAG-MISC AC CKT
INOP ALM DIV I
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION

STONE & WEBSTER ENGINEERING CORPORATION

12177-ESK-7IASO7

GE-1516

D