12177-EE-IS-5

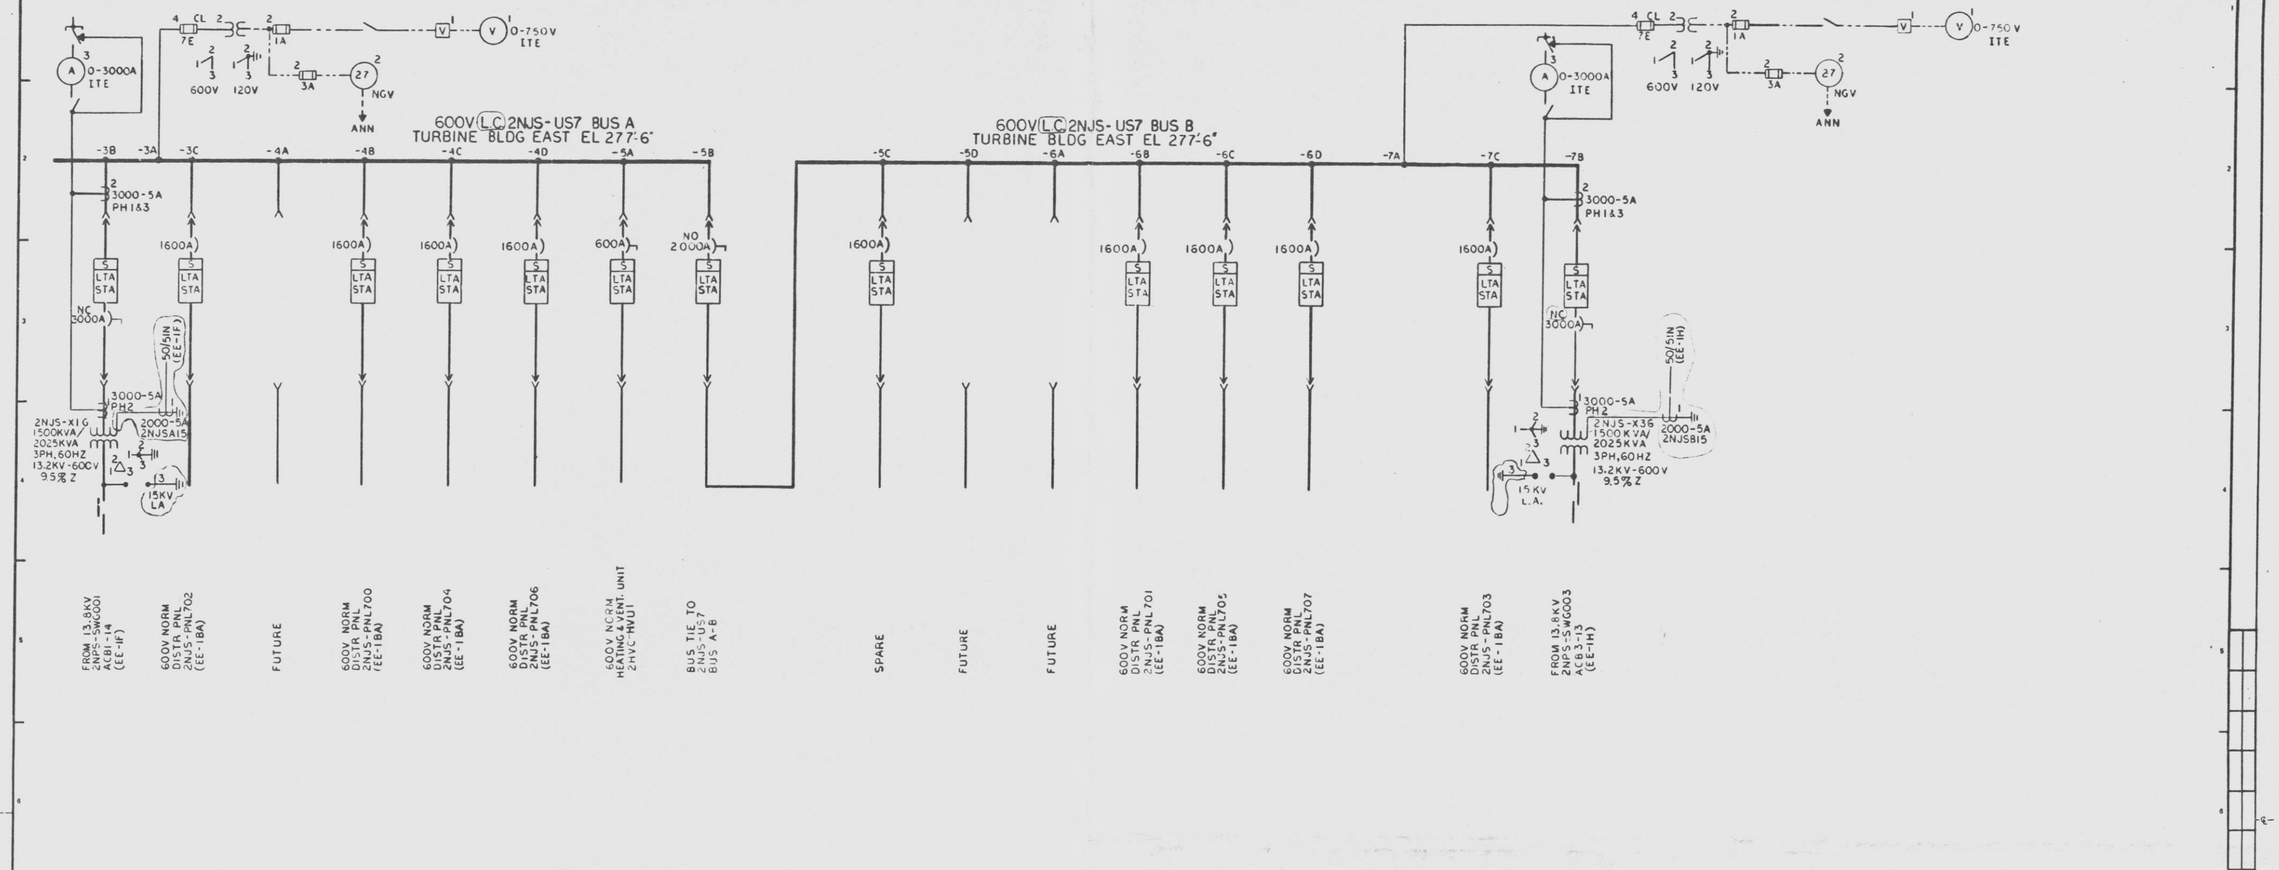

NOTES:
1. GENERAL NOTES, REFERENCES, ADDITIONAL SYMBOLS & LOCATION SYMBOLS EE-1T

ISSUE	DESCRIPTION	CHKD	CORR	APPR	DATE
6	SEE RECORD OF DRAWING CHANGES BCE-1S-5				
5	SEE RECORD OF DRAWING CHANGES BCE-1S-4				
3	ADDED XFMR IMPEDANCE				
2	REVISED & REDRAWN DUE TO ELIMINATION OF 5 SECTIONS NO LONGER REQD				
1	ORIGINAL ISSUE RELEASED FOR CONSTRUCTION				

THE INFORMATION ON THIS DRAWING MAY NOT BE COPIED OR USED FOR OTHER THAN THE CONSTRUCTION, MAINTENANCE OR REPAIR OF THE PLANT FACILITY DESCRIBED IN THE TITLE BLOCK.

TI APERTURE CARD

APPROVED _____
LICENSED PROFESSIONAL ENGINEER, NO. 042839
STATE OF NEW YORK
ALTERATION EXCEPT BY A LICENSED PROFESSIONAL ENGINEER IS ILLEGAL

QA CAT II

600V ONE LINE DIAGRAM NORMAL BUS 2NJS-US7 TURBINE BLDG EAST EL 277'-6"

NINE MILE POINT NUCLEAR STATION — UNIT 2
NIAGARA MOHAWK POWER CORPORATION
STONE & WEBSTER ENGINEERING CORPORATION
CHERRY HILL, N.J.

CH

DRAWING NUMBER 12177-EE-IS-5

DESIGNED BY	DRAWN BY K.PEAKE	AREAS	LEVELS	WORK PKG
DSGN CHK'D BY	CHK'D BY C.HENDERSON	2		33A

ISSUE 0 — MAT'L APP'D BY A.GUHAL — BLDG LDR: P.HUHTA — MAT'L APP'D BY — ISSUE 0

A-0900.7A FILM