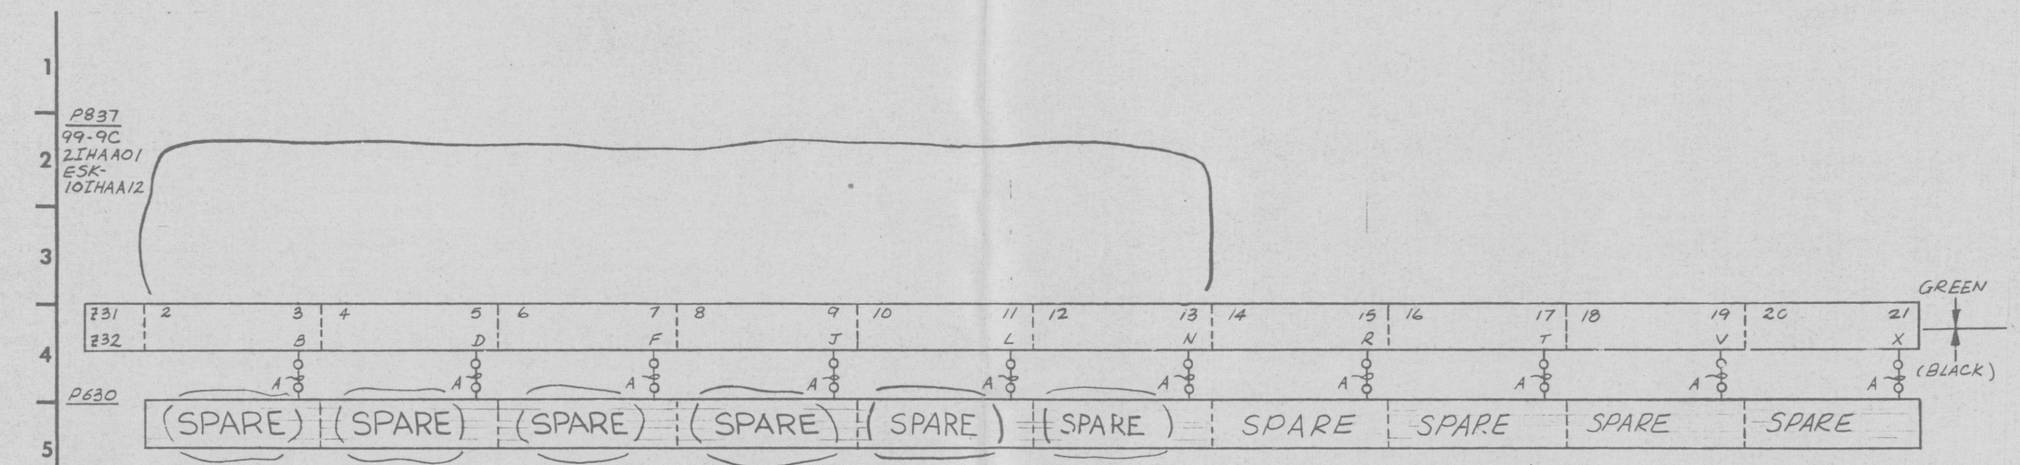

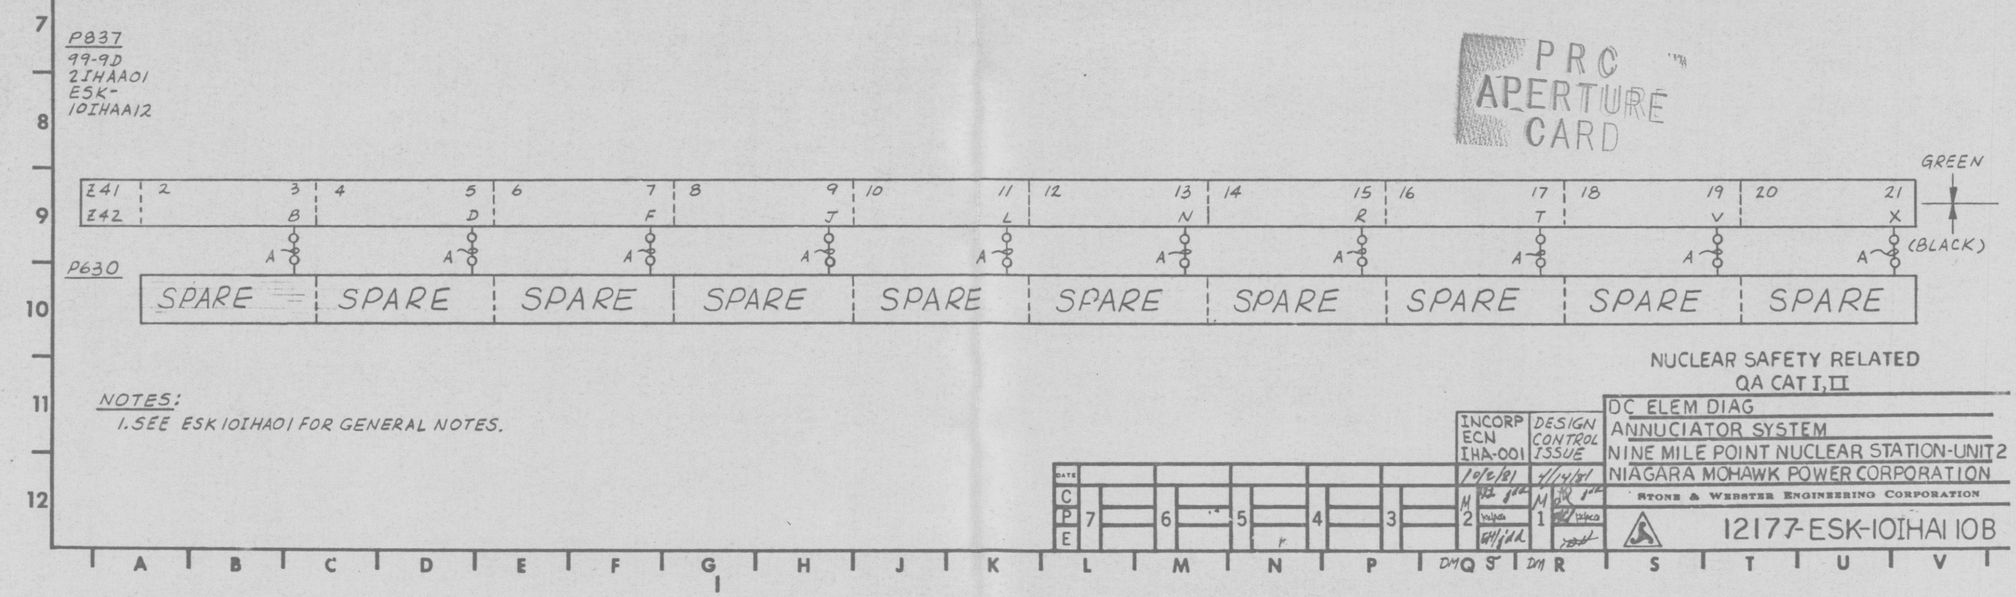

PRC
APERTURE
CARD

NOTES:
1. SEE ESK 10IHA01 FOR GENERAL NOTES.

NUCLEAR SAFETY RELATED
QA CAT I, II

DC ELEM DIAG	
ANNUCIATOR SYSTEM	
NINE MILE POINT NUCLEAR STATION-UNIT 2	
NIAGARA MOHAWK POWER CORPORATION	
STONE & WEBSTER ENGINEERING CORPORATION	
12177-ESK-10IHA 10B	

	DATE	INCORP ECN IHA-001	DESIGN CONTROL ISSUE
C		10/6/81	11/4/81
P	7 6 5 4 3	2	1
E			

A 9860.8