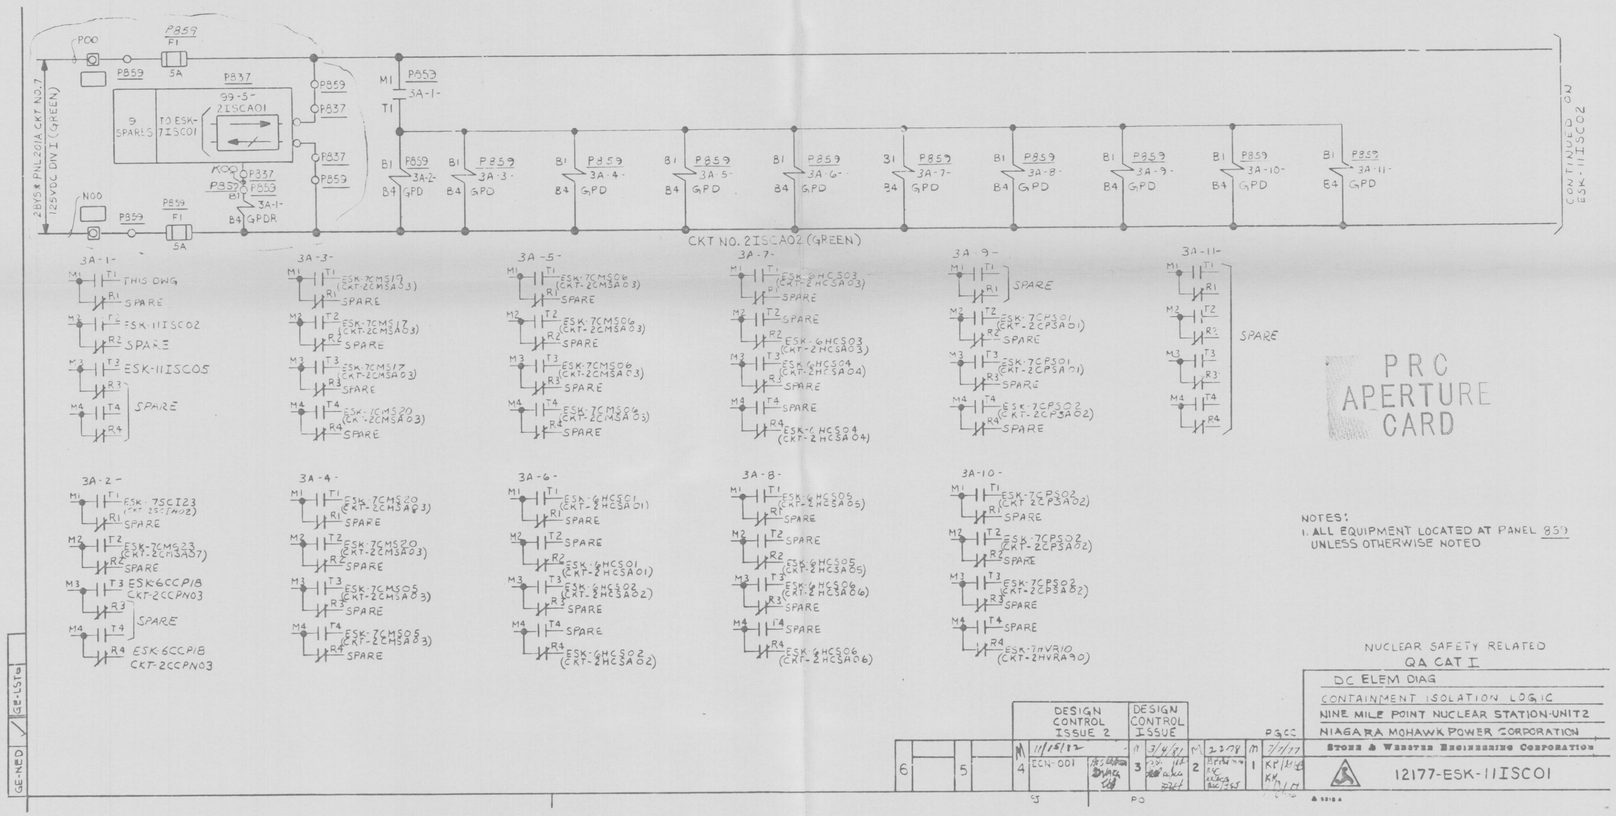


PRC APERTURE CARD

NOTES:
1. ALL EQUIPMENT LOCATED AT PANEL 859 UNLESS OTHERWISE NOTED

NUCLEAR SAFETY RELATED
QA CAT I

DC ELEM DIAG
CONTAINMENT ISOLATION LOGIC
NINE MILE POINT NUCLEAR STATION-UNIT 2
NIAGARA MOHAWK POWER CORPORATION
STONE & WEBSTER ENGINEERING CORPORATION

12177-ESK-11ISC01

| | | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | | | | | | | | | | | | | | | |
| 6 | | 5 | | 4 | 11/25/82 | ECN-001 | | 3 | 3/4/81 | 2 | 3-2-79 | 1 | 7/7/77 | KT KK | |

DESIGN CONTROL ISSUE 2 — SJ
DESIGN CONTROL ISSUE — PO
PGCC

GE-NED / GE-LSTG

D