


PRC
APERTURE
CARD

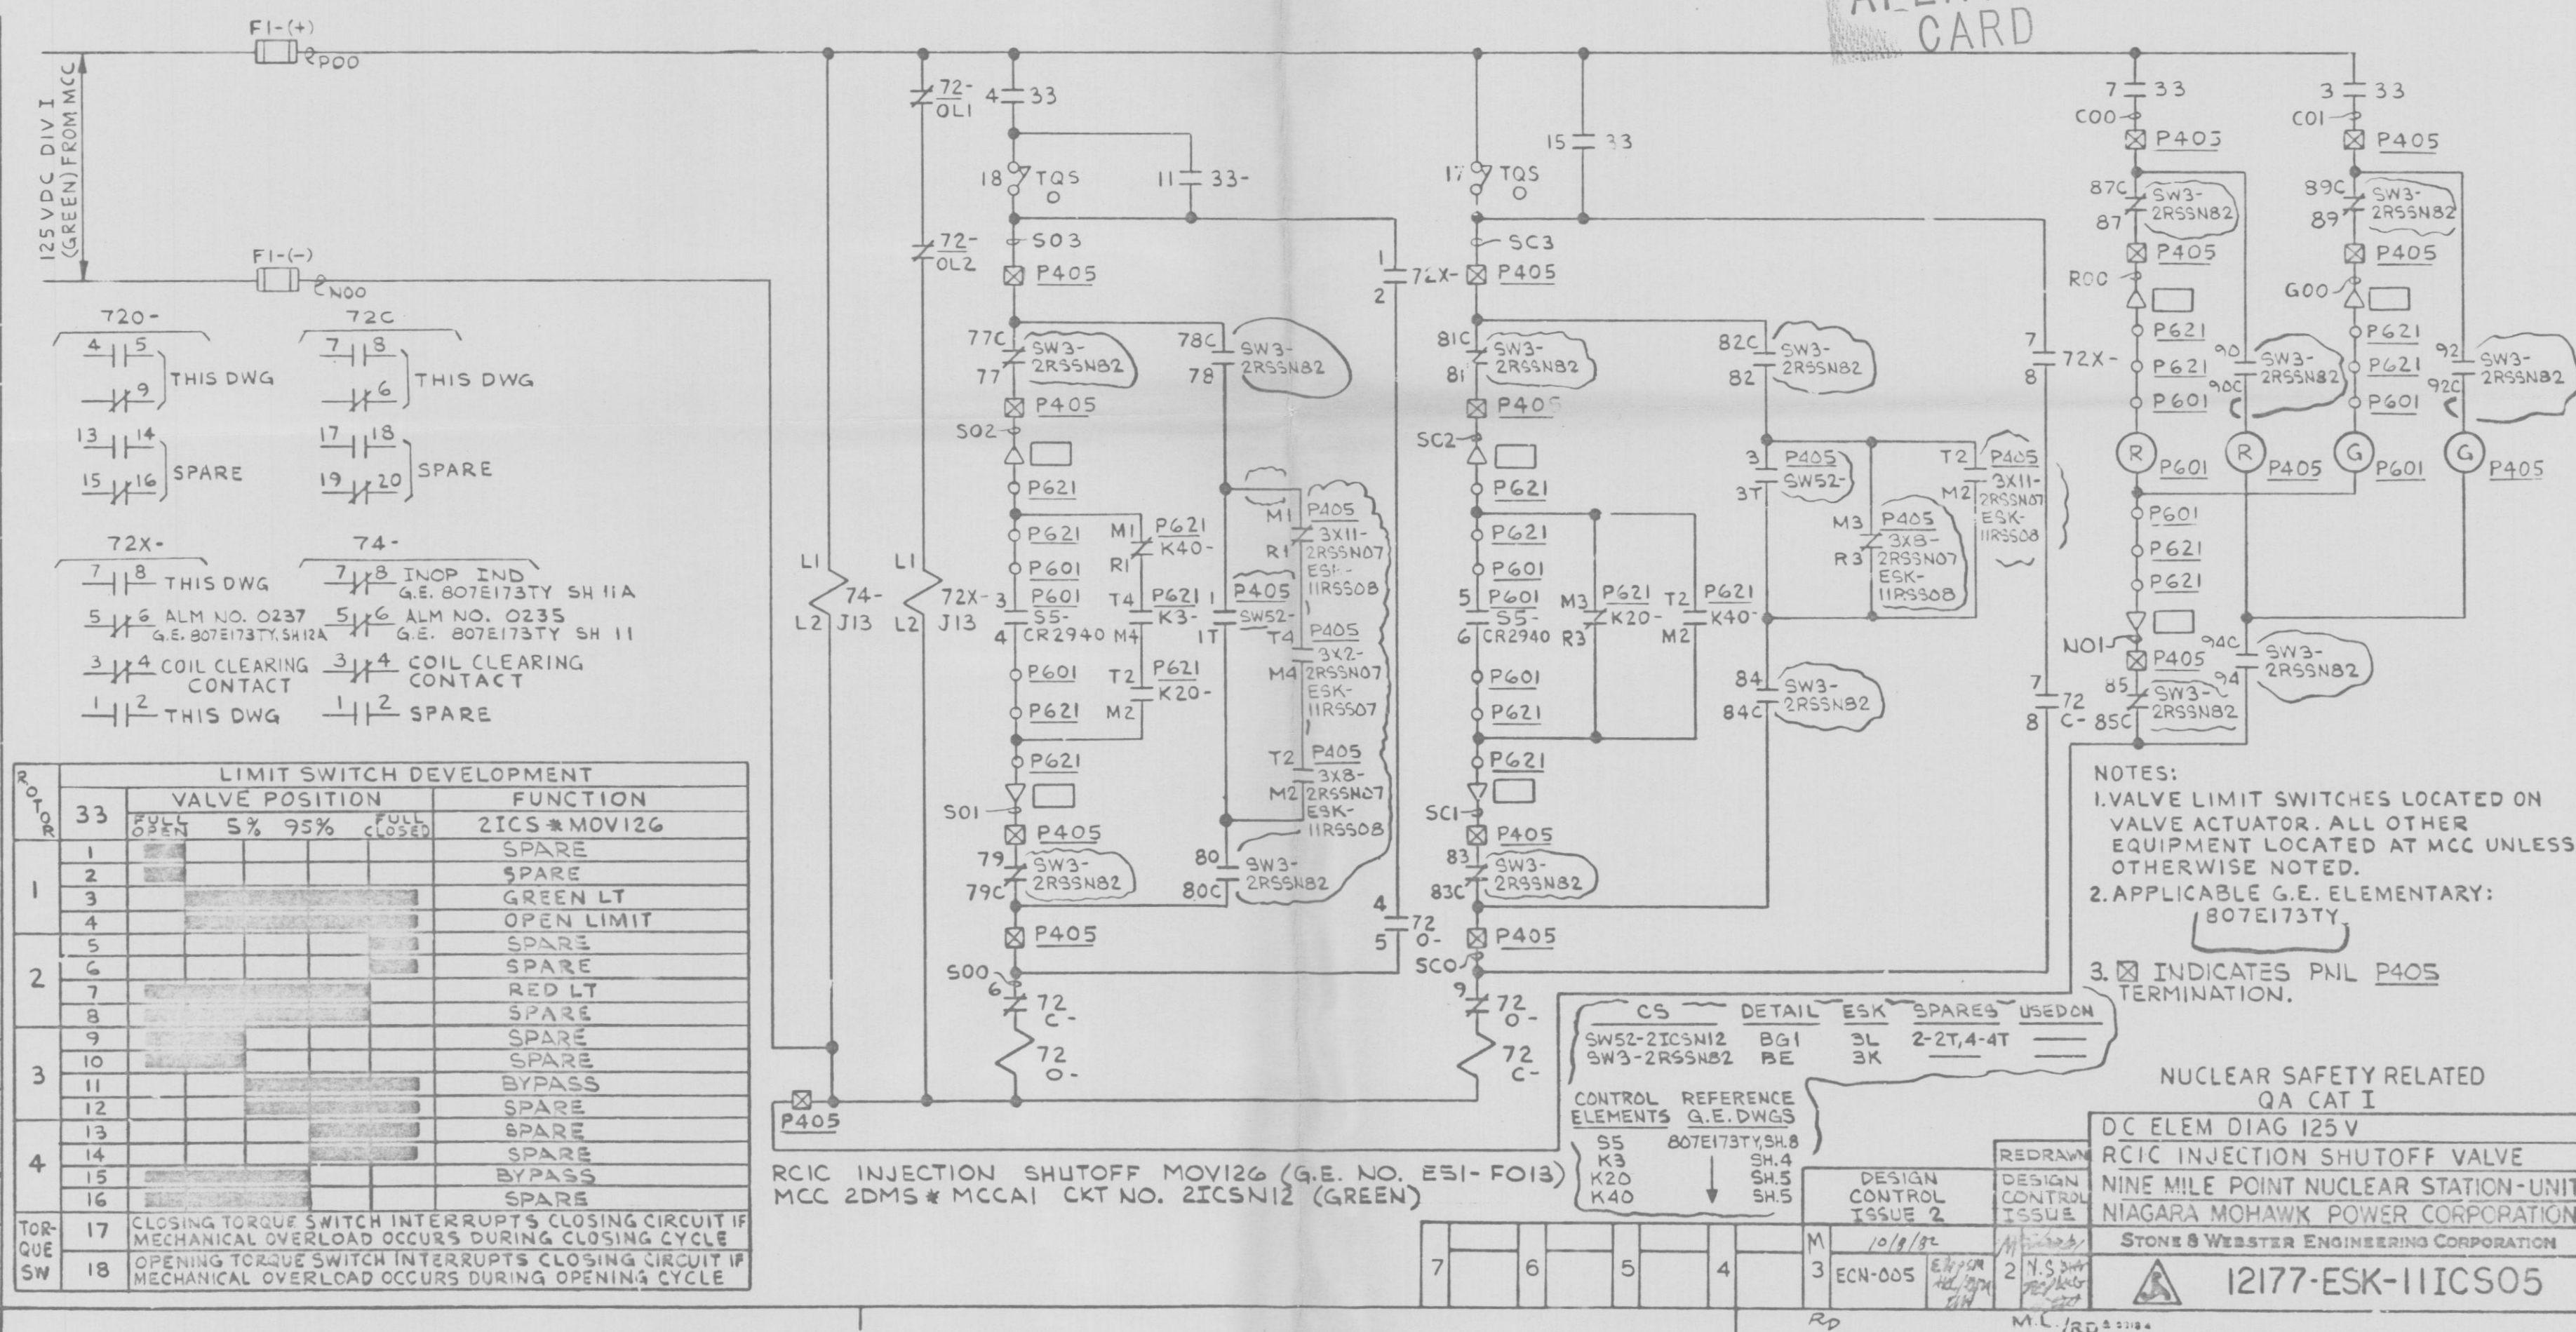

ROTOR		LIMIT SWITCH DEVELOPMENT				
		VALVE POSITION			FUNCTION	
	33	FULL OPEN	5%	95%	FULL CLOSED	
1	1	■				2ICS * MOV12G SPARE
	2	■				SPARE
	3		■	■	■	GREEN LT
	4		■	■	■	OPEN LIMIT
2	5				■	SPARE
	6				■	SPARE
	7		■	■	■	RED LT
	8		■	■	■	SPARE
3	9		■	■	■	SPARE
	10		■	■	■	SPARE
	11			■	■	BYPASS
	12			■	■	SPARE
4	13			■	■	SPARE
	14			■	■	SPARE
	15		■	■		BYPASS
	16		■	■		SPARE
TOR- QUE SW	17	CLOSING TORQUE SWITCH INTERRUPTS CLOSING CIRCUIT IF MECHANICAL OVERLOAD OCCURS DURING CLOSING CYCLE				
	18	OPENING TORQUE SWITCH INTERRUPTS CLOSING CIRCUIT IF MECHANICAL OVERLOAD OCCURS DURING OPENING CYCLE				

NOTES:

1. VALVE LIMIT SWITCHES LOCATED ON VALVE ACTUATOR. ALL OTHER EQUIPMENT LOCATED AT MCC UNLESS OTHERWISE NOTED.
2. APPLICABLE G.E. ELEMENTARY:
807E173TY
3. ☒ INDICATES PNL P405 TERMINATION.

NUCLEAR SAFETY RELATED
QA CAT I

DC ELEM DIAG 125 V
RCIC INJECTION SHUTOFF VALVE
NINE MILE POINT NUCLEAR STATION-UNIT
NIAGARA MOHAWK POWER CORPORATION
STONE & WEBSTER ENGINEERING CORPORATION

12177-ESK-11ICS05