

FROM:

Niagara Mohawk Power Corporation  
 Lycoming, New York 13093  
 P. J. Schneider

DATE OF DOCUMENT:

11-3-70

DATE RECEIVED

11-10-70

NO.:

3625

LTR.

MEMO:

PORT:

OTHER:

x

TO:

ORIG.:

CC:

OTHER:

1

Dr. Peter A. Morris

ACTION NECESSARY ☐CONCURRENCE ☐DATE ANSWERED: ~~11-10-70~~NO ACTION NECESSARY ☐COMMENT ☐

BY:

CLASSIF:

POST OFFICE

U

REG. NO:

FILE CODE:

50-220 - *Applic.*

DESCRIPTION: (Must Be Unclassified)

Ltr submitting pursuant to Para.  
 4.3.3(d) of Tech Specs..trans the  
 following:

REFERRED TO

DATE

RECEIVED BY

DATE

Ziemann

11-10-70

W/9 cys for ACTION

DISTRIBUTION:

ENCLOSURES:

Report - Primary Containment Integrated  
 Leak Test.

→ Regulatory File  
 AEC PDR

Compliance (2)

OGC(Rm P 506A)

H. Price &amp; Staff

D. Thompson

Morris/Schroeder  
 Skovholt

DeYoung

Boyd (4)

DTIE(Laughlin)

NSIC(Buchanan)

DO NOT REMOVE

ACKNOWLEDGED

3625

fod

REMARKS:

(38 cys rec'd)

See Reports Folder

U.S. ATOMIC ENERGY COMMISSION

MAIL CONTROL FORM FORM AEC-3265  
(8-60)


DC HQ1 BTUOAE

50-220

## NIAGARA MOHAWK POWER CORPORATION

NIAGARA  MOHAWK300 ERIE BOULEVARD WEST  
SYRACUSE, N.Y. 13202

November 3, 1970

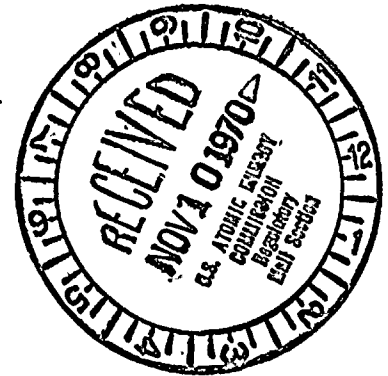

Dr. Peter A. Morris, Director  
Division of Reactor Licensing  
United States Atomic Energy Commission  
Washington, D. C. 20545

Dear Dr. Morris:

In the Technical Specifications for Nine Mile Point Nuclear Station, paragraph 4.3.3(d), we were required to conduct a primary containment integrated leak rate test within 12 months, plus or minus 8 months, of initial criticality. This test was conducted on June 27 + 28, 1970, (initial criticality was September 5, 1969), therefore within the time requirement.

We are pleased to report that at 22 psig, leakage by the reference method was 0.56% of the contained volume. The validity was checked at 0.57% by pump-back. Inasmuch as the allowable operational leak rate has been established as 0.87% from initial test data, the present test is well within allowable limits.


Enclosed are forty (40) copies of the test for your distribution.

Compliance with Technical Specifications would require the next testing of the containment during mid-1972.

Very truly yours,

F. J. Schneider  
Vice President - Operations

PAB/lrs  
Enclosures

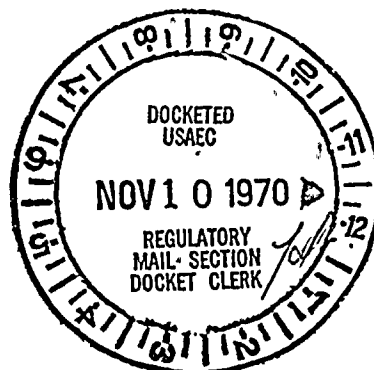

3625

