

FROM:

Niagara Mohawk Power Corp.
Syracuse, N.Y.
Minot H. Pratt

DATE OF DOCUMENT:

6-18-70

DATE RECEIVED

6-22-70

NO.:

1542

LTR.

MEMO:

REPORT:

OTHER:

X notarized 6-18-70

TO:

Morris

ORIG.:

CC:

OTHER:

1

ACTION NECESSARY ☐NO ACTION NECESSARY ☐CONCURRENCE ☐COMMENT ☐

DATE ANSWERED:

BY:

CLASSIF:

POST OFFICE

U

REG. NO:

FILE CODE:

50-220

Input form

H G P L

DESCRIPTION: (Must Be Unclassified)

Ltr requesting Amdt to ltr DPR-17 for...
for an increase in the maximum quantity
of Antimony 122-124, which may be
possessed at any one time

ENCLOSURES:

REFERRED TO

DATE

RECEIVED BY

DATE

Ziemann

6-23-70

W/9 cys for action

DISTRIBUTION

Reg file cy
AEC PDR

Compliance (2)
OGC Room P-505-a

Bkovholt
DeYoung

Boyd (4 cys)

D. Thompson
N. Dube

DHE- Laughlin

NSIC- Buchanan

REMARKS:


ACKNOWLEDGED
DO NOT REMOVE

1942

FEL

U.S. ATOMIC ENERGY COMMISSION

MAIL CONTROL FORM FORM AEC-3265 (8-60)


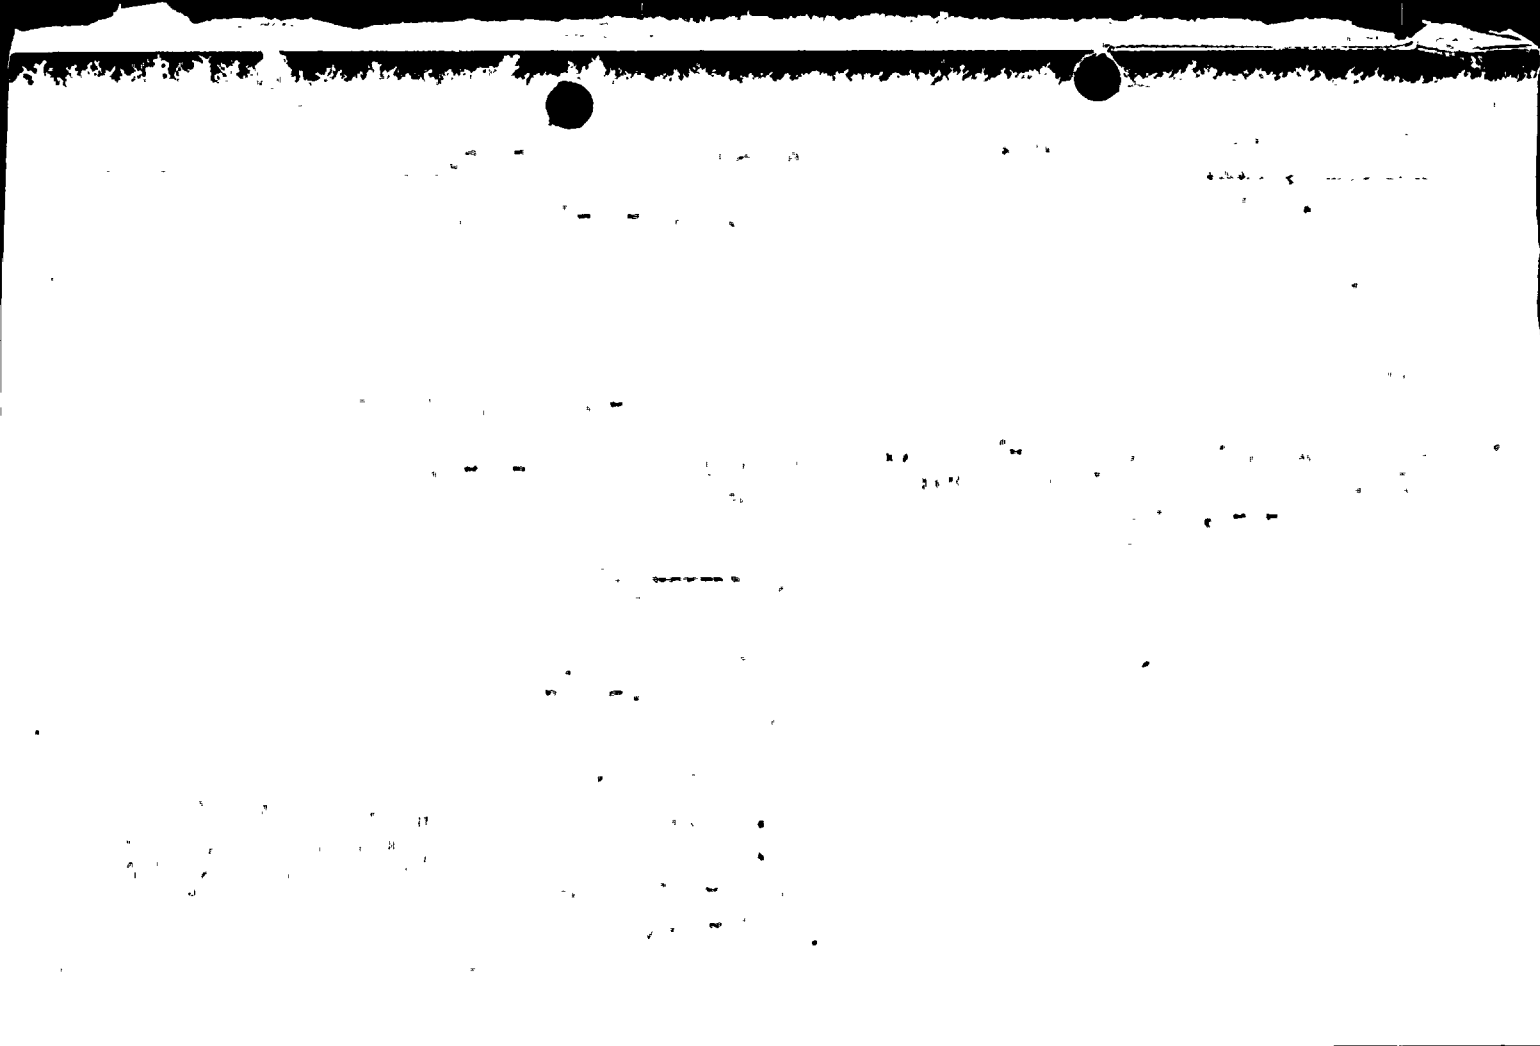


NIAGARA MOHAWK POWER CORPORATION

NIAGARA  MOHAWK

300 ERIE BOULEVARD WEST
SYRACUSE, N.Y. 13202

June 18, 1970

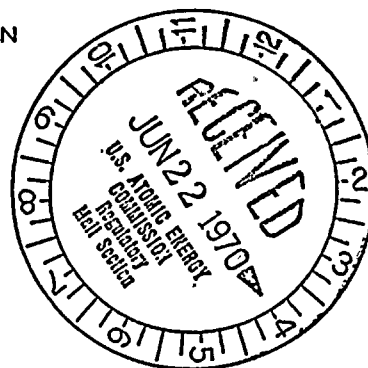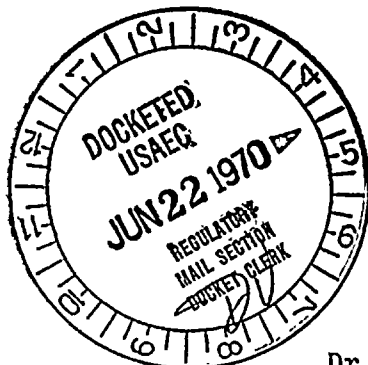

Dr. Peter A. Morris, Director
Division of Reactor Licensing
United States Atomic Energy Commission
Washington, D. C. 20545

Dear Dr. Morris:

Re: Provisional Operating License DPR-17
Docket No. 50-220

An amendment to Provisional Operating License DPR-17 is requested providing for an increase in the maximum quantity of Antimony 122-124, which may be possessed at any one time.

Provision 2.C presently limits the quantity of Antimony 122-124 to 12,500 curies as five sealed sources not to exceed 2,500 curies each. It is requested to raise the allowable limit to 25,000 curies as ten sealed sources not to exceed 2,500 curies each.

The reason for the change is to allow five additional sources to be on hand in the event the existing sources within the reactor have to be replaced. Replacement may be required due to decrease in source activity as a result of an extended shutdown. Non-reactor storage of the Antimony shall be in its original shipping cask or suitable container in the spent fuel pool.


Very truly yours,



Minot H. Pratt
Vice President and
Executive Engineer

Subscribed and sworn to before me this 18th day of June 1970

kp

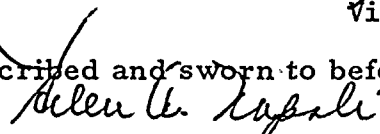

HELEN A. NAPOLI

Notary Public in the State of New York
Qualified in Onondaga Co. No. 34-8097225
My Commission Expires March 30, 1972

June 18, 1970

762
1942
762

