

MAY 21 1973

Docket No. 50-220

Niagara Mohawk Power Corporation  
ATTN: Mr. Philip D. Raymond  
Vice President - Engineering  
300 Erie Boulevard West  
Syracuse, New York 13202

Gentlemen:


Our letter to you dated March 26, 1971, requested that you submit, as a supplement to your Final Safety Analysis Report (FSAR), a description of your quality assurance program for the Nine Mile Point Nuclear Station Unit No. 1 (NMP-1). Appendix B of 10 CFR 50 was indicated as the criteria for a quality assurance program for design, construction, and operation of the structures, systems, and components of the facility. In particular, we were interested in determining to what extent your quality assurance program covers such activities as operation, maintenance, repair, refueling, and modifications.

Your reply dated June 21, 1971, was submitted as the Ninth Supplement to the FSAR. In addition, you briefly addressed this subject in your application dated July 5, 1972, for conversion from the provisional operating license to a full-term operating license. We have evaluated these submittals against the criteria of Appendix B of 10 CFR 50 as each applies to quality assurance during operation of NMP-1.

As you may be aware, Regulatory Guide No. 1.33, Quality Assurance Program Requirements (Operation), was issued on November 3, 1972. The Guide references AINS 3.2, Standard for Administrative Controls for Nuclear Power Plants, and ANSI N45.2-1971, Quality Assurance Program Requirements for Nuclear Power Plants. Conformance with these standards will provide an adequate basis for complying with Appendix B of 10 CFR Part 50.

Please reassess your quality assurance program as it applies to the plant operation and maintenance, in light of Regulatory Guide No. 1.33 and the above comments, and resubmit a description of the program that

109

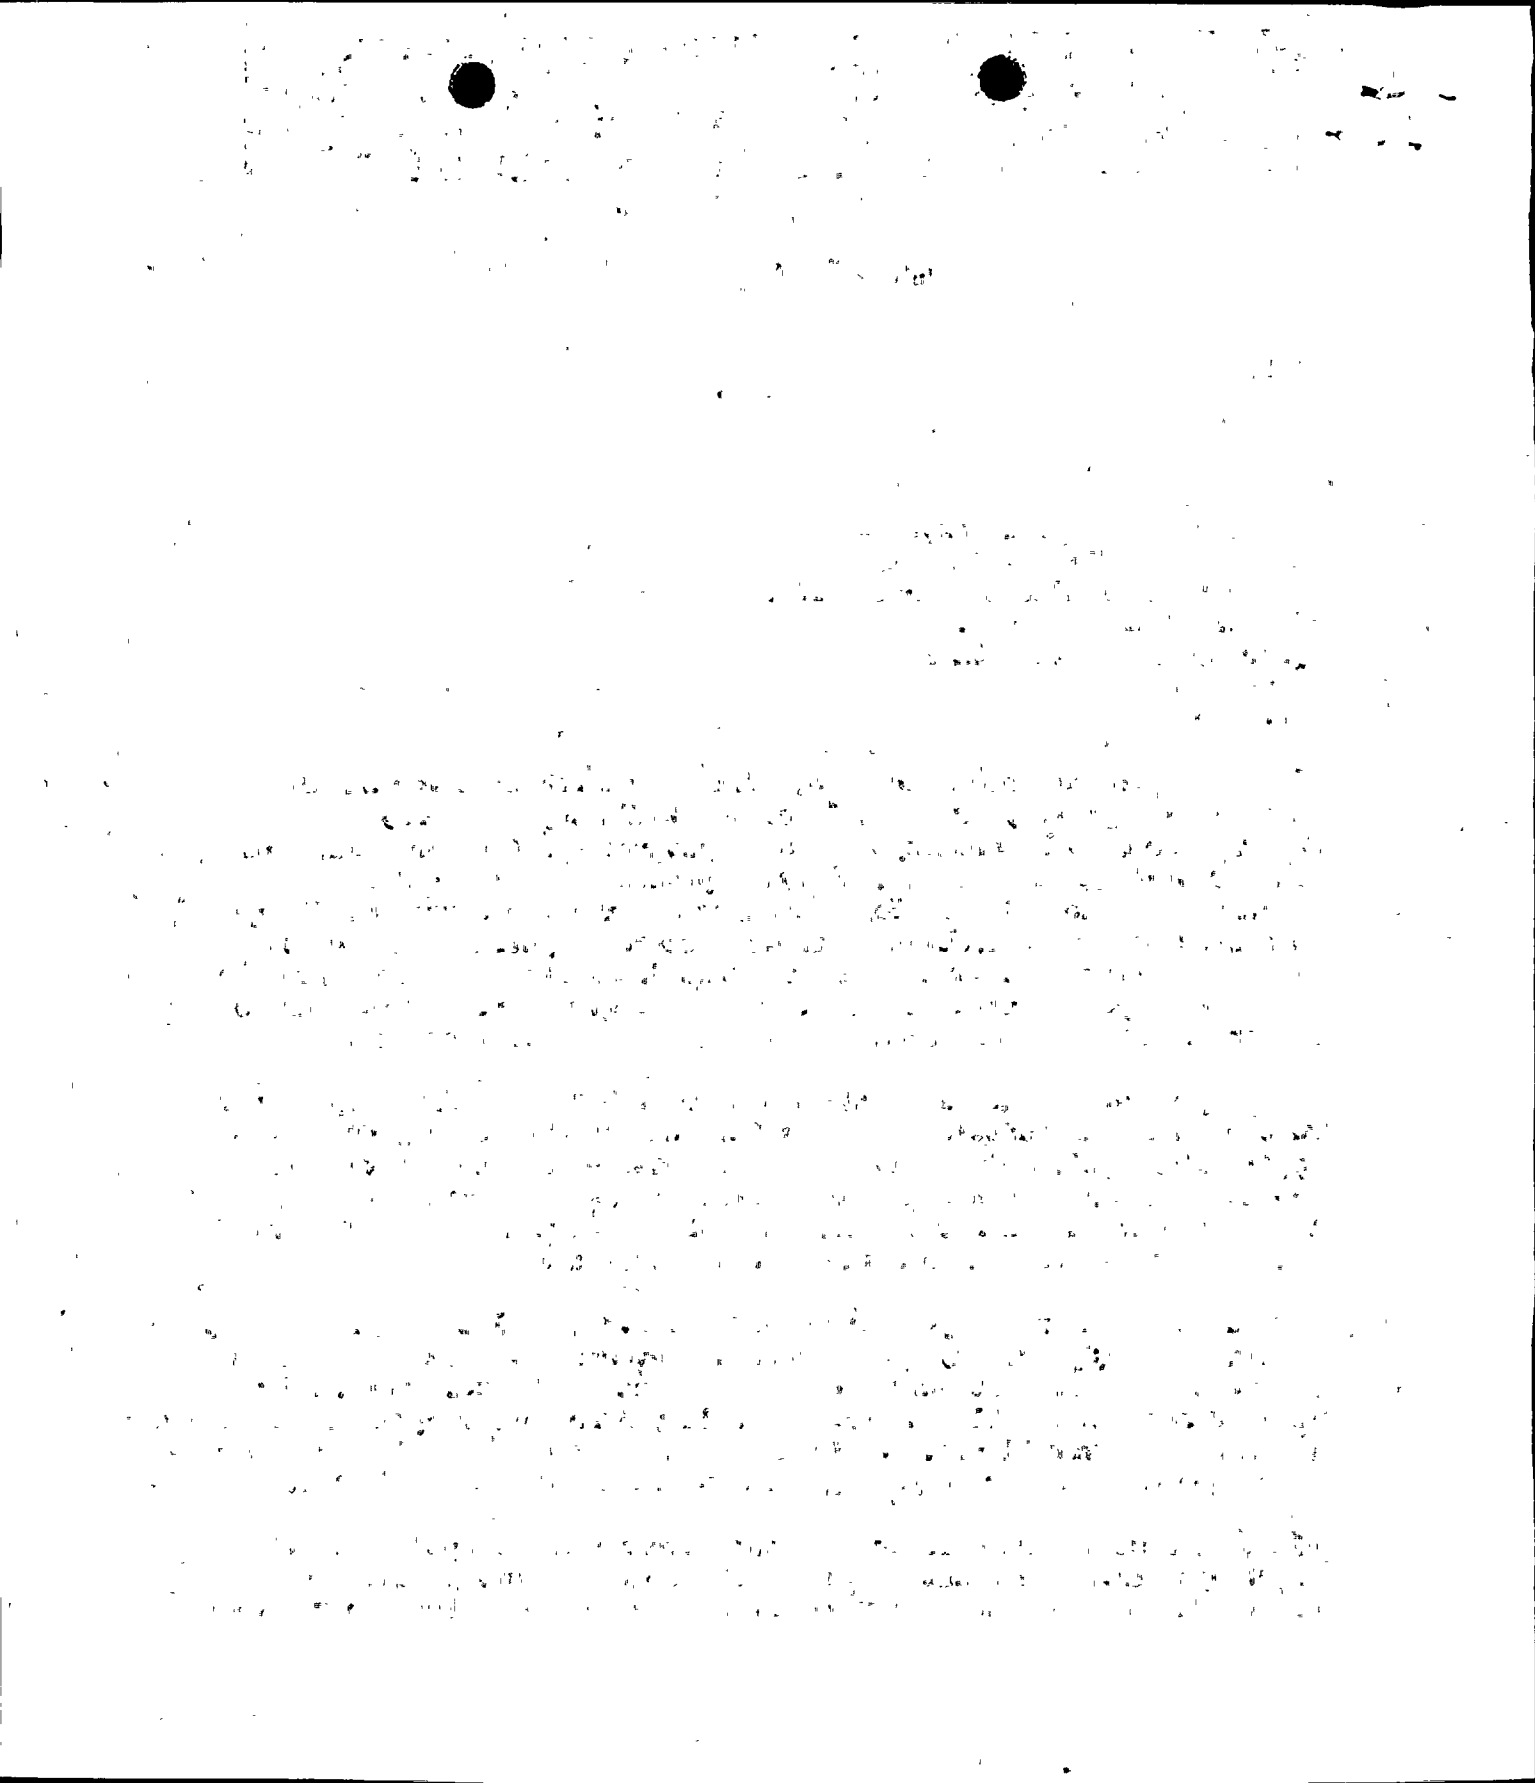

MAY 21 1973

is responsive to the guide. Deviation from ANS 3.2 or ANSI N45.2-1971 must be described in detail and adequately justified. Where reference is made in the discussion that the requirement is satisfied by a statement in the Technical Specifications, a specific reference to the appropriate subsection of the Technical Specifications should be made.

The above information should be submitted within 90 days of the date of this letter as a supplement to your application for conversion from a provisional operating license to a full-term operating license. Three signed and notarized originals and thirty-seven additional copies of your submittal should be provided.

Sincerely,

Original signed by  
Dennis L. Ziemann

Dennis L. Ziemann, Chief  
Operating Reactors Branch #2  
Directorate of Licensing

cc: J. Bruce MacDonald, Esquire  
Deputy Commissioner and Counsel  
New York State Department of  
Commerce and Counsel to the  
Atomic Energy Council

Arvin E. Upton, Esquire  
LeBoeuf, Lamb, Leiby & MacRae

Dr. William Seymour  
Staff Coordinator  
New York State Atomic Energy Council  
New York State Department of Commerce

Oswego City Library

Distribution

✓ Docket File  
AEC PDR  
Local PDR  
RP Reading  
Branch Reading  
JRBuchanan, ORNL  
DJSkovholt, L:OR  
TJCarter, L:OR  
ACRS (16)  
RO (3)  
Bordenick, OGC  
Haflich, OGC  
DLZiemann, L:ORB #2  
CJDeBevec, L:ORB #2  
RMDiggs, L:ORB #2  
RWHouston, L:OSB  
JRSears, L:OSB

OFFICE ▶	L:ORB #2 X7403	L:ORB #2	L:ORB #2			
SURNAME ▶	CJDeBevec:sjh	RMDiggs	DLZiemann			
DATE ▶	5/17/73	5/17/73	5/21/73			

