


SPAN 1010'	
INITIAL SAG DATA	REMARKS
30' 60' 90'	
33'5" 35'1" 36'9"	CONDUCTOR
32'8" 33'8" 34'8"	O.H.G.W.

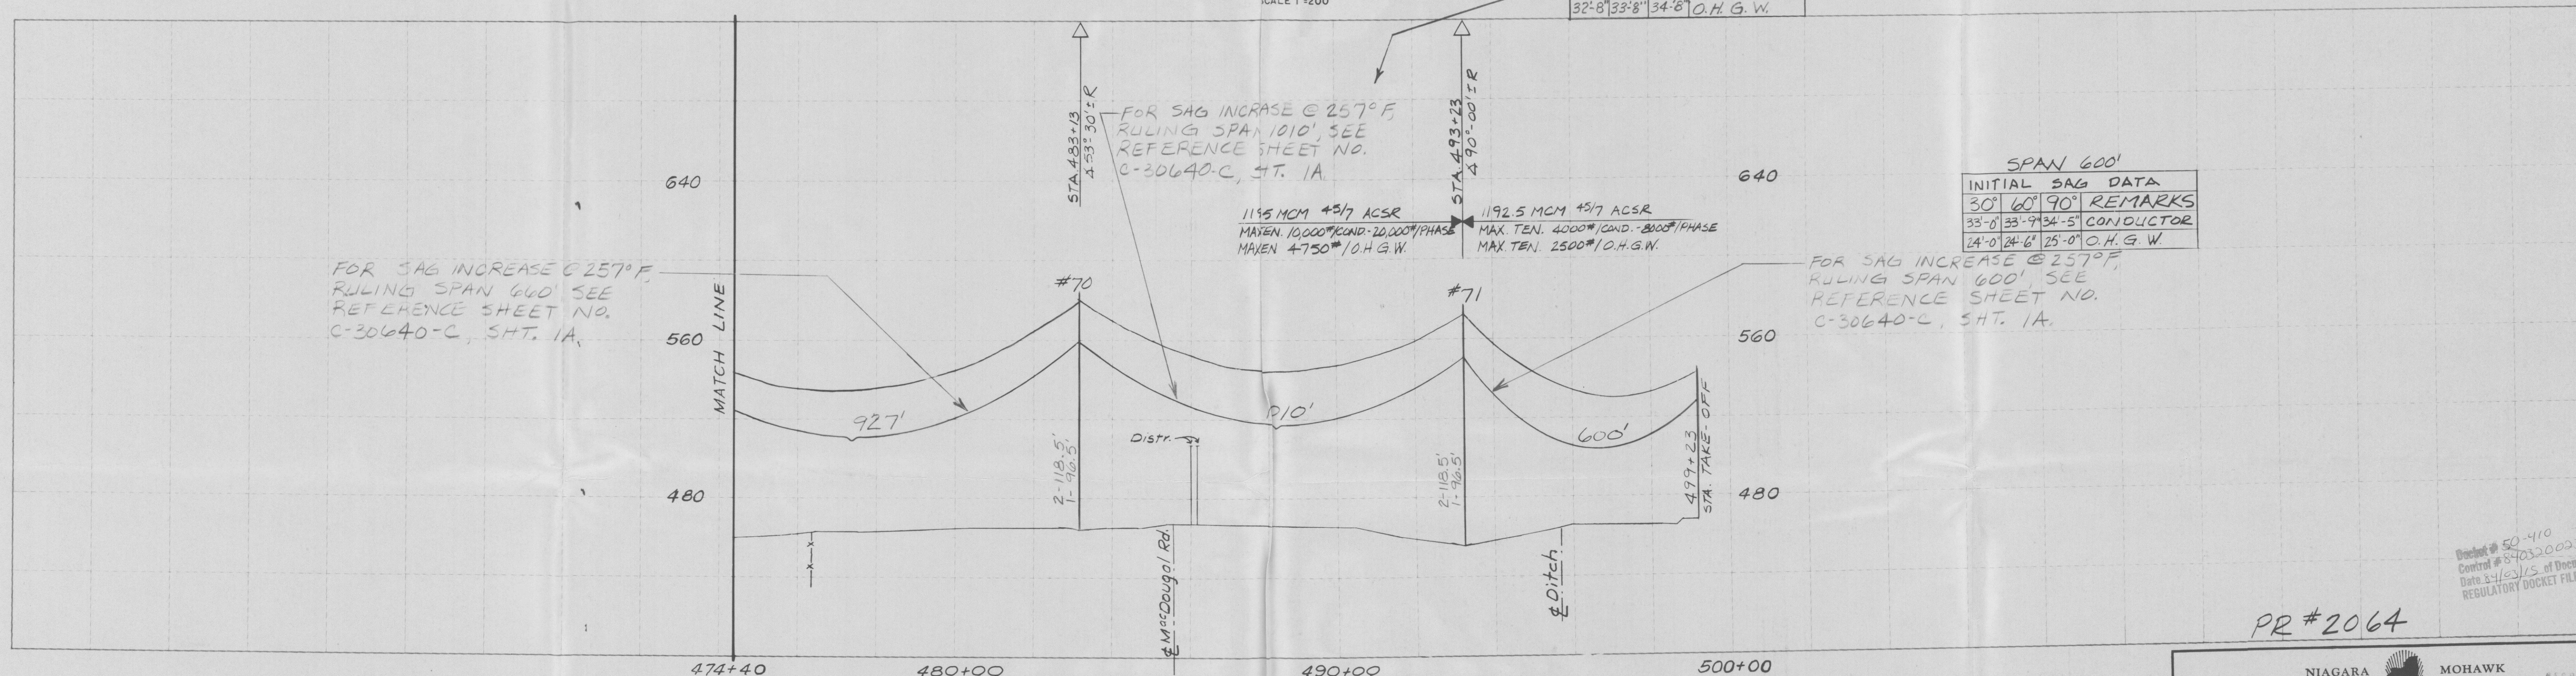

SPAN 600'	
INITIAL SAG DATA	REMARKS
30' 60' 90'	
33'0" 33'9" 34'5"	CONDUCTOR
34'0" 34'6" 35'0"	O.H.G.W.

PROFILE
 SCALES: HORZ. 1" = 200'
 VERT. 1" = 40'

NOTE:
 FOR ALL PROPERTY INFORMATION
 SEE DRAWING NO. C-20112-C.

TI
 APERTURE
 CARD

8403210171 E

RIGHT-OF-WAY APPROVED *John R. Miller, 9-2-83*

NO.		DATE	BY	DESCRIPTION OF REVISION	CK.	APP.	APP.
1	12-14-83	UB		FIRST ISSUE	B.T. K.	APP. <i>[Signature]</i>	APP. <i>[Signature]</i>

NIAGARA MOHAWK POWER CORPORATION SYRACUSE, N.Y.	
NINE MILE TRANSMISSION COMPLEX 345KV	
SCRIBA - VOLNEY #21	
MOAIC	
345KV-3#-60~	SINGLE CIRCUIT
B. Thorpe DES.	DATE 8-29-83
SCALE 1" = 200'	INDEX 6.2-S18-M5
NO. C-39195-C	

Product # 50-410
 Control # 5403200033
 Date 2/15/15 of Document
 REGULATORY DOCKET FILE

PR #2064