



- NOTE:
1. Clear 3 ft. beyond limits of excavation for level spreader.

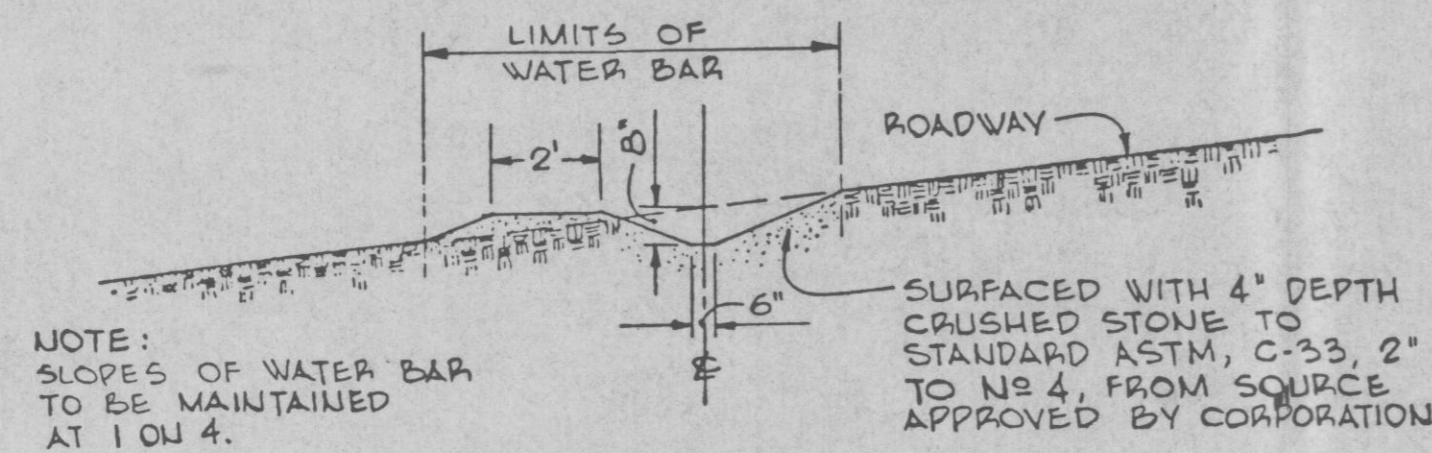

SECTION A-A (SK-1)
(THROUGH WATER BAR)

NOTE:


| Road Slope % | Water Bar Spacing - ft. |
|--------------|-------------------------|
| 2 | 250 |
| 5 | 135 |
| 10 | 80 |
| 15 | 60 |

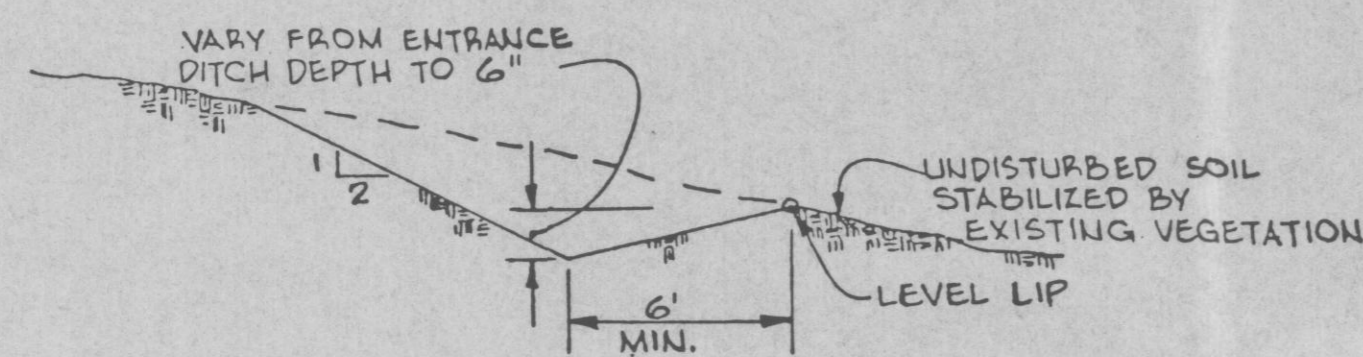

SECTION B-B (SK-1)
(THROUGH LEVEL SPREADER)

NOTES:

1. Length of Spreader Feet
15
20
26
34
44
Contributing Drainage Area Acres
≤ 1.5
1.5 to 4
4 to 6
6 to 9
9 to 14
2. All disturbed soil to be stabilized, mulched and seeded subject to approval of Corporation.
3. Level lip to be maintained at constant elevation over full length of spreader.

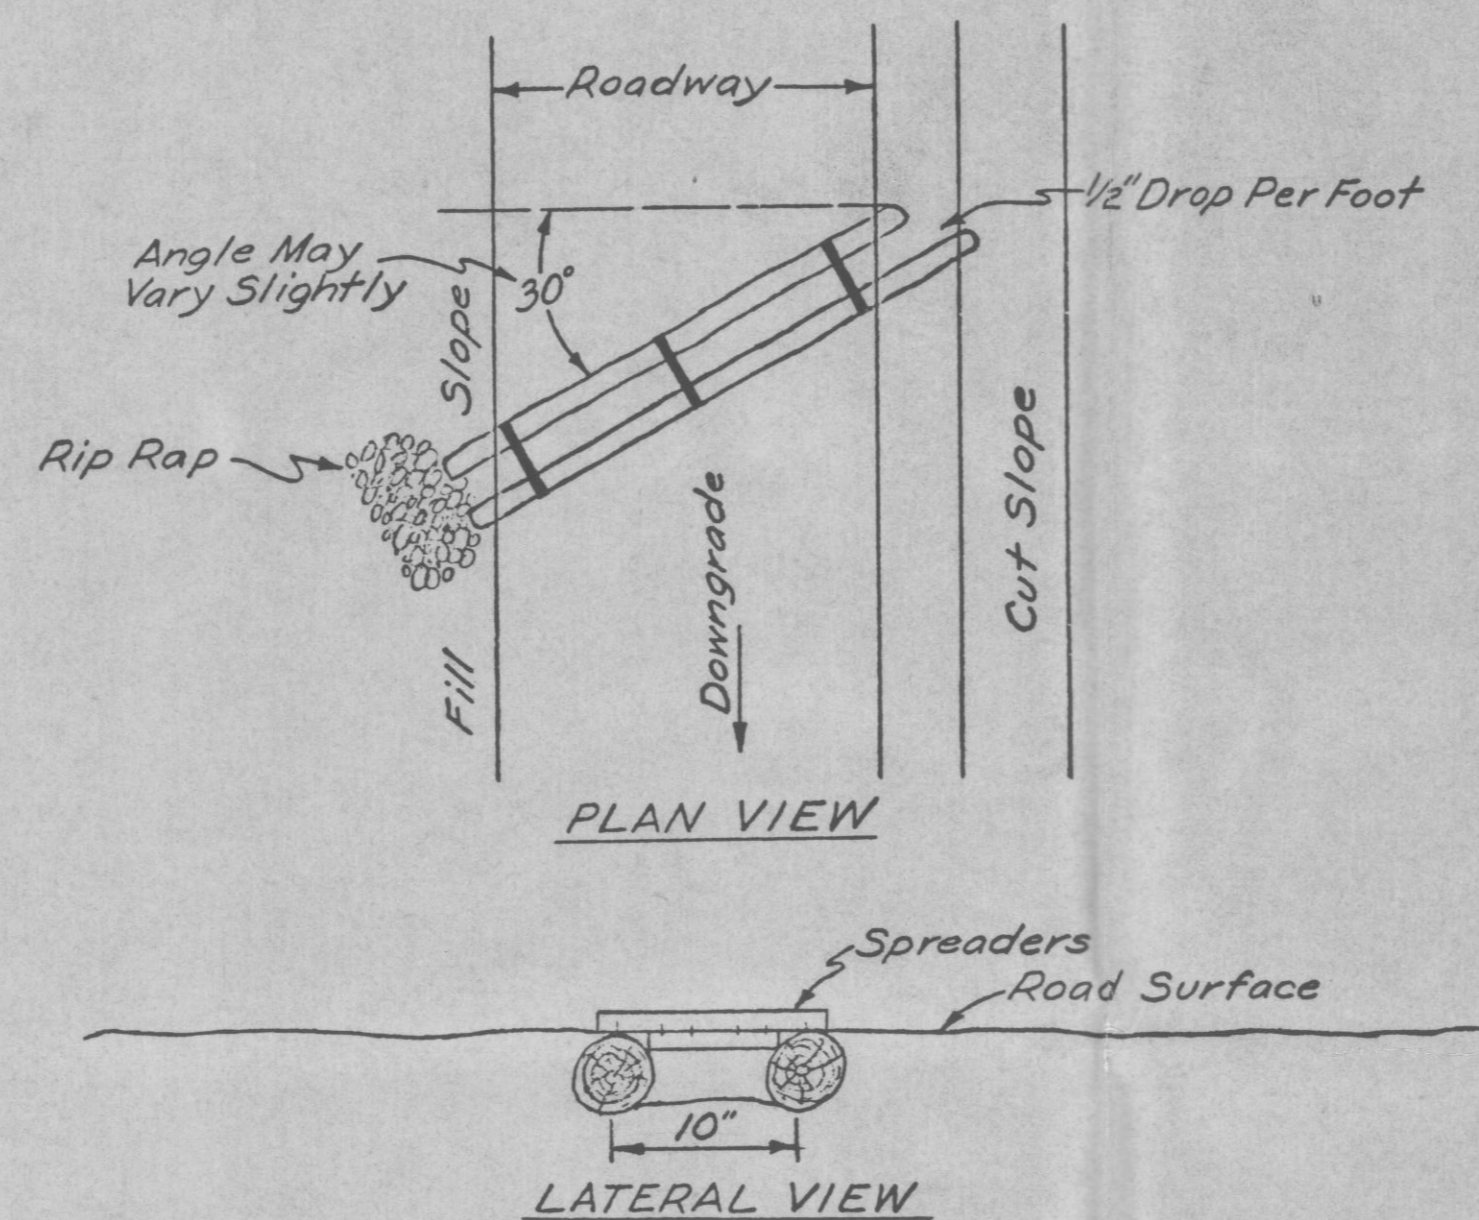


OPEN TOP LOG CULVERT


NOTES:

1. Log Culverts May Be Substituted For Waterbars, Where Directed By The Right-Of-Way Manager.
2. Spreaders Should Be Construction Grade 4" x 4" Lumber, Securely Fastened With Steel Spikes.
3. Recommended Distances Between Open Top Culverts.

| Percent | Spacing |
|---------|-----------|
| 2-5 | 300 - 500 |
| 6-10 | 200 - 300 |
| 11-15 | 100 - 200 |

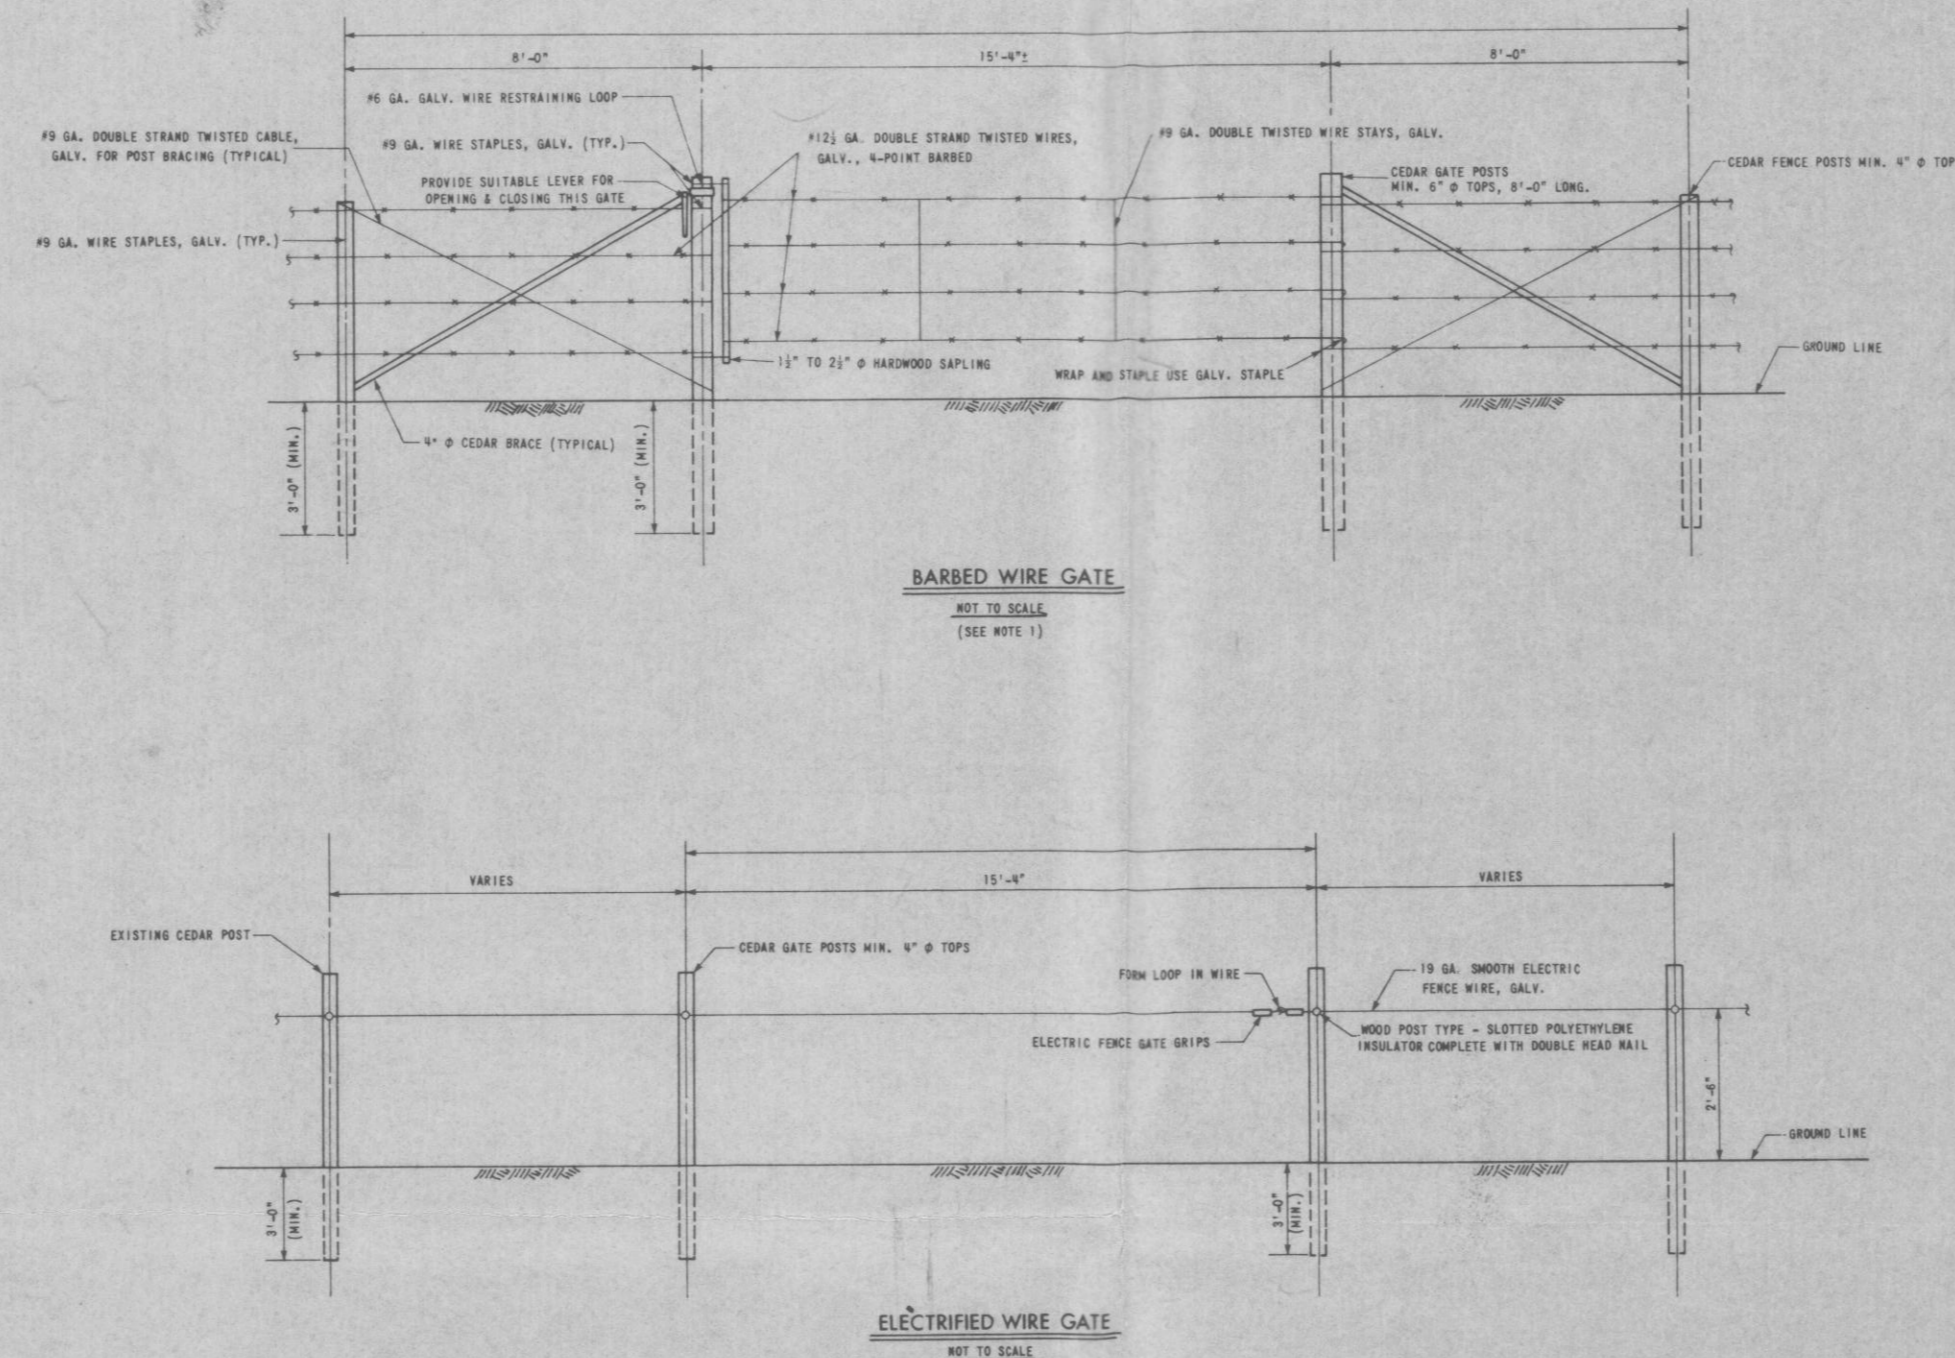


Gate Frames & Posts Shall Be Of A.S.T.M. A-120 Hot Dipped Galv. Pipe Or Appr. Equal

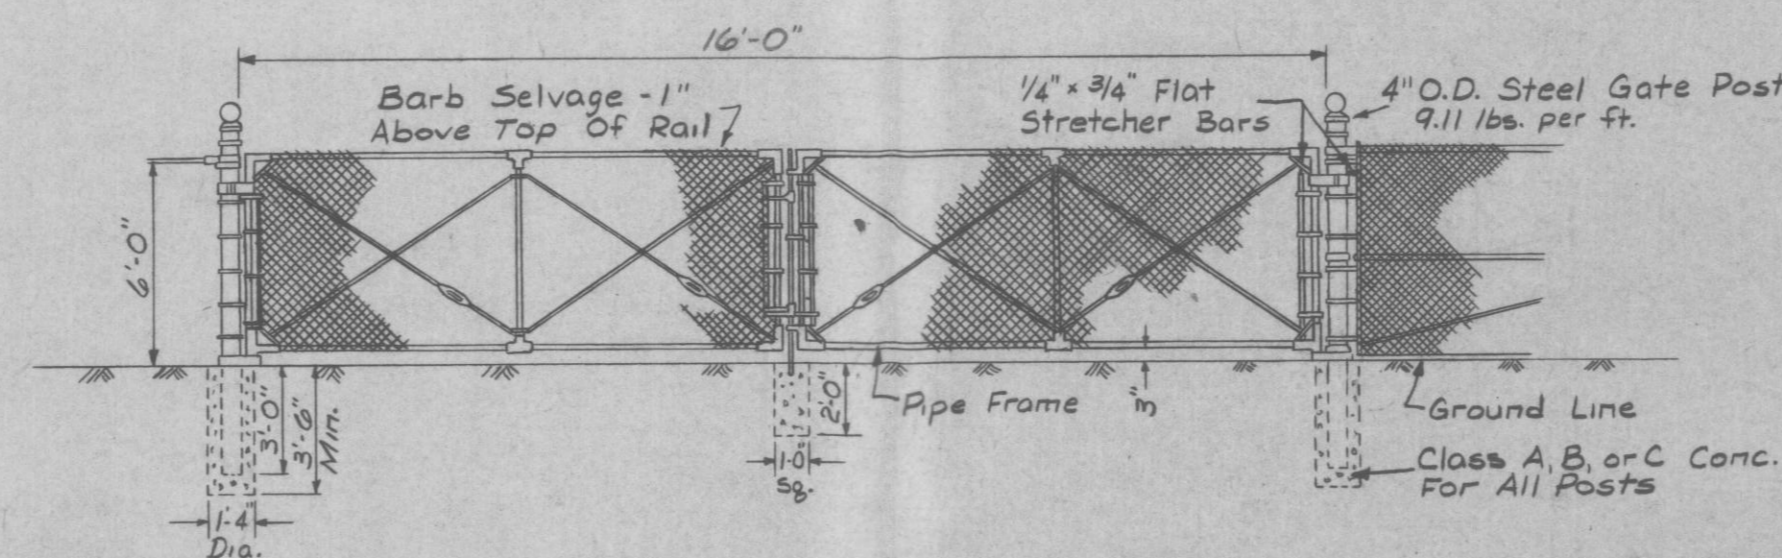


DOUBLE SWING GATE
New York State D.O.T. Steel Chain Link Fence Gate
Not To Scale

GATES AND DETAILS

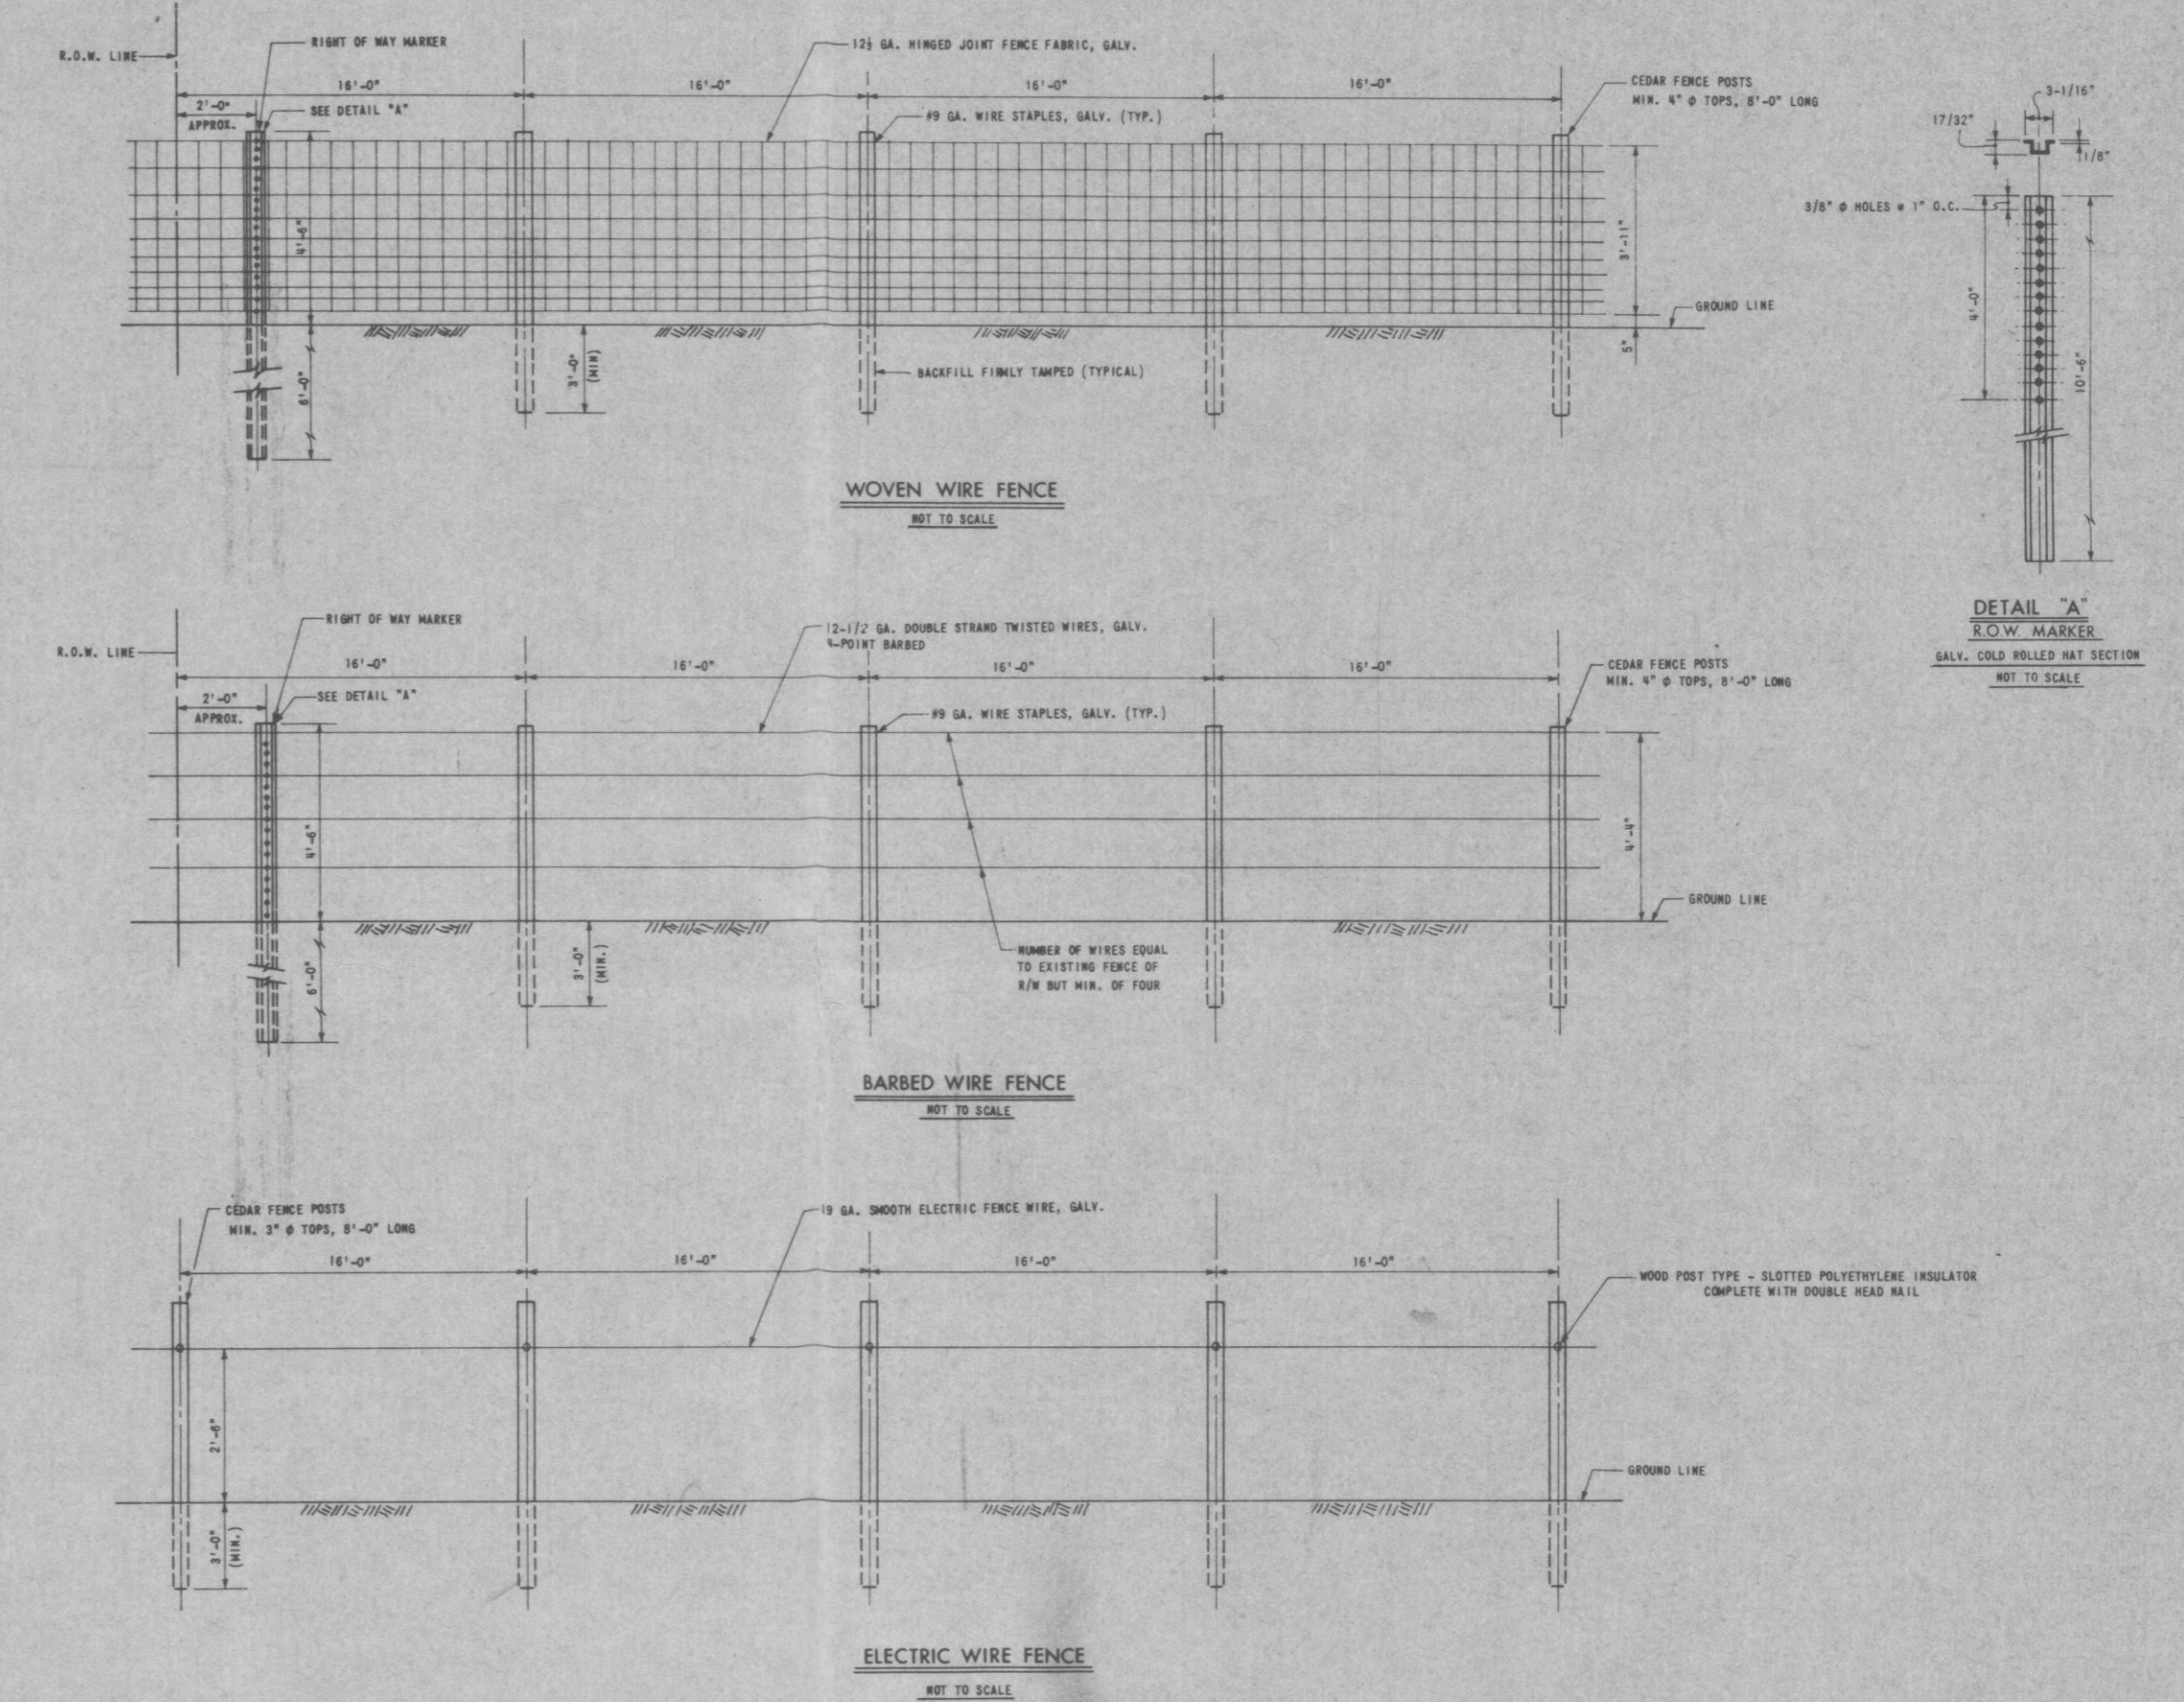

FENCES AND DETAILS

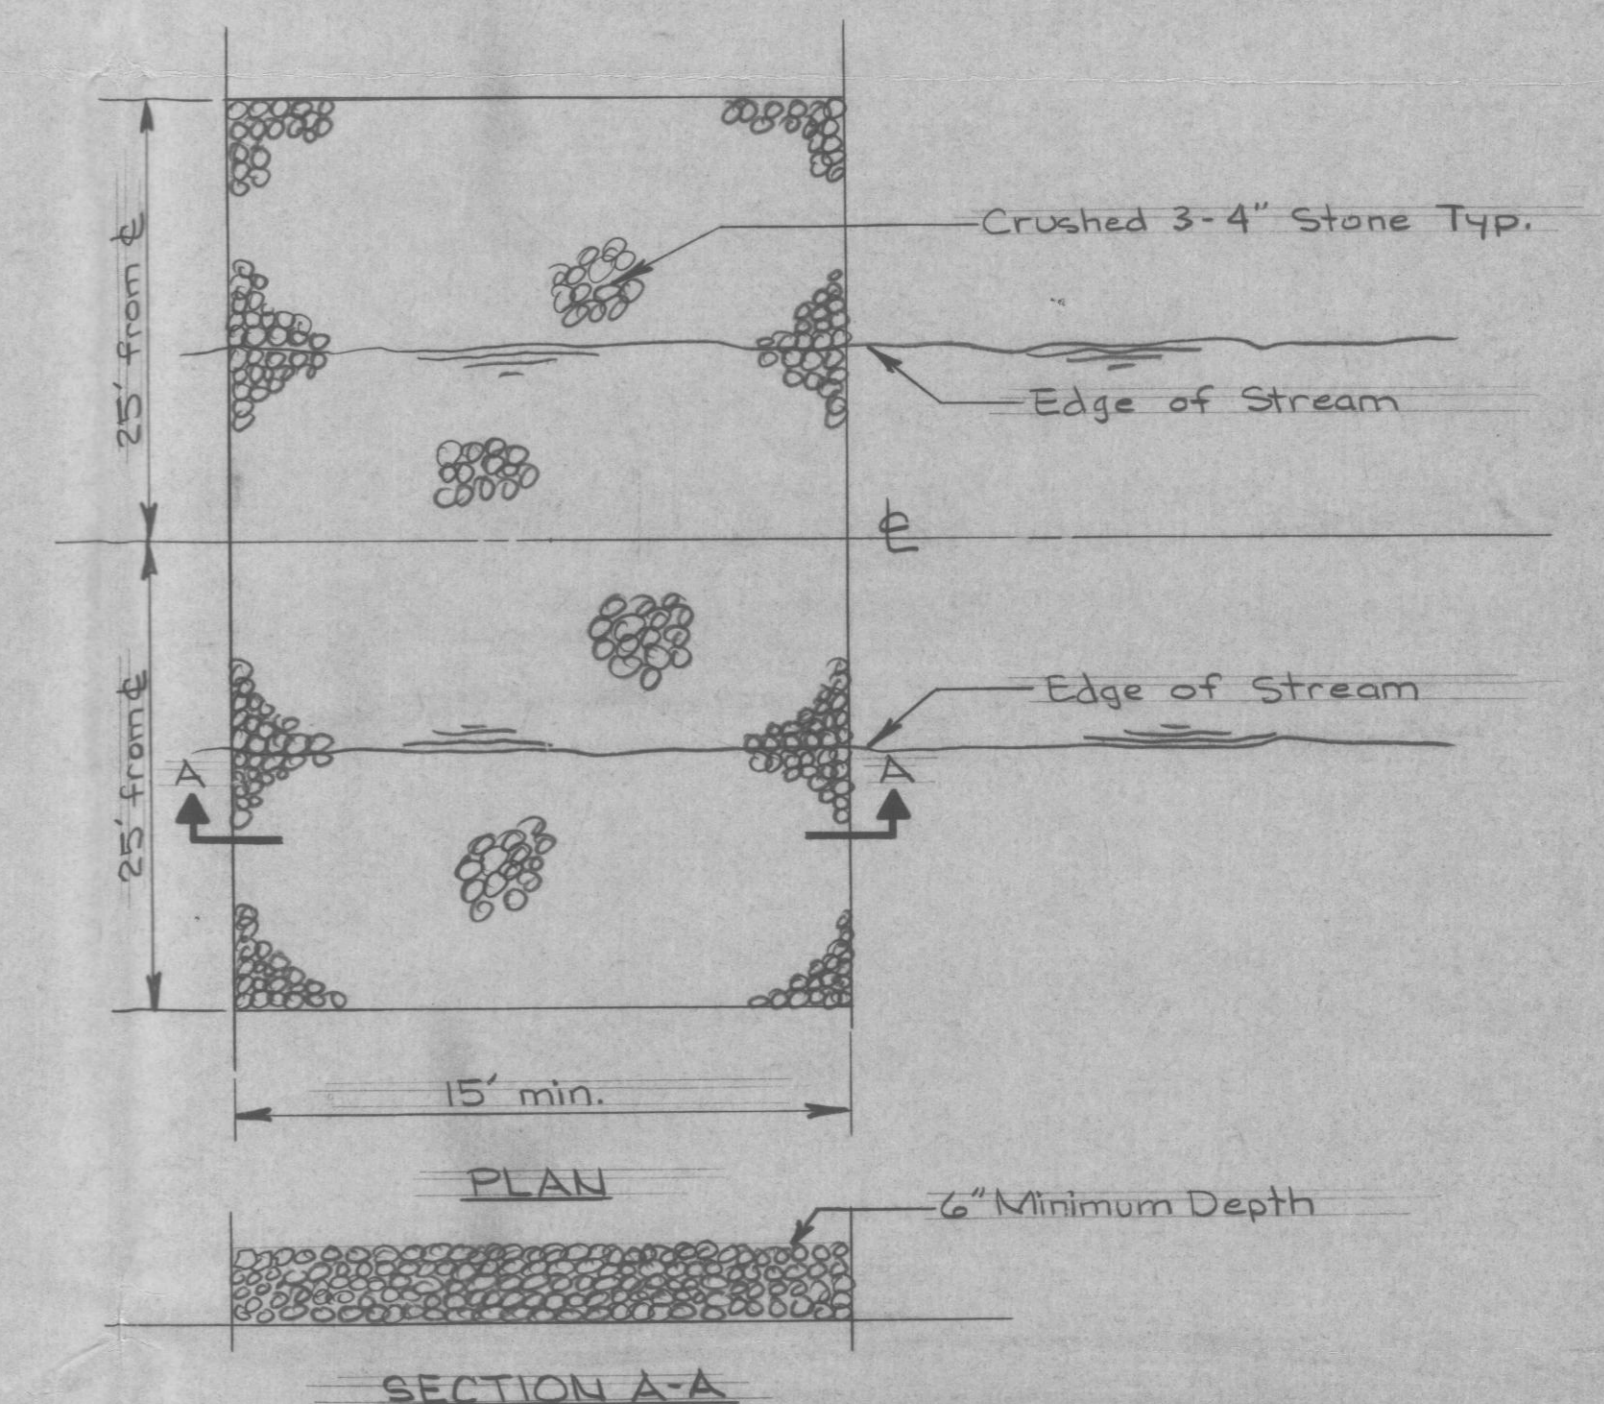

STONE FORD

TI
APERTURE
CARD

3403210176 E

| | | | | | |
|-----|------|----|-------------------------|-----|------|
| NO. | DATE | BY | DESCRIPTION OF REVISION | CR. | APP. |
| | | | | | |
| | | | | | |
| | | | | | |

| | |
|---|--------------------|
| NIAGARA MOHAWK | |
| NIAGARA MOHAWK POWER CORPORATION SYRACUSE, N. Y. | |
| SYSTEM TRANSMISSION | |
| RIGHT-OF-WAY IMPROVEMENT DETAILS | |
| DATE 2-8-77 | SCALE NOT TO SCALE |
| INDEX 6.0-1-M49 | NO. C-31245-C |
| SHEET 2 OF 2 | |