

BEFORE THE
UNITED STATES NUCLEAR REGULATORY COMMISSION

In the Matter of

:

PENNSYLVANIA POWER &
LIGHT COMPANY

:

Docket No. 50-387

PROPOSED AMENDMENT NO. 57

FACILITY OPERATING LICENSE NO. NPF-14

SUSQUEHANNA STEAM ELECTRIC STATION
UNIT NO. 1

Licensee, Pennsylvania Power & Light Company, hereby files proposed Amendment No. 57 to its Facility Operating License No. NPF-14 dated July 17, 1982.

This amendment contains a revision to the Susquehanna SES Unit 1 Technical Specifications.


PENNSYLVANIA POWER & LIGHT COMPANY
BY:



N. W. Curtis

Vice President - Engineering &
Construction - Nuclear

Sworn to and subscribed before me
this 10th of December, 1984.


MARSHA C. BANTZ, Public Notary
Allentown, Lehigh County, Pa.
My Commission Expires Jan. 13, 1986

8412180623 841206
PDR ADDCK 05000387
P PDR

1947

1948

1949

1950

1951

1952

1953

1954

1955

1956

1957

1958

1959

1960

1961

1962

1963

1964

1965

1966

1967

1968

1969

1970

1971

1972

1973

1974

1975

1976

1977

1978

1979

1980

1981

BEFORE THE
UNITED STATES NUCLEAR REGULATORY COMMISSION

In the Matter of

:

PENNSYLVANIA POWER &
LIGHT COMPANY

:

Docket No. 50-388

PROPOSED AMENDMENT NO. 12

FACILITY OPERATING LICENSE NO. NPF-22

SUSQUEHANNA STEAM ELECTRIC STATION
UNIT NO. 2

Licensee, Pennsylvania Power & Light Company, hereby files proposed Amendment No. 12 to its Facility Operating License No. NPF-22 dated March 23, 1984.

This amendment contains a revision to the Susquehanna SES Unit 2 Technical Specifications.

PENNSYLVANIA POWER & LIGHT COMPANY
BY:



N. W. Curtis

Vice President - Engineering &
Construction - Nuclear

Sworn to and subscribed before me
this 16th of December, 1984.



Notary Public

MARTHA G. BARTO, Notary Public
Allentown, Lehigh County, Pa.
My Commission Expires Jan. 13, 1986

THE UNITED STATES OF AMERICA
DEPARTMENT OF THE INTERIOR

WASHINGTON, D. C.

OFFICE OF THE SECRETARY

WASHINGTON, D. C.

TO THE HONORABLE SECRETARY OF THE INTERIOR

FROM THE SECRETARY OF THE INTERIOR

RE: [illegible]

[illegible]

[illegible]

[illegible]

[illegible]

[illegible]

[illegible]


[illegible]

[illegible]

[illegible]

FIGURE ONE


CHANNEL A 125V DC
SINGLE LINE DIAGRAM
(TYPICAL OF 4 CHANNELS)

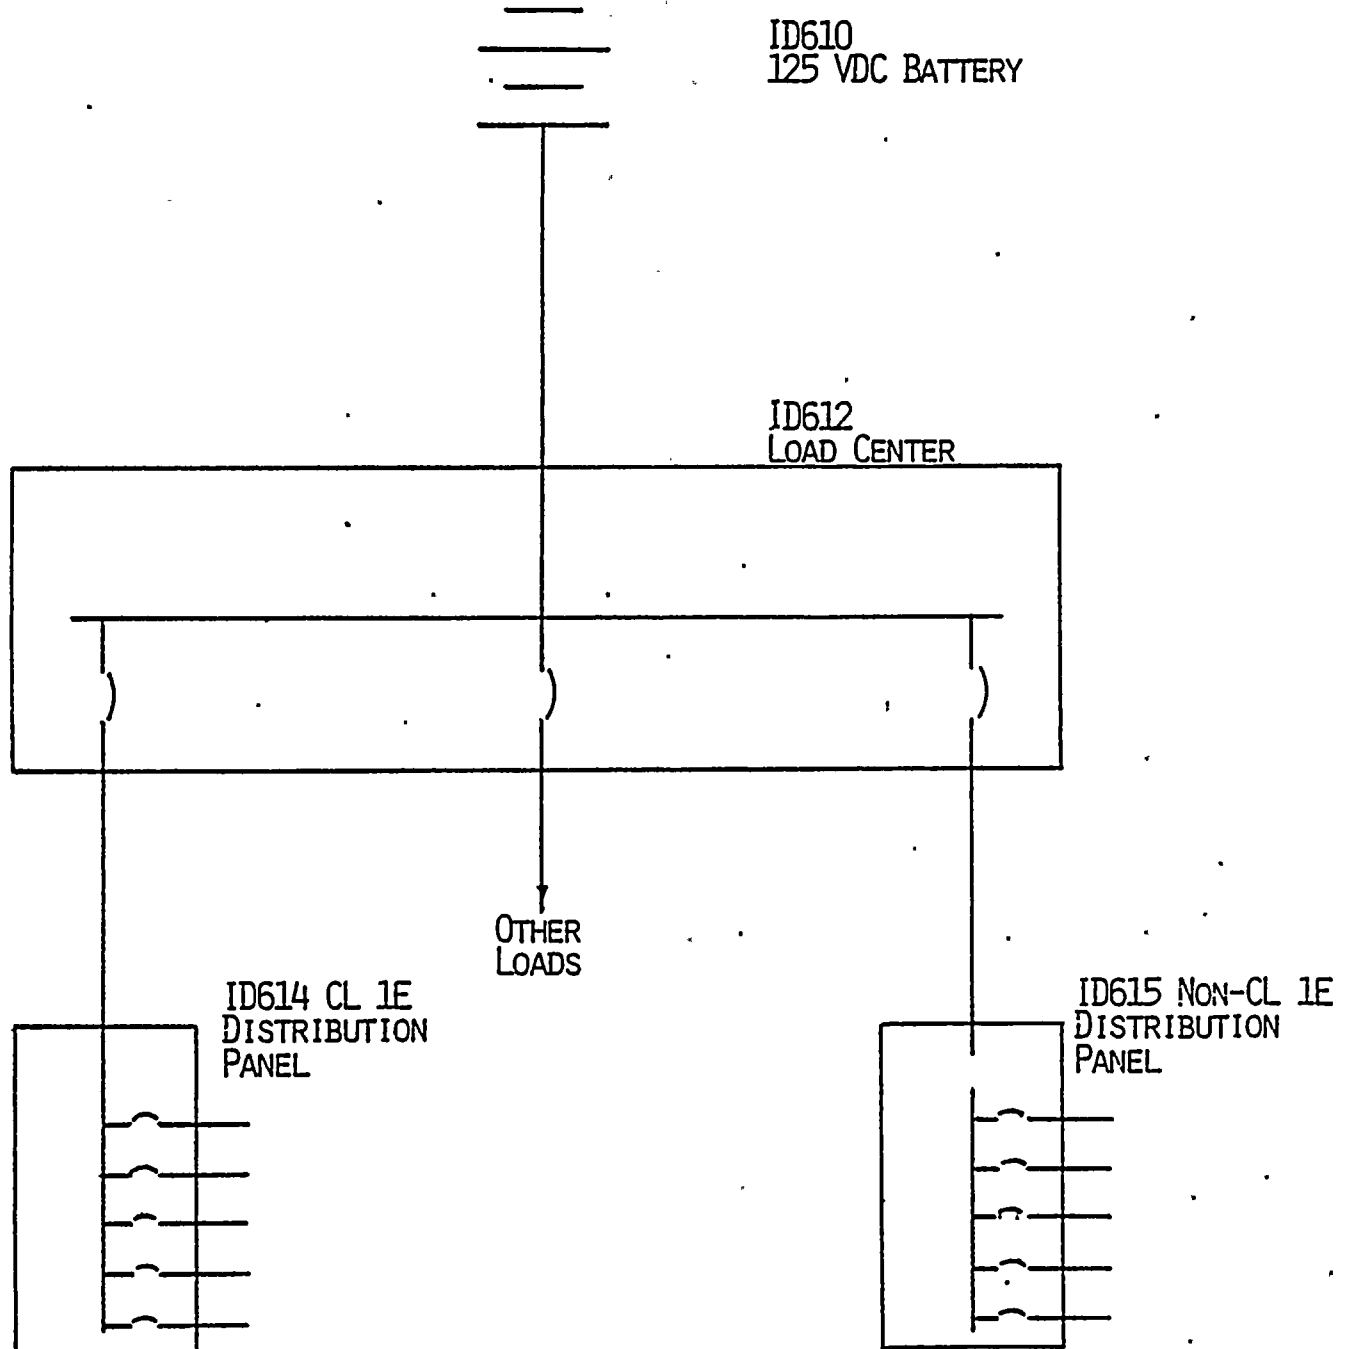

EXISTING CONFIGURATION

ID614
DISTRIBUTION
PANEL

COMMON LOAD:
CONTROL PANEL,
4KV SWGR, ETC.

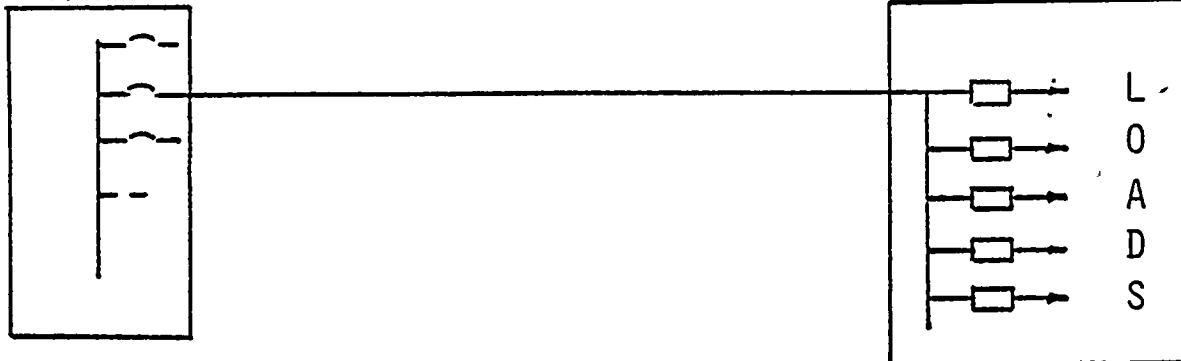

NEW CONFIGURATION

ID614
DISTRIBUTION
PANEL

NEW MANUAL
TRANSFER
SWITCH

COMMON
LOAD

2D614
DISTRIBUTION
PANEL

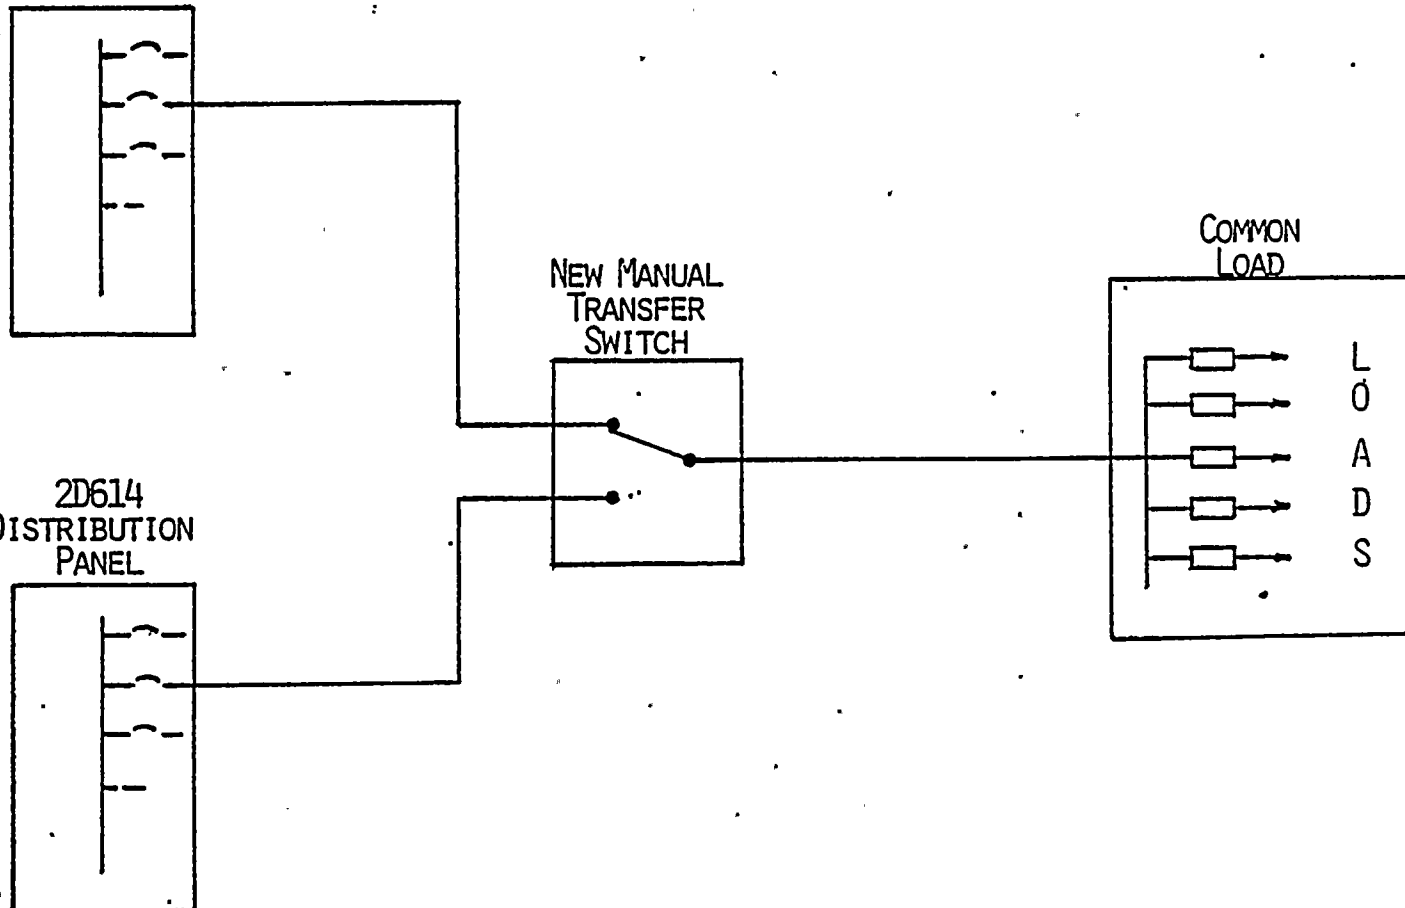


FIGURE THREE

4KV LOAD DISTRIBUTION

