

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8203300118 DOC. DATE: 82/03/23 NOTARIZED: NO DOCKET #
 FACIL: 50-389 St. Lucie Plant, Unit 2, Florida Power & Light Co. 05000389
 AUTH. NAME AUTHOR AFFILIATION
 UHRIG, R.E. Florida Power & Light Co.
 RECIP. NAME RECIPIENT AFFILIATION
 EISENHUT, D.G. Division of Licensing

SUBJECT: Forwards minutes of 820302 meeting in Bethesda, MD re
 equipment qualification.

DISTRIBUTION CODE: A048S COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 3
 TITLE: Equipment Qualification (OR & PRE-OL)

NOTES:

	RECIPIENT ID CODE/NAME		COPIES			RECIPIENT ID CODE/NAME		COPIES	
			LTTR	ENCL				LTTR	ENCL
	LIC BR #3 BC 12		6	6		NERSES, V.	01	1	1
INTERNAL:	ELD	20	1	1		GC	21	1	1
	IE	18	1	1		NRR/DE/EOB	07	5	5
	NRR/DL DIR	22	1	1		NRR/DL/ORAB	06	1	1
	NRR/DSI/AEB		1	1		<u>REG FILE</u>	04	1	1
	RGN2		1	1					
EXTERNAL:	ACRS	23	10	10		LPDR	03	1	1
	NRC PDR	02	1	1		NSIC	05	1	1
	NTIS		1	1					


TOTAL NUMBER OF COPIES REQUIRED: LTTR 34 ENCL 34

1. The first part of the document is a list of names and addresses. The names are: John Doe, Jane Smith, and Bob Johnson. The addresses are: 123 Main Street, 456 Elm Street, and 789 Oak Street.

2. The second part of the document is a list of items and their quantities. The items are: Apples, Bananas, and Oranges. The quantities are: 10, 5, and 3.

3. The third part of the document is a list of dates and times. The dates are: 1/1/2020, 2/1/2020, and 3/1/2020. The times are: 10:00 AM, 2:00 PM, and 5:00 PM.

Category		Item		Quantity		Date	
Fruit	Apples	Red	10	10	10	1/1/2020	10:00 AM
	Bananas	Yellow	5	5	5	2/1/2020	2:00 PM
	Oranges	Orange	3	3	3	3/1/2020	5:00 PM
	Grapes	Green	2	2	2	4/1/2020	10:00 AM
Vegetables	Cucumbers	Green	10	10	10	1/1/2020	10:00 AM
	Carrots	Orange	5	5	5	2/1/2020	2:00 PM
	Broccoli	Green	3	3	3	3/1/2020	5:00 PM
	Spinach	Green	2	2	2	4/1/2020	10:00 AM

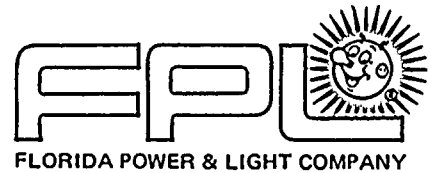

March 23, 1982
L-82-109

Office of Nuclear Reactor Regulation
Attention: Mr. Darrell G. Eisenhower, Director
Nuclear Reactor Regulation
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

Dear Mr. Eisenhower:

Re: St. Lucie Unit 2
Docket No. 50-389
Equipment Qualification Meeting Minutes



Attached please find the meeting minutes of our meeting with your staff on March 2, 1982, to discuss equipment qualification.

Very truly yours,


Robert. E. Uhrig
Vice President
Advanced Systems & Technology

REU/RAK/ga

Attachment

cc: James P. O'Reilly, Regional Administrator, Region II
Harold Reis, Esquire

A048
1/1

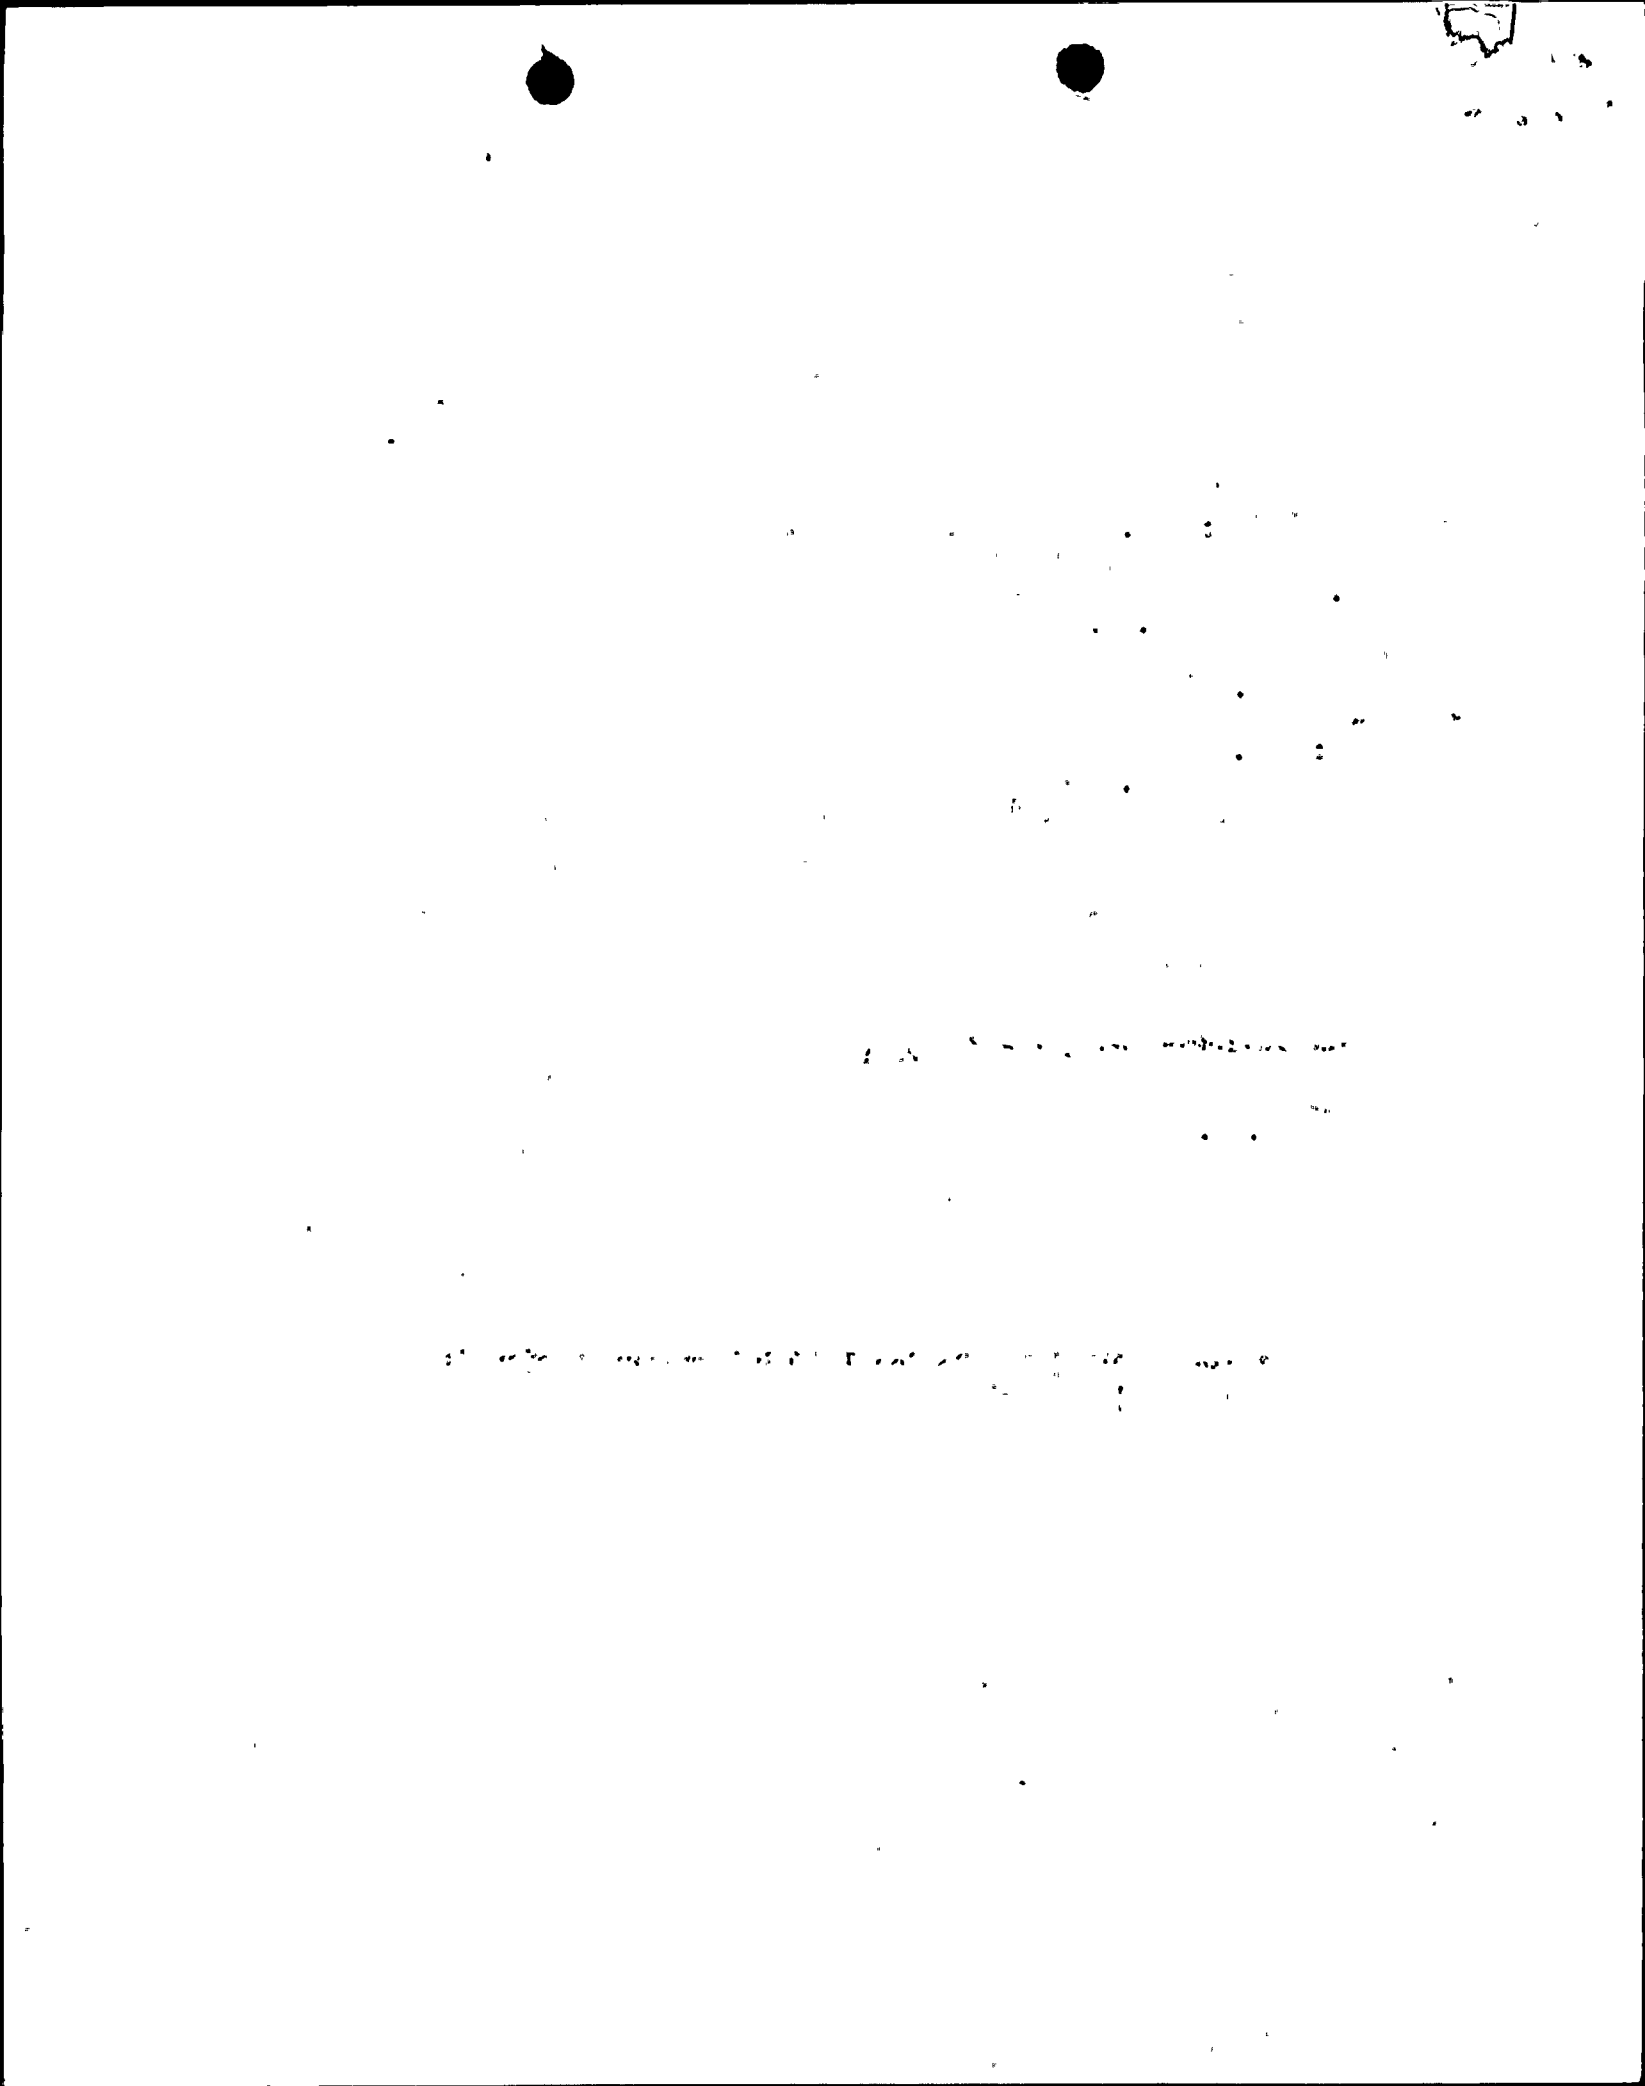

A meeting was held on March 2, 1982 in Triangle Towers, Bethesda, Maryland to discuss environmental qualification for FPL St. Lucie Unit #2. The following were in attendance:

J. Nerses	NRC/NRR/DL/LB#3
J. Kennedy	NRC/NRR/DE/eqB
J. Moulton	L-E
David D. Reiff	NRC/NRR/DE/eqB
Paul Shemanski	NRC/NRR/DE/eqB
Jerry Jackson	NRC/NRR/DE/eqB
Erroll W. Dotson	FPL
Zoltan R. Rosztoczy	NRC/eqB
Mike Horrell	Ebasco Licensing
Dr. Stephen L. Ostrow	Ebasco Applied Physics Dept.
Enoch Z. Zuchman	Ebasco Project Engineer
Larry Gradin	Ebasco Services
David Smith	FPL
John Franklin	FPL
Leonard R. Casella	FPL
John E. Sheetz	FPL
Larry Bell	NRC/AEB
Harold Walker	NRC/eqB
Kulin D. Desin	NRC/eqB

The following decisions/conclusions were reached:

1. St. Lucie Unit #2 is considered a category I plant except for purchase orders issued prior to July 1974. Prior to July 1974 it is category II.
2. The new rule 50.49 and RG 1.89 comments will be transmitted to NRC prior to March 31, 1982.
3. "Complete" means a completion of the review of all the software with the proposed disposition including commitment dates for all open (missing) items. It does not mean all software is on hand.
4. The site audit will be scheduled for mid May 1982.
5. FPL will transmit a master list of all class IE systems by function to NRC by March 31, 1982. (Rev. 2 of the Guidebook)
6. The break of the steam supply line to the auxiliary feedwater pump will be clarified by March 31, 1982.
7. A separate section of the Guidebook will be added addressing margin philosophy. Specific clarification on margin will be as necessary on each data package.
8. Sample radiation calculations will be submitted to NRC before March 30, 1982. One percent failed fuel for 40 years was assumed for the source term.

Meeting - March 2, 1982 (continued)

9. The FPL environmental program was discussed:
 - A) It is not an Ebasco program per se although the present task manager is an Ebasco employee, FPL maintains an active role. A description of the long term program including maintaining the equipment, ordering replacement parts and maintaining the specified environment will be transmitted to NRC. No date was established.
 - B) Although it was not discussed at this meeting, it has been discussed previously that FPL and Ebasco will determine and defend the environmental qualification of all equipment including that supplied by the NSSS vendor.
10. A justification of the duration of the accident; is, the time to return to a "normal" environment; will be provided to NRC by March 31, 1982.
11. The NRC will include 2 or 3 mild environment electrical equipment and 2 or 3 mechanical equipment purchase specifications in the site audit to determine that the environmental requirements are adequate. FPL will respond with sections in the Guidebook defining the methods environmental requirements were determined for mild environment and mechanical equipment.
12. An entire set of zone maps will be submitted to NRC by March 31, 1982.
13. Revision 2 will include the missing section 9.3, a list of abbreviations, a further "QA review" of CES sheets and the Guidebook for updating and accuracy. Revision 2 of the Guidebook will be submitted to NRC on March 31, 1982.

