

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8002200543 DOC. DATE: 80/02/13 NOTARIZED: NO DOCKET #
 FACIL: 50-244 Robert Emmet Ginna Nuclear Plant, Unit 1, Rochester G 05000244
 AUTH. NAME: WHITE, L. D. AUTHOR AFFILIATION: Rochester Gas & Electric Corp.
 RECIP. NAME: ZIEMANN, D. L. RECIPIENT AFFILIATION: Operating Reactors Branch 2

SUBJECT: Requests approval of encl proposed mods to spent fuel pool cooling sys, per license Amend 17.

DISTRIBUTION CODE: A001S COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 1+30
 TITLE: General Distribution for after Issuance of Operating Lic.

NOTES: ICU: J. SHAPAKER, C. HOFMAUER.


ACTION:	RECIPIENT	COPIES		RECIPIENT	COPIES	
	ID CODE/NAME	LTTR	ENCL		ID CODE/NAME	LTTR
	05 BC ORB #2	7	7			
INTERNAL:	01 REG FILE	1	1	02 NRC PDR	1	1
	12 PGE	2	2	15 CORE PERF BR	1	1
	17 ENGR BR	1	1	18 REAC SFTY BR	1	1
	19 PLANT SYS BR	1	1	20 EEB	1	1
	21 EFLT TRT SYS	1	1	EPB-DOR	1	1
	OELO	1	0	STS GROUP LEADR	1	1
EXTERNAL:	03 LPDR	1	1	04 NSIC	1	1
	23 ACRS	16	16			

FEB 25 1980

TOTAL NUMBER OF COPIES REQUIRED: LTTR

40 39
 38 ENCL 37

CP

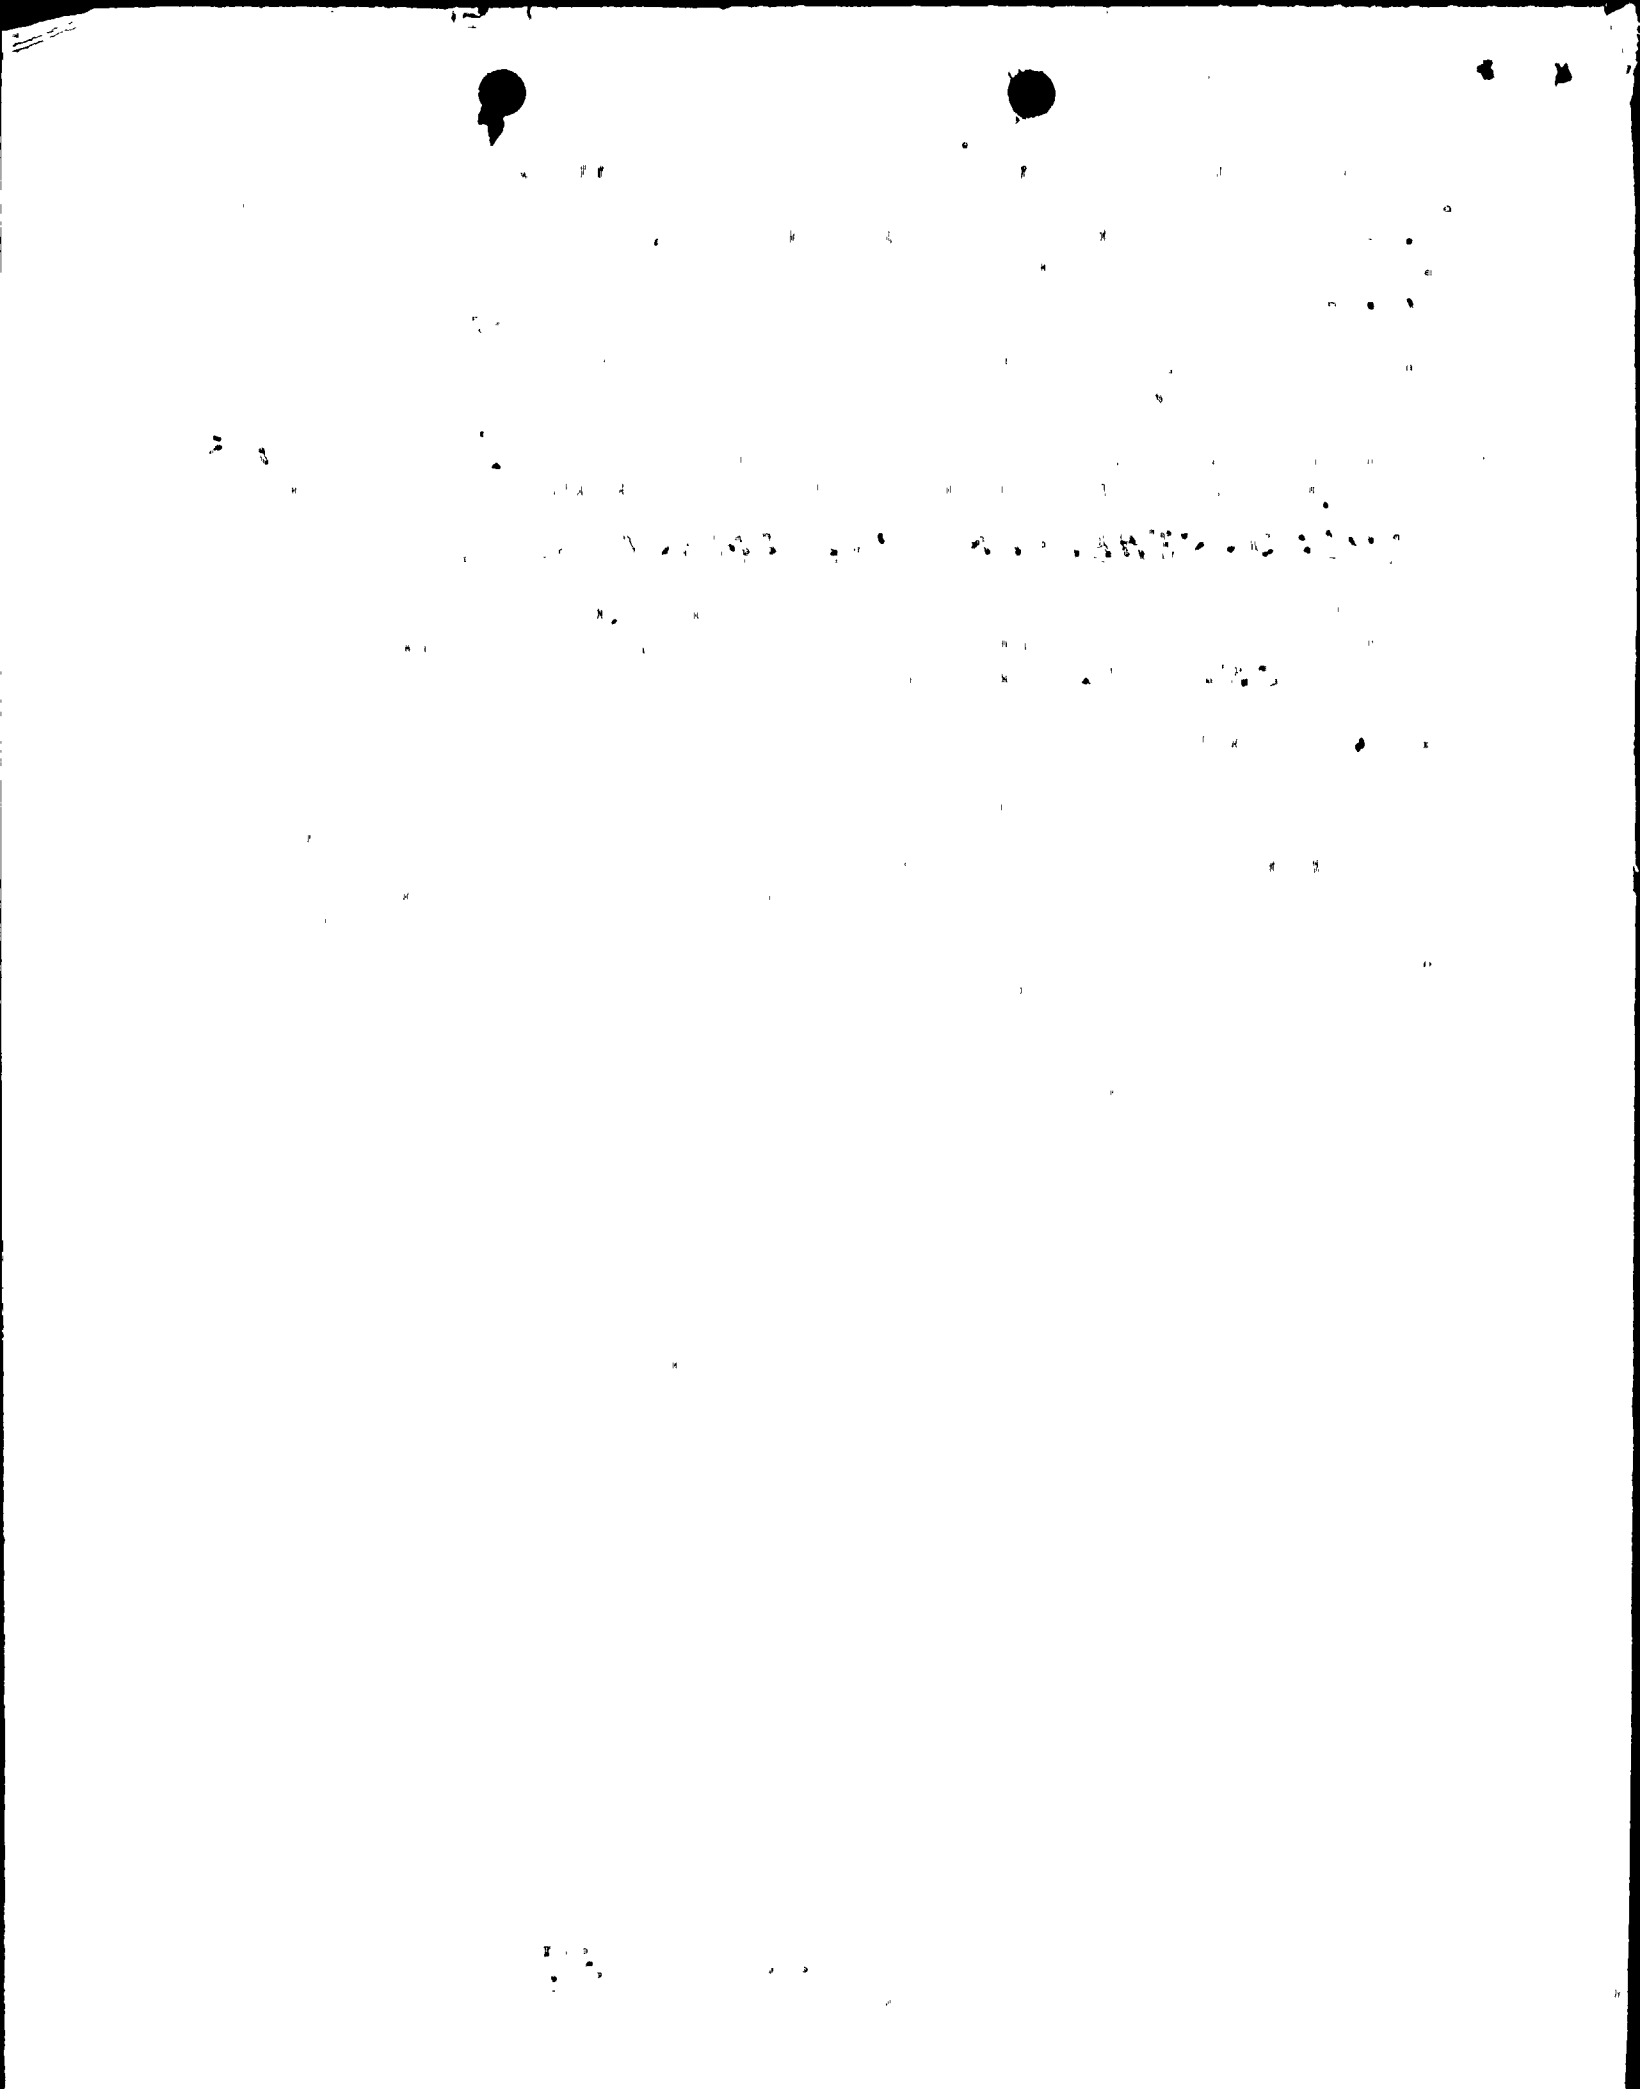




ROCHESTER GAS AND ELECTRIC CORPORATION • 89 EAST AVENUE, ROCHESTER, N.Y. 14649

LEON D. WHITE, JR.
VICE PRESIDENT

TELEPHONE
AREA CODE 716 546-2700



February 13, 1980

Director of Nuclear Reactor Regulation
Attention: Mr. D. L. Ziemann, Chief
Operating Reactor Branch #2
U.S. Nuclear Regulatory Commission
Washington, DC 20555

Subject: Spent Fuel Pool Cooling System
R. E. Ginna Nuclear Power Plant, Unit No. 1
Docket No. 50-244

Dear Mr. Ziemann:

In early 1977, Rochester Gas and Electric Corporation (RG&E) expanded the fuel storage capacity of the Ginna spent fuel pool from 210 fuel assemblies to 595 assemblies. This modification was performed in order to provide storage through the late 1980's. Amendment No. 17 to the Ginna Operating License, issued on November 17, 1976, included a discussion of the present spent fuel cooling system and stated that RG&E had committed to future spent fuel pool cooling system modifications. The proposed modifications to the cooling system are described in the attached Design Criteria.

The purpose of this letter is to request approval by the NRC of the proposed modifications described in the attached Design Criteria.

Very truly yours,

L. D. White, Jr.

L. D. White, Jr.

*137001
5.11*

8002200

543