

SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR:8806150181	DOC.DATE: 87/12/31	NOTARIZED: NO	DOCKET #
FACIL:50-244	Robert Emmet Ginna Nuclear Plant, Unit 1, Rochester G		05000244
AUTH.NAME	AUTHOR AFFILIATION		
SNOW,B.A.	Rochester Gas & Electric Corp.		
RECIP.NAME	RECIPIENT AFFILIATION		

SUBJECT: "Semiannual Radioactive Effluent Release Rept, Jul-Dec 1987."
W/880229 ltr.

DISTRIBUTION CODE: IE48D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 62
TITLE: 50.36a(a)(2) Semiannual Effluent Release Reports

NOTES: License Exp date in accordance with 10CFR2,2.109 (9/19/72). 05000244

RECIPIENT		COPIES		RECIPIENT		COPIES	
ID CODE/NAME		LTTR	ENCL	ID CODE/NAME		LTTR	ENCL
PD1-3 LA		1	0	PD1-3 PD		5	5
STAHLER, C		1	1				
INTERNAL: AEOD/DOA		1	1	AEOD/DSP/TPAB		1	1
ARM TECH ADV		1	1	NRR/DEST/PSB 8D		1	1
NRR/DREP/RPB 10		4	4	NUDOCS-ABSTRACT		1	1
REG-ELLE 01		1	1	RGN1 FILE 02		1	1
RGN2/DRSS/EPRPB		1	1				
EXTERNAL: BNL TICHLER, J03		1	1	LPDR		1	1
NRC PDR		1	1				

TOTAL NUMBER OF COPIES REQUIRED: LTTR 22 ENCL 21

SEMIANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT

R. E. GINNA NUCLEAR PLANT

ROCHESTER GAS AND ELECTRIC

DOCKET NO. 50-244

JULY - DECEMBER 1987

DE 48
1/1

TABLE OF CONTENTS

1.0	INTRODUCTION
2.0	SUPPLEMENTAL INFORMATION
2.1	REGULATORY LIMITS
2.2	MAXIMUM PERMISSIBLE CONCENTRATIONS
2.3	RELEASE RATE LIMITS
2.4	MEASUREMENTS AND APPROXIMATIONS OF TOTAL RADIOACTIVITY
2.5	BATCH RELEASES
2.6	ABNORMAL RELEASES
3.0	SUMMARY OF GASEOUS RADIOACTIVE EFFLUENTS
4.0	SUMMARY OF LIQUID RADIOACTIVE EFFLUENTS
5.0	SOLID WASTE
6.0	LOWER LIMIT OF DETECTION
7.0	RADIOLOGICAL IMPACT
8.0	METEOROLOGICAL DATA
9.0	LAND USE CENSUS CHANGES
10.0	ANNUAL TABULATION OF PERSONNEL EXPOSURE
11.0	LEAK TEST OF SEALED SOURCES
12.0	CHANGES TO THE OFFSITE DOSE CALCULATION MANUAL
13.0	CHANGES TO THE PROCESS CONTROL PROGRAM
14.0	MAJOR CHANGES TO RADWASTE TREATMENT SYSTEMS

LIST OF TABLES

Table 1A	Gaseous Effluents - Gaseous Summation of all Releases
Table 1B	Gaseous Effluents - Continuous and Batch Releases
Table 2A	Liquid Effluents - Summation of all Releases
Table 2B	Liquid Effluents - Continuous and Batch Releases
Table 3	Solid Waste and Irradiated Fuel Shipments
Table 4A	Radiation Dose to Nearest Individual Receptor from Gaseous Releases
Table 4B	Radiation Dose to Nearest Individual from Liquid Releases
Table 5A	Liquid Effluents - Summation of all Releases (corrected table for Jan-June 1987)
Table 5B	Liquid Effluents - Continuous and Batch Releases (corrected table for Jan-June 1987)
Table 6A	Number of Personnel and Man-Rem by Work and Job Function
Table 6B	Standard Report of Personnel Whole Body Exposure

1.0 INTRODUCTION

This Semiannual Radioactive Effluent Release Report is for Rochester Gas and Electric Company's R.E. Ginna plant and is submitted in accordance with the requirements of Tech. Spec. Section 6.9.1.4. The report covers the period from July 1, 1987 through December 31, 1987.

This report includes a summary of the quantities of radioactive gaseous and liquid effluents and solid waste released from the plant presented in the format outlined in appendix B of Regulatory Guide 1.21, Revision 1, June 1974. It includes the annual summary of personnel whole body exposure and man-rem received by work groups.

All gaseous and liquid effluents discharged during this reporting period were in compliance with the limits of the R.E. Ginna Technical Specifications.

2.0 SUPPLEMENTAL INFORMATION

2.1 Regulatory Limits

The Technical Specification limits applicable to release of radioactive material in liquid and gaseous effluents are:

2.1.1 Fission and Activation Gases

The instantaneous dose rate, as calculated in the ODCM, due to noble gases released in gaseous effluents from the site shall be limited to a release rate which would yield ≤ 500 mrem/yr to the total body and ≤ 3000 mrem/yr to the skin if allowed to continue for a full year.

The air dose, as calculated in the ODCM, due to noble gases released in gaseous effluents from the site shall be limited to the following:

- (i) During any calendar quarter to ≤ 10 mrad for gamma radiation and to ≤ 20 mrad for beta radiation.

2.1.2 Radioiodine, Tritium and Particulates

The instantaneous dose rate, as calculated in the ODCM, due to radioactive materials released in gaseous effluents from the site as radioiodines, radioactive materials in particulate form, and radionuclides other than noble gases with half-lives greater than 8 days shall be limited to a release rate which would yield ≤ 1500 mrem/yr to any organ if allowed to continue for a full year.

The dose to an individual, as calculated in the ODCM, from radioiodine, radioactive materials in particulate form and radionuclides other than noble gases with half-lives greater than eight days released with gaseous effluents from the site shall be limited to the following:

- (i) During any calendar quarter to ≤ 7.5 mrem to any organ.
- (ii) During any calendar year to ≤ 15 mrem to any organ.

2.1.3 Liquid Effluents

The release of radioactive liquid effluents shall be such that the concentration in the circulating water discharge does not exceed the limits specified in accordance with Appendix B, Table II, Column 2 and notes thereto of 10CFR20. For dissolved or entrained noble gases the total activity due to dissolved or entrained noble gases shall not exceed 2 E-4 uCi/ml .

The dose or dose commitment to an individual as calculated in the ODCM from radioactive materials in liquid effluents released to unrestricted areas shall be limited:

- (i) During any calendar quarter to ≤ 1.5 mrem to the total body and to ≤ 5 mrem to any organ, and
- (ii) During any calendar year to ≤ 3 mrem to the total body and to ≤ 10 mrem to any organ.

2.2 Maximum Permissible Concentrations (MPC)

- 2.2.1 For gaseous effluents, maximum permissible concentrations are not directly used in release rate calculations since the applicable limits are stated in terms of dose rate at the unrestricted area boundary.
- 2.2.2 For liquid effluents, the maximum permissible concentration values specified in 10CFR20, Appendix B, Table II, column 2 are used to calculate release rates and permissible concentrations at the unrestricted area boundary. A value of $2E-04$ uCi/ml is used as the MPC for dissolved and entrained noble gases in liquid effluents.

2.3 Release Rate Limits

The release rate limits for fission and activation gases from the R.G.&E Ginna plant are not based on the average energy of the radionuclide mixture in gaseous effluents; therefore, this value is not applicable. However, the average energy of the radionuclide mixture was 0.285 Mev.

2.4 Measurements and Approximations of Total Radioactivity

Gamma spectroscopy was the primary analysis method used to determine the radionuclide composition and concentration of gaseous and liquid effluents. Composite samples were analyzed for Sr-89, Sr-90 and Fe-55 by a contract laboratory. Tritium and alpha analysis were done using liquid scintillation and gas flow proportional counting respectively.

The total radioactivity in effluent release was determined from the measured concentration of each radionuclide present and the total volume of effluents released.

2.5 Batch Releases

2.5.1 Liquid

1. Number of batch release: 2.89 E+02
2. Total time period for batch releases: 1.88 E+04
3. Maximum time period for a batch release: 2.12 E+02
4. Average time period for batch releases: 6.5 E+01
5. Minimum time period for a batch release: 1.10 E+01
6. Average stream flow during periods of release effluent into a flowing stream: 1.28 E+06

2.5.2 Gaseous

1. Number of batch releases: 7E+00
2. Total time period for batch releases: 2.9E+03 min
3. Maximum time period for a batch release: 7.06E+02 min
4. Average time period for batch releases: 4.20E+02min
5. Minimum time period for a batch release: 2.95E+02 min

2.6 Abnormal Releases

There were no abnormal releases of liquid or gaseous effluents during the reporting period.

3.0 SUMMARY OF GASEOUS RADIOACTIVE EFFLUENTS

The quantities of radioactive material released in gaseous effluents are summarized in tables 1A and 1B. All releases were considered to be elevated releases.

4.0 SUMMARY OF LIQUID RADIOACTIVE EFFLUENTS

The quantities of radioactive material released in liquid effluents are summarized in tables 2A and 2B.

5.0 SOLID WASTES

The quantities of radioactive material released in shipments of solid waste transported from the site during the reporting period are summarized in table 3. Principal nuclides were determined by gamma spectroscopy and non-gamma emitters were calculated from scaling factors determined by an independent laboratory from representative samples of that waste type.

6.0 LOWER LIMIT OF DETECTION NOT MET

There were no releases for which any gamma emitting radionuclide did not meet the required lower limit for detection.

For the determination of Sr-89, the contract laboratory results for the third quarter, as has occurred in several quarters during the years of 1984, 1985 and 1986, did not meet the Technical Specification requirement for the lower limit of detection of $5E-8$ uCi/ml. The laboratory LLD value at the time of analysis was $1E-8$ uCi/ml, but the quarterly composite sample must be decay corrected to the midpoint of the sampling period, causing the Tech Spec LLD requirement to be exceeded. The decay correction factor exceeded a value of 5 and gave a calculated LLD greater than $5E-8$ uCi/ml.

A tabulation of the missed LLD's by the contract laboratory for the years of 1986 and 1987 are:

Date	Analysis	Sample	Value
1986 First Qt.	Sr-89	Retention Tank	6.1 E-8
1986 Fourth Qt.	Sr-89	Boiler Return	6.4 E-8
"	Sr-89	House Heating Boiler	8.2 E-8
"	Sr-89	High Cond. Waste Tank	6.9 E-8
1987 Third Qt.	Sr-89	High Cond. Waste Tank	6.1 E-8
"	Sr-89	Retention Tank	8.5 E-8

7.0 RADIOLOGICAL IMPACT

An assessment of doses to the maximally exposed individual from gaseous and liquid effluents was performed for locations representing the maximum dose. In all cases, doses were well below Technical Specification limits. Doses were assessed based upon actual meteorological conditions considering the noble gas exposure, inhalation, ground plane and ingestion pathways. The ingestion pathways considered were the produce, vegetable, goat's milk, cow's milk and meat pathway. The results of this assessment are presented in tables 4A and B.

8.0 METEOROLOGICAL DATA

The annual summary of hourly meteorological data collected during 1987 is not included with this report, but can be made available at the R.G.&E Ginna Plant as allowed by our Technical Specification.

9.0 LAND USE CHANGES

There were no changes in critical receptor location for dose calculations during the reporting period.

10.0 ANNUAL TABULATION OF PERSONNEL EXPOSURE

The annual tabulation of the number of station, utility and other personnel receiving exposures greater than 100 mrem/yr and their associated man-rem exposure according to work and job function required by Technical Specification 6.9.2.2 and 10CFR20.407 is included as tables 6A and 6B.

11.0 LEAK TEST OF SEALED SOURCES

No sealed sources were found to be leaking when smeared by both wet and dry smears.

12.0 CHANGES TO THE OFFSITE DOSE CALCULATION MANUAL (ODCM)

There were no changes to the ODCM during the report period.

During an internal audit of Technical Specification reporting requirements, there was no record found that a copy of Revision 2 of the ODCM was sent to the NRC with the January-June 1986 Semi-Annual Radioactive Effluent Release Report. A Copy of Revision 2 is included with this report. The ODCM was revised to show:

- a. A change in the flow of the circulating discharge water used for dilution of releases before leaving the restricted boundary. All example calculations affected by this change were corrected.
- b. The deletion of the measurement of direct radiation by film badge. The plant discontinued the use of personnel dosimetry by film badge and it was deleted from the environmental program. The use of TLD monitoring continues.
- c. The addition of the word instantaneous to section VI.
- d. The correction of several typographical errors overlooked previously.

13.0 CHANGES TO THE PROCESS CONTROL PROGRAM (PCP)

There were no changes to the PCP during the reporting period.

14.0 MAJOR CHANGES TO RADWASTE TREATMENT SYSTEMS

There were no major changes to the Radwaste Treatment Systems during the reporting period.

TABLE 1 A

EFFLUENT AND WASTE DISPOSAL SEMIANNUAL REPORT

GASEOUS EFFLUENTS - SUMMATION OF ALL RELEASES

JULY 1 - DECEMBER 31, 1987

	Unit	Quarter	Quarter	Est. Total Error %
A. Fission & activation gases		3	4	
1. Total release	Ci	1.36E+01	1.56E+01	7.0E+00
2. Average release rate for period	uCi/sec	1.71E+00	1.96E+00	
3. Percent of technical specification limit	%	2.71E-04	3.11E-04	
B. Iodines				
1. Total iodine-131	Ci	1.06E-05	1.24E-05	4.3E+01
2. Average release rate for period	uCi/sec	1.33E-06	1.56E-06	
3. Percent of technical specification limit	%	2.92E-03	3.43E-03	
C. Particulates				
1. Particulates with half-lives > 8 days	Ci	6.78E-06	5.95E-06	4.3E+01
2. Average release rate for period	uCi/sec	8.53E-07	7.49E-07	
3. Percent of technical specification limit	%	7.86E-05	7.07E-05	
4. Gross alpha radioactivity	Ci	E	E	
D. Tritium				
1. Total release	Ci	5.73E+01	5.43E+01	3.2E+00
2. Average release rate for period	uCi/sec	7.21E+00	6.83E+00	
3. Percent of technical specification limit	%	6.71E-03	6.36E-03	

TABLE 1 B

EFFLUENT AND WASTE DISPOSAL SEMIANNUAL REPORT
GASEOUS EFFLUENTS - CONTINUOUS AND BATCH RELEASES
JULY 1 - DECEMBER 31, 1987

Nuclides Released	Unit	CONTINUOUS MODE		BATCH MODE	
		Quarter	Quarter	Quarter	Quarter
1. Fission gases		3	4	3	4
krypton-85	Ci			6.99E-02	
krypton-85m	Ci			2.26E-04	
krypton-87	Ci	3.75E-02	3.01E-02		
krypton-88	Ci	5.10E-02	3.22E-02		
xenon-133	Ci	1.04E+01	1.29E+01	1.36E-02	4.66E-02
xenon-135	Ci	2.39E+00	1.86E+00	4.03E-03	
xenon-135m	Ci	4.32E-01	4.38E-01		
xenon-138	Ci	1.48E-01	1.50E-01		
Others (specify)	Ci				
xenon-131m	Ci	5.07E-02	4.42E-02		
xenon-133m	Ci		5.52E-03		
argon-41	Ci	7.42E-02	1.45E-01		
Total for period	Ci	1.36E+01	1.56E+01	8.78E-02	4.66E-02
2. Iodines					
iodine-131	Ci	1.86E-06	1.66E-06		
iodine-133	Ci	8.69E-06	1.07E-05		
iodine-135	Ci				
Total for period	Ci	1.06E-05	1.24E-05		
3. Particulates					
strontium-89	Ci		*		
strontium-90	Ci		*		
cesium-134	Ci				
cesium-137	Ci				
barium-lanthanum-140	Ci				
Others (specify)	Ci				
	Ci				
	Ci				
unidentified	Ci	6.78E-06	5.95E-06		

Note: Isotopes for which no value is given were not identified in applicable releases.

* Sample sent out for analysis but results not yet received. Data for identified isotopes will be included with next semi-annual report for January-June, 1988.

TABLE 2A

EFFLUENT AND WASTE DISPOSAL SEMIANNUAL REPORT

LIQUID EFFLUENTS - SUMMATION OF ALL RELEASES

JULY 1 - DECEMBER 31, 1987

	Unit	Quarter 3	Quarter 4	Est. Total Error, %
A. Fission and activation products				
1. Total release (not including tritium, gases, alpha)	Ci	2.61E-02	1.78E-03	1.1E+01
2. Average diluted concentration during period	uCi/ml	1.53E-10	1.05E-11	
3. Percent of applicable limit	%	3.17E-04	2.17E-05	
B. Tritium				
1. Total release	Ci	1.19E+02	1.17E+02	3.2E+00
2. Average diluted concentration during period	uCi/ml	6.96E-07	6.88E-07	
3. Percent of applicable limit	%	2.32E-02	2.29E-02	
C. Dissolved and entrained gases				
1. Total release	Ci		5.88E-07	3.4E+01
2. Average diluted concentration during period	uCi/ml	E	3.46E-15	
3. Percent of applicable limit	%	E	1.73E-09	
D. Gross alpha radioactivity				
1. Total release	Ci	E	E	E
E. Volume of waste released (prior to dilution)				
	liters	3.00E+07	2.41E+07	5.0E+00
F. Volume of dilution water used during period				
	liters	1.71E+11	1.70E+11	5.0E+00

TABLE 2B

EFFLUENT AND WASTE DISPOSAL SEMIANNUAL REPORT

LIQUID EFFLUENTS - CONTINUOUS AND BATCH RELEASES

JULY 1 - DECEMBER 31, 1987

Nuclides Released	Unit	CONTINUOUS MODE		BATCH MODE	
		Quarter	Quarter	Quarter	Quarter
		3	4	3	4
strontium-89	Ci		*		*
strontium-90	Ci		*		*
cesium-134	Ci	6.84E-05	8.05E-08	2.39E-03	5.43E-04
cesium-137	Ci	1.74E-04	1.37E-04	2.74E-03	9.28E-04
iodine-131	Ci	8.06E-07	9.37E-07		
cobalt-58	Ci			7.67E-07	
cobalt-60	Ci	1.78E-07	1.76E-07	9.71E-05	1.71E-04
iron-59	Ci				
zinc-65	Ci				
manganese-54	Ci	1.18E-07	9.59E-09		
chromium-51	Ci				
zirconium-niobium-95	Ci				
molybdenum-99	Ci				
technetium-99m	Ci				
barium-lanthanum-140	Ci				
cerium-141	Ci				
Other (specify)	Ci				
iodine-133	Ci	2.80E-06	2.09E-06		
iron-55	Ci		*	2.07E-02	*
silver-110m	Ci			5.48E-04	
	Ci				
	Ci				
unidentified	Ci				
Total for period (above)	Ci	2.46E-04	1.40E-04	2.59E-02	1.64E-03
xenon-133	Ci				
xenon-135	Ci			5.88E-07	

NOTE: Isotopes for which no value is given were not identified in applicable releases.

*Sample sent out for analysis but results not yet received. Data for identified isotopes will be included with next semi-annual report for January - June, 1988

TABLE 3

EFFLUENT AND WASTE DISPOSAL SEMIANNUAL REPORT

SOLID WASTE AND IRRADIATED FUEL SHIPMENTS

A. SOLID WASTE SHIPPED OFFSITE FOR BURIAL OR DISPOSAL (Not irradiated fuel)

1. Type of waste	Unit	6-month Period	Est. Total Error %
a. Spent resins, filter sludges, evaporator bottoms, etc.	m ³	1.47E+01	5.0E+00
	Ci	2.01E+02	5.0E+00
b. Dry compressible waste, contaminated equip, etc.	m ³	4.1 E+01	5.0E+00
	Ci	1.44E+00	1.0E+01
c. Irradiated components, control rods, etc.	m ³		
	Ci		
d. Other (describe)	m ³		
	Ci		

2. Estimate of major nuclide composition (by type of waste)

a.	iron-55	%	9.03E+00
	cobalt-60	%	4.89E+01
	nickel-63	%	1.19E+01
	cesium-134	%	7.05E+00
	cesium-137	%	1.29E+01
	cobalt-58	%	4.47E+00
	hydrogen-3	%	4.07E+00
b.	cobalt-60	%	4.17E+01
	iron-55	%	4.17E+01
	cesium-137	%	1.66E+01
c.		%	
d.		%	
		%	
		%	

3. Solid Waste Disposition

<u>Number of Shipments</u>	<u>Mode of Transportation</u>	<u>Destination</u>
2	Enclosed Van	Barnwell, S.C.
1	Lowboy	Barnwell, S.C.

B. IRRADIATED FUEL SHIPMENTS (Disposition)

<u>Number of Shipments</u>	<u>Mode of Transportation</u>	<u>Destination</u>
None		

TABLE 4A

RADIATION DOSES TO NEAREST INDIVIDUAL RECEPTOR
FROM GASEOUS RELEASES IN REM

1987 QUARTER 1

Direction	Adult			Teen			Child			Infant		
	Total Body	Skin	Thyroid	Total Body	Skin	Thyroid	Total Body	Skin	Thyroid	Total Body	Skin	Thyroid
N	1.2E-7	2.2E-7	1.5E-7	1.2E-7	2.2E-7	1.5E-7	1.1E-7	2.2E-7	1.5E-7	9.8E-8	2.2E-7	1.5E-7
NNE	8.6E-8	1.6E-7	1.1E-7	8.6E-8	1.6E-7	1.2E-7	8.3E-8	1.6E-7	1.2E-7	7.2E-8	1.6E-7	1.1E-7
NE	1.3E-7	2.0E-7	1.6E-7	1.3E-7	2.0E-7	1.7E-7	1.2E-7	2.0E-7	1.6E-7	9.9E-8	2.0E-7	1.4E-7
ENE	7.3E-8	1.1E-7	9.0E-8	7.3E-8	1.1E-7	9.4E-8	7.0E-8	1.1E-7	9.2E-8	5.7E-8	1.1E-7	7.7E-8
E	1.0E-6	1.8E-6	1.3E-6	1.0E-6	1.8E-6	1.3E-6	9.6E-7	1.8E-6	1.3E-6	8.4E-7	1.8E-6	1.2E-6
ESE	2.5E-6	4.8E-6	3.1E-6	2.5E-6	4.8E-6	3.2E-6	2.4E-6	4.8E-6	3.2E-6	2.1E-6	4.8E-6	2.9E-6
SE	8.8E-7	1.3E-6	1.4E-6	8.8E-7	1.3E-6	1.6E-6	8.4E-7	1.3E-6	1.6E-6	7.0E-7	1.3E-6	1.4E-6
SSE	1.1E-6	1.5E-6	1.7E-6	1.1E-6	1.5E-6	1.9E-6	1.0E-6	1.5E-6	1.9E-6	8.4E-7	1.5E-6	1.6E-6
S	2.0E-6	3.0E-6	3.6E-6	2.0E-6	3.0E-6	3.9E-6	1.9E-6	3.0E-6	4.0E-6	1.6E-6	3.0E-6	3.5E-6
SSW	1.1E-6	1.8E-6	1.9E-6	1.1E-6	1.8E-6	2.1E-6	1.1E-6	1.8E-6	2.1E-6	9.1E-7	1.8E-6	1.9E-6
SW	8.1E-7	1.3E-6	1.3E-6	8.1E-7	1.3E-6	1.5E-6	7.8E-7	1.3E-6	1.5E-6	6.6E-7	1.3E-6	1.3E-6
WSW	2.8E-7	3.7E-7	4.6E-7	2.8E-7	3.7E-7	5.0E-7	2.7E-7	3.7E-7	5.1E-7	2.2E-7	3.7E-7	4.4E-7
W	1.6E-7	2.3E-7	2.0E-7	1.6E-7	2.3E-7	2.1E-7	1.6E-7	2.3E-7	2.0E-7	1.3E-7	2.3E-7	1.7E-7
WNW	4.6E-8	6.7E-8	6.1E-8	4.6E-8	6.7E-8	6.5E-8	4.5E-8	6.7E-8	6.5E-8	3.9E-8	6.7E-8	5.8E-8
NW	2.4E-8	1.9E-8	3.5E-8	2.4E-8	1.9E-8	3.7E-8	2.2E-8	1.9E-8	3.7E-8	1.6E-8	1.9E-8	2.9E-8
NNW	4.8E-8	6.5E-8	6.9E-8	4.8E-8	6.5E-8	7.3E-8	4.5E-8	6.5E-8	7.3E-8	3.6E-8	6.5E-8	6.2E-8

TABLE 4A

RADIATION DOSES TO NEAREST INDIVIDUAL RECEPTOR
FROM GASEOUS RELEASES IN REM

1987 QUARTER 2

Direction	Adult			Teen			Child			Infant		
	Total Body	Skin	Thyroid	Total Body	Skin	Thyroid	Total Body	Skin	Thyroid	Total Body	Skin	Thyroid
N	6.6E-8	5.4E-8	6.6E-8	6.6E-8	5.4E-8	6.6E-8	6.1E-8	5.4E-8	6.6E-8	4.4E-8	5.4E-8	6.6E-8
NNE	6.4E-8	5.3E-8	6.4E-8	6.4E-8	5.3E-8	6.4E-8	5.9E-8	5.3E-8	5.9E-8	4.3E-8	5.3E-8	4.3E-8
NE	9.6E-8	7.1E-8	9.6E-8	9.6E-8	7.1E-8	9.6E-8	8.8E-8	7.1E-8	8.8E-8	6.2E-8	7.1E-8	6.3E-8
ENE	6.7E-8	5.1E-8	6.7E-8	6.7E-8	5.1E-8	6.8E-8	6.2E-8	5.1E-8	6.2E-8	4.4E-8	5.1E-8	4.4E-8
E	1.3E-6	9.7E-7	1.3E-6	1.3E-6	9.7E-7	1.4E-6	1.6E-6	9.7E-7	1.6E-6	8.7E-7	9.7E-7	9.4E-7
ESE	7.1E-7	6.2E-7	7.2E-7	7.5E-7	6.2E-7	7.7E-7	8.8E-7	6.2E-7	9.1E-7	6.7E-7	6.2E-7	7.0E-7
SE	3.1E-7	3.2E-7	3.2E-7	3.2E-7	3.2E-7	3.3E-7	3.4E-7	3.2E-7	3.5E-7	2.7E-7	3.2E-7	2.8E-7
SSE	3.6E-7	3.3E-7	3.7E-7	3.9E-7	3.3E-7	3.9E-7	4.7E-7	3.3E-7	4.8E-7	4.4E-7	3.3E-7	4.6E-7
S	5.5E-7	5.5E-7	5.6E-7	5.7E-7	5.5E-7	5.8E-7	6.4E-7	5.5E-7	6.5E-7	5.4E-7	5.5E-7	5.6E-7
SSW	7.4E-7	6.8E-7	7.5E-7	7.4E-7	6.8E-7	7.8E-7	8.6E-7	6.8E-7	8.7E-7	6.7E-7	6.8E-7	6.9E-7
SW	1.5E-6	1.2E-6	1.5E-6	1.5E-6	1.2E-6	1.6E-6	1.8E-6	1.2E-6	1.8E-6	1.5E-6	1.2E-6	1.6E-6
WSW	9.0E-7	7.6E-7	9.1E-7	9.5E-7	7.6E-7	9.6E-7	1.1E-6	7.6E-7	1.1E-6	8.2E-7	7.6E-7	8.5E-7
W	2.5E-7	2.1E-7	2.5E-7	2.6E-7	2.1E-7	2.6E-7	3.0E-7	2.1E-7	3.1E-7	2.4E-7	2.1E-7	2.4E-7
WNW	1.6E-7	1.9E-7	1.7E-7	1.7E-7	1.9E-7	1.7E-7	1.9E-7	1.9E-7	1.9E-7	1.1E-7	1.9E-7	1.1E-7
NW	3.4E-8	2.2E-8	3.4E-8	3.4E-8	2.2E-8	3.4E-8	3.1E-8	2.2E-8	3.1E-8	2.1E-8	2.2E-8	2.2E-8
NNW	5.8E-8	4.5E-8	5.8E-8	5.8E-8	4.5E-8	5.8E-8	5.3E-8	4.5E-8	5.4E-8	3.8E-8	4.5E-8	3.8E-8

TABLE 4A

RADIATION DOSES TO NEAREST INDIVIDUAL RECEPTOR
FROM GASEOUS RELEASES IN REM

1987 QUARTER 3

Direction	Adult			Teen			Child			Infant		
	Total Body	Skin	Thyroid	Total Body	Skin	Thyroid	Total Body	Skin	Thyroid	Total Body	Skin	Thyroid
N	1.1E-7	3.2E-8	1.1E-7	1.1E-7	3.2E-8	1.1E-7	1.0E-7	3.2E-8	1.0E-7	6.5E-8	3.2E-8	6.5E-8
NNE	1.5E-7	4.3E-8	1.5E-7	1.5E-7	4.3E-8	1.5E-7	1.4E-7	4.3E-8	1.4E-7	8.7E-8	4.3E-8	8.7E-8
NE	1.3E-7	5.1E-8	1.3E-7	1.3E-7	5.1E-8	1.3E-7	1.2E-7	5.1E-8	1.2E-7	7.7E-8	5.1E-8	7.7E-8
ENE	6.9E-8	2.5E-8	6.9E-8	7.0E-8	2.5E-8	7.0E-8	6.3E-8	2.5E-8	6.3E-8	4.0E-8	2.5E-8	4.0E-8
E	1.4E-6	3.9E-7	1.4E-6	1.5E-6	3.9E-7	1.5E-6	1.9E-6	3.9E-7	2.0E-6	7.2E-7	3.9E-7	7.9E-7
ESE	6.7E-7	2.3E-7	6.9E-6	7.2E-7	2.3E-7	7.4E-7	8.9E-7	2.3E-7	9.3E-7	3.7E-7	2.3E-7	4.2E-7
SE	5.8E-7	2.5E-7	5.9E-7	6.1E-7	2.5E-7	6.3E-7	7.3E-7	2.5E-7	7.7E-7	3.8E-7	2.5E-7	4.2E-7
SSE	6.7E-7	2.0E-7	6.9E-7	7.2E-7	2.0E-7	7.4E-7	8.7E-7	2.0E-7	9.0E-7	3.8E-7	2.0E-7	4.2E-7
S	2.7E-6	1.6E-6	2.8E-6	2.9E-6	1.6E-6	3.0E-6	3.6E-6	1.6E-6	3.8E-6	1.8E-6	1.6E-6	2.0E-6
SSW	8.0E-7	3.2E-7	8.3E-7	8.6E-7	3.2E-7	8.9E-7	1.1E-6	3.2E-7	1.1E-6	5.2E-7	3.2E-7	5.6E-7
SW	1.9E-6	6.5E-7	1.9E-6	2.0E-6	6.5E-7	2.1E-6	2.5E-6	6.5E-7	2.6E-6	1.5E-6	6.5E-7	1.6E-6
WSW	1.2E-6	3.1E-7	1.3E-6	1.4E-6	3.1E-7	1.4E-6	1.8E-6	3.1E-7	1.8E-6	1.0E-6	3.1E-7	1.1E-6
W	6.4E-7	1.6E-7	6.4E-7	7.0E-7	1.6E-7	7.1E-7	9.2E-7	1.6E-7	9.3E-7	4.3E-7	1.6E-7	4.5E-7
WNW	2.8E-7	1.2E-7	2.8E-7	3.0E-7	1.2E-7	3.0E-7	3.8E-7	1.2E-7	3.9E-7	1.0E-7	1.2E-7	1.0E-7
NW	3.7E-8	1.2E-8	3.7E-8	3.7E-8	1.2E-8	3.7E-8	3.3E-8	1.2E-8	3.3E-8	2.1E-8	1.2E-8	2.1E-8
NNW	7.3E-8	2.4E-8	7.4E-8	7.4E-8	2.4E-8	7.4E-8	6.6E-8	2.4E-8	6.7E-8	4.2E-8	2.4E-8	4.2E-8

TABLE 4A

RADIATION DOSES TO NEAREST INDIVIDUAL RECEPTOR
FROM GASEOUS RELEASES IN REM

1987 QUARTER 4

Direction	Adult			Teen			Child			Infant		
	Total Body	Skin	Thyroid	Total Body	Skin	Thyroid	Total Body	Skin	Thyroid	Total Body	Skin	Thyroid
N	5.6E-8	4.9E-8	5.6E-8	5.6E-8	4.9E-8	5.7E-8	5.2E-8	4.9E-8	5.2E-8	3.8E-8	4.9E-8	3.8E-8
NNE	4.7E-8	4.0E-8	4.7E-8	4.7E-8	4.0E-8	4.7E-8	4.4E-8	4.0E-8	4.4E-8	3.2E-8	4.0E-8	3.2E-8
NE	5.5E-8	4.4E-7	5.6E-8	5.6E-8	4.4E-8	5.6E-8	5.1E-8	4.4E-8	5.2E-8	3.7E-8	4.4E-8	3.7E-8
ENE	4.6E-8	3.4E-8	4.6E-8	4.6E-8	3.4E-8	4.6E-8	4.2E-8	3.4E-8	4.2E-8	3.0E-8	3.4E-8	3.0E-8
E	6.3E-7	5.9E-7	6.5E-7	6.4E-7	5.9E-7	6.5E-7	6.1E-7	5.9E-7	6.4E-7	4.5E-7	5.9E-7	4.7E-7
ESE	4.8E-7	4.3E-7	4.9E-7	4.8E-7	4.3E-7	4.9E-7	4.6E-7	4.3E-7	4.7E-7	3.3E-7	4.3E-7	3.4E-7
SE	6.8E-7	5.6E-7	6.8E-7	6.8E-7	5.6E-7	6.8E-7	6.3E-7	5.6E-7	6.4E-7	4.6E-7	5.6E-7	4.7E-7
SSE	5.4E-7	4.8E-7	5.6E-7	5.4E-7	4.8E-7	5.7E-7	5.3E-7	4.8E-7	5.7E-7	3.8E-7	4.8E-7	4.2E-7
S	7.9E-7	7.1E-7	8.0E-7	8.0E-7	7.1E-7	8.1E-7	7.5E-7	7.1E-7	7.7E-7	5.7E-7	7.1E-7	5.8E-7
SSW	1.2E-7	1.4E-7	1.2E-7	1.2E-7	1.4E-7	1.2E-7	1.2E-7	1.4E-7	1.3E-7	9.3E-8	1.4E-7	9.9E-8
SW	1.1E-7	1.5E-7	1.1E-7	1.1E-8	1.5E-8	1.1E-7	1.1E-7	1.5E-7	1.1E-7	1.0E-7	1.5E-7	1.0E-7
WSW	6.2E-8	6.9E-8	6.2E-8	6.3E-8	6.9E-8	6.3E-8	6.4E-8	6.9E-8	6.5E-8	5.0E-8	6.9E-8	5.2E-8
W	1.5E-7	1.5E-7	1.5E-7	1.5E-7	1.5E-7	1.5E-7	1.5E-7	1.5E-7	1.5E-7	1.2E-7	1.5E-7	1.2E-7
WNW	9.1E-8	1.3E-7	9.2E-8	9.2E-8	1.3E-7	9.2E-8	9.0E-8	1.3E-7	9.2E-8	8.0E-8	1.3E-7	9.2E-8
NW	1.4E-8	1.2E-8	1.4E-8	1.4E-8	1.2E-8	1.4E-8	1.3E-8	1.2E-8	1.3E-8	9.3E-9	1.2E-8	9.4E-9
NNW	3.1E-8	2.7E-8	3.2E-8	3.2E-8	2.7E-8	3.2E-8	2.9E-8	2.7E-8	2.9E-8	2.1E-8	2.7E-8	2.2E-8

TABLE 4B

RADIATION DOSE TO NEAREST INDIVIDUAL
FROM LIQUID RELEASES IN MREM

	<u>Adult</u>	<u>Teen</u>	<u>Child</u>	<u>Infant</u>
First Quarter				
Total Body	1.5E-1	8.7E-2	3.5E-2	1.4E-3
Bone	1.1E-1	1.2E-1	1.5E-1	2.8E-4
Thyroid	3.2E-3	2.6E-2	3.5E-3	1.9E-3
Second Quarter				
Total Body	8.8E-3	5.1E-3	2.7E-3	7.9E-4
Bone	6.6E-3	7.0E-3	8.7E-3	2.0E-5
Thyroid	9.0E-4	1.0E-2	1.0E-3	7.9E-4
Third Quarter				
Total Body	3.0E-2	1.7E-2	7.1E-3	4.8E-4
Bone	2.3E-2	2.4E-2	3.0E-2	5.7E-5
Thyroid	5.4E-4	4.6E-3	6.0E-4	4.7E-4
Fourth Quarter				
Total Body	9.1E-3	5.3E-3	2.9E-3	8.9E-4
Bone	6.5E-3	6.9E-3	8.5E-3	1.6E-5
Thyroid	1.0E-3	4.0E-3	1.1E-3	8.9E-4

TABLE 5 A

EFFLUENT AND WASTE DISPOSAL SEMIANNUAL REPORT

LIQUID EFFLUENTS - SUMMATION OF ALL RELEASES

CORRECTED PAGE FOR JANUARY 1 - JUNE 30, 1987 REPORT

	Unit	Quarter 1	Quarter 2	Est.Total Error, %
A. Fission and activation products				
1. Total release (not including tritium, gases, alpha)	Ci	2.36E-02	7.36E-03	1.1E+01
2. Average diluted concentration during period	uCi/ml	1.83E-10	4.35E-11	
3. Percent of applicable limit	%	4.10E-03	8.55E-05	
B. Tritium				
1. Total release	Ci	2.23E+02	1.05E+02	3.2E+00
2. Average diluted concentration during period	uCi/ml	1.73E-06	6.21E-07	
3. Percent of applicable limit	%	5.77E-02	2.07E-02	
C. Dissolved and entrained gases				
1. Total release	Ci	1.90E-03	1.11E-06	3.4E+01
2. Average diluted concentration during period	uCi/ml	1.47E-11	6.57E-15	
3. Percent of applicable limit	%	7.35E-06	3.28E-09	
D. Gross alpha radioactivity				
1. Total release	Ci	2.45E-04		4.8E+01
E. Volume of waste released (prior to dilution) liters				
		2.53E+07	3.13E+07	5.0E+00
F. Volume of dilution water used during period liters				
		1.29E+11	1.69E+11	5.0E+00

TABLE 5 B

EFFLUENT AND WASTE DISPOSAL SEMIANNUAL REPORT

LIQUID EFFLUENTS - CONTINUOUS AND BATCH RELEASES

CORRECTED PAGE FOR JANUARY 1 - JUNE 30, 1987 REPORT

Nuclides Released	Unit	CONTINUOUS MODE		BATCH MODE	
		Quarter 1	Quarter 2	Quarter 1	Quarter 2
strontium-89	Ci			5.75E-04	1.18E-05
strontium-90	Ci			1.04E-05	2.83E-06
cesium-134	Ci	5.98E-04	1.40E-04	9.68E-03	3.70E-04
cesium-137	Ci	6.41E-04	2.00E-04	1.05E-02	7.23E-04
iodine-131	Ci	5.37E-05	1.29E-06	1.01E-03	
cobalt-58	Ci	1.07E-06		1.08E-04	1.44E-05
cobalt-60	Ci	1.44E-06	3.41E-05	3.75E-04	2.27E-04
iron-59	Ci				
zinc-65	Ci				
manganese-54	Ci	1.01E-06	3.86E-07	1.09E-06	
chromium-51	Ci				
zirconium-niobium-95	Ci			7.24E-07	1.59E-06
molybdenum-99	Ci				
technetium-99m	Ci				
barium-lanthanum-140	Ci				
cerium-141	Ci				
Other (specify)	Ci				
iodine-133	Ci	1.26E-05	5.99E-06		
iodine-135	Ci	1.54E-05	7.33E-06		
ruthenium-103	Ci			2.80E-07	
silver-110m	Ci			2.56E-05	9.06E-06
iron-55	Ci		5.61E-03		
unidentified	Ci				
Total for period (above)	Ci	1.32E-3	6.00E-03	2.23E-02	1.36E-03
xenon-133	Ci			1.81E-03	5.59E-07
xenon-135	Ci			9.03E-05	5.50E-07

Note: Isotopes for which no value is given were not identified in applicable releases.

TABLE 6A

RG&E GINNA STATION
NUMBER OF PERSONNEL AND MAN-REM BY WORK AND JOB FUNCTION (1987)
REGULATORY GUIDE 1.16 REPORT

WORK PERMIT SUFFIX & WORK GROUP	NO. OF PERSONNEL (>100 MREM)			TOTAL MAN-REM		
	CONTRACT WORKERS	STATION EMPLOYEES	UTILITY EMPLOYEES	CONTRACT WORKERS	STATION EMPLOYEES	UTILITY EMPLOYEES
REACTOR OPERATIONS & SURVEILLANCE						
Maintenance Personnel	105	54	70	1.995	6.935	1.652
Operating Personnel	0	23	0	0.000	9.974	0.000
Health Physics Personnel	28	12	0	3.168	4.508	0.000
Supervisory Personnel	24	16	13	1.552	2.570	0.487
Engineering Personnel	10	0	4	0.331	0.000	0.084
ROUTINE MAINTENANCE						
Maintenance Personnel	144	51	141	29.498	16.148	19.048
Operating Personnel	0	8	0	0.000	0.322	0.000
Health Physics Personnel	28	12	3	4.429	2.758	0.330
Supervisory Personnel	26	16	15	4.268	2.233	3.042
Engineering Personnel	34	0	3	10.982	0.000	0.351
INSERVICE INSPECTION						
Maintenance Personnel	42	18	49	3.686	0.285	4.089
Operating Personnel	0	2	0	0.000	0.002	0.000
Health Physics Personnel	15	4	0	0.595	0.156	0.000
Supervisory Personnel	6	8	6	0.105	0.166	0.379
Engineering Personnel	5	0	2	0.020	0.000	0.150
SPECIAL MAINTENANCE						
Maintenance Personnel	132	49	142	46.635	8.401	63.306
Operating Personnel	0	12	0	0.000	0.122	0.000
Health Physics Personnel	26	10	2	1.832	1.504	0.000
Supervisory Personnel	24	13	12	4.657	0.855	0.617
Engineering Personnel	15	0	4	0.648	0.000	0.150
WASTE PROCESSING						
Maintenance Personnel	24	22	13	4.560	0.460	0.183
Operating Personnel	0	5	0	0.000	0.047	0.000
Health Physics Personnel	6	6	3	2.554	0.095	0.575
Supervisory Personnel	1	5	2	0.092	0.097	0.175
Engineering Personnel	0	0	0	0.000	0.000	0.000
REFUELING						
Maintenance Personnel	61	29	130	7.031	3.645	24.293
Operating Personnel	0	3	0	0.000	0.001	0.000
Health Physics Personnel	19	8	0	2.328	1.957	0.000
Supervisory Personnel	15	2	7	1.280	0.365	0.075
Engineering Personnel	21	0	1	9.705	0.000	0.015
TOTAL						
Maintenance Personnel	159	54	153	93.405	35.874	111.571
Operating Personnel	0	23	0	0.000	10.468	0.000
Health Physics Personnel	28	12	3	14.906	10.978	0.905
Supervisory Personnel	28	16	15	11.954	6.286	4.775
Engineering Personnel	34	0	4	21.686	0.000	0.750
GRAND TOTAL	245	100	169	141.951	63.606	118.001

NOTE: This report is based on SRPD (Self Reading Pocket Dosimeter) exposures taken from the WORK PERMITS.

TABLE 6B

ROCHESTER GAS & ELECTRIC CORPORATION
ROBERT E. GINNA STATION
STANDARD REPORT OF PERSONNEL WHOLE BODY EXPOSURE (REM)
BY EXPOSURE GROUPS
FOR THE YEAR OF 1987

REQUIRED AS PER 10CFR20 PARAGRAPH 20.407(b)

DOSE (REM)	NUMBER OF PEOPLE
0.000 - 0.100	496
0.100 - 0.250	258
0.250 - 0.500	153
0.500 - 0.750	132
0.750 - 1.000	90
1.000 - 2.000	39
2.000 - 3.000	88
3.000 - 4.000	13
4.000 - 5.000	0
5.000 - 6.000	0
6.000 - 7.000	0
7.000 - 8.000	0
8.000 - 9.000	0
9.000 - 10.000	0
10.000 - 11.000	0
11.000 - 12.000	0
12.000 -	0

TOTAL NUMBER OF PERSONNEL MONITORED 1269

PERSONNEL WITH THE FIVE HIGHEST EXPOSURES FOR YEAR

Bement, John S.	117-58-1594	2.905 rem
Polfleit, Peter S.	065-54-9637	2.421 rem
Galletto, James E.	058-48-0822	2.403 rem
Bodley, Warren A.	058-46-2638	2.388 rem
Slade, Timothy R.	060-42-7098	2.332 rem

Offsite Dose Calculating Manual

for

Ginna Station

Rochester Gas and Electric Corporation

Revision 2

Ginna Station Offsite Dose Calculating Manual

TABLE OF CONTENTS

<u>Radiological Effluent Technical Specification Section</u>		<u>Dose Calculation Manual</u>	<u>Page #</u>
3.5.4 4.12.1	I.	Liquid Effluent Monitor Setpoints	1
3.5.4 4.12.2	II.	Gaseous Effluent Monitor Setpoints	3
3.9.1.1	III.	Liquid Effluent Release Concentrations	9
3.9.1.2	IV.	Liquid Effluent Dose	10
3.9.1.3 3.9.2.3 5.5	V.	Liquid and Gaseous Radwaste Treatment and Operability	13
3.9.2.1	VI.	Gaseous Effluent Dose Rate	17
3.9.2.2	VII.	Gaseous Effluent Doses	18
4.10.1	VIII.	Environmental Monitor Sample Locations	20
3.9.2.4	IX.	Preparation of Special Report to Demonstrate Compliance with Environmental Radiation Protection Standards	32
	X.	References	33

LIST OF TABLES AND FIGURES

		<u>Page</u>
Table 1	Dose Parameters for Radioiodines and Radioactive Particulate, Gaseous Effluents	7
Table 2	Dose Factors for Noble Gases and Daughters	8
Table 3	Dispersion Parameter (\bar{X}/Q) for Long Term Releases, Plant Vent	25
Table 4	Dispersion Parameter (\bar{D}/Q) for Long Term Releases, Plant Vent	26
Table 5	Dispersion Parameter (\bar{X}/Q) for Long Term Releases, Containment Purge	27
Table 6	Dispersion Parameter (\bar{D}/Q) for Long Term Releases, Containment Purge	28
Table 7	Dispersion Parameter (\bar{X}/Q) for Long Term Releases, Ground Vent	29
Table 8	Dispersion Parameter (\bar{D}/Q) for Long Term Releases, Ground Vent	30
Table 9	Pathway Dose Factors Due to Radionuclides Other than Noble Gases	31
Figure 1	Ginna Station Liquid Waste Treatment System	15
Figure 2	Ginna Station Gaseous Waste Treatment and Ventilation Exhaust Systems	16
Figure 3	Location of Onsite Air Monitors and Post Accident TLD's	21
Figure 4	Location of Farms for Milk Samples and Ontario Water District Intake	22
Figure 5	Location of Offsite TLD's	23
Figure 6	Location of Offsite Air Monitors	24

I. Liquid Effluent Monitor Setpoints

The Ginna Technical Specifications, Section 3.5.4, require alarm and/or trip setpoints for radiation monitors on each liquid effluent line (reference 1). Precautions, limitations and setpoints applicable to the operation of Ginna Station liquid effluent monitors are provided in plant procedures P-9 and RD-13.1. Setpoint values are calculated to assure that alarm and trip actions occur prior to exceeding the limits of 10 CFR 20 at the release point to the unrestricted area. For added conservatism, liquid effluent release rates are administratively set so that only small fractions of the applicable 10 CFR 20 maximum permissible concentrations can be reached in the discharge canal.

The calculated alarm and trip action setpoints for each radioactive liquid effluent line monitor and flow determination must satisfy the following equation:

$$\text{Equation (1): } \frac{cf}{F+f} \leq C$$

Where:

- C = the effluent concentration which implements the 10 CFR 20 limit for unrestricted areas, in $\mu\text{Ci/ml}$.
- c = the setpoint, in $\mu\text{Ci/ml}$, of the radioactivity monitor measuring the radioactivity concentration in the discharge line prior to dilution and subsequent release.
- f = the flow as measured at the radiation monitor location, in volume per unit time, in the same units as F below.
- F = the dilution water flow as determined prior to the release point, in volume per unit time.

Liquid effluent batch releases from Ginna Station are discharged through a liquid waste disposal monitor. The liquid waste stream (f) is diluted (by F) in the plant discharge canal before it enters Lake Ontario.

The limiting batch release concentration (c) corresponding to the liquid waste monitor setpoint is calculated from the above expression. Since the value of (f) is very small in comparison to (F), the expression becomes:

$$\text{Equation (2): } c \leq \frac{C \cdot F}{f}$$

Where:

- C = the maximum permissible concentration of gross beta, gamma activity above background in the circulating water discharge at the unrestricted area boundary ($1 \times 10^{-7} \mu\text{Ci/ml}$).
- F = the dilution flow assuming operation of only 1 circulating water pump (170,000 gpm).
- f = the maximum waste effluent discharge rate through the designated pathway.

The limiting release concentration (c) is then converted to a setpoint count rate by use of the monitor calibration factor determined per procedure RD-13.1. The expression becomes:

$$\text{Equation (2a):} \quad \text{Setpoint (cpm)} = \frac{c(\mu\text{Ci/ml})}{\text{Cal. Factor } (\mu\text{Ci/ml per cpm)}}$$

Example (Liquid Radwaste Monitor R-18):

If one assumes, for example, that the maximum pump effluent discharge rate (f) is 30 gpm, then the limiting batch release concentration (c) would be determined as follows:

$$c (\mu\text{Ci/ml}) \leq \frac{1 \times 10^{-7} (\mu\text{Ci/ml}) \cdot 170,000 (\text{gpm})}{30 (\text{gpm})}$$

$$c \leq 5.7 \times 10^{-4} (\mu\text{Ci/ml})$$

The monitor R-18 alarm and trip setpoint (in cpm) is then determined utilizing the monitor calibration factor calculated in plant procedure RD-13.1. Assuming a calibration factor of

$$9.5 \times 10^{-9} \frac{(\mu\text{Ci/ml})}{\text{cpm}}$$

and a limiting batch release concentration determined above the alarm and trip setpoint for monitor R-18 would be:

$$\frac{5.7 \times 10^{-4} (\mu\text{Ci/ml})}{9.5 \times 10^{-9} \frac{(\mu\text{Ci/ml})}{\text{cpm}}} = 6 \times 10^4 \text{ cpm}$$

The setpoint values for the Containment Fan Cooler Monitor (R-16), Spent Fuel Pit Heat Exchanger Service Water monitor (R-20), Steam Generator Blowdown monitor (R-19), the Retention Tank monitor (R-21), and the All Volatile Treatment waste discharge monitor (R-22) are calculated in a similar manner using Equation (2), substituting appropriate values of (f) and the corresponding calibration factor.

II. Gaseous Effluent Monitor Setpoints

The Ginna Technical Specifications (reference 1) require alarm and/or trip setpoints for specified radiation monitors on each noble gas effluent line. Precautions, limitations and setpoints applicable to the operation of Ginna Station gaseous effluent monitors are provided in plant procedures P-9 and RD-13.1. Setpoints are conservatively established for each ventilation noble gas monitor so that dose rates in unrestricted areas corresponding to 10 CFR Part 20 limits will not be exceeded. Setpoints shall be determined so that dose rates from releases of noble gases will comply with the Technical Specification requirements of 3.9.2.1.a(i), which stipulate that the dose rate for noble gases shall be ≤ 500 mrem/yr to the total body and ≤ 3000 mrem/yr to the skin.

The calculated alarm and trip action setpoints for each radioactive gaseous effluent monitor must satisfy the following equation:

$$\text{Equation (3): } c \leq \frac{Q_{iv}}{f \cdot k \cdot K}$$

where:

c = setpoint in cpm

Q_{iv} = release rate limit by specific nuclide in $\mu\text{Ci/sec}$

f = discharge flow rate in cfm

k = units conversion factor (cc/sec/cfm)

K = calibration factor ($\mu\text{Ci/cc/cpm}$)

The general methodology for establishing plant ventilation monitor setpoints is based upon a vent concentration limit (in $\mu\text{Ci/cc}$) derived from site specific meteorology and vent release characteristics.

Additional radiation monitor alarm and/or trip setpoints are calculated for radiation monitors measuring radioiodines, radioactive materials in particulate form and radionuclides other than noble gases. Setpoints are determined to assure that dose rates from the release of these effluents shall comply with Technical Specification 3.9.2.1.a (ii), which requires that the dose rate for all radioiodines, radioactive materials in particulate form, and radionuclides other than noble gases with half-lives greater than 8 days shall be ≤ 1500 mrem/yr to an organ.

The release rate limit for noble gases shall be calculated by the following equation for total body dose:

$$\text{Equation (4): } Q_{iv} (\mu\text{Ci/sec}) \leq \frac{500 \text{ (mrem/yr)}}{K_i \text{ (mrem/yr per } \mu\text{Ci/m}^3) \cdot \overline{X/Q_v} \text{ (sec/m}^3\text{)}}$$

and by the following equation for skin doses:

$$\text{Equation (5): } Q_{iv} (\mu\text{Ci/sec}) \leq \frac{3000 \text{ (mrem/yr)}}{(L_i + 1.1M_i) \text{ (mrem/yr per } \mu\text{Ci/m}^3) \cdot \overline{X/Q_v} \text{ (sec/m}^3\text{)}}$$

Where:

K_i = The total body dose factor due to gamma emissions for each identified noble gas radionuclide, (in mrem/yr per $\mu\text{Ci/m}^3$) from Table 2.

L_i = The skin dose factor due to beta emissions for each identified noble gas radionuclide, in mrem/yr per $\mu\text{Ci/m}^3$ from Table 2.

M_i = The air dose factor due to gamma emissions for each identified noble gas radionuclide, in mrad/yr per $\mu\text{Ci/m}^3$ from Table 2. (unit conversion constant of 1.1 mrem/mrad converts air dose to skin dose).

$\overline{X/Q_v}$ = The highest calculated annual average dispersion parameter for estimating the dose to the critical offsite receptor from vent release point (v). (in sec/m^3). The $\overline{X/Q_v}$ is calculated by the method described in Reg. Guide 1.111 (reference 6).

Q_{iv} = The release rate of radionuclide (i) from vent (v) which results in a dose rate of 500 mrem/yr to the whole body or 3000 mrem/yr to the skin of the critical receptor, (in $\mu\text{Ci/sec}$).

Historically, xenon-133 is the principal noble gas released from all vents and is appropriate for use as the reference isotope for establishing monitor setpoints. The whole body dose will be limiting, and the Xe-133 release rate limit is calculated by substituting the appropriate values in equation (4). After the release rate limit for Xe-133 is determined for each vent, the corresponding vent concentration limits are calculated based on applicable vent flow rates. Annually-derived monitor calibration factors ($\mu\text{Ci/cc}$ per cpm) convert limiting vent concentrations to count rate.

Containment, Plant Vent and Air Ejector Noble Gas Monitors
(Monitors R-12, R-14 and R-15)

Monitor R-12 measures noble gas activity in containment when it is isolated, or in the containment vent during purge releases. Noble gases being released via the plant vent are detected by R-14. Monitor R-15, on the air ejector, normally indicates only background noble gas activity; however it serves as one of the first indicators of primary-to-secondary leakage. Additional noble gas monitoring capability for the containment, plant and air ejector vents is provided by high-range effluent monitors R-12A, R-14A and R-15A, respectively.

Noble gas monitor setpoints are conservatively set in Procedure P-9 to correspond to fractions of the applicable 10 CFR 20 maximum permissible concentrations (MPCs) for unrestricted areas. Fractions are small enough so as to assure the timely detection of any simultaneous discharges from multiple release points before the combined downwind site boundary concentration could exceed MPC. Additional conservatism is provided by basing these setpoints upon instantaneous downwind concentrations. Release rates during the remainder of a given year, combined with any infrequent releases at setpoint levels, are likely to result in only a very small fraction of the 10 CFR 20 annual limits.

- - - - -
Example: (Plant vent monitor R-14)

Using Xe-133 as the controlling isotope for the setpoint and assuming a measured activity at $1.63 \text{ E-}6 \text{ } \mu\text{Ci/cc}$, a ratemeter reading of 16 cpm above background and a vent flow of $6.45 \text{ E}4 \text{ cfm}$.

$$\text{Xe-133 efficiency} = \frac{\text{Activity}}{\text{Net Ratemeter Reading}}$$

$$\text{Xe-133 efficiency} = \frac{1.63\text{E-}6}{16} = 1.02\text{E-}7 \frac{\mu\text{Ci/cc}}{\text{cpm}}$$

$$\text{Release Rate Limit } Q_{iv} = \frac{500 \text{ mrem/yr}}{(K_i)(X/Q_v)}$$

$$Q_{iv} = \frac{500}{(2.94\text{E}2)(2.7\text{E-}6)} = 6.3\text{E}5 \text{ } \mu\text{Ci/sec}$$

$$\text{setpoint} = c = \frac{Q_{iv}}{(f)(k)(K)}$$

$$c = \frac{6.3E5 \text{ } (\mu\text{Ci/sec})}{6.45E4 \text{ (cfm)} \cdot 472 \frac{\text{cc/sec}}{\text{cfm}} \cdot 1.0E-7 \frac{\mu\text{Ci/cc}}{\text{cpm}}}$$

$$c = 2.1E5 \text{ cpm (R-14 is set at 1/10 of this value, per Procedure P-9)}$$

1. Note: Continuous radioiodine and particulate monitoring on the air ejector is not required. Calculations and plant measurements have indicated that the iodine and particulate source terms via the air ejector compared to other airborne release pathways, are negligible. (See references 5, 7, and 8).

TABLE 1

DOSE PARAMETERS FOR RADIOIODINES AND RADIOACTIVE
PARTICULATE, GASEOUS EFFLUENTS*

Radio- nuclide	P_i Inhalation Pathway (mrem/yr per $\mu\text{Ci}/\text{m}^3$)	P_i Food & Ground Pathways ($\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$)	Radio- nuclide	P_i Inhalation Pathway (mrem/yr per $\mu\text{Ci}/\text{m}^3$)	P_i Food & Ground Pathways ($\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$)
H-3	6.5E+02	2.4E+03	Cd-115m	7.0E+04	4.8E+07
Cr-51	3.6E+02	1.1E+07	Sn-126	1.2E+06	1.1E+09
Mn-54	2.5E+04	1.1E+09	Sb-125	1.5E+04	1.1E+09
Fe-59	2.4E+04	7.0E+08	Te-127m	3.8E+04	7.4E+10
Co-58	1.1E+04	5.7E+08	Te-129m	3.2E+04	1.3E+09
Co-60	3.2E+04	4.6E+09	Te-132	1.0E+03	7.2E+07
Zn-65	6.3E+04	1.7E+10	Cs-134	7.0E+05	5.3E+10
Rb-86	1.9E+05	1.6E+10	Cs-136	1.3E+05	5.4E+09
Sr-89	4.0E+05	1.0E+10	Cs-137	6.1E+05	4.7E+10
Sr-90	4.1E+07	9.5E+10	Ba-140	5.6E+04	2.4E+08
Y-91	7.0E+04	1.9E+09	Ce-141	2.2E+04	8.7E+07
Zr-95	2.2E+04	3.5E+08	Ce-144	1.5E+05	6.5E+08
Nb-95	1.3E+04	3.6E+08	Np-239	2.5E+04	2.5E+06
Mo-99	2.6E+02	3.3E+08	I-131	1.5E+07	1.1E+12
Ru-103	1.6E+04	3.4E+10	I-133	3.6E+06	9.6E+09
Ru-106	1.6E+05	4.4E+11	Unidentified	4.1E+07	9.5E+10
Ag-110m	3.3E+04	1.5E+10			

*The listed dose parameters are for radionuclides that may be detected in gaseous effluents. These and additional dose parameters for isotopes not included in Table 1 may be calculated using the methodology described in NUREG-0133, Section 5.2.1 (reference 2).

TABLE 2
DOSE FACTORS FOR NOBLE GASES AND DAUGHTERS*

<u>Radionuclide</u>	<u>Total Body Dose Factor K_i (mrem/yr per $\mu\text{Ci}/\text{m}^3$)</u>	<u>Skin Dose Factor L_i (mrem/yr per $\mu\text{Ci}/\text{m}^3$)</u>	<u>Gamma Air Dose Factor M_i (mrad/yr per $\mu\text{Ci}/\text{m}^3$)</u>	<u>Beta Air Dose Factor N_i (mrad/yr per $\mu\text{Ci}/\text{m}^3$)</u>
Kr-83m	7.56E-02**	---	1.93E+01	2.88E+02
Kr-85m	1.17E+03	1.46E+03	1.23E+03	1.97E+03
Kr-85	1.61E+01	1.34E+03	1.72E+01	1.95E+03
Kr-87	5.92E+03	9.73E+03	6.17E+03	1.03E+04
Kr-88	1.47E+04	2.37E+03	1.52E+04	2.93E+03
Kr-89	1.66E+04	1.01E+04	1.73E+04	1.06E+04
Kr-90	1.56E+04	7.29E+03	1.63E+04	7.83E+03
Xe-131m	9.15E+01	4.76E+02	1.56E+02	1.11E+03
Xe-133m	2.51E+02	9.94E+02	3.27E+02	1.48E+03
Xe-133	2.94E+02	3.06E+02	3.53E+02	1.05E+03
Xe-135m	3.12E+03	7.11E+02	3.36E+03	7.39E+02
Xe-135	1.81E+03	1.86E+03	1.92E+03	2.46E+03
Xe-137	1.42E+03	1.22E+04	1.51E+03	1.27E+04
Xe-138	8.83E+03	4.13E+03	9.21E+03	4.75E+03
Ar-41	8.84E+03	2.69E+03	9.30E+03	3.28E+03

*The listed dose factors are for radionuclides that may be detected in gaseous effluents. These dose factors for noble gases and daughter nuclides are taken from Table B-1 of Regulatory Guide 1.109 (reference 3). A semi-infinite cloud is assumed.

**7.56E-02 = 7.56×10^{-2} .

III. Liquid Effluent Release Concentrations

Liquid batch releases are controlled individually and each batch release is authorized and based upon sample analysis and the existing dilution flow in the discharge canal. Plant procedures RD-7 and RD-8 establish the methods for sampling and analysis of each batch prior to release. A release rate limit is calculated for each batch based upon analysis, dilution flow and all procedural conditions being met before it is authorized for release. The waste effluent stream entering the discharge canal is continuously monitored and the release will be automatically terminated if the pre-selected monitor setpoint is exceeded. (See Section I.)

If gross beta analysis is performed for each batch release in lieu of gamma isotopic analysis, then a weekly composite for principal gamma emitters and I-131 is performed. Additional monthly and quarterly composite analyses are to be performed as specified in Table 4.12-1 of the Ginna Technical Specifications.

The equations used to calculate activity are:

Gamma Spectrometry:

$$\mu\text{Ci/cc Act.} = \frac{\text{peak area counts} - \text{bkgd counts}}{(\text{Count Time})(\text{Eff.})(\text{Vol.})(T_{1/2} \text{ correction})(3.7\text{E4})(\text{Branching fraction})}$$

Gross Beta Gamma:

$$\mu\text{Ci/cc Act.} = \frac{\text{total counts} - \text{bkgd counts}}{(\text{Count Time})(\text{Eff.})(\text{Vol.})(T_{1/2} \text{ correction})(3.7\text{E4})}$$

where: count time is in seconds;

eff. = counting efficiency, in $\frac{\text{counts per sec}}{\text{disintegrations per sec.}}$;

vol. = volume, in milliliters;

$T_{1/2}$ correction = decay correction factor, dimensionless;

3.7E4 = conversion constant, in $\frac{\text{disintegrations per sec.}}{\mu\text{Ci}}$;

Branching fraction is the fraction disintegrating by a particular decay mode, dimensionless.

IV.

Liquid Effluent Dose

The dose contribution received by the maximally exposed individual from the ingestion of Lake Ontario fish and drinking water is determined using the following methodology. These calculations will assume a near field dilution factor of 1.0 in evaluating the fish pathway dose, and a dilution factor of 20 between the plant discharge and the Ontario Water District drinking water intake located 1.1 miles away (Figure 4). The dilution factor of 20 was derived from drift and dispersion studies documented in reference 4.

Dose contributions from shoreline recreation, boating and swimming have been shown to be negligible in the Appendix I dose analysis (reference 5) and do not need to be routinely evaluated. Also, there is no known human consumption of shellfish from Lake Ontario.

The dose contribution to an individual will be determined to ensure that it complies with the Technical Specification requirements of 3.9.1.2.a (i) and 3.9.1.2.a (ii). The dose or dose commitment to an individual from radioactive materials in liquid effluents released to unrestricted areas shall be limited: (i) During any calendar quarter to ≤ 1.5 mrem to the total body and to ≤ 5 mrem to any organ, and, (ii) During any calendar year to ≤ 3 mrem to the total body and to ≤ 10 mrem to any organ. Offsite receptor doses will be determined for the limiting age group and organ, unless census data show that actual offsite individuals are of a less limiting age group.

The following expression is used to calculate ingestion pathway dose contributions for the total release period $\sum_{\ell=1}^m \Delta t_{\ell}$ from all radionuclides identified in liquid effluents released to unrestricted areas:

$$\text{Equation (6): } D_{i\tau} = \sum_{\ell=1}^m [A_{i\tau} \sum_{\ell=1}^m \Delta t_{\ell} C_{i\ell} F_{\ell}]$$

Where:

$D_{i\tau}$ = the cumulative dose commitment to the total body or any organ, τ , from the liquid effluents for the total time period (in mrem). $\sum_{\ell=1}^m \Delta t_{\ell}$

Δt_{ℓ} = the length of the ℓ th time period over which $C_{i\ell}$ and F_{ℓ} are averaged for all liquid releases, (in hours).

$C_{i\ell}$ = the average concentration of radionuclide, i , in undiluted liquid effluent during time period Δt_{ℓ} from any liquid release, (in $\mu\text{Ci/ml}$).

$A_{i\tau}$ = the site-related ingestion dose commitment factor to the total body or any organ τ for each identified principal gamma and beta emitter (in mrem/hr per $\mu\text{Ci/ml}$). See equation (7).

F_ℓ = the discharge canal dilution factor for $C_{i\ell}$ during any liquid effluent release. Defined as the ratio of the maximum undiluted liquid waste flow during release to the average flow from the site discharge structure to unrestricted receiving waters. The dilution factor will depend on the number of circulation pumps operating and, during icing conditions, the percentage opening of the recirculating gate. Reference curves are presented in plant procedure RD-7.

$$\text{Equation (7): } A_{i\tau} = k_o (U_w/D_w + U_F BF_i) DF_i$$

Where:

$A_{i\tau}$ = the site-related ingestion dose commitment factor to the total body or to any organ τ for each identified principal gamma and beta emitter, (in mrem/hr per $\mu\text{Ci/ml}$).

k_o = units conversion factor, $1.14 \times 10^5 = 10^6 \text{ pCi}/\mu\text{Ci} \times 10^3 \text{ ml/kg} \div 8760 \text{ hr/yr}$.

U_w = a receptor person's water consumption by age group from table E-5 of Regulatory Guide 1.109 (reference 3).

D_w = Dilution factor from the near field area of the release point to potable water intake. The site specific dilution factor is 20. This factor is assumed to be 1.0 for the fish ingestion pathway.

U_F = a receptor person's fish consumption by age group from table E-5 of Regulatory Guide 1.109.

BF_i = Bioaccumulation factor for nuclide, i , (in fish pCi/kg per PCi/l), from Table A-1 of Regulatory Guide 1.109.

DF_i = Dose conversion factor for the ingestion of nuclide, i , for a receptor person in pre-selected organ, τ , (in mrem/pCi), from Tables E-11, E-12, E-13, E-14 of Regulatory Guide 1.109.

The monthly dose contribution from releases for which radionuclide concentrations are determined by periodic composite sample analysis may be approximated by assuming an average monthly concentration based on the previous monthly or quarterly composite analyses. However, in the radioactive effluent release report (submitted within 60 days of January 1 per Technical Specification 6.9.1.4) the calculated dose contributions from these radionuclides shall be based on the actual composite analyses.

Example which illustrates how to compute the dose to the whole body via the fish and drinking water pathways, assuming an initial Cs-137 discharge concentration of $3.0 \text{ E-4 } \mu\text{Ci/ml}$:

Given the following discharge factors, where:

$$\begin{aligned} \Delta t_{\ell} &= 1 \text{ hour} \\ C_{i\ell} &= 3.0 \text{ E-4 } \mu\text{Ci/ml} \\ F_{\ell} &= \frac{20 \text{ gpm}}{170,000 \text{ gpm}} = 1.2 \text{ E-4} \\ D_w &= 20 \end{aligned}$$

And, taking the following values from Regulatory Guide 1.109 which concern the receptor of interest, which we assume is the child in this case:

$$\begin{aligned} U_w &= 510 \text{ l/year} \\ U_F &= 6.9 \text{ Kg/year} \\ BF_i &= 2000 \text{ pCi/kg per pCi/l} \\ DF_i &= 4.62 \text{ E-5 mrem/pCi} \end{aligned}$$

Then, the site-related ingestion dose commitment factor, A_{it} , is calculated as follows:

$$\begin{aligned} A_{it} \frac{\text{mrem/hr}}{\mu\text{Ci/ml}} &= K_o (U_w/D_w + U_F BF_i) DF_i \\ &= 1.14 \text{ E5 } \left(\frac{510}{20} + 6.9 \cdot 2000 \right) 4.62 \text{ E-5} \\ A_{it} &= 7.28 \text{ E4 mrem/hr per } \mu\text{Ci/ml} \end{aligned}$$

And, the whole body dose to the child is then:

$$\begin{aligned} D_t \text{ mrem} &= (A_{it})(\Delta t_{\ell})(C_{i\ell})(F_{\ell}) \\ &= (7.28 \text{ E4})(1)(3.0 \text{ E-4})(1.2 \text{ E-4}) \end{aligned}$$

$$D_t = 2.6\text{E-3 mrem to the whole body from Cs-137}$$

(The dose contribution from any other isotopes would then need to be calculated and summed).

V. Liquid and Gaseous Radwaste Treatment and Operability

An objective of the Ginna Technical Specifications which implement the overall requirements of 10 CFR Part 50, Appendix I, is to ensure that the plant radwaste treatment equipment is used and maintained. This equipment is to be utilized to reduce radioactive discharges from nuclear plants to levels "as low as reasonably achievable" or ALARA. ALARA levels warranting equipment operability have been defined by the NRC in the form of monthly dose "trigger" values. The trigger values, which are provided below, correspond to approximately 1/48 of the annual design objective doses given by 10 CFR Part 50, Appendix I. If continued at this rate, these monthly doses would correspond to just under 1/4 of the Appendix I annual design objectives.

	<u>Liquid Radwaste System</u>	<u>Gaseous Radwaste System</u>	<u>Ventilation Exhaust</u>
31-day	0.06 mrem (w. body)	0.2 mrad (gamma air)	
Trigger			0.3 mrem (any organ)
Values	0.2 mrem (any organ)	0.4 mrad (beta air)	

Figures 1 and 2 show the Ginna liquid and gaseous waste/ventilation exhaust systems. These systems are normally in routine use at the plant. Because discharges are being treated, the trigger values in the Technical Specifications may be exceeded but compliance with the stated quarterly and annual dose limits is required.

If the liquid or gaseous radwaste/ventilation exhaust systems were to be inoperable in excess of 31 days, then effluents are considered "untreated" waste. Should, over a 31-day period, the plant discharges exceed the dose trigger values in conjunction with extended inoperability of a waste treatment system, then Technical Specifications 3.9.1.3.b and 3.9.2.3.c apply. In this case, a 30-day report must be submitted to the Commission which identifies the inoperable equipment and describes appropriate corrective actions (see Technical Specifications 3.9.1.3.b and 3.9.2.3.c).

Example:

Assume a case where plant modifications were underway on the waste evaporator and demineralizer piping, and a reduction of the liquid waste volume contained in the waste holdup tank (WHUT) was needed. Assuming no other means of treatment were readily available, WHUT liquid (untreated) might be transferred to the waste condensate tanks, sampled and then discharged on a controlled basis.

In this case, assume also that a decision was made to proceed this way at the beginning of a given month, knowing that the waste evaporator and other portions of the liquid radwaste treatment system would be unavailable for the next 45 days.


The following method would be used to determine the need for a 30-day report:


1. Using existing plant procedures, sample the concentration contained in the WHUT (C_{i0}). Decide a sample frequency (e.g. 1-day) since the tank concentration could change.

2. Determine the permissible release rate to maintain the concentration in the discharge canal well within the applicable maximum permissible concentration (e.g. 1/100-1/10 MPC) for the mixture. (The discharge canal concentration is equal to $C_{i\ell} \cdot F_{\ell}$).
3. Calculate the incremental dose from all identified isotopes via the drinking water and fish ingestion pathways for each receptor group. The critical receptor will probably be the child. Assume the release will be continuous and that doses will be evaluated each day, corresponding to the WHUT sampling frequency. (We thus compute D_T using Equations 6 and 7, taking Δt_{ℓ} as the duration of each release; in this case, 24 hr/day).
4. The offsite receptor dose due to a controlled discharge of the WHUT contents is thus determined and cumulated over each daily release time interval. If the WHUT isotopic mixture and the discharge canal dilution factor, F_{ℓ} , are relatively constant, then each day's dose increment should be approximately the same. One can then estimate the number of release days it will take to reach the applicable dose trigger value.
5. The 30-day reporting requirement applies if a radwaste treatment system is inoperable and dose trigger values are exceeded. In the example, one reporting criterion is already met, since the treatment systems will be out of service for more than 31 days. If we determine that the liquid pathway dose does not exceed the trigger values in 31 days or less, then a 30-day report is not required. However, if a liquid pathway dose attains a trigger level within 31 days, then a report submittal would be required.
6. In the last case, it would be prudent to avoid a situation requiring the 30-day report. First, a trigger level dose, when added to the calculated doses resulting from all other liquid release sources (e.g. high conductivity waste tank, blowdown, retention tank), may significantly impact upon the plant's "dose budget" for the calendar quarter or the calendar year. Also, more realistically, other treatment options would likely be available at the plant and could be utilized.

GINNA STATION LIQUID WASTE TREATMENT SYSTEM

FIGURE 1

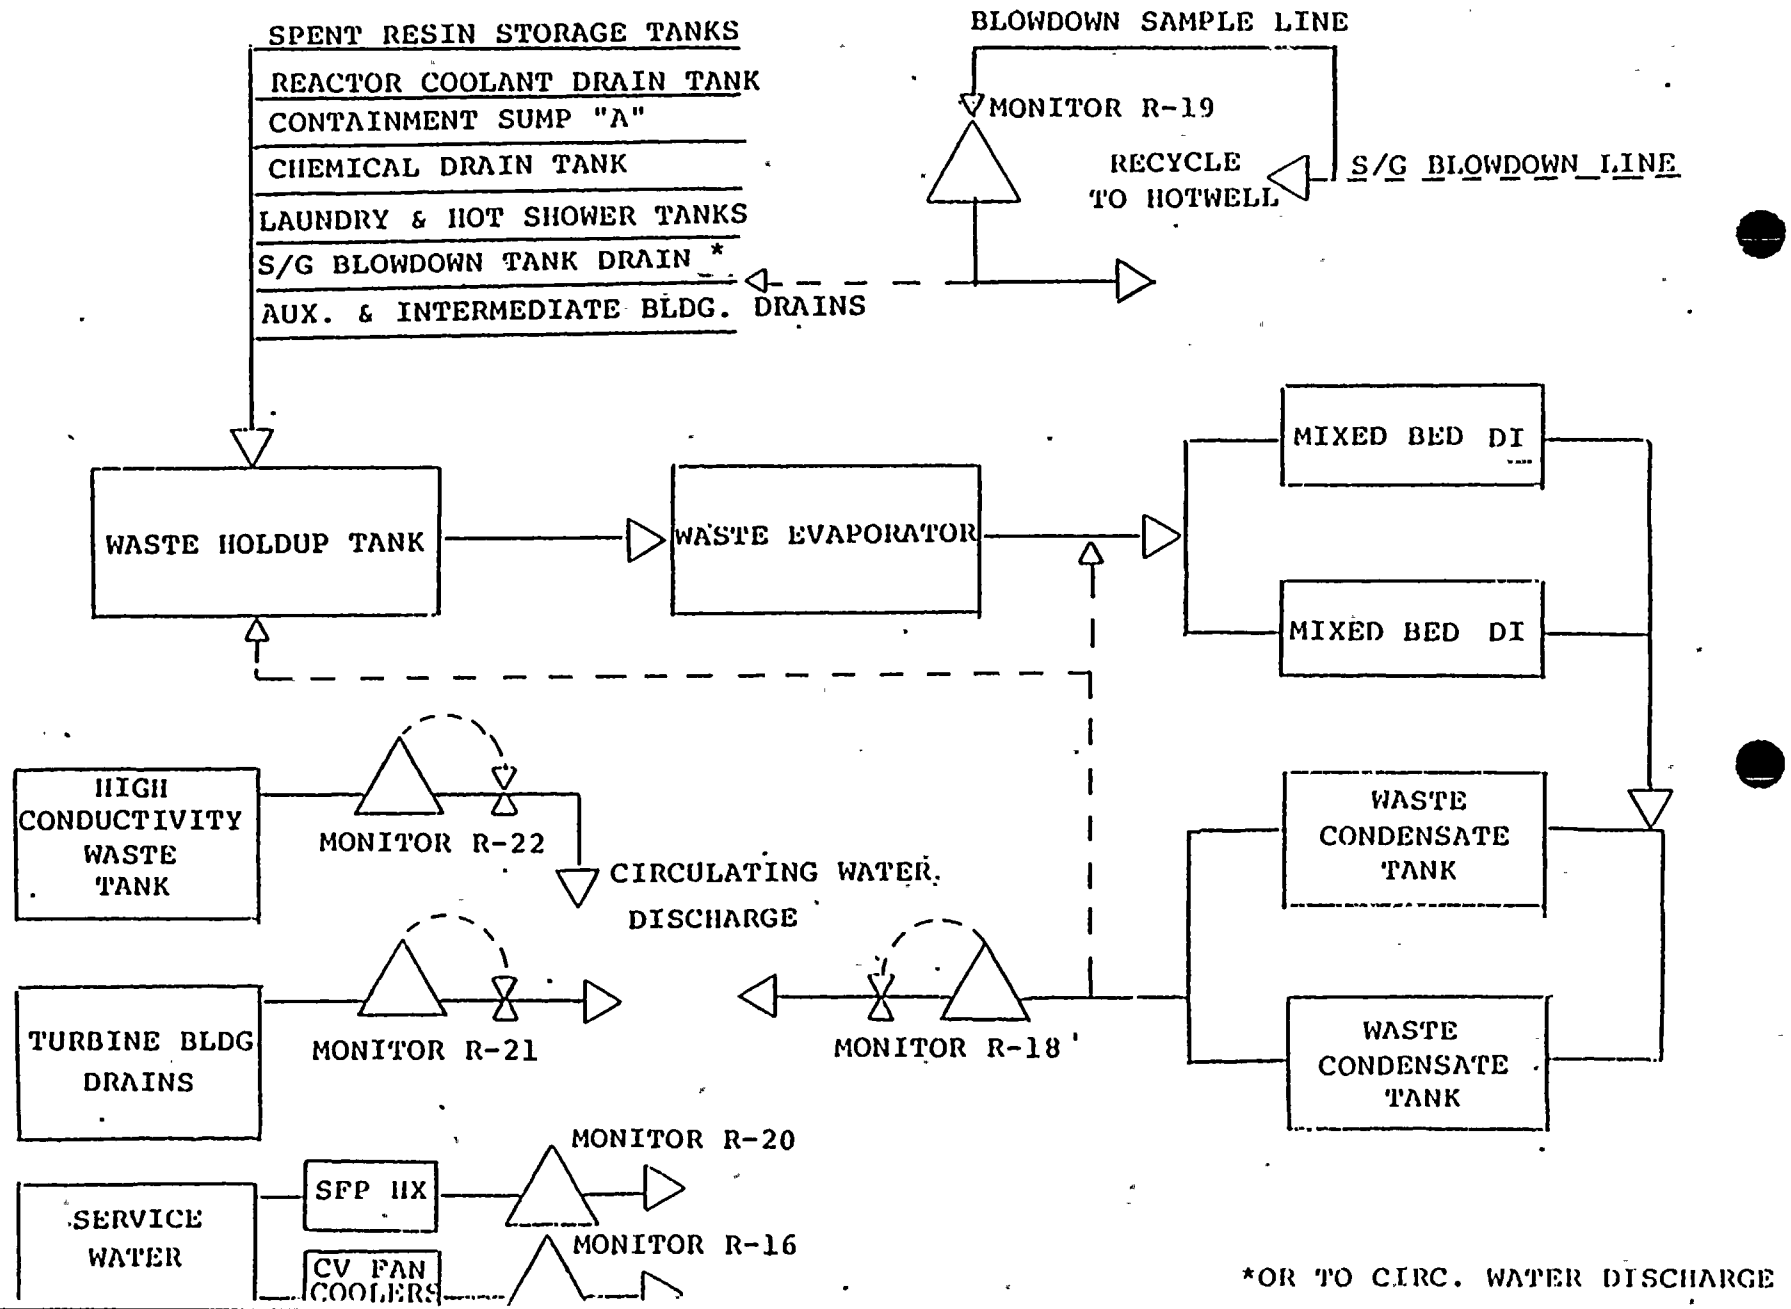

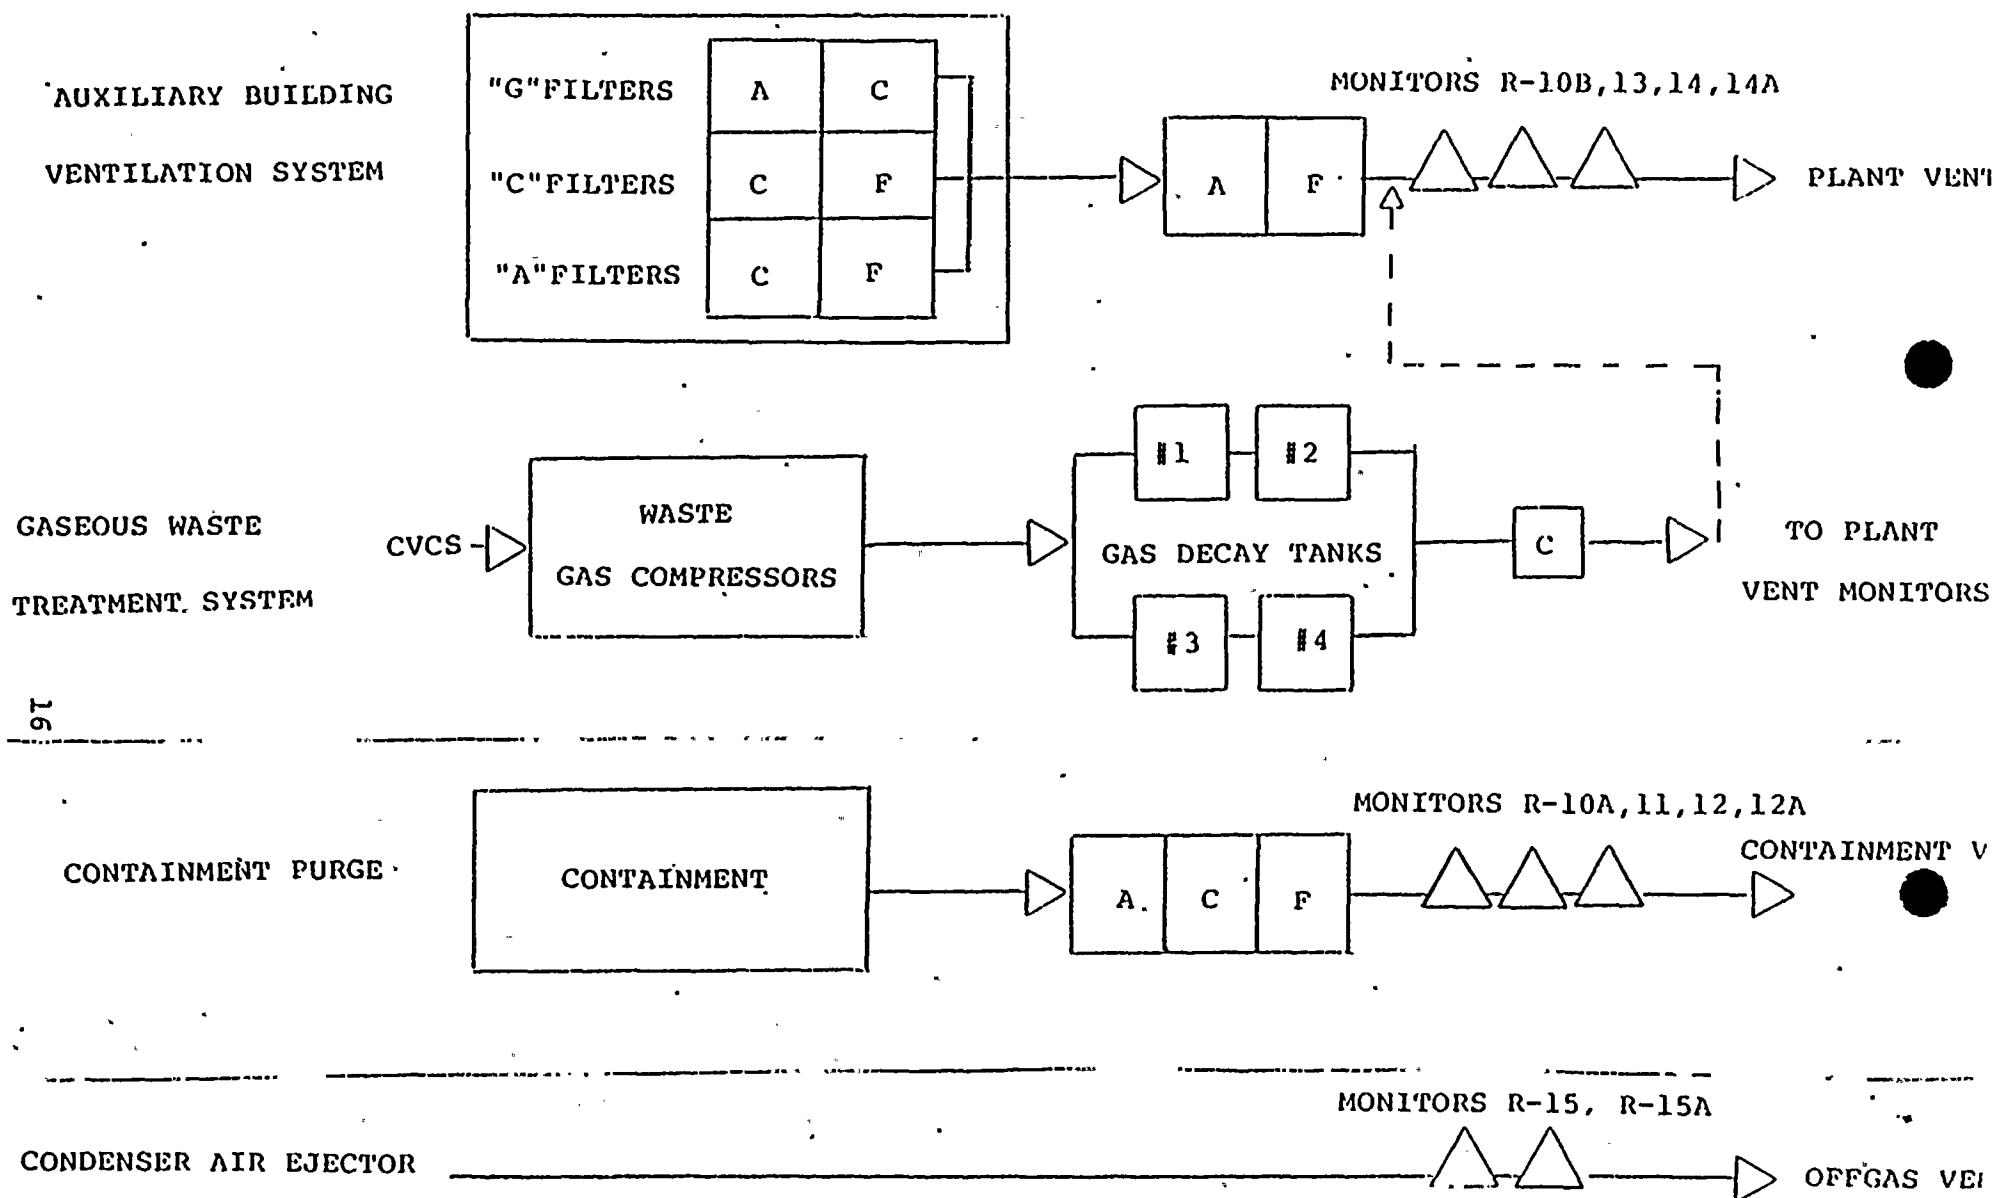

NOTE: A=HEPA FILTERS
C=CHARCOAL FILTERS
F=FANS

VI. Gaseous Effluent Dose Rate

Gaseous effluent monitor setpoints as described in Section II of this manual are established at concentrations which permit some margin for corrective action to be taken before exceeding offsite dose rates corresponding to 10 CFR Part 20 limitations. Plant procedures RD-1.1, RD-1.2, RD-1.3, RD-2, RD-3, RD-5 and RD-12 establish the methods for sampling and analysis for continuous ventilation releases and for containment purge releases. Plant procedure RD-6 establishes the methods for sampling and analysis prior to gas decay tank releases. The instantaneous dose rate in unrestricted areas due to unplanned releases of airborne radioactive materials may be averaged over a 24-hour period according to Technical Specification 3.9.2.1.b. Dose rate shall be determined using the following expressions:

For noble gases:

$$\text{Equation (8): } D = \sum_i [K_i \overline{(X/Q)}_v Q_{iv}] \leq 500 \text{ mrem/yr (to total body)}$$

$$\text{Equation (9): } D = \sum_i [(L_i + 1.1 M_i) \overline{(X/Q)}_v Q_{iv}] \leq 3000 \text{ mrem/yr (total gamma \& beta dose to the skin)}$$

For radioiodines, radioactive materials in particulate form, and radionuclides other than noble gases.

$$\text{Equation (10): } D = \sum [P_i W_v Q_{iv}] \leq 1500 \text{ mrem/yr (critical organ)}$$

K_i = The total body dose factor due to gamma emissions for each identified noble gas radionuclide, (in mrem/yr per $\mu\text{Ci}/\text{m}^3$ from Table 2).

L_i = The skin dose factor due to beta emissions for each identified noble gas radionuclide, (in mrem/yr per $\mu\text{Ci}/\text{m}^3$ from Table 2).

M_i = The air dose factor due to gamma emissions for each identified noble gas radionuclide, (in mrad/yr per $\mu\text{Ci}/\text{m}^3$ from Table 2), (unit conversion constant of 1.1 mrem/mrad converts air dose to skin dose).

P_i = The dose parameter for radionuclides other than noble gases for the inhalation/pathway, in mrem/yr per $\mu\text{Ci}/\text{m}^3$ and for food and ground plane pathways, (in $\text{m}^2 \cdot \text{mrem/yr per } \mu\text{Ci/sec}$) from Table 1. The dose factors are based on the critical individual organ and most restrictive age group.

$\overline{(X/Q)}_v$ = The highest calculated annual average relative concentration for any area at or beyond the unrestricted area boundary, (in sec/m^3).

W_v = The highest annual average dispersion parameter for estimating the dose to the critical receptor; (in sec/m^3 for the inhalation pathway, and in m^2 for the food and ground pathways).

Q_{iv} = the release rate of radionuclide i from vent (v), (in $\mu\text{Ci/sec}$).

VII. Gaseous Effluent Doses

The air dose in unrestricted areas due to noble gases released in gaseous effluents from the site shall be determined using the following expressions:

During any calendar year, for gamma radiation:

$$\text{Equation (11): } D_{\gamma} = 3.17 \times 10^{-8} \sum_i [M_i \overline{(X/Q)}_v \tilde{Q}_{iv}] \leq 10 \text{ mrad, and}$$

During any calendar year for beta radiation:

$$\text{Equation (12): } D_{\beta} = 3.17 \times 10^{-8} \sum_i [N_i \overline{(X/Q)}_v \tilde{Q}_{iv}] \leq 20 \text{ mrad}$$

Where:

M_i = The air dose factor due to gamma emissions for each identified noble gas radionuclide, (in mrad/yr per $\mu\text{Ci}/\text{m}^3$ from Table 2).

N_i = The air dose factor due to beta emissions for each identified noble gas radionuclide, (in mrad/yr per $\mu\text{Ci}/\text{m}^3$ from Table 2).

$\overline{(X/Q)}_v$ = For vent releases. The highest calculated annual average relative concentration for any area at or beyond the unrestricted area boundary, including uninhabited areas, (in sec/m^3).

D_{γ} = The total gamma air dose from gaseous effluents, (in mrad).

D_{β} = The total beta air dose from gaseous effluents, (in mrad).

\tilde{Q}_{iv} = The release of noble gas radionuclides, i , in gaseous effluents from all vents, in μCi . Releases shall be cumulative over the time period.

3.17×10^{-8} = The inverse of the number of seconds in a year.

The dose to an individual from radioiodines and radioactive materials in particulate form with half-lives greater than 8 days in gaseous effluents released from the site to unrestricted areas shall be determined using the following expression:

During any calendar year:

$$\text{Equation (13): } D_I = 3.17 \times 10^{-8} \sum_i R_i [W_v \tilde{Q}_{iv}], \leq 15 \text{ mrad}$$

Where:

\tilde{Q}_{iv} = The release of radioiodines, and radioactive materials in particulate form in gaseous effluents, i , with half-lives greater than 8 days, (in μCi). Releases shall be cumulative over the desired time period as appropriate.

D_I = The total dose from radioiodines and radioactive materials in particulate form with half-lives greater than 8 days in gaseous effluents, (in mrem).

W_v = The annual average dispersion parameter for estimating the dose to an individual at the critical location; (in sec/m^3 for the inhalation pathway, and in m^2 for the food and ground pathways).

R_i = The dose factor for each identified radionuclide, i , (in $\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$ or mrem/yr per $\mu\text{Ci}/\text{m}^3$ from Table 9).

VIII. Environmental Monitor Sample Locations

Figure 3 shows the onsite* indicator sample locations for airborne particulates, radioiodine and direct radiation. Respective sample locations are specified below. Also indicated on Figure 3 is the onsite vegetable garden, as well as the placement of post-accident TLD's (locations 13-24). The onsite garden is located in the sector having the highest D/Q value.

Figure 4 gives the location of the only milk herds within 5 miles of the plant. On this map is also included the Ontario Water District intake pumping station where lake water is sampled prior to treatment.

Figure 5 shows the offsite control sample locations for airborne particulates, radioiodine and direct radiation. Sample stations 9 and 11 are situated near population centers (Webster and Williamson) located approximately 7 miles from the Ginna site.

Key to Figures 3 to 5:

<u>Type</u>		<u>Location</u>
Radioiodine:	2 onsite	#4 and 7
	2 offsite	#9 and 11
Particulate:	7 onsite	#2, 3, 4, 5, 6, 7 and 13
	5 offsite	#8, 9, 10, 11 and 12
Direct Radiation:		
	TLD	
	18 onsite	#2, 3, 4, 5, 6, 7, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23 and 24
	10 4-5 miles	#31, 32, 33, 34, 35, 36, 37, 38, 39 and 40
	11 >5 miles	#8, 9, 10, 11, 12, 25, 26, 27, 28, 29 and 30
Surface Water	1 control (Russell Station)	
	1 indicator (Ginna Condenser Water Discharge)	
Drinking Water	1 indicator (Ontario Water District Intake)	
Milk	1 control (#4)	
	3 indicator (#1 2, 3)	
Fish	4 control	
	4 indicator (offshore at Ginna)	
Food Products	1 control	
	2 indicator (onsite)	

Note: "Onsite" refers to the area surrounding the Ginna plant bounded by RG&E property lines. "Offsite" refers to the area beyond the immediate RG&E property.

FIGURE 3

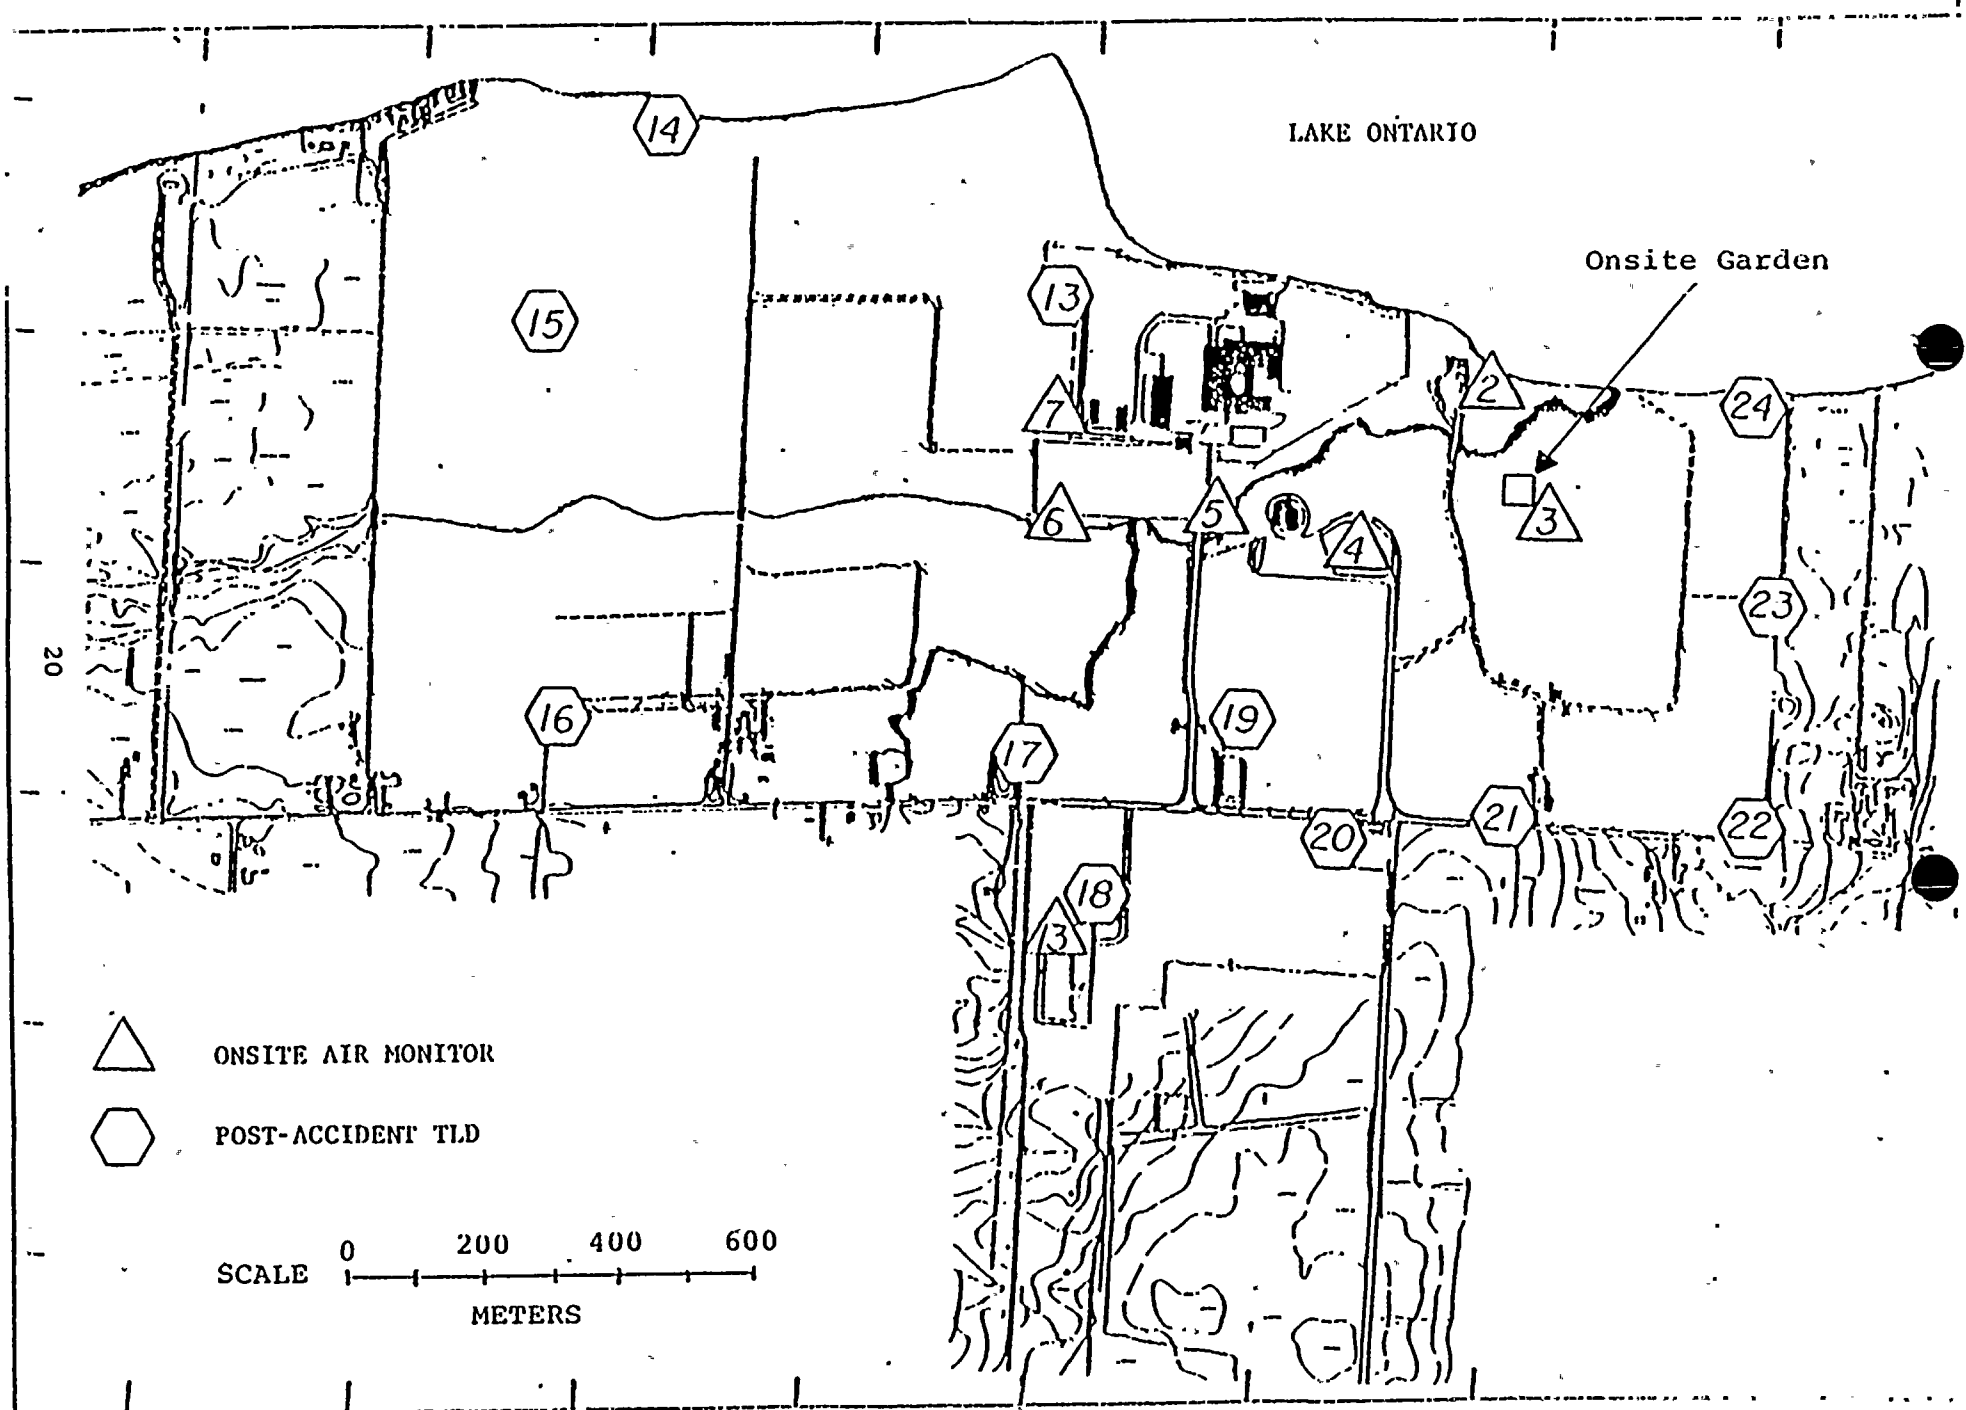


FIGURE 4



Water Sample Station



Milk Sample Station

LAKE ONTARIO

10 MILES

15 MILES

5 MILES

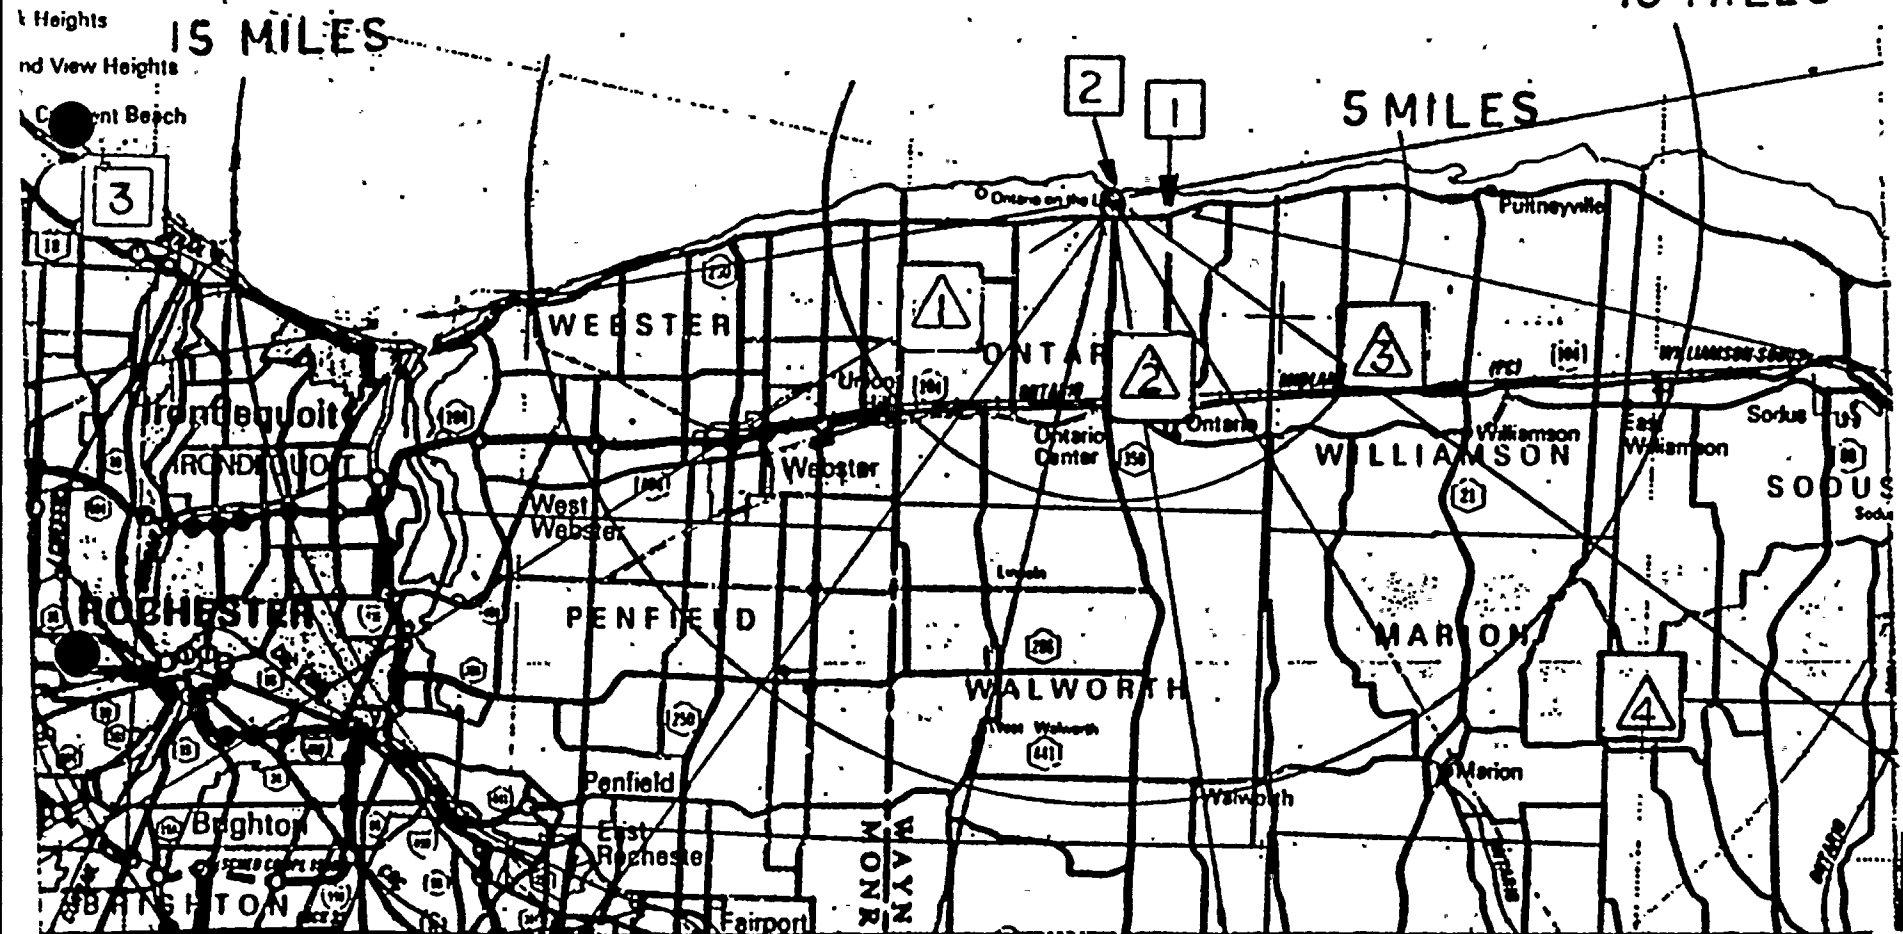
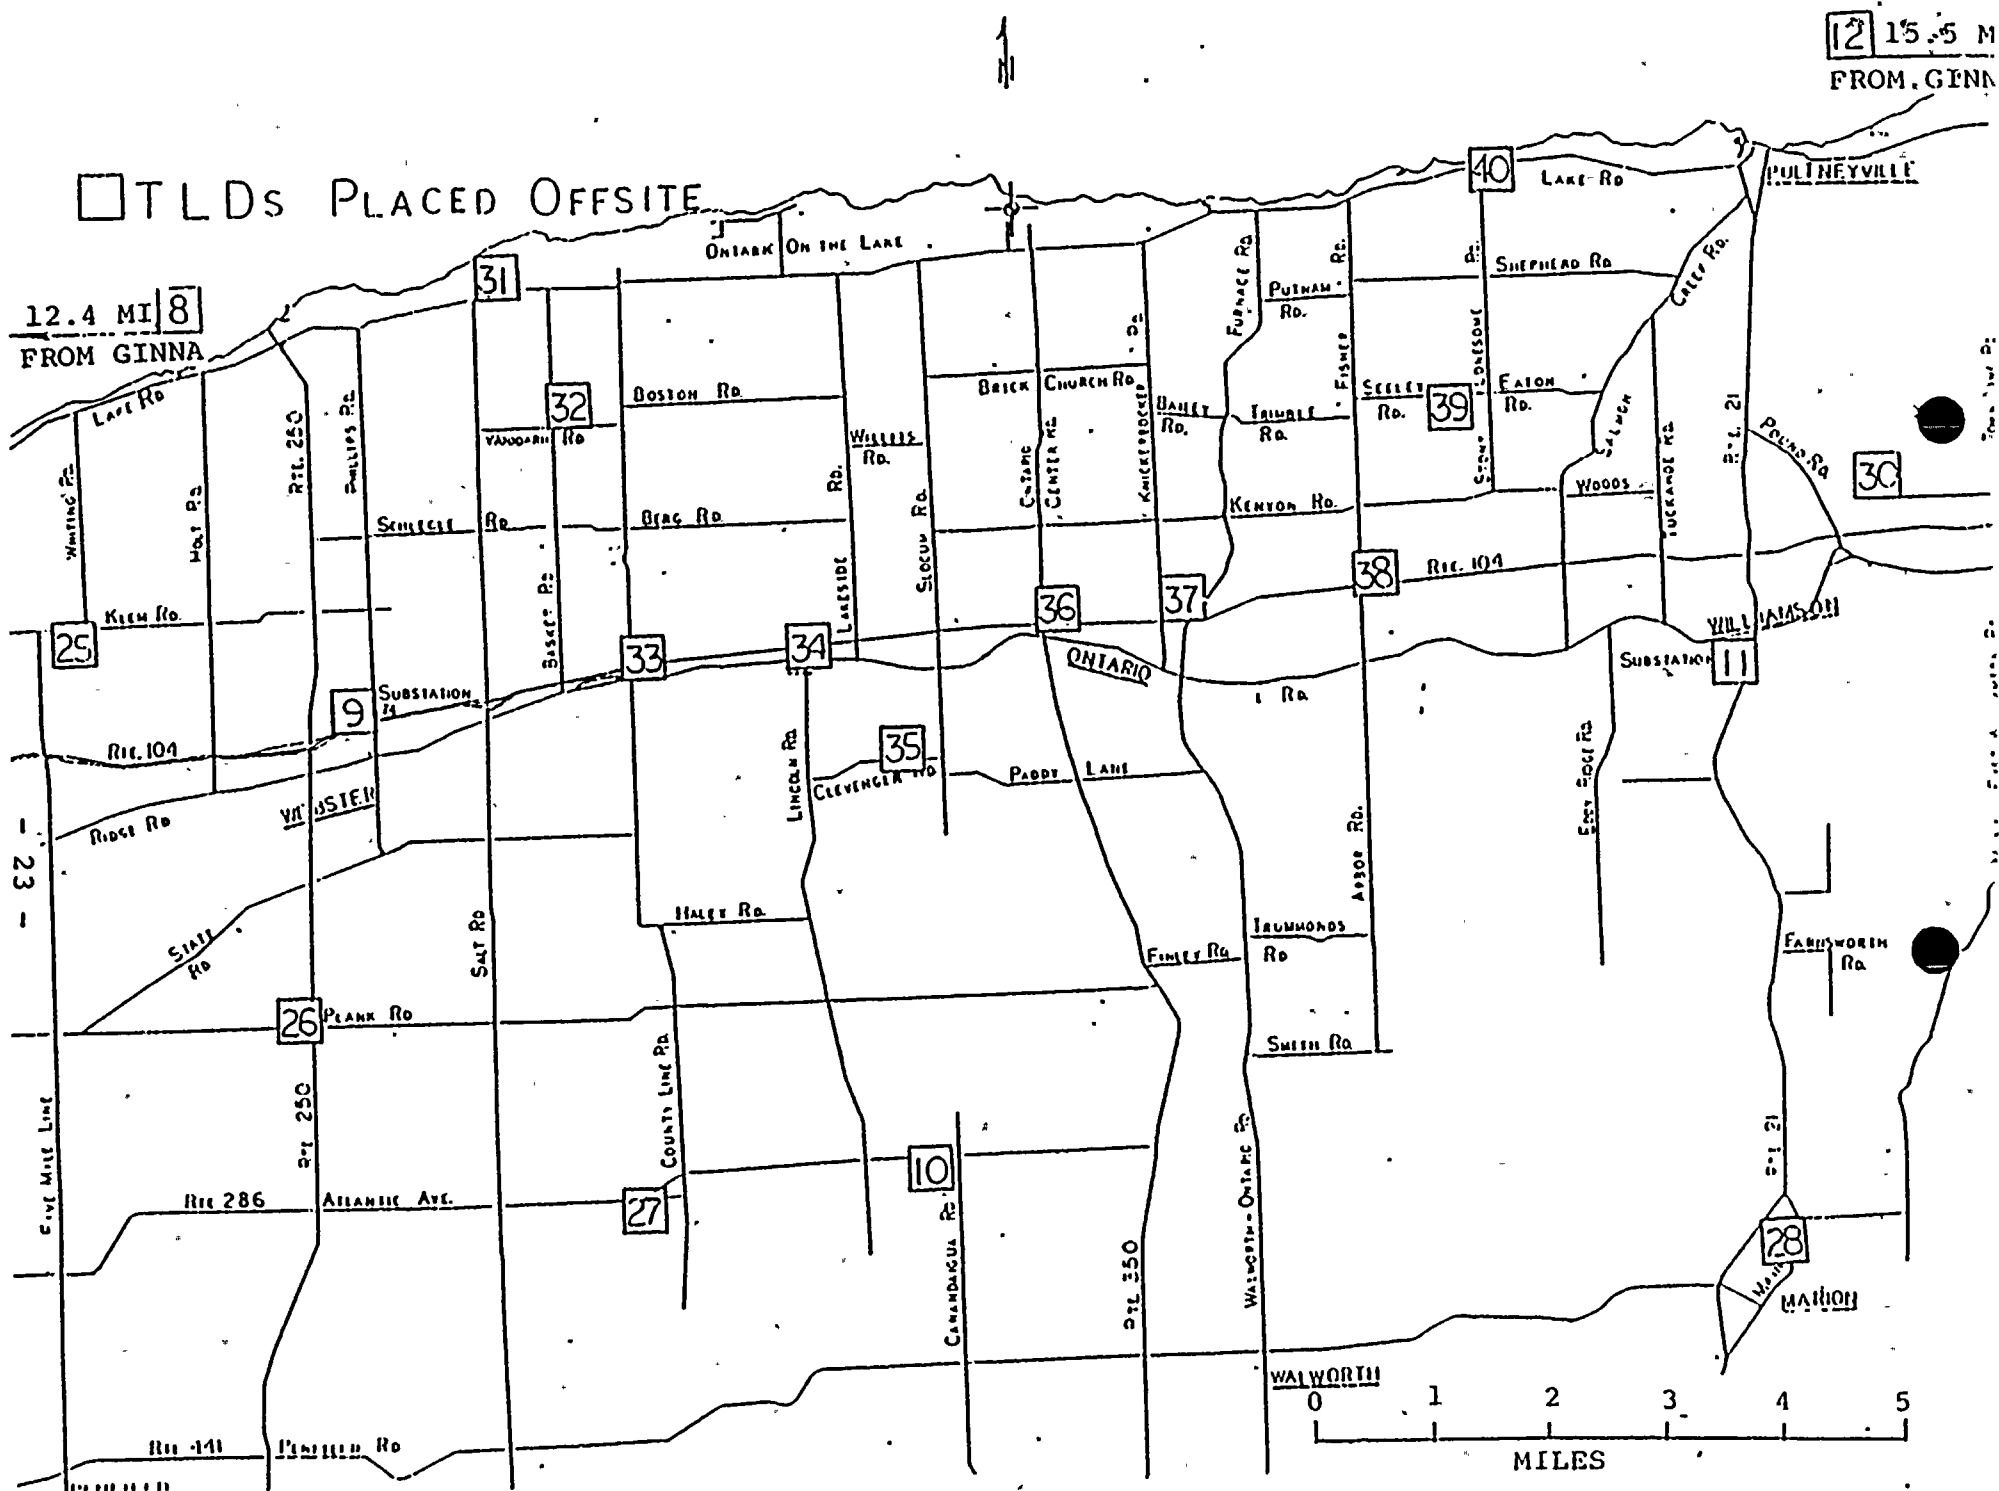


FIGURE 5



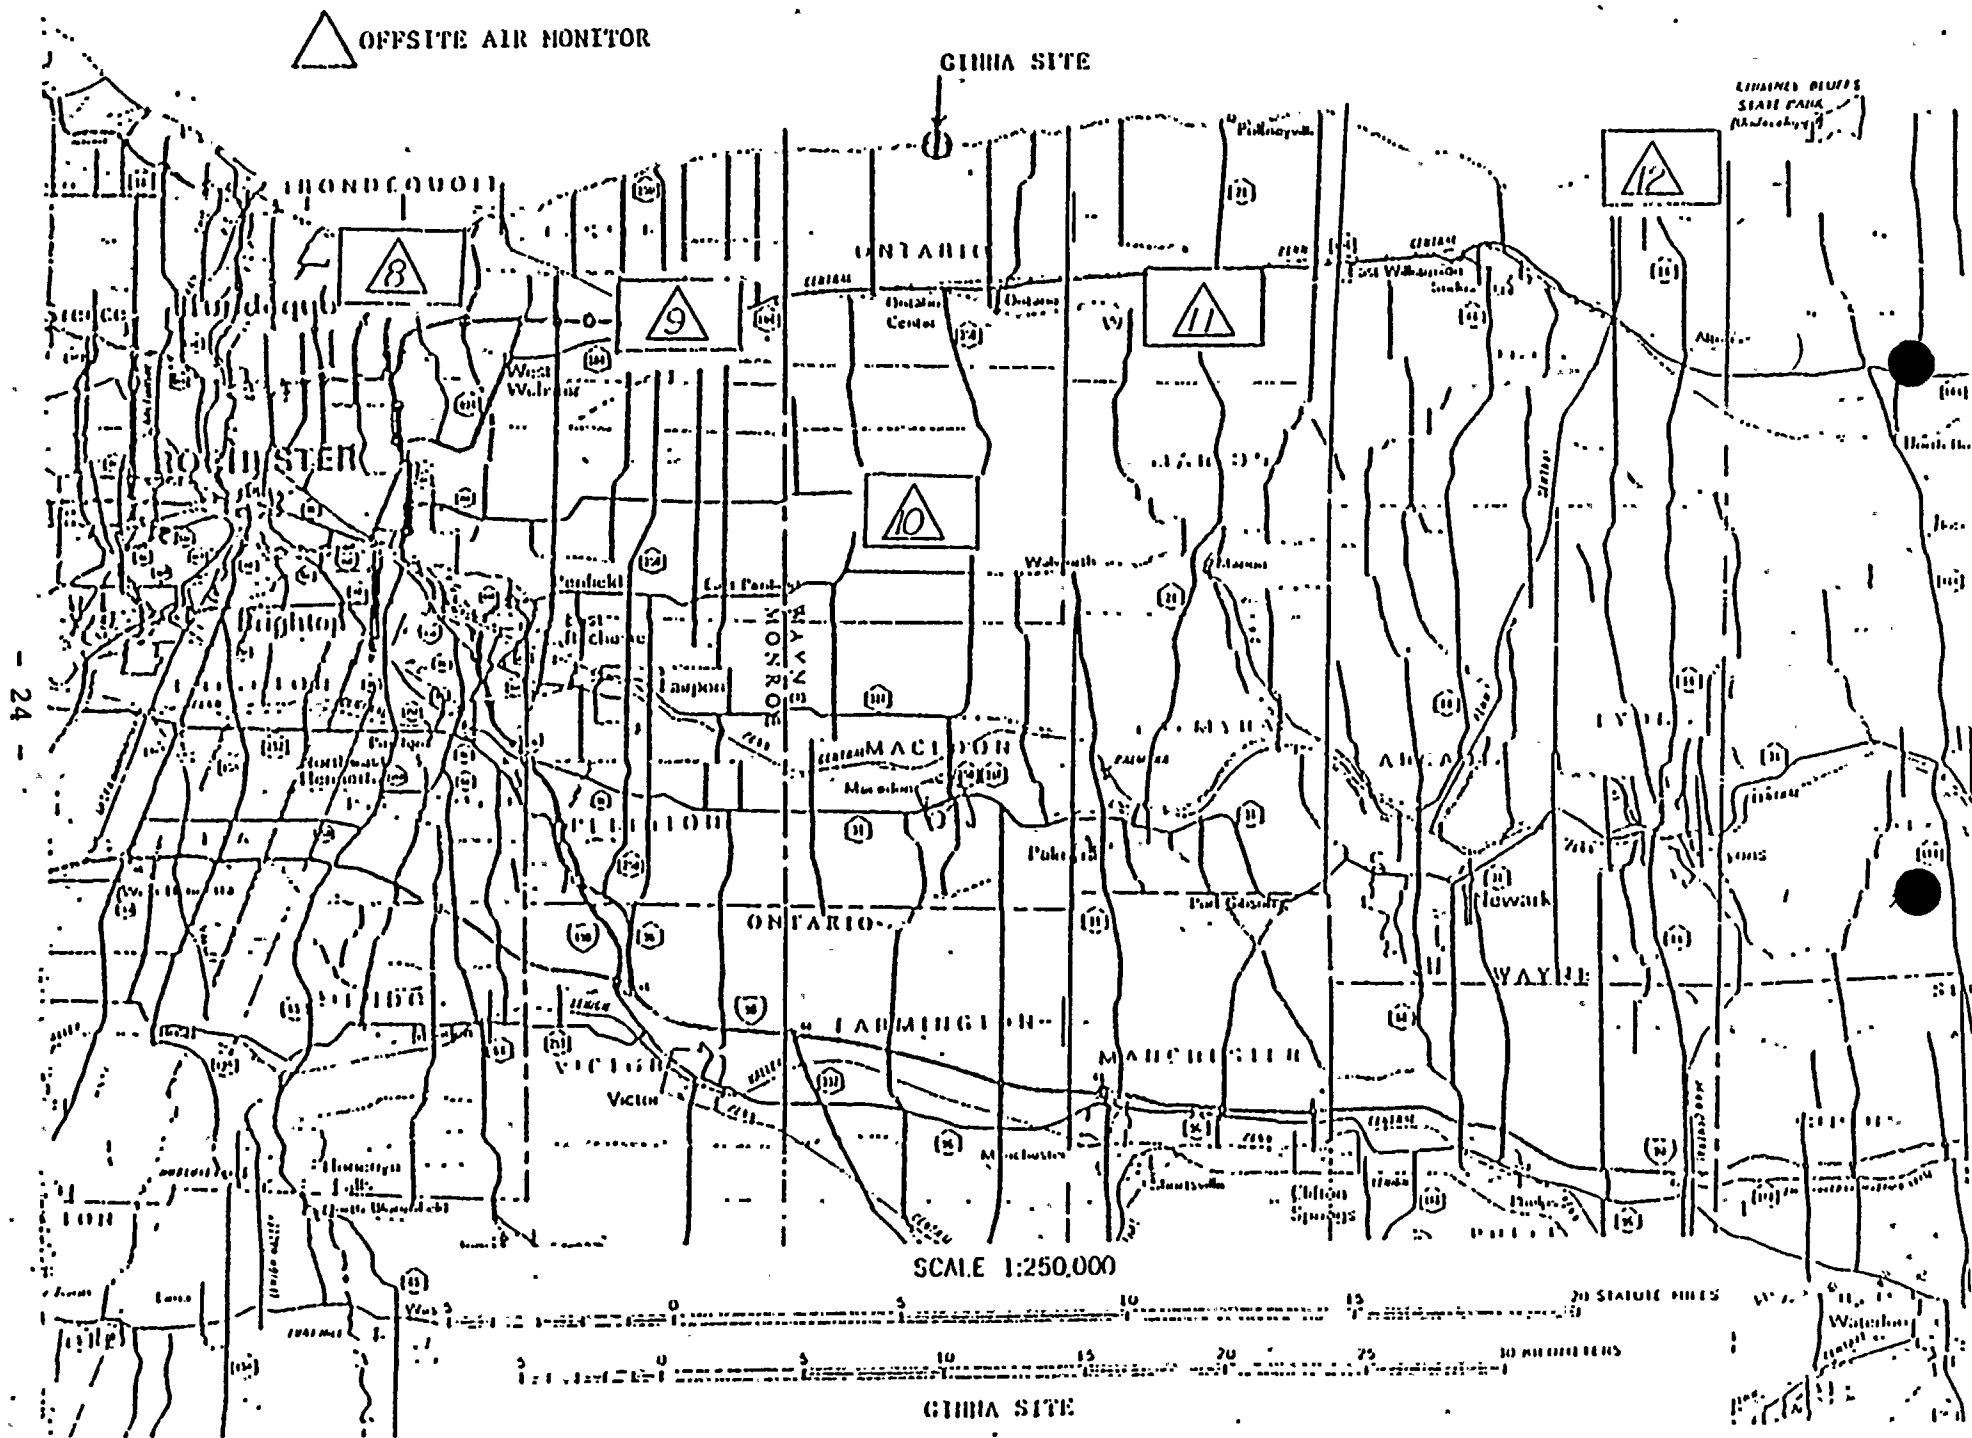


TABLE 3

DISPERSION PARAMETER (\bar{X}/Q) FOR LONG TERM RELEASES > 500 HR/YR OR > 125 HR/QTR

Plant Vent

Distance to the control location, in miles

Sector*	0-0.5	0.5-1.0	1.0-1.5	1.5-2.0	2.0-2.5	2.5-3.0	3.0-3.5	3.5-4.0	4.0-4.5	4.5-5.0
N	8.8 E-6	2.1 E-6	1.0 E-6	4.7 E-7	2.5 E-7	1.8 E-7	1.3 E-7	1.1 E-7	9.4 E-8	8.2 E-8
NNE	7.4 E-6	1.7 E-6	9.2 E-7	4.5 E-7	2.5 E-7	1.8 E-7	1.4 E-7	1.2 E-7	9.9 E-8	9.0 E-8
NE	9.7 E-6	2.3 E-6	1.2 E-6	5.9 E-7	3.2 E-7	2.3 E-7	1.8 E-7	1.5 E-7	1.2 E-7	1.1 E-7
ENE	9.2 E-6	2.2 E-6	1.1 E-6	5.0 E-7	2.6 E-7	1.8 E-7	1.4 E-7	1.2 E-7	9.8 E-8	8.7 E-8
E	1.1 E-5	2.7 E-6	1.3 E-6	5.4 E-7	2.7 E-7	1.9 E-7	1.4 E-7	1.2 E-7	9.6 E-8	8.5 E-8
ESE	8.5 E-6	2.1 E-6	1.1 E-6	4.4 E-7	2.2 E-7	1.5 E-7	1.1 E-7	9.4 E-8	7.9 E-8	6.9 E-8
SE	6.5 E-6	1.4 E-6	6.9 E-7	3.0 E-7	1.5 E-7	1.1 E-7	8.5 E-8	6.9 E-8	5.6 E-8	4.8 E-8
SSE	3.6 E-6	1.1 E-6	5.0 E-7	2.3 E-7	1.2 E-7	8.4 E-8	6.3 E-8	5.2 E-8	4.2 E-8	3.5 E-8
S	2.1 E-6	8.8 E-7	4.5 E-7	1.9 E-7	1.0 E-7	7.6 E-8	5.9 E-8	4.8 E-8	4.0 E-8	3.3 E-8
SSW	2.0 E-6	5.8 E-7	3.4 E-7	1.8 E-7	9.6 E-8	6.8 E-8	5.3 E-8	4.5 E-8	3.8 E-8	3.2 E-8
SW	2.3 E-6	5.6 E-7	3.0 E-7	1.4 E-7	7.6 E-8	5.4 E-8	4.2 E-8	3.5 E-8	2.9 E-8	2.4 E-8
WSW	2.9 E-6	7.1 E-7	5.3 E-7	1.6 E-7	9.0 E-8	6.4 E-8	4.8 E-8	3.9 E-8	3.3 E-8	2.9 E-8
W	3.3 E-6	1.0 E-6	5.1 E-7	2.4 E-7	1.3 E-7	9.6 E-8	7.2 E-8	5.9 E-8	4.9 E-8	4.3 E-8
WNW	2.7 E-6	8.9 E-7	4.7 E-7	2.3 E-7	1.2 E-7	9.0 E-8	6.9 E-8	5.8 E-8	4.8 E-8	4.2 E-8
NW	2.0 E-6	6.4 E-7	3.6 E-7	1.8 E-7	9.8 E-8	7.4 E-8	5.7 E-8	4.6 E-8	3.9 E-8	3.4 E-8
NNW	4.3 E-6	1.2 E-6	5.7 E-7	2.7 E-7	1.4 E-7	1.0 E-7	8.0 E-8	6.7 E-8	5.6 E-8	4.9 E-8

*Direction wind blows into

TABLE 4

DISPERSION PARAMETER (D/Q) FOR LONG TERM RELEASES > 500 HR/YR OR > 125 HR/QTRPlant Vent

Distance to the control location, in miles

Sector*	0-0.5	0.5-1.0	1.0-1.5	1.5-2.0	2.0-2.5	2.5-3.0	3.0-3.5	3.5-4.0	4.0-4.5	4.5-5.0
N	8.3 E-8	1.7 E-8	6.1 E-9	2.5 E-9	1.2 E-9	7.3 E-10	5.1 E-10	4.1 E-10	2.9 E-10	2.5 E-10
NNE	4.5 E-8	1.0 E-8	3.7 E-9	1.5 E-9	7.0 E-10	4.4 E-10	3.1 E-10	2.4 E-10	1.8 E-10	1.5 E-10
NE	6.5 E-8	1.5 E-8	5.4 E-9	2.2 E-9	1.0 E-9	6.5 E-10	4.5 E-10	3.6 E-10	2.6 E-10	2.2 E-10
ENE	8.3 E-8	1.8 E-8	6.4 E-9	2.6 E-9	1.2 E-9	7.5 E-10	5.3 E-10	4.1 E-10	3.1 E-10	2.6 E-10
E	1.4 E-7	2.9 E-8	1.0 E-8	4.2 E-9	1.9 E-9	1.2 E-9	8.6 E-10	6.7 E-10	4.8 E-10	4.1 E-10
ESE	1.4 E-7	3.0 E-8	1.1 E-8	4.3 E-9	1.9 E-9	1.2 E-9	8.7 E-10	6.7 E-10	5.2 E-10	4.5 E-10
SE	1.3 E-7	2.7 E-8	9.3 E-9	3.7 E-9	1.7 E-9	1.0 E-9	7.7 E-10	6.1 E-10	4.6 E-10	4.0 E-10
SSE	5.8 E-8	1.4 E-8	4.7 E-9	1.9 E-9	8.9 E-10	5.6 E-10	4.1 E-10	3.5 E-10	2.7 E-10	2.3 E-10
S	2.8 E-8	8.6 E-9	3.1 E-9	1.3 E-9	5.8 E-10	3.8 E-10	2.9 E-10	2.4 E-10	1.8 E-10	1.6 E-10
SSW	3.1 E-8	7.8 E-9	3.1 E-9	1.3 E-9	5.9 E-10	3.7 E-10	2.7 E-10	2.2 E-10	1.8 E-10	1.5 E-10
SW	4.5 E-8	1.0 E-8	3.6 E-9	1.5 E-9	6.8 E-10	4.4 E-10	3.1 E-10	2.5 E-10	1.9 E-10	1.6 E-10
WSW	5.6 E-8	1.3 E-8	4.6 E-9	1.8 E-9	8.4 E-10	5.3 E-10	3.7 E-10	2.9 E-10	2.1 E-10	1.8 E-10
W	4.2 E-8	1.0 E-8	3.9 E-9	1.6 E-9	7.4 E-10	4.7 E-10	3.3 E-10	2.6 E-10	1.9 E-10	1.6 E-10
WNW	2.2 E-8	5.9 E-9	2.4 E-9	1.0 E-9	4.7 E-10	3.0 E-10	2.1 E-10	1.7 E-10	1.3 E-10	1.0 E-10
NW	1.5 E-8	4.1 E-9	1.7 E-9	7.0 E-10	3.3 E-10	2.1 E-10	1.5 E-10	1.2 E-10	8.8 E-11	7.4 E-11
NNW	4.0 E-8	9.2 E-9	3.5 E-9	1.4 E-9	6.6 E-10	4.2 E-10	2.9 E-10	2.3 E-10	1.7 E-10	1.4 E-10

*Direction wind blows into

TABLE 5

DISPERSION PARAMETER $(\overline{X/Q})_{cp}$ FOR LONG TERM RELEASES > 500 HR/YR OR > 125 HR/QTRContainment Purge

Distance to the control location, in miles

Sector*	0-0.5	0.5-1.0	1.0-1.5	1.5-2.0	2.0-2.5	2.5-3.0	3.0-3.5	3.5-4.0	4.0-4.5	4.5-5.0
N	3.7 E-6	1.2 E-6	7.2 E-7	3.6 E-7	2.0 E-7	1.4 E-7	1.1 E-7	9.6 E-8	8.1 E-8	7.1 E-8
NNE	3.1 E-6	1.0 E-6	6.6 E-7	3.5 E-7	2.0 E-7	1.5 E-7	1.2 E-7	1.0 E-7	8.9 E-8	7.9 E-8
NE	4.1 E-6	1.4 E-6	9.0 E-7	4.7 E-7	2.7 E-7	2.0 E-7	1.6 E-7	1.3 E-7	1.1 E-7	1.0 E-7
ENE	3.9 E-6	1.3 E-6	7.7 E-7	3.9 E-7	2.1 E-7	1.5 E-7	1.2 E-7	1.0 E-7	8.5 E-8	7.5 E-8
E	4.9 E-6	1.6 E-6	8.8 E-7	4.1 E-7	2.2 E-7	1.5 E-7	1.2 E-7	1.0 E-7	8.3 E-8	7.3 E-8
ESE	4.3 E-6	1.5 E-6	9.1 E-7	3.9 E-7	2.0 E-7	1.4 E-7	1.1 E-7	8.6 E-8	7.4 E-8	6.4 E-8
SE	4.2 E-6	1.2 E-6	6.1 E-7	2.8 E-7	1.4 E-7	9.9 E-8	8.0 E-8	6.5 E-8	5.4 E-8	4.6 E-8
SSE	2.3 E-6	9.7 E-7	4.6 E-7	2.2 E-7	1.2 E-7	8.1 E-8	6.1 E-8	5.0 E-8	4.0 E-8	3.4 E-8
S	1.3 E-6	7.7 E-7	4.1 E-7	1.9 E-7	1.0 E-7	7.4 E-8	5.8 E-8	4.7 E-8	3.8 E-8	3.2 E-8
SSW	1.2 E-6	4.5 E-7	3.3 E-7	1.7 E-7	9.5 E-8	6.7 E-8	5.3 E-8	4.5 E-8	3.7 E-8	3.2 E-8
SW	1.3 E-6	4.1 E-7	2.7 E-7	1.3 E-7	7.3 E-8	5.2 E-8	4.1 E-8	3.4 E-8	2.7 E-8	2.3 E-8
WSW	1.7 E-6	5.3 E-7	3.2 E-7	1.5 E-7	8.6 E-8	6.0 E-8	4.5 E-8	3.8 E-8	3.2 E-8	2.8 E-8
W	1.7 E-6	7.2 E-7	4.4 E-7	2.1 E-7	1.2 E-7	8.6 E-8	6.6 E-8	5.5 E-8	4.6 E-8	4.0 E-8
WNW	1.2 E-6	6.0 E-7	3.9 E-7	2.0 E-7	1.1 E-7	8.2 E-8	6.3 E-8	5.3 E-8	4.5 E-8	3.9 E-8
NW	8.5 E-7	4.4 E-7	3.0 E-7	1.6 E-7	8.9 E-8	6.5 E-8	5.1 E-8	4.3 E-8	3.5 E-8	3.2 E-8
NNW	1.8 E-6	7.0 E-7	4.4 E-7	2.2 E-7	1.2 E-7	9.0 E-8	7.1 E-8	6.0 E-8	5.0 E-8	4.4 E-8

*Direction wind blows into

TABLE 6

DISPERSION PARAMETER ($\overline{D/Q}$) FOR LONG TERM RELEASES > 500 HR/YR OR > 125 HR/QTRContainment Purge

Distance to the control location, in miles

Sector*	0-0.5	0.5-1.0	1.0-1.5	1.5-2.0	2.0-2.5	2.5-3.0	3.0-3.5	3.5-4.0	4.0-4.5	4.5-5.0
N	4.2 E-8	1.0 E-8	4.0 E-9	1.6 E-9	7.6 E-10	4.6 E-10	3.4 E-10	2.7 E-10	1.9 E-10	1.6 E-10
NNE	2.3 E-8	6.2 E-9	2.5 E-9	1.0 E-9	4.8 E-10	2.9 E-10	2.2 E-10	1.7 E-10	1.2 E-10	1.0 E-10
NE	3.4 E-8	9.3 E-9	3.7 E-9	1.5 E-9	7.1 E-10	4.5 E-10	3.2 E-10	2.5 E-10	1.8 E-10	1.6 E-10
ENE	4.2 E-8	1.1 E-8	4.3 E-9	1.8 E-9	8.3 E-10	5.3 E-10	3.8 E-10	2.9 E-10	2.1 E-10	1.8 E-10
E	7.3 E-8	1.9 E-8	7.4 E-9	3.0 E-9	1.4 E-9	9.0 E-10	6.4 E-10	5.0 E-10	3.6 E-10	3.1 E-10
ESE	9.1 E-8	2.4 E-8	9.1 E-9	3.6 E-9	1.6 E-9	9.9 E-10	7.5 E-10	5.9 E-10	4.8 E-10	4.2 E-10
SE	1.0 E-7	2.4 E-8	8.4 E-9	3.4 E-9	1.6 E-9	9.6 E-10	7.4 E-10	5.9 E-10	4.6 E-10	4.1 E-10
SSE	4.3 E-8	1.3 E-8	4.3 E-9	1.8 E-9	8.3 E-10	5.4 E-10	4.0 E-10	3.6 E-10	2.7 E-10	2.3 E-10
S	2.1 E-8	8.1 E-9	2.9 E-9	1.7 E-9	5.5 E-10	3.7 E-10	3.0 E-10	2.5 E-10	1.9 E-10	1.6 E-10
SSW	2.1 E-8	6.9 E-9	2.9 E-9	1.2 E-9	5.7 E-10	3.6 E-10	2.7 E-10	2.2 E-10	1.8 E-10	1.5 E-10
SW	3.4 E-8	8.9 E-9	3.3 E-9	1.4 E-9	6.3 E-10	4.1 E-10	3.0 E-10	2.5 E-10	1.9 E-10	1.6 E-10
WSW	4.3 E-8	1.1 E-8	4.2 E-9	1.7 E-9	7.8 E-10	4.9 E-10	3.4 E-10	2.7 E-10	2.0 E-10	1.7 E-10
W	3.0 E-8	8.8 E-9	3.4 E-9	1.4 E-9	6.5 E-10	4.2 E-10	2.9 E-10	2.3 E-10	1.7 E-10	1.4 E-10
WNW	1.2 E-8	4.5 E-9	2.0 E-9	8.4 E-10	4.0 E-10	2.6 E-10	1.8 E-10	1.4 E-10	1.1 E-10	9.1 E-11
NW	8.8 E-9	3.2 E-9	1.4 E-9	5.9 E-10	2.8 E-10	1.8 E-10	1.3 E-10	1.0 E-10	7.6 E-11	6.5 E-11
NNW	2.2 E-8	6.4 E-9	2.6 E-9	1.1 E-9	5.0 E-10	3.3 E-10	2.3 E-10	1.8 E-10	1.4 E-10	1.1 E-10

*Direction wind blows into

TABLE 7

DISPERSION PARAMETER ($\overline{X/Q}$) FOR LONG TERM RELEASES > 500 HR/YR OR > 125 HR/QTRGround Vent

Distance to the control location, in miles

Sector*	0-0.5	0.5-1.0	1.0-1.5	1.5-2.0	2.0-2.5	2.5-3.0	3.0-3.5	3.5-4.0	4.0-4.5	4.5-5.0
N	4.4 E-5	8.2 E-6	3.4 E-6	1.4 E-6	6.9 E-7	4.7 E-7	3.4 E-7	2.7 E-7	2.2 E-7	1.9 E-7
NNE	5.5 E-5	1.0 E-5	4.2 E-6	1.8 E-6	8.7 E-7	5.9 E-7	4.3 E-7	3.5 E-7	2.9 E-7	2.4 E-7
NE	6.5 E-5	1.2 E-5	5.1 E-6	2.1 E-6	1.0 E-6	6.9 E-7	5.1 E-7	4.1 E-7	3.4 E-7	2.8 E-7
ENE	4.4 E-5	8.3 E-6	3.5 E-6	1.4 E-6	6.9 E-7	4.8 E-7	3.4 E-7	2.8 E-7	2.2 E-7	1.9 E-7
E	3.7 E-5	7.1 E-6	2.9 E-6	1.2 E-6	5.7 E-7	3.7 E-7	2.8 E-7	2.2 E-7	1.8 E-7	1.5 E-7
ESE	2.6 E-5	4.8 E-6	2.0 E-6	7.8 E-7	3.8 E-7	2.5 E-7	1.8 E-7	1.5 E-7	1.1 E-7	9.9 E-8
SE	1.7 E-5	3.1 E-6	1.3 E-6	5.0 E-7	2.4 E-7	1.6 E-7	1.1 E-7	9.3 E-8	7.6 E-8	6.3 E-8
SSE	1.3 E-5	2.4 E-6	9.5 E-7	3.7 E-7	1.8 E-7	1.2 E-7	8.6 E-8	7.0 E-8	5.7 E-8	4.6 E-8
S	1.2 E-5	2.2 E-6	9.0 E-7	3.5 E-7	1.7 E-7	1.1 E-7	8.4 E-8	6.7 E-8	5.4 E-8	4.5 E-8
SSW	1.2 E-5	2.1 E-6	8.7 E-7	3.5 E-7	1.7 E-7	1.1 E-7	8.3 E-8	6.6 E-8	5.4 E-8	4.5 E-8
SW	9.7 E-6	1.7 E-6	6.8 E-7	2.7 E-7	1.3 E-7	8.7 E-8	6.3 E-8	5.1 E-8	4.1 E-8	3.4 E-8
WSW	1.4 E-5	2.4 E-6	9.9 E-7	4.0 E-7	1.9 E-7	1.3 E-7	9.3 E-8	7.6 E-8	6.3 E-8	5.2 E-8
W	2.5 E-5	4.5 E-6	1.8 E-6	7.5 E-7	3.6 E-7	2.4 E-7	1.8 E-7	1.4 E-7	1.1 E-7	9.8 E-8
WNW	2.4 E-5	4.6 E-6	1.9 E-6	7.7 E-7	3.7 E-7	2.5 E-7	1.8 E-7	1.5 E-7	1.2 E-7	9.7 E-8
NW	2.1 E-5	4.0 E-6	1.6 E-6	6.7 E-7	3.3 E-7	2.2 E-7	1.6 E-7	1.3 E-7	1.1 E-7	8.8 E-8
NNW	2.9 E-5	5.4 E-6	2.2 E-6	9.2 E-7	4.5 E-7	3.0 E-7	2.2 E-7	1.8 E-7	1.5 E-7	1.2 E-7

*Direction wind blows into

TABLE 8

DISPERSION PARAMETER ($\overline{D/Q}$) FOR LONG TERM RELEASES > 500 HR/YR OR > 125 HR/QTRGround Vent

Distance to the control location, in miles

Sector*	0-0.5	0.5-1.0	1.0-1.5	1.5-2.0	2.0-2.5	2.5-3.0	3.0-3.5	3.5-4.0	4.0-4.5	4.5-5.0
N	2.0 E-7	3.7 E-8	1.2 E-8	5.0 E-9	2.3 E-9	1.4 E-9	9.7 E-10	7.6 E-10	5.5 E-10	4.7 E-10
NNE	1.8 E-7	3.4 E-8	1.1 E-8	4.5 E-9	2.1 E-9	1.3 E-9	9.0 E-10	6.9 E-10	5.0 E-10	4.3 E-10
NE	2.5 E-7	4.5 E-8	1.5 E-8	6.1 E-9	2.8 E-9	1.7 E-9	1.1 E-9	9.2 E-10	6.9 E-10	5.8 E-10
ENE	2.1 E-7	3.9 E-8	1.3 E-8	5.3 E-9	2.4 E-9	1.5 E-9	1.0 E-9	8.0 E-10	6.0 E-10	5.0 E-10
E	2.5 E-7	4.6 E-8	1.5 E-8	6.2 E-9	2.8 E-9	1.7 E-9	1.2 E-9	9.4 E-10	7.0 E-10	5.8 E-10
ESE	2.2 E-7	4.1 E-8	1.3 E-8	5.5 E-9	2.5 E-9	1.6 E-9	1.1 E-9	8.4 E-10	6.3 E-10	5.2 E-10
SE	1.8 E-7	3.7 E-8	1.1 E-8	4.5 E-9	2.1 E-9	1.3 E-9	9.0 E-10	6.9 E-10	5.1 E-10	4.3 E-10
SSE	9.8 E-8	1.8 E-8	6.0 E-9	2.4 E-9	1.1 E-9	6.8 E-10	4.8 E-10	3.7 E-10	2.7 E-10	2.3 E-10
S	6.8 E-8	1.3 E-8	4.2 E-9	1.7 E-9	7.7 E-10	4.8 E-10	3.3 E-10	2.6 E-10	1.9 E-10	1.6 E-10
SSW	6.7 E-8	1.2 E-8	4.1 E-9	1.7 E-9	7.6 E-10	4.7 E-10	3.3 E-10	2.5 E-10	1.8 E-10	1.5 E-10
SW	7.6 E-8	1.4 E-8	4.7 E-9	1.9 E-9	8.6 E-10	5.5 E-10	3.8 E-10	2.9 E-10	2.1 E-10	1.7 E-10
WSW	9.9 E-8	1.8 E-8	6.1 E-9	1.5 E-9	1.1 E-9	6.9 E-10	4.9 E-10	3.7 E-10	2.8 E-10	2.3 E-10
W	1.1 E-7	2.0 E-8	6.7 E-9	2.7 E-9	1.2 E-9	7.5 E-10	5.4 E-10	4.1 E-10	3.0 E-10	2.5 E-10
WNW	8.9 E-8	1.6 E-8	5.4 E-9	2.2 E-9	1.0 E-9	6.3 E-10	4.3 E-10	3.3 E-10	2.5 E-10	2.1 E-10
NW	7.0 E-8	1.3 E-8	4.3 E-9	1.7 E-9	7.9 E-10	4.9 E-10	3.4 E-10	2.6 E-10	2.0 E-10	1.6 E-10
NNW	1.2 E-7	1.2 E-8	7.1 E-9	1.9 E-9	1.3 E-9	8.1 E-10	5.7 E-10	4.4 E-10	3.2 E-10	2.7 E-10

*Direction wind blows into

TABLE 9

PATHWAY DOSE FACTORS DUE TO RADIONUCLIDES OTHER THAN NOBLE GASES*

Radio-nuclide	Inhalation Pathway R_i (mrem/yr per $\mu\text{Ci}/\text{m}^3$)	Meat Pathway R_i ($\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$)	Ground Plane Pathway R_i ($\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$)	Cow-Milk-Infant Pathway R_i ($\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$)	Leafy Vegetables Pathway R_i ($\text{m}^2 \cdot \text{mrem}/\text{yr}$ per $\mu\text{Ci}/\text{sec}$)
H-3	1.12E 03	2.33E 02	0.	2.38E 03	2.47E 02
CR-51	1.70E 04	4.98E 05	5.31E 06	5.75E 06	1.63E 06
MN-54	1.57E 06	7.60E 06	1.56E 09	3.70E 07	5.38E 07
FE-59	1.27E 06	6.49E 08	3.09E 08	4.01E 08	1.10E 08
CO-58	1.10E 06	9.49E 07	4.27E 08	7.01E 07	4.55E 07
CO-60	7.06E 06	3.61E 08	2.44E 10	2.25E 08	1.54E 08
ZN-65	9.94E 05	1.05E 09	8.28E 08	1.99E 10	2.24E 08
SR-89	2.15E 06	4.89E 08	2.42E 04	1.28E 10	5.39E 09
SR-90	1.01E 08	1.01E 10	0.	1.19E 10	9.85E 10
ZR-95	2.23E 06	6.09E 08	2.73E 08	8.76E 05	1.13E 08
I-131	1.62E 07	2.60E 09	1.01E 07	4.95E 11	2.08E 10
I-133	3.84E 06	6.45E 01	1.43E 06	4.62E 09	3.88E 08
CS-134	1.01E 06	1.42E 09	7.70E 09	6.37E 10	1.96E 09
CS-136	1.71E 05	5.06E 07	1.64E 08	6.61E 09	1.60E 08
CS-137	9.05E 05	1.27E 09	1.15E 10	5.75E 10	1.80E 09
BA-140	1.74E 06	5.00E 07	2.26E 07	2.75E 08	2.03E 08
CE-141	5.43E 05	1.45E 07	1.48E 07	1.43E 07	8.99E 07

*Additional dose factors for isotopes not included in Table 9 may be calculated using the methodology described in NUREG-0133, Section 5.3.1 (reference 2).

IX. Preparation of Special Report to Demonstrate Compliance with Environmental Radiation Protection Standards

Ginna Technical Specification 3.9.2.4.a requires the preparation and submittal of a Special Report to the Commission when calculated effluent release doses exceed twice the limits of Specifications 3.9.1.2.a, 3.9.2.2.a or 3.9.2.2.b. In addition, subsequent releases are to be limited so that the dose or dose commitment to a real individual from all uranium fuel cycle sources is limited to ≤ 25 mrem to the total body or any organ (except the thyroid, which is limited to ≤ 75 mrem) for the calendar year that includes the release(s) in the Special Report. This includes the dose contributions from the calendar quarter in which the limits were exceeded and the subsequent calendar quarters within the current calendar year.

The following general guidelines are presented for preparation of the Special Report:

- 1) The maximally exposed real member of the public will generally be the same individual considered in the Technical Specification;
- 2) Dose contributions to the maximally exposed individual need only be considered to be those resulting from the Ginna plant itself. All other uranium fuel cycle facilities or operations are of sufficient distance to contribute a negligible portion of the individual's dose.
- 3) For determining the total dose to the maximally exposed individual from the major gaseous and liquid effluent pathways and from direct radiation, dose evaluation techniques used in preparing the Special Report may be those described in this manual or other applicable methods where appropriate.
- 4) The contribution from direct radiation may be estimated by effluent dispersion modelling or calculated from the results of the environmental monitoring program for direct radiation.

X. References

1. R.E. Ginna Nuclear Power Plant Unit No. 1, Appendix A to Provisional Operating License No. DPR-18, Technical Specifications, Rochester Gas and Electric Corporation, Docket No. 50-244.
2. USNRC, Preparation of Radiological Effluent Technical Specifications for Nuclear Power Plants, NUREG-0133 (October, 1978).
3. USNRC, Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I, Regulatory Guide 1.109, Revision 1 (October, 1977).
4. R. E. Ginna Nuclear Power Plant, Environmental Report, Appendix B (August, 1972).
5. R.E. Ginna Nuclear Power Plant, Calculations to Demonstrate Compliance with the Design Objectives of 10 CFR Part 50, Appendix I. Rochester Gas and Electric Corporation, (June, 1976)
6. USNRC, Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water-Cooled Reactors, Regulatory Guide 1.111, Revision 1 (July, 1977).
7. R. E. Ginna Nuclear Power Plant, Incident Evaluation, Ginna Steam Generator Tube Failure Incident January 25, 1982, Rochester Gas and Electric Corporation, (April 12, 1982).
8. Pelletier, C. A. et. al., Sources of Radioiodine at Pressurized Water Reactors, EPRI NP-939 (November, 1978).



NEW
YORK
STATE

ROCHESTER GAS AND ELECTRIC CORPORATION • 89 EAST AVENUE, ROCHESTER, N.Y. 14649-0001

TELEPHONE
AREA CODE 716 546-2700

February 29, 1988


Mr. William T. Russell
Regional Administrator
U.S. Nuclear Regulatory Commission
Region 1
631 Park Avenue
King of Prussia, Penn 19406

Dear Mr. Russell:

This Semi-annual Radioactive Effluent Release Report is being forwarded to you in accordance with the requirements of Tech Spec. Section 6.9.1.4.

We have changed the overall format of this report from our earlier submittals; however, we have kept the summary report of effluent releases in the format outlined in appendix B of Regulatory Guide 1.21 Revision 1, June 1974.

Very truly yours,


Bruce A. Snow

IE48
11

