

# EMERGENCY SHUTDOWN EQUIPMENT LOCAL CONTROL


STEAM GEN BLOWDN.  
VALVES CV 70, CV 71  
DEFEAT SWITCH

REF DWG - RGE-10905-300  
RAP

RGE 10905 SH-71, 76, 77, 81, 82, 90, 121, 300

FIRE SYSTEM  
STORAGE TANK  
LO PRESS.

HEATING  
BOILER  
PANEL

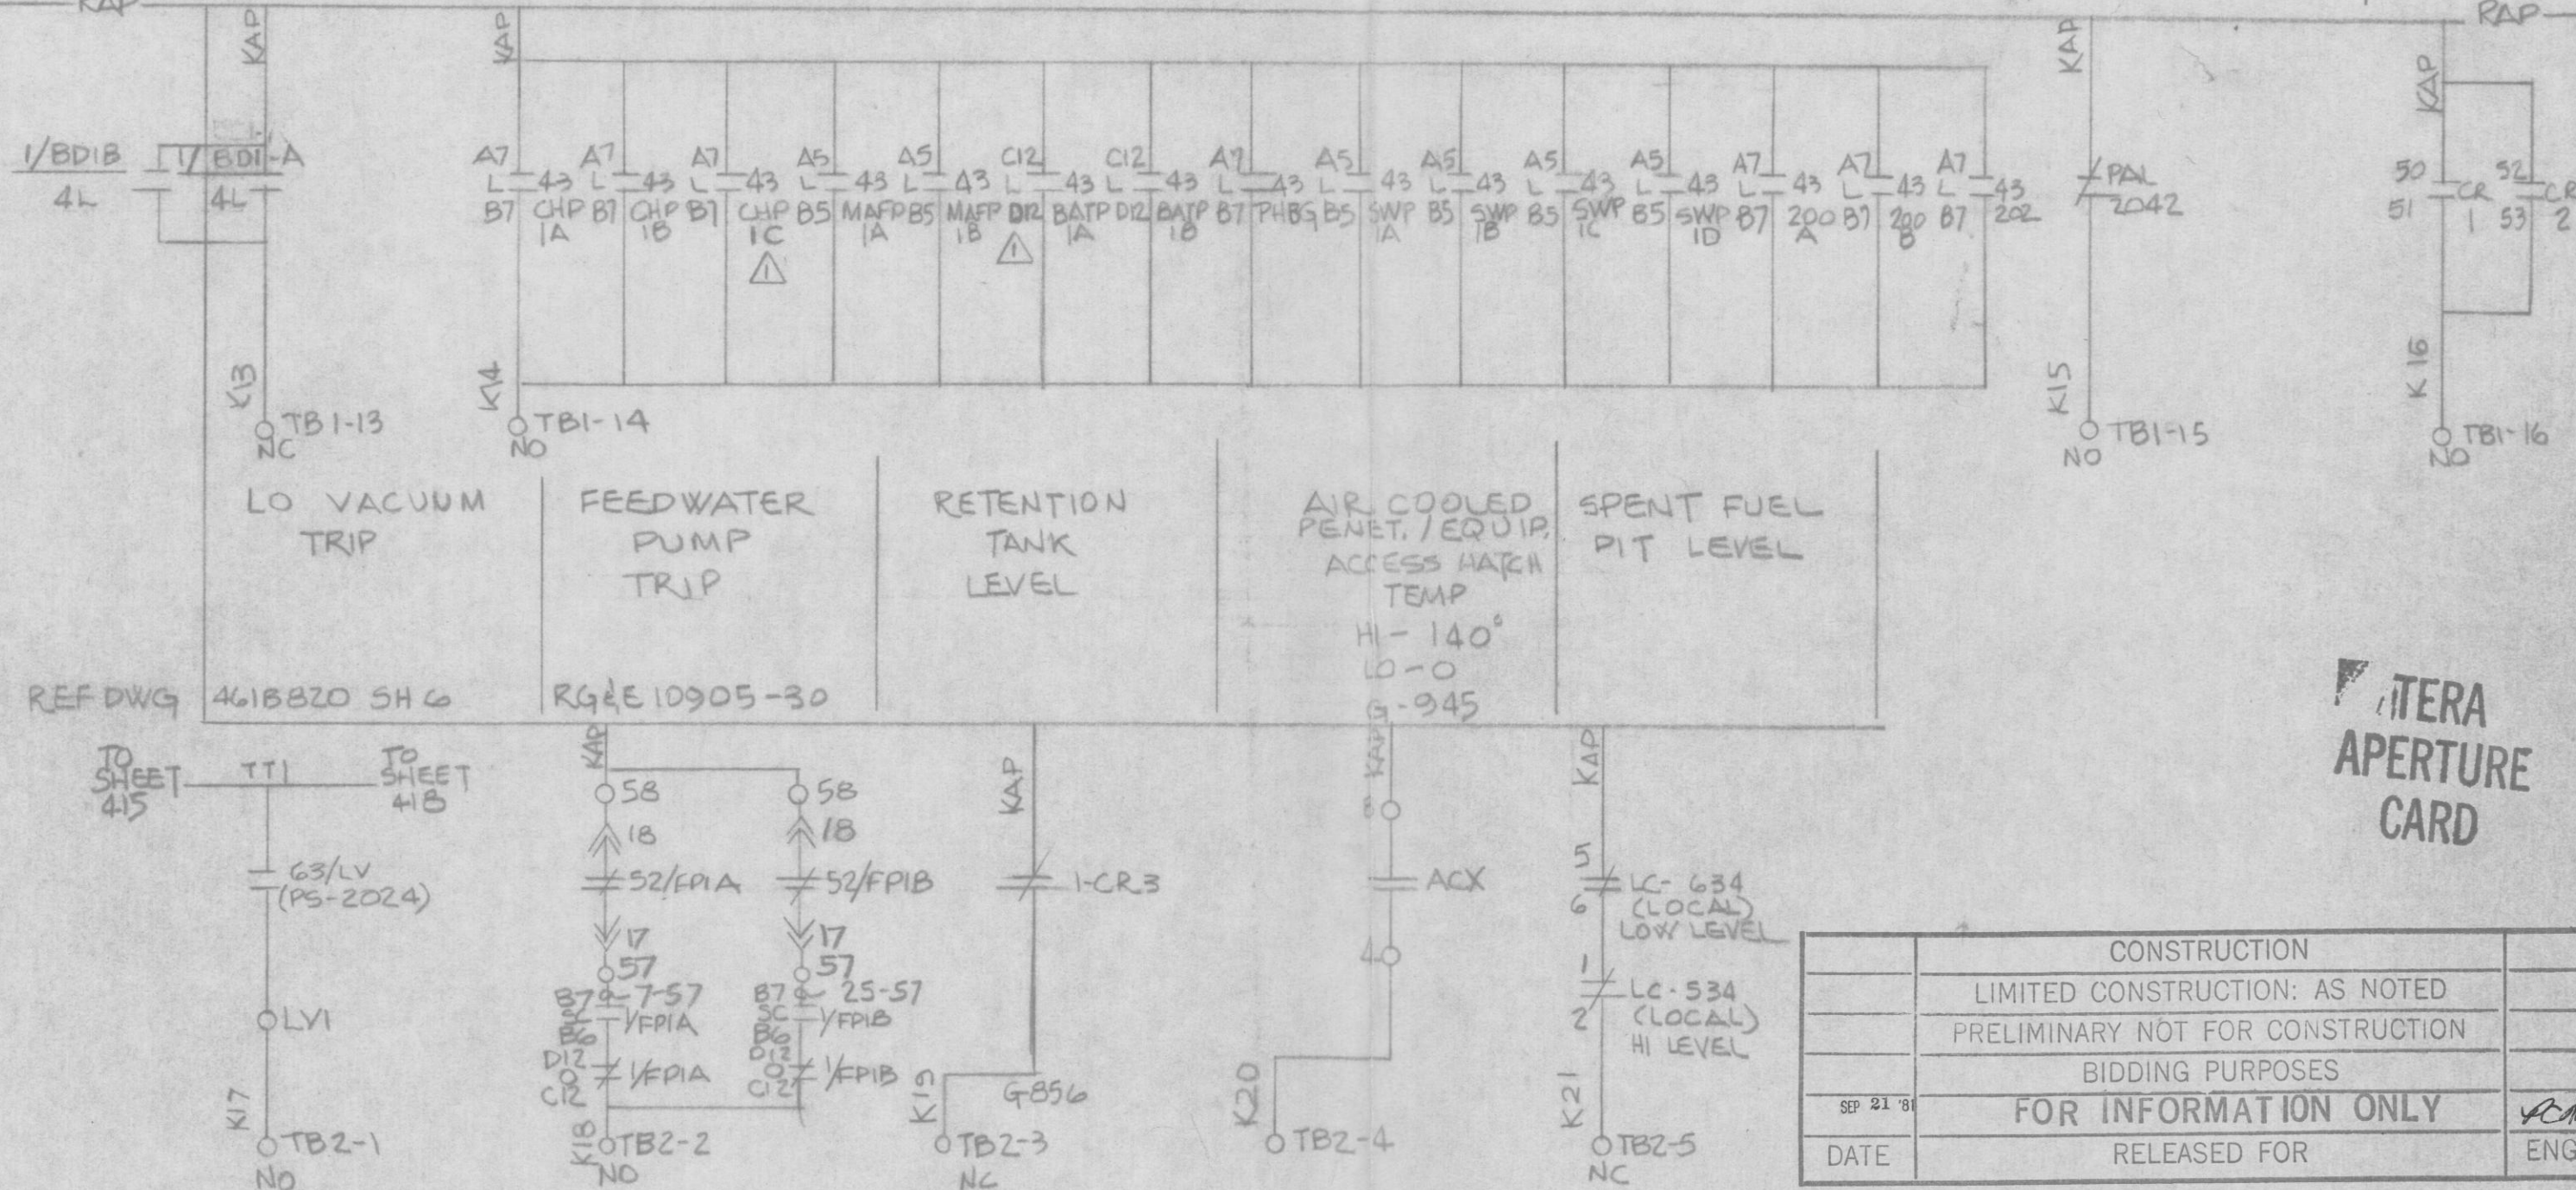

	CONSTRUCTION	
	LIMITED CONSTRUCTION: AS NOTED	
	PRELIMINARY NOT FOR CONSTRUCTION	
	BIDDING PURPOSES	
SEP 21 '81	FOR INFORMATION ONLY	RCR
DATE	RELEASED FOR	ENGR.

NOTE:

NC = JUMPER TERM. 1 & 2 ON ANN DROP  
NO = JUMPER TERM. 1 & 3 ON ANN DROP

NOTE: THIS DRAWING SUPERSEDES WESTINGHOUSE DRAWING NUMBER 4998425 SH 416

REGULATORY DOCKET FILE COPY

Docket # 50-244  
Control # 8109290350  
Date 9-22-81 of Document:  
REGULATORY DOCKET FILE

REV	DATE	BY	CHK'D	RESP	ENG'R	DATE
ORIGINAL	7/6/76	RW	RW	RES	4/20/76	
		DRAWN	CK'D	RESP	ENG'R	DATE

ROBERT EMMETT GINNA NUCLEAR POWER  
STATION UNIT NO. 1  
ELEMENTARY WIRING DIAGRAM  
ANNUNCIATOR PANEL K

ROCHESTER GAS & ELECTRIC CORP.  
ROCHESTER, NEW YORK  
ENGINEERING  
DEPT  
No. 10905-416

28C