

Washington Public Power Supply System
A JOINT OPERATING AGENCY

Central File

P. O. Box 968

3000 GEO. WASHINGTON WAY

RICHLAND, WASHINGTON 99352


PHONE (509) 375-3000

Docket Nos. ✓50-397, 50-460
50-508, 50-509
50-513

June 6, 1979

Mr. R. H. Engelken, Director
U.S. Nuclear Regulatory Commission
Region V
Suite 202, Walnut Creek Plaza
1990 N. California Boulevard
Walnut Creek, California 94596

Subject: IE BULLETIN 79-03
LONGITUDINAL WELD DEFECTS IN
STAINLESS STEEL PIPE SPOOLS

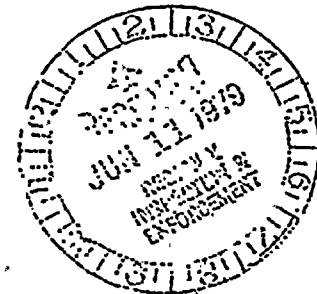

Dear Mr. Engelken:

WPPSS has reviewed the subject IE Bulletin entitled, "Longitudinal Weld Defects in ASME SA-312, Type 304, Stainless Steel Pipe Spools manufactured by Youngstown Welding and Engineering Company" and submits the following information in response:

ASME SA-312, Type 304, or other welded (without filler metal) pipe manufactured by Youngstown Welding and Engineering Company is not in use or planned for use in safety-related systems on any of the WPPSS projects, WNP-1, 2, 3, 4 or 5, Docket Nos. 50-460, 397, 508, 513 and 509 respectively.

If you have any questions, please feel free to contact me.

Very truly yours,

D. L. Renberger

D. L. RENBERGER
Assistant Director, Technology

DLR:ADCK:asm

cc: CR Bryant - BPA
D Roe - BPA
D Smithpeter - BPA
NRC - Office of Inspection & Enforcement,
Washington, DC

7908280

7908280387

A0/I
2

79-89

