

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8203170334 DOC. DATE: 82/03/03 NOTARIZED: NO DOCKET #
 FACIL: 50-397 WPPSS Nuclear Project, Unit 2, Washington Public Powe 05000397
 AUTH. NAME AUTHOR AFFILIATION
 BOUCHEY, G.D. Washington Public Power Supply System
 RECIPIENT NAME RECIPIENT AFFILIATION
 SCHWENCER, A. Licensing Branch 2

SUBJECT: Notifies that estimated 49 square ft of unqualified organic coating are inside containment, per 820205 commitment.

DISTRIBUTION CODE: B001S COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 1
 TITLE: PSAR/FSAR AMDTS and Related Correspondence

NOTES: 2 copies all matl: PM.

05000397


RECIPIENT		COPIES		RECIPIENT		COPIES	
ID CODE/NAME		LTTR	ENCL	ID CODE/NAME		LTTR	ENCL
A/D LICENSNG		1	0	LIC BR #2 BC		1	0
LIC BR #2 LA		1	0	AULUCK, R.	01	1	1
INTERNAL: ELD		1	0	IE	06	1	1
IE/DEP/EPDB	35	1	1	IE/DEP/EPLB	36	3	1
MPA		1	0	NRR/DE/CEB	11	1	1
NRR/DE/EQB	13	3	3	NRR/DE/GB	28	2	2
NRR/DE/HGEB	30	2	2	NRR/DE/MEB	18	1	1
NRR/DE/MTEB	17	1	1	NRR/DE/QAB	21	1	1
NRR/DE/SAB	24	1	1	NRR/DE/SEB	25	1	1
NRR/DHFS/HFEB40		1	1	NRR/DHFS/LQB	32	1	1
NRR/DHFS/OLB	34	1	1	NRR/DHFS/PTRB20		1	1
NRR/DSI/AEB	26	1	1	NRR/DSI/ASB	27	1	1
NRR/DSI/CPB	10	1	1	NRR/DSI/CSB	09	1	1
NRR/DSI/ETSB	12	1	1	NRR/DSI/ICSB	16	1	1
NRR/DSI/PSB	19	1	1	NRR/DSI/RAB	22	1	1
NRR/DSI/RSB	23	1	1	NRR/DST/LGB	33	1	1
REG FILE	04	1	1	RGNS		1	1
EXTERNAL: ACRS	41	16	16	BNL (AMDTS ONLY)		1	1
FEMA-REP DIV	39	1	1	LPDR	03	1	1
NRC PDR	02	1	1	NSIC	05	1	1
NTIS		1	1				

TOTAL NUMBER OF COPIES REQUIRED: LTTR

64

ENCL

0

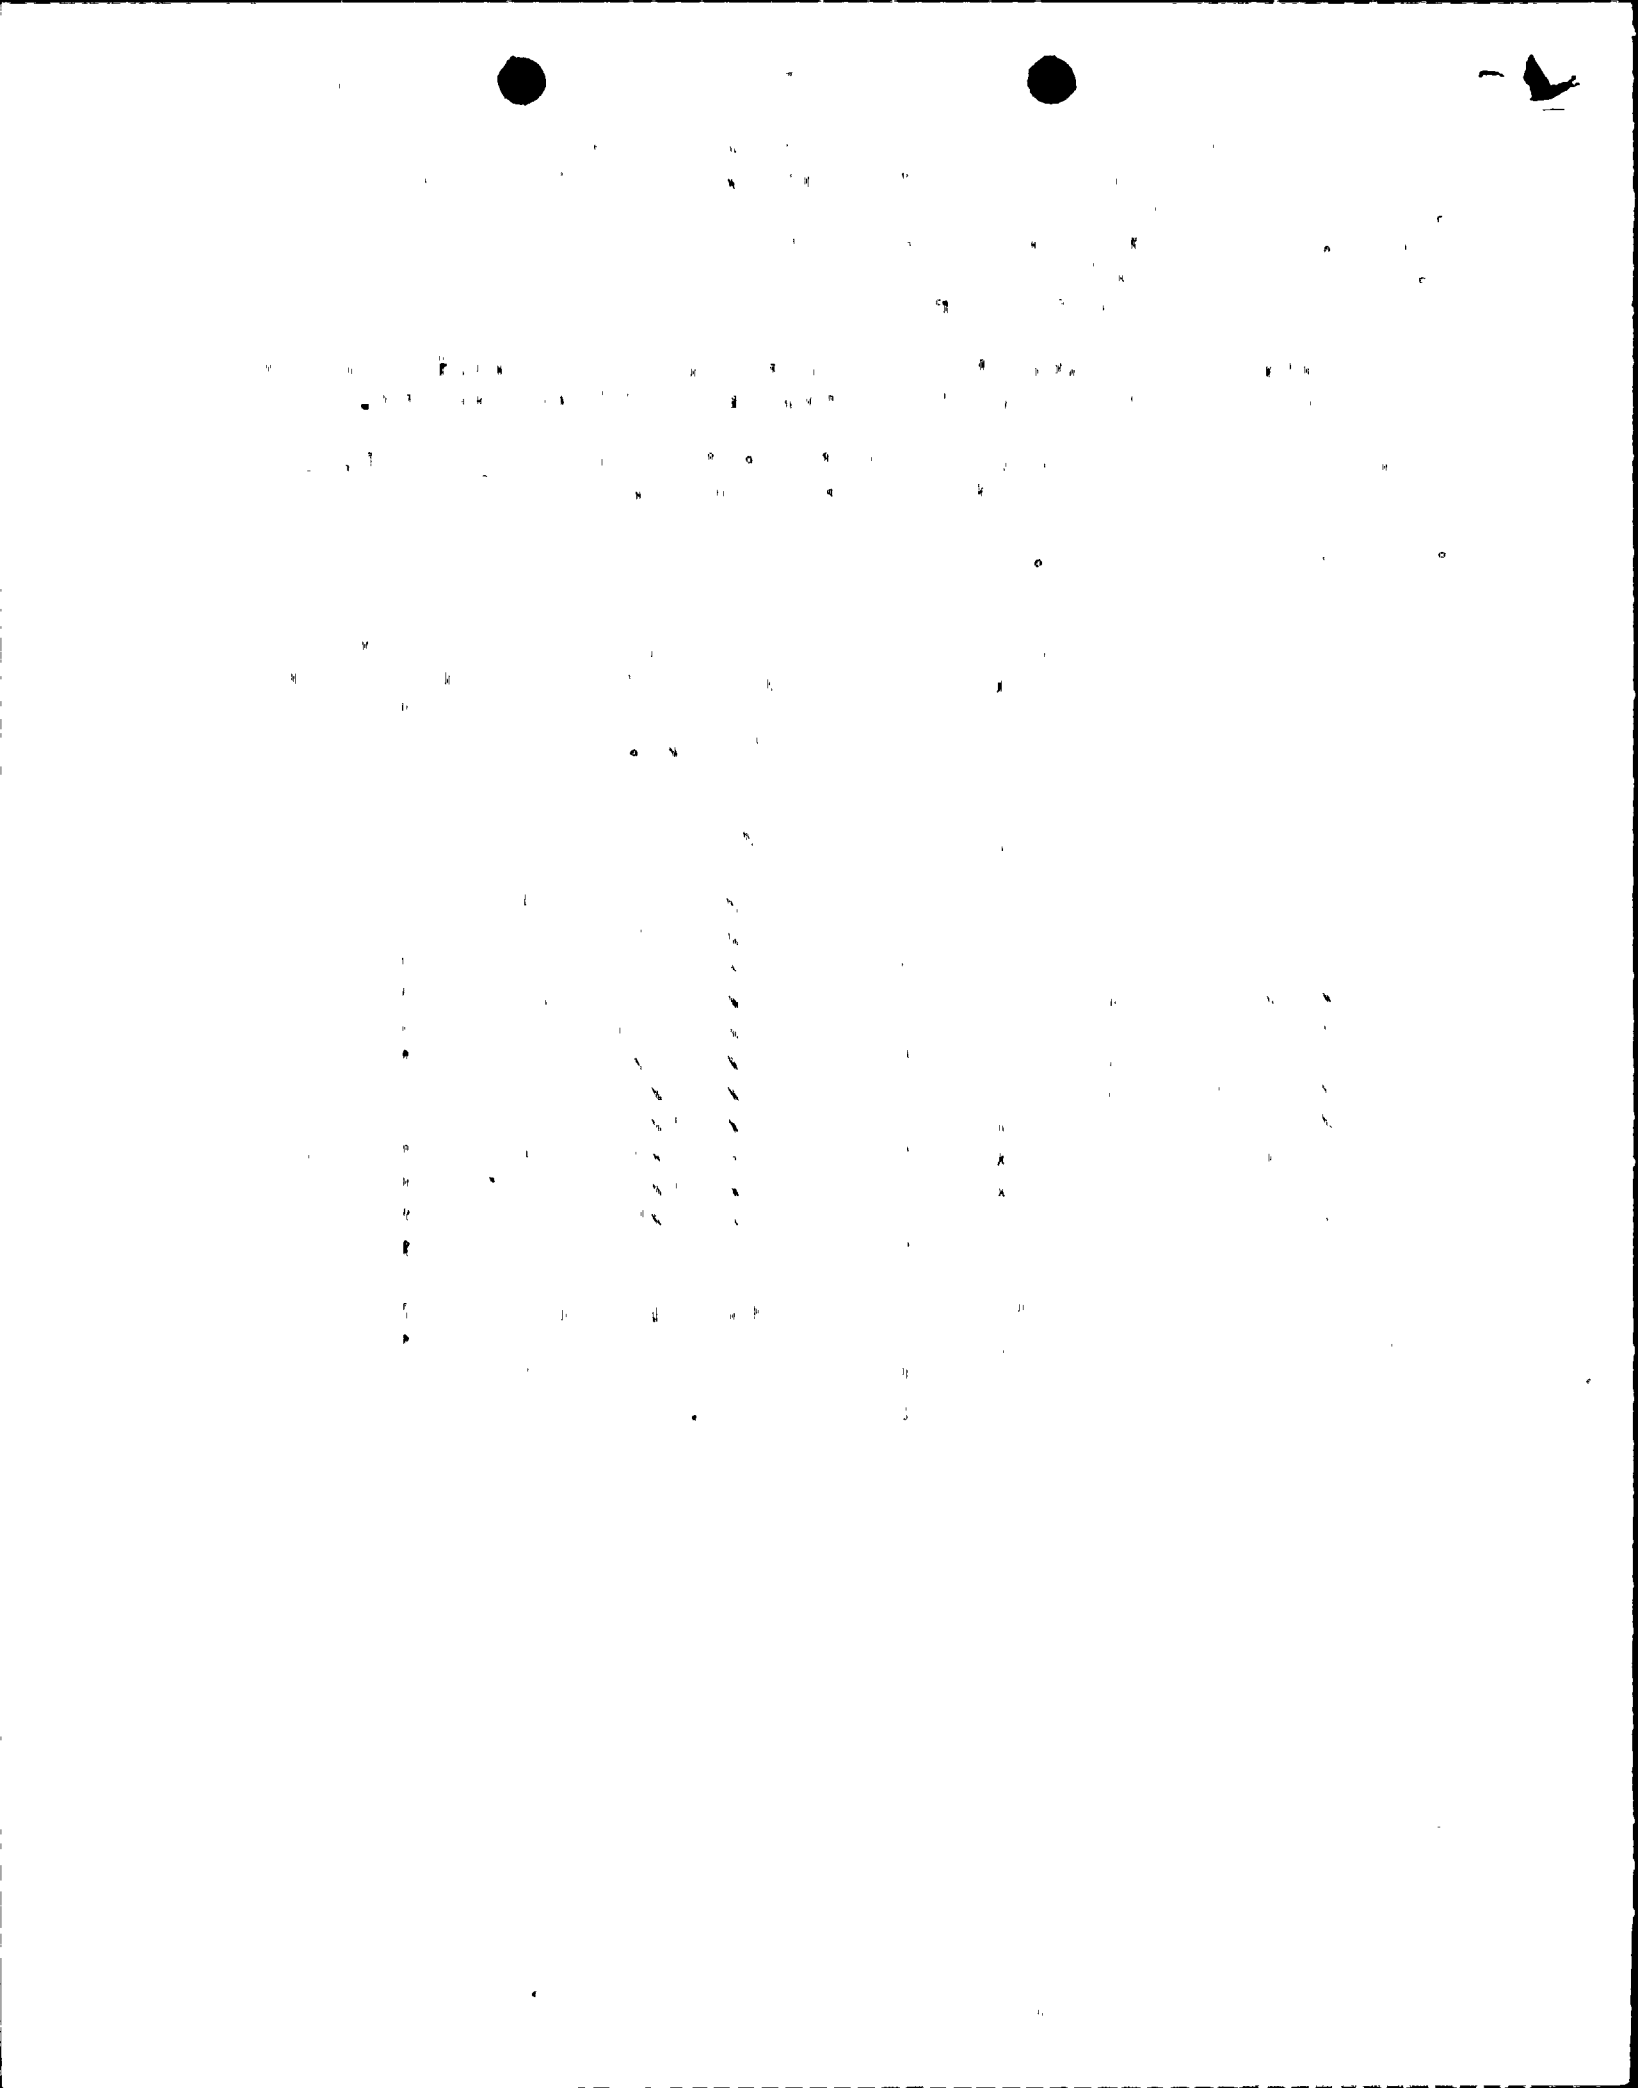


Washington Public Power Supply System

P.O. Box 968 3000 George Washington Way Richland, Washington 99352 (509) 372-5000

March 3, 1982
G02-82-287

Docket No. 50-397

Mr. A. Schwencer, Chief
Licensing Branch No. 2
Division of Licensing
U. S. Nuclear Regulatory Commission
Washington, D.C. 20555

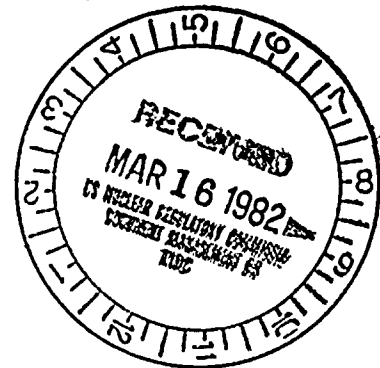

Dear Mr. Schwencer:

Subject: NUCLEAR PROJECT NO. 2
WNP-2 CONTAINMENT PROTECTIVE COATINGS

Reference: Letter G02-82-148, G.D. Bouchey (SS)
to A. Schwencer (NRC), Same Subject,
dated February 5, 1982

The reference letter committed to providing an estimate of the amount of unqualified protective coatings inside Containment at WNP-2.

There are an estimated 49 square feet of unqualified organic coating inside the Drywell.

There are an estimated 3,376 square feet of damaged inorganic zinc in the Suppression Pool vapor space area; since inorganic zinc fails as a finely divided particle and not as a flake or chip it will not be a debris source and is considered acceptable. There are also 1,837 lineal feet of non-continuous weld seams in the immersion area of the Wetwell which will be periodically inspected and maintained as necessary.

Very truly yours,

G. D. Bouchey
Deputy Director, Safety and Security

WWR/jca

cc: R AuLuck - NRC
WS Chin - BPA
R Feil - NRC Site
F Witt - NRC

Boo1
1/0

