

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8204060148 DOC. DATE: 82/03/26 NOTARIZED: NO DOCKET #
 FACIL: 50-397 WPPSS Nuclear Project, Unit 2, Washington Public Power 05000397
 AUTH. NAME AUTHOR AFFILIATION
 BOUCHEY, G.D. Washington Public Power Supply System
 RECIP. NAME RECIPIENT AFFILIATION
 SCHWENCER, A. Licensing Branch 2

SUBJECT: Forwards review of "Summary of Conformance to NRC Regulations of 10CFR20,50 & 100."

DISTRIBUTION CODE: B001S COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 2140
 TITLE: PSAR/FSAR AMDTS and Related Correspondence

NOTES: 2 copies all matl: PM.

05000397

RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
A/D LICENSNG	1 0	LIC BR #2 BC	1 0
LIC BR #2 LA	1 0	AULUCK, R. 01	1 1
INTERNAL: ELD	1 0	IE	06 1 1
IE/DEP/EPDB 35	1 1	IE/DEP/EPLB 36	3 3
MPA	1 0	NRR/DE/CEB 11	1 1
NRR/DE/EOB 13	3 3	NRR/DE/GB 28	2 2
NRR/DE/HGEB 30	2 2	NRR/DE/MEB 18	1 1
NRR/DE/MTEB 17	1 1	NRR/DE/QAB 21	1 1
NRR/DE/SAB 24	1 1	NRR/DE/SEB 25	1 1
NRR/DHFS/HFEB40	1 1	NRR/DHFS/LQB 32	1 1
NRR/DHFS/OLB 34	1 1	NRR/DHFS/PTRB20	1 1
NRR/DSI/AEB 26	1 1	NRR/DSI/ASB 27	1 1
NRR/DSI/CPB 10	1 1	NRR/DSI/CSB 09	1 1
NRR/DSI/ETSB 12	1 1	NRR/DSI/ICSB 16	1 1
NRR/DSI/PSB 19	1 1	NRR/DSI/RAB 22	1 1
NRR/DSI/RSB 23	1 1	NRR/DST/LGB 33	1 1
REG FILE 04	1 1	RGNS	2 2
EXTERNAL: ACRS 41	16 16	BNL (AMDTS ONLY)	1 1
FEMA-REP DIV 39	1 1	LPDR 03	1 1
NRC PDR 02	1 1	NSIC 05	1 1
NTIS	1 1		


TOTAL NUMBER OF COPIES REQUIRED: LTTR

65

63 ENCL

60

58

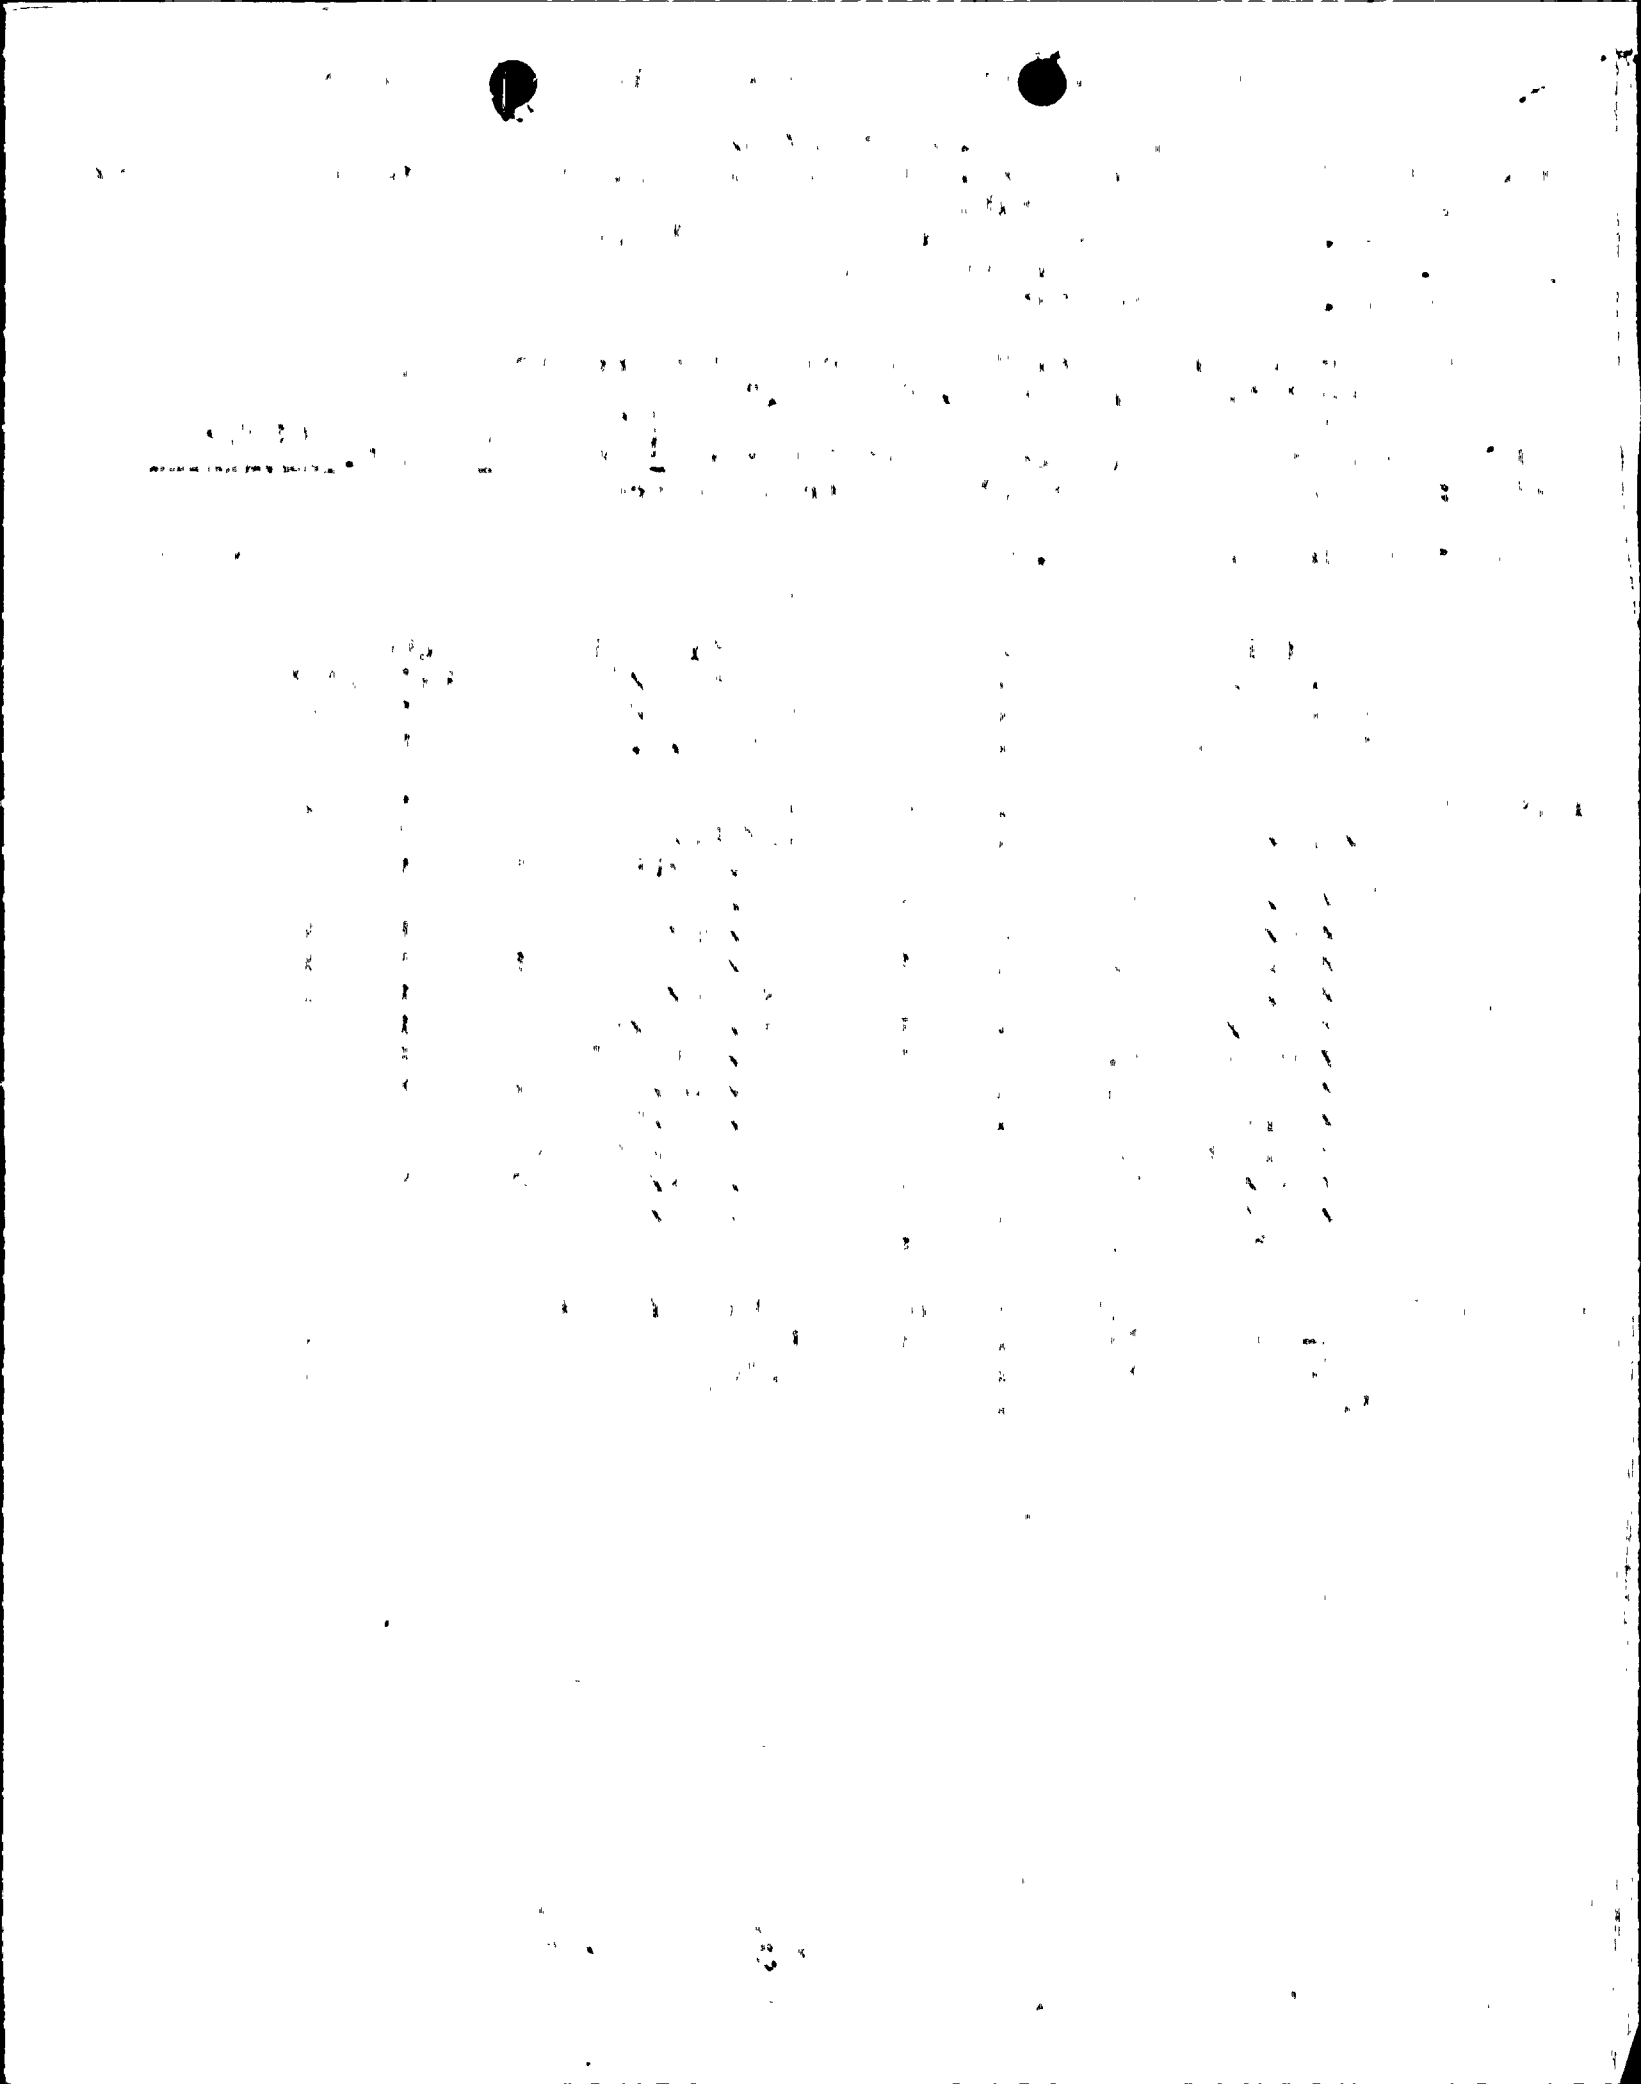

Washington Public Power Supply System

P.O. Box 968 3000 George Washington Way Richland, Washington 99352 (509) 372-5000

March 26, 1982
G02-82-344



Docket No. 50-397

Mr. A. Schwencer
Licensing Branch No. 2
Division of Licensing
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

Dear Mr. Schwencer:

Subject: WNP-2 SUMMARY OF CONFORMANCE TO NUCLEAR REGULATORY
COMMISSION REGULATIONS 10CFR PARTS 20, 50 and 100

Reference: (1) Letter, A. Schwencer to R. L. Ferguson,
dated March 19, 1982
(2) NRC Internal memo from McCorkle to Schwencer,
dated November 6, 1981

The Washington Public Power Supply System has conducted a review of the conformance of WNP-2 design to NRC Regulations of Safety Significance as requested by the NRC (Ref. 1). The review is documented in the enclosed report.

In addition to the information provided in this enclosure, conformance to 10CFR50, Appendix A, General Design Criteria for Nuclear Power Plants, is discussed in Chapter 3, Section 3.1.2 of the Final Safety Analysis Report (FSAR). Appendix C to the FSAR contains information on the Supply System's conformance assessment of WNP-2 to USNRC Regulatory Guides, Division 1. Furthermore, the methods by which the applicable requirements of 10CFR73 relate to physical security have been discussed previously in reports submitted to the NRC and withheld from public disclosure under the provisions of 10CFR2.790. The physical security plan and safeguard contingency plan have been accepted and approved by the NRC (Ref. 2).

Boo1
S/1



Mr. A. Schwencer
Page Two
March 26, 1982
NRC Regulation 10CFR Parts
20, 50, and 100

If you have any questions on the enclosure or the other noted documents,
please direct them to this office.

Very truly yours,



G. D. Bouchey, Deputy Director
Safety and Security

RGJ:jr

Enclosure - 10 copies

cc: R Auluck - NRC
WS Chin - BPA - 399
R Feil - NRC 917Q
NS Reynolds - D&L

