


NOTES:  
1. FOR GENERAL NOTES & REFERENCE DRAWINGS SEE M-607 SHEET 1 OF 3.  
2. PIPING & TUBING WITHIN THE REACTOR BLDG SAMPLE ROOM TO BE QUALITY CLASS II, SEISMIC CATEGORY I FOR SAMPLE RACK SR-6, FUME HOOD SR-7 AND TSW LINES TO BE QUALITY CLASS I, SEISMIC CATEGORY I, EXCEPT AS NOTED ON M-619, INSTRUMENT CONNECTION DIAGRAMS.

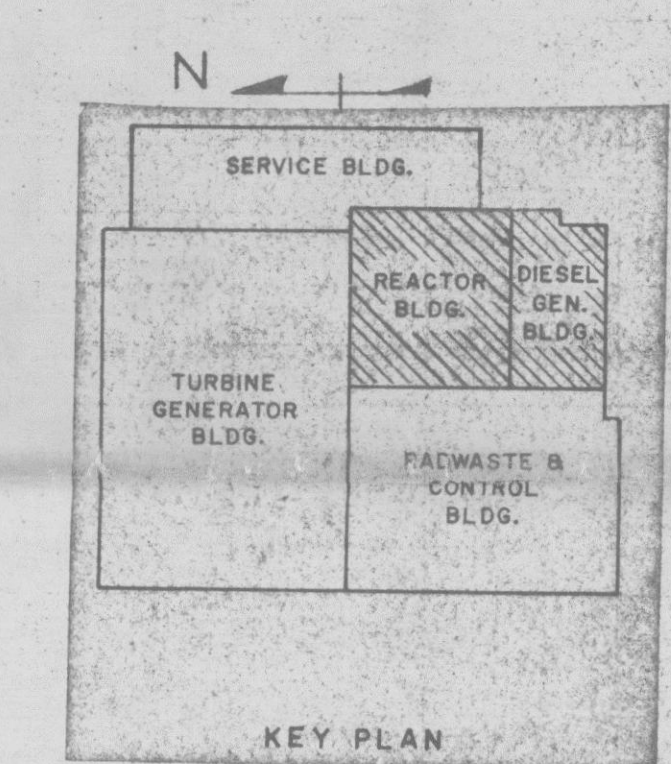

INFORMATION ONLY

PRO APERTURE CARD

**VOID**

**BURNS AND ROE, INC.**  
ENGINEERS AND CONSTRUCTORS  
ORADELL, N.J. HEMPSTEAD, N.Y. LOS ANGELES, CALIF.

**FLOW DIAGRAM**  
STEAM AND LIQUID SAMPLING  
REACTOR BUILDING

WASHINGTON PUBLIC POWER SUPPLY SYSTEM  
HANFORD No. 2

REVISION	DATE	BY	CHKD	APPROVED	REVISION	DATE	BY	CHKD	APPROVED
5	PER TASK 8300: ADDED PED-220-I-0007	8/1/79	WJL	PCN 3554	1	DRAWING APPROVED FOR CONSTRUCTION	7/10/79	REC	PWL
6	PER TASK 8300: ADDED PED-220-I-0380 (J40)	1/1/80	KAD	PCN 3554	2	CONTRACT 220: ADDED EXPANSION TANKS (ZONE G-2). REVISED VALVES & ADDED VALVE N°S. PER V-19A, 19B & 20 (ZONES F-14, J-10 & D-4) PER PCN 3559	3/10/80	N.D.	JRL
7	PER TASK 3040: PED-220-I-584 (H-1-2) 215-M-A364 (F-14-15; H-1-10)	1/1/80	B.E.	PCN 3557	3	CONTRACT 220: ADDED COOLING WATER FOR ANALYzers & MONITORS (F-14-15 & B-C) (THIS IS IN ADDITION TO WATER PER PCN 3424)			
					4				
					5				

ENGINEERING REVIEW

SCALE: NONE

APPROVED FOR CONSTRUCTION

W.O. 2808

DWG. M607 SH.2

REV	DATE	BY	CHKD	APPROVED	REVISION
5	PER TASK 8300: ADDED PED-220-I-0007	8/1/79	WJL	PCN 3554	1
6	PER TASK 8300: ADDED PED-220-I-0380 (J40)	1/1/80	KAD	PCN 3554	2
7	PER TASK 3040: PED-220-I-584 (H-1-2) 215-M-A364 (F-14-15; H-1-10)	1/1/80	B.E.	PCN 3557	3
					4
					5