REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR:8307050001 DOC.DATE: 83/06/15 NOTARIZED: NO DOCKET #
FACIL:50-397 WPPSS Nuclear Project, Unit 2, Washington Public Powe 05000397
AUTH.NAME AUTHOR AFFILIATION
BOUCHEY,G.D. Washington Public Power Supply System
RECIP.NAME RECIPIENT AFFILIATION
SCHWENCER,A. Licensing Branch 2

SUBJECT: Submits lowest svc metal temp values for most limiting pressure boundary components & table for theoretical min wall thickness for valves RFW-V-65A/B based on hydro test pressures per GDC 51.

DISTRIBUTION CODE: B001S COPIES RECEIVED:LTR 1 ENCL 1 SIZE: 7
TITLE: Licensing Submittal: PSAR/FSAR Amdts & Related Correspondence

NOTES:

	RECIPIENT ID CODE/NAME		COPIES LTTR	COPIES ENCL	RECIPIENT ID CODE/NAME		COPIES LTTR	COPIES ENCL
	NRR/DL/ADL		1	0	NRR LB2 BC		1	0
	NRR LB2 LA		1	0	AULUCK,R.	01	1	1
INTERNAL:	ELD/HDS2		1	0	IE FILE		1	1
	IE/DEPER/EPB	36	3	3	IE/DEPER/IRB	35	1	1
	IE/DEQA/QAB	21	1	1	NRR/DE/AEAB		1	0
	NRR/DE/CEB	11	1	1	NRR/DE/EHEB		1	1
	NRR/DE/EQB	13	2	2	NRR/DE/GB	28	2	2
	NRR/DE/MEB	18	1	1	NRR/DE/MTEB	17	1	1
	NRR/DE/SAB	24	1	1	NRR/DE/SGEB	25	1	1
	NRR/DHFS/HFEB	40	1	1	NRR/DHFS/LQB	32	1	1
	NRR/DHFS/PSRB		1	1	NRR/DL/SSPB		1	0
	NRR/DSI/AEB	26	1	1	NRR/DSI/ASB		1	1
	NRR/DSI/CPB	10	1	1	NRR/DSI/CSB	09	1	1
	NRR/DSI/ICSB	16	1	1	NRR/DSI/METB	12	1	1
	NRR/DSI/PSB	19	1	1	NRR/DSI/RAB	22	1	1
	NRR/DSI/RSB	23	1	1	REG FILE	04	1	1
	RGN5		3	3	RM/DDAMI/MIB		1	0
EXTERNAL:	ACRS	41	6	6	BNL(AMDTS ONLY)		1	1
	DMB/DSS (AMDTS)		1	1	FEMA-REP DIV	39	1	1
	LPDR	03	1	1	NRC PDR	02	1	1
	NSIC	05	1	1	NTIS		1	1

TOTAL NUMBER OF COPIES REQUIRED: LTTR 53 ENCL 46

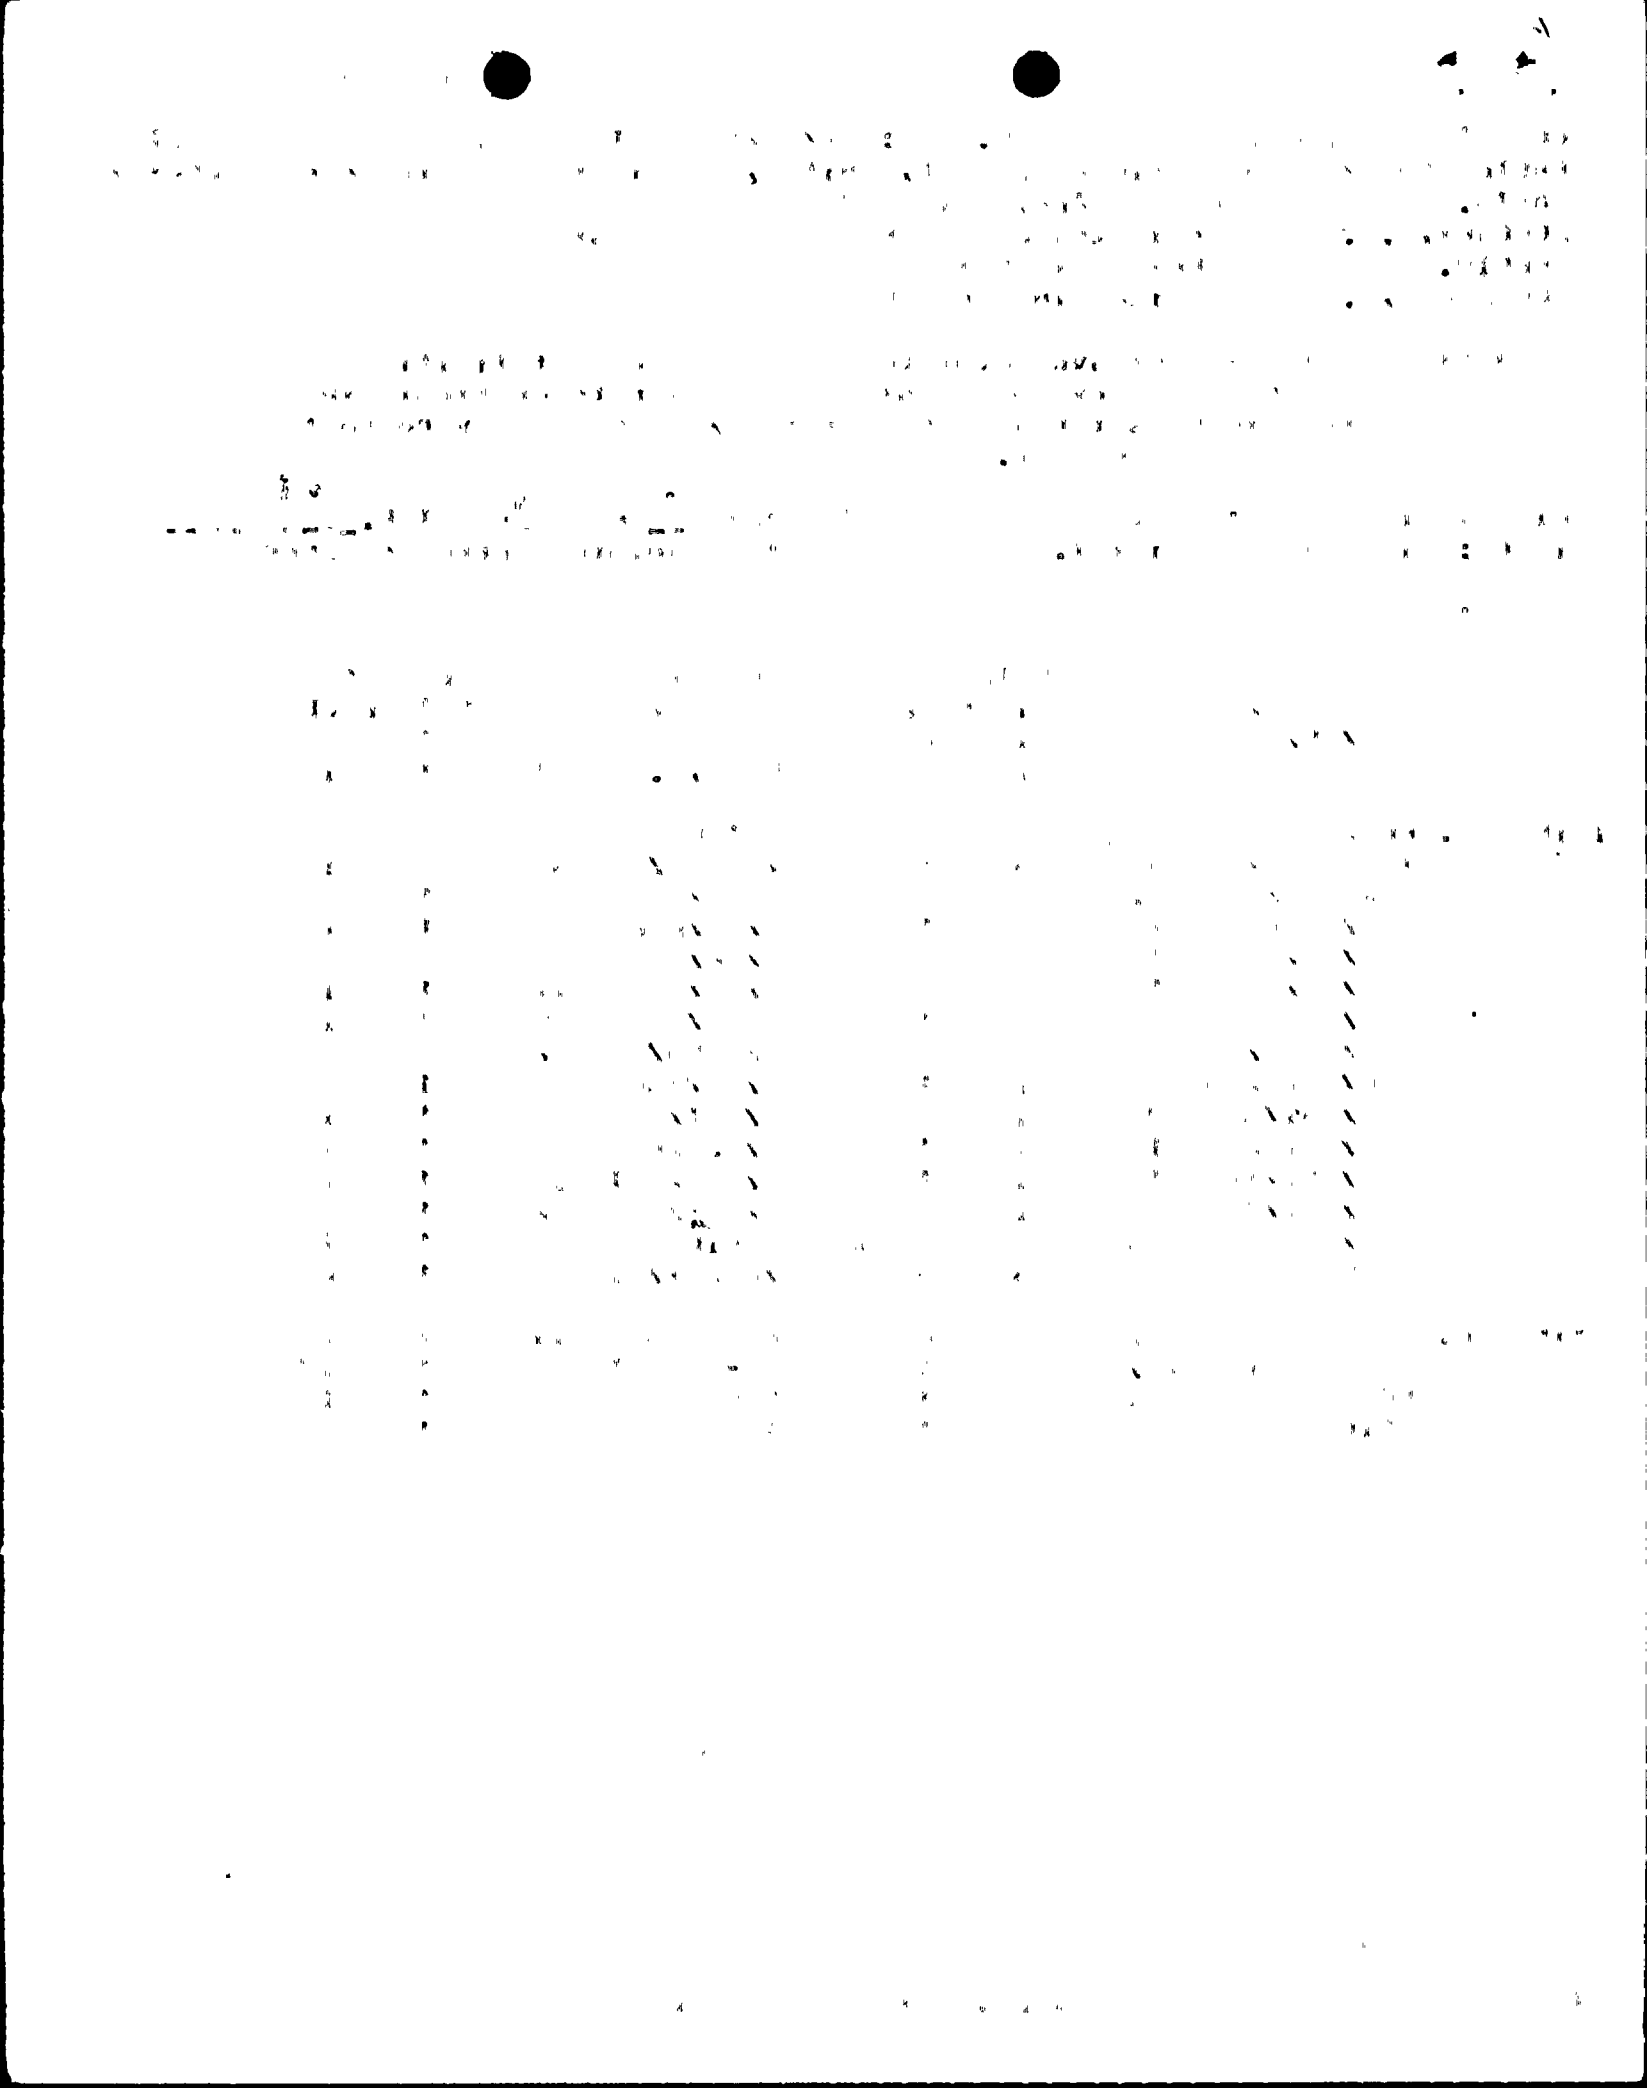

Washington Public Power Supply System
P.O. Box 968 3000 George Washington Way Richland, Washington 99352 (509) 372-5000

June 15, 1983
G02-83-525

Docket No. 50-397

Director of Nuclear Reactor Regulation
Attention: Mr. A. Schwencer, Chief
Licensing Branch No. 2
Division of Licensing
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

Dear Mr. Schwencer:

Subject: NUCLEAR PROJECT NO. 2
GENERAL DESIGN CRITERION 51

Reference: a) G02-82-551, G.D. Bouchey (SS) to A. Schwencer (NRC), Same Subject, dated June 21, 1982

b) G02-83-048, G.D. Bouchey (SS) to A. Schwencer (NRC), General Design Criterion 51, Clarification, dated January 18, 1983

Reference a) provided the results of a Supply System evaluation for fracture toughness of containment pressure boundary components with respect to GDC 51. The evaluation developed Lowest Service Metal Temperature (LSMT) values for the most limiting pressure boundary components. Reference b) provided an alternate evaluation to Reference a) and revised LSMT values for NRC review. Subsequent meetings and correspondence between Supply System personnel and NRC staff have resulted in a re-evaluation of both references. As a result attachment 1 is forwarded providing LSMT values that supersede those values provided in references a) and b). Of note are the LSMT values for the Reactor Feedwater Isolation Valve RFW V-65A/B body and wedge. In support of these LSMT values for RFW V-65A/B attachment 2, Theoretical Minimum Wall Thickness for Valves RFW V-65A/B is provided.

With submittal of attachments 1) and 2) Supply System compliance with GDC 51 is maintained.

Very truly yours,

GD Bouchey

G.D. Bouchey
Manager, Nuclear Safety and Regulatory Program

cc: R Auluck - NRC
WS Chin - BPA
J Halopatz - NRC
A Toth - NRC Site

PLP/mmt
Attachments

B001
1/1

Equipment Hatch	*LSMT
(PDM DWG's 116, 115, 113, 114)	
Pc. mk. 116 a^R is 2-1/2" thick, fabricated from SA-537 Gr. B., quenched and tempered material. NUREG 0577 Table 4.4 assigns a ($\overline{NDT}$ + 2σ) NDT of -60°F to the material. Summer '77 Addenda, of ASME Class 2 rules assign a Lowest Service Metal Temperature (LSMT) of -30°F allowing adjustment for thickness.	-30°F
Pc. mk. 116b is 3" thick, fabricated from SA-516 Gr. 70, quenched and tempered material. Summer '77 Addenda, of ASME Class 2 rules assign a T_{NDT} of -10°F and a LSMT of +30°F, allowing adjustment for thickness.	+30°F
Pc. mk. 113a is 1-1/4" fabricated from SA-516 Gr. 70, normalized material. Summer '77 Addenda, of ASME Class 2 rules assign a T_{NDT} of 0°F and a LSMT of +30°F to the material allowing adjustment for thickness.	+30°F
Personnel Airlock Assembly	
(PDM DWG's 16, 17, 18, 19, 20, 21, 25)	
Pc. mk's 17a, 17b, 17c, 17pl are 3-1/2" thick, fabricated from SA-516 Gr. 70, quenched and tempered material. Summer '77 Addenda, of ASME Class 2 rules assign a T_{NDT} of -10°F and LSMT of +35°F to the material allowing adjustment for thickness.	+35°F
Pc. mk. 16a is 2" thick fabricated from SA-516 Gr. 70, normalized material. Summer '77 Addenda, of ASME Class 2 rules assign a T_{NDT} of 0°F and a LSMT of +30°F to the material allowing adjustment for thickness.	+30°F
Pc. mk. 25a is 2-1/2" thick fabricated from SA-537 Gr. B., quenched and tempered material. NUREG 0577 Table 4.4 assigns a ($\overline{NDT}$ + 2σ) NDT of -60°F to the material. Summer '77 Addenda, of ASME Class 2 rules assign a LSMT of -30°F allowing adjustment for thickness.	-30°F
Drywell Head	
The Drywell Head Flange is 4" thick fabricated from SA-516 Gr. 70, normalized material. Summer '77 Addenda, Class 2 rules assign T_{NDT} of 0°F and a LSMT of +50°F to the material allowing adjustment for thickness.	+50°F

*LSMT in this evaluation only applies during hydrostatic testing or leak testing.

Drywell Head (Cont'd.)

The Drywell Head Flange Bolts are manufactured from SA-320 Gr. L43, material. NUREG 0577 states that this material is least susceptible to brittle fracture. +50°F

The Drywell Head Flange Nuts are manufactured from SA-194 Gr. 7, material. NUREG 0577 states that this material is least susceptible to brittle fracture.

Flued Heads

Main Steam Flued Heads are manufactured from SA-105 Gr. II, material with a limiting thickness of 4-1/2". NUREG 0577 Table 4.4 assigns a NDT of -28°F to normalized C-Mo material. The T_{NDT} of quenched and tempered material can reasonably be expected to lie in the population below -28°F. Given a T_{NDT} of -28°F and a limiting thickness of 4-1/2" the Summer '77 Addenda, of ASME Class 2 rules would assign a LSMT of +24°F to the material allowing adjustment for thickness. +24°F

Reactor Feedwater Flued Heads are 10" thick manufactured from AS-350 Gr. LF2, quenched and tempered material. NUREG 0577 Table 4.4 assigns a NDT of -28°F to normalized material. The T_{NDT} of quenched and tempered material can reasonably be expected to lie in the population below -28°F. Summer '77 Addenda, of ASME Class 2 rules assign a LSMT of +52°F to the material allowing adjustment for thickness. +52°F

Containment Penetration Limiting Materials

The Main Steam and Reactor Feedwater penetration nozzles are 2" thick fabricated from SA-155 KCF 70, Class 1, normalized material. Summer '77, of ASME Class 2 rules assign a T_{NDT} of 0°F and a LSMT of +30°F to the material allowing adjustment for thickness. +30°F

Penetration X-119 is 24" x 1.219" wall, is fabricated from SA-333 Gr. 6, material. This material was Cv tested at -50°F to criteria consistent with Summer '77 Addenda, of ASME Class 2 rules. -50°F

Penetration X-45 is 16" x .844 wall, is fabricated from SA-333 Gr. 1, material. This material was Cv tested at 50°F to criteria consistent with Summer '77 Addenda, of ASME Class 2 rules. -50°F

Containment Penetration Limiting Materials (cont'd.)

Penetration X-55 has a closure plate typical of spare penetrations. The plates are SA-516 Gr. 70, normalized material, 1" thick. Summer '77 Addenda, of ASME Class 2 rules assign a T_{NDT} of 0°F and a LSMT of +30°F to the material allowing adjustment for thickness. +30°F

Reactor Feedwater Check Valves

(RFW 32A typ)

The valve body minimum design thickness is 2.28" and is fabricated from SA-216 WCB normalized, quenched and tempered material. Summer '77 Addenda, of ASME Class 2 rules assign a T_{NDT} of +30°F and a LSMT of +60°F to the material allowing adjustment for thickness. +60°F

The valve disc minimum design thickness is 2.28" and is fabricated from SA-352 LCB normalized and tempered material. NUREG 0577 Table 4.4 would categorize the material on the basis of chemistry as comparable to A-216. The NUREG identifies a NDT of +57°F for the material. Assuming a T_{NDT} of 57°F Summer '77 Addenda, of ASME Class 2 rules would assign a LSMT of +87°F to the material allowing adjustment for thickness. +87°F

The valve bonnet minimum design thickness is 4-15/16" and is manufactured from SA-516 Gr. 70, normalized material. Summer '77 Addenda, of ASME Class 2 rules assign a T_{NDT} of 0°F and a LSMT of 55°F to the material allowing adjustment for thickness. +55°F

The volts and nuts used in assembling the valve are SA-193 B7 and SA-194 2H respectfully. NUREG 0577 Table 4.6 categorizes the material as having the least susceptibility to failure.

Reactor Feedwater Subassembly

The only material over 5/8" thick requiring review in the subassembly is the large bore pipe which is SA-106 Gr. B, normalized material 1.812" thick. It is reasonable that T_{NDT} of this material would lie in population below NDT of +27°F. Given T_{NDT} of +27°F Summer '77 Addenda, of ASME Class 2 rules would assign a LSMT of +57°F to the material allowing adjustment for thickness. +57°F

Reactor Feedwater Isolation Valves (Typ)

The valve body minimum design thickness is 2.4" and is manufactured from SA-352 Gr. LCB, normalized material. NUREG 0577 Table 4.4 would categorize the material on the basis of chemistry, as comparable to A-216. NUREG identifies a NDT of 57°F for the material. Assuming a T_{NDT} of 57°F, Summer '77 Addenda, of ASME Class 2 rules would assign a LSMT of 87°F to the material allowing adjustment for thickness. +87°F

The wedge limiting theoretical minimum thicknesses based on RPV hydro test pressure of 1563 PSIG and ANSI hydro test pressure 3020 PSIG are 1.92" and 2.69" respectively. The thickness of 2.69" was used to determine the LSMT. The wedge is manufactured from SA-352 Gr. LCB, normalized and tempered material. NUREG 0577 Table 4.4 would categorize the material on the basis of chemistry, as comparable to A-216. Assuming a T_{NDT} of 57°F Summer '77 Addenda, of ASME Class 2 rules would assign a LSMT of 89°F to the material allowing adjustment for thickness. 89°F

The bonnet minimum design thickness is 2.4" and is manufactured from SA-350 Gr. LF2, quenched and tempered material. NUREG 0577 Table 4.4 assigns a NDT of -28°F to normalized material. The T_{NDT} of quenched and tempered material can reasonably be expected to lie in the population below -28°F. Summer '77 Addenda, of ASME Class 2 rules assign a LSMT of +2°F to the material allowing adjustment for thickness. +2°F

Main Steam Isolation Valves (Typ)

The body's minimum design thickness is 1.58" and is manufactured from SA-216 WCB, normalized quenched and tempered material. Summer 77 Addenda, of ASME Class 2 rules assign a T_{NDT} of +30°F and a LSMT of +60°F allowing adjustment for thickness. +60°F

The bonnet minimum design thickness 7.66" and is manufactured from SA-105 Gr., II, normalized and tempered material. NUREG 0577 Table 4.4 assigns a ($\overline{NDT}$ + 1.36) NDT of -50°F to the material. Summer '77 Addenda, of ASME Class 2 rules assign a LSMT of +65°F to the material allowing adjustment for thickness. +65°F

The disc's minimum design thickness if 5.5" and is manufactured from SA-182 Gr. F11, normalized and tempered material. Data for material of comparable chemistry presented in Figure 24 of ASM Metals Handbook, Ninth Edition, Volume 1, page 702, would infer for this material a T_{NDT} below 32°F. Given its alloy content, its microstructure resulting from normalizing and tempering would be expected to favor a toughness characterization comparable to that of SA-105 to which NUREG 0577 Table 4.4 +53°F

Main Steam Isolation Valves (Typ) (cont'd.)

assigns a ($\overline{NDT}$ + 1.36) NDT of -50°F. Summer '77 Addenda, of ASME Class 2 rules would assign a LSMT of +53°F to the material allowing adjustment for thickness.

The stem disc minimum design thickness is 1.56" and is manufactured from SA-182 Gr. F11. Using the same analysis as for the disc. Summer '77 Addenda, of ASME Class 2 rules would assign a LSMT of +25°F to the material allowing adjustment for thickness. +25°F

The bolts and nuts used in assembling of the Main Steam Isolation Valves are SA-193 Gr. B7 and SA-194 Gr. 7, respectfully. NUREG 0577 classifies these as least susceptible to fracture.

TABLE
THEORETICAL MINIMUM WALL THICKNESS FOR
VALVES RFW-V-65A/B

BASED ON HYDRO TEST PRESSURES

	Theoretical[b] Min. Thickness t_m (inches)	Theoretical[c] Min. Thickness t_m (inches)	Actual Min. Thickness t (inches)	Safety Ratio[b] t/t_m	Safety Ratio[c] t/t_m
Body (Weld Ends)[d][e]	0.78	1.54	2.4	3.08	1.56
Body (Gate Cavity)[d][e]	1.20	2.34	3.1	2.58	1.32
Wedge[f][e]	1.92	2.69	5.13	2.67	1.90

(a) This is the results of an informal calculation provided for information only. The author will retain the calculation in his personal files

(b) Based on RPV hydro test pressure of 1563 psig

(c) Based on balance of plant hydro test pressure of 3070 psig

(d) Lame stress formulation

(e) S_m = 23.3 Ksi @ 100°F -- SA352 - LCB

(f) Plate bending stresses; stress intensity limit is 1.5 (S_m) (Roark, 4th edition, page 217, case 6)