


7TS (UNDERVOLTAGE TEST SWITCH)

CONTACT NO.	POSITION	27/7-3	27/7-4	27/7-5
1	X			X
2	X			X
3	X		X	X
4	X		X	X
5	X	X		
6	X	X		
7	X	X		X
8	X	X		X
9	X	X	X	
10	X	X	X	
11	X	X	X	
12	X	X	X	
13	X	X	X	
14	X	X	X	


LOCATED IN SM-7 UNIT 10
GE TYPE 58M, MAINTAINED CONTACTS

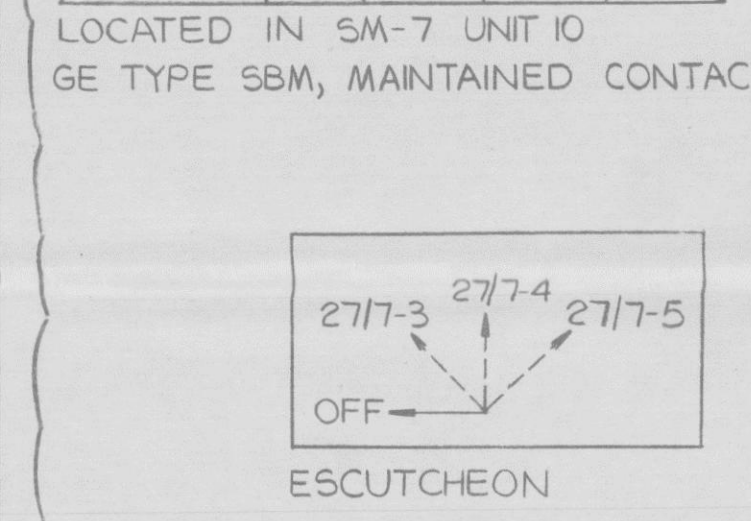

8TS (UNDERVOLTAGE TEST SWITCH)

CONTACT NO.	POSITION	27/8-3	27/8-4	27/8-5
1	X			X
2	X			X
3	X		X	X
4	X		X	X
5	X	X		
6	X	X		
7	X	X		X
8	X	X		X
9	X	X	X	
10	X	X	X	
11	X	X	X	
12	X	X	X	
13	X	X	X	
14	X	X	X	

LOCATED IN SM-8 UNIT 3
GE TYPE 58M, MAINTAINED CONTACTS

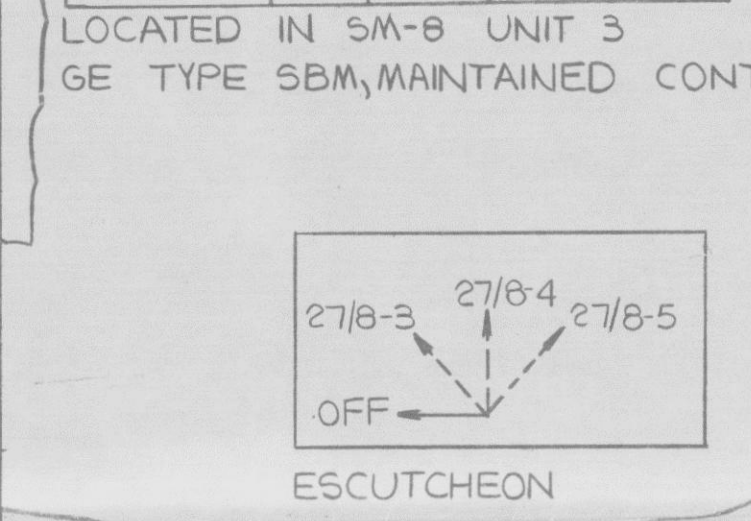

Docket # 50-397
Control # 830240150
Rev. 5/16/19, in Design
R. B. H. 10/1/19

8310240153 E

PRO APERTURE CARD

BURNS AND ROE, INC.
ENGINEERS AND CONSTRUCTORS
ORADELL, N. J. HEMPSTEAD, N. Y. LOS ANGELES, CALIF.

4160V SWITCHGEAR
ELEMENTARY DIAGRAMS
SH-10

WASHINGTON PUBLIC POWER SUPPLY SYSTEM
HANFORD No. 2

REVISION	DATE	DRWN	CHKD	APPROVED	REVISION	DATE	DRWN	CHKD	APPROVED	RELEASED FOR	BY	DATE
1	HOLD E-101 REMOVED PER 218-E-4618	B3	L5	3	0	APPROVED FOR CONSTRUCTION, PER TASK 3040: PED W218-E-5180 (ADDED HOLD E-101)	12-4-81	MS	CDW	8		
2					1	PER TASK 3040: PED W218-E-4477 (G-14, G-11) 4-8-82	8-2	BE	CDW	5		
3					2	PER TASK 3040: PED'S 218-E-4618 (F-K-1-2, A-K-9-15), 218-E-A903 (A-K-4-B), F-2-A-2-4 (CONT.)						

ENGINEERING REVIEW	SCALE	DRWN	CHKD	DATE
MECH. - 5	ELECT. - 5	STRUCT. - 5	MS	CDW
DATE	12-4-81			

APPROVED FOR CONSTRUCTION
W. O. 2808
DWG. E517