

# REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8510090165 DOC. DATE: 85/09/27 NOT INDEXED: NO DOCKET #  
 FACIL: 50-397 WPPSS Nuclear Project, Unit 2, Washington Public Powe 05000397  
 AUTH. NAME: SORENSEN, G.C. AUTHOR AFFILIATION: Washington Public Power Supply System  
 RECIP. NAME: BUTLER, W.R. RECIPIENT AFFILIATION: Licensing Branch 2


SUBJECT: Forwards "Washington Nuclear Plant Unit 2 Spray Pond Drift  
 Loss Rept," per License Condition 2.C.(6) re UHS License  
 Condition 2.C.(6) satisfied, Rev 1. to Operating & Engineering  
 Test Procedure 8.2.92, "UHS Performance," also encl.

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR 1 ENCL. 61 SIZE: 2+49  
 TITLE: OR Submittal: General Distribution

NOTES: OL: 12/20/83 05000397

	RECIPIENT ID CODE/NAME		COPIES LTTR ENCL		RECIPIENT ID CODE/NAME		COPIES LTTR ENCL
	NRR LB2 BC	01	7	7			
INTERNAL:	ACRS	09	6	6	ADM/LFMB		1 0.
	ELD/HDS2		1	0	NRR/DE/MTEB		1 1.
	NRR/DL DIR		1	1	NRR/DL/ORAB		1 0.
	NRR/DL/TSRG		1	1	NRR/DSI/METB		1 1.
	NRR/DSI/RAB		1	1	<u>REG FILE</u>	04	1 1.
	RGN5		1	1			
EXTERNAL:	24X		1	1	EG&G. BRUSKE, S		1 1.
	LPDR	03	1	1	NRC PDR	02	1 1.
	NSIC	05	1	1			

TOTAL NUMBER OF COPIES REQUIRED: LTTR 28 ENCL 25

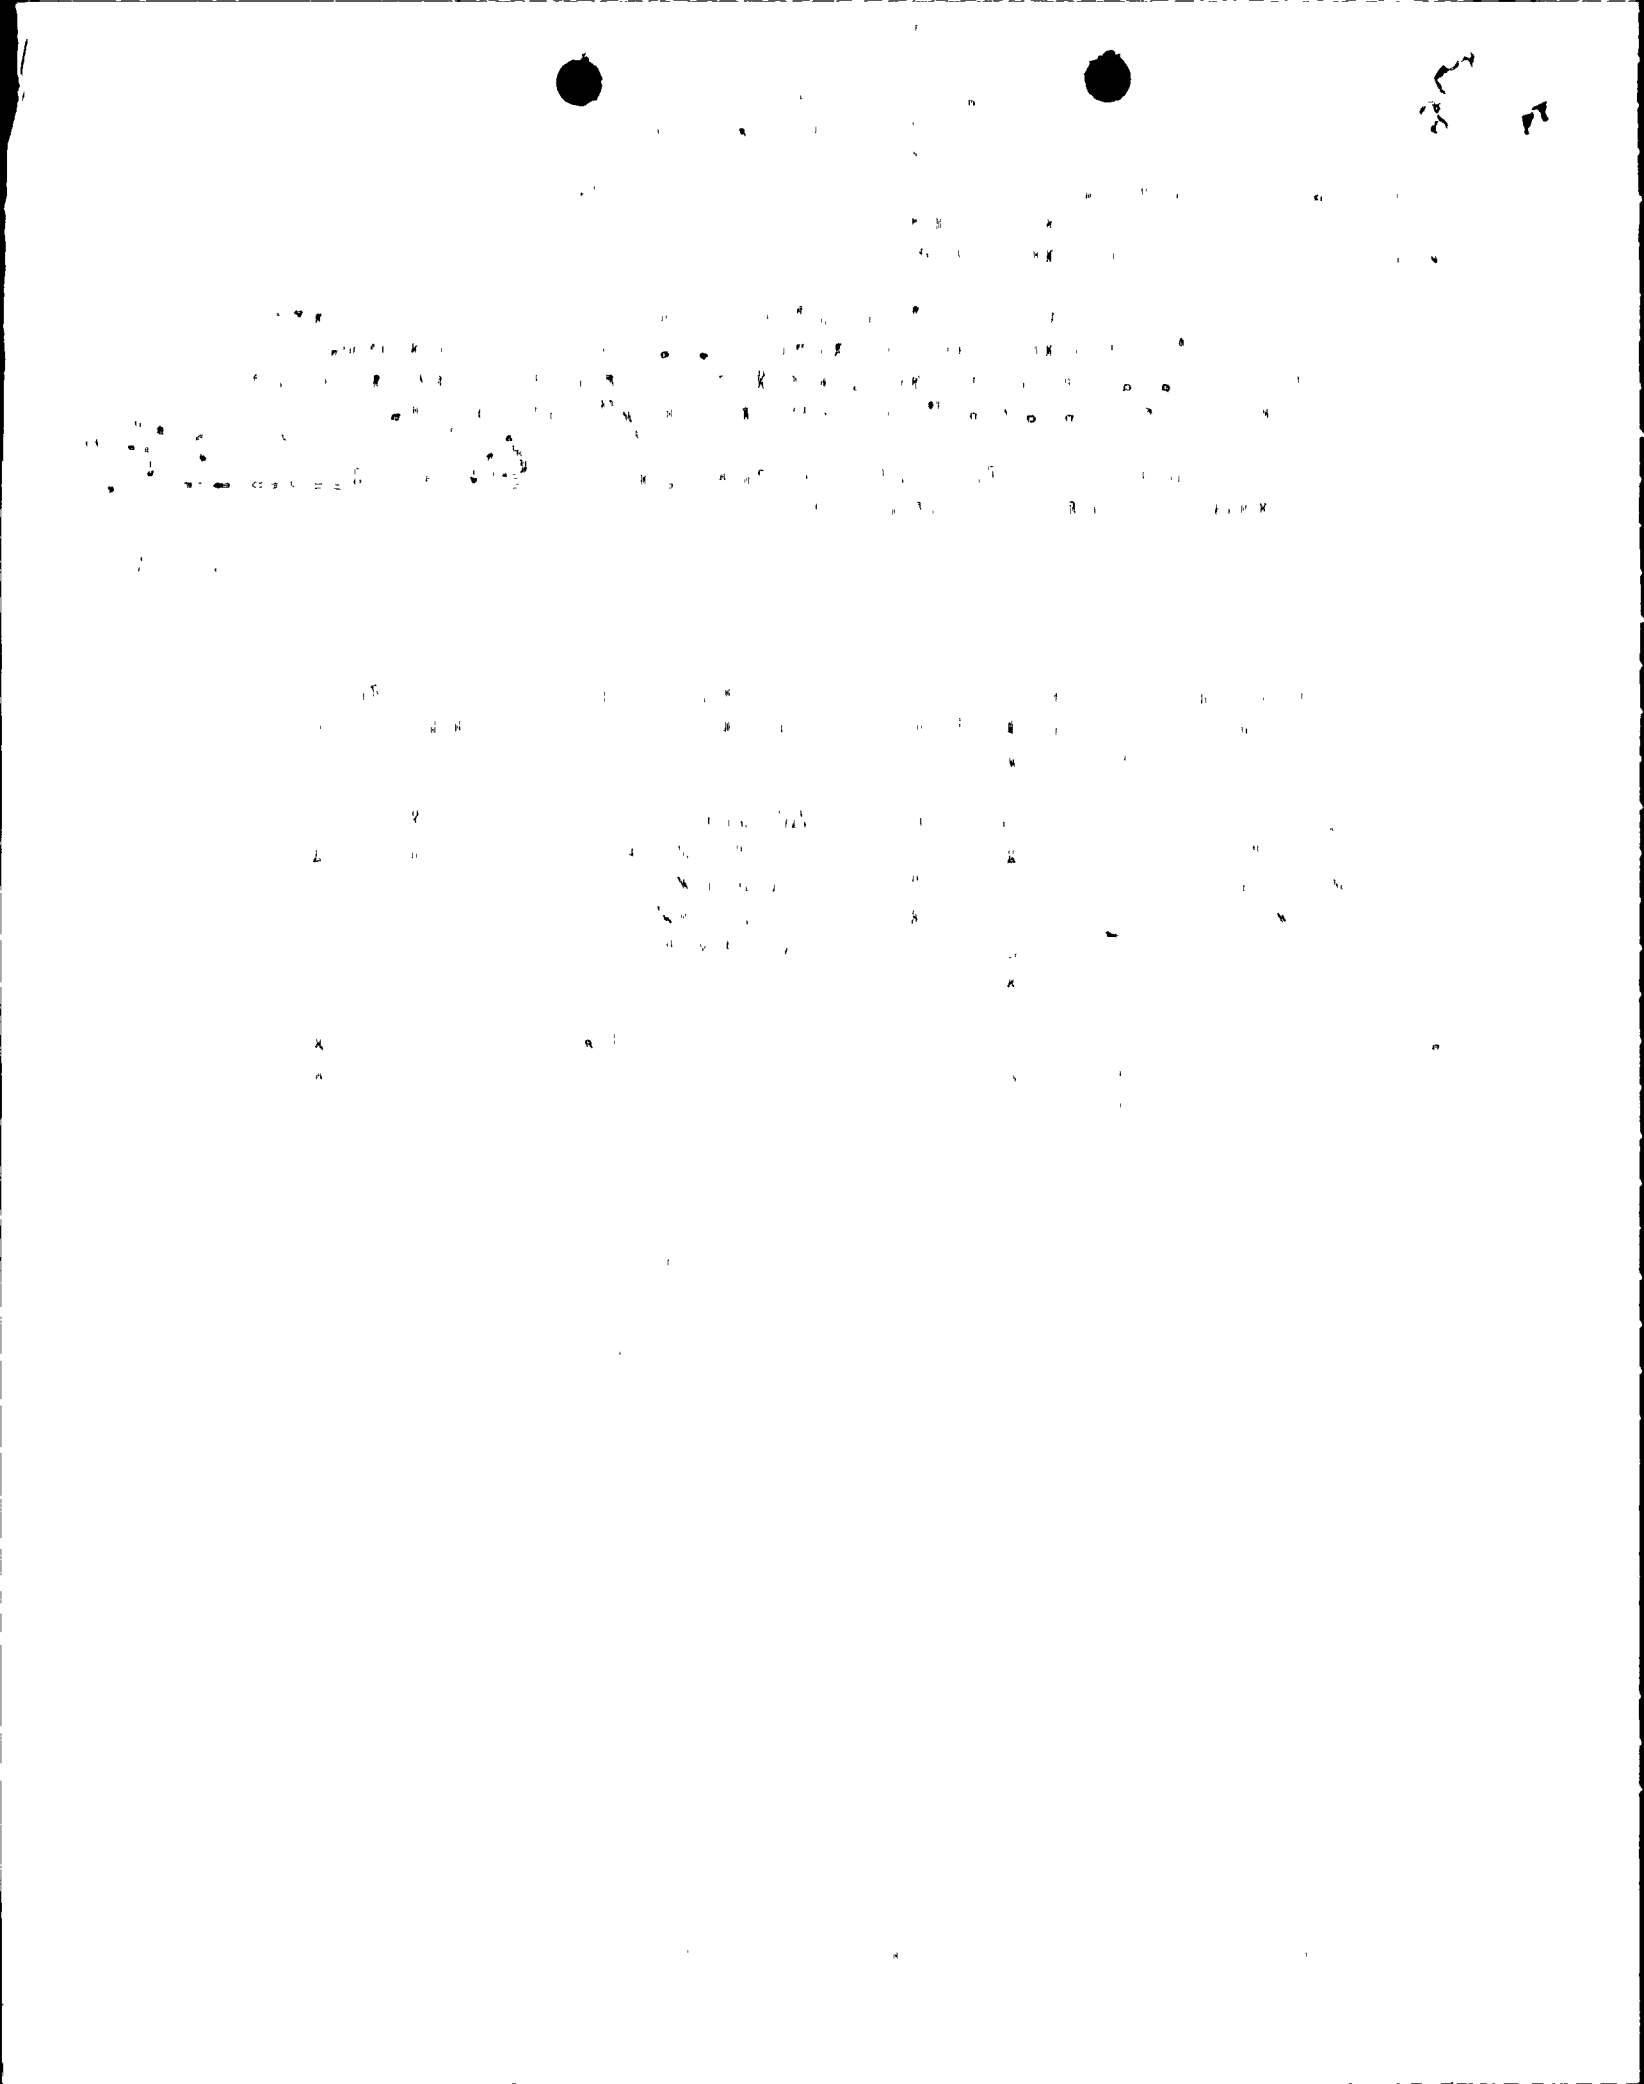

## Washington Public Power Supply System

3000 George Washington Way P.O. Box 968 Richland, Washington 99352-0968 (509)372-5000

8510090163 850927  
PDR ADOCK 05000397  
PDR

Docket No. 50-397

September 27, 1985  
G02-85-649

Director of Nuclear Reactor Regulation  
Attention: Mr. W. R. Butler, Chief  
Licensing Branch No. 2  
Division of Licensing  
U.S. Nuclear Regulatory Commission  
Washington, D.C. 20555

Dear Mr. Butler:

Subject: NUCLEAR PLANT NO. 2  
OPERATING LICENSE NPF-21, LICENSE  
CONDITION 2.C.(6), ULTIMATE HEAT SINK

- References: 1) Letter, G02-85-200, G.C. Sorensen (SS) to A. Schwencer (NRC),  
Same Subject, Dated April 11, 1985  
2) Letter, G02-82-297, G.D. Bouchey (SS) to A. Schwencer (NRC),  
"Standby Service Water System", Dated March 5, 1981  
3) Letter, G02-82-536, G.D. Bouchey (SS) to A. Schwencer (NRC),  
"Ultimate Heat Sink Testing", Dated June 11, 1982

The subject license condition requires the Supply System provide certain information concerning testing of the ultimate heat sink spray ponds to the NRC staff for their review and approval. In accordance with these requirements, the tests have been completed and the results reviewed and accepted by the Plant Operations Committee. The attached "WNP-2 Spray Pond Drift Loss Report" provides the required test results and conclusions. With the submittal of this report and information provided in the referenced letters, the Supply System considers Licensing Condition 2.C.(6), Ultimate Heat Sink, fully satisfied.

*Adol*  
*1/61*



Mr. W. R. Butler  
Page Two  
September 27, 1985  
G02-85-649

Should you have any questions, please contact Mr. P.L. Powell, Manager,  
WNP-2 Licensing.

Very truly yours,



G. C. Sorensen, Manager  
Regulatory Programs

SLS/vih

Attachments:

cc: JO Bradfute - NRC  
WS Chin - BPA  
JB Martin - NRC RV  
E. Revelle - BPA  
NS Reynolds - BLCP&R  
AD Toth - NRC Site