[illegible]


LEGEND

1. ALL VALVES SUFFIXED WITH A (V) EQUAL A 3/4" VENT VALVE
2. ALL VALVES SUFFIXED WITH A (D) EQUAL A 3/4" DRAIN VALVE

SI APERTURE CARD

INFORMATION COPY

FSAR FIG NO. 9.3-2A
FSAR FIG NO. 3.2-21A (C)

 WASHINGTON PUBLIC POWER SUPPLY SYSTEM RICHMOND, WASHINGTON 98352-0568		WNP 2	
SIGNED	DATE	TITLE	
APPROVED <i>[Signature]</i>	6-25-88	FLOW DIAGRAM	
DESIGN <i>[Signature]</i>	6-25-88	CONTAINMENT INSTRUMENT AIR SYSTEM	
CHECKED <i>[Signature]</i>	6-25-88	DRAWING # NSSG	
DRAWN	6-11-88	SCALE	REV. SHEET 1 OF 2

D

NRC TOP TIER

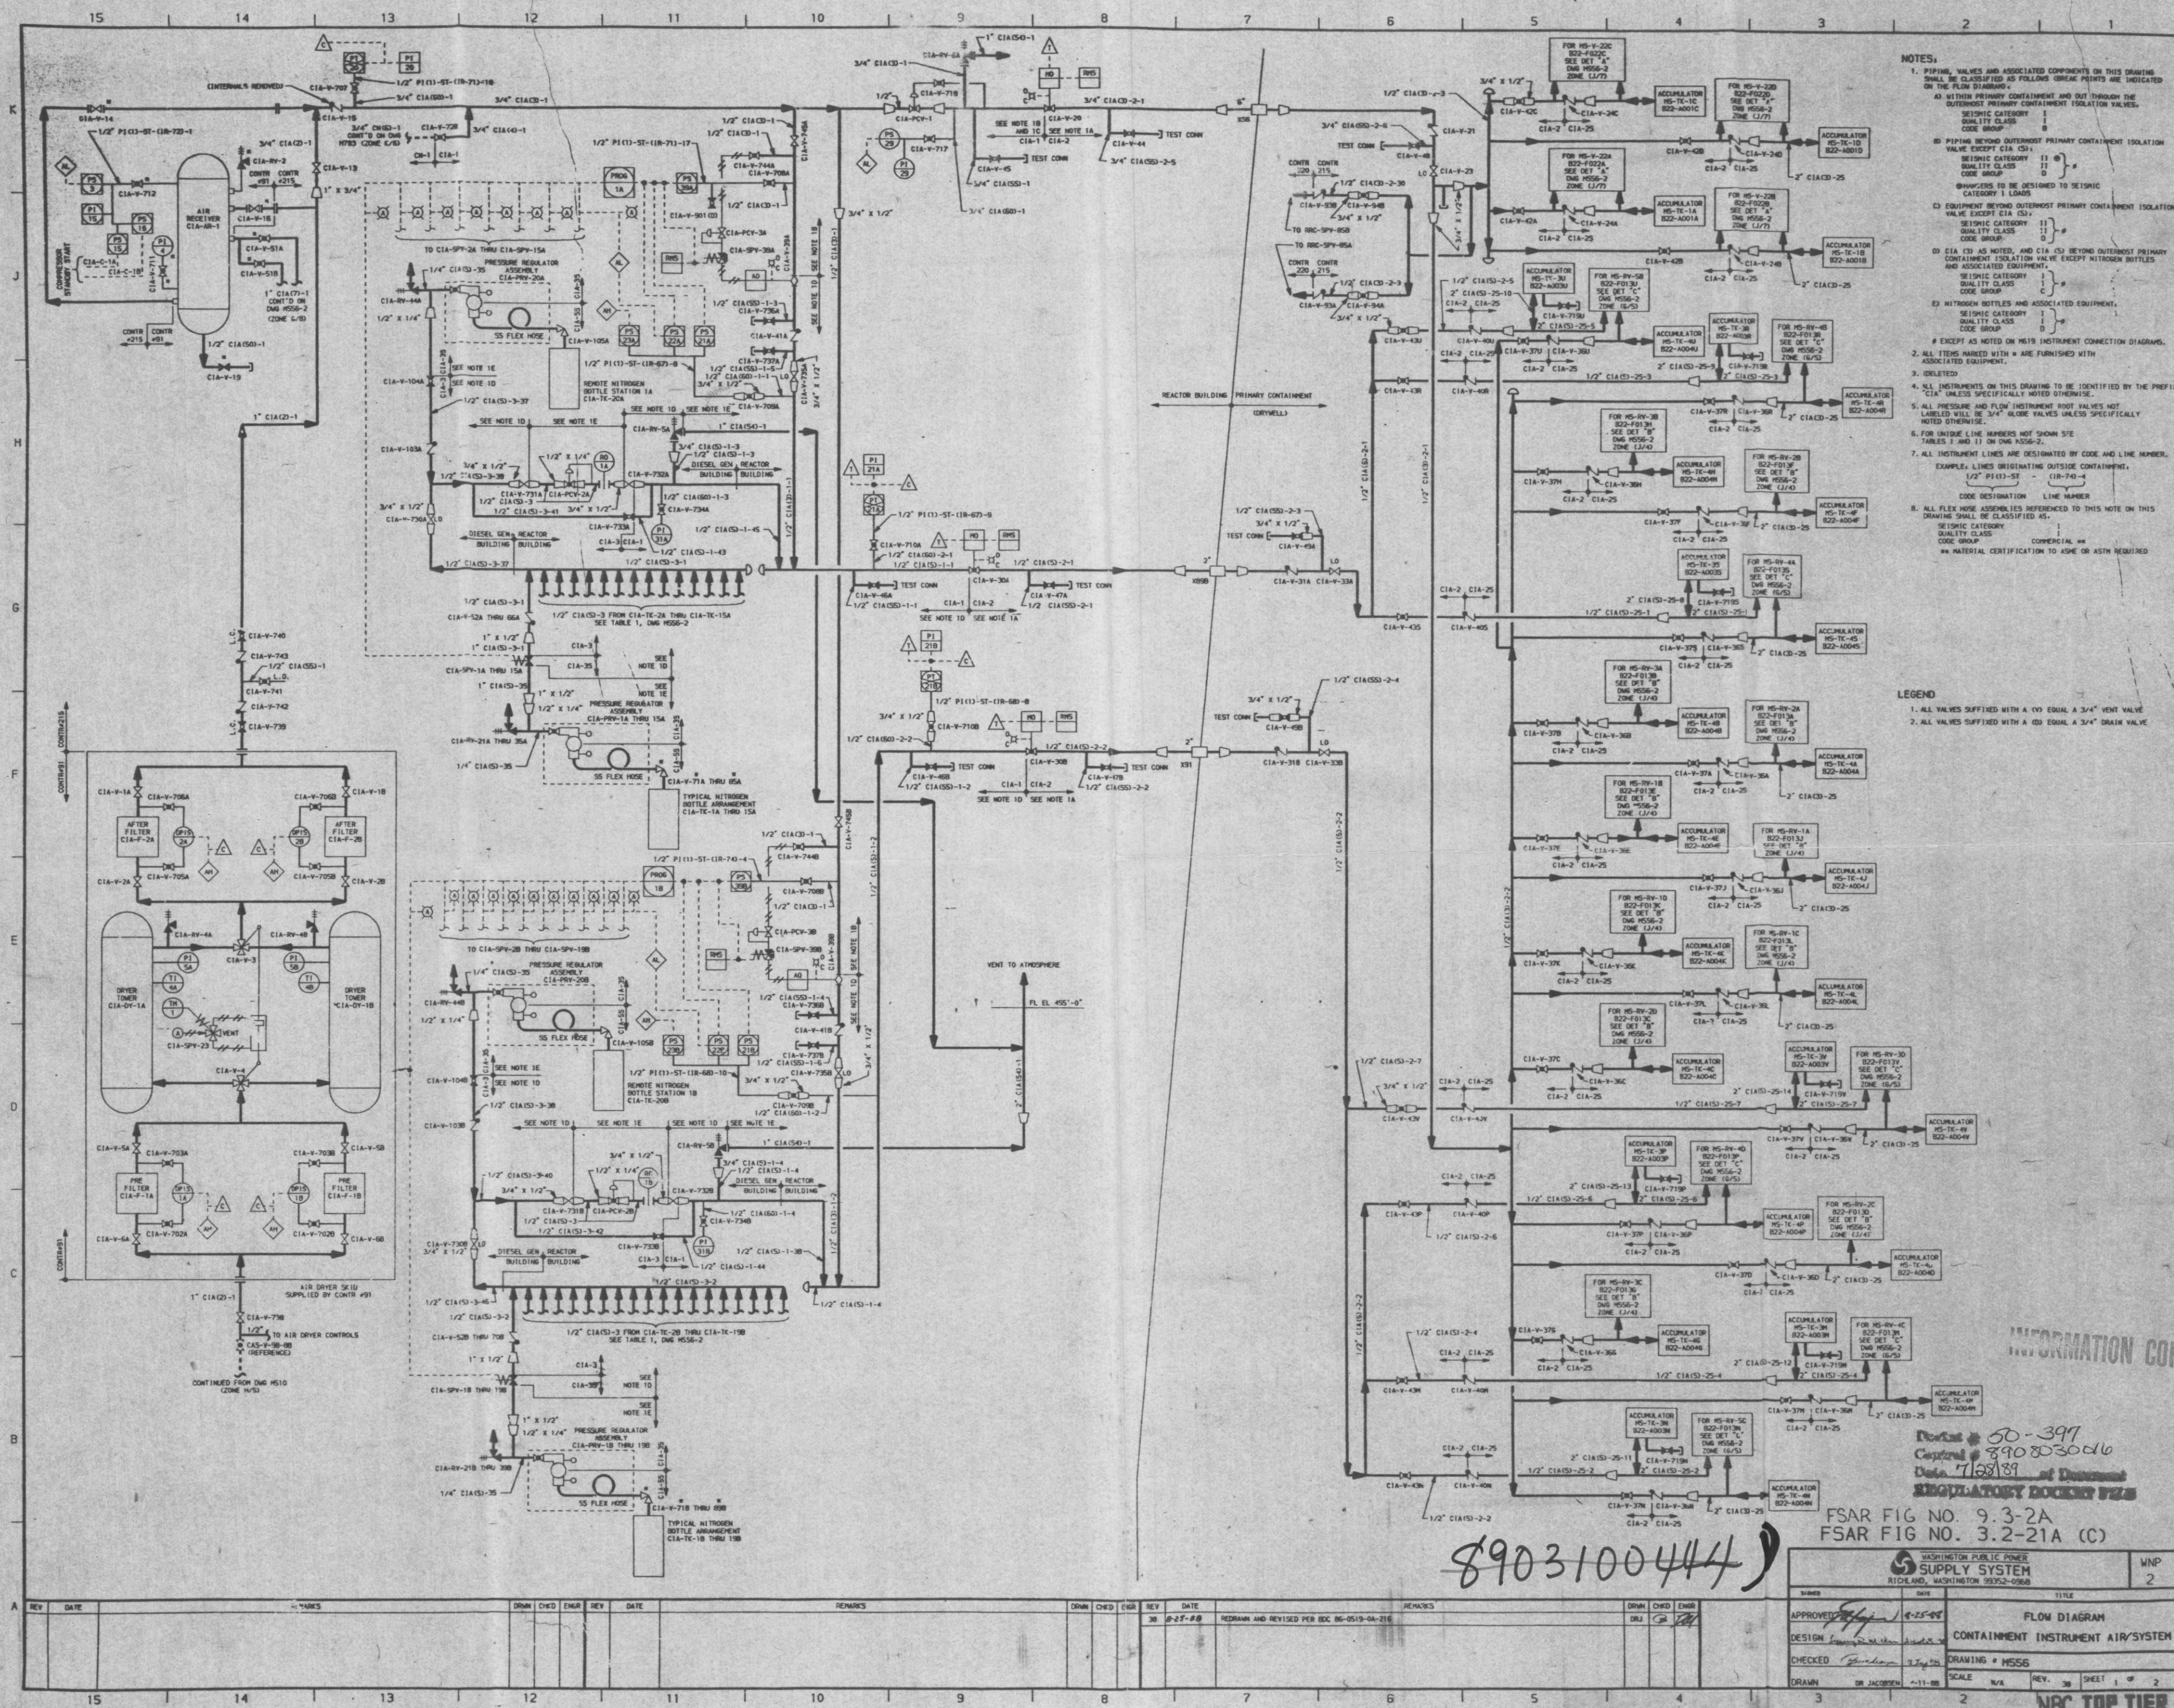


Figure 4-2 Containment Instrument Air System, Sheet 1