

ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8907280181 DOC. DATE: 89/07/20 NOTARIZED: NO DOCKET #
 FACIL: 50-397 WPPSS Nuclear Project, Unit 2, Washington Public Powe 05000397
 AUTH. NAME AUTHOR AFFILIATION *See Rept.*
 SORESEN, G.C. Washington Public Power Supply System
 RECIP. NAME RECIPIENT AFFILIATION
 Document Control Branch (Document Control Desk)

SUBJECT: Forwards addl info re Generic Ltr 88-01, per 890516 request.

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 46
 TITLE: OR Submittal: General Distribution

NOTES:

	RECIPIENT ID CODE/NAME		COPIES			RECIPIENT ID CODE/NAME		COPIES	
			LTTR	ENCL				LTTR	ENCL
	PD5 LA		1	1		PD5 PD		1	1
	SAMWORTH, R		5	5					
INTERNAL:	ACRS		6	6		NRR/DEST/ADS 7E		1	1
	NRR/DEST/CEB 8H		1	1		NRR/DEST/ESB 8D		1	1
	NRR/DEST/ICSB		1	1		NRR/DEST/MTB 9H		1	1
	NRR/DEST/RSB 8E		1	1		NRR/DOEA/TSB 11		1	1
	NUDOCS-ABSTRACT		1	1		OC/LFMB		1	0
	OGC/HDS2		1	0		REG FILE 01		1	1
	RES/DSIR/EIB		1	1					
EXTERNAL:	LPDR		1	1		NRC PDR		1	1
	NSIC		1	1					


NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,
 ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTTR 28 ENCL 26

R
I
D
S
/
A
D
D
S

m/a 2

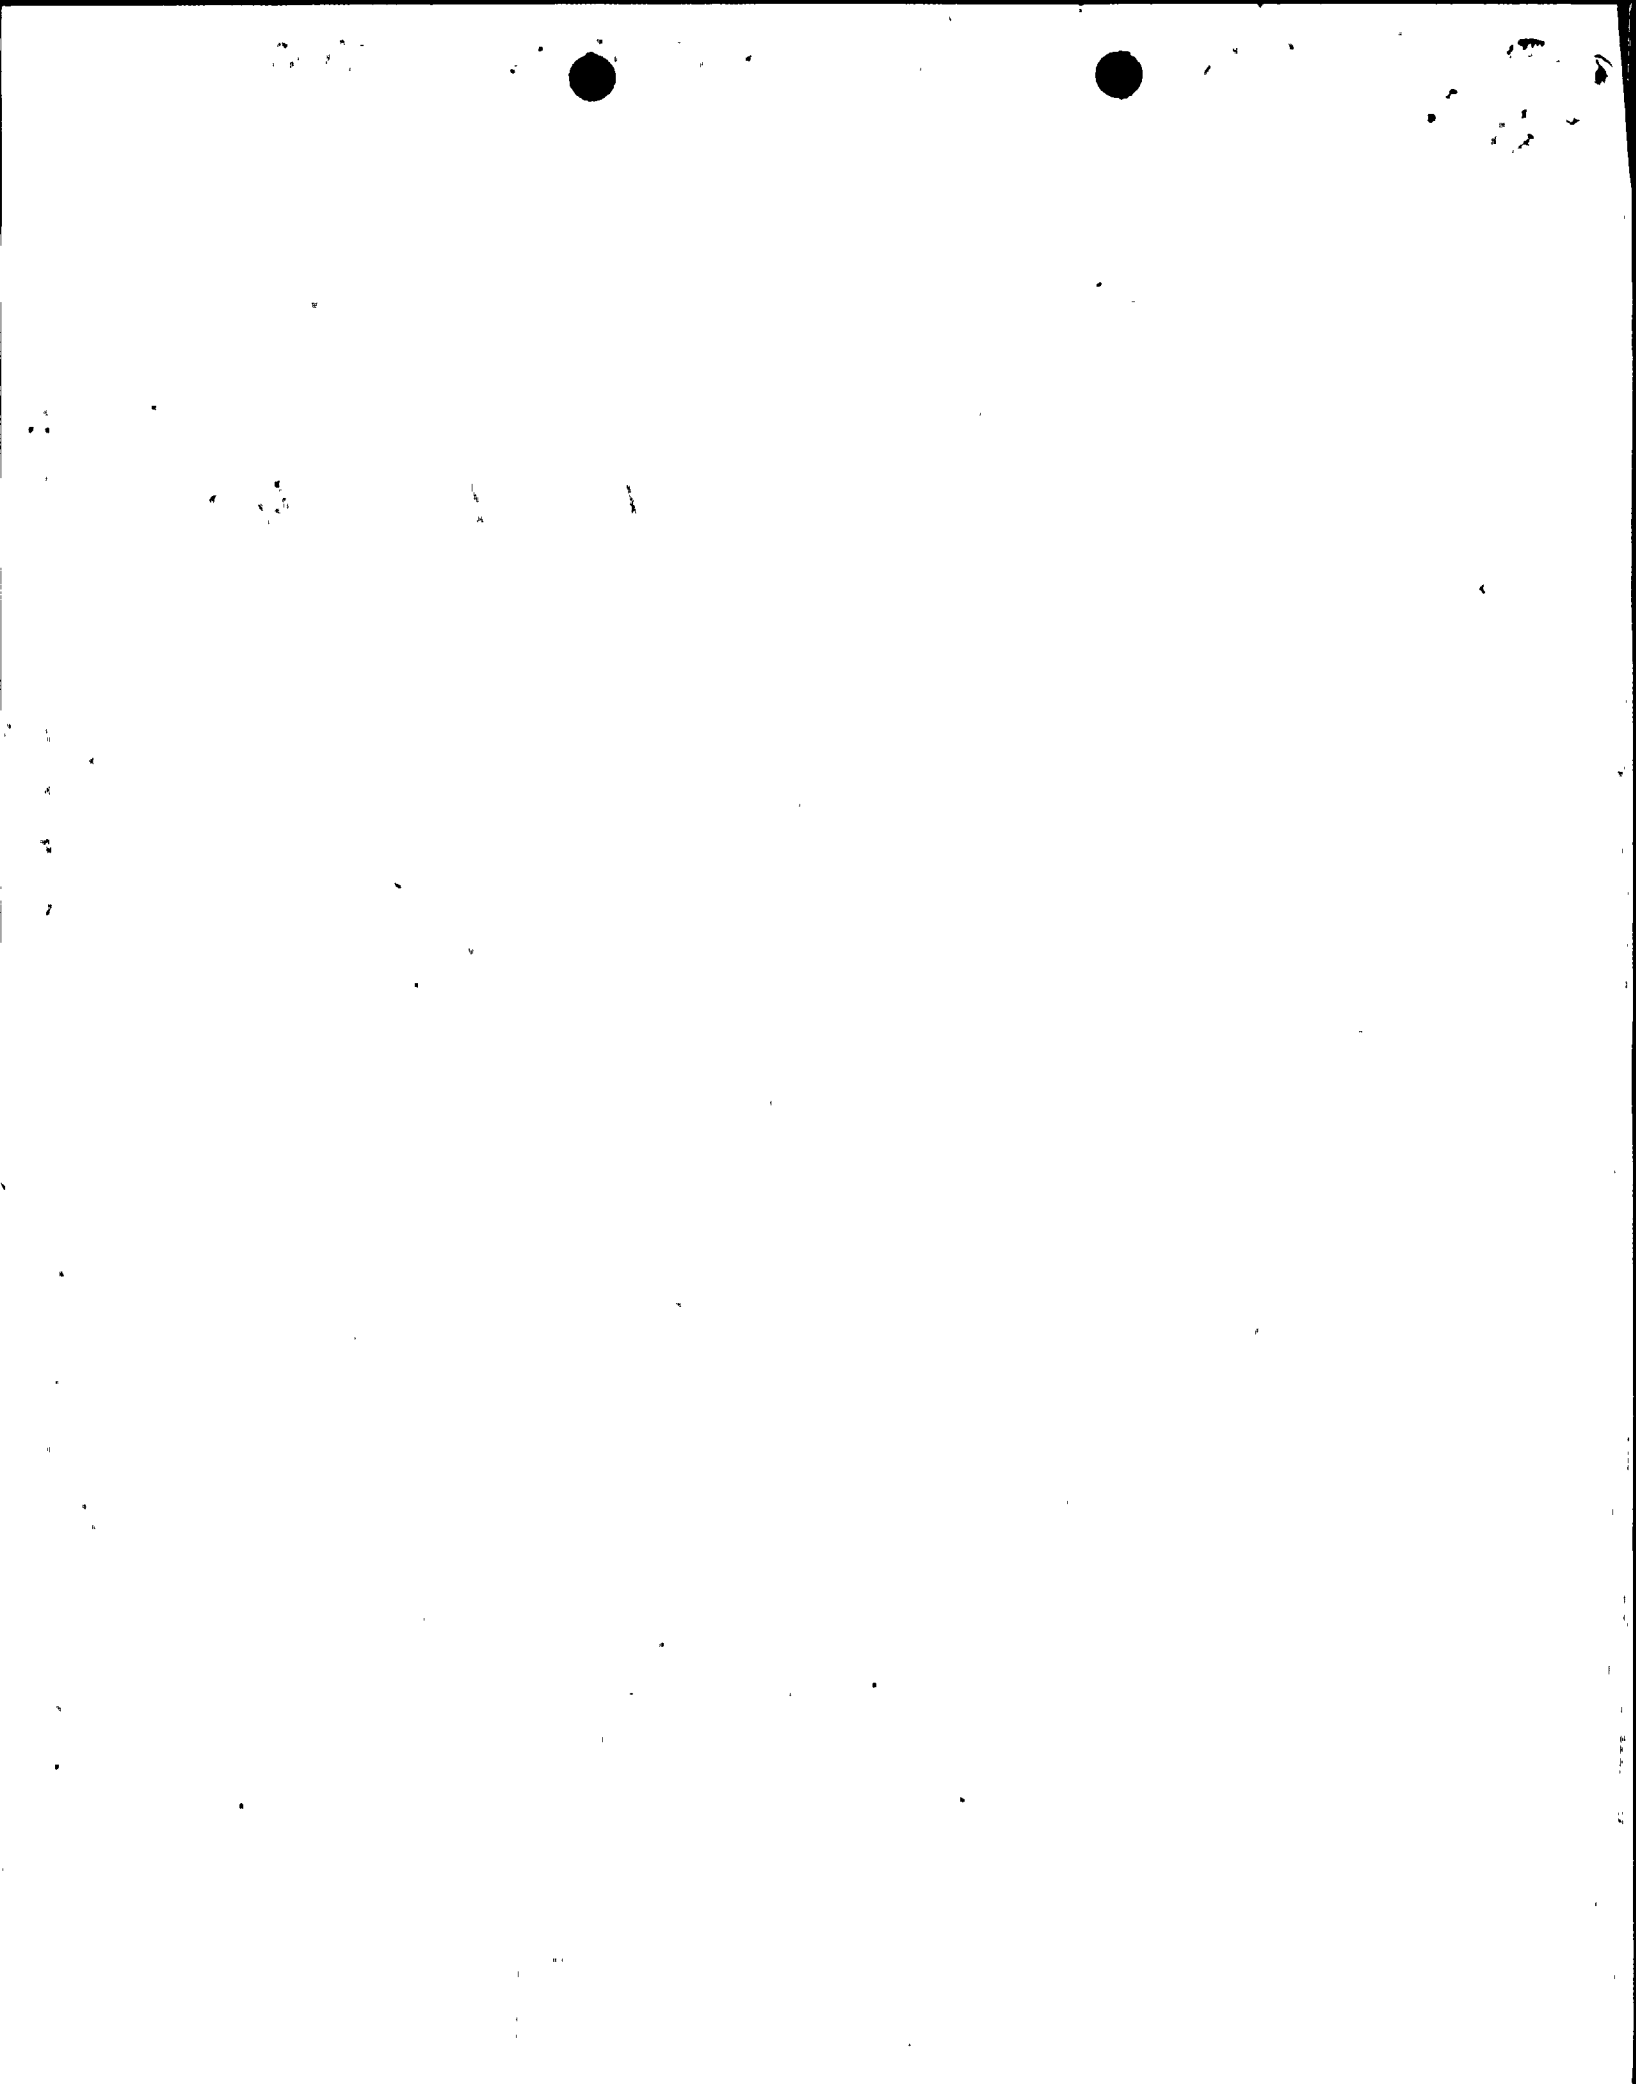



WASHINGTON PUBLIC POWER SUPPLY SYSTEM

P.O. Box 968 • 3000 George Washington Way • Richland, Washington 99352

July 20, 1989
G02-89-123

Docket No. 50-397

U. S. Nuclear Regulatory Commission
Attn: Document Control Desk
Mail Station P1-137
Washington, D.C. 20555

Gentlemen:

Subject: NUCLEAR PLANT NO. 2
SUPPLY SYSTEM'S RESPONSE TO
GENERIC LETTER 88-01 REQUEST
FOR ADDITIONAL INFORMATION

Reference: 1) Letter, R.B. Samworth (NRC) to
G.C. Sorensen (SS), "Generic Letter
88-01 Response, Request for Additional
Information (TAC No. 69161)", dated
May 16, 1989


2) Letter, G02-88-164, GC Sorensen (SS) to
NRC, "Supply System's Response to NRC's
Generic Letter 88-01", dated July 26, 1988

In Reference 1) the NRC requested that the Supply System provide additional information with respect to the Supply System's response to Generic Letter 88-01 (Reference 2). This information was requested to be provided within 60 days of receipt of the NRC's request.

The purpose of this letter is to provide an item by item response to the information requested above. A copy of this response has been sent to Dr. Armand A. Lakner with Viking Systems International.

This completes the Supply System's response to Generic Letter 88-01.

Very truly yours,


G. C. Sorensen, Manager
Regulatory Programs

DPR/bk

cc: JB Martin - NRC RV
NS Reynolds - BCP&R
RB Samworth - NRC
DL Williams - BPA/399
NRC Site Inspector - 901A
AA Lakner - Viking Systems International

8907280181 890720
PDR ADCK 05000397
P PDC

Accol
11 15