

COLR 94-10, Revision 1
Controlled Copy No. _____

WNP-2
Cycle 10
Core Operating Limits Report

December 1994

Washington Public Power Supply System

9502010200 950125
PDR ADOCK 05000397
P PDR

WNP-2
Cycle 10
Core Operating Limits Report

LIST OF EFFECTIVE PAGES

<u>Page</u>	<u>Revision</u>
i	0
1	1
2	1
3	0
4	0
5	0
6	0
7	0
8	0
9	0
10	0
11	0
12	1
13	0
14	0
15	0
16	0
17	0
18	0
19	0
20	0
21	0
22	0
23	0
24	0
25	0
26	0
27	0
28	0
29	0
30	0
31	0
32	0
33	0
34	0

WNP-2
Cycle 10
Core Operating Limits Report

LIST OF EFFECTIVE PAGES

Page

Revision

35
35a
36
37

1
1
0
0

WNP-2
Cycle 10
Core Operating Limits Report

TABLE OF CONTENTS

	<u>Page</u>
1.0 <u>INTRODUCTION AND SUMMARY</u>	1
2.0 <u>AVERAGE PLANAR LINEAR HEAT GENERATION RATE (APLHGR)</u> <u>LIMITS FOR USE IN TECHNICAL SPECIFICATION 3.2.1</u>	2
3.0 <u>MINIMUM CRITICAL POWER RATIO (MCPR) LIMIT FOR USE IN</u> <u>TECHNICAL SPECIFICATION 3.2.3</u>	8
4.0 <u>LINEAR HEAT GENERATION RATE (LHGR) LIMIT FOR USE IN</u> <u>TECHNICAL SPECIFICATION 3.2.4</u>	29
5.0 <u>REFERENCES</u>	35

1.0 INTRODUCTION AND SUMMARY

This report provides the Average Planar Linear Heat Generation Rate (APLHGR) limits, the Minimum Critical Power Ratio (MCPR) limits, and the Linear Heat Generation Rate (LHGR) limits for WNP-2, Cycle 10 as required by Technical Specification 6.9.3.1. As required by Technical Specifications 6.9.3.2 and 6.9.3.3, these limits were determined using NRC-approved methodology and are established so that all applicable limits of the plant safety analysis are met. The thermal limits for SPC fuel given in this report are documented in the "Cycle 10 Plant Transient Analysis" (Reference 5.1.1), the "Cycle 10 Reload Analysis" (Reference 5.1.2) and the "Improved Reduced Flow MCPR Operating Limits for WNP-2 Cycle 10" (Reference 5.1.9). The thermal limits determined through the approved methodology are modified for the GE11 and SVEA-96 LFAs as discussed below.

The WNP-2 Cycle 10 core includes four Siemens Power Corporation (SPC), four GE Nuclear Energy (GE), and four ABB Combustion Engineering Nuclear Operations (ABB CENO) Lead Fuel Assemblies (LFAs). The SPC LFAs were inserted during the reload for Cycle 5. The GE and ABB CENO LFAs were inserted at the beginning of Cycle 6 and were designed to be compatible with the reload fuel utilized in Cycle 6. The LFAs are loaded in core locations which analysis has shown to have sufficient thermal margin such that the LFAs are not expected to be the most limiting fuel assemblies on either a nodal or an assembly power basis. The GE Nuclear Energy GE11 LFAs are described in the "GE11 Lead Fuel Assembly Report for Washington Public Power Supply System Nuclear Project No. 2, Reload 5, Cycle 6" (Reference 5.3.1). This reference describes the design goals of the GE11 LFAs and provides support for monitoring the GE11 LFAs at thermal limits based on the SPC 8x8 reload fuel thermal limits. The ABB CENO SVEA-96 LFAs are described in the "Supplemental Lead Fuel Assembly Licensing Report—SVEA-96 LFAs for WNP-2—Summary" (Reference 5.3.2). The process for developing thermal limits for the SVEA-96 LFAs based upon the SPC 8x8 reload fuel thermal limits is described in References 5.3.2 through 5.3.4.

The MAPLHGR limits for the GE11 LFAs are the same as for the SPC 8x8 reload fuel, except that a ratio $([64-2]/[81-7])$ is applied to account for the different number of fuel pins in the two designs. The MAPLHGR limits for the SVEA-96 LFAs are the same as for the SPC 8x8 reload fuel, except that a ratio $([64-2]/[100-4])$ is applied to account for the different number of fuel pins in the two designs. Furthermore, the MAPLHGR limits for the SVEA-96 LFAs are multiplied by the following constants: (a) 1.04 to account for a different estimation of the local power in the output from POWERPLEX compared to ABB CENO methods and (b) 1.02 to account for a different estimation of exposure in the output from POWERPLEX compared to ABB CENO methods.

The MCPR limit is the maximum of (a) the applicable exposure dependent, full power and full flow MCPR limit, (b) the applicable exposure and power dependent MCPR limit, and (c) the flow dependent MCPR limit specified in this report. This stipulation assures that the safety limit MCPR will not be violated throughout the WNP-2 operating regime. Full power MCPR limits are specified to define operating limits at rated power and flow. For the WNP-2 core, the Turbine Trip without Bypass event is limiting for operation at rated power and flow. Power dependent MCPR limits are specified to define operating limits at other than rated power

conditions. For the WNP-2 core, the Feedwater Controller Failure event from reduced power is calculated to be more severe than from full power conditions. A flow dependent MCPR is specified to define operating limits at other than rated flow conditions. The reduced flow MCPR limit provides bounding protection for the limiting Recirculation Flow Increase event (Reference 5.1.9).

The LHGR limits for the GE11 LFAs are the same as for the SPC 8x8 reload fuel, except that a ratio ($[64-2]/[81-7]$) is applied to account for the different number of fuel pins in the two designs. The LHGR limits for the SVEA-96 LFAs are taken directly from Reference 5.3.2.

The reload licensing analyses for this cycle provide operating limits for Extended Load Line (ELLLA) operation which extends the power and flow operating regime for WNP-2 up to the 109% rod line which at full power corresponds to 87% of rated flow. The MCPR limits defined in this report are applicable up to 100% of rated thermal power along and below the 109% rod line. The minimum flow for operation at rated power is 87% of rated flow; the maximum is 106%. References 5.1.1 and 5.1.2 and the references in Section 5.4 document the analyses in support of ELLLA operation.

Preparation, review and approval of this report were performed in accordance with applicable Supply System procedures. The specific topical report revisions and supplements which describe the methodology utilized in this cycle specific analysis are referenced in Section 5.2.

2.0 AVERAGE PLANAR LINEAR HEAT GENERATION RATE (APLHGR) LIMITS FOR USE IN TECHNICAL SPECIFICATION 3.2.1

The APLHGRs for use in Technical Specification 3.2.1 shall not exceed the limits shown in Figures 2.1, 2.2, 2.4, and 2.5 when in two-loop operation and in Figures 2.1, 2.3, 2.4, and 2.5 when in single loop operation. The limits for each fuel type as a function of Average Planar Exposure are provided for the SPC reload fuel, the SPC LFAs, the SVEA-96 LFAs, and the GE11 LFAs.



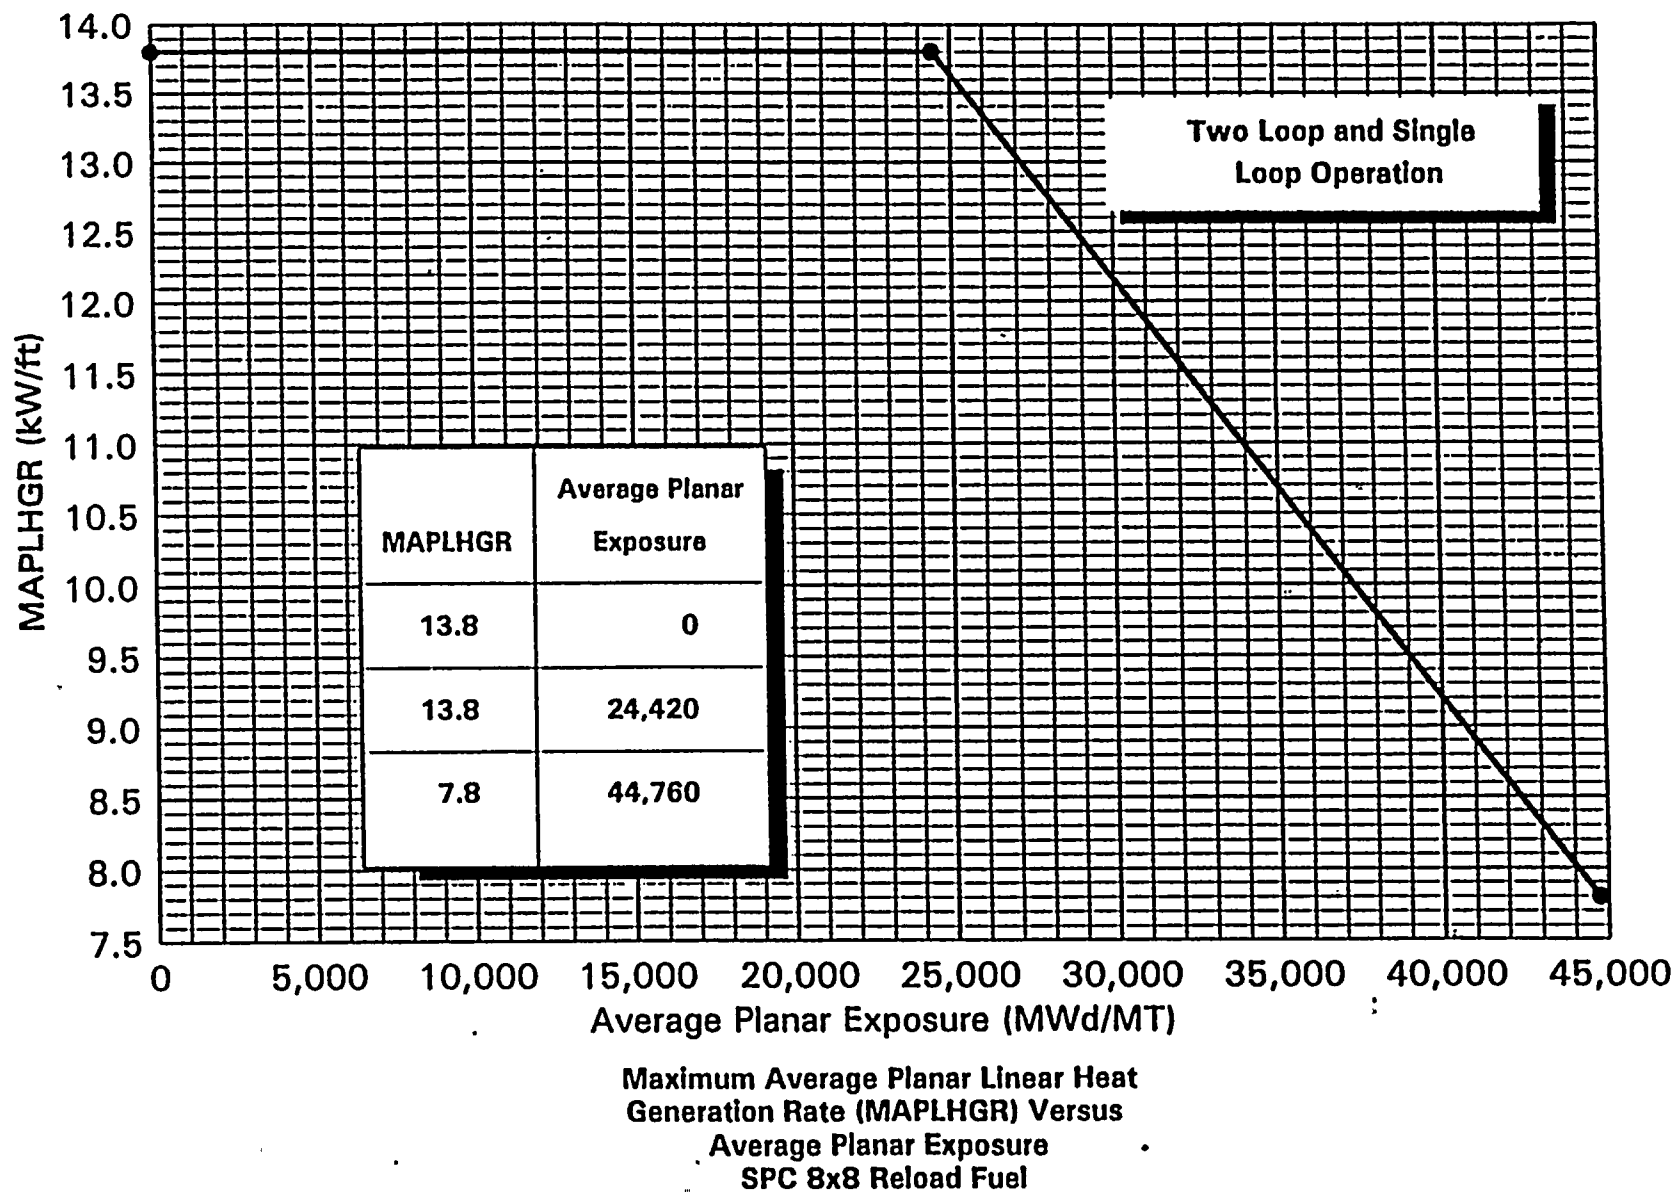


Figure 2.1

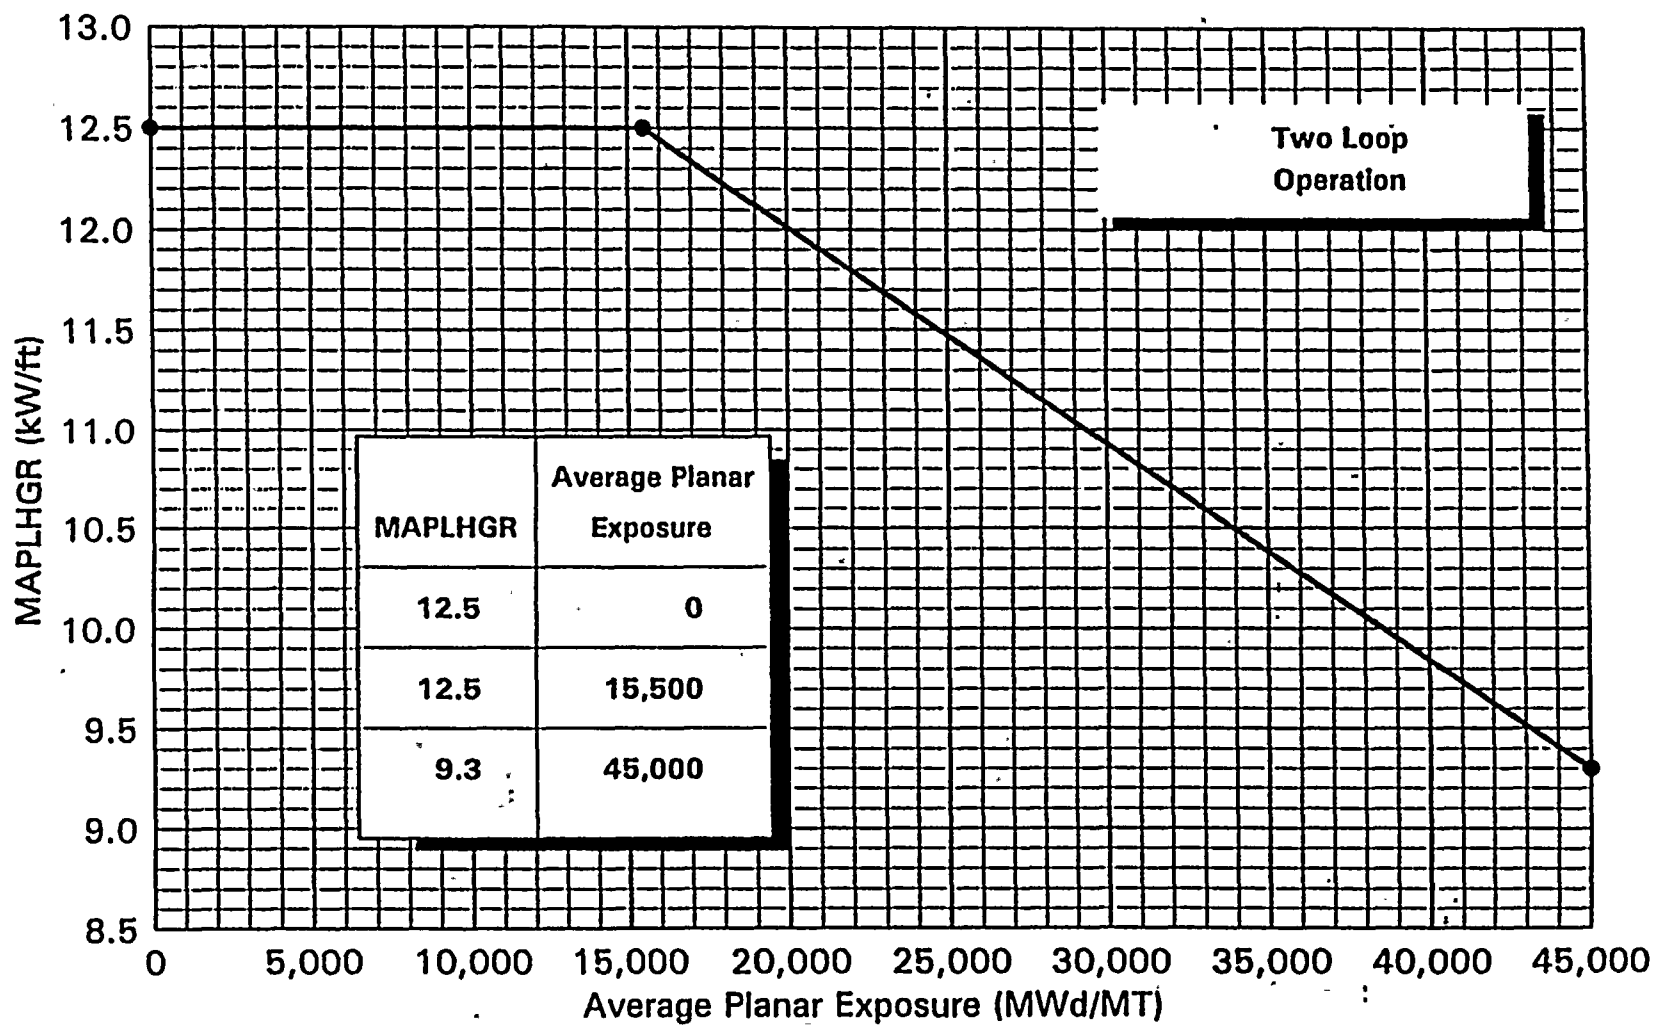


Maximum Average Planar Linear Heat
Generation Rate (MAPLHGR) Versus
Average Planar Exposure
SPC 9x9-9X Reload Fuel and SPC 9x9 LFA's

Figure 2.2

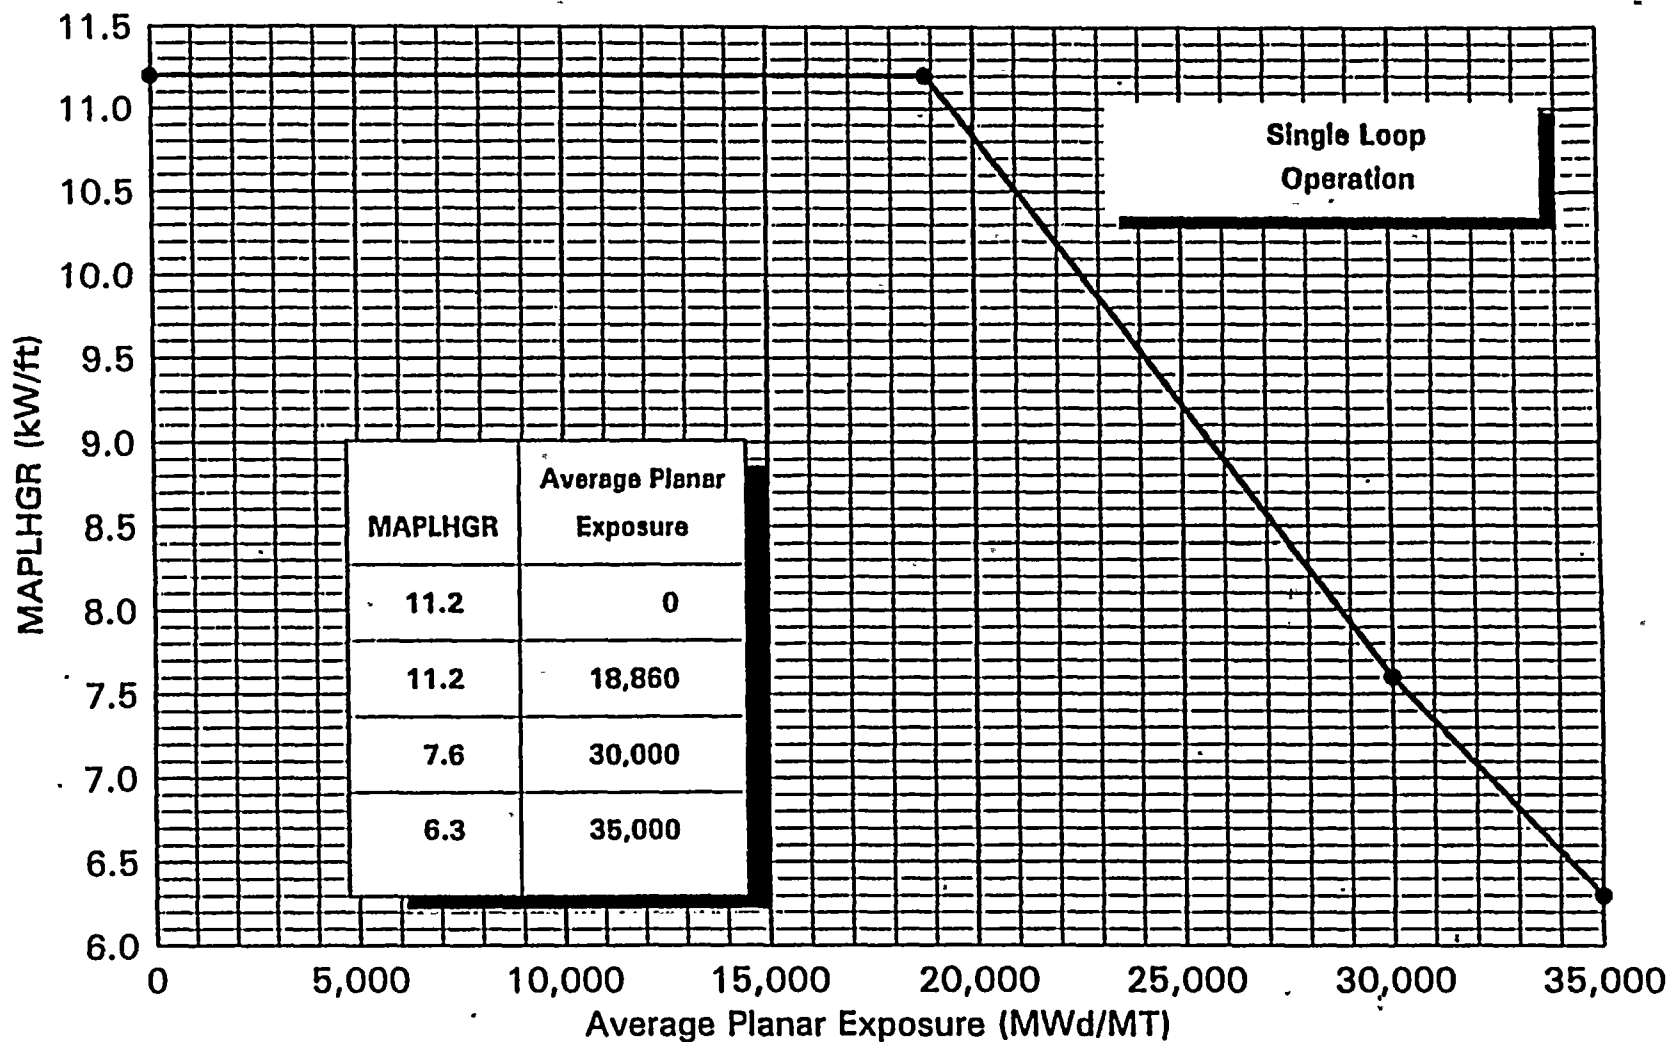


Maximum Average Planar Linear Heat
Generation Rate (MAPLHGR) Versus
Average Planar Exposure
SPC 9x9-9X Reload Fuel and SPC 9x9 LFA's

Figure 2.3

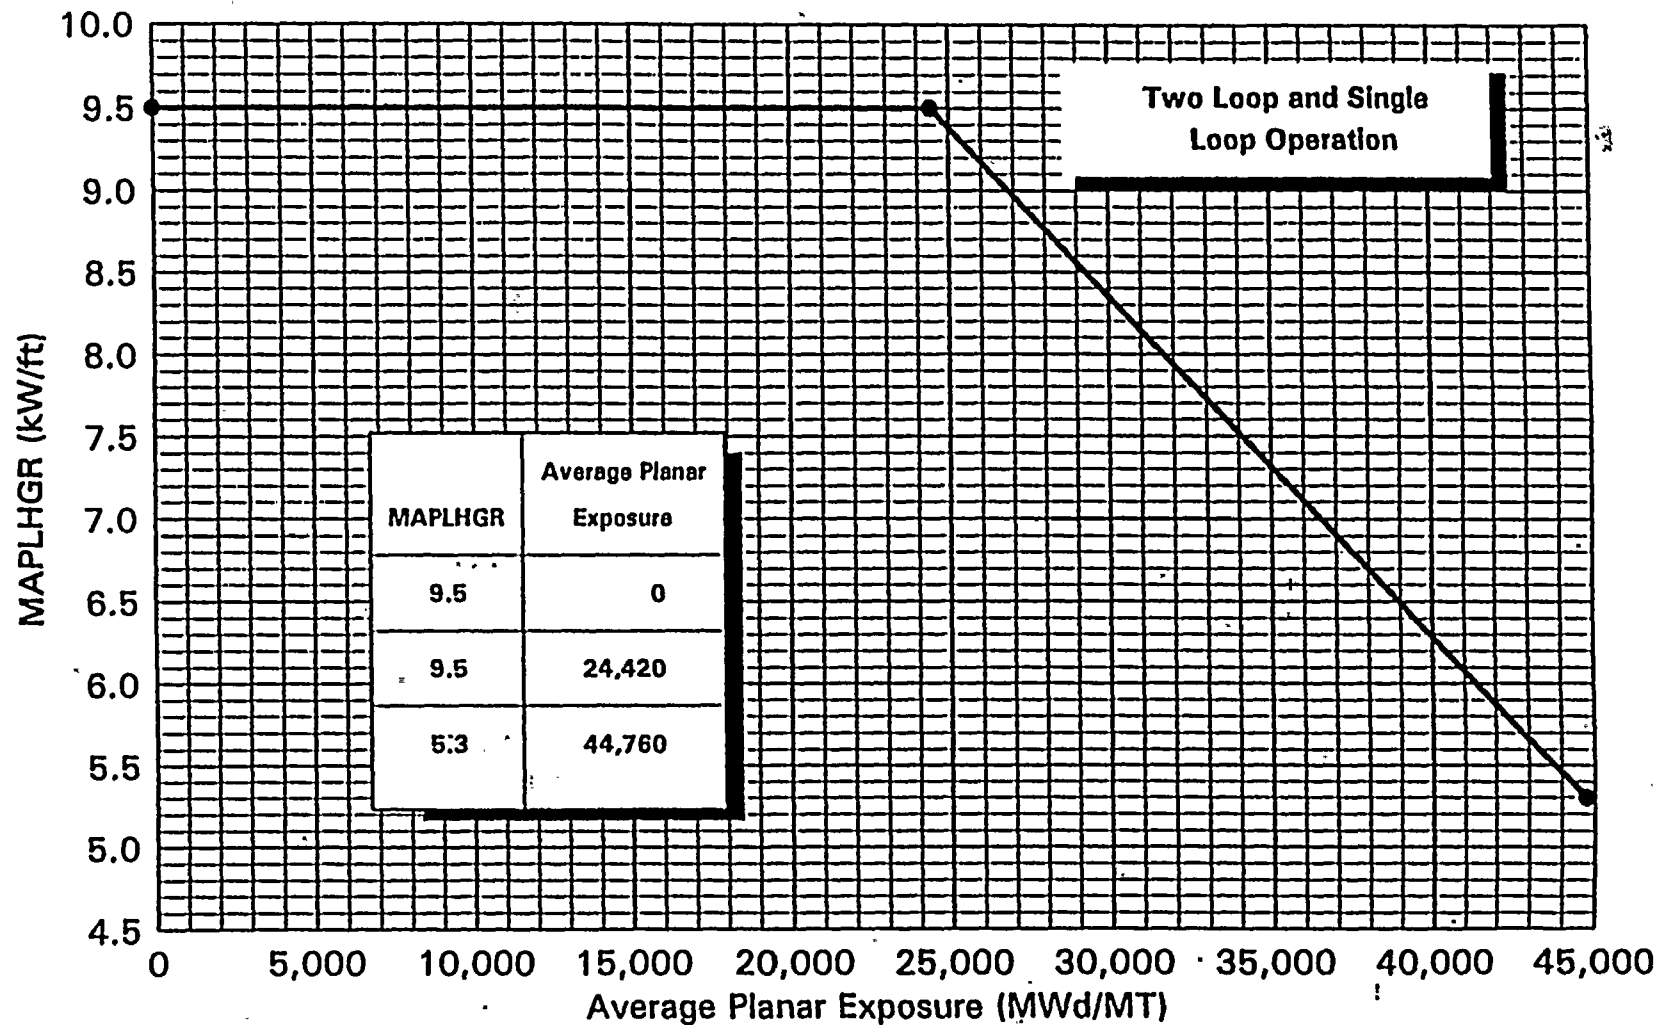

Maximum Average Planar Linear Heat Generation Rate (MAPLHGR) Versus Average Planar Exposure SVEA-96 Lead Fuel Assemblies

Figure 2.4

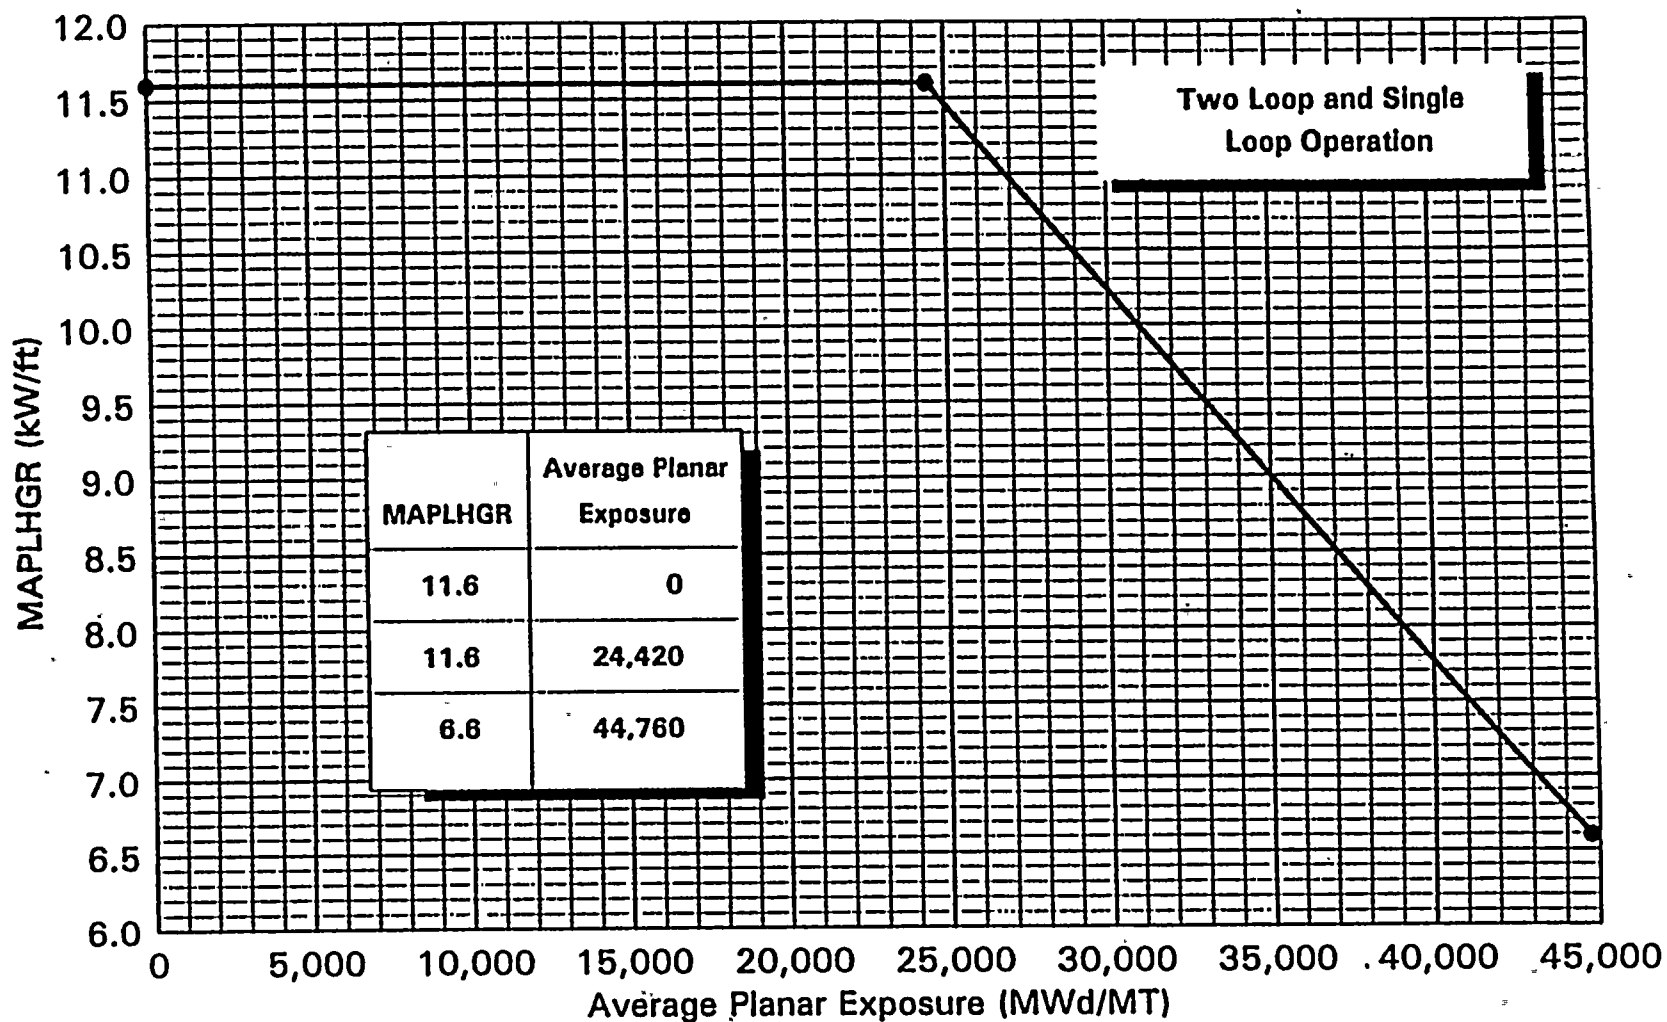

Maximum Average Planar Linear Heat
Generation Rate (MAPLHGR) Versus
Average Planar Exposure
GE11 Lead Fuel Assemblies

Figure 2.5

3.0 MINIMUM CRITICAL POWER RATIO (MCPR) LIMIT FOR USE IN TECHNICAL SPECIFICATION 3.2.3

The MCPR limit for use in Technical Specification 3.2.3 shall be:

Greater than or equal to the greater of the limits determined from Tables 3.1a and 3.1b and Figures 3.1 and 3.2a through 3.11b.

Table 3.1a
WNP-2 Cycle 10 MCPR Operating Conditions
Cycle Exposures ≤ 4500 MWd/MTU

Condition Limit		SLMCPR = 1.07 ⁽²⁾			
		SPC 8x8 GE11 LFA	SPC 9x9 LFA	SPC 9x9 LFA	SVEA-96 LFA
NSS ⁽¹⁾	Full Power	1.24 ⁽³⁾	1.24 ⁽³⁾	1.28	1.44 ⁽³⁾
	Flow Dependent	Figure 3.1			
	Power Dependent ⁽⁴⁾	Fig. 3.2a	Fig. 3.3a	Fig. 3.3a	Fig. 3.2a
TSSS ⁽¹⁾	Full Power	1.26	1.24	1.35	1.48
	Flow Dependent	Figure 3.1			
	Power Dependent ⁽⁴⁾	Fig. 3.4a	Fig. 3.5a	Fig. 3.5a	Fig. 3.4a
NSS ⁽¹⁾ RPT Inoperable	Full Power	1.28	1.27	1.43	1.51
	Flow Dependent	Figure 3.1			
	Power Dependent ⁽⁴⁾	Fig. 3.10a	Fig. 3.11a	Fig. 3.11a	Fig. 3.10a
SLO ⁽²⁾ NSS	Full Power	1.56	1.36	1.36	1.98
	Flow Dependent	None			
	Power Dependent ⁽⁴⁾	Fig. 3.2a	Fig. 3.3a	Fig. 3.3a	Fig. 3.2a
SLO ⁽²⁾ TSSS	Full Power	1.56	1.36	1.36	1.98
	Flow Dependent	None			
	Power Dependent ⁽⁴⁾	Fig. 3.4a	Fig. 3.5a	Fig. 3.5a	Fig. 3.4a
SLO ⁽²⁾ NSS RPT Inoperable	Full Power	1.56	1.36	1.36	1.98
	Flow Dependent	None			
	Power Dependent ⁽⁴⁾	Fig. 3.10a	Fig. 3.11a	Fig. 3.11a	Fig. 3.10a

Table 3.1b
WNP-2 Cycle 10 MCPR Operating Conditions
Cycle Exposures > 4500 MWd/MTU

Condition Limit		SLMCPR = 1.07 ⁽²⁾				SLMCPR = 1.07 ⁽²⁾ FFTR			
		SPC 8x8 GE11 LFA	SPC 9x9	SPC 9x9 LFA	SVEA-96	SPC 8x8 GE11 LFA	SPC 9x9 LFA	SPC 9x9 LFA	SVEA-96
NSS ⁽¹⁾	Full Power	1.30	1.27	1.44	1.54	1.32	1.29	1.46	1.58
	Flow Dependent	Figure 3.1				Figure 3.1			
	Power Dependent ⁽⁴⁾	Fig. 3.2b	Fig. 3.3b	Fig. 3.3b	Fig. 3.2b	Fig. 3.6	Fig. 3.7	Fig. 3.7	Fig. 3.6
TSSS ⁽¹⁾	Full Power	1.33	1.30	1.49	1.60	1.35	1.32	1.51	1.63
	Flow Dependent	Figure 3.1				Figure 3.1			
	Power Dependent ⁽⁴⁾	Fig. 3.4b	Fig. 3.5b	Fig. 3.5b	Fig. 3.4b	Fig. 3.8	Fig. 3.9	Fig. 3.9	Fig. 3.8
NSS ⁽¹⁾ RPT Inoperable	Full Power	1.38	1.35	1.61	1.68	Not Analyzed			
	Flow Dependent	Figure 3.1							
	Power Dependent ⁽⁴⁾	Fig. 3.10b	Fig. 3.11b	Fig. 3.11b	Fig. 3.10b				
SLO ⁽²⁾ NSS	Full Power	1.56	1.36	1.36	1.98	1.56	1.36	1.36	1.98
	Flow Dependent	None				None			
	Power Dependent ⁽⁴⁾	Fig. 3.2b	Fig. 3.3b	Fig. 3.3b	Fig. 3.2b	Fig. 3.6	Fig. 3.7	Fig. 3.7	Fig. 3.6
SLO ⁽²⁾ TSSS	Full Power	1.56	1.36	1.36	1.98	1.56	1.36	1.36	1.98
	Flow Dependent	None				None			
	Power Dependent ⁽⁴⁾	Fig. 3.4b	Fig. 3.5b	Fig. 3.5b	Fig. 3.4b	Fig. 3.8	Fig. 3.9	Fig. 3.9	Fig. 3.8
SLO ⁽²⁾ NSS RPT Inoperable	Full Power	1.56	1.36	1.36	1.98	Not Analyzed			
	Flow Dependent	None							
	Power Dependent ⁽⁴⁾	Fig. 3.10b	Fig. 3.11b	Fig. 3.11b	Fig. 3.10b				

Notes for Tables 3.1a and 3.1b

Note 1: The scram insertion times must meet the requirements of Technical Specification 3.1.3.4. The NSS MCPR values are based on the SPC transient analysis performed using the control rod insertion times shown below (defined as normal scram speed: NSS). In the event that Surveillance 4.1.3.2 shows these scram insertion times have been exceeded, the MCPR limit shall be determined from the applicable Technical Specification Scram Speed (TSSS) MCPR limits in Tables 3.1a and b.

Position Inserted From Fully Withdrawn	Slowest measured average control rod insertion times to specified notches for all operable control rods for each group of four control rods arranged in a two-by-two array (seconds)
Notch 45	0.380
Notch 39	0.720
Notch 25	1.600
Notch 5	2.950

Note 2: For Single Loop Operation (SLO), the SLMCPR increases by 0.01. The increase is included in the MCPR limits for SLO.

Note 3: For the noted full power MCPR limits, the control rod withdrawal error (CRWE) event is limiting. The turbine trip without bypass (TTNB) event is limiting for the remaining full power limits. CRWE analysis was performed with a nominal rod block monitor (RBM) setpoint of 1.06. Use of the nominal setpoint is in accordance with the methodology described in Reference 5.2.6, consistent with approved industry practice.

Note 4: Power dependent MCPR limits are provided for core thermal powers greater than or equal to 25% of rated power at all core flows. The power dependent MCPR limits for core thermal powers less than or equal to 30% of rated power are subdivided by core flow. Limits are provided for core flows greater than 50% of rated flow and less than or equal to 50% of rated flow, respectively. A step change in the power dependent MCPR limits occurs at 30% of rated power because direct scram on turbine throttle valve closure is automatically bypassed per Technical Specification 3.3.1.



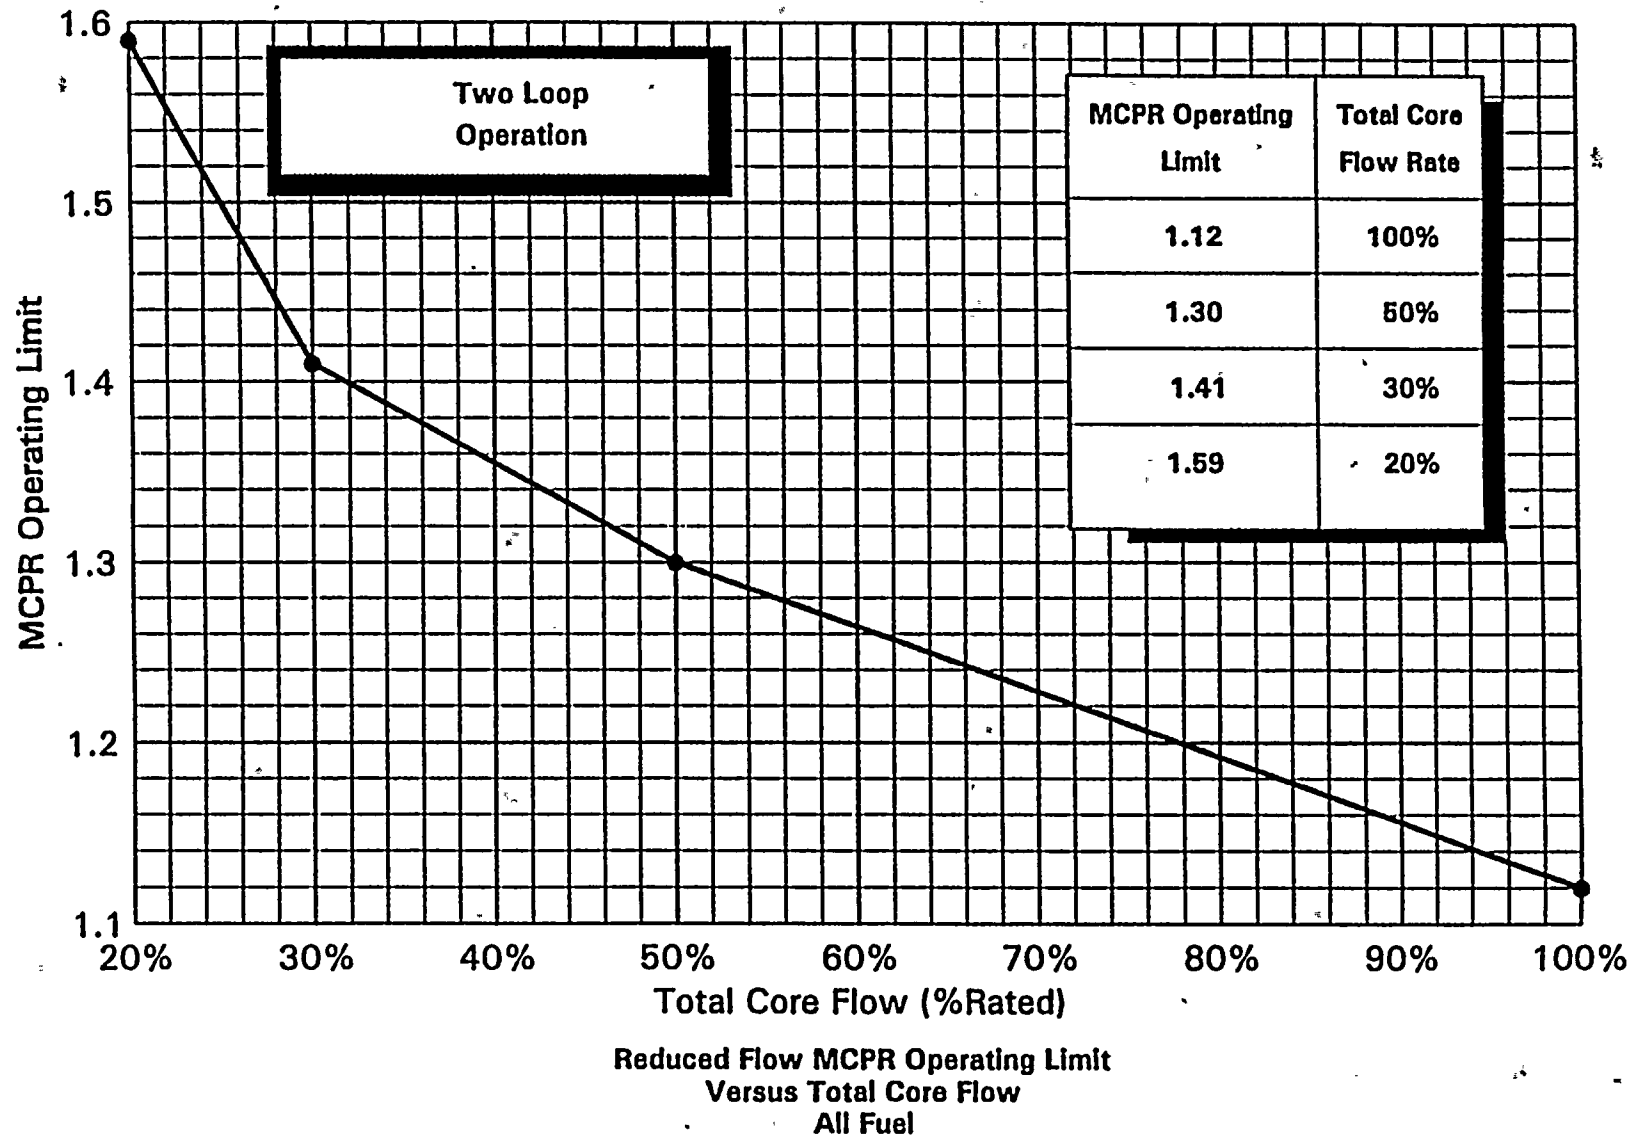


Figure 3.1

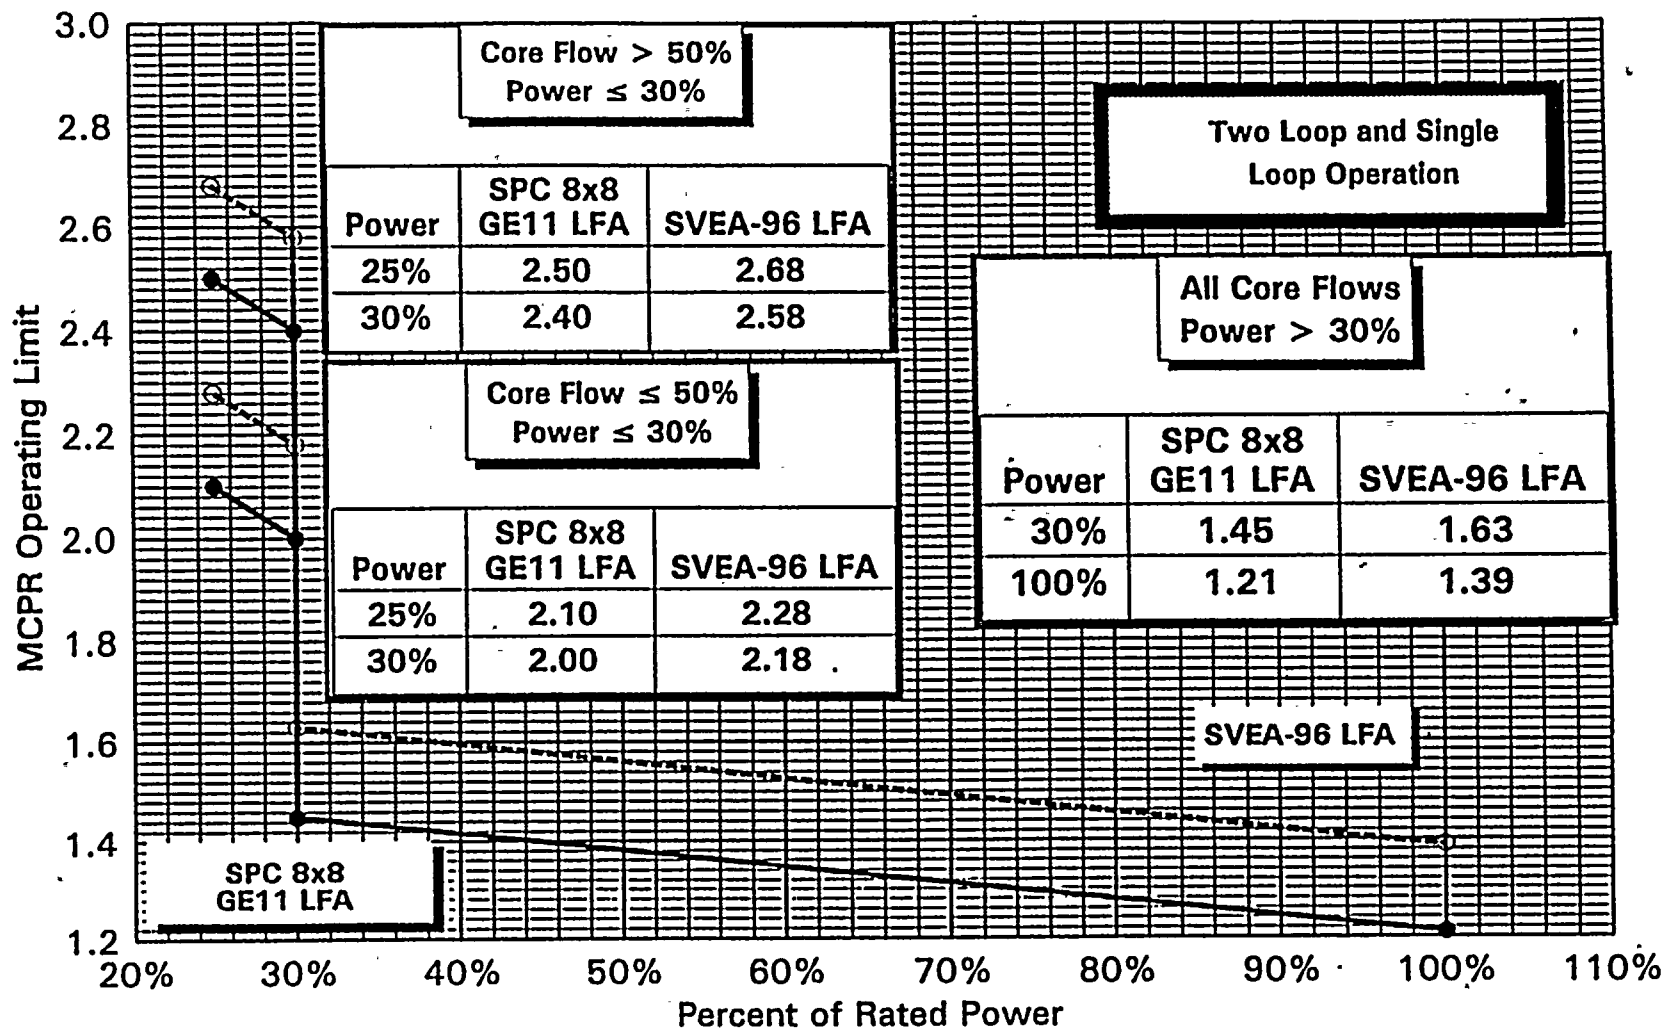


Reduced Power MCPR Operating Limit
 Versus Percent of Rated Power
 NSS, RPT Operable
 SPC 8x8, GE11 LFA, SVEA-96 LFA
 Cycle Exposures ≤ 4500 MWd/MT

Figure 3.2a

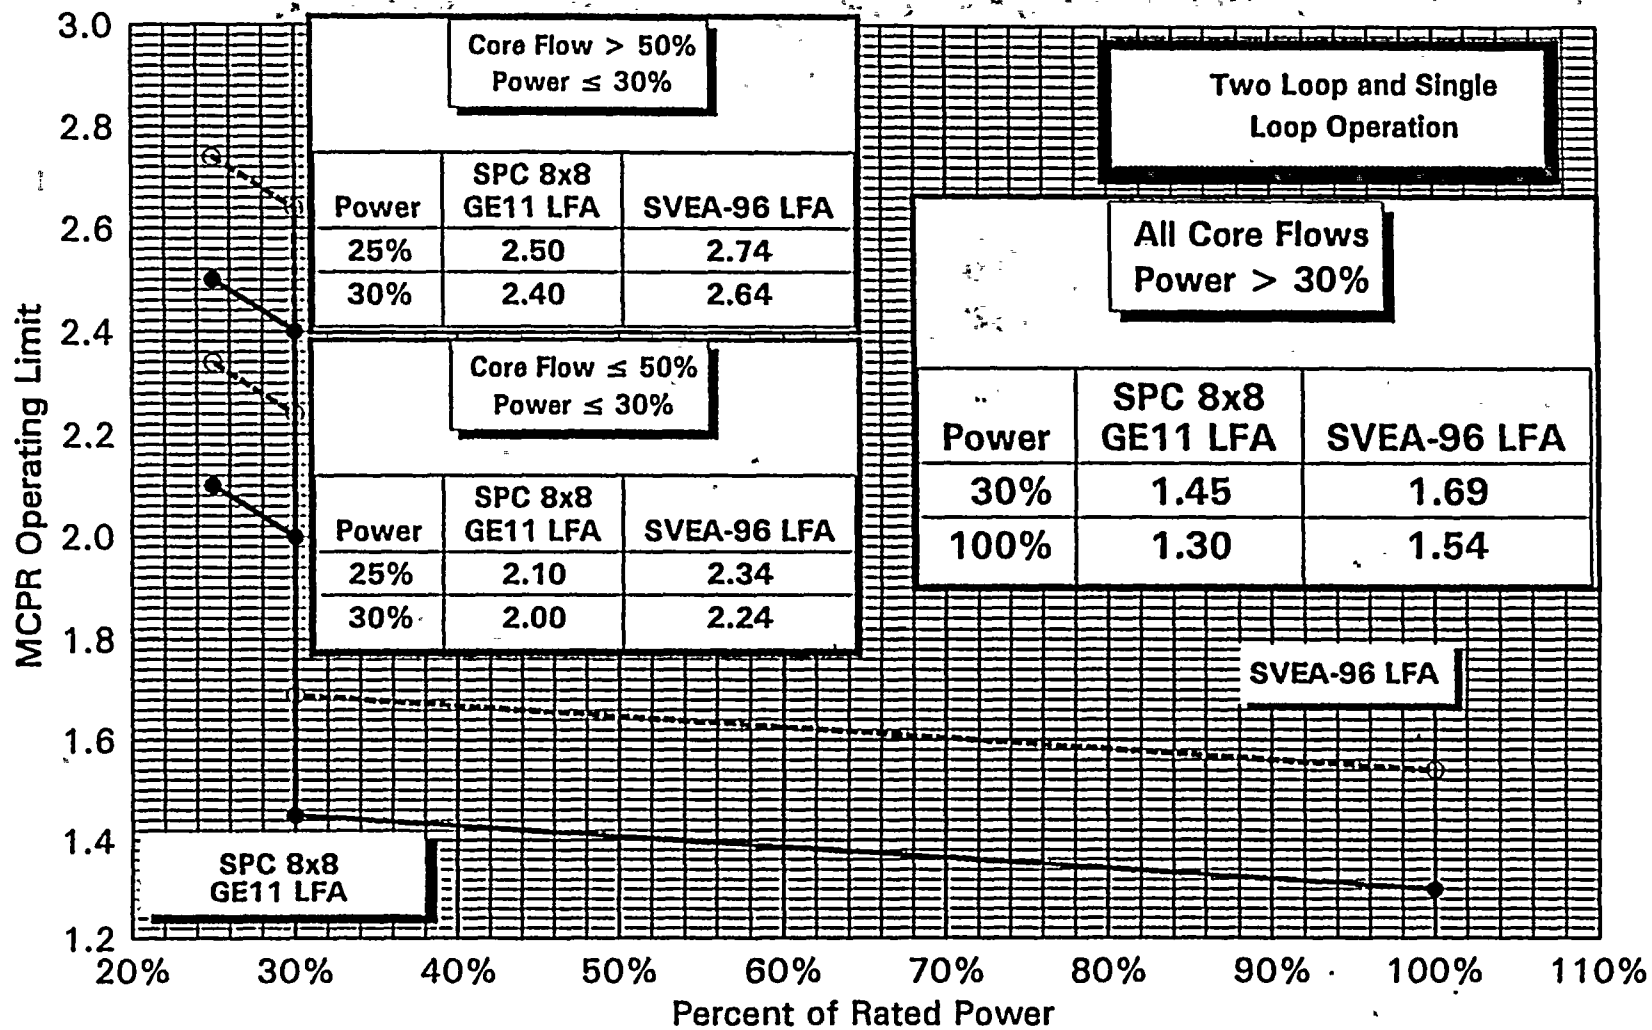


Reduced Power MCPR Operating Limit
Versus Percent of Rated Power
NSS, RPT Operable
SPC 8x8, GE11 LFA, SVEA-96 LFA
Cycle Exposures > 4500 MWd/MT

Figure 3.2b

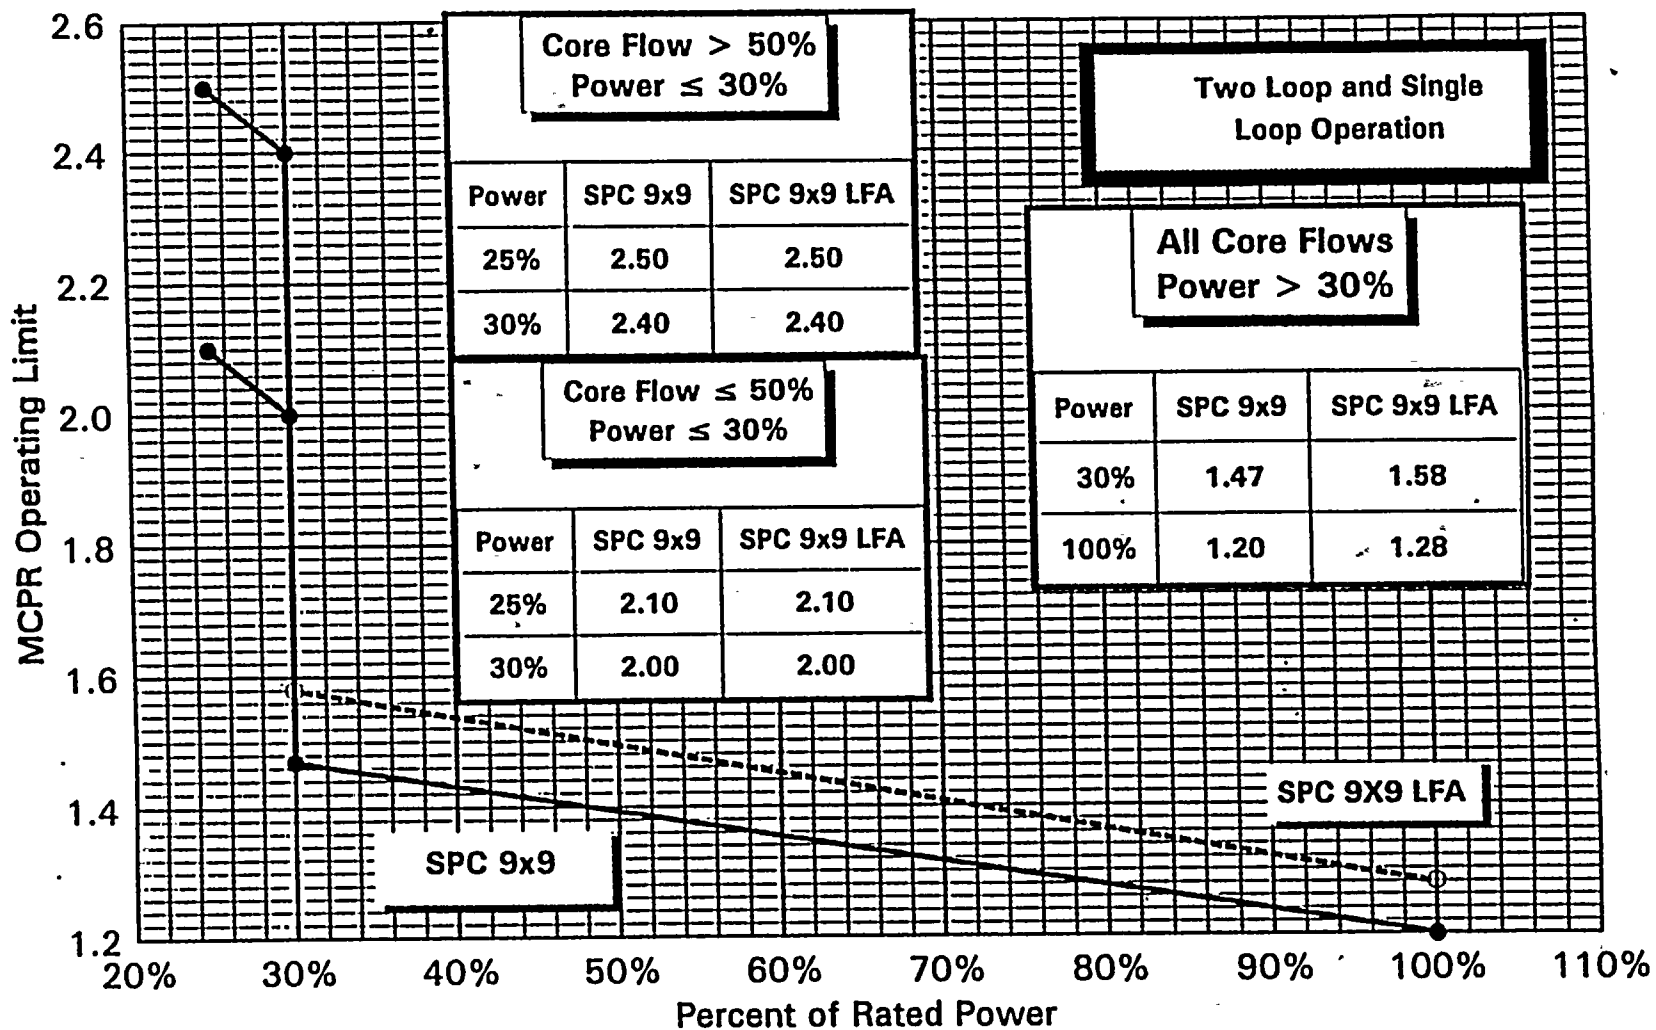


Reduced Power MCPR Operating Limit
Versus Percent of Rated Power
NSS, RPT Operable
SPC 9x9, SPC 9x9 LFA
Cycle Exposures ≤ 4500 MWd/MT

Figure 3.3a

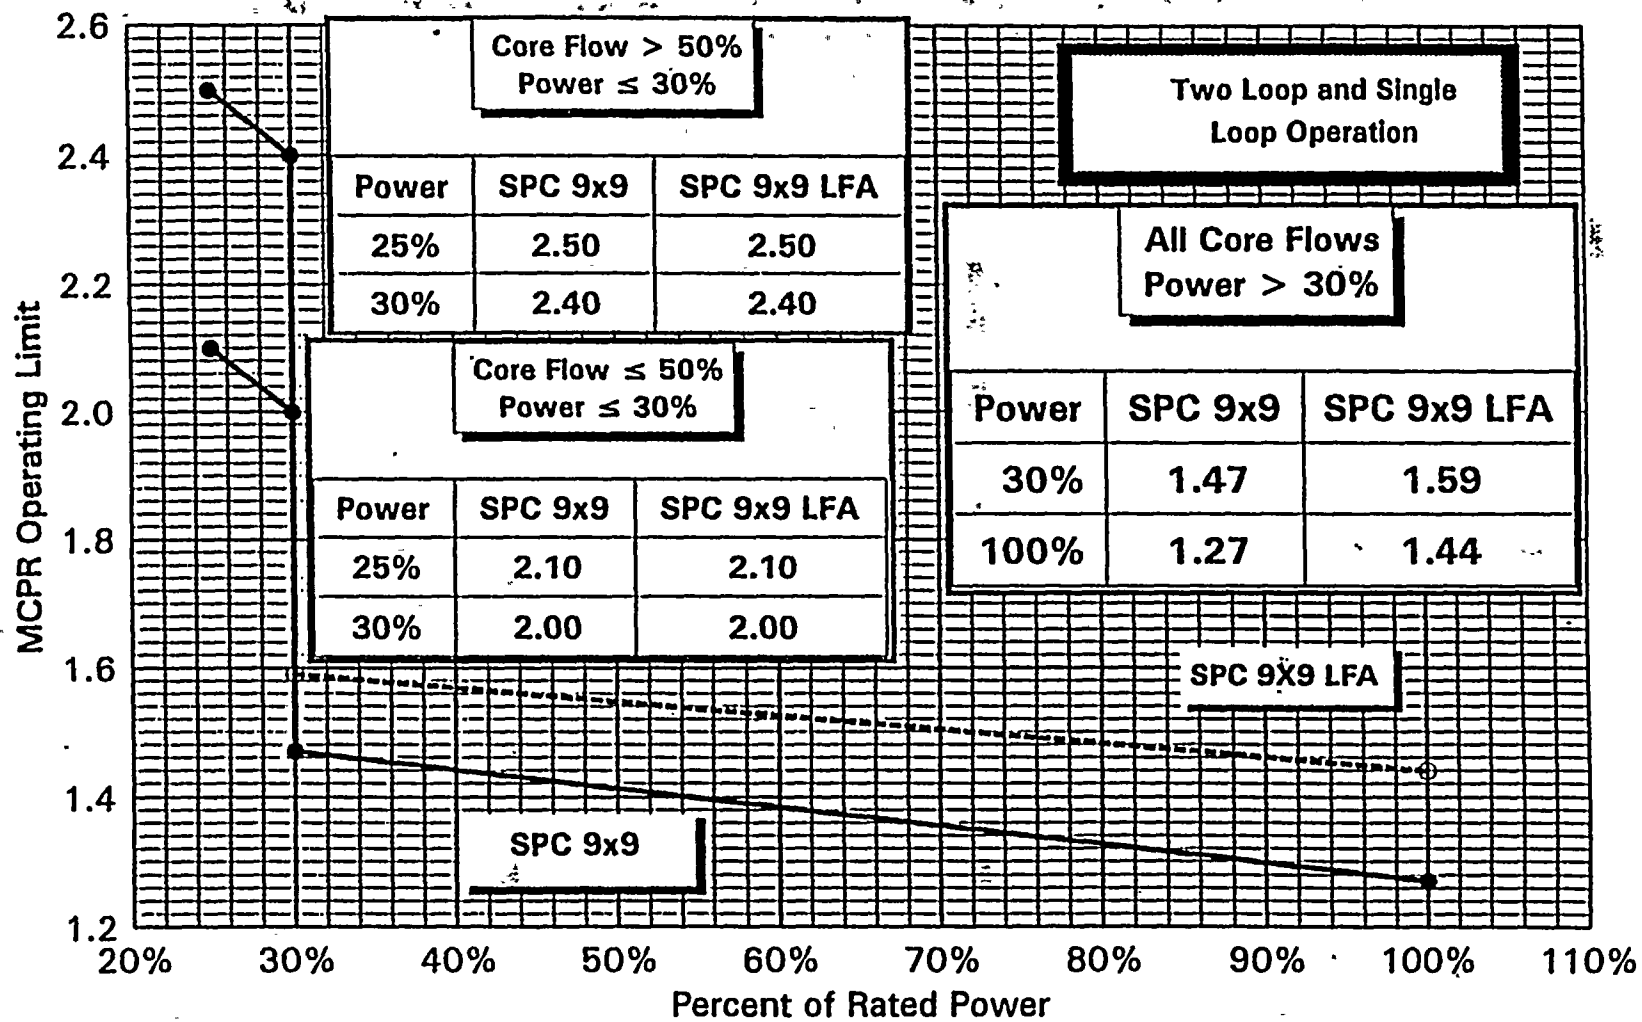


Reduced Power MCPR Operating Limit
Versus Percent of Rated Power
NSS, RPT Operable
SPC 9x9, SPC 9x9 LFA
Cycle Exposures > 4500 MWd/MT

Figure 3.3b

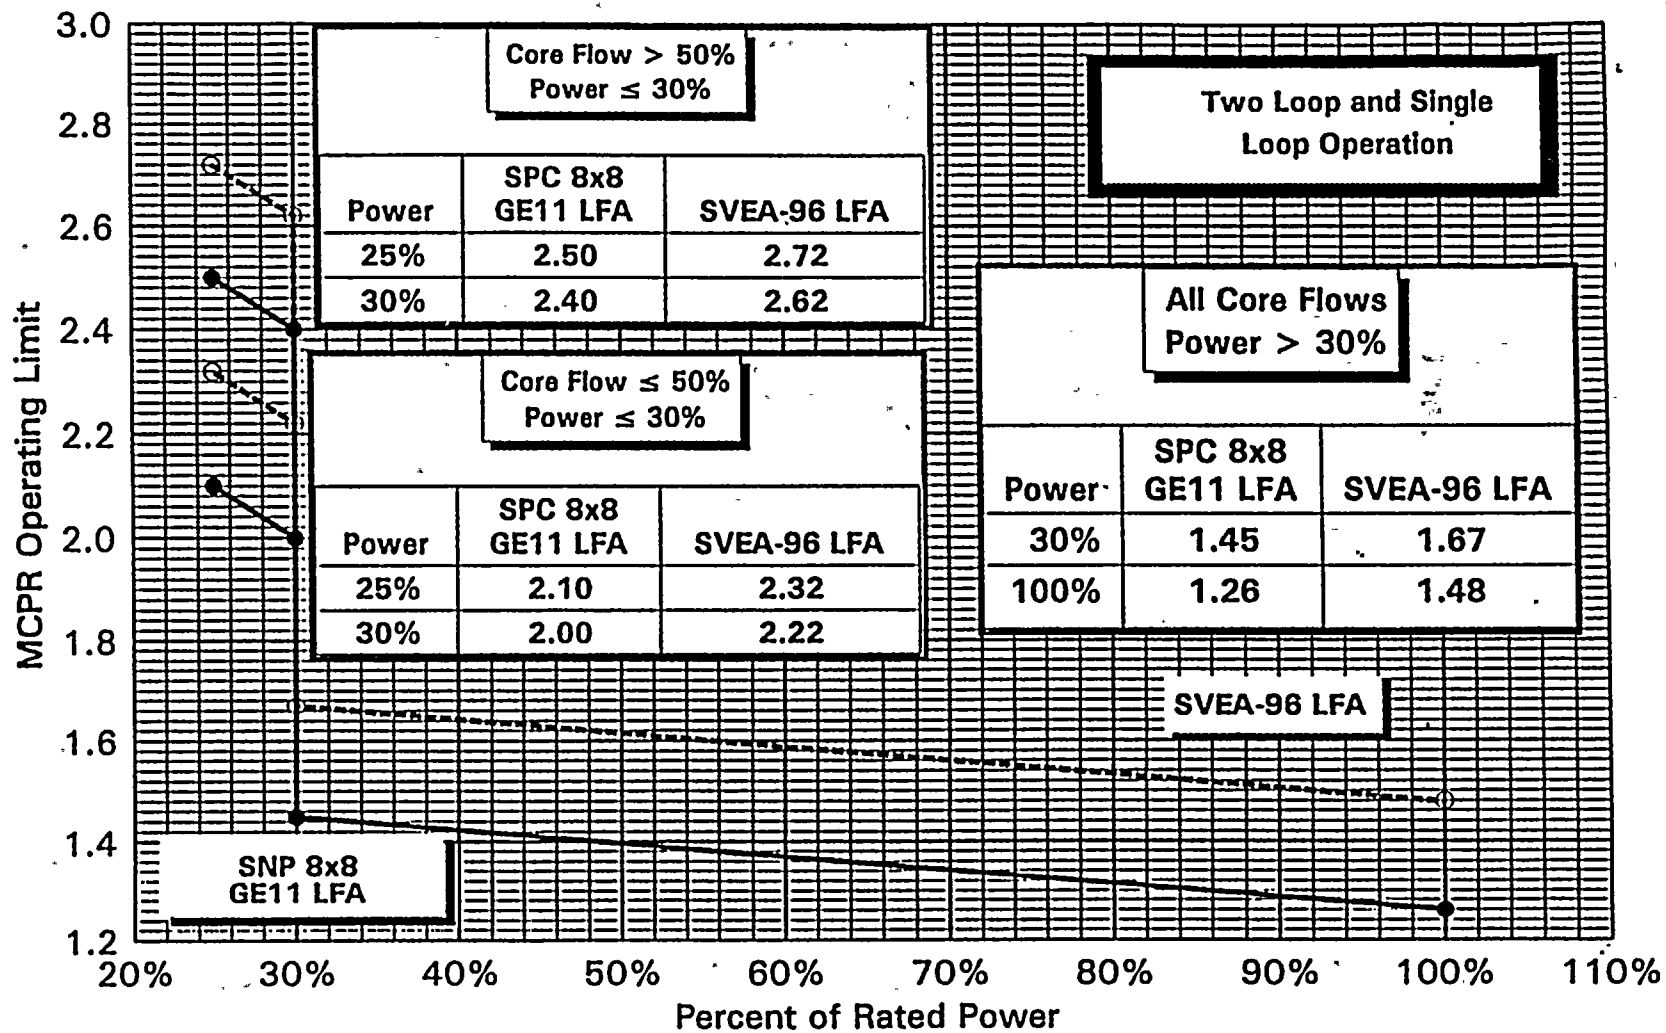


Reduced Power MCPR Operating Limit
Versus Percent of Rated Power
TSSS, RPT Operable
SPC 8x8, GE11 LFA, SVEA-96 LFA
Cycle Exposures ≤ 4500 MWd/MT

Figure 3.4a

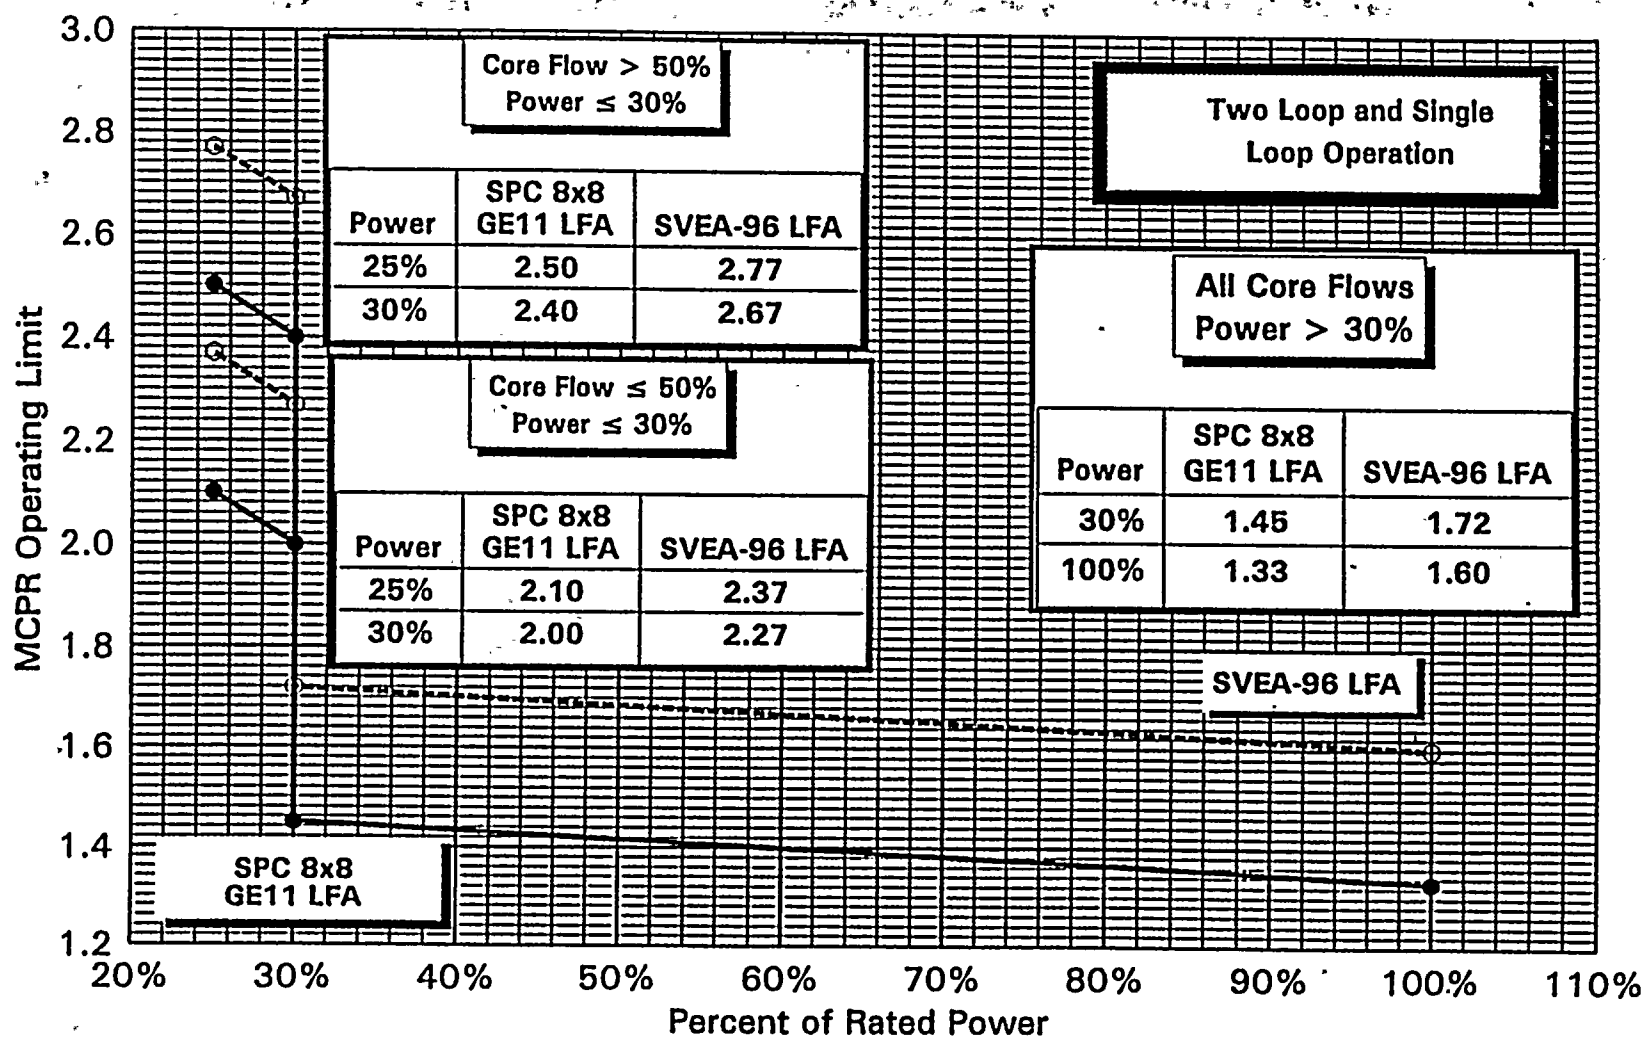


Reduced Power MCPR Operating Limit
Versus Percent of Rated Power
TSSS, RPT Operable
SPC 8x8, GE11 LFA, SVEA-96 LFA
Cycle Exposures > 4500 MWd/MT

Figure 3.4b

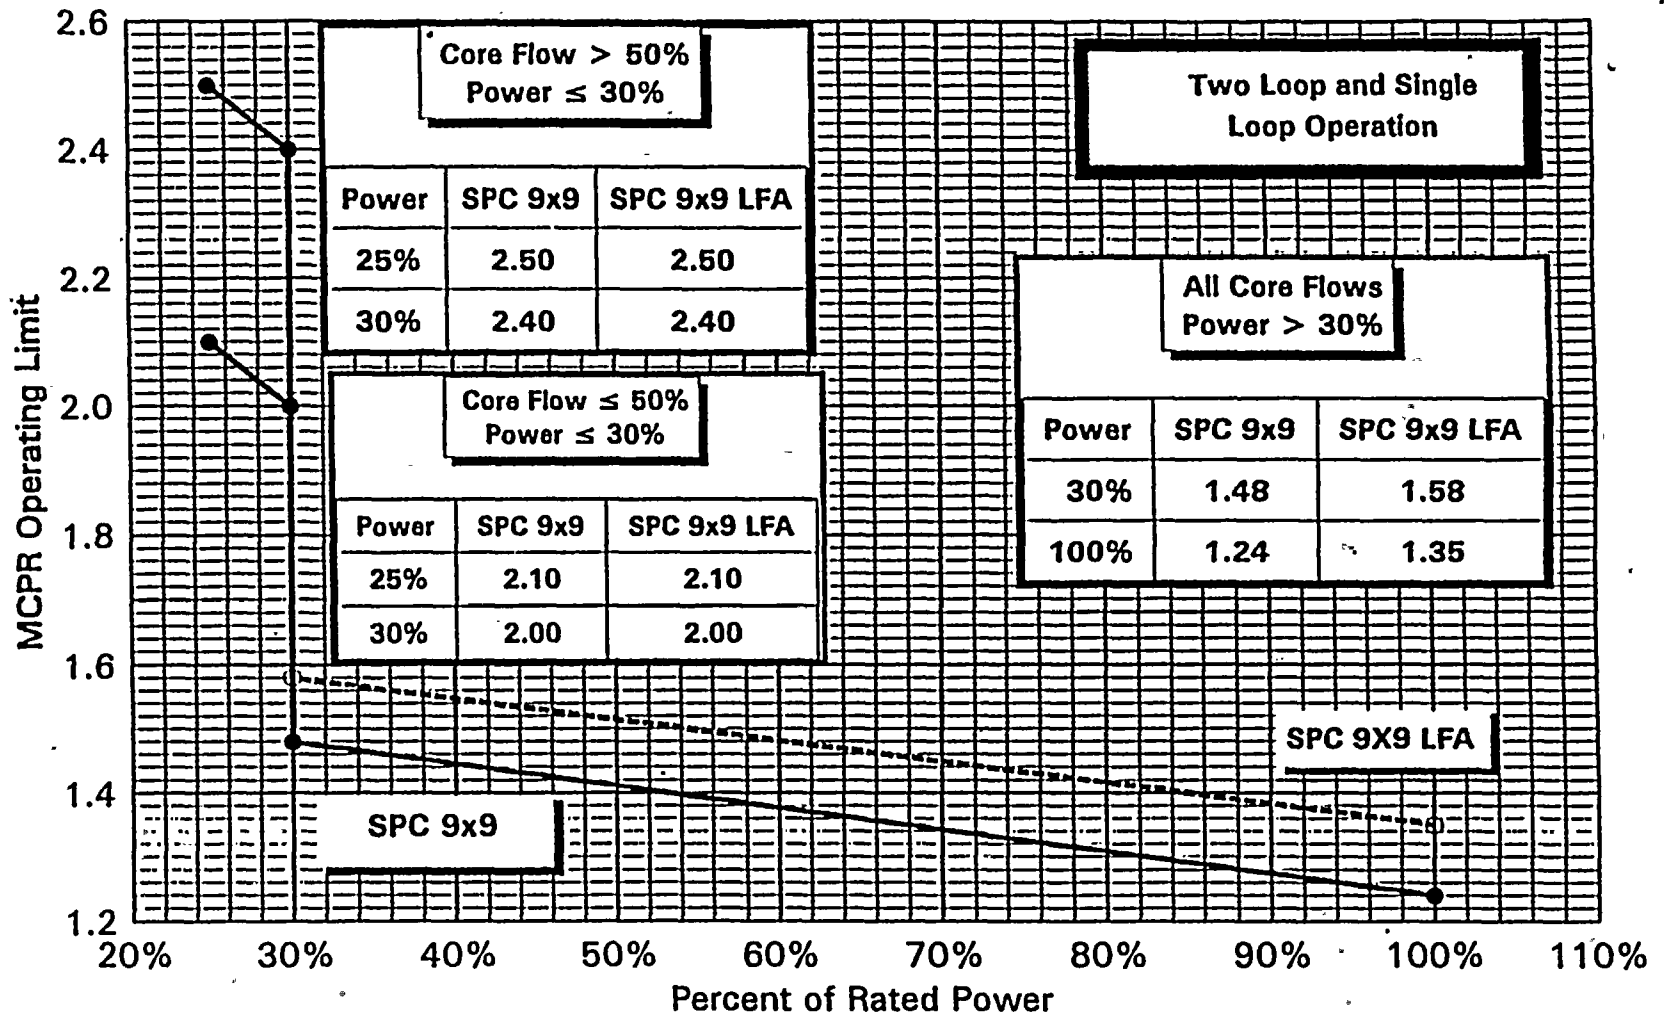


Reduced Power MCPR Operating Limit
Versus Percent of Rated Power
TSSS, RPT Operable
SPC 9x9, SPC 9x9 LFA
Cycle Exposures ≤ 4500 MWd/MT

Figure 3.5a

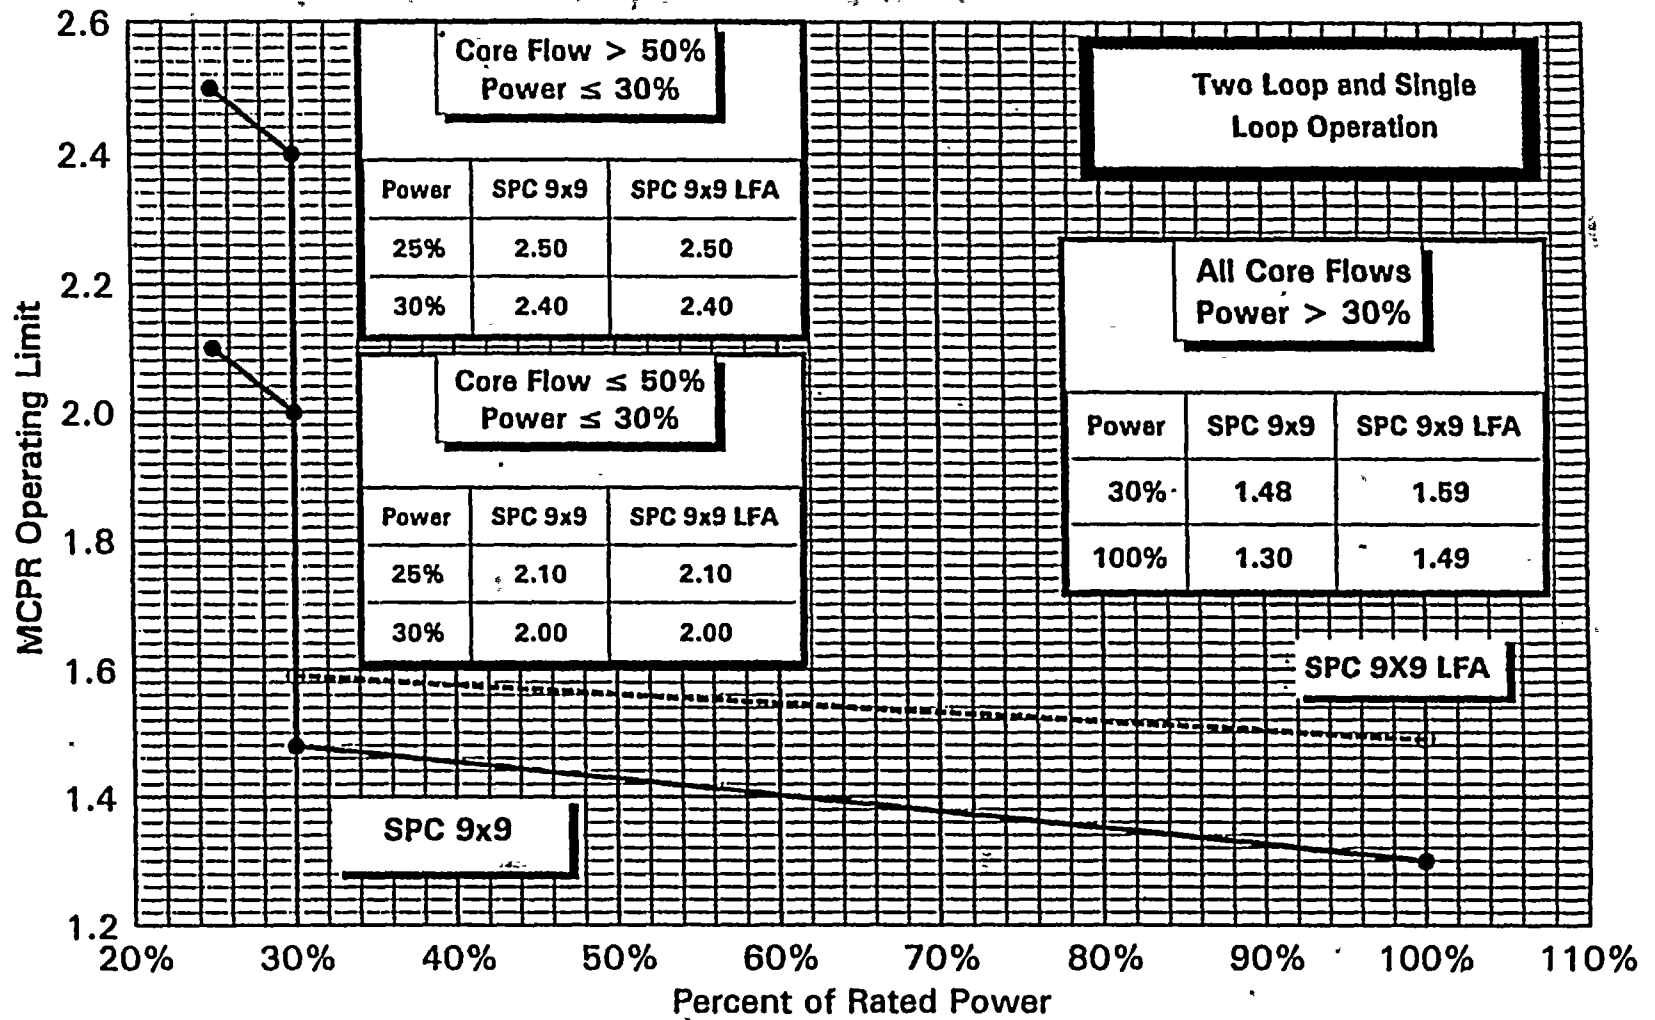


Reduced Power MCPR Operating Limit
Versus Percent of Rated Power
TSSS, RPT Operable
SPC 9x9, SPC 9x9 LFA
Cycle Exposures > 4500 MWd/MT

Figure 3.5b

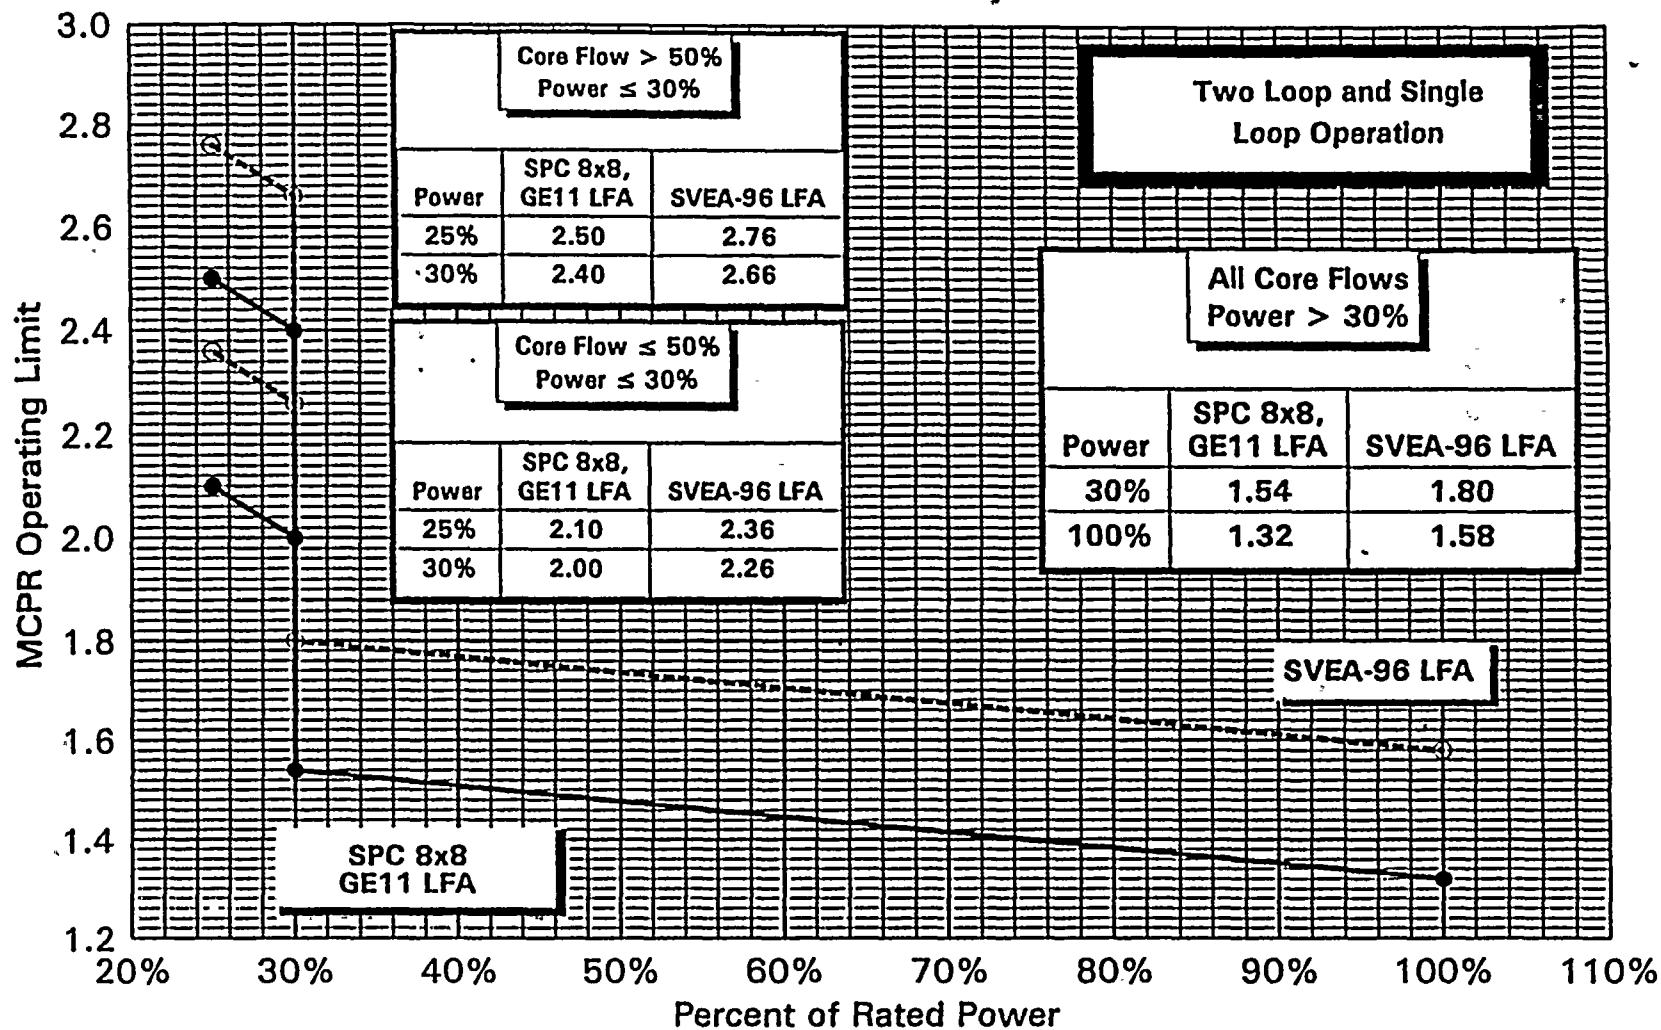


Reduced Power MCPR Operating Limit
Versus Percent of Rated Power
NSS, RPT Operable
SPC 8x8, GE11 LFA, SVEA-96 LFA
FFTR Operation

Figure 3.6

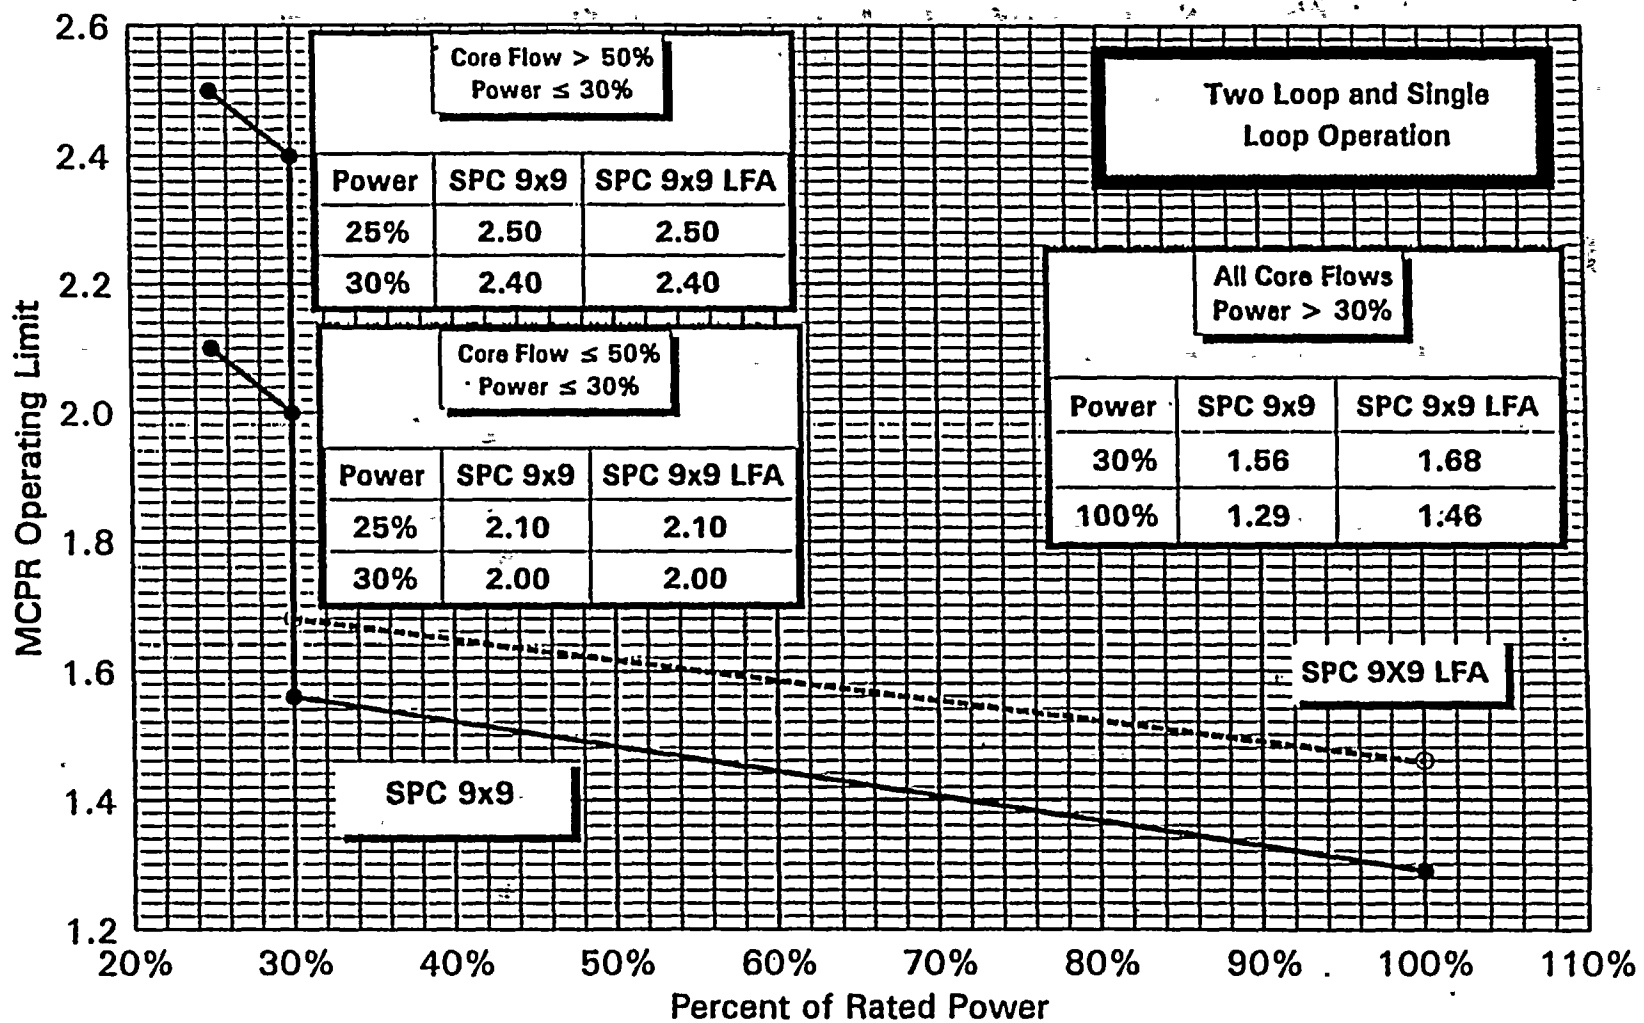

Reduced Power MCPR Operating Limit
 Versus Percent of Rated Power
 NSS, RPT Operable
 SPC 9x9, SPC 9x9 LFA
 FFTR Operation

Figure 3.7

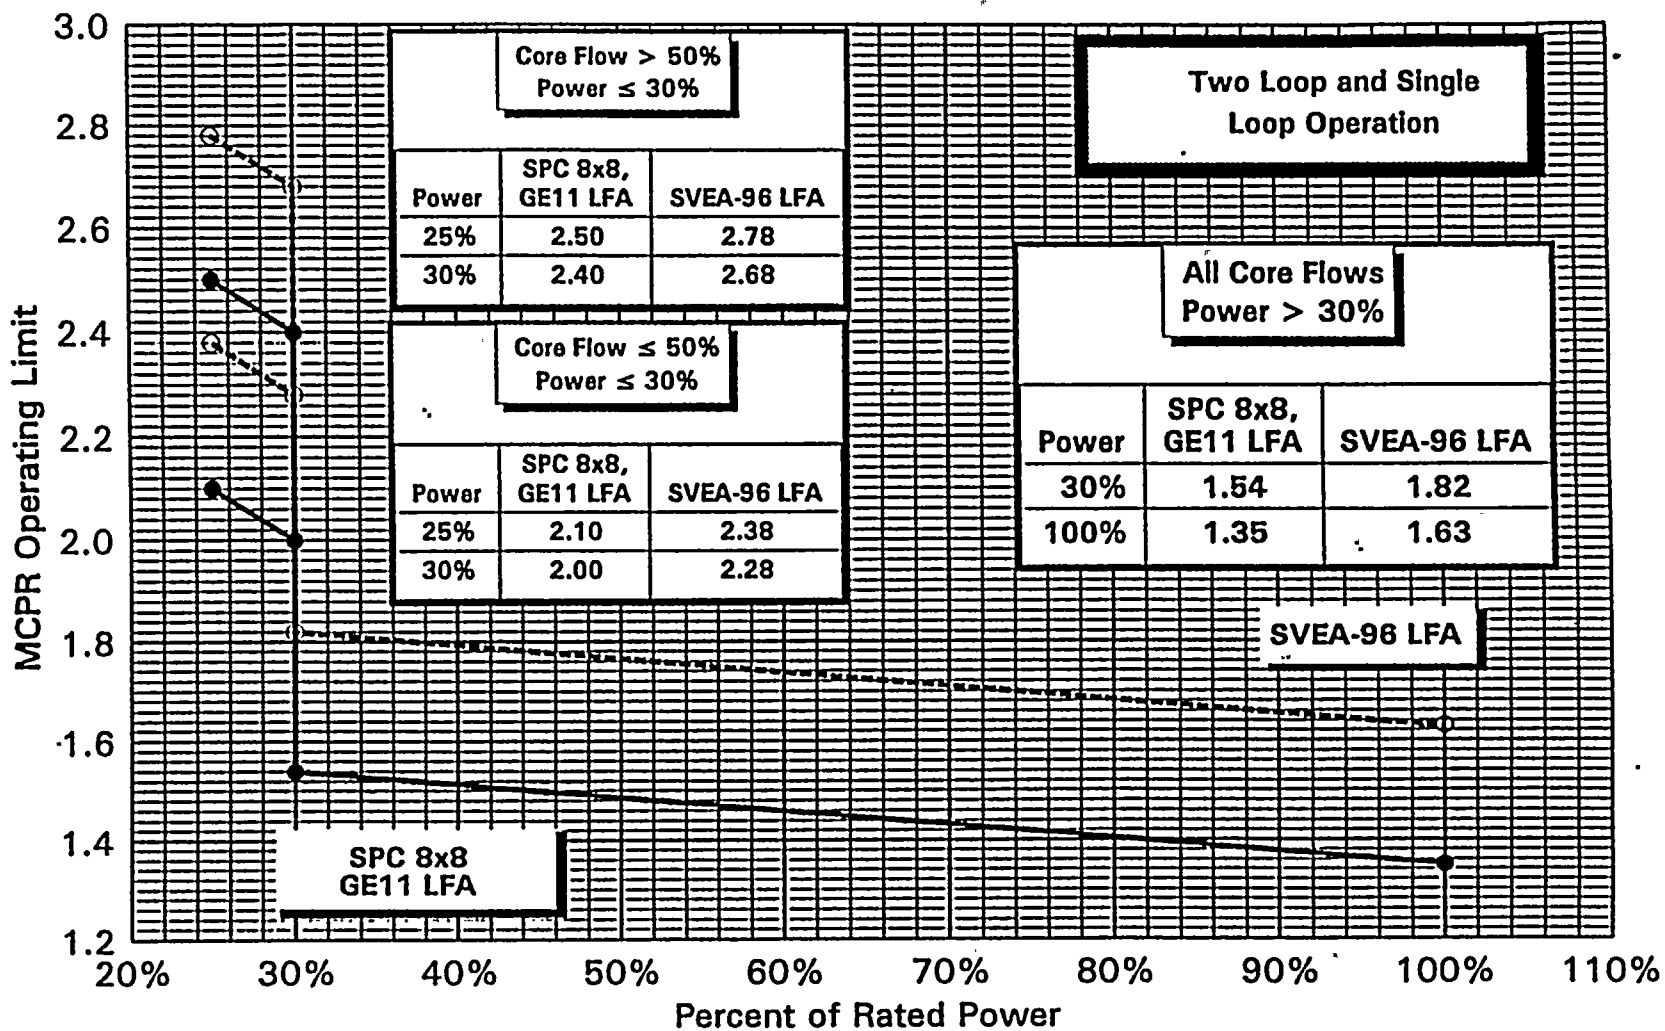

Reduced Power MCPR Operating Limit
Versus Percent of Rated Power
TSSS, RPT Operable
SPC 8x8, GE11 LFA, SVEA-96 LFA
FFTR Operation

Figure 3.8



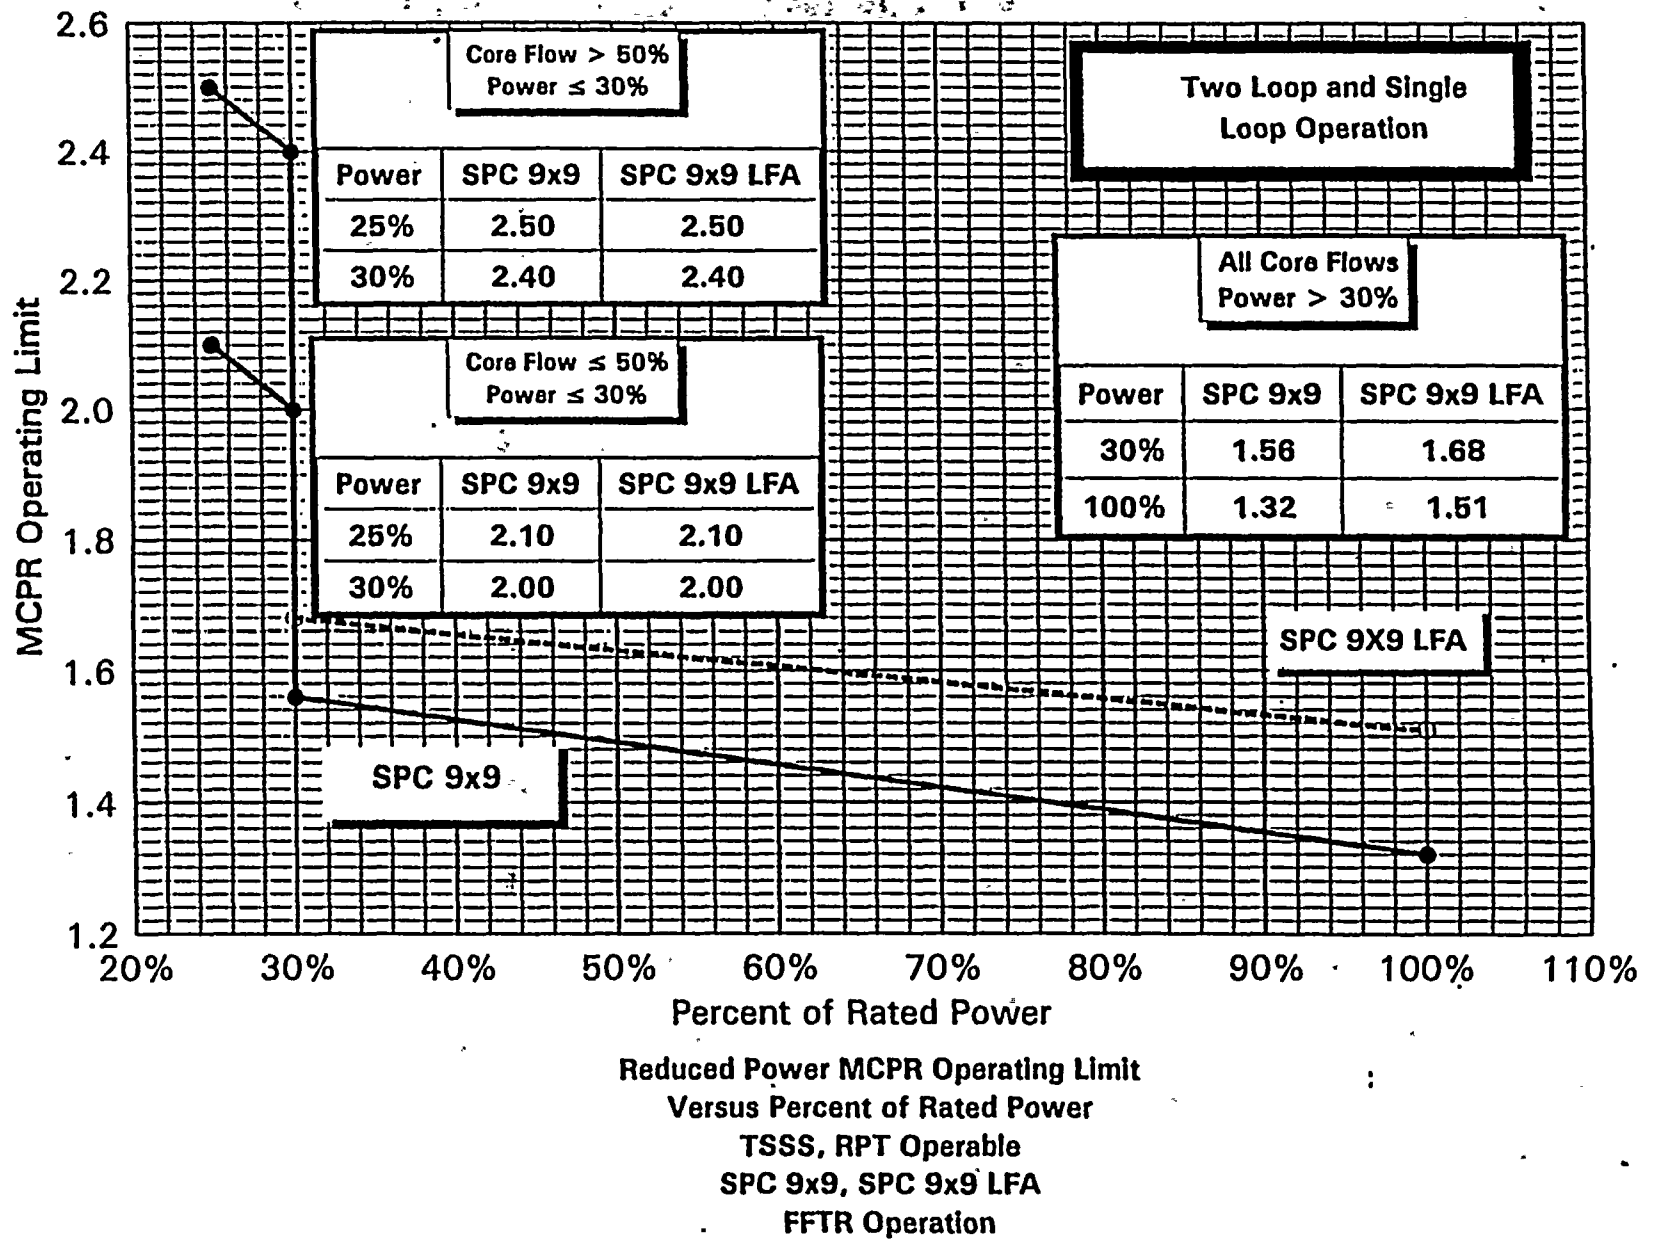


Figure 3.9

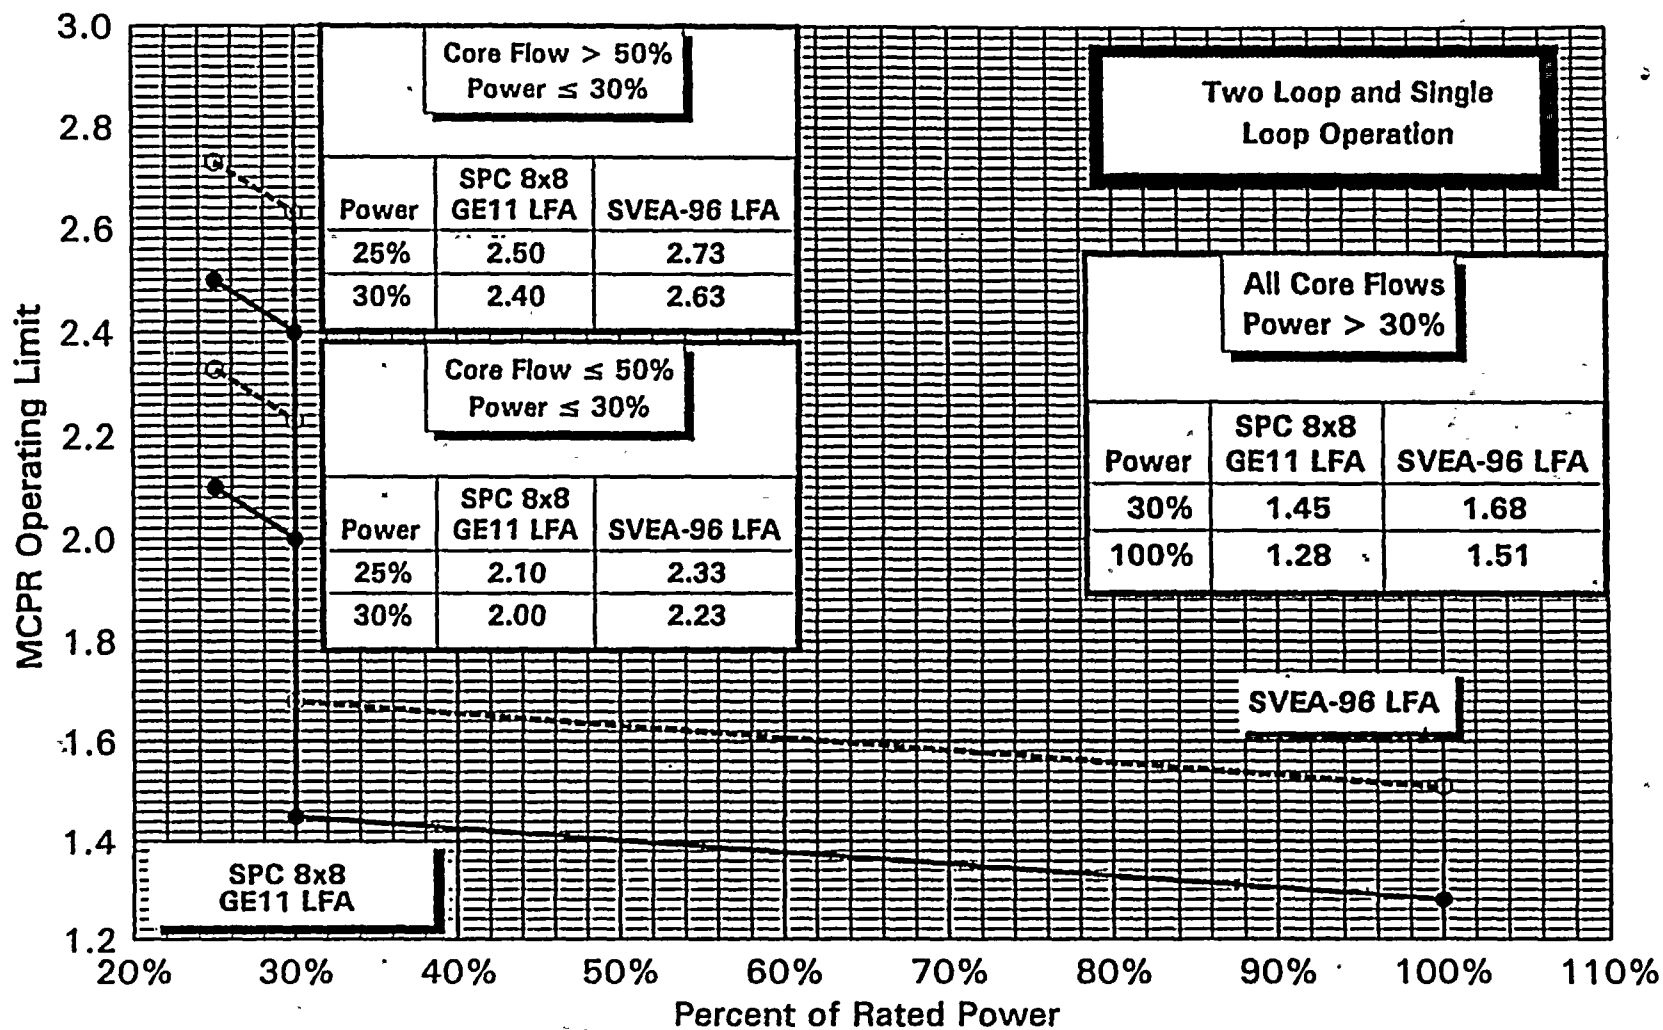


Reduced Power MCPR Operating Limit
Versus Percent of Rated Power
NSS, RPT Inoperable
SPC 8x8, GE11 LFA, SVEA-96 LFA
Cycle Exposures ≤ 4500 MWd/MT

Figure 3.10a

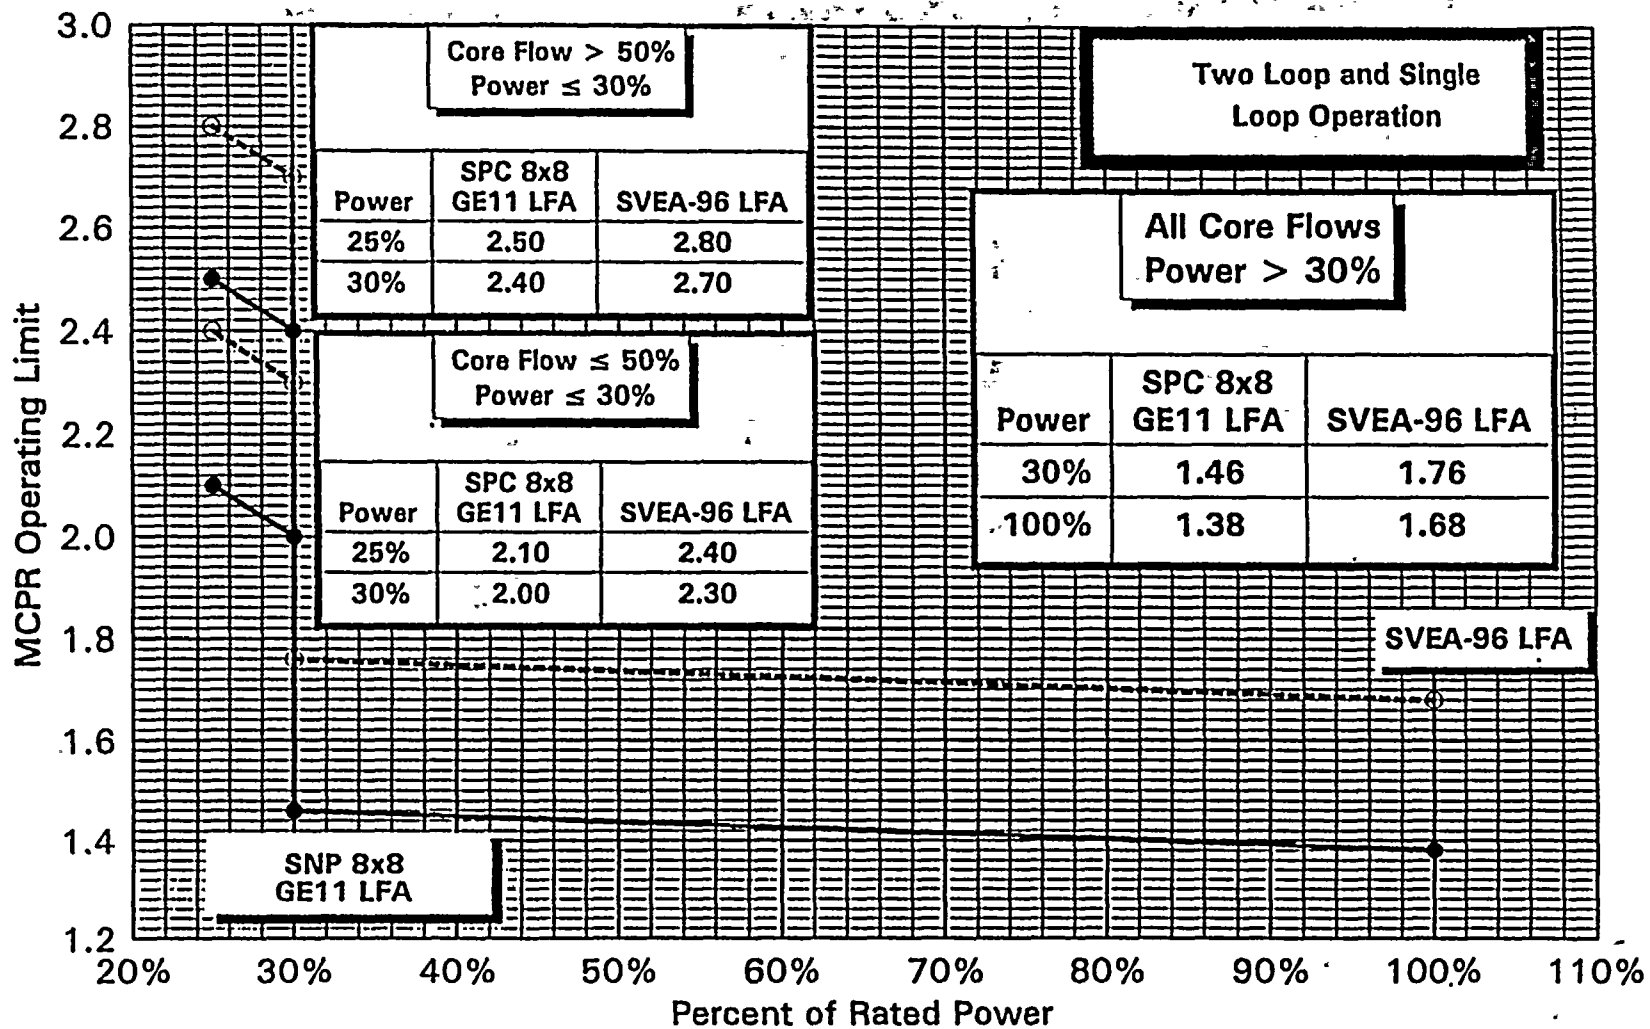


Reduced Power MCPR Operating Limit
Versus Percent of Rated Power
NSS, RPT Inoperable
SPC 8x8, GE11 LFA, SVEA-96 LFA
Cycle Exposures > 4500 MWd/MT

Figure 3.10b

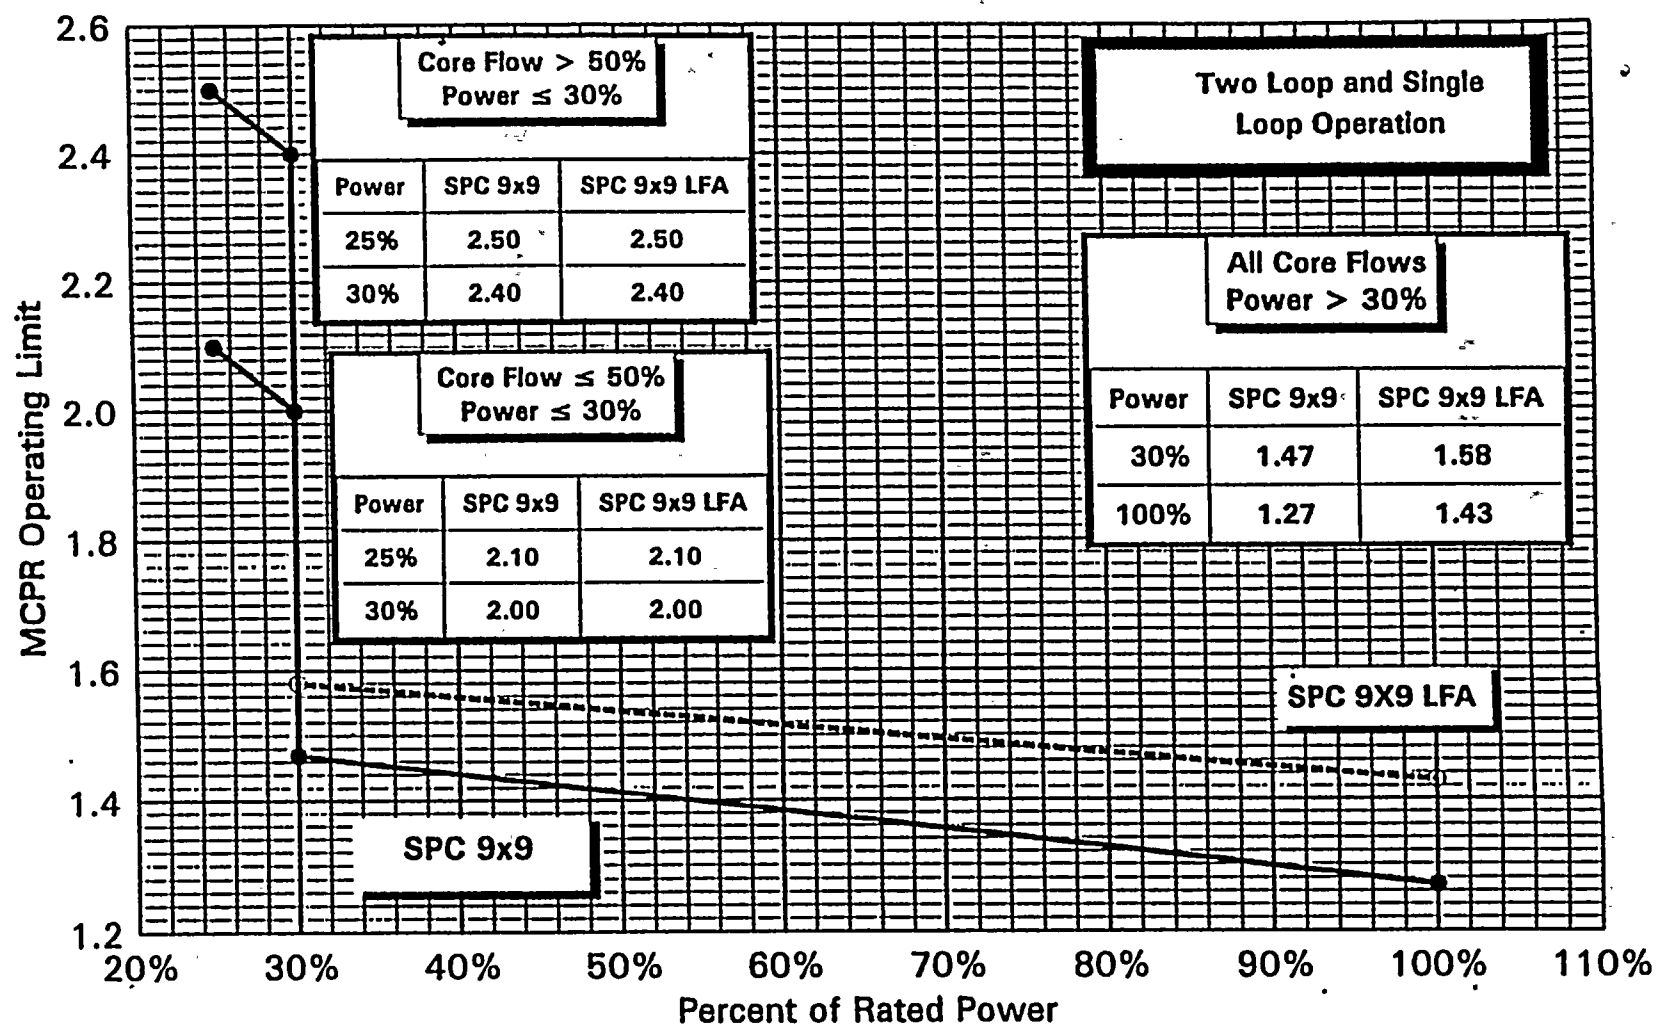

Reduced Power MCPR Operating Limit
 Versus Percent of Rated Power
 NSS, RPT Inoperable
 SPC 9x9, SPC 9x9 LFA
 Cycle Exposures ≤ 4500 MWd/MT

Figure 3.11a

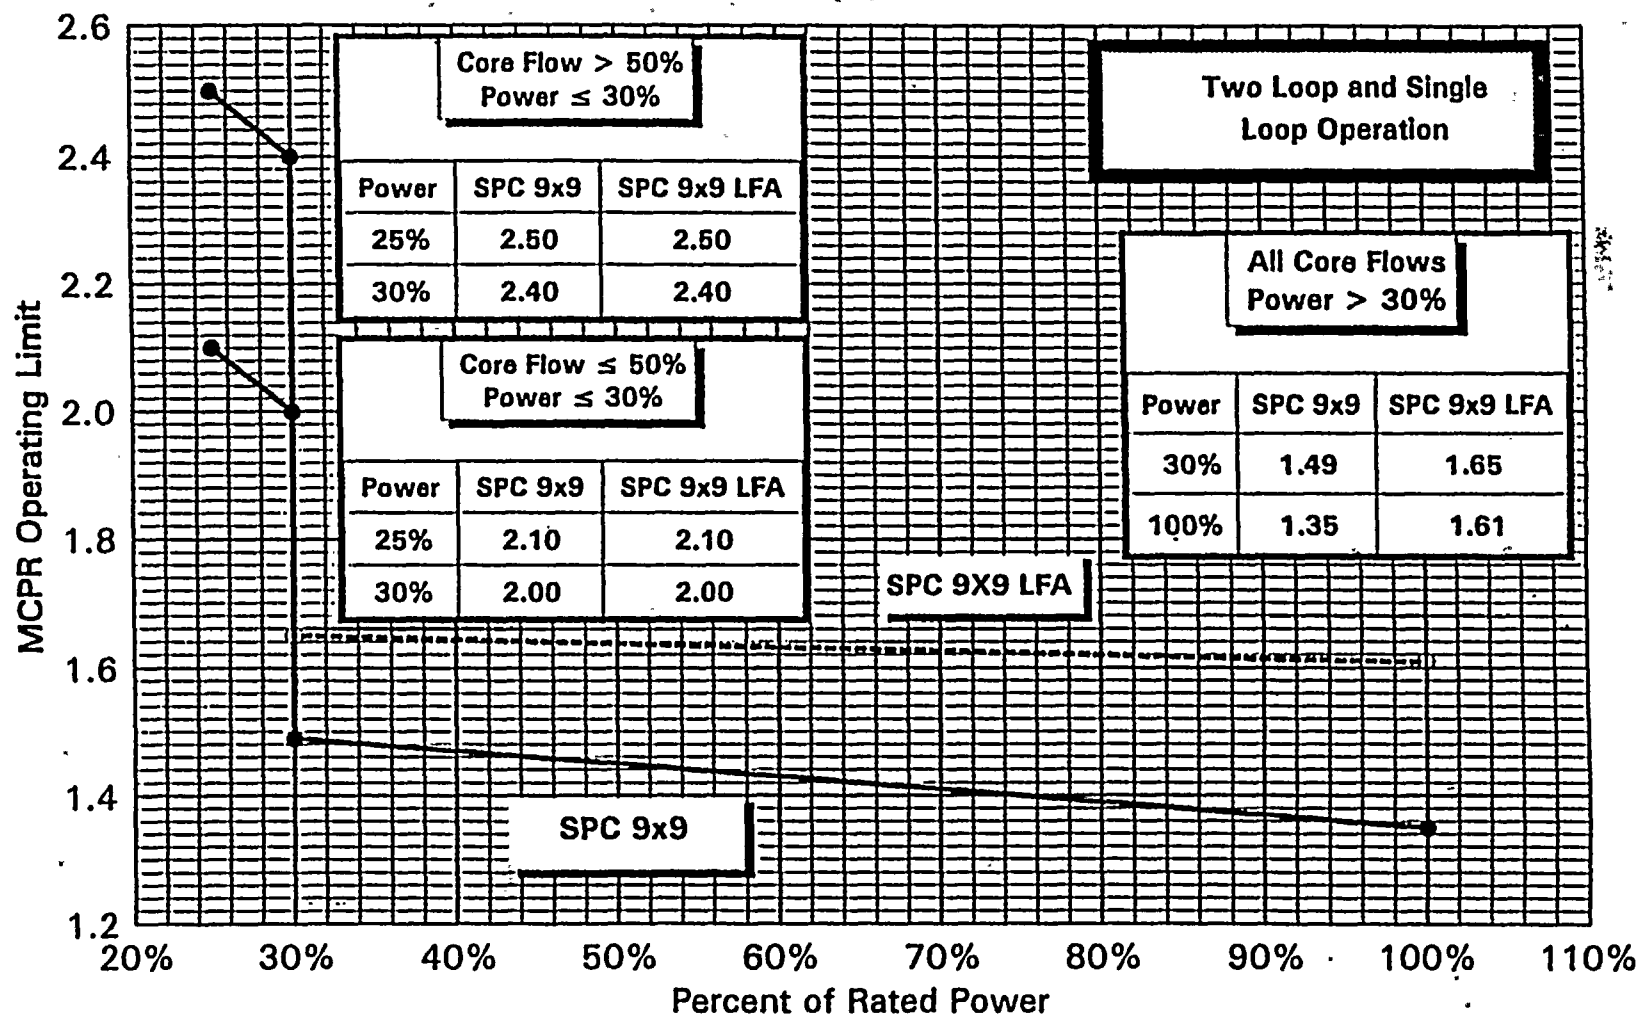

Reduced Power MCPR Operating Limit
 Versus Percent of Rated Power
 NSS, RPT Inoperable
 SPC 9x9, SPC 9x9 LFA
 Cycle Exposures > 4500 MWd/MT

Figure 3.11b

4.0 • LINEAR HEAT GENERATION RATE (LHGR) LIMIT FOR USE IN TECHNICAL SPECIFICATION 3.2.4

The LHGR limit for use in Technical Specification 3.2.4 shall not exceed the values shown in Figures 4.1 through 4.5.


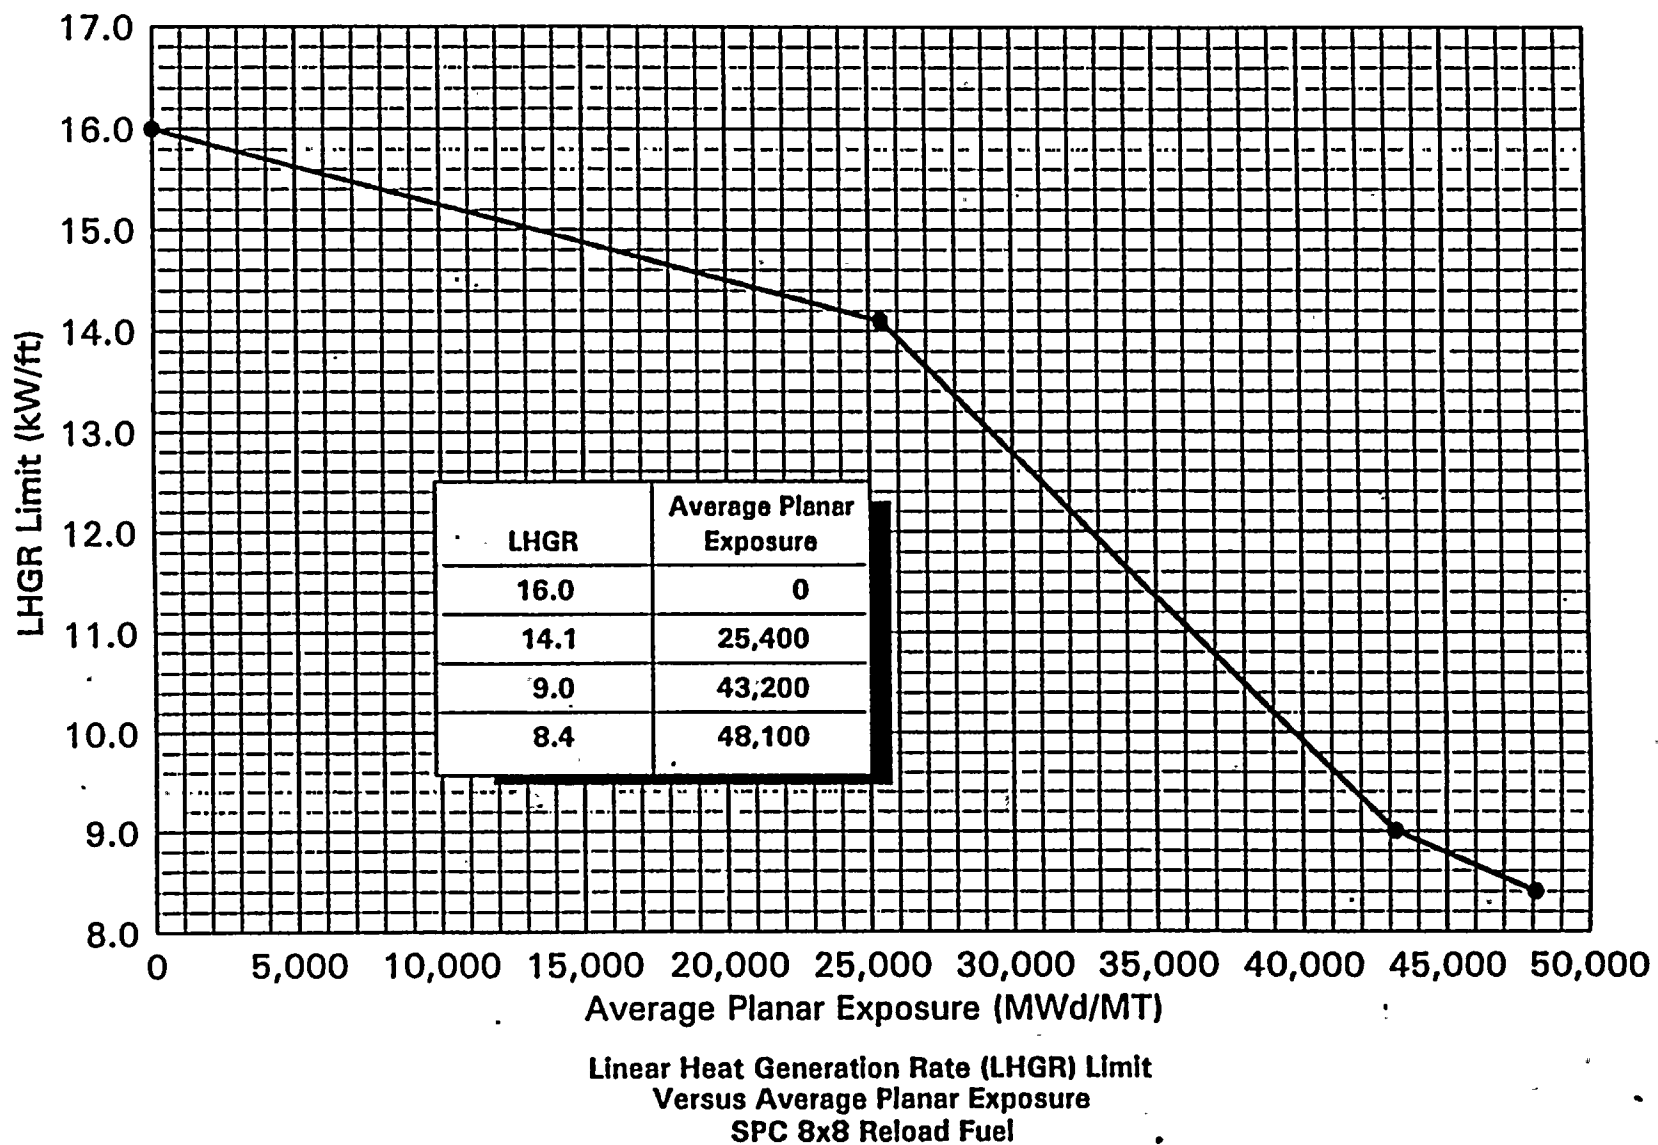


Figure 4.1

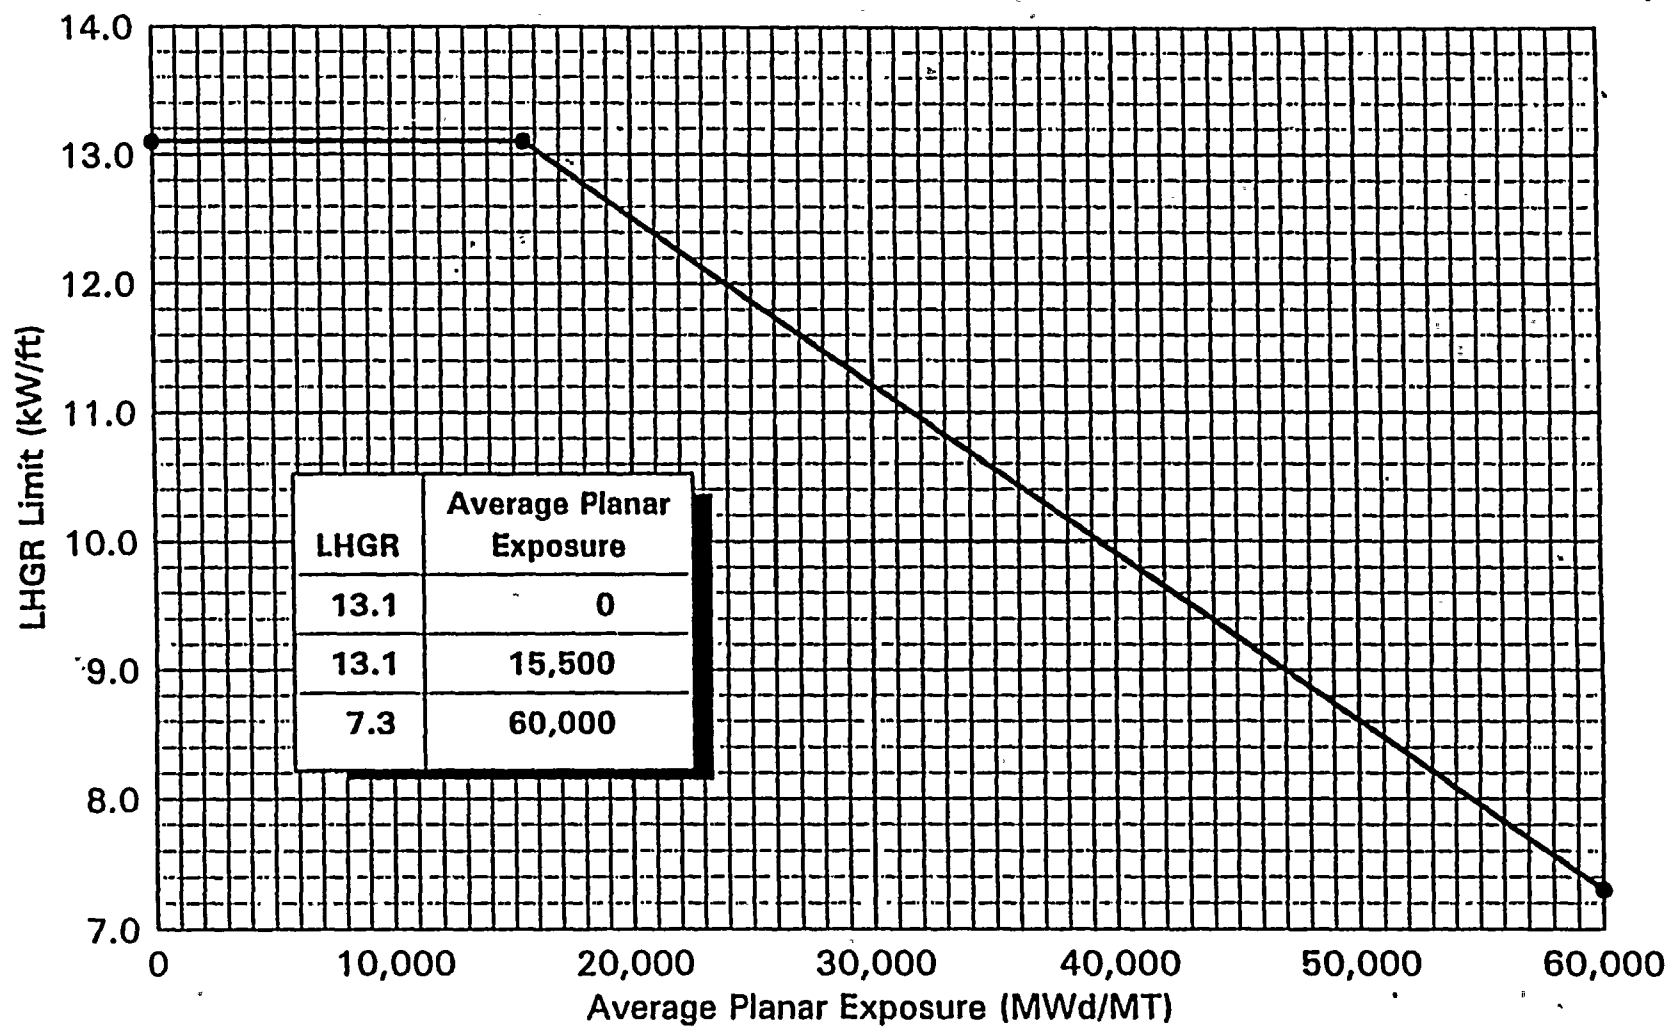

Linear Heat Generation Rate (LHGR) Limit
Versus Average Planar Exposure
SPC 9x9-9X Reload Fuel and SPC 9x9-9X LFA Fuel

Figure 4.2

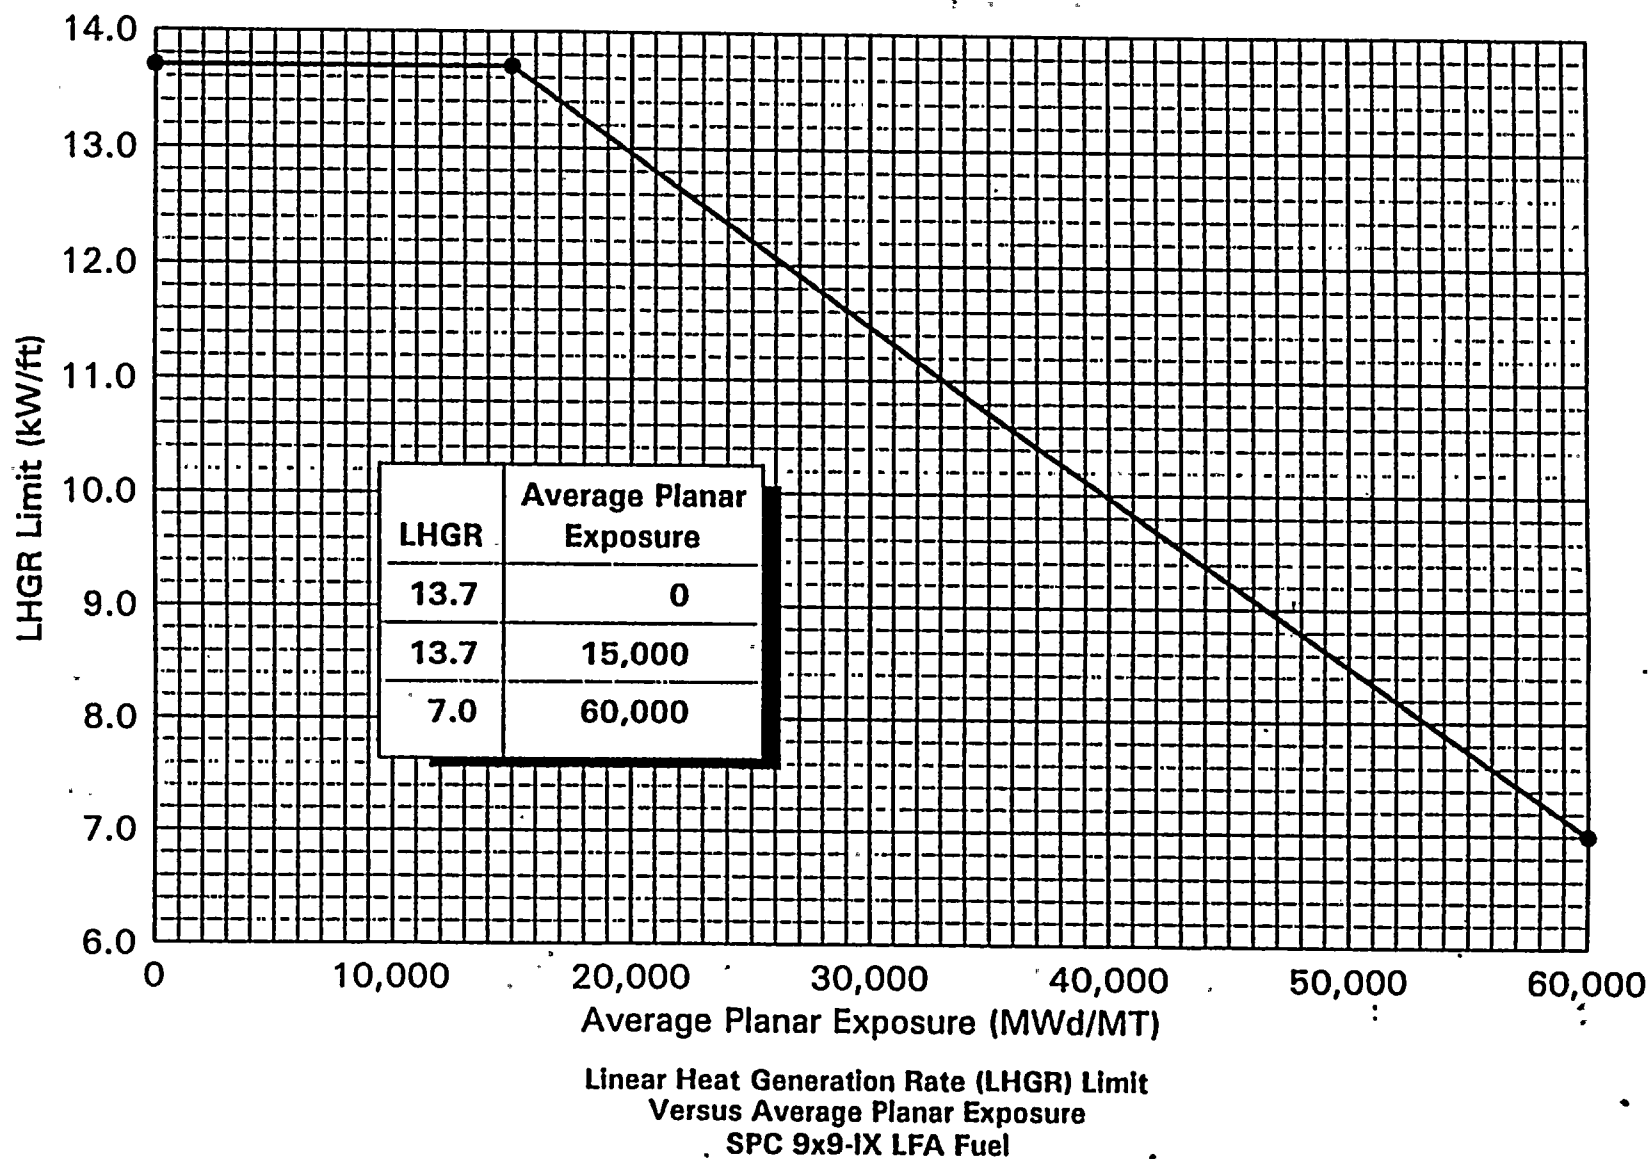


Figure 4.3

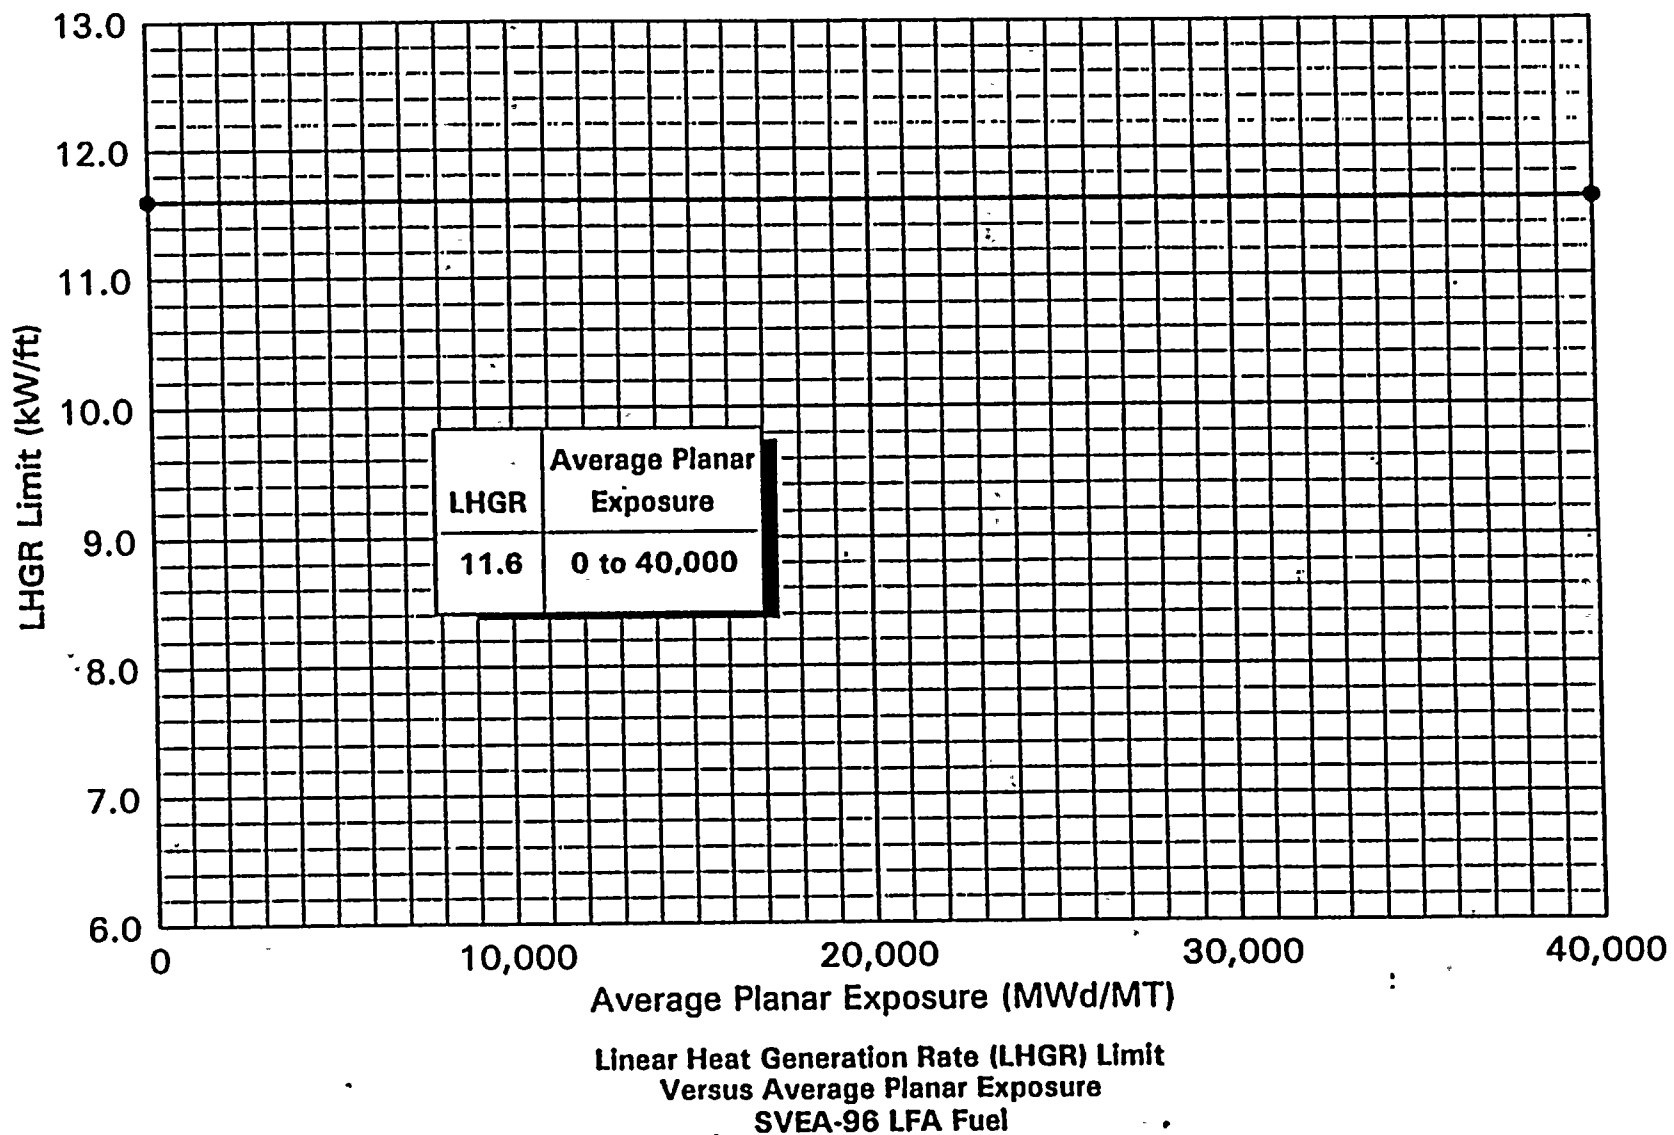


Figure 4.4

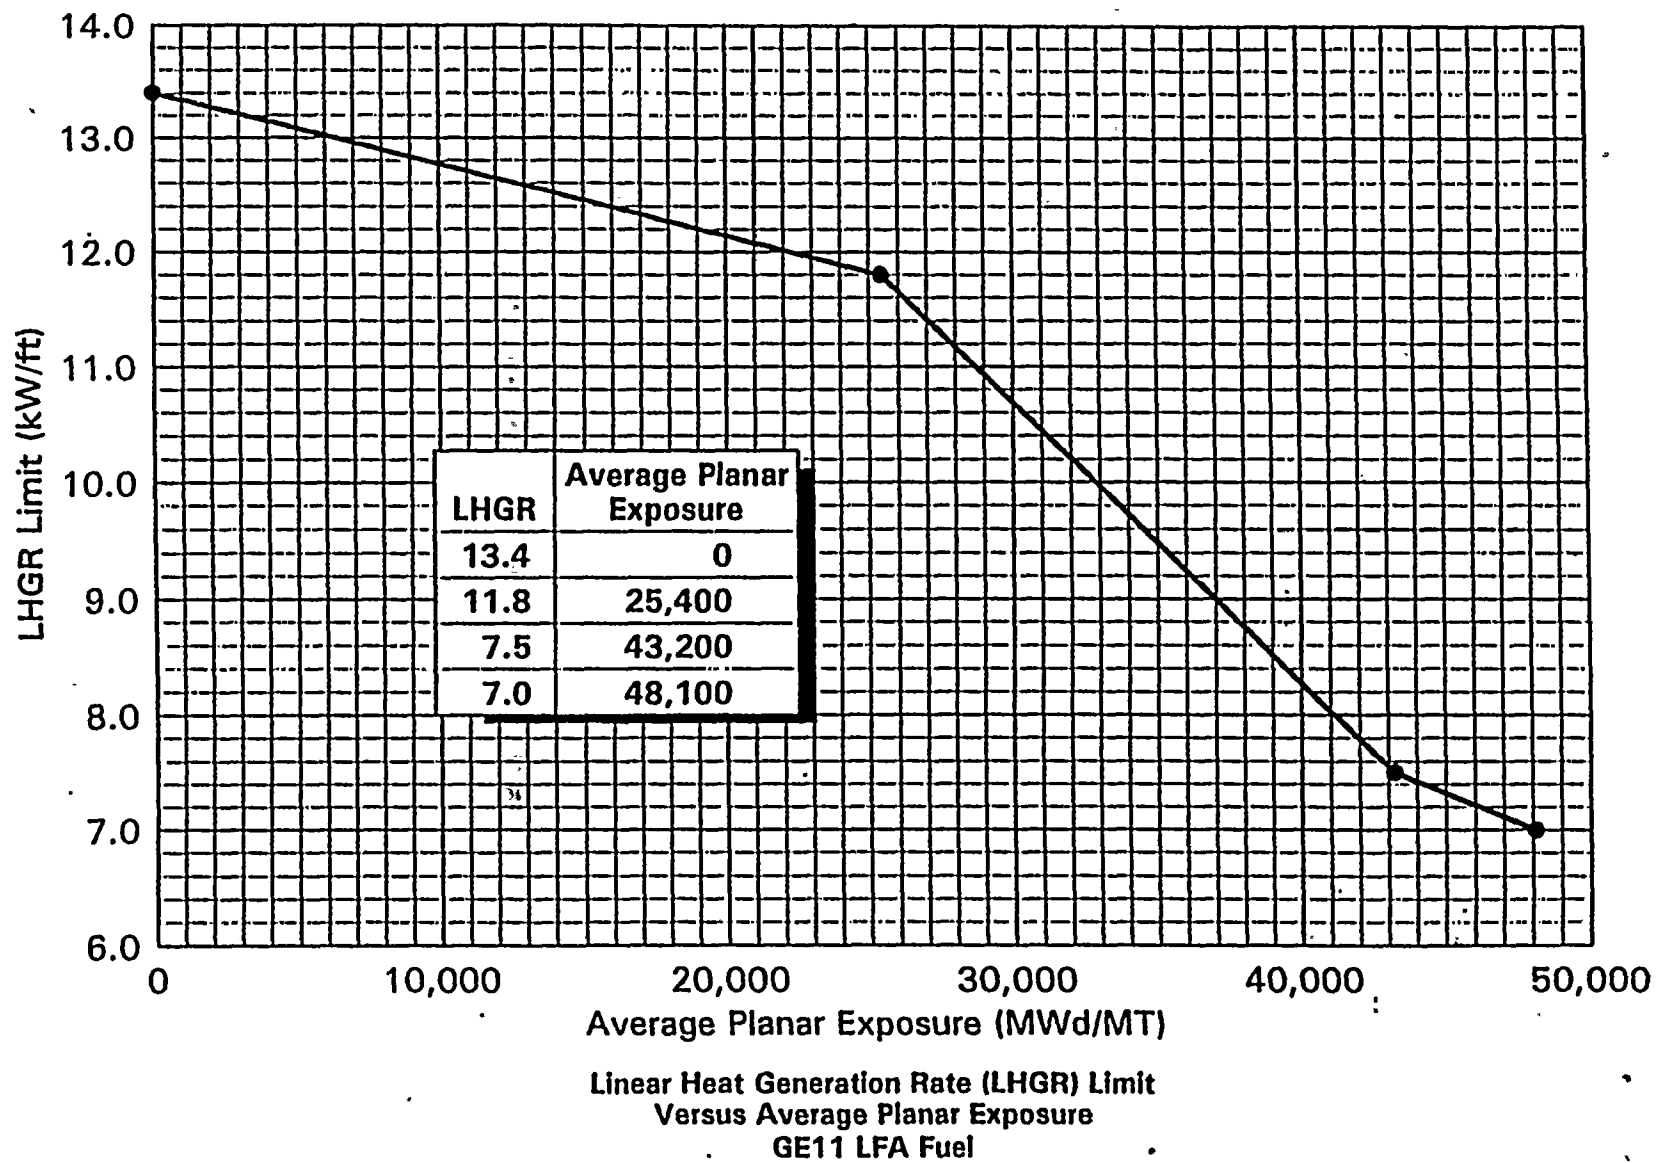


Figure 4.5

5.0 • REFERENCES5.1 Reports for Current Cycle

- 5.1.1 EMF-94-095, "WNP-2 Cycle 10 Plant Transient Analysis," Siemens Power Corporation, June 1994.
- 5.1.2 EMF-94-096, "WNP-2 Cycle 10 Reload Analysis," Siemens Power Corporation, June 1994.
- 5.1.3 SPCWP-94-041, "Licensing Results Supporting Section 3/4.2 of the WNP-2 Technical Specifications for Cycle 10," Letter from YU Fresk, Siemens Power Corporation, to RA Vopalensky, Supply System, April 1, 1994.
- 5.1.4 SPCWP-94-062, "STAIF Stability Results in Support of WNP-2 Cycle 10," Letter from YU Fresk, Siemens Power Corporation, to RA Vopalensky, Supply System, June 14, 1994.
- 5.1.5 SPCWP-94-042, "Licensing Results Supporting Section 2.1 of the WNP-2 Technical Specifications for Cycle 10," Letter from YU Fresk, Siemens Power Corporation, to RA Vopalensky, Supply System, April 1, 1994.
- 5.1.6 SPCWP-94-068, "SPC Comments on WNP-2 Cycle 10 Draft COLR," Letter from YU Fresk, Siemens Power Corporation, to RA Vopalensky, Supply System, June 23, 1994.
- 5.1.7 RDW:94-092, "WNP-2 Cycle 9 Core Operating Limits Report - GE11 Lead Use Assemblies," Letter from RD Williams, GE Nuclear Energy, to DL Whitcomb, Supply System, June 21, 1994.
- 5.1.8 ABBWP-94-040, "SVEA-96 Lead Fuel Assembly Treatment in WNP-2 Cycle 10 Core Operating Limits Report," Letter from CG Schon, ABB Combustion Engineering Nuclear Operations, to RA Vopalensky, Supply System, June 15, 1994.
- 5.1.9 SPCWP-94-108, "Improved Reduced Flow MCPR Operating Limits for WNP-2 Cycle 10," Letter from YU Fresk, Siemens Power Corporation, to RA Vopalensky, Supply System, December 12, 1994.
- 5.1.10 RDW:94-162, "WNP-2 Cycle 10 Core Operating Limits Report—Rev. 1," Letter from RD Williams, GE Nuclear Energy, to DL Whitcomb, Supply System, December 14, 1994.
- 5.1.11 NFBWR-94-055, "SVEA-96 LFA Flow-Dependent MCPR Limits," Letter from CG Schon, ABB CENO Fuel Operations, to R Vopalensky, Supply System, December 22, 1994.

5.2 Licensing Topical Reports in Technical Specification 6.9.3.2

- 5.2.1 ANF-1125(P)(A) and Supplements 1 and 2, "ANFB Critical Power Correlation," Advanced Nuclear Fuels Corporation, April 1990.
- 5.2.2 "NRC Approval of ANFB Additive Constants for 9x9-9X BWR Fuel," Letter from RC Jones, NRC, to RA Copeland, Advanced Nuclear Fuels Corporation, November 14, 1990.

- 5.2.3 ANF-524(P)(A), Revision 2 and Supplements 1 and 2, "Advanced Nuclear Fuels Critical Power Methodology for Boiling Water Reactors," Advanced Nuclear Fuels Corporation, November 1990.
- 5.2.4 ANF-913(P)(A), Volume 1, Revision 1 and Volume 1, Supplements 2, 3, and 4, "COTRANSA2: A Computer Program for Boiling Water Reactor Transient Analyses," Advanced Nuclear Fuels Corporation, August 1990.
- 5.2.5 ANF-CC-33(P)(A), Supplement 2, "HUXY: A Generalized Multirod Heatup Code with 10 CFR 50, Appendix K, Heatup Option," Advanced Nuclear Fuels Corporation, January 1991.
- 5.2.6 XN-NF-80-19(P)(A), Volume 1, Supplements 3 and 4, "Advanced Nuclear Fuels Methodology for Boiling Water Reactors: Benchmark Results for the CASMO-3G/MICROBURN-B Calculation Methodology," Advanced Nuclear Fuels Corporation, November 1990.
- 5.2.7 XN-NF-80-19(P)(A), Volume 4, Revision 1, "Exxon Nuclear Methodology for Boiling Water Reactors: Application of the ENC Methodology to BWR Reloads," Exxon Nuclear Company, Inc., June 1986.
- 5.2.8 XN-NF-80-19(P)(A), Volume 3; Revision 2, "Exxon Nuclear Methodology for Boiling Water Reactors THERMEX: Thermal Limits Methodology Summary Description," Exxon Nuclear Company, Inc., January 1987.
- 5.2.9 XN-NF-85-67(P)(A), Revision 1, "Generic Mechanical Design for Exxon Nuclear Jet Pump BWR-Reload Fuel," Exxon Nuclear Company, Inc., September 1986.
- 5.2.10 ANF-89-014(P)(A), Revision 1 and Supplements 1 and 2, "Generic Mechanical Design for Advanced Nuclear Fuels 9x9-IX and 9x9-9X Reload Fuel," Advanced Nuclear Fuels Corporation, October 1991.
- 5.2.11 XN-NF-81-22(P)(A), "Generic Statistical Uncertainty Analysis Methodology," Exxon Nuclear Company, Inc., November 1983.
- 5.2.12 NEDE-24011-P-A-6, "General Electric Standard Application for Reactor Fuel," GE Nuclear Energy, April 1983.
- 5.3 GE Nuclear Energy and ABB Combustion Engineering Nuclear Operations Lead Fuel Assembly Reports
 - 5.3.1 "GE11 Lead Fuel Assembly Report for Washington Public Power Supply System Nuclear Project No. 2, Reload 5, Cycle 6," GE Nuclear Energy, December 1989.

- 5.3.2 UK 90-126, "Supplemental Lead Fuel Assembly Licensing Report—SVEA-96 LFAs for WNP-2—Summary," ABB Atom, January 1990.
- 5.3.3 ATOF-91-120, "Assembly Treatment in WNP-2 Cycle 7 Core Operating Limits Report," Letter from WR Harris, ABB Atom, to DL Whitcomb, Supply System, May 1, 1991.
- 5.3.4 ABBWP-94-039, "WNP-2 SVEA-96 Lead Fuel Assembly Operating Limit MCPR," Letter from CG Schon, ABB Combustion Engineering Nuclear Operations, to RA Vopalensky, Supply System, June 15, 1994.
- 5.4 Reports for the Extended Load Line Limit Analysis (ELLLA)
 - 5.4.1 "Reactor Vessel Internals Evaluation Task Report for WNP-2 Power Uprate Project," GE Nuclear Energy, April 1993 (DRAFT).
 - 5.4.2 "WNP-2 Power Uprate Containment Response Evaluation Input to Engineering Report," GE Nuclear Energy, January 19, 1993 (DRAFT).
 - 5.4.3 GE-NE-189-69-1092, "Effects of Adjustable Speed Drive on Reactor Internal Vibration at the WNP-2 Nuclear Power Plant," GE Nuclear Energy, October 1992.
 - 5.4.4 GE-NE-189-34-0392, "Jet Pump Sensing Line Vibration Test for Washington Nuclear Project 2," GE Nuclear Energy, March 1992.
 - 5.4.5 NEDE-24222, "Assessment of BWR Mitigation of ATWS, Vol. II (NUREG 0460, Alternate No. 3)," General Electric Company, December 1979.
 - 5.4.6 "Washington Nuclear Project Unit 2 System Evaluation Report for Power Uprate—Reactor Recirculation Control System," GE Nuclear Energy, February 1, 1993.
 - 5.4.7 GE Report 22A7104, Revision 0, "Dynamic Load Report—Fuel Vertical Support," GE Nuclear Energy, June 30, 1982.
 - 5.4.8 "Fuel Lift Non-Proprietary Letter," Letter from DM Kelly, GE Nuclear Energy, to WC Wolkenhauer, Supply System, February 15, 1993.
 - 5.4.9 93-PU-0054, "ELLLA Related Power Uprate Task Reports," Letter from DM Kelly, GE Nuclear Energy, to WC Wolkenhauer, Supply System, June 3, 1993.