

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

MA/1

ACCESSION NBR:8007160652 DOC.DATE: 80/07/09 NOTARIZED: NO
 FACIL: 80-328 Sequoyah Nuclear Plant, Unit 2, Tennessee Valley Auth
 50-329 Midland Plant, Unit 1, Consumers Power Co.
 STN-50-530 Palo Verde Nuclear Station, Unit 3, Arizona Public Service Co.
 AUTH.NAME: VAN BRUNT, E.E. AUTHOR AFFILIATION: Arizona Public Service Co.
 RECIP.NAME: SPENCER, G.S. RECIPIENT AFFILIATION: Region 5, San Francisco, Reactor Construction & Engineer

DOCKET # 05000328
 05000529
 05000530

SUBJECT: Forwards final deficiency rept re closure of Comsip, Inc
 containment gas analysis pump valve.

DISTRIBUTION CODE: B019S COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 2+3
 TITLE: Construction Deficiency Report (10CFR50.55E)


NOTES: M Cunningham all amends to FSAR & changes to Tech Specs.
 Standardized Plant.

05000328
 05000530

	RECIPIENT		COPIES			RECIPIENT		COPIES		
	ID	CODE/NAME	LTTR	ENCL		ID	CODE/NAME	LTTR	ENCL	
ACTION:	A/D	OP REACT	21	1	1	A/D	LICENSNG	21	1	1
	IPPOLITO, T.		15	1	1	CLARK, R.		15	1	1
	SCHWENCER, A.		15	1	1	SERVICE, M.		20	1	1
	LEE, J.		20	1	1	STAHL, C.		14	1	1
	HOOD, D.		14	1	1	KERRIGAN, J.		14	1	1
INTERNAL:	AD/RCI/IE			1	1	AEOD			1	1
	DIR, HUM FAC	SFY		1	1	EDO & STAFF	07		1	1
	EQUIP QUAL	BR16		1	1	FIELD COOR/IE	13		1	1
	HYD/GEO BR	22		1	1	I&E	05		2	2
	LIC QUAL BR			1	1	MOORE, V.			1	1
	MPA	08		1	1	NRC PDR	02		1	1
	OELD	23		1	1	OR ASSESS BR	17		1	1
	PROC/IST, REV	BR		1	1	QA BR	10		1	1
REG FILE	01		1	1	STANDRDS DEV	11		1	1	
EXTERNAL:	ACRS		24	16	16	LPDR	03		1	1
	NSIC		04	1	1					

JUL 17 1980

TOTAL NUMBER OF COPIES REQUIRED: LTTR 47 ENCL 47

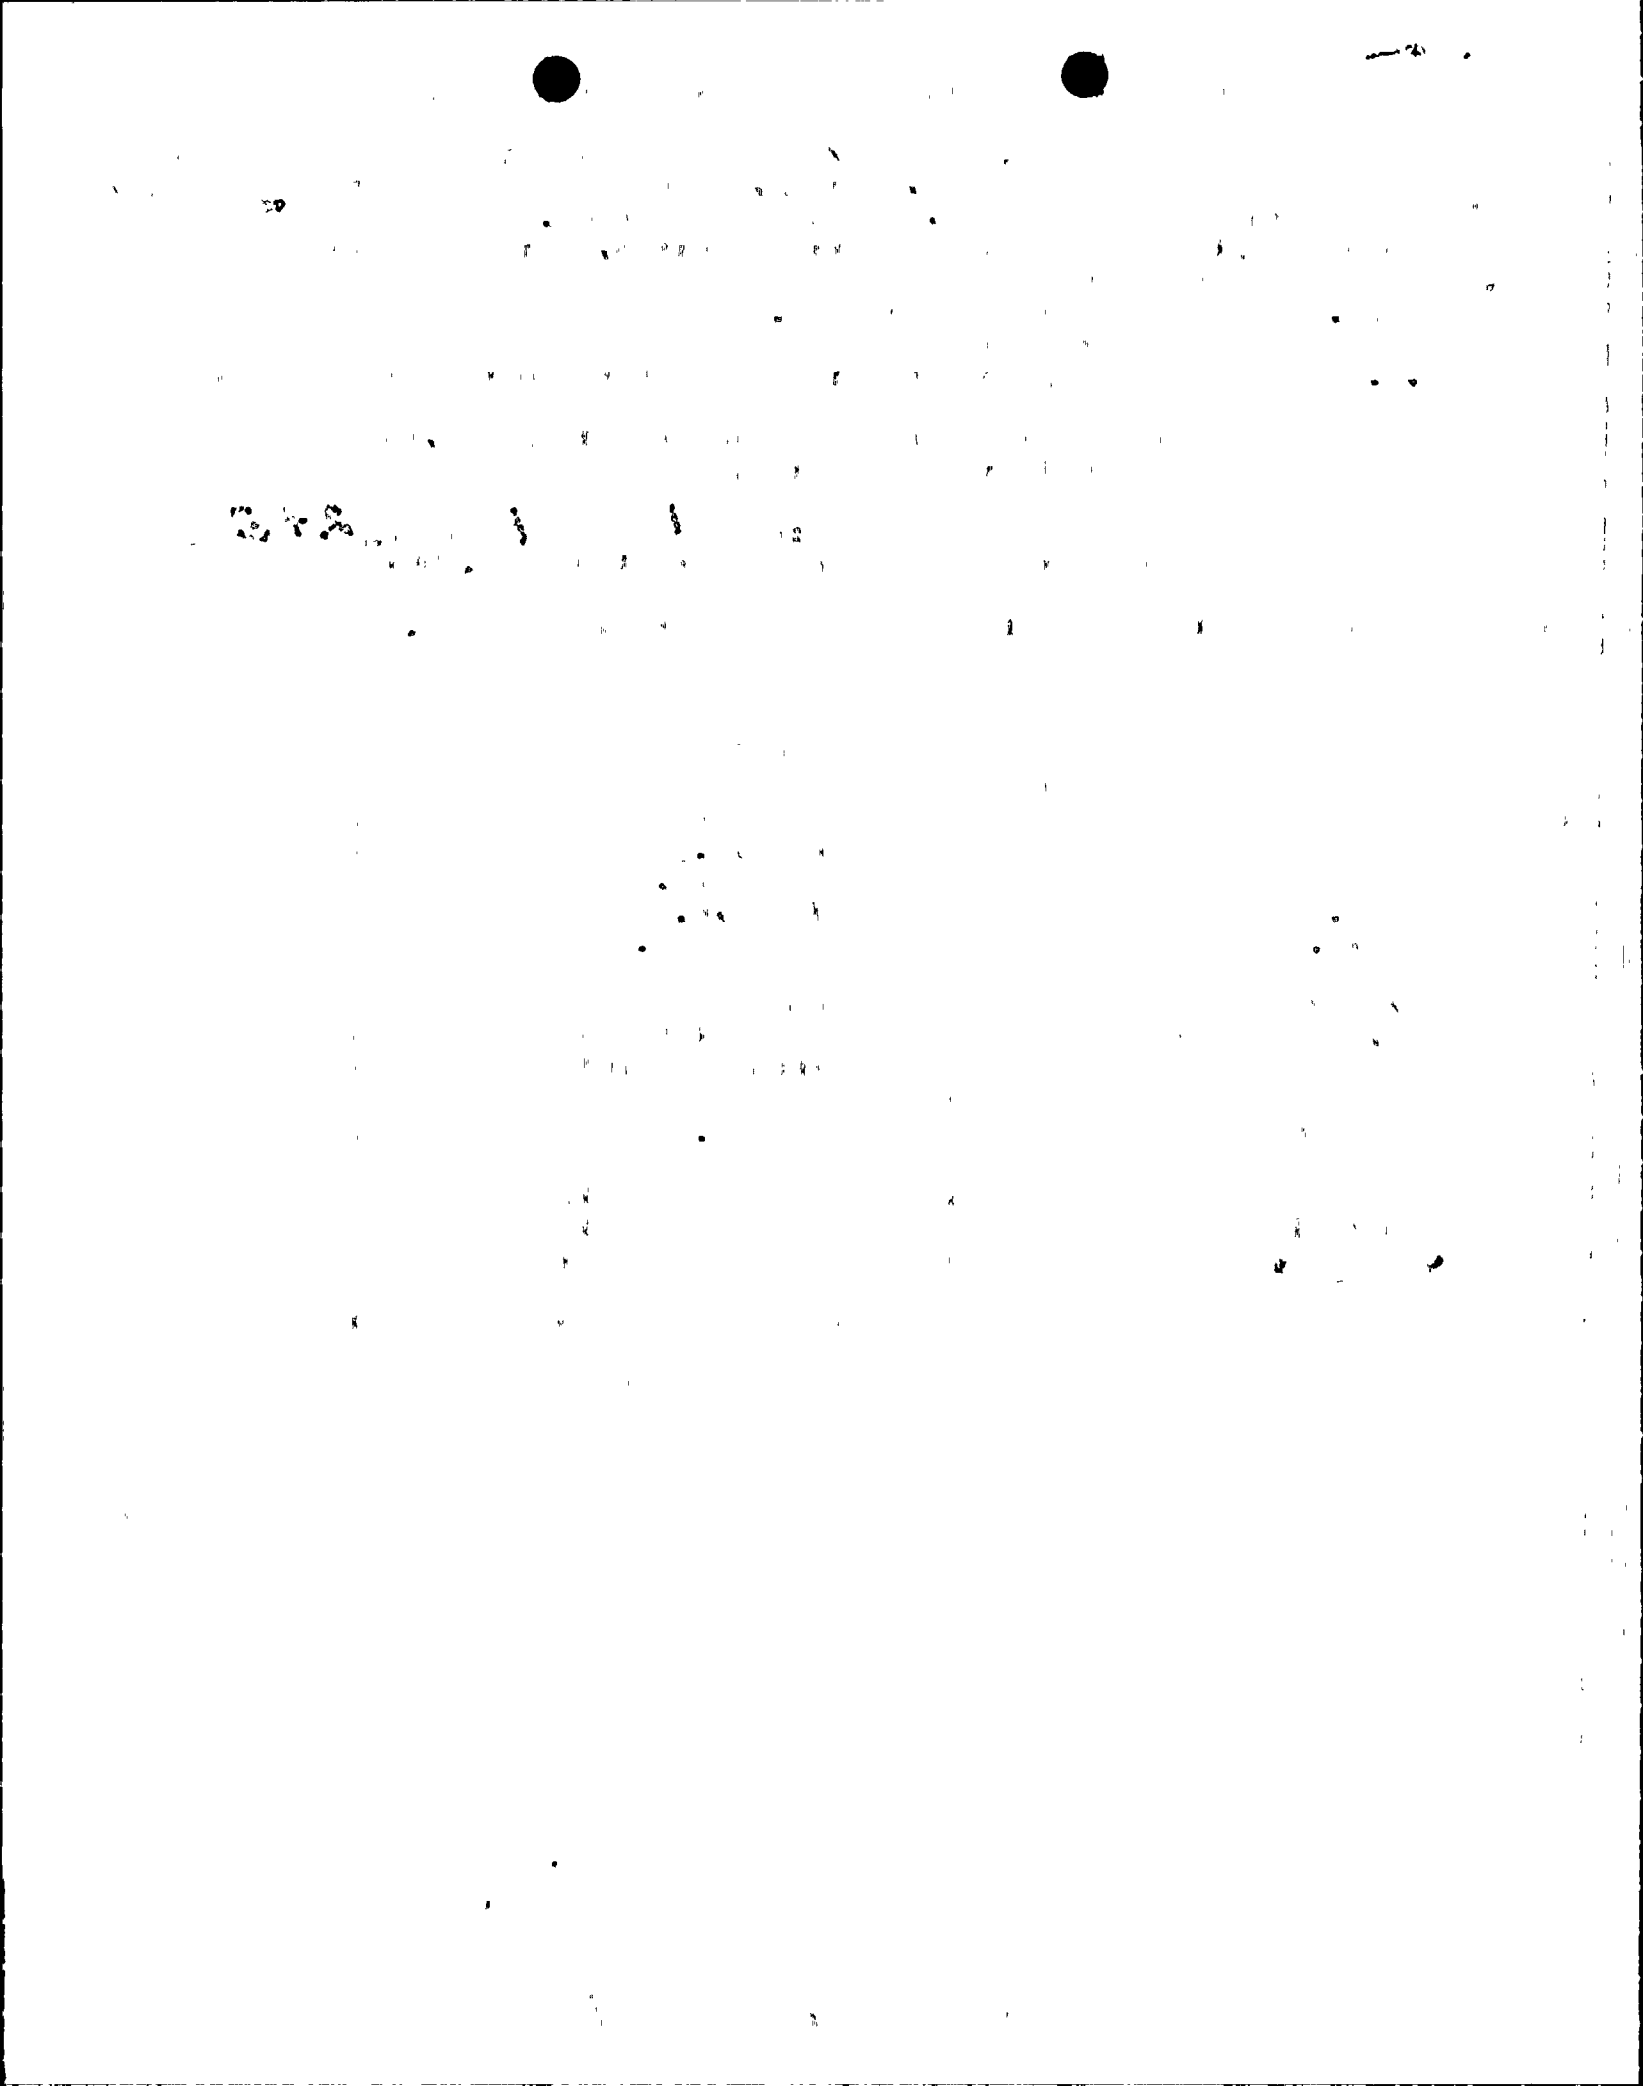

ARIZONA



PUBLIC SERVICE COMPANY

P. O. BOX 21666 • PHOENIX, ARIZONA 85036

July 9, 1980
ANPP-15864-BSK/JAR

U. S. Nuclear Regulatory Commission
Region V
Walnut Creek Plaza - Suite 202
1990 North California Boulevard
Walnut Creek, California 94596

Attention: Mr. G. S. Spencer, Chief
Reactor Construction and
Engineering Support Branch

Subject: A 50.55(e) Reportable Condition Relating to a Closure
of Comsip, Incorporated Containment Gas Analysis System
Pump Valve
File: 80-019-026

Reference: Telephone Conversation between R. Haynes and B. S. Kaplan
on June 12, 1980 (DER 80-15)

Dear Sir:

Attached, is our final written report of the reportable deficiency,
under 10CFR50.55(e), referenced above.

Very truly yours,

E. E. Van Brunt / JAR

E. E. Van Brunt, Jr.
APS Vice President
Nuclear Projects
ANPP Project Director

EEVBJr/BSK:skc

Attachment

BO19
S
1/1

8007160652

Mr. G. S. Spencer, Chief
Reactor Construction and
Engineering Support Branch
ANPP-15864-BSK/JAR
July 9, 1980
Page 2

cc: Victor Stello, Jr., Director
Office of Inspection and Enforcement
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

A. C. Gehr
Snell & Wilmer

R. L. Robb
D. B. Fasnacht
W. E. Ide
B. S. Kaplan
A. C. Rogers
J. M. Allen
W. H. Wilson
W. G. Bingham
W. J. Stubblefield
J. E. Bashore
R. W. Welcher
D. R. Hawkinson
J. Brand

