

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)


ACCESSION NBR:8410170264 DOC.DATE: 84/10/12 NOTARIZED: YES DOCKET #
 FACIL:STN-50-528 Palo Verde Nuclear Station, Unit 1, Arizona Publi 05000528
 STN-50-529 Palo Verde Nuclear Station, Unit 2, Arizona Publi 05000529
 STN-50-530 Palo Verde Nuclear Station, Unit 3, Arizona Publi 05000530
 AUTH.NAME AUTHOR AFFILIATION
 VAN BRUNT,E.E. Arizona Public Service Co.
 RECIP.NAME RECIPIENT AFFILIATION
 KNIGHTON,G.W. Licensing Branch 3

SUBJECT: Forwards revised FSAR changes to Section 17.2, clarifying that corporate QA director given authority to stop activities &/or use of matls not in conformance w/specified quality requirements & provisions of operations QA program.

DISTRIBUTION CODE: B001D COPIES RECEIVED:LTR 1 ENCL 1 SIZE: 4
 TITLE: Licensing Submittal: PSAR/FSAR Amdts & Related Correspondence

NOTES:Standardized plant. 05000528
 Standardized plant. 05000529
 Standardized plant. 05000530

RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
NRR/DL/ADL	1 0	NRR LB3 BC	1 0
NRR LB3 LA	1 0	LICITRA,E 01	1 1
INTERNAL: ADM/LFMB	1 0	ELD/HDS3	1 0
IE FILE	1 1	IE/DEPER/EPB 36	3 3
IE/DEPER/IRB 35	1 1	IE/DQASIP/QAB21	1 1
NRR ROE,M,L	1 1	NRR/DE/AEAB	1 0
NRR/DE/CEB 11	1 1	NRR/DE/EHEB	1 1
NRR/DE/EQB 13	2 2	NRR/DE/GB 28	2 2
NRR/DE/MEB 18	1 1	NRR/DE/MTEB 17	1 1
NRR/DE/SAB 24	1 1	NRR/DE/SGEB 25	1 1
NRR/DHFS/HFEB40	1 1	NRR/DHFS/LQB 32	1 1
NRR/DHFS/PSRB	1 1	NRR/DL/SSPB	1 0
NRR/DSI/AEB 26	1 1	NRR/DSI/ASB	1 1
NRR/DSI/CPB 10	1 1	NRR/DSI/CSB 09	1 1
NRR/DSI/ICSB 16	1 1	NRR/DSI/METB 12	1 1
NRR/DSI/PSB 19	1 1	NRR/DSI/RAB 22	1 1
NRR/DSI/RSB 23	1 1	REG FILE 04	1 1
RGNS	3 3	RM/DDAMI/MIB	1 0
EXTERNAL: ACRS 41	6 6	BNL (AMDTs ONLY)	1 1
DMB/DSS (AMDTs)	1 1	FEMA-REP DIV 39	1 1
LPDR 03	1 1	NRC PDR 02	1 1
NSIC 05	1 1	NTIS	1 1

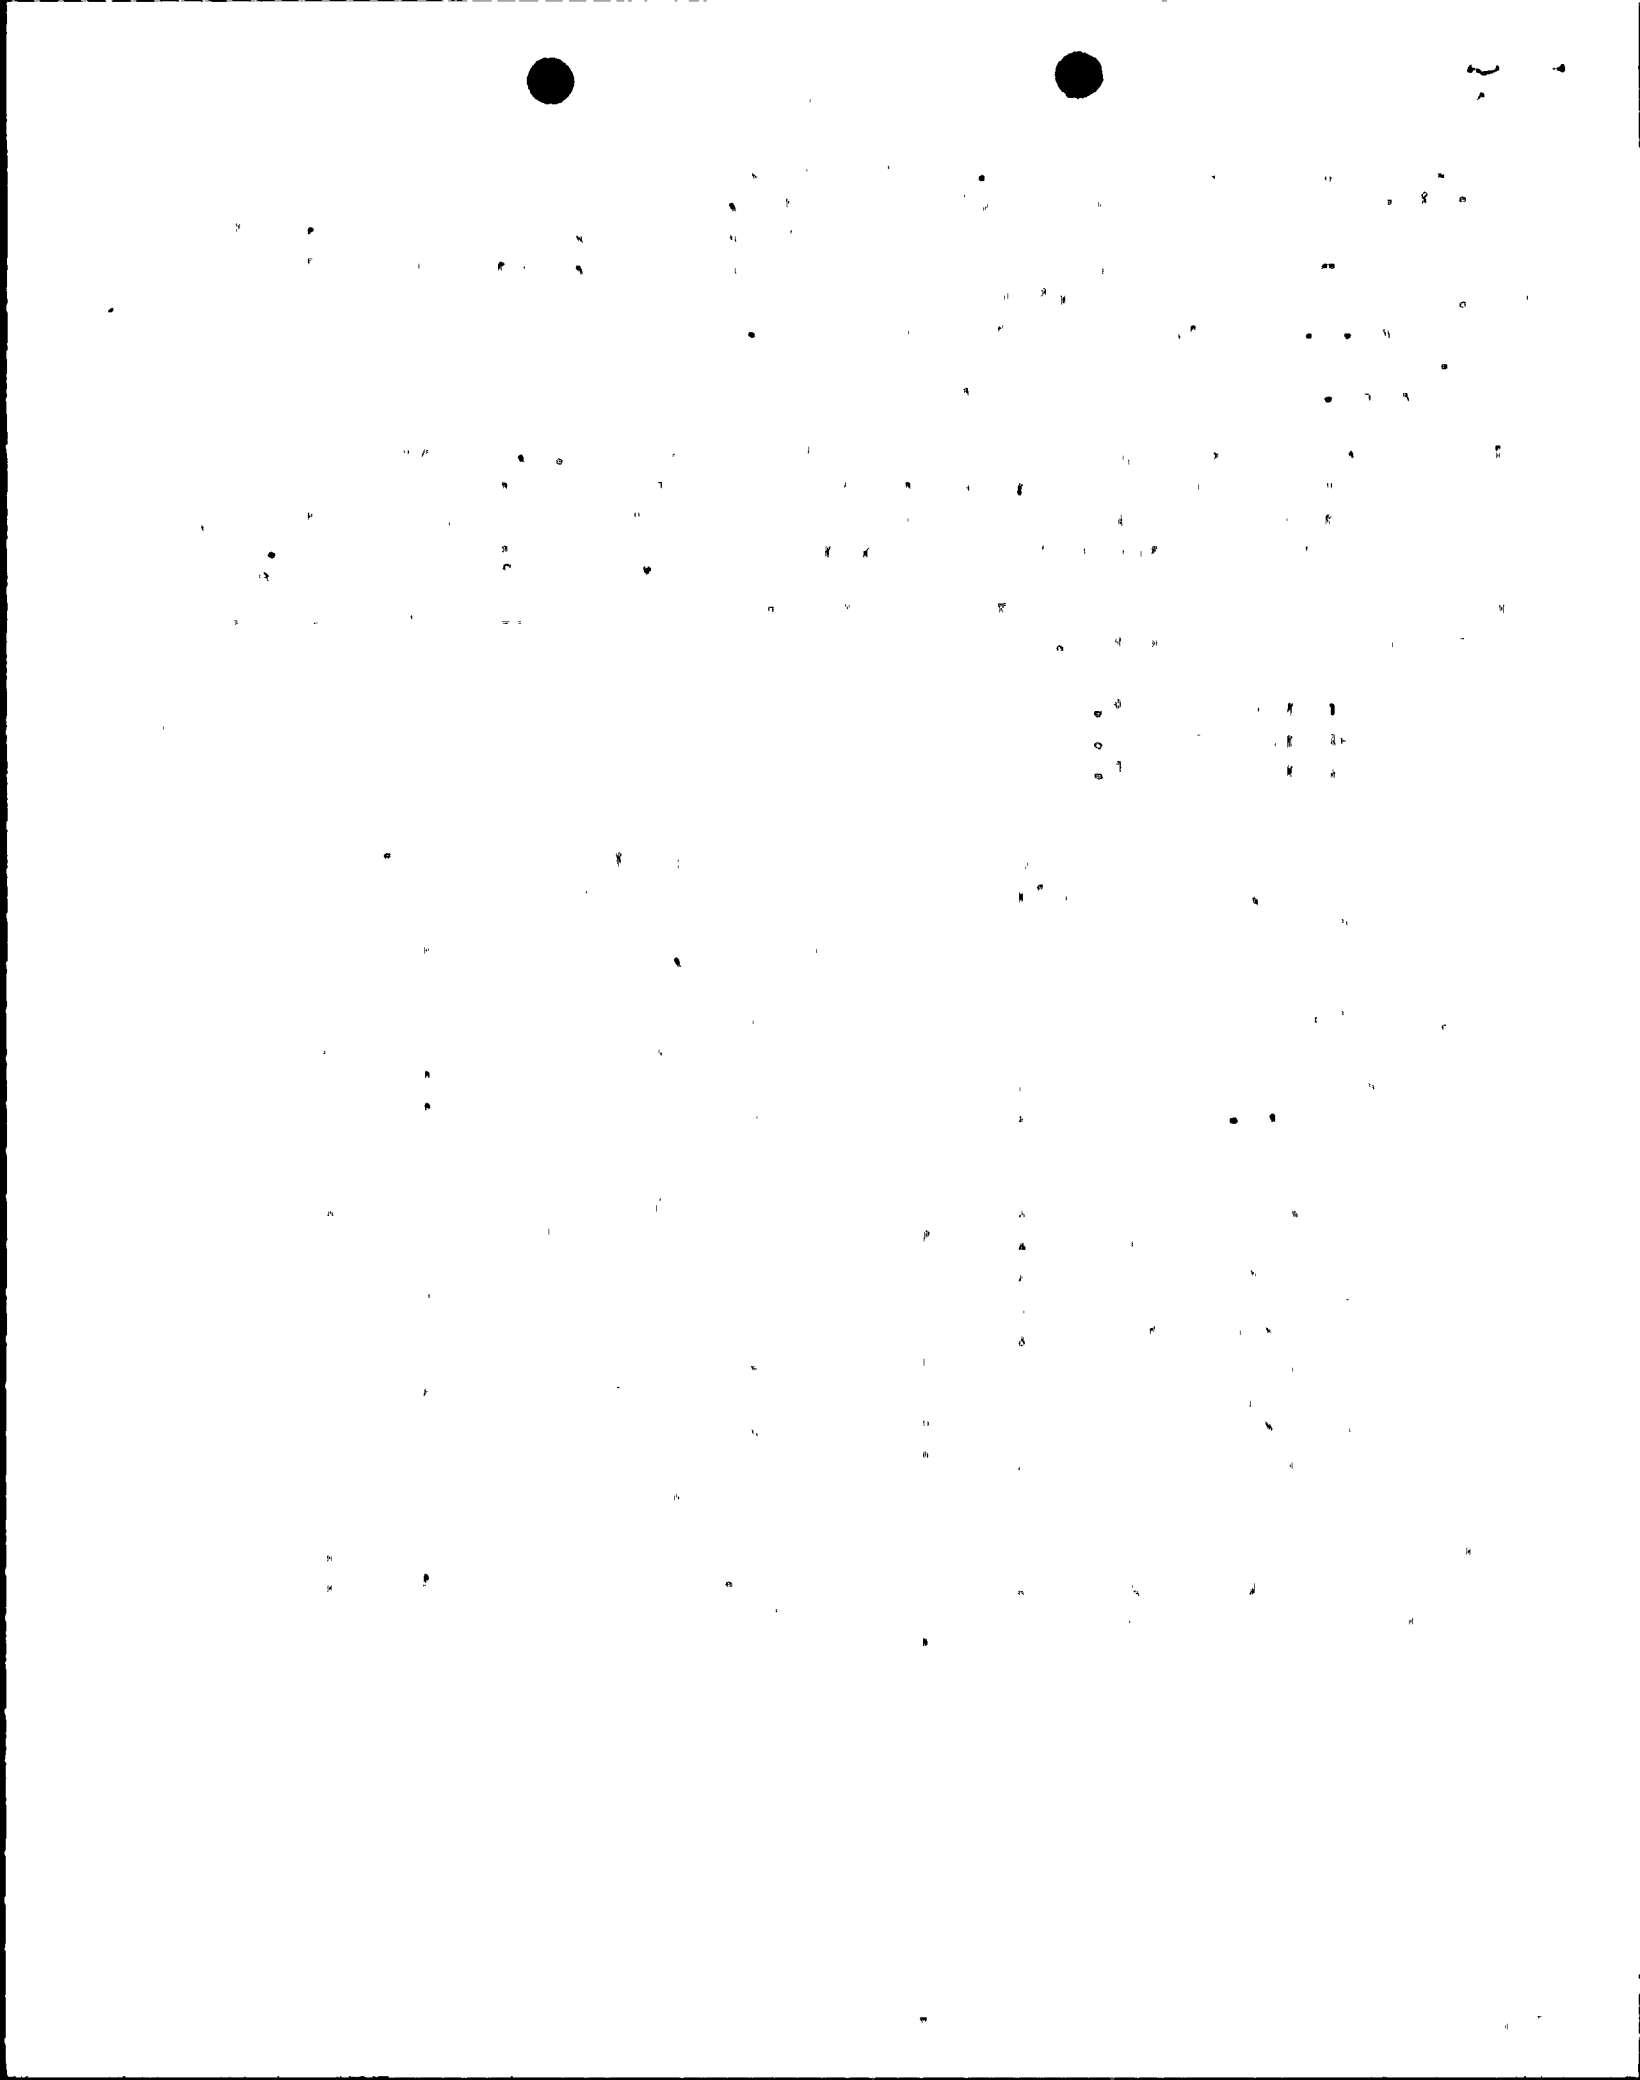

Arizona Public Service Company

Director of Nuclear Reactor Regulation
Attention: Mr. George Knighton, Chief
Licensing Branch No. 3
Division of Licensing
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

October 12, 1984
ANPP-30836 TFQ/JYM

Subject: Palo Verde Nuclear Generating Station (PVNGS)
Units 1, 2 and 3
Revised FSAR Change to Chapter 17
Docket Nos. STN-50-528/529/530
File: 84-056-026; G.1.01.10

Reference: Letter from E. E. Van Brunt Jr., APS, to G. W. Knighton,
NRC, ANPP-30405 dated August 30, 1984.

Dear Mr. Knighton:

Attached are revised FSAR changes to Section 17.2 which update our
Chapter 17 submittal provided in the referenced letter.

The changes made to page 17.2-5 were intended to clarify that the Corporate
Quality Assurance Director has been given the authority to have stopped,
the activities and/or the use of further processing of materials that
are not in conformance with the specified quality requirements, and/or
provisions of the Operations Quality Assurance Program.

The change made to page 17.2-11A provided in the referenced submittal
has been rewritten on a page incorporating amendment 13 changes.

If you have any questions on this matter, please contact me.

Very truly yours,



E. E. Van Brunt, Jr.
APS Vice President
Nuclear Production
ANPP Project Director

EEVBJr/JYM/bg
Attachment

cc: E. A. Licitra w/a
A. C. Gehr w/a
G. Zwetzig w/a


8410170264 841012
PDR ADDCK 05000528
A PDR

Boo!
11

ANPP-30836


STATE OF ARIZONA)
) ss.
COUNTY OF MARICOPA)

I, Edwin E. Van Brunt, Jr., represent that I am Vice President, Nuclear Production of Arizona Public Service Company, that the foregoing document has been signed by me on behalf of Arizona Public Service Company with full authority to do so, that I have read such document and know its contents, and that to the best of my knowledge and belief, the statements made therein are true.

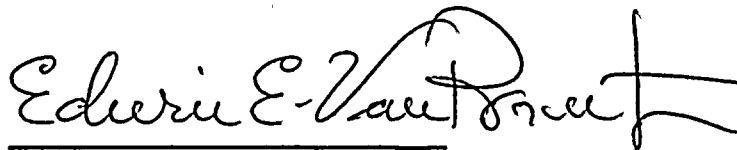

Edwin E. Van Brunt, Jr.

Sworn to before me this 11th day of October, 1984.



Notary Public

My Commission Expires:

My Commission Expires April 6, 1987



Director
The Corporate Quality Assurance Manager has been given the authority, by the Chairman and Chief Executive Officer, to maintain open lines of communication with individuals and groups having responsibilities related to the startup and operation of the PVNGS to ensure that policies and requirements of the Operations Quality Assurance Program are properly interpreted and adequately implemented, and to determine the effectiveness of the Operations Quality Assurance Program. He has the authority to cross organizational lines to identify quality problems, to initiate, recommend, or provide solutions and to verify implementation of solutions. The Corporate Quality Assurance Manager *Director* has been given the authority, by the Chairman and Chief Executive Officer *to have stopped, by established procedures, the activities and/or the use or further processing of materials that are not in conformance with specified quality requirements and/or the provisions of the Operations Quality Assurance Program.* *This authority is exercised through established procedure.* The Corporate Quality Assurance Manager *Director* shall satisfy the following minimum qualification requirements:

- A. Graduate of a 4-year accredited engineering or science college or university.
- B. At least 2 years of management or supervisory experience.
- C. Minimum of 5 years experience in quality assurance, including testing or inspection (or both) of equivalent manufacturing, construction, and installation activities. At least 1 year of this experience shall be associated with nuclear facilities.
- D. In lieu of a degree, a high school graduate with a minimum of 1 year related technical or academic training and 10 years of experience in general quality assurance or engineering of equivalent manufacturing, construction, and installation

QUALITY ASSURANCE DURING
THE OPERATIONS PHASE17.2.1.6.1 Startup Manager

12 The Startup Manager has the responsibility for directing Pre-
13 requisite and Phase I startup activities and for proper imple-
mentation of the quality assurance program during startup
activities. He is responsible for ensuring the criteria con-
tained in the operation quality assurance program are incorpo-
rated in startup procedures, except that Regulatory Guide 1.28
will be followed in lieu of Regulatory Guide 1.33. The Startup
Manager reports directly to the Vice President, Nuclear. *Transition
Manager who reports directly to the Vice President Nuclear Production.*
Project Services Group
17.2.1.7 ~~Administrative and Technical Services~~

The Administrative and Technical Services organization is
shown in figure 13.1-2^A_B and described in section 13.1.

17.2.1.8 Nuclear Construction

12 The Nuclear Construction ^{department} organization is shown in figure 13.1-4^{3F}
and described in section 13.1.

17.2.1.9 Nuclear Records Management

The Nuclear Records Management ^{department} organization is shown in
figure 13.1-4^{3B} and described in section 13.1.

