

# REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8412070187 DOC. DATE: 84/12/03 NOTARIZED: YES DOCKET #  
 FACIL: STN-50-528 Palo Verde Nuclear Station, Unit 1, Arizona Publ 05000528  
 AUTH. NAME: AUTHOR AFFILIATION  
 VAN BRUNT, E. E. Arizona Public Service Co.  
 KARNER, D. B. Arizona Public Service Co.  
 RECIP. NAME: RECIPIENT AFFILIATION  
 KNIGHTON, G. Licensing Branch 3

SUBJECT: Forwards marked-up final draft Tech Specs & itemized list of corrections. *566 TECH SPGS*

DISTRIBUTION CODE: B001D COPIES RECEIVED: LTR *1* ENCL *6 on shelf* SIZE: *400*  
 TITLE: Licensing Submittal: PSAR/FSAR Amdts & Related Correspondence

NOTES: Standardized plant.

05000528

RECIPIENT		COPIES		RECIPIENT		COPIES	
ID CODE/NAME		LTTR	ENCL	ID CODE/NAME		LTTR	ENCL
NRR/DL/ADL		1		NRR LB3 BC		1	0
NRR LB3 LA		1		LICITRA, E.	01	1	10
INTERNAL: ACRS	41	6		ADM/LFMB		1	
ELD/HDS3		1		IE FILE		1	
IE/DEPER/EPB	36	1		IE/DEPER/IRB	35	1	
IE/DQASIP/QAB21		1		NRR ROE, M. L		1	
NRR/DE/AEAB		1		NRR/DE/CEB	11	1	
NRR/DE/EHEB		1		NRR/DE/eqb	13	2	
NRR/DE/GB	28	2		NRR/DE/MEB	18	1	
NRR/DE/MTEB	17	1		NRR/DE/SAB	24	1	
NRR/DE/SGEB	25	1		NRR/DHFS/HFEB40		1	
NRR/DHFS/LQB	32	1		NRR/DHFS/PSRB		1	
NRR/DL/SSPB		1		NRR/DSI/AEB	26	1	
NRR/DSI/ASB		1		NRR/DSI/CPB	10	1	
NRR/DSI/CSB	09	1		NRR/DSI/ICSB	16	1	
NRR/DSI/METB	12	1		NRR/DSI/PSB	19	1	
NRR/DSI/RAB	22	1		NRR/DSI/RSB	23	1	
REG. FILE	04	1	10	RGN5		3	
RM/DDAMI/MIB		1	0				
EXTERNAL: BNL (AMDTS ONLY)		1		DMB/DSS (AMDTS)		1	①
FEMA-REP DIV	39	1		LPDR	03	1	10
NRC PDR	02	1	10	NSIC	05	1	10
NTIS		1	10	PNL GRUEL/R		1	①

*Limited dist.*

The following is a list of the names of the persons who have been  
 appointed to the various positions in the office of the  
 Secretary of the State, for the year 1900.

The following is a list of the names of the persons who have been  
 appointed to the various positions in the office of the  
 Secretary of the State, for the year 1900.

List of Names		List of Names	
1	1	1	1
2	2	2	2
3	3	3	3
4	4	4	4
5	5	5	5
6	6	6	6
7	7	7	7
8	8	8	8
9	9	9	9
10	10	10	10
11	11	11	11
12	12	12	12
13	13	13	13
14	14	14	14
15	15	15	15
16	16	16	16
17	17	17	17
18	18	18	18
19	19	19	19
20	20	20	20
21	21	21	21
22	22	22	22
23	23	23	23
24	24	24	24
25	25	25	25
26	26	26	26
27	27	27	27
28	28	28	28
29	29	29	29
30	30	30	30
31	31	31	31
32	32	32	32
33	33	33	33
34	34	34	34
35	35	35	35
36	36	36	36
37	37	37	37
38	38	38	38
39	39	39	39
40	40	40	40
41	41	41	41
42	42	42	42
43	43	43	43
44	44	44	44
45	45	45	45
46	46	46	46
47	47	47	47
48	48	48	48
49	49	49	49
50	50	50	50
51	51	51	51
52	52	52	52
53	53	53	53
54	54	54	54
55	55	55	55
56	56	56	56
57	57	57	57
58	58	58	58
59	59	59	59
60	60	60	60
61	61	61	61
62	62	62	62
63	63	63	63
64	64	64	64
65	65	65	65
66	66	66	66
67	67	67	67
68	68	68	68
69	69	69	69
70	70	70	70
71	71	71	71
72	72	72	72
73	73	73	73
74	74	74	74
75	75	75	75
76	76	76	76
77	77	77	77
78	78	78	78
79	79	79	79
80	80	80	80
81	81	81	81
82	82	82	82
83	83	83	83
84	84	84	84
85	85	85	85
86	86	86	86
87	87	87	87
88	88	88	88
89	89	89	89
90	90	90	90
91	91	91	91
92	92	92	92
93	93	93	93
94	94	94	94
95	95	95	95
96	96	96	96
97	97	97	97
98	98	98	98
99	99	99	99
100	100	100	100

The following is a list of the names of the persons who have been  
 appointed to the various positions in the office of the  
 Secretary of the State, for the year 1900.



## Arizona Nuclear Power Project

P.O. BOX 52034 • PHOENIX, ARIZONA 85072-2034

ANPP-31298-EEVB/SRF

December 3, 1984

Director of Nuclear Reactor Regulation  
Attention: Mr. George Knighton, Chief  
Licensing Branch No. 3, Division of Licensing  
U. S. Nuclear Regulatory Commission  
Washington, D. C. 20555

Subject: PVNGS Unit 1  
PVNGS Unit 1 Final Draft Technical  
Specifications  
Docket No. STN 50-528  
File: 005-419.05

References: A) NRC Letter Dated August 14, 1984,  
from G. W. Knighton, NRC to  
E. E. Van Brunt, Jr., APS  
  
B) APS Letter Dated September 14, 1984,  
from E. E. Van Brunt, Jr., APS to  
G. W. Knighton, NRC

This letter is submitted for the purpose of (i) transmitting a marked-up copy of the "Final Draft" Technical Specifications (Attachment A) and an itemized list of corrections included in such marked-up copy (Attachment B) and (ii) providing our certification respecting Attachment A.

In developing Attachment A for PVNGS Unit 1 the following process was implemented to ensure that a workable set of technical specifications was developed.

A committee to review NUREG 0212 Rev. 3 and develop PVNGS Tech. Specs. was established approximately two years ago. Our committee consisted of representatives from offsite engineering, Licensing, onsite Operations, H.P./Chemistry, Maintenance, Engineering, Startup, QA, STA/ISEG, I and C, Training, Bechtel Engineering and Combustion Engineering. This committee worked closely with the NRC reviewer to develop a set of Technical Specifications that represented PVNGS.

This committee functioned, as follows, to mold the CE Standard Tech Specs so they would represent the design of PVNGS, and the manner in which the plant will be operated and would agree with other supporting documentation (i.e., FSAR):

*Boo 1/6 Limited*  
*Hest*

8412070187 841203  
PDR ADOCK 05000528  
A PDR

11/11/11

11/11/11



Mr. George Knighton  
PVNGS Unit 1 Final Draft  
ANPP - 31298  
Page Two

1. Utilize our own Plant Specific experience to review systems, their functions, parameters and system names.
2. Discussed Tech Spec problems with operating units throughout the industry.
3. Held review meetings with various operating units.
4. Had operating experienced units review/comment on our proof/review Tech Specs.
5. Monitored Federal Register to see if any Tech Spec changes other plants obtained would apply to PVNGS.
6. Reviewed various operating experiences (i.e., LERs, some inspection reports, etc.) to see if they could affect the Tech Specs.
7. Compared the Tech Specs to the PVNGS FSAR for consistency.
8. Compared the Tech Specs to the PVNGS SER for consistency.
9. Compared the Tech Specs to the CESSAR FSAR for consistency.
10. Compared the Tech Specs to the CE-SER for consistency.
11. We have used our vendor's experience and support from the beginning to develop our Tech Specs.
12. Continuous discussions over the past two years with our Resident Inspectors and resolving their problems either through discussion or revision to the Tech Specs.

In addition to these committee functions, we have taken the following measures to assure that our Tech. Specs. are workable for PVNGS Unit 1 and will reflect the manner in which the unit will operate.

1. We have used our Tech Specs during our startup program to see if we can live with the various specs and associated equipment in order to eliminate future problems (i.e., pump performance, etc.).



Mr. George Knighton  
PVNGS Unit 1 Final Draft  
ANPP - 31298  
Page Three

2. We have had our DCPs reviewed to see if Tech Spec changes are needed.
3. We have trained our operators in our "marked up" Tech Specs over the past 2 years.
4. We have utilized our Tech Specs on the PVNGS Plant Specific Simulator.
5. We have monitored/solicited questions and interpretation problems from Training and Operations and revised our Tech Specs to make the Tech Specs clear for everyone.
6. We have written our procedures from our marked up Tech Specs and as problems arise we may have changed the spec.

In completing the above process APS had a set of Technical Specifications ready for the proof and review stage of Licensing.

Reference A transmitted to APS a copy of the PVNGS proof and review Technical Specifications. Upon completing that review APS transmitted our comments in Reference B. Our NRC reviewer not only obtained our comments but also the comments of the NRC Staff.

In the process of resolving the comments a series of meetings were conducted between the appropriate NRC branches and APS representatives. In resolving all the comments a "final draft" of the PVNGS Technical Specifications was developed.

This "final draft" was transmitted to APS to perform our final review and certification that these Tech. Specs. represent the design and anticipated operation of PVNGS Unit 1. In formulating a certification program we requested Bechtel Power Corporation and Combustion Engineering to certify to APS that the design and anticipated operation of PVNGS Unit 1 was reflected in the Technical Specifications.

Attachment A is a marked up copy of the PVNGS Unit 1 Technical Specifications as certified by APS, Bechtel and Combustion Engineering. If the Technical Specifications issued by the NRC as part of the PVNGS Unit 1 Operating License differs from Attachment A, the certification of APS, Bechtel and Combustion Engineering may be invalidated.

Attachment B itemizes corrections and typographical errors in Attachment A.



Mr. George Knighton  
PVNGS Unit 1 Final Draft  
ANPP - 31298  
Page Four

Based on the review process implemented, the certification process, Bechtel's and Combustion Engineering's certifications, I certify that the "final draft" of the PVNGS Unit 1 Technical Specifications as marked up in Attachment A to reflect the design and anticipated operation of PVNGS Unit 1.

Very truly yours,

*E. E. Van Brunt / ESK*

E. E. Van Brunt, Jr.  
APS Vice President  
Nuclear Projects Management  
ANPP Project Director

EEVB/SF/jle  
Attachments

cc: E. Licitra  
J. B. Martin  
R. Zimmerman  
G. Fiorelli



STATE OF ARIZONA )  
 ) ss.  
COUNTY OF MARICOPA)

I, Donald B. Karner, represent that I am Assistant Vice President, Nuclear Production of Arizona Public Service Company, that the foregoing document has been signed by me on behalf of Arizona Public Service Company with full authority to do so, that I have read such document and know its contents, and that to the best of my knowledge and belief, the statements made therein are true.


Donald B. Karner  
Donald B. Karner

Sworn to before me this 3rd day of December, 1984.

Dora E. Mesder  
Notary Public

My Commission Expires:

My Commission Expires April 6, 1987





ATTACHMENT A



..8412070187

**FINAL DRAFT**

DRAFT

TECHNICAL SPECIFICATIONS

PALO VERDE NUCLEAR GENERATING STATION

UNIT NO. 1

DOCKET NO. 50-528

Changes in FINAL DRAFT  
from the 11/8/84 DRAFT  
Copy

## INDEX

### DEFINITIONS

<u>SECTION</u>	<u>PAGE</u>
<u>1.0 DEFINITIONS</u>	
1.1 ACTION.....	1-1
1.2 AXIAL SHAPE INDEX.....	1-1
1.3 AZIMUTHAL POWER TILT.....	1-1
1.4 CHANNEL CALIBRATION.....	1-1
1.5 CHANNEL CHECK.....	1-1
1.6 CHANNEL FUNCTIONAL TEST.....	1-2
1.7 CONTAINMENT INTEGRITY.....	1-2
1.8 CONTROLLED LEAKAGE.....	1-2
1.9 CORE ALTERATION.....	1-2
1.10 DOSE EQUIVALENT I-131.....	1-3
1.11 $\bar{E}$ -AVERAGE DISINTEGRATION ENERGY.....	1-3
1.12 ENGINEERED SAFETY FEATURES RESPONSE TIME.....	1-3
1.13 FREQUENCY NOTATION.....	1-3
1.14 GASEOUS RADWASTE SYSTEM.....	1-3
1.15 IDENTIFIED LEAKAGE.....	1-3
1.16 MEMBER(S) OF THE PUBLIC.....	1-4
1.17 OFFSITE DOSE CALCULATION MANUAL.....	1-4
1.18 OPERABLE - OPERABILITY.....	1-4
1.19 OPERATIONAL MODE - MODE.....	1-4
1.20 PHYSICS TESTS.....	1-4
1.21 PLANAR RADIAL PEAKING FACTOR - $F_{xy}$ .....	1-4
1.22 PRESSURE BOUNDARY LEAKAGE.....	1-4
1.23 PROCESS CONTROL PROGRAM.....	1-5
1.24 PURGE - PURGING.....	1-5
1.25 RATED THERMAL POWER.....	1-5
1.26 REACTOR TRIP SYSTEM RESPONSE TIME.....	1-5
1.27 REPORTABLE EVENT.....	1-5
1.28 SHUTDOWN MARGIN.....	1-5
1.29 SITE BOUNDARY.....	1-6
1.30 SOFTWARE.....	1-6

# FINAL DRAFT

## INDEX

### DEFINITIONS

---

<u>SECTION</u>	<u>PAGE</u>
1.31 SOLIDIFICATION.....	1-6
1.32 SOURCE CHECK.....	1-6
1.33 STAGGERED TEST BASIS.....	1-6
1.34 THERMAL POWER.....	1-6
1.35 UNIDENTIFIED LEAKAGE.....	1-6
1.36 UNRESTRICTED AREA.....	1-6
1.37 VENTILATION EXHAUST TREATMENT SYSTEM.....	1-7
1.38 VENTING.....	1-7



## INDEX

### SAFETY LIMITS AND LIMITING SAFETY SYSTEM SETTINGS

<u>SECTION</u>	<u>PAGE</u>
<u>2.1 SAFETY LIMITS</u>	
2.1.1 REACTOR CORE.....	2-1
2.1.1.1 DNBR.....	2-1
2.1.1.2 PEAK LINEAR HEAT RATE.....	2-1
2.1.2 REACTOR COOLANT SYSTEM PRESSURE.....	2-1
<u>2.2 LIMITING SAFETY SYSTEM SETTINGS</u>	
2.2.1 REACTOR TRIP SETPOINTS.....	2-2
2.2.2 CORE PROTECTION CALCULATOR ADDRESSABLE CONSTANTS.....	2-2

### BASES

<u>SECTION</u>	<u>PAGE</u>
<u>2.1 SAFETY LIMITS</u>	
2.1.1 REACTOR CORE.....	B 2-1
2.1.2 REACTOR COOLANT SYSTEM PRESSURE.....	B 2-2
<u>2.2 LIMITING SAFETY SYSTEM SETTINGS</u>	
2.2.1 REACTOR TRIP SETPOINTS.....	B 2-2
2.2.2 CORE PROTECTION CALCULATOR ADDRESSABLE CONSTANTS.....	B 2-7

## INDEX

### LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

<u>SECTION</u>	<u>PAGE</u>
<u>3/4.0 APPLICABILITY</u> .....	3/4 0-1
<u>3/4.1 REACTIVITY CONTROL SYSTEMS</u>	
3/4.1.1 BORATION CONTROL	
SHUTDOWN MARGIN - $T_{cold} > 210^{\circ}\text{F}$ .....	3/4 1-1
SHUTDOWN MARGIN - $T_{cold} \leq 210^{\circ}\text{F}$ .....	3/4 1-3
MODERATOR TEMPERATURE COEFFICIENT.....	3/4 1-4
MINIMUM TEMPERATURE FOR CRITICALITY.....	3/4 1-6
3/4.1.2 BORATION SYSTEMS	
FLOW PATHS - SHUTDOWN.....	3/4 1-7
FLOW PATHS - OPERATING.....	3/4 1-8
CHARGING PUMPS - SHUTDOWN.....	3/4 1-9
CHARGING PUMPS - OPERATING.....	3/4 1-10
BORATED WATER SOURCES - SHUTDOWN.....	3/4 1-11
BORATED WATER SOURCES - OPERATING.....	3/4 1-13
BORON DILUTION ALARMS.....	3/4 1-14
3/4.1.3 MOVABLE CONTROL ASSEMBLIES	
CEA POSITION.....	3/4 1-21
POSITION INDICATOR CHANNELS - OPERATING.....	3/4 1-25
POSITION INDICATOR CHANNELS - SHUTDOWN.....	3/4 1-26
CEA DROP TIME.....	3/4 1-27
SHUTDOWN CEA INSERTION LIMIT.....	3/4 1-28
REGULATING CEA INSERTION LIMITS.....	3/4 1-29



## INDEX

### LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

<u>SECTION</u>	<u>PAGE</u>
<u>3/4.2 POWER DISTRIBUTION LIMITS</u>	
3/4.2.1 LINEAR HEAT RATE.....	3/4 2-1
3/4.2.2 PLANAR RADIAL PEAKING FACTORS.....	3/4 2-2
3/4.2.3 AZIMUTHAL POWER TILT.....	3/4 2-3
3/4.2.4 DNBR MARGIN.....	3/4 2-5
3/4.2.5 RCS FLOW RATE.....	3/4 2-8
3/4.2.6 REACTOR COOLANT COLD LEG TEMPERATURE.....	3/4 2-9
3/4.2.7 AXIAL SHAPE INDEX.....	3/4 2-11
3/4.2.8 PRESSURIZER PRESSURE.....	3/4 2-12
<u>3/4.3 INSTRUMENTATION</u>	
3/4.3.1 REACTOR PROTECTIVE INSTRUMENTATION.....	3/4 3-1
3/4.3.2 ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION.....	3/4 3-17
3/4.3.3 MONITORING INSTRUMENTATION	
RADIATION MONITORING INSTRUMENTATION.....	3/4 3-37
INCORE DETECTORS.....	3/4 3-41
SEISMIC INSTRUMENTATION.....	3/4 3-42
METEOROLOGICAL INSTRUMENTATION.....	3/4 3-45
REMOTE SHUTDOWN <del>INSTRUMENTATION</del> <i>SYSTEM</i> .....	3/4 3-48
POST-ACCIDENT MONITORING INSTRUMENTATION.....	3/4 3-57
FIRE DETECTION INSTRUMENTATION.....	3/4 3-60
LOOSE-PART DETECTION INSTRUMENTATION.....	3/4 3-68
RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION.....	3/4 3-70
<u>3/4.4 REACTOR COOLANT SYSTEM</u>	
3/4.4.1 REACTOR COOLANT LOOPS AND COOLANT CIRCULATION	
STARTUP AND POWER OPERATION.....	3/4 4-1
HOT STANDBY.....	3/4 4-2
HOT SHUTDOWN.....	3/4 4-3
COLD SHUTDOWN - LOOPS FILLED.....	3/4 4-5
COLD SHUTDOWN - LOOPS NOT FILLED.....	3/4 4-6

# FINAL DRAFT

## INDEX

### LIMITING CONDITION FOR OPERATION AND SURVEILLANCE REQUIREMENTS

<u>SECTION</u>	<u>PAGE</u>
3/4.4.2 SAFETY VALVES	
SHUTDOWN.....	3/4 4-7.
OPERATING.....	3/4 4-8
3/4.4.3 PRESSURIZER	
PRESSURIZER.....	3/4 4-9
AUXILIARY SPRAY.....	3/4 4-10
3/4.4.4 STEAM GENERATORS.....	3/4 4-11
3/4.4.5 REACTOR COOLANT SYSTEM LEAKAGE	
LEAKAGE DETECTION SYSTEMS.....	3/4 4-18
OPERATIONAL LEAKAGE.....	3/4 4-19
3/4.4.6 CHEMISTRY.....	3/4 4-22
3/4.4.7 SPECIFIC ACTIVITY.....	3/4 4-25
3/4.4.8 PRESSURE/TEMPERATURE LIMITS	
REACTOR COOLANT SYSTEM.....	3/4 4-29
PRESSURIZER HEATUP/COOLDOWN LIMITS.....	3/4 4-32
OVERPRESSURE PROTECTION SYSTEMS.....	3/4 4-33
3/4.4.9 STRUCTURAL INTEGRITY.....	3/4 4-34
3/4.4.10 REACTOR COOLANT SYSTEM VENTS.....	3/4 4-35
<u>3/4.5 EMERGENCY CORE COOLING SYSTEMS (ECCS)</u>	
3/4.5.1 SAFETY INJECTION TANKS.....	3/4 5-1
3/4.5.2 ECCS SUBSYSTEMS - $T_{cold} \geq 350^{\circ}F$ .....	3/4 5-3
3/4.5.3 ECCS SUBSYSTEMS - $T_{cold} < 350^{\circ}F$ .....	3/4 5-7
3/4.5.4 REFUELING WATER TANK.....	3/4 5-8

## INDEX

### LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

<u>SECTION</u>	<u>PAGE</u>
<u>3/4.6 CONTAINMENT SYSTEMS</u>	
3/4.6.1 PRIMARY CONTAINMENT	
CONTAINMENT INTEGRITY.....	3/4 6-1
CONTAINMENT LEAKAGE.....	3/4 6-2
CONTAINMENT AIR LOCKS.....	3/4 6-4
INTERNAL PRESSURE.....	3/4 6-6
AIR TEMPERATURE.....	3/4 6-7
CONTAINMENT VESSEL STRUCTURAL INTEGRITY.....	3/4 6-8
CONTAINMENT VENTILATION SYSTEM.....	3/4 6-14
3/4.6.2 DEPRESSURIZATION AND COOLING SYSTEMS	
CONTAINMENT SPRAY SYSTEM.....	3/4 6-15
IODINE REMOVAL SYSTEM.....	3/4 6-17
3/4.6.3 CONTAINMENT ISOLATION VALVES.....	3/4 6-19
3/4.6.4 COMBUSTIBLE GAS CONTROL	
HYDROGEN MONITORS.....	3/4 6-36
ELECTRIC HYDROGEN RECOMBINERS.....	3/4 6-37
HYDROGEN PURGE CLEANUP SYSTEM.....	3/4 6-38

## INDEX

### LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

<u>SECTION</u>	<u>PAGE</u>
<u>3/4.7 PLANT SYSTEMS</u>	
3/4.7.1 TURBINE CYCLE	
SAFETY VALVES.....	3/4 7-1
AUXILIARY FEEDWATER SYSTEM.....	3/4 7-4
CONDENSATE STORAGE TANK.....	3/4 7-6
ACTIVITY.....	3/4 7-7
MAIN STEAM LINE ISOLATION VALVES.....	3/4 7-9
ATMOSPHERIC DUMP VALVES.....	3/4 7-10
3/4.7.2 STEAM GENERATOR PRESSURE/TEMPERATURE LIMITATION.....	3/4 7-11
3/4.7.3 ESSENTIAL COOLING WATER SYSTEM.....	3/4 7-12
3/4.7.4 ESSENTIAL SPRAY POND SYSTEM.....	3/4 7-13
3/4.7.5 ULTIMATE HEAT SINK.....	3/4 7-14
3/4.7.6 ESSENTIAL CHILLED WATER SYSTEM.....	3/4 7-15
3/4.7.7 CONTROL ROOM ESSENTIAL FILTRATION SYSTEM.....	3/4 7-16
3/4.7.8 ESF PUMP ROOM AIR EXHAUST CLEANUP SYSTEM.....	3/4 7-19
3/4.7.9 SNUBBERS:.....	3/4 7-21
3/4.7.10 SEALED SOURCE CONTAMINATION.....	3/4 7-27
3/4.7.11 FIRE SUPPRESSION SYSTEMS	
FIRE SUPPRESSION WATER SYSTEM.....	3/4 7-29
SPRAY AND/OR SPRINKLER SYSTEMS.....	3/4 7-32
CO <sub>2</sub> SYSTEMS.....	3/4 7-35
FIRE HOSE STATIONS.....	3/4 7-37
YARD FIRE HYDRANTS AND HYDRANT HOSE HOUSES.....	3/4 7-40
HALON	3/4
3/4.7.12 FIRE-RATED ASSEMBLIES.....	3/4 7-42
3/4.7.13 SHUTDOWN COOLING SYSTEM.....	3/4 7-44
3/4.7.14 CONTROL ROOM AIR TEMPERATURE.....	3/4 7-45
<u>3/4.8 ELECTRICAL POWER SYSTEMS</u>	
3/4.8.1 A.C. SOURCES	
OPERATING.....	3/4 8-1
SHUTDOWN.....	3/4 8-8

## INDEX

### LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

<u>SECTION</u>	<u>PAGE</u>
<u>ELECTRICAL POWER SYSTEMS (Continued)</u>	
3/4.8.2 D.C. SOURCES	
OPERATING.....	3/4 8-9
SHUTDOWN.....	3/4 8-13
3/4.8.3 ONSITE POWER DISTRIBUTION SYSTEMS	
OPERATING.....	3/4 8-14
SHUTDOWN.....	3/4 8-16
3/4.8.4 ELECTRICAL EQUIPMENT PROTECTIVE DEVICES	
CONTAINMENT PENETRATION CONDUCTOR OVERCURRENT PROTECTIVE DEVICES.....	3/4 8-17
MOTOR-OPERATED VALVES THERMAL OVERLOAD PROTECTION AND BYPASS DEVICES.....	3/4 8-40
<u>3/4.9 REFUELING OPERATIONS</u>	
3/4.9.1 BORON CONCENTRATION.....	3/4 9-1
3/4.9.2 INSTRUMENTATION.....	3/4 9-2
3/4.9.3 DECAY TIME.....	3/4 9-3
3/4.9.4 CONTAINMENT BUILDING PENETRATIONS.....	3/4 9-4
3/4.9.5 COMMUNICATIONS.....	3/4 9-5
3/4.9.6 REFUELING MACHINE.....	3/4 9-6
3/4.9.7 CRANE TRAVEL - SPENT FUEL STORAGE POOL BUILDING.....	3/4 9-7
3/4.9.8 SHUTDOWN COOLING AND COOLANT CIRCULATION	
HIGH WATER LEVEL.....	3/4 9-8
LOW WATER LEVEL.....	3/4 9-9
3/4.9.9 CONTAINMENT PURGE VALVE ISOLATION SYSTEM.....	3/4 9-10
3/4.9.10 WATER LEVEL - REACTOR VESSEL	
FUEL ASSEMBLIES.....	3/4 9-11
CEAs.....	3/4 9-12
3/4.9.11 WATER LEVEL - STORAGE POOL.....	3/4 9-13
3/4.9.12 FUEL BUILDING ESSENTIAL VENTILATION SYSTEM.....	3/4 9-14
<u>3/4.10 SPECIAL TEST EXCEPTIONS</u>	
3/4.10.1 SHUTDOWN MARGIN.....	3/4 10-1
3/4.10.2 MODERATOR TEMPERATURE COEFFICIENT, GROUP HEIGHT, INSERTION, AND POWER DISTRIBUTION LIMITS.....	3/4 10-2
3/4.10.3 REACTOR COOLANT LOOPS.....	3/4 10-3

FINAL DRAFT

INDEX

LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

<u>SECTION</u>	<u>PAGE</u>
3/4.10.4 CEA POSITION, REGULATING CEA INSERTION LIMITS AND REACTOR COOLANT COLD LEG TEMPERATURE.....	3/4 10-4
3/4.10.5 MINIMUM TEMPERATURE FOR CRITICALITY.....	3/4 10-5
3/4.10.6 SAFETY INJECTION TANKS.....	3/4 10-6
3/4.10.7 SPENT FUEL POOL LEVEL.....	3/4 10-7
3/4.10.8 SAFETY INJECTION TANK PRESSURE.....	3/4 10-8
<u>3/4.11 RADIOACTIVE EFFLUENTS</u>	
3/4.11.1 SECONDARY SYSTEM LIQUID WASTE DISCHARGES TO ONSITE EVAPORATION PONDS	
CONCENTRATION.....	3/4 11-1
DOSE.....	3/4 11-5
LIQUID HOLDUP TANKS.....	3/4 11-6
3/4.11.2 GASEOUS EFFLUENTS	
DOSE RATE.....	3/4 11-7
DOSE - NOBLE GASES.....	3/4 11-11
DOSE - IODINE-131, IODINE-133, TRITIUM, AND RADIONUCLIDES IN PARTICULATE FORM.....	3/4 11-12
GASEOUS RADWASTE TREATMENT.....	3/4 11-13
EXPLOSIVE GAS MIXTURE.....	3/4 11-14
GAS STORAGE TANKS.....	3/4 11-15
3/4.11.3 SOLID RADIOACTIVE WASTE.....	3/4 11-16
3/4.11.4 TOTAL DOSE.....	3/4 11-18
<u>3/4.12 RADIOLOGICAL ENVIRONMENTAL MONITORING</u>	
3/4.12.1 MONITORING PROGRAM.....	3/4 12-1
3/4.12.2 LAND USE CENSUS.....	3/4 12-11
3/4.12.3 INTERLABORATORY COMPARISON PROGRAM.....	3/4 12-12

FINAL DRAFT

INDEX

BASES

---

<u>SECTION</u>	<u>PAGE</u>
<u>3/4.0 APPLICABILITY</u> .....	B 3/4 0-1
<u>3/4.1 REACTIVITY CONTROL SYSTEMS</u>	
3/4.1.1 BORATION CONTROL.....	B 3/4 1-1
3/4.1.2 BORATION SYSTEMS.....	B 3/4 1-2
3/4.1.3 MOVABLE CONTROL ASSEMBLIES.....	B 3/4 1-4
<u>3/4.2 POWER DISTRIBUTION LIMITS</u>	
3/4.2.1 LINEAR HEAT RATE.....	B 3/4 2-1
3/4.2.2 PLANAR RADIAL PEAKING FACTORS.....	B 3/4 2-2
3/4.2.3 AZIMUTHAL POWER TILT.....	B 3/4 2-2
3/4.2.4 DNBR MARGIN.....	B 3/4 2-3
3/4.2.5 RCS FLOW RATE.....	B 3/4 2-4
3/4.2.6 REACTOR COOLANT COLD LEG TEMPERATURE.....	B 3/4 2-4
3/4.2.7 AXIAL SHAPE INDEX.....	B 3/4 2-4
3/4.2.8 PRESSURIZER PRESSURE.....	B 3/4 2-4
<u>3/4.3 INSTRUMENTATION</u>	
3/4.3.1 and 3/4.3.2 REACTOR PROTECTIVE AND ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION.....	B 3/4 3-1
3/4.3.3 MONITORING INSTRUMENTATION.....	B 3/4 3-1

## INDEX

### BASES

<u>SECTION</u>	<u>PAGE</u>
<u>3/4.4 REACTOR COOLANT SYSTEM</u>	
3/4.4.1 REACTOR COOLANT LOOPS AND COOLANT CIRCULATION.....	B 3/4 4-1
3/4.4.2 SAFETY VALVES.....	B 3/4 4-1
3/4.4.3 PRESSURIZER.....	B 3/4 4-2
3/4.4.4 STEAM GENERATORS.....	B 3/4 4-3
3/4.4.5 REACTOR COOLANT SYSTEM LEAKAGE.....	B 3/4 4-4
3/4.4.6 CHEMISTRY.....	B 3/4 4-4
3/4.4.7 SPECIFIC ACTIVITY.....	B 3/4 4-5
3/4.4.8 PRESSURE/TEMPERATURE LIMITS.....	B 3/4 4-6
3/4.4.9 STRUCTURAL INTEGRITY.....	B 3/4 4-11
3/4.4.10 REACTOR COOLANT SYSTEM VENTS.....	B 3/4 4-11
<u>3/4.5 EMERGENCY CORE COOLING SYSTEMS (ECCS)</u>	
3/4.5.1 SAFETY INJECTION TANKS.....	B 3/4 5-1
3/4.5.2 and 3/4.5.3 ECCS SUBSYSTEMS.....	B 3/4 5-2
3/4.5.4 REFUELING WATER TANK.....	B 3/4 5-3

### CE-ATMOSPHERIC TYPE CONTAINMENT

<u>3/4.6 CONTAINMENT SYSTEMS</u>	
3/4.6.1 PRIMARY CONTAINMENT.....	B 3/4 6-1
3/4.6.2 DEPRESSURIZATION AND COOLING SYSTEMS.....	B 3/4 6-3
3/4.6.3 CONTAINMENT ISOLATION VALVES.....	B 3/4 6-4
3/4.6.4 COMBUSTIBLE GAS CONTROL.....	B 3/4 6-4



## INDEX

### BASES

<u>SECTION</u>	<u>PAGE</u>
<u>3/4.7 PLANT SYSTEMS</u>	
3/4.7.1 TURBINE CYCLE.....	B 3/4 7-1
3/4.7.2 STEAM GENERATOR PRESSURE/TEMPERATURE LIMITATION.....	B 3/4 7-3
3/4.7.3 ESSENTIAL COOLING WATER SYSTEM.....	B 3/4 7-3
3/4.7.4 ESSENTIAL SPRAY POND SYSTEM.....	B 3/4 7-4
3/4.7.5 ULTIMATE HEAT SINK.....	B 3/4 7-4
3/4.7.6 ESSENTIAL CHILLED WATER SYSTEM.....	B 3/4 7-4
3/4.7.7 CONTROL ROOM ESSENTIAL FILTRATION SYSTEM.....	B 3/4 7-5
3/4.7.8 ESF PUMP ROOM AIR EXHAUST CLEANUP SYSTEM.....	B 3/4 7-5
3/4.7.9 SNUBBERS.....	B 3/4 7-5
3/4.7.10 SEALED SOURCE CONTAMINATION.....	B 3/4 7-7
3/4.7.11 FIRE SUPPRESSION SYSTEMS.....	B 3/4 7-7
3/4.7.12 FIRE-RATED ASSEMBLIES.....	B 3/4 7-8
3/4.7.13 SHUTDOWN COOLING SYSTEM.....	B 3/4 7-8
3/4.7.14 CONTROL ROOM AIR TEMPERATURE.....	B 3/4 7-8
<u>3/4.8 ELECTRICAL POWER SYSTEMS</u>	
3/4.8.1, 3/4.8.2, and 3/4.8.3 A.C. SOURCES, D.C. SOURCES, and ONSITE POWER DISTRIBUTION SYSTEMS.....	B 3/4 8-1
3/4.8.4 ELECTRICAL EQUIPMENT PROTECTIVE DEVICES.....	B 3/4 8-3
<u>3/4.9 REFUELING OPERATIONS</u>	
3/4.9.1 BORON CONCENTRATION.....	B 3/4 9-1
3/4.9.2 INSTRUMENTATION.....	B 3/4 9-1
3/4.9.3 DECAY TIME.....	B 3/4 9-1
3/4.9.4 CONTAINMENT BUILDING PENETRATIONS.....	B 3/4 9-1
3/4.9.5 COMMUNICATIONS.....	B 3/4 9-1

## INDEX

### BASES

<u>SECTION</u>	<u>PAGE</u>
3/4.9.6 REFUELING MACHINE.....	B 3/4 9-2
3/4.9.7 CRANE TRAVEL - SPENT FUEL STORAGE POOL BUILDING.....	B 3/4 9-2
3/4.9.8 SHUTDOWN COOLING AND COOLANT CIRCULATION.....	B 3/4 9-2
3/4.9.9 CONTAINMENT PURGE VALVE ISOLATION SYSTEM.....	B 3/4 9-2
3/4.9.10 and 3/4.9.11 WATER LEVEL - REACTOR VESSEL and STORAGE POOL .....	B 3/4 9-3
3/4.9.12 FUEL BUILDING ESSENTIAL VENTILATION SYSTEM.....	B 3/4 9-3
<u>3/4.10 SPECIAL TEST EXCEPTIONS</u>	
3/4.10.1 SHUTDOWN MARGIN.....	B 3/4 10-1
3/4.10.2 MODERATOR TEMPERATURE COEFFICIENT, GROUP HEIGHT, INSERTION, AND POWER DISTRIBUTION LIMITS.....	B 3/4 10-1
3/4.10.3 REACTOR COOLANT LOOPS.....	B 3/4 10-1
3/4.10.4 CEA POSITION, REGULATING CEA INSERTION LIMITS AND REACTOR COOLANT COLD LEG TEMPERATURE.....	B 3/4 10-1
3/4.10.5 MINIMUM TEMPERATURE FOR CRITICALITY.....	B 3/4 10-1
3/4.10.6 SAFETY INJECTION TANKS.....	B 3/4 10-2
3/4.10.7 SPENT FUEL POOL LEVEL.....	B 3/4 10-2
3/4.10.8 SAFETY INJECTION TANK PRESSURE.....	B 3/4 10-2
<u>3/4.11 RADIOACTIVE EFFLUENTS</u>	
3/4.11.1 SECONDARY SYSTEM LIQUID WASTE DISCHARGES TO ONSITE EVAPORATION PONDS.....	B 3/4 11-1
3/4.11.2 GASEOUS EFFLUENTS.....	B 3/4 11-2
3/4.11.3 SOLID RADIOACTIVE WASTE.....	B 3/4 11-5
3/4.11.4 TOTAL DOSE.....	B 3/4 11-5
<u>3/4.12 RADIOLOGICAL ENVIRONMENTAL MONITORING</u>	
3/4.12.1 MONITORING PROGRAM.....	B 3/4 12-1
3/4.12.2 LAND USE CENSUS.....	B 3/4 12-2
3/4.12.3 INTERLABORATORY COMPARISON PROGRAM.....	B 3/4 12-2



FINAL DRAFT

INDEX

DESIGN FEATURES

---

<u>SECTION</u>	<u>PAGE</u>
<u>5.1 SITE</u>	
5.1.1 SITE AND EXCLUSION BOUNDARIES.....	5-1
5.1.2 LOW POPULATION ZONE.....	5-1
5.1.3 GASEOUS RELEASE POINTS.....	5-1
<u>5.2 CONTAINMENT</u>	
5.2.1 CONFIGURATION.....	5-1
5.2.2 DESIGN PRESSURE AND TEMPERATURE.....	5-1
<u>5.3 REACTOR CORE</u>	
5.3.1 FUEL ASSEMBLIES.....	5-5
5.3.2 CONTROL ELEMENT ASSEMBLIES.....	5-5
<u>5.4 REACTOR COOLANT SYSTEM</u>	
5.4.1 DESIGN PRESSURE AND TEMPERATURE.....	5-5
5.4.2 VOLUME.....	5-5
<u>5.5 METEOROLOGICAL TOWER LOCATION.....</u>	5-6
<u>5.6 FUEL STORAGE</u>	
5.6.1 CRITICALITY.....	5-6
5.6.2 DRAINAGE.....	5-6
5.6.3 CAPACITY.....	5-6
<u>5.7 COMPONENT CYCLIC OR TRANSIENT LIMIT.....</u>	5-6

## INDEX

### ADMINISTRATIVE CONTROLS

---

<u>SECTION</u>	<u>PAGE</u>
<u>6.1 RESPONSIBILITY</u> .....	6-1
<u>6.2 ORGANIZATION</u>	
6.2.1 OFFSITE.....	6-1
6.2.2 UNIT STAFF.....	6-1
6.2.3 INDEPENDENT SAFETY ENGINEERING GROUP	
FUNCTION.....	6-6
COMPOSITION.....	6-6
RESPONSIBILITIES.....	6-6
AUTHORITY.....	6-6
RECORDS.....	6-6
6.2.4 SHIFT TECHNICAL ADVISOR.....	6-6
<u>6.3 UNIT STAFF QUALIFICATIONS</u> .....	6-6
<u>6.4 TRAINING</u> .....	6-7
<u>6.5 REVIEW AND AUDIT</u>	
6.5.1 PLANT REVIEW BOARD	
FUNCTION.....	6-7
COMPOSITION.....	6-7
ALTERNATES.....	6-7
MEETING FREQUENCY.....	6-7
QUORUM.....	6-8
RESPONSIBILITIES.....	6-8
AUTHORITY.....	6-9
RECORDS.....	6-9
6.5.2 TECHNICAL REVIEW AND CONTROL.....	6-9

## INDEX

### ADMINISTRATIVE CONTROLS

---

<u>SECTION</u>	<u>PAGE</u>
6.5.3 NUCLEAR SAFETY GROUP	
FUNCTION.....	6-10
COMPOSITION.....	5-10
CONSULTANTS.....	6-10
REVIEW.....	6-10
AUDITS.....	6-11
AUTHORITY.....	6-12
RECORDS.....	6-12
<u>6.6 REPORTABLE EVENT ACTION.....</u>	6-12
<u>6.7 SAFETY LIMIT VIOLATION.....</u>	6-12
<u>6.8 PROCEDURES AND PROGRAMS.....</u>	6-13
<u>6.9 REPORTING REQUIREMENTS</u>	
6.9.1 ROUTINE REPORTS.....	6-16
STARTUP REPORT.....	6-16
ANNUAL REPORTS.....	6-16
MONTHLY OPERATING REPORT.....	6-17
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT.....	6-17
SEMIANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT.....	6-18
6.9.2 SPECIAL REPORTS.....	6-19
<u>6.10 RECORD RETENTION.....</u>	6-20
<u>6.11 RADIATION PROTECTION PROGRAM.....</u>	6-21
<u>6.12 HIGH RADIATION AREA.....</u>	6-21
<u>6.13 PROCESS CONTROL PROGRAM.....</u>	6-22

**FINAL DRAFT**

INDEX

ADMINISTRATIVE CONTROLS

---

<u>SECTION</u>	<u>PAGE</u>
6.14 <u>OFFSITE DOSE CALCULATION MANUAL</u> .....	6-23
6.15 <u>MAJOR CHANGES TO RADIOACTIVE LIQUID, GASEOUS, AND SOLID WASTE TREATMENT SYSTEMS</u> .....	6-23
6.16 <u>PRE-PLANNED, ALTERNATE SAMPLING PROGRAM</u> .....	6-24





# FINAL DRAFT

## INDEX

### LIST OF FIGURES

		PAGE
3.1-1	ALLOWABLE MTC MODES 1 AND 2.....	3/4 1-5
3.1-2	MINIMUM BORATED WATER VOLUMES.....	3/4 1-12
3.1-2A	PART LENGTH CEA INSERTION LIMIT VS. THERMAL POWER.....	3/4 1-23
3.1-2B	CORE POWER LIMIT AFTER CEA DEVIATION.....	3/4 1-24
3.1-3	CEA INSERTION LIMITS VS THERMAL POWER (COLSS IN SERVICE).....	3/4 1-31
3.1-4	CEA INSERTION LIMITS VS THERMAL POWER (COLSS OUT OF SERVICE).....	3/4 1-32
3.2-1	DNBR MARGIN OPERATING LIMIT BASED ON COLSS (COLSS IN SERVICE).....	3/4 2-6
3.2-2	DNBR MARGIN OPERATING LIMIT BASED ON CORE PROTECTION CALCULATOR (COLSS OUT OF SERVICE).....	3/4 2-7
3.2-3	REACTOR COOLANT COLD LEG TEMPERATURE VS CORE POWER LEVEL.....	3/4 2-10
3.3-1	DNBR MARGIN OPERATING LIMIT BASED ON COLSS FOR BOTH CEAC'S INOPERABLE.....	3/4 3-10
3.4-1	DOSE EQUIVALENT I-131 PRIMARY COOLANT SPECIFIC ACTIVITY LIMIT VERSUS PERCENT OF RATED THERMAL POWER WITH THE PRIMARY COOLANT SPECIFIC ACTIVITY > 1.0 $\mu$ Ci/GRAM DOSE EQUIVALENT I-131.....	3/4 4-28
3.4-2	REACTOR COOLANT SYSTEM PRESSURE TEMPERATURE LIMITATIONS FOR 0 TO 10 YEARS OF FULL POWER OPERATION.....	3/4 4-30
4.7-1	SAMPLING PLAN FOR SNUBBER FUNCTIONAL TEST.....	3/4 7-26
B 3/4.4-1	NIL-DUCTILITY TRANSITION TEMPERATURE INCREASE AS A FUNCTION OF FAST (E > 1 MeV) NEUTRON FLUENCE (550°F IRRADIATION).....	B 3/4 4-10
5.1-1	SITE AND EXCLUSION BOUNDARIES.....	5-2
5.1-2	LOW POPULATION ZONE.....	5-3
5.1-3	GASEOUS RELEASE POINTS.....	5-4
6.2-1	OFFSITE ORGANIZATION.....	6-3
6.2-2	ONSITE UNIT ORGANIZATION.....	6-4

# INDEX

FINAL DRAFT

## LIST OF TABLES

	PAGE
1.1 FREQUENCY NOTATION.....	1-8
1.2 OPERATIONAL MODES.....	1-9
2.2-1 REACTOR PROTECTIVE INSTRUMENTATION TRIP SETPOINT LIMITS.....	2-3
2.2-2 CORE PROTECTION CALCULATOR ADDRESSABLE CONSTANTS.....	2-7
REQUIRED MONITORING FREQUENCIES FOR BACKUP BORON DILUTION DETECTION AS A FUNCTION OF OPERATING CHARGING PUMPS AND PLANT OPERATIONAL MODES.....	
3.1-1 FOR $K_{eff} > 0.98$ .....	3/4 1-16
3.1-2 FOR $0.98 \geq K_{eff} > 0.97$ .....	3/4 1-17
3.1-3 FOR $0.97 \geq K_{eff} > 0.96$ .....	3/4 1-18
3.1-4 FOR $0.96 \geq K_{eff} > 0.95$ .....	3/4 1-19
3.1-5 FOR $K_{eff} \leq 0.95$ .....	3/4 1-20
3.3-1 REACTOR PROTECTIVE INSTRUMENTATION.....	3/4 3-3
3.3-2 REACTOR PROTECTIVE INSTRUMENTATION RESPONSE TIMES.....	3/4 3-11
3.3-2a INCREASES IN BERRO, BERR2, AND BERR4 VERSUS RTD DELAY TIMES.....	3/4 3-13
4.3-1 REACTOR PROTECTIVE INSTRUMENTATION SURVEILLANCE REQUIREMENTS.....	3/4 3-14
3.3-3 ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION.....	3/4 3-18
3.3-4 ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION TRIP VALUES.....	3/4 3-25
3.3-5 ENGINEERED SAFETY FEATURES RESPONSE TIMES.....	3/4 3-28
4.3-2 ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION SURVEILLANCE REQUIREMENTS.....	3/4 3-31
3.3-6 RADIATION MONITORING INSTRUMENTATION.....	3/4 3-38
4.3-3 RADIATION MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS.....	3/4 3-40
3.3-7 SEISMIC MONITORING INSTRUMENTATION.....	3/4 3-43
4.3-4 SEISMIC MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS.....	3/4 3-44
3.3-8 METEOROLOGICAL MONITORING INSTRUMENTATION.....	3/4 3-46
4.3-5 METEOROLOGICAL MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS.....	3/4 3-47
3.3-9 REMOTE SHUTDOWN INSTRUMENTATION.....	3/4 3-49



## INDEX

### LIST OF TABLES

	<u>PAGE</u>
4.3-6 REMOTE SHUTDOWN INSTRUMENTATION SURVEILLANCE REQUIREMENTS.....	3/4 3-56
3.3-10 POST-ACCIDENT MONITORING INSTRUMENTATION.....	3/4 3-58
4.3-7 POST-ACCIDENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS.....	3/4 3-59
3.3-11 FIRE DETECTION INSTRUMENTS.....	3/4 3-61
3.3-12 LOOSE PARTS SENSOR LOCATIONS.....	3/4 3-69
3.3-13 RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION.....	3/4 3-71
4.3-8 RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS.....	3/4 3-76
4.4-1 MINIMUM NUMBER OF STEAM GENERATORS TO BE INSPECTED DURING INSERVICE INSPECTION.....	3/4 4-16
4.4-2 STEAM GENERATOR TUBE INSPECTION.....	3/4 4-17
3.4-1 REACTOR COOLANT SYSTEM PRESSURE ISOLATION VALVES.....	3/4 4-21
3.4-2 REACTOR COOLANT SYSTEM CHEMISTRY.....	3/4 4-23
4.4-3 REACTOR COOLANT SYSTEM CHEMISTRY LIMITS SURVEILLANCE REQUIREMENTS.....	3/4 4-24
4.4-4 PRIMARY COOLANT SPECIFIC ACTIVITY SAMPLE AND ANALYSIS PROGRAM.....	3/4 4-27
4.4-5 REACTOR VESSEL MATERIAL SURVEILLANCE PROGRAM WITHDRAWAL SCHEDULE.....	3/4 4-31
4.6-1 TENDON SURVEILLANCE - FIRST YEAR.....	3/4 6-12
4.6-2 TENDON LIFT-OFF FORCE - FIRST YEAR.....	3/4 6-13
3.6-1 CONTAINMENT ISOLATION VALVES.....	3/4 6-21
3.7-1 STEAM LINE SAFETY VALVES PER LOOPS.....	3/4 7-2

# FINAL DRAFT

## INDEX

### LIST OF TABLES

	<u>PAGE</u>
3.7-2 MAXIMUM ALLOWABLE VARIABLE STEADY STATE POWER LEVEL AND OVERPOWER HIGH TRIP SETPOINT WITH INOPERABLE STEAM LINE SAFETY VALVES DURING TWO LOOP OPERATION WITH FOUR PUMPS OPERATING.....	3/4 7-3
4.7-1 SECONDARY COOLANT SYSTEM SPECIFIC ACTIVITY SAMPLE AND ANALYSIS PROGRAM.....	3/4 7-8
3.7-3 SPRAY AND/OR SPRINKLER SYSTEMS.....	3/4 7-34
3.7-4 FIRE HOSE STATIONS.....	3/4 7-39
3.7-5 YARD FIRE HYDRANTS AND ASSOCIATED HYDRANT HOSE HOUSES.....	3/4 7-41
4.8-1 DIESEL GENERATOR TEST SCHEDULE.....	3/4 8-7
3.8-1 D.C. ELECTRICAL SOURCES.....	3/4 8-11
4.8-2 BATTERY SURVEILLANCE REQUIREMENTS.....	3/4 8-12
3.8-2 CONTAINMENT PENETRATION CONDUCTOR OVERCURRENT PROTECTIVE DEVICES.....	3/4 8-19
3.8-3 MOTOR-OPERATED VALVES THERMAL OVERLOAD PROTECTION AND/OR BYPASS DEVICES.....	3/4 8-41
4.11-1 RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS PROGRAM..	3/4 11-2
4.11-2 RADIOACTIVE GASEOUS WASTE SAMPLING AND ANALYSIS PROGRAM.....	3/4 11-8
3.12-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM.....	3/4 12-3
3.12-2 REPORTING LEVELS FOR RADIOACTIVITY CONCENTRATIONS IN ENVIRONMENTAL SAMPLES.....	3/4 12-7
4.12-1 DETECTION CAPABILITIES FOR ENVIRONMENTAL SAMPLE ANALYSIS.....	3/4 12-8
B 3/4.4-1 REACTOR VESSEL TOUGHNESS.....	B 3/4 4-8
5.7-1 COMPONENT CYCLIC OR TRANSIENT LIMITS.....	5-7
5.7-2 PRESSURIZER SPRAY NOZZLE USAGE FACTOR.....	5-9
6.2-1 MINIMUM SHIFT CREW COMPOSITION.....	6-5

## 1.0 DEFINITIONS

---

The defined terms of this section appear in capitalized type and are applicable throughout these Technical Specifications.

### ACTION

1.1 ACTION shall be that part of a specification which prescribes remedial measures required under designated conditions.

### AXIAL SHAPE INDEX

1.2 The AXIAL SHAPE INDEX shall be the power generated in the lower half of the core less the power generated in the upper half of the core divided by the sum of these powers.

### AZIMUTHAL POWER TILT - $T_q$

1.3 AZIMUTHAL POWER TILT shall be the power asymmetry between azimuthally symmetric fuel assemblies.

### CHANNEL CALIBRATION

1.4 A CHANNEL CALIBRATION shall be the adjustment, as necessary, of the channel output such that it responds with the necessary range and accuracy to known values of the parameter which the channel monitors. The CHANNEL CALIBRATION shall encompass the entire channel including the sensor and alarm and/or trip functions, and shall include the CHANNEL FUNCTIONAL TEST. The CHANNEL CALIBRATION may be performed by any series of sequential, overlapping, or total channel steps such that the entire channel is calibrated.

### CHANNEL CHECK

1.5 A CHANNEL CHECK shall be the qualitative assessment of channel behavior during operation by observation. This determination shall include, where possible, comparison of the channel indication and/or status with other indications and/or status derived from independent instrument channels measuring the same parameter.

## DEFINITIONS

### CHANNEL FUNCTIONAL TEST

1.6 A CHANNEL FUNCTIONAL TEST shall be:

- a. Analog channels - the injection of a simulated signal into the channel as close to the sensor as practicable to verify OPERABILITY including alarm and/or trip functions.
- b. Bistable channels - the injection of a simulated signal into the sensor to verify OPERABILITY including alarm and/or trip functions.
- c. Digital computer channels - the exercising of the digital computer hardware using diagnostic programs and the injection of simulated process data into the channel to verify OPERABILITY including alarm and/or trip functions.
- d. Radiological effluent process monitoring channels - the CHANNEL FUNCTIONAL TEST may be performed by any series of sequential, overlapping, or total channel steps such that the entire channel is functionally tested.

The CHANNEL FUNCTIONAL TEST shall include adjustment, as necessary, of the alarm, interlock and/or trip setpoints such that the setpoints are within the required range and accuracy.

### CONTAINMENT INTEGRITY

1.7 CONTAINMENT INTEGRITY shall exist when:

- a. All penetrations required to be closed during accident conditions are either:
  1. Capable of being closed by an OPERABLE containment automatic isolation valve system, or
  2. Closed by manual valves, blind flanges, or deactivated automatic valves secured in their closed positions, except as provided in Table 3.6-4 of Specification 3.6.3.1.
- b. All equipment hatches are closed and sealed,
- c. Each air lock is in compliance with the requirements of Specification 3.6.1.3,
- d. The containment leakage rates are within the limits of Specification 3.6.1.2, and
- e. The sealing mechanism associated with each penetration (e.g., welds, bellows or O-rings) is OPERABLE.

### CONTROLLED LEAKAGE

1.8 Not Applicable.

### CORE ALTERATION

1.9 CORE ALTERATION shall be the movement or manipulation of any component within the reactor pressure vessel with the vessel head removed and fuel in the vessel. Suspension of CORE ALTERATION shall not preclude completion of movement of a component to a safe conservative position.

## DEFINITIONS

### DOSE EQUIVALENT I-131

1.10 DOSE EQUIVALENT I-131 shall be that concentration of I-131 (microcuries/gram) which alone would produce the same thyroid dose as the quantity and isotopic mixture of I-131, I-132, I-133, I-134 and I-135 actually present. The thyroid dose conversion factors used for this calculation shall be those listed in Table III of TID-14844, "Calculation of Distance Factors for Power and Test Reactor Sites."

### $\bar{E}$ - AVERAGE DISINTEGRATION ENERGY

1.11  $\bar{E}$  shall be the average (weighted in proportion to the concentration of each radionuclide in the reactor coolant at the time of sampling) of the sum of the average beta and gamma energies per disintegration (in MeV) for isotopes, other than iodines, with half-lives greater than 15 minutes, making up at least 95% of the total noniodine activity in the coolant.

### ENGINEERED SAFETY FEATURES RESPONSE TIME

1.12 The ENGINEERED SAFETY FEATURES RESPONSE TIME shall be that time interval from when the monitored parameter exceeds its ESF actuation setpoint at the channel sensor until the ESF equipment is capable of performing its safety function (i.e., the valves travel to their required positions, pump discharge pressures reach their required values, etc.). Times shall include diesel generator starting and sequence loading delays where applicable.

### FREQUENCY NOTATION

1.13 The FREQUENCY NOTATION specified for the performance of Surveillance Requirements shall correspond to the intervals defined in Table 1.1.

### GASEOUS RADWASTE SYSTEM

1.14 A GASEOUS RADWASTE SYSTEM shall be any system designed and installed to reduce radioactive gaseous effluents by collecting primary coolant system offgases from the primary system and providing for delay or holdup for the purpose of reducing the total radioactivity prior to release to the environment.

### IDENTIFIED LEAKAGE

1.15 IDENTIFIED LEAKAGE shall be:

- a. Leakage into closed systems, other than reactor coolant pump controlled bleed-off flow, such as pump seal or valve packing leaks that are captured and conducted to a sump or collecting tank, or
- b. Leakage into the containment atmosphere from sources that are both specifically located and known either not to interfere with the operation of leakage detection systems or not to be PRESSURE BOUNDARY LEAKAGE, or
- c. Reactor Coolant System leakage through a steam generator to the secondary system.





## DEFINITIONS

---

### MEMBER(S) OF THE PUBLIC

1.16 MEMBER(S) OF THE PUBLIC shall include all persons who are not occupationally associated with the plant. This category does not include employees of the licensee, its contractors, or vendors. Also excluded from this category are persons who enter the site to service equipment or to make deliveries. This category does include persons who use portions of the site for recreational, occupational, or other purposes not associated with the plant.

### OFFSITE DOSE CALCULATION MANUAL (ODCM)

1.17 The OFFSITE DOSE CALCULATION MANUAL shall contain the current methodology and parameters used in the calculation of offsite doses due to radioactive gaseous and liquid effluents, in the calculation of gaseous and liquid effluent monitoring alarm/trip setpoints, and in the conduct of the environmental radiological monitoring program.

### OPERABLE - OPERABILITY

1.18 A system, subsystem, train, component, or device shall be OPERABLE or have OPERABILITY when it is capable of performing its specified function(s), and when all necessary attendant instrumentation, controls, electrical power, cooling or seal water, lubrication or other auxiliary equipment that are required for the system, subsystem, train, component, or device to perform its function(s) are also capable of performing their related support function(s).

### OPERATIONAL MODE - MODE

1.19 An OPERATIONAL MODE (i.e. MODE) shall correspond to any one inclusive combination of core reactivity condition, power level, and cold leg reactor coolant temperature specified in Table 1.2.

### PHYSICS TESTS

1.20 PHYSICS TESTS shall be those tests performed to measure the fundamental nuclear characteristics of the reactor core and related instrumentation and (1) described in Chapter 14.0 of the FSAR, (2) authorized under the provisions of 10 CFR 50.59, or (3) otherwise approved by the Commission.

### PLANAR RADIAL PEAKING FACTOR - $F_{xy}$

1.21 The PLANAR RADIAL PEAKING FACTOR is the ratio of the peak to plane average power density of the individual fuel rods in a given horizontal plane, excluding the effects of azimuthal tilt.

### PRESSURE BOUNDARY LEAKAGE

1.22 PRESSURE BOUNDARY LEAKAGE shall be leakage (except steam generator tube leakage) through a nonisolable fault in a Reactor Coolant System component body, pipe wall, or vessel wall.

**FINAL DRAFT**

## DEFINITIONS

### PROCESS CONTROL PROGRAM (PCP)

1.23 The PROCESS CONTROL PROGRAM shall contain the provisions to assure that the SOLIDIFICATION of wet radioactive wastes results in a waste form with properties that meet the requirements of 10 CFR Part 61 and of low level radioactive waste disposal sites. The PCP shall identify process parameters influencing SOLIDIFICATION such as pH, oil content, H<sub>2</sub>O content, solids content, ratio of solidification agent to waste and/or necessary additives for each type of anticipated waste, and the acceptable boundary conditions for the process parameters shall be identified for each waste type, based on laboratory scale and full-scale testing or experience. The PCP shall also include an identification of conditions that must be satisfied, based on full-scale testing, to assure that dewatering of bead resins, powdered resins, and filter sludges will result in volumes of free water, at the time of disposal, within the limits of 10 CFR Part 61 and of low level radioactive waste disposal sites.

### PURGE - PURGING

1.24 PURGE or PURGING shall be the controlled process of discharging air or gas from a confinement to maintain temperature, pressure, humidity, concentration, or other operating condition, in such a manner that replacement air or gas is required to purify the confinement.

### RATED THERMAL POWER

1.25 RATED THERMAL POWER shall be a total reactor core heat transfer rate to the reactor coolant of 3800 MWt.

### REACTOR TRIP SYSTEM RESPONSE TIME

1.26 The REACTOR TRIP SYSTEM RESPONSE TIME shall be the time interval from when the monitored parameter exceeds its trip setpoint at the channel sensor until electrical power is interrupted to the CEA drive mechanism.

### REPORTABLE EVENT

1.27 A REPORTABLE EVENT shall be any of those conditions specified in Section 50.73 to 10 CFR Part 50.

### SHUTDOWN MARGIN

1.28 SHUTDOWN MARGIN shall be the instantaneous amount of reactivity by which the reactor is subcritical or would be subcritical from its present condition assuming:

- a. No change in part-length control element assembly position, and
- b. All full-length control element assemblies (shutdown and regulating) are fully inserted except for the single assembly of highest reactivity worth which is assumed to be fully withdrawn.



## DEFINITIONS

---

### SITE BOUNDARY

1.29 The SITE BOUNDARY shall be that line beyond which the land is neither owned, nor leased, nor otherwise controlled by the licensee.

### SOFTWARE

1.30 The digital computer SOFTWARE for the reactor protection system shall be the program codes including their associated data, documentation, and procedures.

### SOLIDIFICATION

1.31 SOLIDIFICATION shall be the conversion of radioactive wastes from liquid systems to a homogeneous (uniformly distributed), monolithic, immobilized solid with definite volume and shape, bounded by a stable surface of distinct outline on all sides (free-standing).

### SOURCE CHECK

1.32 A SOURCE CHECK shall be the qualitative assessment of channel response when the channel sensor is exposed to a source of increased radioactivity.

### STAGGERED TEST BASIS

1.33 A STAGGERED TEST BASIS shall consist of:

- a. A test schedule for n systems, subsystems, trains, or other designated components obtained by dividing the specified test interval into n equal subintervals, and
- b. The testing of one system, subsystem, train, or other designated component at the beginning of each subinterval.

### THERMAL POWER

1.34 THERMAL POWER shall be the total reactor core heat transfer rate to the reactor coolant.

### UNIDENTIFIED LEAKAGE

1.35 UNIDENTIFIED LEAKAGE shall be all leakage which does not constitute either IDENTIFIED LEAKAGE or reactor coolant pump controlled bleed-off flow.

### UNRESTRICTED AREA

1.36 An UNRESTRICTED AREA shall be any area at or beyond the SITE BOUNDARY access to which is not controlled by the licensee for purposes of protection of individuals from exposure to radiation and radioactive materials, or any area within the SITE BOUNDARY used for residential quarters or for industrial, commercial, institutional, and/or recreational purposes.

## DEFINITIONS

---

### VENTILATION EXHAUST TREATMENT SYSTEM

1.37 A VENTILATION EXHAUST TREATMENT SYSTEM shall be any system designed and installed to reduce gaseous radioiodine or radioactive material in particulate form in effluents by passing ventilation or vent exhaust gases through charcoal adsorbers and/or HEPA filters for the purpose of removing iodines or particulates from the gaseous exhaust stream prior to the release to the environment. Such a system is not considered to have any effect on noble gas effluents. Engineered Safety Feature (ESF) atmospheric cleanup systems are not considered to be VENTILATION EXHAUST TREATMENT SYSTEM components.

### VENTING

1.38 VENTING shall be the controlled process of discharging air or gas from a confinement to maintain temperature, pressure, humidity, concentration, or other operating condition, in such a manner that replacement air or gas is not provided or required during VENTING. Vent, used in system names, does not imply a VENTING process.



## DEFINITIONS

TABLE 1.1  
FREQUENCY NOTATION

<u>NOTATION</u>	<u>FREQUENCY</u>
S	At least once per 12 hours.
D	At least once per 24 hours.
W	At least once per 7 days.
M	At least once per 31 days.
Q	At least once per 92 days.
SA	At least once per 184 days.
R	At least once per 18 months.
P	Completed prior to each release.
S/U	Prior to each reactor startup.
N.A.	Not applicable.
4M	AT LEAST 4 TIMES PER MONTH AT INTERVALS NO GREATER THAN 9 DAYS AND A MINIMUM OF 48 TIMES PER YEAR



# FINAL DRAFT

## DEFINITIONS

TABLE 1.2  
OPERATIONAL MODES

OPERATIONAL MODE	REACTIVITY CONDITION, $K_{eff}$	% OF RATED THERMAL POWER*	COLD LEG TEMPERATURE ( $T_{cold}$ )
1. POWER OPERATION	$\geq 0.99$	$> 5\%$	$\geq 350^{\circ}\text{F}$
2. STARTUP	$\geq 0.99$	$\leq 5\%$	$\geq 350^{\circ}\text{F}$
3. HOT STANDBY	$< 0.99$	0	$\geq 350^{\circ}\text{F}$
4. HOT SHUTDOWN	$< 0.99$	0	$350^{\circ} > T_{cold} > 210^{\circ}\text{F}$
5. COLD SHUTDOWN	$< 0.99$	0	$\leq 210^{\circ}\text{F}$
6. REFUELING**	$\leq 0.95$	0	$\leq 135^{\circ}\text{F}$

\*Excluding decay heat.

\*\*Fuel in the reactor vessel with the vessel head closure bolts less than fully tensioned or with the head removed.



FINAL DRAFT

## 2.0 SAFETY LIMITS AND LIMITING SAFETY SYSTEM SETTINGS

### 2.1 SAFETY LIMITS

#### 2.1.1 REACTOR CORE

##### DNBR

2.1.1.1 The calculated DNBR of the reactor core shall be maintained greater than or equal to 1.231.

APPLICABILITY: MODES 1 and 2.

##### ACTION:

Whenever the calculated DNBR of the reactor has decreased to less than 1.231, be in HOT STANDBY within 1 hour, and comply with the requirements of Specification 6.7.1.

##### PEAK LINEAR HEAT RATE

2.1.1.2 The peak linear heat rate (adjusted for fuel rod dynamics) of the fuel shall be maintained less than or equal to 21 kW/ft.

APPLICABILITY: MODES 1 and 2.

##### ACTION:

Whenever the peak linear heat rate (adjusted for fuel rod dynamics) of the fuel has exceeded 21 kW/ft, be in HOT STANDBY within 1 hour, and comply with the requirements of Specification 6.7.1.

#### REACTOR COOLANT SYSTEM PRESSURE

2.1.2 The Reactor Coolant System pressure shall not exceed 2750 psia.

APPLICABILITY: MODES 1, 2, 3, 4, and 5.

##### ACTION:

MODES 1 and 2:

Whenever the Reactor Coolant System pressure has exceeded 2750 psia, be in HOT STANDBY with the Reactor Coolant System pressure within its limit within 1 hour, and comply with the requirements of Specification 6.7.1.

MODES 3, 4, and 5:

Whenever the Reactor Coolant System pressure has exceeded 2750 psia, reduce the Reactor Coolant System pressure to within its limit within 5 minutes, and comply with the requirements of Specification 6.7.1.

## SAFETY LIMITS AND LIMITING SAFETY SYSTEM SETTINGS

### 2.2 LIMITING SAFETY SYSTEM SETTINGS

#### REACTOR TRIP SETPOINTS

2.2.1 The reactor protective instrumentation setpoints shall be set consistent with the Trip Setpoint values shown in Table 2.2-1.

APPLICABILITY: As shown for each channel in Table 3.3-1.

#### ACTION:

With a reactor protective instrumentation setpoint less conservative than the value shown in the Allowable Values column of Table 2.2-1, declare the channel inoperable and apply the applicable ACTION statement requirement of Specification 3.3.1 until the channel is restored to OPERABLE status with its trip setpoint adjusted consistent with the Trip Setpoint value.

#### CORE PROTECTION CALCULATOR ADDRESSABLE CONSTANTS

2.2.2 Core Protection Calculator Addressable Constants shall be in accordance with Table 2.2-2.

APPLICABILITY: As shown for Core Protection Calculators in Table 3.3-1.

#### ACTION:

With a Core Protection Calculator Addressable Constant less conservative than the value shown in the Allowable Value column of Table 2.2-2, declare the channel inoperable and apply the applicable ACTION statement requirement of Specification 3.3.1 until the channel is restored to OPERABLE status.

TABLE 2.2-1

REACTOR PROTECTIVE INSTRUMENTATION TRIP SETPOINT LIMITS

<u>FUNCTIONAL UNIT</u>	<u>TRIP SETPOINT</u>	<u>ALLOWABLE VALUES</u>
I. TRIP GENERATION		
A. Process		
1. Pressurizer Pressure - High	$\leq 2383$ psia	$\leq 2388$ psia
2. Pressurizer Pressure - Low	$\geq 1837$ psia (2)	$\geq 1822$ psia (2)
3. Steam Generator Level - Low	$\geq 44.2\%$ (4)	$\geq 43.7\%$ (4)
4. Steam Generator Level - High	$\leq 91.0\%$ (9)	$\leq 91.5\%$ (9)
5. Steam Generator Pressure - Low	$\geq 919$ psia (3)	$\geq 912$ psia (3)
6. Containment Pressure - High	$\leq 3.0$ psig	$\leq 3.2$ psig
7. Reactor Coolant Flow - Low		
a. Rate	$\leq 1.05\%/s$ (6)(7)	$\leq 1.10\%/s$ (6)(7)
b. Floor	$\geq 52.2\%$ (6)(7)	$\geq 47.2\%$ (6)(7)
c. Band	$\leq 40.0\%$ (6)(7)	$\leq 42.1\%$ (6)(7)
8. Local Power Density - High	$\leq 21.0$ kW/ft (5)	$\leq 21.0$ kW/ft (5)
9. DNBR - Low	$\geq 1.231$ (5)	$\geq 1.231$ (5)
B. Excore Neutron Flux		
1. Variable Overpower Trip		
a. Rate	$< 10.6\%/min$ of RATED THERMAL POWER (8)	$< 11.0\%/min$ of RATED THERMAL POWER (8)
b. Ceiling	$< 110.0\%$ of RATED THERMAL POWER (8)	$< 111.0\%$ of RATED THERMAL-POWER (8)
c. Band	$< 9.8\%$ of RATED THERMAL POWER (8)	$< 10.0\%$ of RATED THERMAL POWER (8)

FINAL  
DRAFT

TABLE 2.2-1 (Continued)

REACTOR PROTECTIVE INSTRUMENTATION TRIP SETPOINT LIMITS

<u>FUNCTIONAL UNIT</u>	<u>TRIP SETPOINT</u>	<u>ALLOWABLE VALUES</u>
2. Logarithmic Power Level - High (1)		
a. Startup and Operating	< 0.798% of RATED THERMAL POWER	< 0.895% of RATED THERMAL POWER
b. Shutdown	< 0.798% of RATED THERMAL POWER	< 0.895% of RATED THERMAL POWER
C. Core Protection Calculator System		
1. CEA Calculators	Not Applicable	Not Applicable
2. Core Protection Calculators	Not Applicable	Not Applicable
D. Supplementary Protection System		
Pressurizer Pressure - High	≤ 2409 psia	≤ 2414 psia
II. RPS LOGIC		
A. Matrix Logic	Not Applicable	Not Applicable
B. Initiation Logic	Not Applicable	Not Applicable
III. RPS ACTUATION DEVICES		
A. Reactor Trip Breakers	Not Applicable	Not Applicable
B. Manual Trip	Not Applicable	Not Applicable

END  
OF  
PAGE

TABLE 2.2-1 (Continued)

## REACTOR PROTECTIVE INSTRUMENTATION TRIP SETPOINT LIMITS

### TABLE NOTATIONS

- (1) Trip may be manually bypassed above 10<sup>-4</sup>% of RATED THERMAL POWER; bypass shall be automatically removed when THERMAL POWER is less than or equal to 10<sup>-4</sup>% of RATED THERMAL POWER.
- (2) In MODES 3-6, value may be decreased manually, to a minimum of 100 psia, as pressurizer pressure is reduced, provided the margin between the pressurizer pressure and this value is maintained at less than or equal to 400 psi; the setpoint shall be increased automatically as pressurizer pressure is increased until the trip setpoint is reached. Trip may be manually bypassed below 400 psia; bypass shall be automatically removed whenever pressurizer pressure is greater than or equal to 500 psia.
- (3) In MODES 3-6, value may be decreased manually as steam generator pressure is reduced, provided the margin between the steam generator pressure and this value is maintained at less than or equal to 200 psi; the setpoint shall be increased automatically as steam generator pressure is increased until the trip setpoint is reached.
- (4) % of the distance between steam generator upper and lower level wide range instrument nozzles.
- (5) As stored within the Core Protection Calculator (CPC). Calculation of the trip setpoint includes measurement, calculational and processor uncertainties, and dynamic allowances. Trip may be manually bypassed below 1% of RATED THERMAL POWER; bypass shall be automatically removed when THERMAL POWER is greater than or equal to 1% of RATED THERMAL POWER.

The approved DNBR limit is 1.231 which includes a partial rod bow penalty compensation. If the fuel burnup exceeds that for which an increased rod bow penalty is required, the DNBR limit shall be adjusted. In this case a DNBR trip setpoint of 1.231 is allowed provided that the difference is compensated by an increase in the CPC addressable constant BERR1 as follows:

$$BERR1_{new} = BERR1_{old} \left[ 1 + \frac{RB - RB_0}{100} \times \frac{\frac{d(POL)}{d(DNBR)}}{\frac{d(POL)}{d(DNBR)}} \right]$$

where  $BERR1_{old}$  is the uncompensated value of BERR1; RB is the fuel rod bow penalty in % DNBR;  $RB_0$  is the fuel rod bow penalty in % DNBR already accounted for in the DNBR limit; POL is the power operating limit; and  $d(POL)/d(DNBR)$  is the absolute value of the most adverse derivative of POL with respect to DNBR.





FINAL DRAFT

TABLE 2.2-1 (Continued)

REACTOR PROTECTIVE INSTRUMENTATION TRIP SETPOINT LIMITS

TABLE NOTATIONS (Continued)

- (6) RATE is the maximum rate of decrease of the trip setpoint.  
FLOOR is the minimum value of the trip setpoint.  
BAND is the amount by which the trip setpoint is below the input signal unless limited by Rate or Floor.  
Setpoints are % of 100% power flow conditions.
- (7) The setpoint may be altered to disable trip function during testing pursuant to Specification 3.10.3.
- (8) RATE is the maximum rate of increase of the trip setpoint. There are no restrictions on the rate at which the setpoint can decrease.  
CEILING is the maximum value of the trip setpoint.  
BAND is the amount by which the trip setpoint is above the input signal unless limited by the rate or the ceiling.
- (9) % of the distance between steam generator upper and lower level narrow range instrument nozzles.

THERE ARE NO RESTRICTIONS ON THE  
RATE AT WHICH THE SETPOINT CAN INCREASE

TABLE 2.2-2

CORE PROTECTION CALCULATOR ADDRESSABLE CONSTANTS

I. TYPE I ADDRESSABLE CONSTANTS

<u>POINT ID NUMBER</u>	<u>PROGRAM LABEL</u>	<u>DESCRIPTION</u>	<u>ALLOWABLE VALUE</u>
60	FC1	Core coolant mass flow rate calibration constant	$\leq 1.15$
61	FC2	Core coolant mass flow rate calibration constant	$\leq 0.0$
62	CEANOP	CEAC/RSPT inoperable flag	0, 1, 2 or 3
63	TR	Azimuthal tilt allowance	$\geq 1.02$
64	TPC	Thermal power calibration constant	$\geq 0.90$
65	KCAL	Neutron flux power calibration constant	$\geq 0.85$
66	DNBRPT	DNBR pretrip setpoint	Unrestricted
67	LPDPT	Local power density pretrip setpoint	Unrestricted

II. TYPE II ADDRESSABLE CONSTANTS

<u>POINT ID NUMBER</u>	<u>PROGRAM LABEL</u>	<u>DESCRIPTION</u>
071	BERR3	Power uncertainty factor used in local power density calculation
072	BERR4	Power uncertainty bias used in local power density calculation
073	EOL	End of life flag
074	ARM1	Multipliers for planar radial peaking factors
075	ARM2	
076	ARM3	
077	ARM4	
078	ARM5	
079	ARM6	
080	ARM7	

TABLE 2.2-2 (Continued)

CORE PROTECTION CALCULATOR ADDRESSABLE CONSTANTS

II. TYPE II ADDRESSABLE CONSTANTS (Continued)

<u>POINT ID NUMBER</u>	<u>PROGRAM LABEL</u>	<u>DESCRIPTION</u>
081	SC11	
082	SC12	
083	SC13	
084	SC21	
085	SC22	Shape annealing correction matrix
086	SC23	
087	SC31	
088	SC32	
089	SC33	
090	PFMLTD	DNBR penalty factor multiplier
091	PFMLTL	Local power density penalty factor multiplier
092	ASM2	Multipliers for CEA shadowing factors
093	ASM3	
094	ASM4	
095	ASM5	
096	ASM6	
097	ASM7	
098	CORR1	Slope of the temperature shadowing correction factor ( $C_{t1}$ )
099	BPPCC1	Boundary Point Power Correlation Coefficients
100	BPPCC2	
101	BPPCC3	
102	BPPCC4	
103	RPCLIM	Reactor Power Cutback Time Limit
<u>CEAC Addressable Constant Value</u>		
295	TCBP	RPC Max Time (only addressable via operator module)
068	BERR0	Thermal power uncertainty bias used in DNBR calculation
069	BERR1	Power uncertainty factor used in DNBR calculation
070	BERR2	Neutron flux power uncertainty bias used in DNBR calculation



FINAL DRAFT

BASES  
FOR  
SECTION 2.0  
SAFETY LIMITS  
AND  
LIMITING SAFETY SYSTEM SETTINGS



FINAL DRAFT

NOTE

The BASES contained in the succeeding pages summarize the reasons for the specifications of Section 2.0 but in accordance with 10 CFR 50.36 are not a part of these Technical Specifications.

## 2.1 and 2.2 SAFETY LIMITS AND LIMITING SAFETY SYSTEM SETTINGS

### BASES

---

#### 2.1.1 REACTOR CORE

The restrictions of these safety limits prevent overheating of the fuel cladding and possible cladding perforation which would result in the release of fission products to the reactor coolant. Overheating of the fuel cladding is prevented by (1) restricting fuel operation to within the nucleate boiling regime where the heat transfer coefficient is large and the cladding surface temperature is slightly above the coolant saturation temperature, and (2) maintaining the dynamically adjusted peak linear heat rate of the fuel at or less than 21 kW/ft which will not cause fuel centerline melting in any fuel rod.

First, by operating within the nucleate boiling regime of heat transfer, the heat transfer coefficient is large enough so that the maximum clad surface temperature is only slightly greater than the coolant saturation temperature. The upper boundary of the nucleate boiling regime is termed "departure from nucleate boiling" (DNB). At this point, there is a sharp reduction of the heat transfer coefficient, which would result in higher cladding temperatures and the possibility of cladding failure.

Correlations predict DNB and the location of DNB for axially uniform and non-uniform heat flux distributions. The local DNB ratio (DNBR), defined as the ratio of the predicted DNB heat flux at a particular core location to the actual heat flux at that location, is indicative of the margin to DNB. The minimum value of DNBR during normal operation and design basis anticipated operational occurrences is limited to 1.231 based upon a statistical combination of CE-1 CHF correlation and engineering factor uncertainties and is established as a Safety Limit. The DNBR limit of 1.231 includes a rod bow compensation of 0.8% on DNBR. For fuel burnups which exceed that for which an increased rod bow penalty is required, the DNBR limit shall be adjusted. In this case the DNBR trip setpoint of 1.231 is allowed if the required DNBR increase is compensated by an increase of the addressable constant BERR1.

Second, operation with a peak linear heat rate below that which would cause fuel centerline melting maintains fuel rod and cladding integrity. Above this peak linear heat rate level (i.e., with some melting in the center), fuel rod integrity would be maintained only if the design and operating conditions are appropriate throughout the life of the fuel rods. Volume changes which accompany the solid to liquid phase change are significant and require accommodation. Another consideration involves the redistribution of the fuel which depends on the extent of the melting and the physical state of the fuel rod at the time of melting. Because of the above factors, the steady state value of the peak linear heat rate which would not cause fuel centerline melting is established as a Safety Limit. To account for fuel rod dynamics (lags), the directly indicated linear heat rate is dynamically adjusted by the CPC program.



FINAL DRAFT

## SAFETY LIMITS AND LIMITING SAFETY SYSTEMS SETTINGS

### BASES

---

Limiting Safety System Settings for the Low DNBR, High Local Power Density, High Logarithmic Power Level, Low Pressurizer Pressure and High Linear Power Level trips, and Limiting Conditions for Operation on DNBR and kW/ft margin are specified such that there is a high degree of confidence that the specified acceptable fuel design limits are not exceeded during normal operation and design basis anticipated operational occurrences.

#### 2.1.2 REACTOR COOLANT SYSTEM PRESSURE

The restriction of this Safety Limit protects the integrity of the Reactor Coolant System from overpressurization and thereby prevents the release of radionuclides contained in the reactor coolant from reaching the containment atmosphere.

The Reactor Coolant System components are designed to Section III, 1974 Edition, Summer 1975 Addendum, of the ASME Code for Nuclear Power Plant Components which permits a maximum transient pressure of 110% (2750 psia) of design pressure. The Safety Limit of 2750 psia is therefore consistent with the design criteria and associated code requirements.

The entire Reactor Coolant System is hydrotested at 3125 psia to demonstrate integrity prior to initial operation.

#### 2.2.1 REACTOR TRIP SETPOINTS

The Reactor Trip Setpoints specified in Table 2.2-1 are the values at which the Reactor Trips are set for each functional unit. The Trip Setpoints have been selected to ensure that the reactor core and Reactor Coolant System are prevented from exceeding their Safety Limits during normal operation and design basis anticipated operational occurrences and to assist the Engineered Safety Features Actuation System in mitigating the consequences of accidents. Operation with a trip set less conservative than its Trip Setpoint but within its specified Allowable Value is acceptable on the basis that the difference between each Trip Setpoint and the Allowable Value is equal to or less than the drift allowance assumed for each trip in the safety analyses.

The DNBR - Low and Local Power Density - High are digitally generated trip setpoints based on Safety Limits of 1.231 and 21 kW/ft, respectively. Since these trips are digitally generated by the Core Protection Calculators, the trip values are not subject to drifts common to trips generated by analog type equipment. The Allowable Values for these trips are therefore the same as the Trip Setpoints.

To maintain the margins of safety assumed in the safety analyses, the calculations of the trip variables for the DNBR - Low and Local Power Density - High trips include the measurement, calculational and processor uncertainties and dynamic allowances as defined in CESSAR System 80 applicable system descriptions and safety analyses.

## SAFETY LIMITS AND LIMITING SAFETY SYSTEMS SETTINGS

### BASES

---

#### REACTOR TRIP SETPOINTS (Continued)

The methodology for the calculation of the PVNGS trip setpoint values, plant protection system, is discussed in the CE Document No. CEN-286(V) dated July 31, 1984.

#### Manual Reactor Trip

The Manual reactor trip is a redundant channel to the automatic protective instrumentation channels and provides manual reactor trip capability.

#### Variable Overpower Trip

A reactor trip on Variable Overpower is provided to protect the reactor core during rapid positive reactivity addition excursions. This trip function will trip the reactor when the indicated neutron flux power exceeds either a rate limited setpoint at a great enough rate or reaches a preset ceiling. The flux signal used is the average of three linear subchannel flux signals originating in each nuclear instrument safety channel. These trip setpoints are provided in Table 2.2-1.

#### Logarithmic Power Level - High

The Logarithmic Power Level - High trip is provided to protect the integrity of fuel cladding and the Reactor Coolant System pressure boundary in the event of an unplanned criticality from a shutdown condition. A reactor trip is initiated by the Logarithmic Power Level - High trip unless this trip is manually bypassed by the operator. The operator may manually bypass this trip when the THERMAL POWER level is above 10<sup>-4</sup>% of RATED THERMAL POWER; this bypass is automatically removed when the THERMAL POWER level decreases to 10<sup>-4</sup>% of RATED THERMAL POWER.

#### Pressurizer Pressure - High

The Pressurizer Pressure - High trip, in conjunction with the pressurizer safety valves and main steam safety valves, provides Reactor Coolant System protection against overpressurization in the event of loss of load without reactor trip. This trip's setpoint is below the nominal lift setting of the pressurizer safety valves and its operation minimizes the undesirable operation of the pressurizer safety valves.

#### Pressurizer Pressure - Low

The Pressurizer Pressure - Low trip is provided to trip the reactor and to assist the Engineered Safety Features System in the event of a decrease in Reactor Coolant System inventory and in the event of an increase in heat



SAFETY LIMITS AND LIMITING SAFETY SYSTEMS SETTINGSBASESPressurizer Pressure - Low (Continued)

removal by the secondary system. During normal operation, this trip's setpoint may be manually decreased, to a minimum value of 100 psia, as pressurizer pressure is reduced during plant shutdowns, provided the margin between the pressurizer pressure and this trip's setpoint is maintained at less than or equal to 400 psi; this setpoint increases automatically as pressurizer pressure increases until the trip setpoint is reached. The operator may manually bypass this trip when pressurizer pressure is below 400 psia. This bypass is automatically removed when the pressurizer pressure increases to 500 psia.

Containment Pressure - High

The Containment Pressure - High trip provides assurance that a reactor trip is initiated in the event of containment building pressurization due to a pipe break inside the containment building. The setpoint for this trip is identical to the safety injection setpoint.

Steam Generator Pressure - Low

The Steam Generator Pressure - Low trip provides protection in the event of an increase in heat removal by the secondary system and subsequent cooldown of the reactor coolant. The setpoint is sufficiently below the full load operating point so as not to interfere with normal operation, but still high enough to provide the required protection in the event of excessively high steam flow. This trip's setpoint may be manually decreased as steam generator pressure is reduced during plant shutdowns, provided the margin between the steam generator pressure and this trip's setpoint is maintained at less than or equal to 200 psi; this setpoint increases automatically as steam generator pressure increases until the normal pressure trip setpoint is reached.

Steam Generator Level - Low

The Steam Generator Level - Low trip provides protection against a loss of feedwater flow incident and assures that the design pressure of the Reactor Coolant System will not be exceeded due to a decrease in heat removal by the secondary system. This specified setpoint provides allowance that there will be sufficient water inventory in the steam generator at the time of the trip to provide a margin of at least 10 minutes before auxiliary feedwater is required to prevent degraded core cooling.

Local Power Density - High

The Local Power Density - High trip is provided to prevent the linear heat rate (kW/ft) in the limiting fuel rod in the core from exceeding the fuel design limit in the event of any design bases anticipated operational occurrence. The local power density is calculated in the reactor protective system utilizing the following information:

## SAFETY LIMITS AND LIMITING SAFETY SYSTEMS SETTINGS

### BASES

---

#### Local Power Density - High (Continued)

- a. Nuclear flux power and axial power distribution from the excore flux monitoring system;
- b. Radial peaking factors from the position measurement for the CEAs;
- c. Delta T power from reactor coolant temperatures and coolant flow measurements.

The local power density (LPD), the trip variable, calculated by the CPC incorporates uncertainties and dynamic compensation routines. These uncertainties and dynamic compensation routines ensure that a reactor trip occurs when the actual core peak LPD is sufficiently less than the fuel design limit such that the increase in actual core peak LPD after the trip will not result in a violation of the Peak Linear Heat Rate Safety Limit. CPC uncertainties related to peak LPD are the same types used for DNBR calculation. Dynamic compensation for peak LPD is provided for the effects of core fuel centerline temperature delays (relative to changes in power density), sensor time delays, and protection system equipment time delays.

#### DNBR - Low

The DNBR - Low trip is provided to prevent the DNBR in the limiting coolant channel in the core from exceeding the fuel design limit in the event of design bases anticipated operational occurrences. The DNBR - Low trip incorporates a low pressurizer pressure floor of 1861 psia. At this pressure a DNBR - Low trip will automatically occur. The DNBR is calculated in the CPC utilizing the following information:

- a. Nuclear flux power and axial power distribution from the excore neutron flux monitoring system;
- b. Reactor Coolant System pressure from pressurizer pressure measurement;
- c. Differential temperature (Delta T) power from reactor coolant temperature and coolant flow measurements;
- d. Radial peaking factors from the position measurement for the CEAs;
- e. Reactor coolant mass flow rate from reactor coolant pump speed;
- f. Core inlet temperature from reactor coolant cold leg temperature measurements.

## SAFETY LIMITS AND LIMITING SAFETY SYSTEMS SETTINGS

### BASES

#### DNBR - Low (Continued)

The DNBR, the trip variable, calculated by the CPC incorporates various uncertainties and dynamic compensation routines to assure a trip is initiated prior to violation of fuel design limits. These uncertainties and dynamic compensation routines ensure that a reactor trip occurs when the calculated core DNBR is sufficiently greater than 1.231 such that the decrease in calculated core DNBR after the trip will not result in a violation of the DNBR Safety Limit. CPC uncertainties related to DNBR cover CPC input measurement uncertainties, algorithm modelling uncertainties, and computer equipment processing uncertainties. Dynamic compensation is provided in the CPC calculations for the effects of coolant transport delays, core heat flux delays (relative to changes in core power), sensor time delays, and protection system equipment time delays.

The DNBR algorithm used in the CPC is valid only within the limits indicated below and operation outside of these limits will result in a CPC initiated trip.

<u>Parameter</u>	<u>Limiting Value</u>
a. RCS Cold Leg Temperature-Low	$\geq 470^{\circ}\text{F}$
b. RCS Cold Leg Temperature-High	$\leq 610^{\circ}\text{F}$
c. Axial Shape Index-Positive	Not more positive than + 0.5
d. Axial Shape Index-Negative	Not more negative than - 0.5
e. Pressurizer Pressure-Low	$\geq 1861 \text{ psia}$
f. Pressurizer Pressure-High	$\leq 2388 \text{ psia}$
g. Integrated Radial Peaking Factor-Low	$\geq 1.28$
h. Integrated Radial Peaking Factor-High	$\leq 4.28$
i. Quality Margin-Low	$\geq 0$

#### Steam Generator Level - High

The Steam Generator Level - High trip is provided to protect the turbine from excessive moisture carry over. Since the turbine is automatically tripped when the reactor is tripped, this trip provides a reliable means for providing protection to the turbine from excessive moisture carryover. This trip's setpoint does not correspond to a safety limit, ~~and no credit was taken in the accident analyses for operation of this trip.~~ Its functional capability at the specified trip setting enhances the overall reliability of the reactor protection system.

AND PROVIDES PROTECTION IN THE EVENT OF EXCESS FEEDWATER FLOW  
THE SETPOINT IS IDENTICAL TO MAIN STEAM ISOLATION SETPOINT

## SAFETY LIMITS AND LIMITING SAFETY SYSTEMS SETTINGS

### BASES

---

#### Reactor Coolant Flow - Low

The Reactor Coolant Flow - Low trip provides protection against a reactor coolant pump sheared shaft event and a four pump flow coastdown during a steam line break with loss of offsite power. A trip is initiated when the pressure differential across the primary side of either steam generator decreases below a variable setpoint. This variable setpoint stays a set amount below the pressure differential unless limited by a set maximum decrease rate or a set minimum value. The specified setpoint ensures that a reactor trip occurs to prevent violation of Peak Linear Heat Rate or DNBR Safety Limits under the stated conditions.

#### Pressurizer Pressure - High (SPS)

The Supplementary Protection System (SPS) augments reactor protection against overpressurization by utilizing a separate and diverse trip logic from the Reactor Protection System for initiation of reactor trip. The SPS will initiate a reactor trip when pressurizer pressure exceeds a predetermined value.

### 2.2.2 CORE PROTECTION CALCULATOR ADDRESSABLE CONSTANTS

The Core Protection Calculator (CPC) addressable constants are provided to allow calibration of the CPC system to more accurate indications of power level, RCS flow rate, axial flux shape, radial peaking factors and CEA deviation penalties. Other CPC addressable constants allow penalization of the calculated DNBR and LPD values based on measurement uncertainties or inoperable equipment. Administrative controls on changes and periodic checking of addressable constant values (see also Technical Specifications 3.3.1 and 6.8.1) ensure that inadvertent misloading of addressable constants into the CPC's is unlikely.

FINAL DRAFT

SECTIONS 3.0 AND 4.0  
LIMITING CONDITIONS FOR OPERATION  
AND  
SURVEILLANCE REQUIREMENTS



## 3/4 LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

### 3/4.0 APPLICABILITY

#### LIMITING CONDITION FOR OPERATION

---

3.0.1 Compliance with the Limiting Conditions for Operation contained in the succeeding specifications is required during the OPERATIONAL MODES or other conditions specified therein; except that upon failure to meet the Limiting Conditions for Operation, the associated ACTION requirements shall be met.

3.0.2 Noncompliance with a specification shall exist when the requirements of the Limiting Condition for Operation and/or associated ACTION requirements are not met within the specified time intervals. If the Limiting Condition for Operation is restored prior to expiration of the specified time intervals, completion of the ACTION requirements is not required.

3.0.3 When a Limiting Condition for Operation is not met, except as provided in the associated ACTION requirements, within 1 hour, action shall be initiated to place the unit in a MODE in which the specification does not apply by placing it, as applicable, in:

1. At least HOT STANDBY within the next 6 hours,
2. At least HOT SHUTDOWN within the following 6 hours, and
3. At least COLD SHUTDOWN within the subsequent 24 hours.

Where corrective measures are completed that permit operation under the ACTION requirements, the ACTION may be taken in accordance with the specified time limits as measured from the time of failure to meet the Limiting Condition for Operation. Exceptions to these requirements are stated in the individual specifications.

This specification is not applicable in MODE 5 or 6.

3.0.4 Entry into an OPERATIONAL MODE or other specified condition shall not be made unless the conditions of the Limiting Condition for Operation are met without reliance on provisions contained in the ACTION requirements. This provision shall not prevent passage through or to OPERATIONAL MODES as required to comply with ACTION statements. Exceptions to these requirements are stated in the individual specifications.

APPLICABILITY

SURVEILLANCE REQUIREMENTS

---

4.0.1 Surveillance Requirements shall be applicable during the OPERATIONAL MODES or other conditions specified for individual Limiting Conditions for Operation unless otherwise stated in an individual Surveillance Requirement.

4.0.2 Each Surveillance Requirement shall be performed within the specified time interval with:

- a. A maximum allowable extension not to exceed 25% of the surveillance interval, and
- b. The combined time interval for any three consecutive surveillance intervals not to exceed 3.25 times the specified surveillance interval.

4.0.3 Failure to perform a Surveillance Requirement within the specified time interval shall constitute a failure to meet the OPERABILITY requirements for a Limiting Condition for Operation. Exceptions to these requirements are stated in the individual specifications. Surveillance Requirements do not have to be performed on inoperable equipment.

4.0.4 Entry into an OPERATIONAL MODE or other specified condition shall not be made unless the Surveillance Requirement(s) associated with the Limiting Condition for Operation have been performed within the stated surveillance interval or as otherwise specified.

4.0.5 Surveillance Requirements for inservice inspection and testing of ASME Code Class 1, 2, and 3 components shall be applicable as follows:

- a. Inservice inspection of ASME Code Class 1, 2, and 3 components and inservice testing ASME Code Class 1, 2, and 3 pumps and valves shall be performed in accordance with Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda as required by 10 CFR 50, Section 50.55a(g), except where specific written relief has been granted by the Commission pursuant to 10 CFR 50, Section 50.55a(g)(6)(i).
- b. Surveillance intervals specified in Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda for the inservice inspection and testing activities required by the ASME Boiler and Pressure Vessel Code and applicable Addenda shall be applicable as follows in these Technical Specifications:

## APPLICABILITY

### SURVEILLANCE REQUIREMENTS (Continued)

#### 4.0.5 (Continued)

ASME Boiler and Pressure  
Vessel Code and applicable  
Addenda terminology for  
inservice inspection and  
testing activities

Required frequencies  
for performing inservice  
inspection and testing  
activities

Weekly  
Monthly  
Quarterly or every 3 months  
Semiannually or every 6 months  
Yearly or annually

At least once per 7 days  
At least once per 31 days  
At least once per 92 days  
At least once per 184 days  
At least once per 366 days

- c. The provisions of Specification 4.0.2 are applicable to the above required frequencies for performing inservice inspection and testing activities.
- d. Performance of the above inservice inspection and testing activities shall be in addition to other specified Surveillance Requirements.
- e. Nothing in the ASME Boiler and Pressure Vessel Code shall be construed to supersede the requirements of any Technical Specification.

## 3/4.1 REACTIVITY CONTROL SYSTEMS

### 3/4.1.1 BORATION CONTROL

SHUTDOWN MARGIN -  $T_{cold}$  GREATER THAN 210°F

### LIMITING CONDITION FOR OPERATION

3.1.1.1 The SHUTDOWN MARGIN shall be greater than or equal to 6.0% delta k/k.

APPLICABILITY: MODES 1, 2\*, 3, and 4.

#### ACTION:

With the SHUTDOWN MARGIN less than 6.0% delta k/k, immediately initiate and continue boration at greater than or equal to 40 gpm of a solution containing greater than or equal to 4000 ppm boron or equivalent until the required SHUTDOWN MARGIN is restored.

### SURVEILLANCE REQUIREMENTS

4.1.1.1.1 The SHUTDOWN MARGIN shall be determined to be greater than or equal to 6.0% delta k/k:

- a. Within 1 hour after detection of an inoperable CEA(s) and at least once per 12 hours thereafter while the CEA(s) is inoperable. If the inoperable CEA is immovable or untrippable, the above required SHUTDOWN MARGIN shall be verified acceptable with an increased allowance for the withdrawn worth of the immovable or untrippable CEA(s).
- b. When in MODE 1 or MODE 2 with  $K_{eff}$  greater than or equal to 1.0, at least once per 12 hours by verifying that CEA group withdrawal is within the Transient Insertion Limits of Specification 3.1.3.6.
- c. When in MODE 2 with  $K_{eff}$  less than 1.0, within 4 hours prior to achieving reactor criticality by verifying that the predicted critical CEA position is within the limits of Specification 3.1.3.6.

\* See Special Test Exception 3.10.1.

FINAL DRAFT

REACTIVITY CONTROL SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

- d. Prior to initial operation above 5% RATED THERMAL POWER after each fuel loading, by consideration of the factors of e. below, with the CEA groups at the Transient Insertion Limits of Specification 3.1.3.6.
- e. When in MODE 3 or 4, at least once per 24 hours by consideration of at least the following factors:
  - 1. Reactor Coolant System boron concentration,
  - 2. CEA position,
  - 3. Reactor Coolant System average temperature,
  - 4. Fuel burnup based on gross thermal energy generation,
  - 5. Xenon concentration, and
  - 6. Samarium concentration.

4.1.1.1.2 The overall core reactivity balance shall be compared to predicted values to demonstrate agreement within  $\pm 1.0\%$  delta k/k at least once per 31 Effective Full Power Days (EFPD). This comparison shall consider at least those factors stated in Specification 4.1.1.1.e., above. The predicted reactivity values shall be adjusted (normalized) to correspond to the actual core conditions prior to exceeding a fuel burnup of 60 EFPD after each fuel loading.

## REACTIVITY CONTROL SYSTEMS

SHUTDOWN MARGIN -  $T_{cold}$  LESS THAN OR EQUAL TO 210°F

### LIMITING CONDITION FOR OPERATION

3.1.1.2 The SHUTDOWN MARGIN shall be greater than or equal to 4.0% delta k/k.

APPLICABILITY: MODE 5.

#### ACTION:

With the SHUTDOWN MARGIN less than 4.0% delta k/k, immediately initiate and continue boration at greater than or equal to 40 gpm of a solution containing greater than or equal to 4000 ppm boron or equivalent until the required SHUTDOWN MARGIN is restored.

### SURVEILLANCE REQUIREMENTS

4.1.1.2 The SHUTDOWN MARGIN shall be determined to be greater than or equal to 4.0% delta k/k:

- a. Within 1 hour after detection of an inoperable CEA(s) and at least once per 12 hours thereafter while the CEA(s) is inoperable. If the inoperable CEA is immovable or untrippable, the above required SHUTDOWN MARGIN shall be increased by an amount at least equal to the withdrawn worth of the immovable or untrippable CEA(s).
- b. At least once per 24 hours by consideration of the following factors:
  1. Reactor Coolant System boron concentration,
  2. CEA position,
  3. Reactor Coolant System average temperature,
  4. Fuel burnup based on gross thermal energy generation,
  5. Xenon concentration, and
  6. Samarium concentration.

FINAL DRAFT

REACTIVITY CONTROL SYSTEMS

MODERATOR TEMPERATURE COEFFICIENT

LIMITING CONDITION FOR OPERATION

---

3.1.1.3 The moderator temperature coefficient (MTC) shall be within the area of Acceptable Operation shown on Figure 3.1-1.

APPLICABILITY: MODES 1 and 2\*#

ACTION:

With the moderator temperature coefficient outside the area of Acceptable Operation shown on Figure 3.1-1, be in at least HOT STANDBY within 6 hours.

SURVEILLANCE REQUIREMENTS

---

4.1.1.3.1 The MTC shall be determined to be within its limits by confirmatory measurements. MTC measured values shall be extrapolated and/or compensated to permit direct comparison with the above limits.


4.1.1.3.2 The MTC shall be determined at the following frequencies and THERMAL POWER conditions during each fuel cycle:

- a. Prior to initial operation above 5% of RATED THERMAL POWER, after each fuel loading.
- b. At any THERMAL POWER, within 7 EFPD after reaching a core average exposure of 40 EFPD burnup into the current cycle.
- c. At any THERMAL POWER, within 7 EFPD after reaching a core average exposure equivalent to two-thirds of the expected current cycle end-of-cycle core average burnup.

\*With Keff greater than or equal to 1.0.

#See Special Test Exception 3.10.2.

FIGURE 3.1-1  
ALLOWABLE MTC MODES 1 AND 2  
PALO VERDE UNIT 1 CYCLE 1

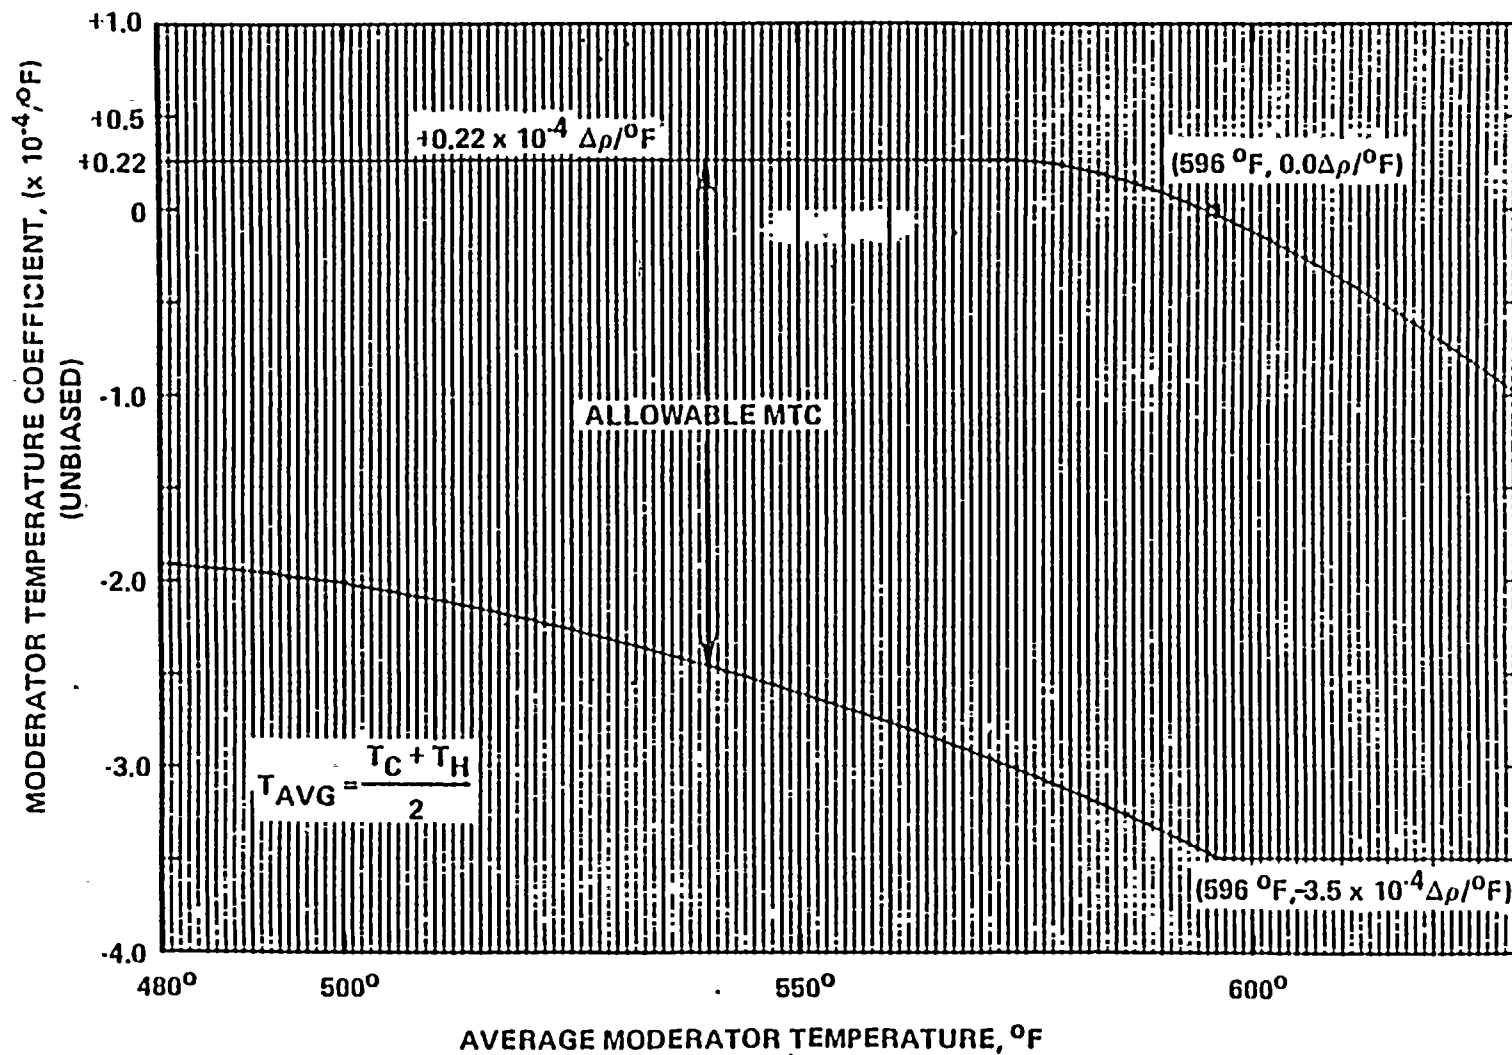

FIELD  
DRAFT



**FINAL DRAFT**

REACTIVITY CONTROL SYSTEMS

MINIMUM TEMPERATURE FOR CRITICALITY

LIMITING CONDITION FOR OPERATION

---

3.1.1.4 The Reactor Coolant System lowest operating loop temperature ( $T_{cold}$ ) shall be greater than or equal to 552°F.

APPLICABILITY: MODES 1 and 2#\*.

ACTION:

With a Reactor Coolant System operating loop temperature ( $T_{cold}$ ) less than 552°F, restore  $T_{cold}$  to within its limit within 15 minutes or be in HOT STANDBY within the next 15 minutes.

SURVEILLANCE REQUIREMENTS

---

4.1.1.4 The Reactor Coolant System temperature ( $T_{cold}$ ) shall be determined to be greater than or equal to 552°F:

- a. Within 15 minutes prior to achieving reactor criticality, and
- b. At least once per 30 minutes when the reactor is critical and the Reactor Coolant System  $T_{cold}$  is less than 557°F.

---

#With  $K_{eff}$  greater than or equal to 1.0.

\*See Special Test Exception 3.10.5.



FINAL DRAFT

## REACTIVITY CONTROL SYSTEMS

### 3/4.1.2 BORATION SYSTEMS

#### FLOW PATHS - SHUTDOWN

#### LIMITING CONDITION FOR OPERATION

---

3.1.2.1 As a minimum, one of the following boron injection flow paths shall be OPERABLE:

- a. If only the spent fuel pool in Specification 3.1.2.5a. is OPERABLE, a flow path from the spent fuel pool via a gravity feed connection and a charging pump to the Reactor Coolant System.
- b. If only the refueling water tank in Specification 3.1.2.5b. is OPERABLE, a flow path from the refueling water tank via either a charging pump, a high pressure safety injection pump, or a low pressure safety injection pump to the Reactor Coolant System.

APPLICABILITY: MODES 5 and 6.

#### ACTION:

With none of the above flow paths OPERABLE, suspend all operations involving CORE ALTERATIONS or positive reactivity changes.

#### SURVEILLANCE REQUIREMENTS

---

4.1.2.1 At least one of the above required flow paths shall be demonstrated OPERABLE at least once per 31 days by verifying that each valve (manual, power-operated, or automatic) in the flow path that is not locked, sealed, or otherwise secured in position, is in its correct position.



**FINAL DRAFT**

REACTIVITY CONTROL SYSTEMS

FLOW PATHS - OPERATING

LIMITING CONDITION FOR OPERATION

---

3.1.2.2 At least two of the following four boron injection flow paths shall be OPERABLE:

- a. A gravity feed flow path from either the refueling water tank or the spent fuel pool through CH-536 (RWT Gravity Feed Isolation Valve) and a charging pump to the Reactor Coolant System,
- b. A gravity feed flow path from the refueling water tank through CH-327 (RWT Gravity Feed/Safety Injection System Isolation Valve) and a charging pump to the Reactor Coolant System,
- c. A flow path from either the refueling water tank or the spent fuel pool through CH-164 (Boric Acid Filter Bypass Valve), utilizing gravity feed and a charging pump to the Reactor Coolant System.
- d. A flow path from the refueling water tank via a high pressure safety injection pump to the Reactor Coolant System.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

With only one of the above required boron injection flow paths to the Reactor Coolant System OPERABLE, restore at least two boron injection flow paths to the Reactor Coolant System to OPERABLE status within 72 hours or be in at least HOT STANDBY and borated to a SHUTDOWN MARGIN equivalent to at least 6% delta k/k at 210°F within the next 6 hours; restore at least two flow paths to OPERABLE status within the next 7 days or be in COLD SHUTDOWN within the next 30 hours.

SURVEILLANCE REQUIREMENTS

---

4.1.2.2 At least two of the above required flow paths shall be demonstrated OPERABLE:

- a. At least once per 31 days by verifying that each valve (manual, power-operated, or automatic) in the flow path that is not locked, sealed, or otherwise secured in position, is in its correct position.
- b. At least once per 18 months when the Reactor Coolant System is at normal operating pressure by verifying that the flow path required by Specification 3.1.2.2 delivers at least 26 gpm for 1 charging pump and 68 gpm for two charging pumps to the Reactor Coolant System.

## REACTIVITY CONTROL SYSTEMS

### CHARGING PUMPS - SHUTDOWN

#### LIMITING CONDITION FOR OPERATION

---

3.1.2.3 At least one charging pump\* or one high pressure safety injection pump or one low pressure safety injection pump in the boron injection flow path required OPERABLE pursuant to Specification 3.1.2.1 shall be OPERABLE and capable of being powered from an OPERABLE emergency power source.

APPLICABILITY: MODES 5 and 6.

#### ACTION:

With no charging pump or high pressure safety injection pump or low pressure safety injection pump OPERABLE or capable of being powered from an OPERABLE emergency power source, suspend all operations involving CORE ALTERATIONS or positive reactivity changes.

#### SURVEILLANCE REQUIREMENTS

---

4.1.2.3 No additional Surveillance Requirements other than those required by Specification 4.0.5.

---

\* Whenever the reactor coolant level is below the bottom of the pressurizer in MODE 5, one and only one charging pump shall be OPERABLE, by verifying at least once per every 7 days that power is removed from the remaining charging pumps.



FINAL DRAFT

REACTIVITY CONTROL SYSTEMS

CHARGING PUMPS - OPERATING

LIMITING CONDITION FOR OPERATION

---

3.1.2.4 At least two charging pumps shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

With only one charging pump OPERABLE, restore at least two charging pumps to OPERABLE status within 72 hours or be in at least HOT STANDBY and borated to a SHUTDOWN MARGIN equivalent to at least 6% delta k/k at 210°F within the next 6 hours; restore at least two charging pumps to OPERABLE status within the next 7 days or be in COLD SHUTDOWN within the next 30 hours.

SURVEILLANCE REQUIREMENTS

---

4.1.2.4 No additional Surveillance Requirements other than those required by Specification 4.0.5.



## REACTIVITY CONTROL SYSTEMS

### BORATED WATER SOURCES - SHUTDOWN

#### LIMITING CONDITION FOR OPERATION

3.1.2.5 As a minimum, one of the following borated water sources shall be OPERABLE:

- a. The spent fuel pool with:
  1. A minimum borated water volume of 33,500 gallons and
  2. A boron concentration of between 4000 ppm and 4400 ppm boron, and
  3. A solution temperature between 60°F and 180°F.
- b. The refueling water tank with:
  1. A minimum contained borated water volume of 33,500 gallons and
  2. A boron concentration of between 4000 ppm and 4400 ppm boron, and
  3. A solution temperature between 60°F and 120°F.

APPLICABILITY: MODES 5\* and 6\*.

#### ACTION:

With no borated water sources OPERABLE, suspend all operations involving CORE ALTERATIONS or positive reactivity changes until at least one borated water source is restored to OPERABLE status.



#### SURVEILLANCE REQUIREMENTS

4.1.2.5 The above required borated water sources shall be demonstrated OPERABLE:

- a. At least once per 7 days by:
  1. Verifying the boron concentration of the water, and
  2. Verifying the contained borated water volume of the refueling water tank or the spent fuel pool.
- b. At least once per 24 hours by verifying the refueling water tank temperature when it is the source of borated water and the outside air temperature is outside the 60°F to 120°F range.
- c. At least once per 24 hours by verifying the spent fuel pool temperature when it is the source of borated water and irradiated fuel is present in the pool.

\*See Special Test Exception 3.10.7.

# FINAL DRAFT

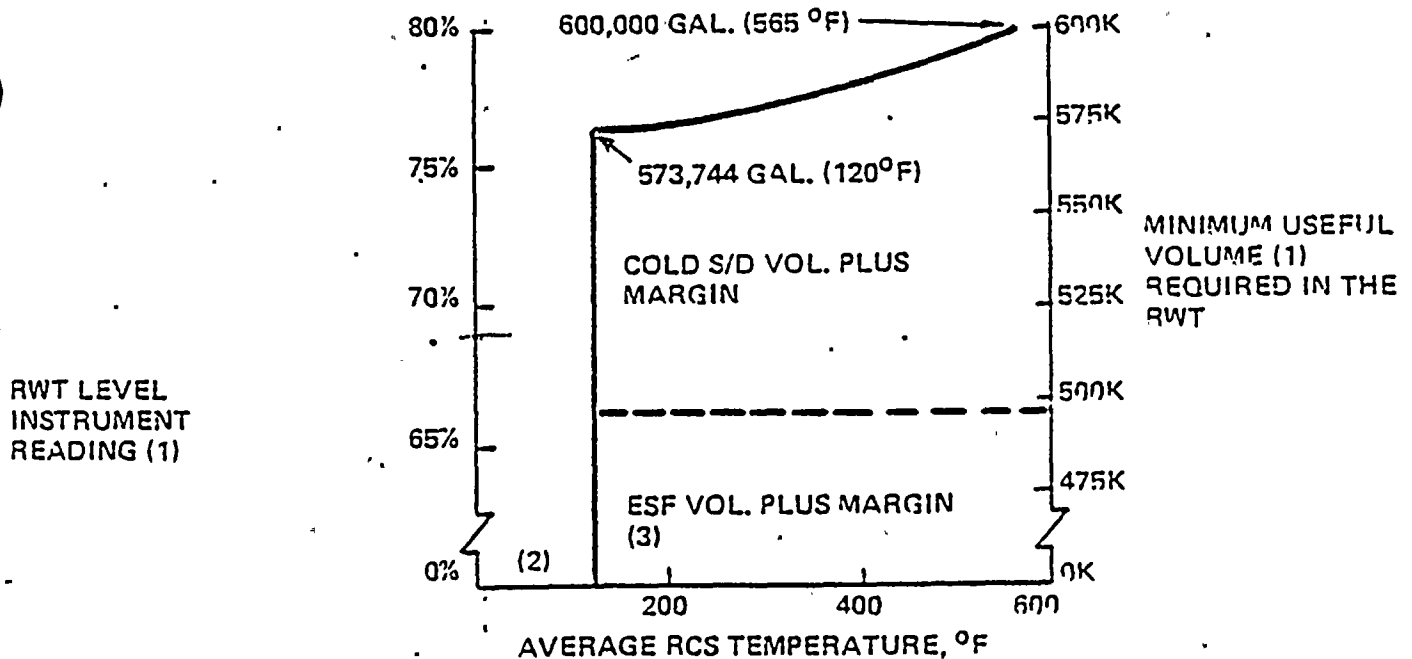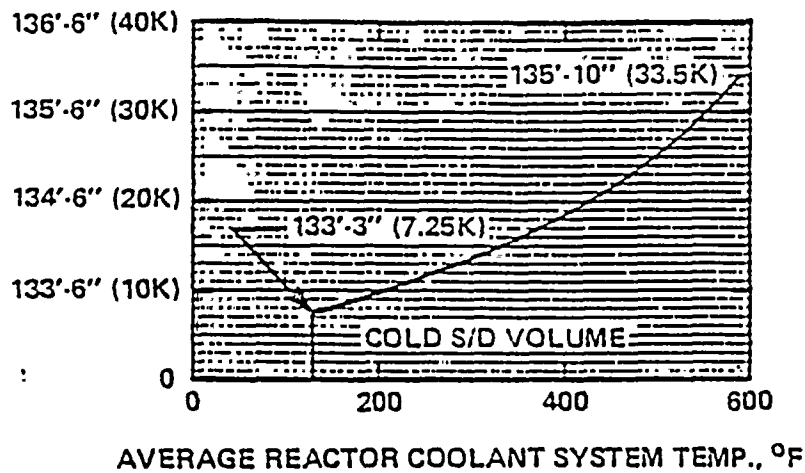

- (1) THE TANK LEVEL AND VOLUME SHOWN ARE THE USEFUL LEVEL AND VOLUME ABOVE THAT IN THE TANK WHICH IS REQUIRED FOR VORTEX CONSIDERATIONS
- (2) DURING MODE 5 AND 6 ONE OF THESE BORATED SOURCES SHALL CONTAIN A MINIMUM OF 33,500 GALLONS
- (3) THIS VOLUME IS NOT REQUIRED DURING MODE 6

FIGURE 3.1-2  
MINIMUM BORATED WATER VOLUMES

FINAL DRAFT

REACTIVITY CONTROL SYSTEMS

BORATED WATER SOURCES - OPERATING

LIMITING CONDITION FOR OPERATION

3.1.2.6 Each of the following borated water sources shall be OPERABLE:

- a. The spent fuel pool with:
  1. A minimum borated water volume as specified in Figure 3.1-2, and
  2. A boron concentration of between 4000 ppm and 4400 ppm boron, and
  3. A solution temperature between 60°F and 180°F. ~~145°F~~ *5 TCT*
- b. The refueling water tank with:
  1. A minimum contained borated water volume as specified in Figure 3.1-2, and
  2. A boron concentration of between 4000 and 4400 ppm of boron, and
  3. A solution temperature between 60°F and 120°F.

APPLICABILITY: MODES 1, 2,\* 3,\* and 4\*.

ACTION:

- a. With the above required spent fuel pool inoperable, restore the pool to OPERABLE status within 72 hours or be in at least HOT STANDBY within the next 6 hours and borated to a SHUTDOWN MARGIN equivalent to at least 6% delta k/k at 210°F, restore the above required spent fuel pool to OPERABLE status within the next 7 days or be in COLD SHUTDOWN within the next 30 hours.
- b. With the refueling water tank inoperable, restore the tank to OPERABLE status within 1 hour or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

4.1.2.6 Each of the above required borated water sources shall be demonstrated OPERABLE:

- a. At least once per 7 days by:
  1. Verifying the boron concentration in the water, and
  2. Verifying the contained borated water volume of the water source.
- b. At least once per 24 hours by verifying the refueling water tank temperature when the outside air temperature is outside the 60°F to 120°F range.
- c. At least once per 24 hours by verifying the spent fuel pool temperature when irradiated fuel is present in the pool.

\* See Special Test Exception 3.10.7.



**FINAL DRAFT**

## REACTIVITY CONTROL SYSTEMS

### BORON DILUTION ALARMS

#### LIMITING CONDITION FOR OPERATION

---

3.1.2.7 Both startup channel high neutron flux alarms shall be OPERABLE.

APPLICABILITY: MODES 3\*, 4, 5, and 6.

ACTION:

- a. With one startup channel high neutron flux alarm inoperable:
  1. Determine the RCS boron concentration when entering MODE 3, 4, 5, or 6 or at the time the alarm is determined to be inoperable. From that time, the RCS boron concentration shall be determined at the applicable monitoring frequency in Table 3.1-1 by either boronometer or RCS sampling.\*\*
- b. With both startup channel high neutron flux alarms inoperable:
  1. Determine the RCS boron concentration by either boronometer and RCS sampling\*\* or by independent collection and analysis of two RCS samples when entering Mode 3, 4, or 5 or at the time both alarms are determined to be inoperable. From that time, the RCS boron concentration shall be determined at the applicable monitoring frequency in Tables 3.1-1 through 3.1-5, as applicable, by either boronometer and RCS sampling\*\* or by collection and analysis of two independent RCS samples. If redundant determination of RCS boron concentration cannot be accomplished immediately, suspend all operations involving CORE ALTERATIONS or positive reactivity changes until the method for determining and confirming RCS boron concentration is restored.
  2. When in MODE 5 with the RCS level below the centerline of the hotleg or MODE 6, suspend all operations involving CORE ALTERATIONS or positive reactivity changes until at least one startup channel high neutron flux alarm is restored to OPERABLE status.
- c. The provisions of Specification 3.0.3 are not applicable.

#### SURVEILLANCE REQUIREMENTS

---

4.1.2.7 Each startup channel high neutron flux alarm shall be demonstrated OPERABLE by performance of:

\*Within 1 hour after the neutron flux is within the startup range following a reactor shutdown.

\*\*With one or more reactor coolant pumps (RCP) operating the sample should be obtained from the hot leg. With no RCP operating, the sample should be obtained from the discharge line of the low pressure safety injection (LPSI) pump operating in the shutdown cooling mode.

FINAL DRAFT

REACTIVITY CONTROL SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

---

- a. A CHANNEL CHECK:
  - 1. At least once per 12 hours.
  - 2. When initially setting setpoints at the following times:
    - a) One hour after a reactor trip.
    - b) After a controlled reactor shutdown: Within 1 hour after the neutron flux is within the startup range in MODE 3.
- b. A CHANNEL FUNCTIONAL TEST every 31 days of cumulative operation during shutdown.

# FINAL DRAFT

TABLE 3.1-1

REQUIRED MONITORING FREQUENCIES FOR BACKUP BORON  
DILUTION DETECTION AS A FUNCTION OF OPERATING  
CHARGING PUMPS AND PLANT OPERATIONAL MODES FOR  $K_{eff} > 0.98$

OPERATIONAL MODE	<u>Number of Operating Charging Pumps</u>			
	0	1	2	3
3	12 hours	1 hour	Operation not allowed	
4	12 hours	1 hour	Operation not allowed	
5 RCS filled	8 hours	1 hour	Operation not allowed	
5 RCS partially drained	Operation not allowed			
6	24 hours	8 hours	4 hours	2 hours





# FINAL DRAFT

TABLE 3.1-2

REQUIRED MONITORING FREQUENCIES FOR BACKUP BORON DILUTION  
DETECTION AS A FUNCTION OF OPERATING CHARGING PUMPS AND PLANT  
OPERATIONAL MODES FOR  $0.98 \geq K_{eff} > 0.97$

OPERATIONAL MODE	<u>Number of Operating Charging Pumps</u>			
	0	1	2	3
3	12 hours	2.5 hours	1 hour	0.5 hours
4	12 hours	2.5 hours	1 hour	0.5 hours
5 RCS filled	8 hours	2.5 hours	1 hour	0.5 hours
5 RCS partially drained	8 hours	0.5 hours	Operation not allowed	
6	24 hours	8 hours	4 hours	2 hours



# FINAL DRAFT

TABLE 3.1-3

REQUIRED MONITORING FREQUENCIES FOR BACKUP BORON DILUTION  
DETECTION AS A FUNCTION OF OPERATING CHARGING PUMPS  
AND PLANT OPERATIONAL MODES FOR  $0.97 \geq K_{eff} > 0.96$

OPERATIONAL MODE	<u>Number of Operating Charging Pumps</u>			
	0	1	2	3
3	12 hours	3.5 hours	1.5 hours	1 hour
4	12 hours	3.5 hours	1.5 hours	1 hour
5 RCS filled	8 hours	3.5 hours	1.5 hours	1 hour
5 RCS partially drained	8 hours	1 hour	Operation not allowed	
6	24 hours	8 hours	4 hours	2 hours



FINAL DRAFT

TABLE 3.1-4

REQUIRED MONITORING FREQUENCIES FOR BACKUP BORON DILUTION  
DETECTION AS A FUNCTION OF OPERATING CHARGING PUMPS  
AND PLANT OPERATIONAL MODES FOR  $0.96 \geq K_{eff} > 0.95$

OPERATIONAL MODE	Number of Operating Charging Pumps			
	0	1	2	3
3	12 hours	5 hours	2 hours	1 hour
4	12 hours	5 hours	2 hours	1 hour
5 RCS filled	8 hours	5 hours	2 hours	1 hour
5 RCS partially drained	8 hours	1.5 hours	Operation not allowed	
6	24 hours	8 hours	4 hours	2 hours

1A  
FINAL DRAFT

TABLE 3.1-5

REQUIRED MONITORING FREQUENCIES FOR BACKUP BORON DILUTION  
DETECTION AS A FUNCTION OF OPERATING CHARGING PUMPS  
AND PLANT OPERATIONAL MODES FOR  $K_{eff} \leq 0.95$

OPERATIONAL MODE	Number of Operating Charging Pumps			
	0	1	2	3
3	12 hours	6 hours	3 hours	1.5 hours
4	12 hours	6 hours	3 hours	1.5 hours
5 RCS filled	8 hours	6 hours	3 hours	1.5 hours
5 RCS partially drained	8 hours	2 hours	Operation not allowed	
6	24 hours	8 hours	4 hours	2 hours

## REACTIVITY CONTROL SYSTEMS

### 3/4.1.3 MOVABLE CONTROL ASSEMBLIES

#### CEA POSITION

#### LIMITING CONDITION FOR OPERATION

3.1.3.1 All full-length (shutdown and regulating) CEAs, and all part-length CEAs which are inserted in the core, shall be OPERABLE with each CEA of a given group positioned within 6.6 inches (indicated position) of all other CEAs in its group. In addition, the position of the part length CEAs Groups shall be limited to the insertion limits shown in Figure 3.1-2A.

APPLICABILITY: MODES 1\* and 2\*.

#### ACTION:

- a. With one or more full-length CEAs inoperable due to being immovable as a result of excessive friction or mechanical interference or known to be untrippable, determine that the SHUTDOWN MARGIN requirement of Specification 3.1.1.1 is satisfied within 1 hour and be in at least HOT STANDBY within 6 hours.
- b. With more than one full-length or part-length CEA inoperable or misaligned from any other CEA in its group by more than 19 inches (indicated position), be in at least HOT STANDBY within 6 hours.
- c. With one or more full-length or part-length CEAs misaligned from any other CEAs in its group by more than 6.6 inches, operation in MODES 1 and 2 may continue, provided ~~within 1 hour~~ that core power is reduced in accordance with Figure 3.1-2B and the misaligned CEA(s) is either:  
THAT WITHIN 1 HOUR
  1. Restored to OPERABLE status within its above specified alignment requirements, or
  2. Declared inoperable and the SHUTDOWN MARGIN requirement of Specification 3.1.1.1 is satisfied. After declaring the CEA inoperable, operation in MODES 1 and 2 may continue pursuant to the requirements of Specification 3.1.3.6 provided:
    - a) Within 1 hour the remainder of the CEAs in the group with the inoperable CEA shall be aligned to within 6.6 inches of the inoperable CEA while maintaining the allowable CEA sequence and insertion limits shown on Figure 3.1-3; the THERMAL POWER level shall be restricted pursuant to Specification 3.1.3.6 during subsequent operation.

\* See Special Test Exceptions 3.10.2 and 3.10.4.





LIMITING CONDITION FOR OPERATION (Continued)

ACTION: (Continued)

- b) The SHUTDOWN MARGIN requirement of Specification 3.1.1.1 is determined at least once per 12 hours.

Otherwise, be in at least HOT STANDBY within 5 hours.

- d. With one full-length CEA inoperable due to causes other than addressed by ACTION a., above, and inserted beyond the Long Term Steady State Insertion Limits (Figure 3.1-3) but within its above specified alignment requirements, operation in MODES 1 and 2 may continue pursuant to the requirements of Specification 3.1.3.6. 3.1-4
- e. With one part-length CEA inoperable and inserted in the core, operation may continue provided the alignment of the inoperable part length CEA is maintained within 6.6 inches (indicated position) of all other part-length CEAs in its group.

SURVEILLANCE REQUIREMENTS

4.1.3.1.1 The position of each full-length and part-length CEA shall be determined to be within 6.6 inches (indicated position) of all other CEAs in its group at least once per 12 hours except during time intervals when one CEAC is inoperable or when both CEACs are inoperable, then verify the individual CEA positions at least once per 4 hours.

4.1.3.1.2 Each full-length CEA not fully inserted and each part-length CEA which is inserted in the core shall be determined to be OPERABLE by movement of at least 5 inches in any one direction at least once per 31 days.

FIGURE 3.1-2A  
PART LENGTH CEA INSERTION LIMIT vs THERMAL POWER


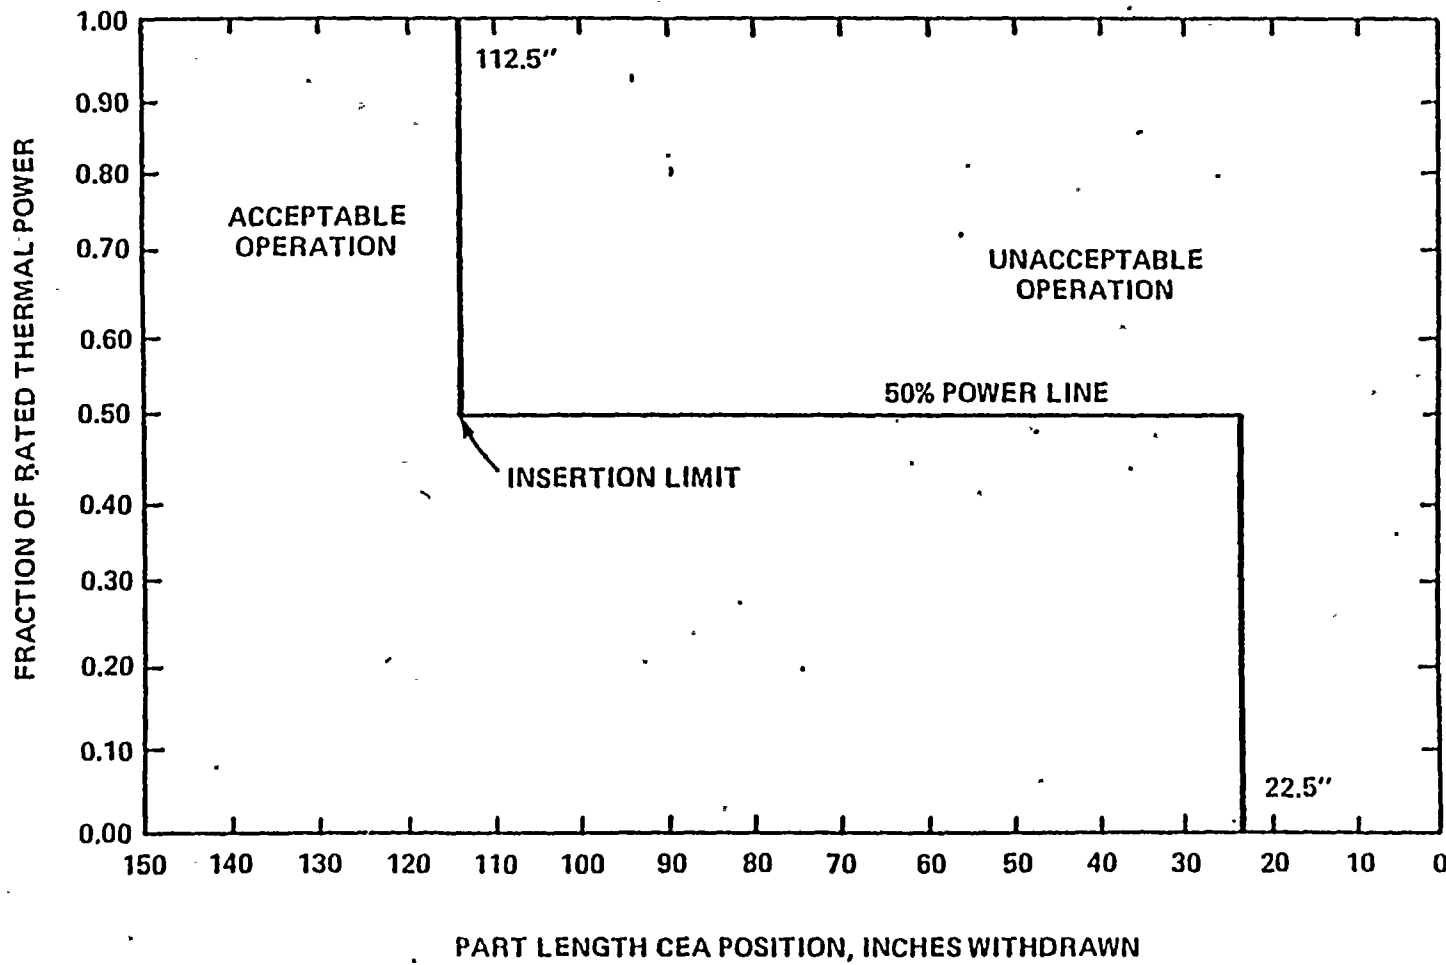


FIGURE 3.1-2A

INSERTION LIMITS FOR PART LENGTH CEAS



FIGURE 3.1-2B  
CORE POWER LIMIT AFTER CEA DEVIATION\*

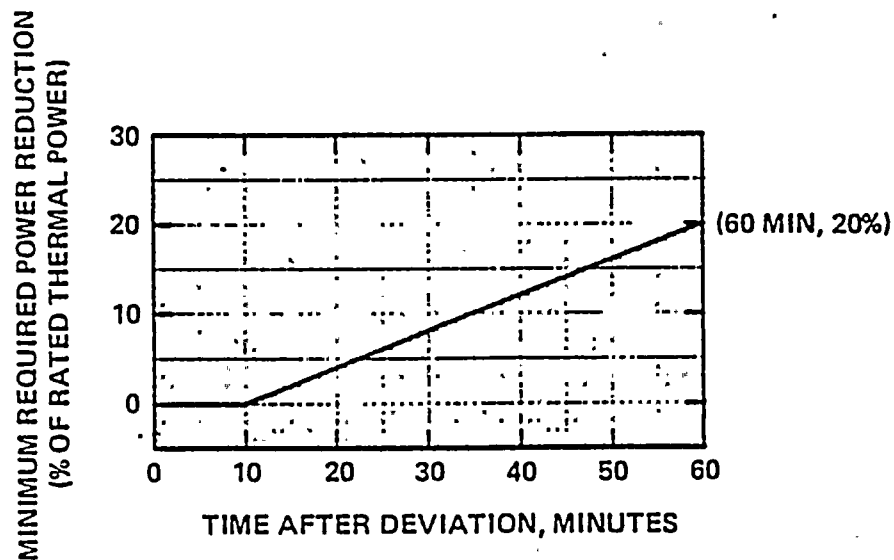

\*WHEN CORE POWER IS REDUCED TO 55% OF RATED THERMAL POWER PER THIS LIMIT CURVE, FURTHER REDUCTION IS NOT REQUIRED

FIGURE 3.1-2B  
CORE POWER REDUCTION

## REACTIVITY CONTROL SYSTEMS

FINAL DRAFT

### POSITION INDICATOR CHANNELS - OPERATING

#### LIMITING CONDITION FOR OPERATION

---

3.1.3.2 At least two of the following three CEA position indicator channels shall be OPERABLE for each CEA:

- a. CEA Reed Switch Position Transmitter (RSPT 1) with the capability of determining the absolute CEA positions within 5.2 inches,
- b. CEA Reed Switch Position Transmitter (RSPT 2) with the capability of determining the absolute CEA positions within 5.2 inches, and
- c. The CEA pulse counting position indicator channel.

APPLICABILITY: MODES 1 and 2.

#### ACTION:

With a maximum of one CEA per CEA group having only one of the above required CEA position indicator channels OPERABLE, within 6 hours either:

- a. Restore the inoperable position indicator channel to OPERABLE status, or
- b. Be in at least HOT STANDBY, or
- c. Position the CEA group(s) with the inoperable position indicator(s) at its fully withdrawn position while maintaining the requirements of Specifications 3.1.3.1 and 3.1.3.6. Operation may then continue provided the CEA group(s) with the inoperable position indicator(s) is maintained fully withdrawn, except during surveillance testing pursuant to the requirements of Specification 4.1.3.1.2, and each CEA in the group(s) is verified fully withdrawn at least once per 12 hours thereafter by its "Full Out" limit.\*

#### SURVEILLANCE REQUIREMENTS

---

4.1.3.2 Each of the above required position indicator channels shall be determined to be OPERABLE by verifying that for the same CEA, the position indicator channels agree within 5.2 inches of each other at least once per 12 hours.

---

\*CEAs are fully withdrawn (Full Out) when withdrawn to at least 144.75 inches.



**FINAL DRAFT**

REACTIVITY CONTROL SYSTEMS

POSITION INDICATOR CHANNELS - SHUTDOWN

LIMITING CONDITION FOR OPERATION

---

3.1.3.3 At least one CEA Reed Switch Position Transmitter indicator channel shall be OPERABLE for each shutdown, regulating, or part-length CEA not fully inserted.

APPLICABILITY: MODES 3\*, 4\*, and 5\*.

ACTION:

With less than the above required position indicator channel(s) OPERABLE, immediately open the reactor trip breakers.

SURVEILLANCE REQUIREMENTS

---

4.1.3.3 The above required CEA Reed Switch Position Transmitter indicator channel(s) shall be determined to be OPERABLE by performance of a CHANNEL FUNCTIONAL TEST at least once per 18 months.

---

\* With the reactor trip breakers in the closed position.

FINAL DRAFT

## REACTIVITY CONTROL SYSTEMS

### CEA DROP TIME

#### LIMITING CONDITION FOR OPERATION

---

3.1.3.4 The individual full-length (shutdown and regulating) CEA drop time, from a fully withdrawn position, shall be less than or equal to 4 seconds from when the electrical power is interrupted to the CEA drive mechanism until the CEA reaches its 90% insertion position with:

- a.  $T_{\text{cold}}$  greater than or equal to 552°F, and
- b. All reactor coolant pumps operating.

APPLICABILITY: MODES 1 and 2.

#### ACTION:

- a. With the drop time of any full-length CEA determined to exceed the above limit, restore the CEA drop time to within the above limit prior to proceeding to MODE 1 or 2.

#### SURVEILLANCE REQUIREMENTS

---

4.1.3.4 The CEA drop time of full-length CEAs shall be demonstrated through measurement prior to reactor criticality:

- a. For all CEAs following each removal and reinstallation of the reactor vessel head,
- b. For specifically affected individual CEAs following any maintenance on or modification to the CEA drive system which could affect the drop time of those specific CEAs, and
- c. At least once per 18 months.



FINAL DRAFT

REACTIVITY CONTROL SYSTEMS

SHUTDOWN CEA INSERTION LIMIT

LIMITING CONDITION FOR OPERATION

---

3.1.3.5 All shutdown CEAs shall be withdrawn to at least 144.75 inches.

APPLICABILITY: MODES 1 and 2\*#.

ACTION:

With a maximum of one shutdown CEA withdrawn to less than 144.75 inches, except for surveillance testing pursuant to Specification 4.1.3.1.2, within 1 hour either:

- a. Withdraw the CEA to at least 144.75 inches, or
- b. Declare the CEA inoperable and apply Specification 3.1.3.1.

SURVEILLANCE REQUIREMENTS

---

4.1.3.5 Each shutdown CEA shall be determined to be withdrawn to at least 144.75 inches:

- a. Within 15 minutes prior to withdrawal of any CEAs in regulating groups during an approach to reactor criticality, and
- b. At least once per 12 hours thereafter.

---

\* See Special Test Exception 3.10.2.

#With  $K_{eff}$  greater than or equal to 1.

## REACTIVITY CONTROL SYSTEMS

### REGULATING CEA INSERTION LIMITS

#### LIMITING CONDITION FOR OPERATION

3.1.3.6 The regulating CEA groups shall be limited to the withdrawal sequence, and to the insertion limits## shown on Figure 3.1-3\*\* when the COLSS is in service or shown on Figure 3.1-4\*\* when the COLSS is not in service. The CEA insertion between the Long Term Steady State Insertion Limits and the Transient Insertion Limits is restricted to:

- a. Less than or equal to 4 hours per 24 hour interval,
- b. Less than or equal to 5 Effective Full Power Days per 30 Effective Full Power Day interval, and
- c. Less than or equal to 14 Effective Full Power Days per 18 Effective Full Power Months.

APPLICABILITY: MODES 1\* and 2\*#.

#### ACTION:

- a. With the regulating CEA groups inserted beyond the Transient Insertion Limits, except for surveillance testing pursuant to Specification 4.1.3.1.2, within 2 hours either:
  1. Restore the regulating CEA groups to within the limits, or
  2. Reduce THERMAL POWER to less than or equal to that fraction of RATED THERMAL POWER which is allowed by the CEA group position using Figures 3.1-3 or 3.1-4.
- b. With the regulating CEA groups inserted between the Long Term Steady State Insertion Limits and the Transient Insertion Limits for intervals greater than 4 hours per 24 hour interval, operation may proceed provided either:
  1. The Short Term Steady State Insertion Limits of Figure 3.1-3 or Figure 3.1-4 are not exceeded, or
  2. Any subsequent increase in THERMAL POWER is restricted to less than or equal to 5% of RATED THERMAL POWER per hour.

\*See Special Test Exceptions 3.10.2 and 3.10.4.

#With  $K_{eff}$  greater than or equal to 1.

\*\*CEAs are fully withdrawn in accordance with Figure 3.1-3 or Figure 3.1-4 when withdrawn to at least 144.75 inches.

##Following a reactor power cutback in which (1) Regulating Group 5 or Regulating Groups 4 and 5 are dropped or (2) Regulating Group 5 or Regulating Groups 4 and 5 are dropped and the remaining Regulating Groups (Groups 1, 2, 3, and 4) sequentially inserted, the Transient Insertion Limit of Figure 3.1-3 or Figure 3.1-4 can be exceeded for up to 2 hours.

## REACTIVITY CONTROL SYSTEMS

FINAL DRAFT

### ACTION: (Continued)

- c. With the regulating CEA groups inserted between the Long Term Steady State Insertion Limits and the Transient Insertion Limits for intervals greater than 5 EFPD per 30 EFPD interval or greater than 14 EFPD per 18 Effective Full Power Months, either:
  1. Restore the regulating groups to within the Long Term Steady State Insertion Limits within 2 hours, or
  2. Be in at least HOT STANDBY within 6 hours.

### SURVEILLANCE REQUIREMENTS

- 4.1.3.6 The position of each regulating CEA group shall be determined to be within the Transient Insertion Limits at least once per 12 hours except during time intervals when the PDIL Auctioneer Alarm Circuit is inoperable, then verify the individual CEA positions at least once per 4 hours. The accumulated times during which the regulating CEA groups are inserted beyond the Long Term Steady State Insertion Limits but within the Transient Insertion Limits shall be determined at least once per 24 hours.

FINAL DRAFT

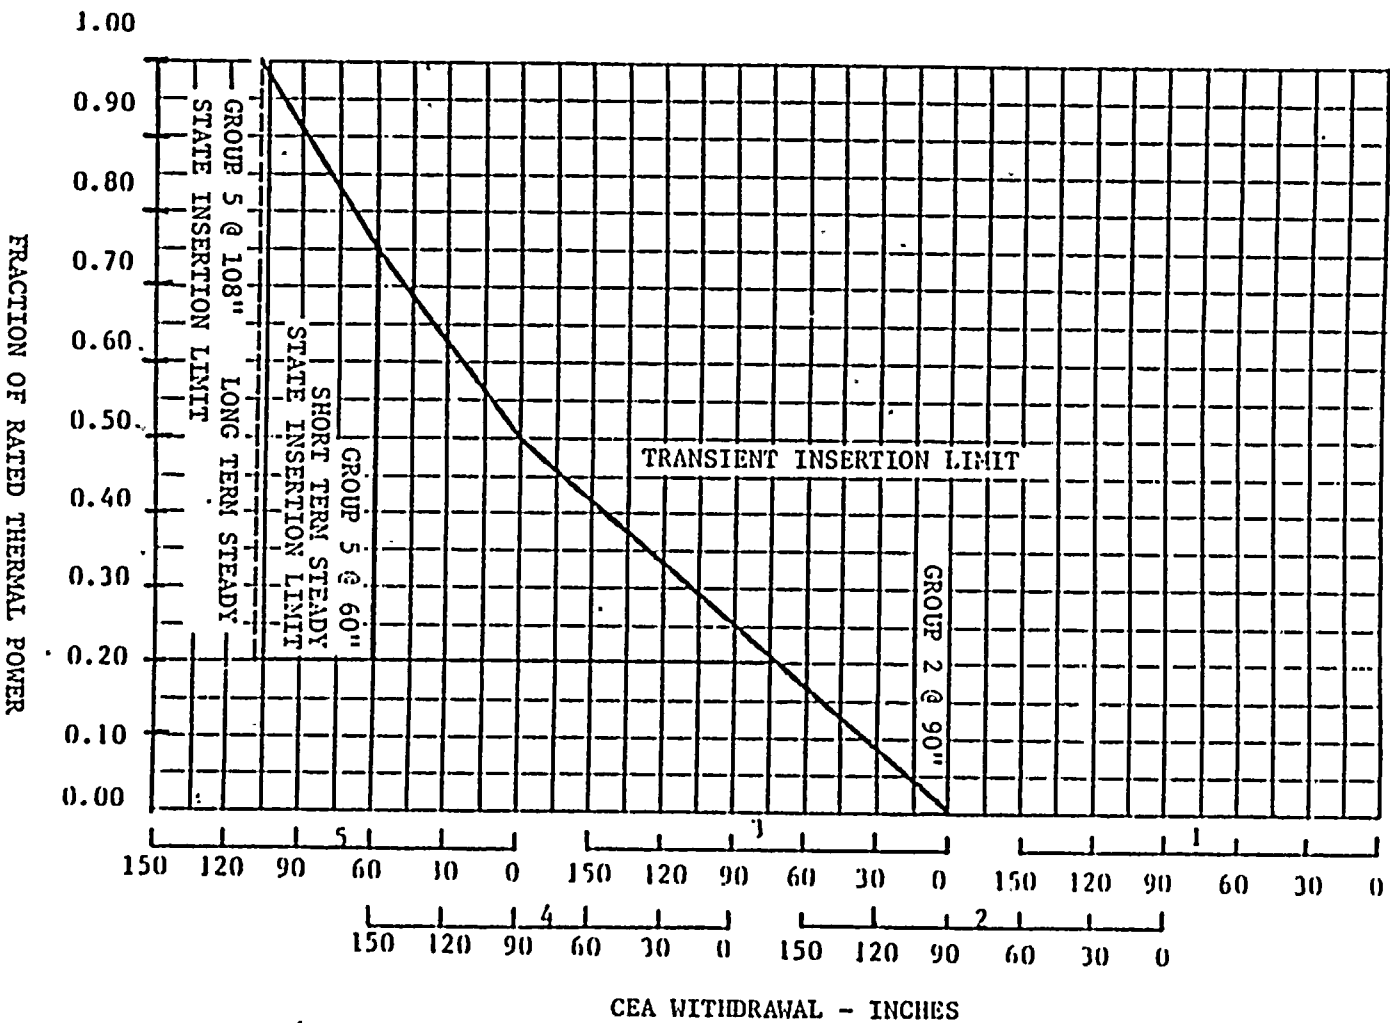


FIGURE 3.1-3

CEA INSERTION LIMITS VS THERMAL POWER  
(COLSS IN SERVICE)

FINAL DRAFT

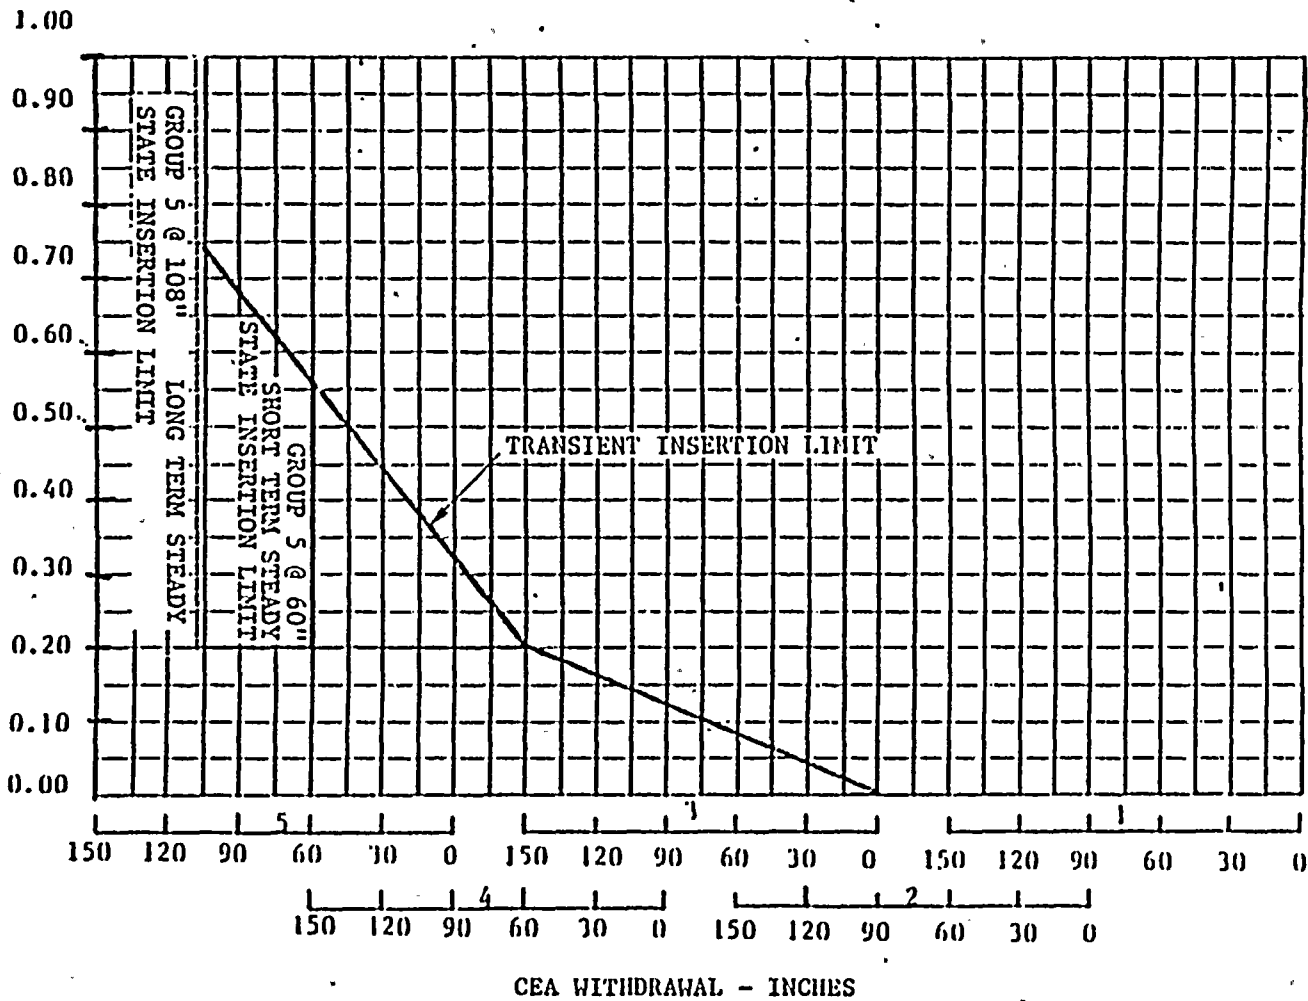


FIGURE 3.1-4

CEA INSERTION LIMITS VS THERMAL POWER  
(COLSS OUT OF SERVICE)

From V-CE-19028 of 9/22/83

3/4.2 POWER DISTRIBUTION LIMITS

3/4 2.1 LINEAR HEAT RATE

LIMITING CONDITION FOR OPERATION

---

3.2.1 The linear heat rate shall not exceed 14.0 kW/ft.

APPLICABILITY: MODE 1 above 20% of RATED THERMAL POWER.

ACTION:

With the linear heat rate exceeding its limits, as indicated by either (1) the COLSS-calculated core power exceeding the COLSS calculated core power operating limit based on kW/ft; or (2) when the COLSS is not being used, any OPERABLE Local Power Density channel exceeding the linear heat rate limit, within 15 minutes initiate corrective action to reduce the linear heat rate to within the limits and either:

- a. Restore the linear heat rate to within its limits within 1 hour, or
- b. Reduce THERMAL POWER to less than or equal to 20% of RATED THERMAL POWER within the next 6 hours.

SURVEILLANCE REQUIREMENTS

---

4.2.1.1 The provisions of Specification 4.0.4 are not applicable.

4.2.1.2 The linear heat rate shall be determined to be within its limits when THERMAL POWER is above 20% of RATED THERMAL POWER by continuously monitoring the core power distribution with the Core Operating Limit Supervisory System (COLSS) or, with the COLSS out of service, by verifying at least once per 2 hours that the linear heat rate, as indicated on all OPERABLE Local Power Density channels, is less than or equal to 14.0 kW/ft.

4.2.1.3 At least once per 31 days, the COLSS Margin Alarm shall be verified to actuate at a THERMAL POWER level less than or equal to the core power operating limit based on 14.0 kW/ft.

## POWER DISTRIBUTION LIMITS

### 3/4.2.2 PLANAR RADIAL PEAKING FACTORS - $F_{xy}$

#### LIMITING CONDITION FOR OPERATION

3.2.2 The measured PLANAR RADIAL PEAKING FACTORS ( $F_{xy}^m$ ) shall be less than or equal to the PLANAR RADIAL PEAKING FACTORS ( $F_{xy}^c$ ) used in the Core Operating Limit Supervisory System (COLSS) and in the Core Protection Calculators (CPC).

APPLICABILITY: MODE 1 above 20% of RATED THERMAL POWER.\*

#### ACTION:

With an  $F_{xy}^m$  exceeding a corresponding  $F_{xy}^c$ , within 6 hours either:

- a. Adjust the CPC addressable constants to increase the multiplier applied to planar radial peaking by a factor equivalent to greater than or equal to  $F_{xy}^m/F_{xy}^c$  and restrict subsequent operation so that a margin to the COLSS operating limits of at least  $[(F_{xy}^m/F_{xy}^c) - 1.0] \times 100\%$  is maintained; or
- b. Adjust the affected PLANAR RADIAL PEAKING FACTORS ( $F_{xy}^c$ ) used in the COLSS and CPC to a value greater than or equal to the measured PLANAR RADIAL PEAKING FACTORS ( $F_{xy}^m$ ) or
- c. Reduce THERMAL POWER to less than or equal to 20% of RATED THERMAL POWER.

#### SURVEILLANCE REQUIREMENTS

4.2.2.1 The provisions of Specification 4.0.4 are not applicable.

4.2.2.2 The measured PLANAR RADIAL PEAKING FACTORS ( $F_{xy}^m$ ) obtained by using the incore detection system, shall be determined to be less than or equal to the PLANAR RADIAL PEAKING FACTORS ( $F_{xy}^c$ ), used in the COLSS and CPC at the following intervals:

- a. After each fuel loading with THERMAL POWER greater than 40% but prior to operation above 70% of RATED THERMAL POWER, and
- b. At least once per 31 Effective Full Power Days.

\*See Special Test Exception 3.10.2.

## POWER DISTRIBUTION LIMITS

### 3/4.2.3 AZIMUTHAL POWER TILT - $T_q$

#### LIMITING CONDITION FOR OPERATION

---

3.2.3 The AZIMUTHAL POWER TILT ( $T_q$ ) shall be less than or equal to the AZIMUTHAL POWER TILT Allowance used in the Core Protection Calculators (CPCs).

APPLICABILITY: MODE 1 above 20% of RATED THERMAL POWER.\*

#### ACTION:

- a. With the measured AZIMUTHAL POWER TILT determined to exceed the AZIMUTHAL POWER TILT Allowance used in the CPCs but less than or equal to 0.10, within 2 hours either correct the power tilt or adjust the AZIMUTHAL POWER TILT Allowance used in the CPCs to greater than or equal to the measured value.
- b. With the measured AZIMUTHAL POWER TILT determined to exceed 0.10:
  1. Due to misalignment of either a part-length or full-length CEA, within 30 minutes verify that the Core Operating Limit Supervisory System (COLSS) (when COLSS is being used to monitor the core power distribution per Specifications 4.2.1 and 4.2.4) is detecting the CEA misalignment.
  2. Verify that the AZIMUTHAL POWER TILT is within its limit within 2 hours after exceeding the limit or reduce THERMAL POWER to less than 50% of RATED THERMAL POWER within the next 2 hours and verify that the Variable Overpower Trip Setpoint has been reduced as appropriate within the next 4 hours.
  3. Identify and correct the cause of the out of limit condition prior to increasing THERMAL POWER; subsequent POWER OPERATION above 50% of RATED THERMAL POWER may proceed provided that the AZIMUTHAL POWER TILT is verified within its limit at least once per hour for 12 hours or until verified acceptable at 95% or greater RATED THERMAL POWER.

---

\* See Special Test Exception 3.10.2.





FINAL DRAFT

POWER DISTRIBUTION LIMITS

SURVEILLANCE REQUIREMENTS

---

4.2.3.1 The provisions of Specification 4.0.4 are not applicable.

4.2.3.2 The AZIMUTHAL POWER TILT shall be determined to be within the limit above 20% of RATED THERMAL POWER by:

- a. Continuously monitoring the tilt with COLSS when the COLSS is OPERABLE.
- b. Calculating the tilt at least once per 12 hours when the COLSS is inoperable.
- c. Verifying at least once per 31 days, that the COLSS Azimuthal Tilt Alarm is actuated at an AZIMUTHAL POWER TILT less than or equal to the AZIMUTHAL POWER TILT Allowance used in the CPCs.
- d. Using the incore detectors at least once per 31 EFPD to independently confirm the validity of the COLSS calculated AZIMUTHAL POWER TILT.

## POWER DISTRIBUTION LIMITS

### 3/4.2.4 DNBR MARGIN

#### LIMITING CONDITION FOR OPERATION

3.2.4 The DNBR margin shall be maintained by operating within the Region of Acceptable Operation of Figure 3.2-1 or 3.2-2, as applicable, or in accordance with the requirements of Action 6 of Table 3.3-1.

APPLICABILITY: MODE 1 above 20% of RATED THERMAL POWER.

#### ACTION:

With operation outside of the region of acceptable operation, as indicated by either (1) the COLSS calculated core power exceeding the COLSS calculated core power operating limit based on DNBR; or (2) when the COLSS is not being used, any OPERABLE Low DNBR channel below the DNBR limit, within 15 minutes initiate corrective action to restore either the DNBR core power operating limit or the DNBR to within the limits and either:

- a. Restore the DNBR core power operating limit or DNBR to within its limits within 1 hour, or
- b. Reduce THERMAL POWER to less than or equal to 20% of RATED THERMAL POWER within the next 6 hours.

#### SURVEILLANCE REQUIREMENTS

4.2.4.1 The provisions of Specification 4.0.4 are not applicable.

4.2.4.2 The DNBR shall be determined to be within its limits when THERMAL POWER is above 20% of RATED THERMAL POWER by continuously monitoring the core power distribution with the Core Operating Limit Supervisory System (COLSS) or, with the COLSS out of service, by verifying at least once per 2 hours that the DNBR margin, as indicated on all OPERABLE DNBR margin channels, is within the limit shown on Figure 3.2-2.

4.2.4.3 At least once per 31 days, the COLSS Margin Alarm shall be verified to actuate at a THERMAL POWER level less than or equal to the core power operating limit based on DNBR.

4.2.4.4 The following DNBR or equivalent penalty factors shall be verified to be included in the COLSS and CPC DNBR calculations at least once per 31 EFPD.

Burnup $\left(\frac{\text{GWD}}{\text{MTU}}\right)$	DNBR Penalty (%) <sup>*</sup>
0-10	0.5
10-20	1.0
20-30	2.0
30-40	3.5
40-50	5.5

<sup>\*</sup>The penalty for each batch will be determined from the batch's maximum burnup assembly and applied to the batch's maximum radial power peak assembly. A single net penalty for COLSS and CPC will be determined from the penalties associated with each batch accounting for the offsetting margins due to the lower radial power peaks in the higher burnup batches.

FINAL DRAFT

FIGURE 3.2-1  
DNBR MARGIN OPERATING LIMIT BASED ON COLSS  
(COLSS IN SERVICE)


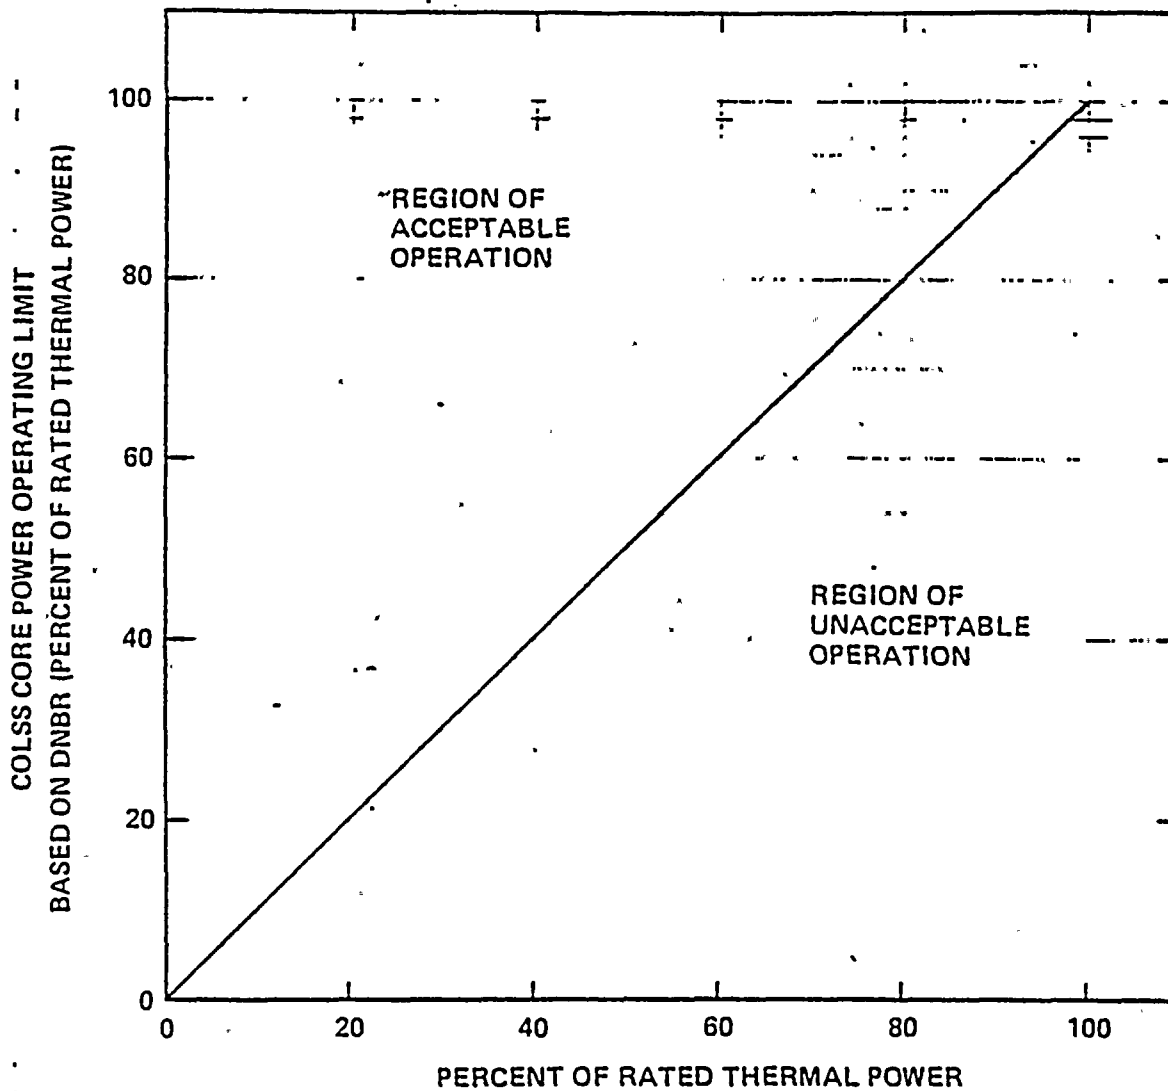


FIGURE 3.2-1  
DNBR MARGIN OPERATING LIMIT BASED ON COLSS  
(COLSS IN SERVICE)

FINAL DRAFT

FIGURE 3.2-2  
DNBR MARGIN OPERATING LIMIT BASED ON CORE PROTECTION CALCULATOR  
(COLSS OUT OF SERVICE)

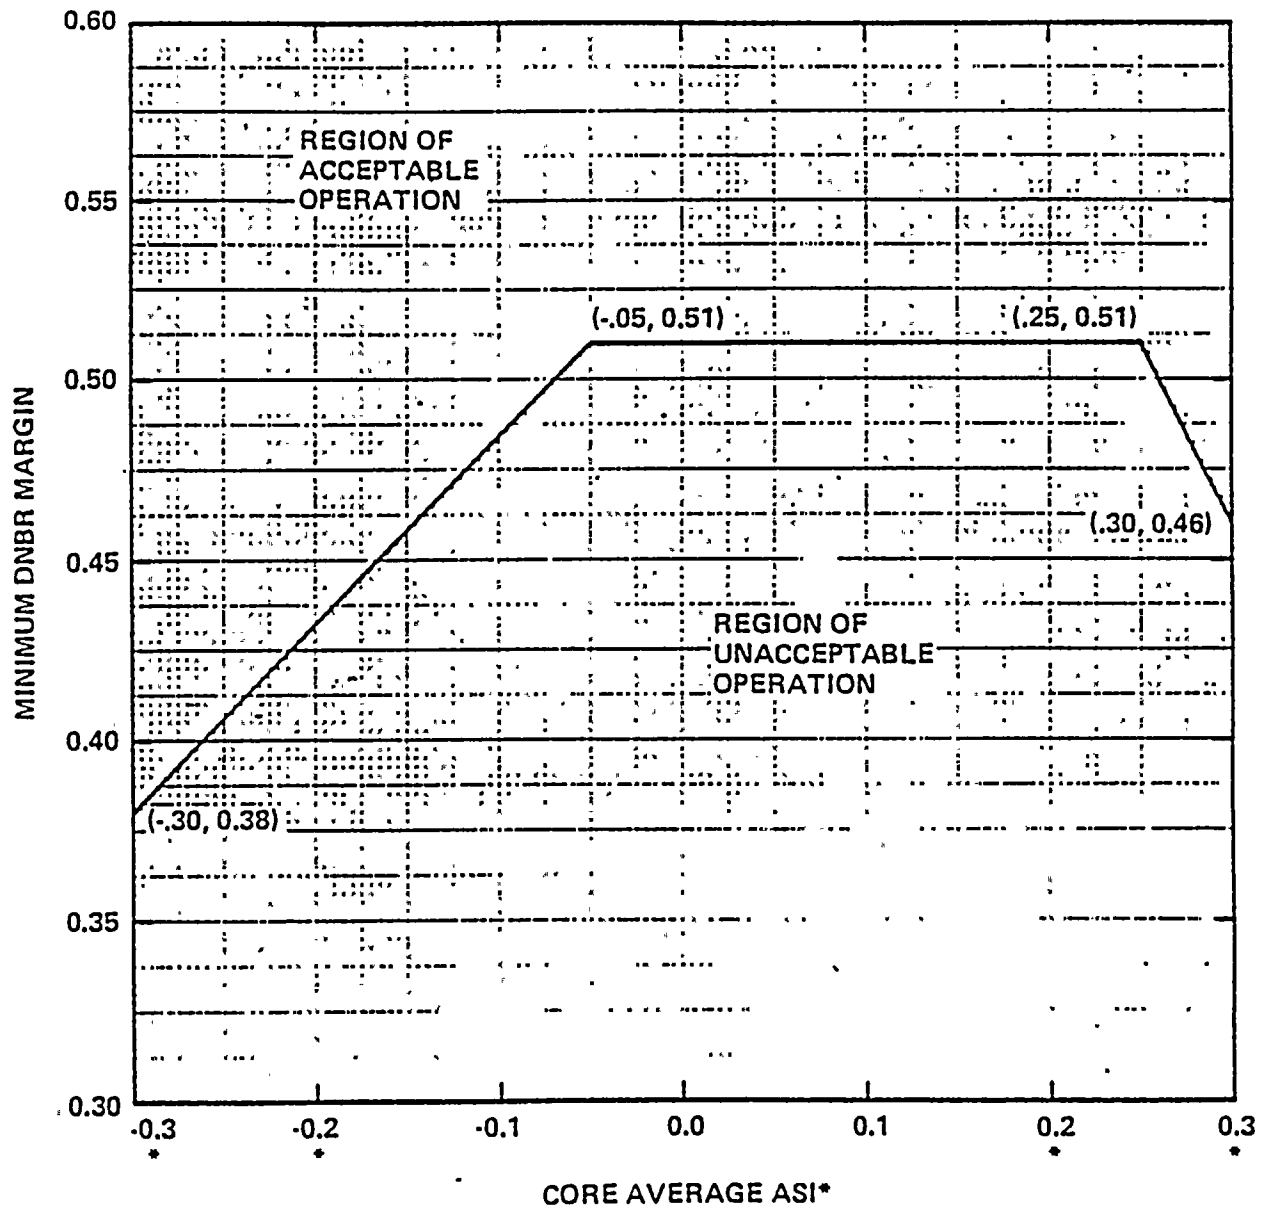

\*SEE SECTION 3.2.7 FOR THE ASI OPERATING LIMITS

FIGURE 3.2-2  
DNBR MARGIN OPERATING LIMIT BASED ON CORE PROTECTION CALCULATORS  
(COLSS OUT OF SERVICE)

FINAL DRAFT

POWER DISTRIBUTION LIMITS

3/4.2.5 RCS FLOW RATE

LIMITING CONDITION FOR OPERATION

3.2.5 The actual Reactor Coolant System total flow rate shall be greater than or equal to  $164.0 \times 10^6$  lbm/hr.

APPLICABILITY: MODE 1.

ACTION:

With the actual Reactor Coolant System total flow rate determined to be less than the above limit, reduce THERMAL POWER to less than 5% of RATED THERMAL POWER within the next 4 hours.

SURVEILLANCE REQUIREMENTS

4.2.5 The actual Reactor Coolant System total flow rate shall be determined to be greater than its limit at least once per 12 hours.

OR EQUAL TO

FINAL DRAFT

## POWER DISTRIBUTION LIMITS

### 3/4.2.6 REACTOR COOLANT COLD LEG TEMPERATURE

#### LIMITING CONDITION FOR OPERATION

3.2.6 The reactor coolant cold leg temperature ( $T_c$ ) shall be within the Area of Acceptable Operation shown in Figure 3.2-3.

APPLICABILITY: MODE 1\* and 2\*

#### ACTION:

With the reactor coolant cold leg temperature exceeding its limit, restore the temperature to within its limit within 2 hours or ~~reduce THERMAL POWER to less than 30% of RATED THERMAL POWER within the next 4 hours.~~ BE IN HOT STANDBY |  
WITHIN THE NEXT 6 HOURS.

#### SURVEILLANCE REQUIREMENTS

4.2.6 The reactor coolant cold leg temperature shall be determined to be within its limit at least once per 12 hours.

\*See Special Test Exception 3.10.4.

FINAL DRAFT

SEE  
NEW  
GRAPH

FIGURE 3.2-3  
REACTOR COOLANT COLD LEG TEMPERATURE vs CORE POWER LEVEL


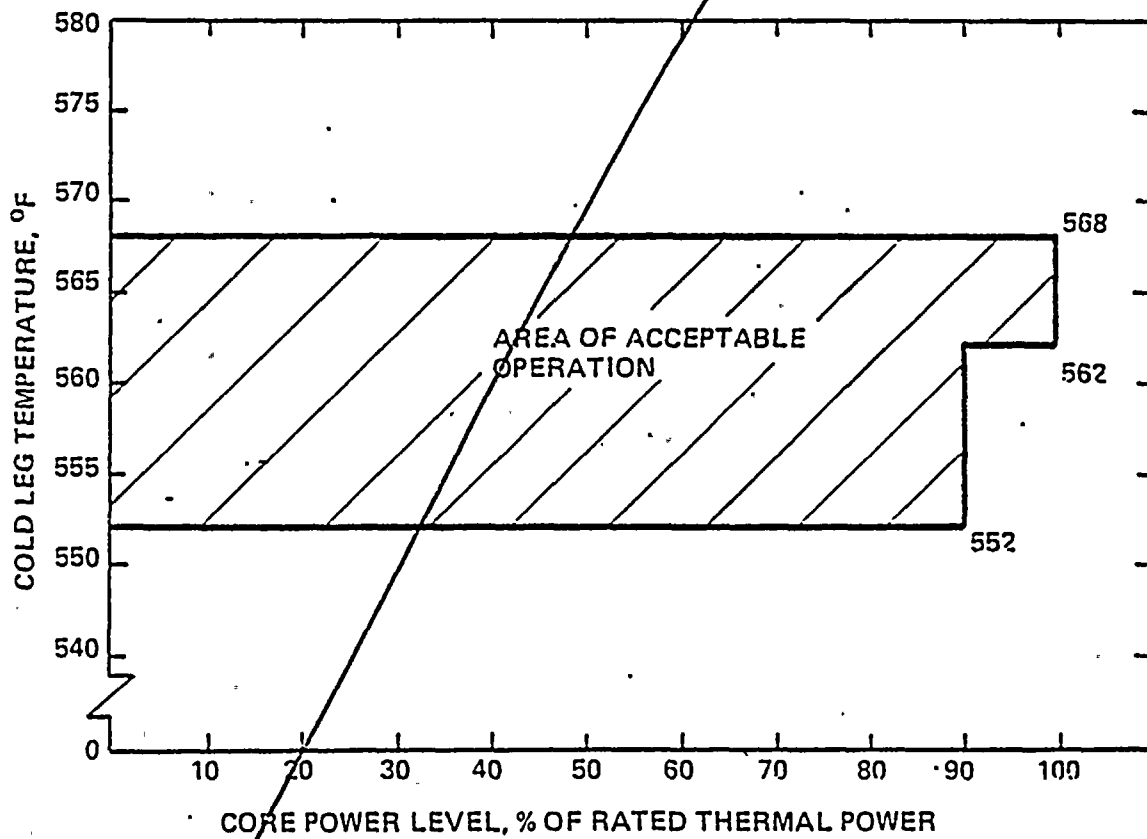


FIGURE 3.2-3  
REACTOR COOLANT COLD LEG TEMPERATURE VS CORE POWER LEVEL



FIGURE 3.2-3  
REACTOR COOLANT COLD LEG TEMPERATURE vs CORE POWER LEVEL

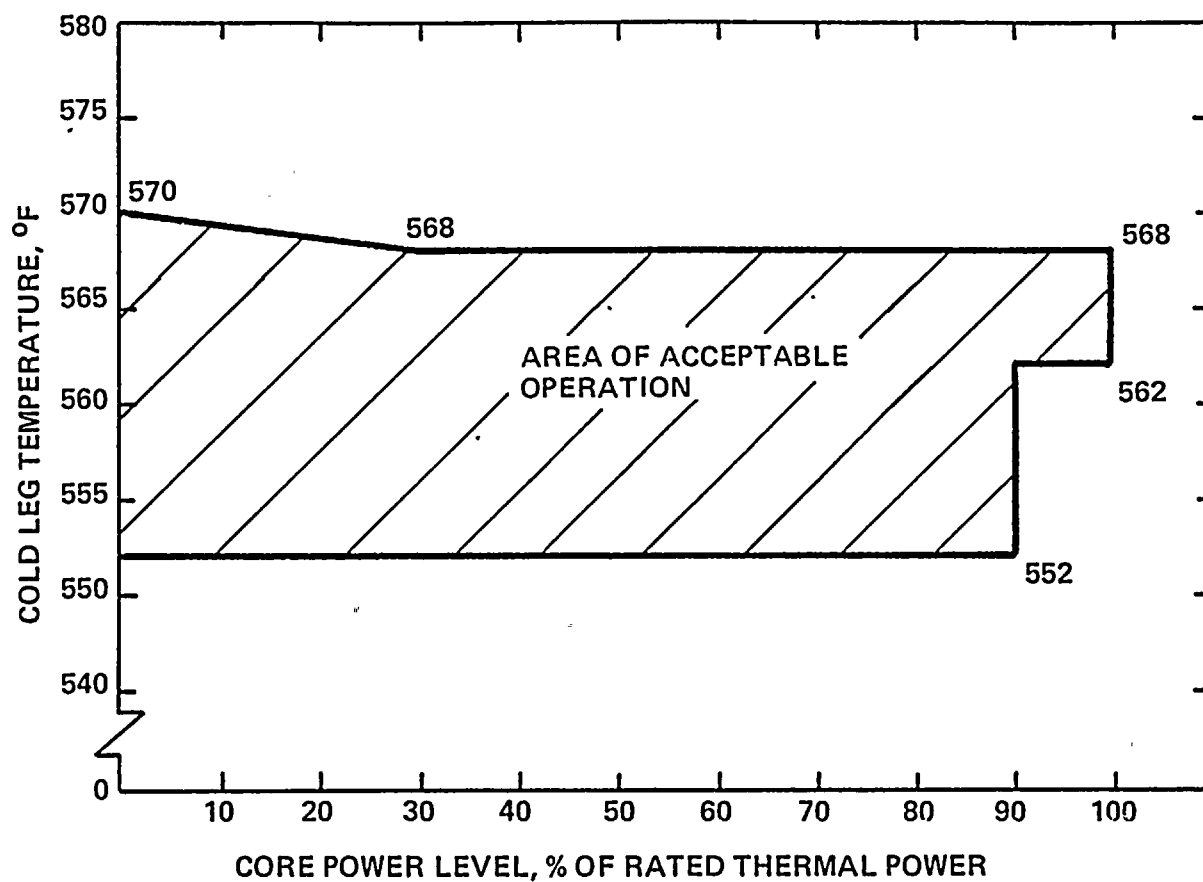

FINAL DRAFT

POWER DISTRIBUTION LIMITS

3/4.2.7 AXIAL SHAPE INDEX

LIMITING CONDITION FOR OPERATION

---

3.2.7 The core average AXIAL SHAPE INDEX (ASI) shall be maintained within the following limits:

- a. COLSS OPERABLE  
 $-0.28 \leq \text{ASI} \leq 0.28$
- b. COLSS OUT OF SERVICE (CPC)  
 $-0.20 \leq \text{ASI} \leq +0.20$

APPLICABILITY: MODE 1 above 20% of RATED THERMAL POWER\*.

ACTION:

With the core average AXIAL SHAPE INDEX outside its above limits, restore the core average ASI to within its limit within 2 hours or reduce THERMAL POWER to less than 20% of RATED THERMAL POWER within the next 4 hours.

SURVEILLANCE REQUIREMENTS

---

4.2.7 The core average AXIAL SHAPE INDEX shall be determined to be within its limit at least once per 12 hours using the COLSS or any OPERABLE Core Protection Calculator channel.

---

\* See Special Test Exception 3.10.2.

FINAL DRAFT

POWER DISTRIBUTION LIMITS

3/4.2.8 PRESSURIZER PRESSURE

LIMITING CONDITION FOR OPERATION

3.2.8 The pressurizer pressure shall be maintained between 1815 psia and 2370 psia.

APPLICABILITY: MODES 1 and 2.\*

ACTION:

With the pressurizer pressure outside its above limits, restore the pressure to within its limit within 2 hours or be in at least HOT STANDBY within the next 6 hours.

SURVEILLANCE REQUIREMENTS

4.2.8 The pressurizer pressure shall be determined to be within its limit at least once per 12 hours.

\* SEE SPECIAL TEST EXCEPTION 3.10.5

### 3/4.3 INSTRUMENTATION

#### 3/4.3.1 REACTOR PROTECTIVE INSTRUMENTATION

##### LIMITING CONDITION FOR OPERATION

---

3.3.1 As a minimum, the reactor protective instrumentation channels and bypasses of Table 3.3-1 shall be OPERABLE with RESPONSE TIMES as shown in Table 3.3-2.

APPLICABILITY: As shown in Table 3.3-1.

ACTION:

As shown in Table 3.3-1.

##### SURVEILLANCE REQUIREMENTS

---

4.3.1.1 Each reactor protective instrumentation channel shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL CALIBRATION and CHANNEL FUNCTIONAL TEST operations for the MODES and at the frequencies shown in Table 4.3-1.

4.3.1.2 The logic for the bypasses shall be demonstrated OPERABLE prior to each reactor startup unless performed during the preceding 92 days. The total bypass function shall be demonstrated OPERABLE at least once per 18 months during CHANNEL CALIBRATION testing of each channel affected by bypass operation.

4.3.1.3 The REACTOR TRIP SYSTEM RESPONSE TIME of each reactor trip function shall be demonstrated to be within its limit at least once per 18 months. Each test shall include at least one channel per function such that all channels are tested at least once every N times 18 months where N is the total number of redundant channels in a specific reactor trip function as shown in the "Total No. of Channels" column of Table 3.3-1.

4.3.1.4 The isolation characteristics of each CEA isolation amplifier shall be verified at least once per 18 months during the shutdown per the following tests for the CEA position isolation amplifiers:

- a. With 120 volts A.C. (60 Hz) applied for at least 30 seconds across the output, the reading on the input does not change by more than 0.015 volt D.C. with an applied input voltage of 5-10 volts D.C.



FINAL DRAFT

INSTRUMENTATION

SURVEILLANCE REQUIREMENTS (Continued)

---

- b. With 120 volts A.C. (60 Hz) applied for at least 30 seconds across the input, the reading on the output does not exceed 15 volts D.C.

4.3.1.5 The Core Protection Calculators shall be determined OPERABLE at least once per 12 hours by verifying that less than three auto restarts have occurred on each calculator during the past 12 hours. The auto restart periodic tests Restart (Code 30) and Normal System Load (Code 33) shall not be included in this total.

4.3.1.6 The Core Protection Calculators shall be subjected to a CHANNEL FUNCTIONAL TEST to verify OPERABILITY within 12 hours of receipt of a High CPC Cabinet Temperature alarm.

TABLE 3.3-1  
REACTOR PROTECTIVE INSTRUMENTATION

<u>FUNCTIONAL UNIT</u>	<u>TOTAL NO. OF CHANNELS</u>	<u>CHANNELS TO TRIP</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABLE MODES</u>	<u>ACTION</u>
<b>I. TRIP GENERATION</b>					
<b>A. Process</b>					
1. Pressurizer Pressure - High	4	2	3	1, 2	2 <sup>#</sup> , 3 <sup>#</sup>
2. Pressurizer Pressure - Low	4	2 (b)	3	1, 2	2 <sup>#</sup> , 3 <sup>#</sup>
3. Steam Generator Level - Low	4/SG	2/SG	3/SG	1, 2	2 <sup>#</sup> , 3 <sup>#</sup>
4. Steam Generator Level - High	4/SG	2/SG	3/SG	1, 2	2 <sup>#</sup> , 3 <sup>#</sup>
5. Steam Generator Pressure - Low	4/SG	2/SG	3/SG	1, 2, 3*, 4*	2 <sup>#</sup> , 3 <sup>#</sup>
6. Containment Pressure - High	4	2	3	1, 2	2 <sup>#</sup> , 3 <sup>#</sup>
7. Reactor Coolant Flow - Low	4/SG	2/SG	3/SG	1, 2	2 <sup>#</sup> , 3 <sup>#</sup>
8. Local Power Density - High	4	2 (c)(d)	3	1, 2	2 <sup>#</sup> , 3 <sup>#</sup>
9. DNBR - Low	4	2 (c)(d)	3	1, 2	2 <sup>#</sup> , 3 <sup>#</sup>
<b>B. Excore Neutron Flux</b>					
1. Variable Overpower Trip	4	2	3	1, 2	2 <sup>#</sup> , 3 <sup>#</sup>
2. Logarithmic Power Level - High					
a. Startup and Operating	4	2 (a)(d)	3	1, 2	2 <sup>#</sup> , 3 <sup>#</sup>
	4	2	3	3*, 4*, 5*	8
b. Shutdown	4	0	2	3, 4, 5	4
<b>C. Core Protection Calculator System</b>					
1. CEA Calculators	2	1	2 (e)	1, 2	6, 7
2. Core Protection Calculators	4	2 (c)(d)	3	1, 2	2 <sup>#</sup> , 3 <sup>#</sup> , 7

RECEIVED  
1971

REACTOR PROTECTIVE INSTRUMENTATION

<u>FUNCTIONAL UNIT</u>	<u>TOTAL NO. OF CHANNELS</u>	<u>CHANNELS TO TRIP</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABLE MODES</u>	<u>ACTION</u>
D. Supplementary Protection System					
Pressurizer Pressure - High	4 (f)	2	3	1, 2	8
II. RPS LOGIC					
A. Matrix Logic	6	1	3	1, 2	1
	6	1	3	3*, 4*, 5*	8
B. Initiation Logic	4	2	4	1, 2	5
	4	2	4	3*, 4*, 5*	8
III. RPS ACTUATION DEVICES					
A. Reactor Trip Breaker	4 (f)	2	4	1, 2	5
	4 (f)	2	4	3*, 4*, 5*	8
B. Manual Trip	4 (f)	2	4	1, 2	5
	4 (f)	2	4	3*, 4*, 5*	8

**F**



TABLE 3.3-1 (Continued)

TABLE NOTATIONS

\*With the protective system trip breakers in the closed position, the CEA drive system capable of CEA withdrawal, and fuel in the reactor vessel.

#The provisions of Specification 3.0.4 are not applicable.

- (a) Trip may be manually bypassed above  $10^{-4}\%$  of RATED THERMAL POWER; bypass shall be automatically removed when THERMAL POWER is less than or equal to  $10^{-4}\%$  of RATED THERMAL POWER.
- (b) Trip may be manually bypassed below 400 psia; bypass shall be automatically removed whenever pressurizer pressure is greater than or equal to 500 psia.
- (c) Trip may be manually bypassed below 1% of RATED THERMAL POWER; bypass shall be automatically removed when THERMAL POWER is greater than or equal to 1% of RATED THERMAL POWER.
- (d) Trip may be bypassed during testing pursuant to Special Test Exception 3.10.3.
- (e) See Special Test Exception 3.10.2.
- (f) There are four channels, each of which is comprised of one of the four reactor trip breakers, arranged in a selective two-out-of-four configuration (i.e., one-out-of-two taken twice).

ACTION STATEMENTS

- ACTION 1 - With the number of channels OPERABLE one less than required by the Minimum Channels OPERABLE requirement, restore the inoperable channel to OPERABLE status within 48 hours or be in at least HOT STANDBY within the next 6 hours and/or open the protective system trip breakers.
- ACTION 2 - With the number of channels OPERABLE one less than the Total Number of Channels, STARTUP and/or POWER OPERATION may continue provided the inoperable channel is placed in the bypassed or tripped condition within 1 hour. If the inoperable channel is bypassed, the desirability of maintaining this channel in the bypassed condition shall be reviewed in accordance with Specification 6.5.1.6. The channel shall be returned to OPERABLE status no later than during the next COLD SHUTDOWN.



TABLE 3.3-1 (Continued)

ACTION STATEMENTS

With a channel process measurement circuit that affects multiple functional units inoperable or in test, bypass or trip all associated functional units as listed below:

Process Measurement Circuit	Functional Unit Bypassed/Tripped
1. Linear Power (Subchannel or Linear)	Variable Overpower (RPS) Local Power Density - High (RPS) DNBR - Low (RPS)
2. Pressurizer Pressure - High (Narrow Range)	Pressurizer Pressure - High (RPS) Local Power Density - High (RPS) DNBR - Low (RPS)
3. Steam Generator Pressure - Low	Steam Generator Pressure - Low Steam Generator Level 1-Low (ESF) Steam Generator Level 2-Low (ESF)
4. Steam Generator Level - Low (Wide Range)	Steam Generator Level - Low (RPS) Steam Generator Level 1-Low (ESF) Steam Generator Level 2-Low (ESF)
5. Core Protection Calculator	Local Power Density - High (RPS) DNBR - Low (RPS)

ACTION 3 - With the number of channels OPERABLE one less than the Minimum Channels OPERABLE requirement, STARTUP and/or POWER OPERATION may continue provided the following conditions are satisfied:

- Verify that one of the inoperable channels has been bypassed and place the other channel in the tripped condition within 1 hour, and
- All functional units affected by the bypassed/tripped channel shall also be placed in the bypassed/tripped condition as listed below:

Process Measurement Circuit	Functional Unit Bypassed/Tripped
1. Linear Power (Subchannel or Linear)	Variable Overpower (RPS) Local Power Density - High (RPS) DNBR - Low (RPS)
2. Pressurizer Pressure - High (Narrow Range)	Pressurizer Pressure - High (RPS) Local Power Density - High (RPS) DNBR - Low (RPS)



TABLE 3.3-1 (Continued)

## ACTION STATEMENTS

- |    |  |   |
|----|--|---|
| 3. | Steam Generator Pressure - Low           | Steam Generator Pressure - Low<br>Steam Generator Level 1-Low (ESF)<br>Steam Generator Level 2-Low (ESF)    |
| 4. | Steam Generator Level - Low (Wide Range) | Steam Generator Level - Low (RPS)<br>Steam Generator Level 1-Low (ESF)<br>Steam Generator Level 2-Low (ESF) |
| 5. | Core Protection Calculator               | Local Power Density - High (RPS)<br>DNBR - Low (RPS)  |

STARTUP and/or POWER OPERATION may continue until the performance of the next required CHANNEL FUNCTIONAL TEST. Subsequent STARTUP and/or POWER OPERATION may continue if one channel is restored to OPERABLE status and the provisions of ACTION 2 are satisfied.

ACTION 4 - With the number of channels OPERABLE one less than required by the Minimum Channels OPERABLE requirement, suspend all operations involving positive reactivity changes.

ACTION 5 - With the number of channels OPERABLE one less than required by the Minimum Channels OPERABLE requirement, STARTUP and/or POWER OPERATION may continue provided the reactor trip breaker of the inoperable channel is placed in the tripped condition within 1 hour, otherwise, be in at least HOT STANDBY within 6 hours; however, the trip breaker associated with the inoperable channel may be closed for up to 1 hour for surveillance testing per Specification 4.3.1.1.

ACTION 6 - a. With one CEAC inoperable, operation may continue for up to 7 days provided that at least once per 4 hours, each CEA is verified to be within 6.6 inches (indicated position) of all other CEAs in its group. After 7 days, operation may continue provided that the conditions of Action Item 6.b or 6.c are met.

b. With both CEACs inoperable and COLSS in service, operation may continue provided that:

1. Within 1 hour:

- a) Operation is restricted to the limits shown in Figure 3.3-1. The DNBR margin required by Specification 3.2.4 is replaced by this restriction when both CEAC's are inoperable and COLSS is in operation.
- b) The Linear Heat Rate Margin required by Specification 3.2.1 is maintained.
- c) The Reactor Power Cutback System is placed out of service.

TABLE 3.3-1 (Continued)

## ACTION STATEMENTS

This power restriction replaces the power restriction of Spec 3.1.3, otherwise Spec 3.1.3 movable assembly remains applicable

2. Within 4 hours:
  - a) All full-length and part-length CEA groups are withdrawn to and subsequently maintained at the "Full Out" position, except during surveillance testing pursuant to the requirements of Specification 4.1.3.1.2 or for control when CEA group 5 may be inserted no further than 127.5 inches withdrawn.
  - b) The "RSPT/CEAC Inoperable" addressable constant in the CPCs is set to be indicated that both CEAC's are inoperable.
  - c) The Control Element Drive Mechanism Control System (CEDMCS) is placed in and subsequently maintained in the "Standby" mode except during CEA group 5 motion permitted by a) above, when the CEDMCS may be operated in either the "Manual Group" or "Manual Individual" mode.
3. At least once per 4 hours, all full-length and part-length CEAs are verified fully withdrawn except during surveillance testing pursuant to Specification 4.1.3.1.2 or during insertion of CEA group 5 as permitted by 2.a) above, then verify at least once per 4 hours that the inserted CEAs are aligned within 6.6 inches (indicated position) of all other CEAs in its group.
4. Following a CEA misalignment with both CEAC's inoperable and COLSS in operation, operation may continue provided that within 1 hour:
  - a) The power is reduced to 85% of the pre-misaligned power but need not be reduced to less than 50% of RATED THERMAL POWER.
  - b) Refer to Section 3.1.3; movable control assemblies for further specification on CEA misalignment.
- c. With both CEACs inoperable and COLSS out-of-service, operation may continue provided that:
  1. Within 1 hour:
    - a) The existing CPC value of the CPC addressable constant "BERR1" is multiplied by 1.19 and the resulting value is re-entered into the CPCs.
    - b) The Reactor Power Cutback System is placed out of service.
    - c) The COLSS out of service Limit Line, Section 3.2.4, is not applicable to this mode of operation.

TABLE 3.3-1 (Continued)

## ACTION STATEMENTS

THIS POWER RESTRICTION REPLACES THE POWER RESTRICTION OF SPEC 3.1.3 OTHERWISE SPEC 3.1.3 MOVABLE CONTROL ASSEMBLY REMAINS APPLICABLE

2. Within 4 hours:
  - a) All full length and part length CEA groups are withdrawn to and subsequently maintained at the "Full Out" position, except during surveillance testing pursuant to the requirements of Specification 4.1.3.1.2 or for control when CEA group 5 may be inserted no further than 127.5 inches withdrawn.
  - b) The "RSPT/CEAC Inoperable" addressable constant in the CPCs is set to be indicated that both CEAC's are inoperable.
  - c) The Control Element Drive Mechanism Control System (CEDMCS) is placed in and subsequently maintained in the "Standby" mode except during CEA group 5 motion permitted by a) above, when the CEDMCS may be operated in either the "Manual Group" or "Manual Individual" mode.
3. At least once per 4 hours, all full length and part length CEAs are verified fully withdrawn except during surveillance testing pursuant to Specification 4.1.3.1.2 or during insertion of CEA group 5 as permitted by 2.a) above, then verify at least once per 4 hours that the inserted CEAs are aligned within 6.6 inches (indicated position) of all other CEAs in its group.
4. Following a CEA misalignment with both CEAC's and COLSS inoperable, operation may continue provided that within 1 hour:
  - a) The power is reduced to .85% of the pre-misaligned power but need not be reduced to less than 50% of RATED THERMAL POWER.
  - b) Refer to Section 3.1.3, movable control assemblies for further specifications on CEA misalignment.

ACTION 7 - With three or more auto restarts, excluding periodic auto restarts (Code 30 and Code 33), of one non-bypassed calculator during a 12-hour interval, demonstrate calculator OPERABILITY by performing a CHANNEL FUNCTIONAL TEST within the next 24 hours.

ACTION 8 - With the number of OPERABLE channels one less than the Minimum Channels OPERABLE requirement, restore ~~the~~ inoperable channel to OPERABLE status within 48 hours or open ~~the~~ affected reactor trip breaker within the next hour. <sup>AN</sup>

FIGURE 3.3-1  
DNBR MARGIN OPERATING LIMIT BASED ON COLSS FOR  
BOTH CEAC'S INOPERABLE

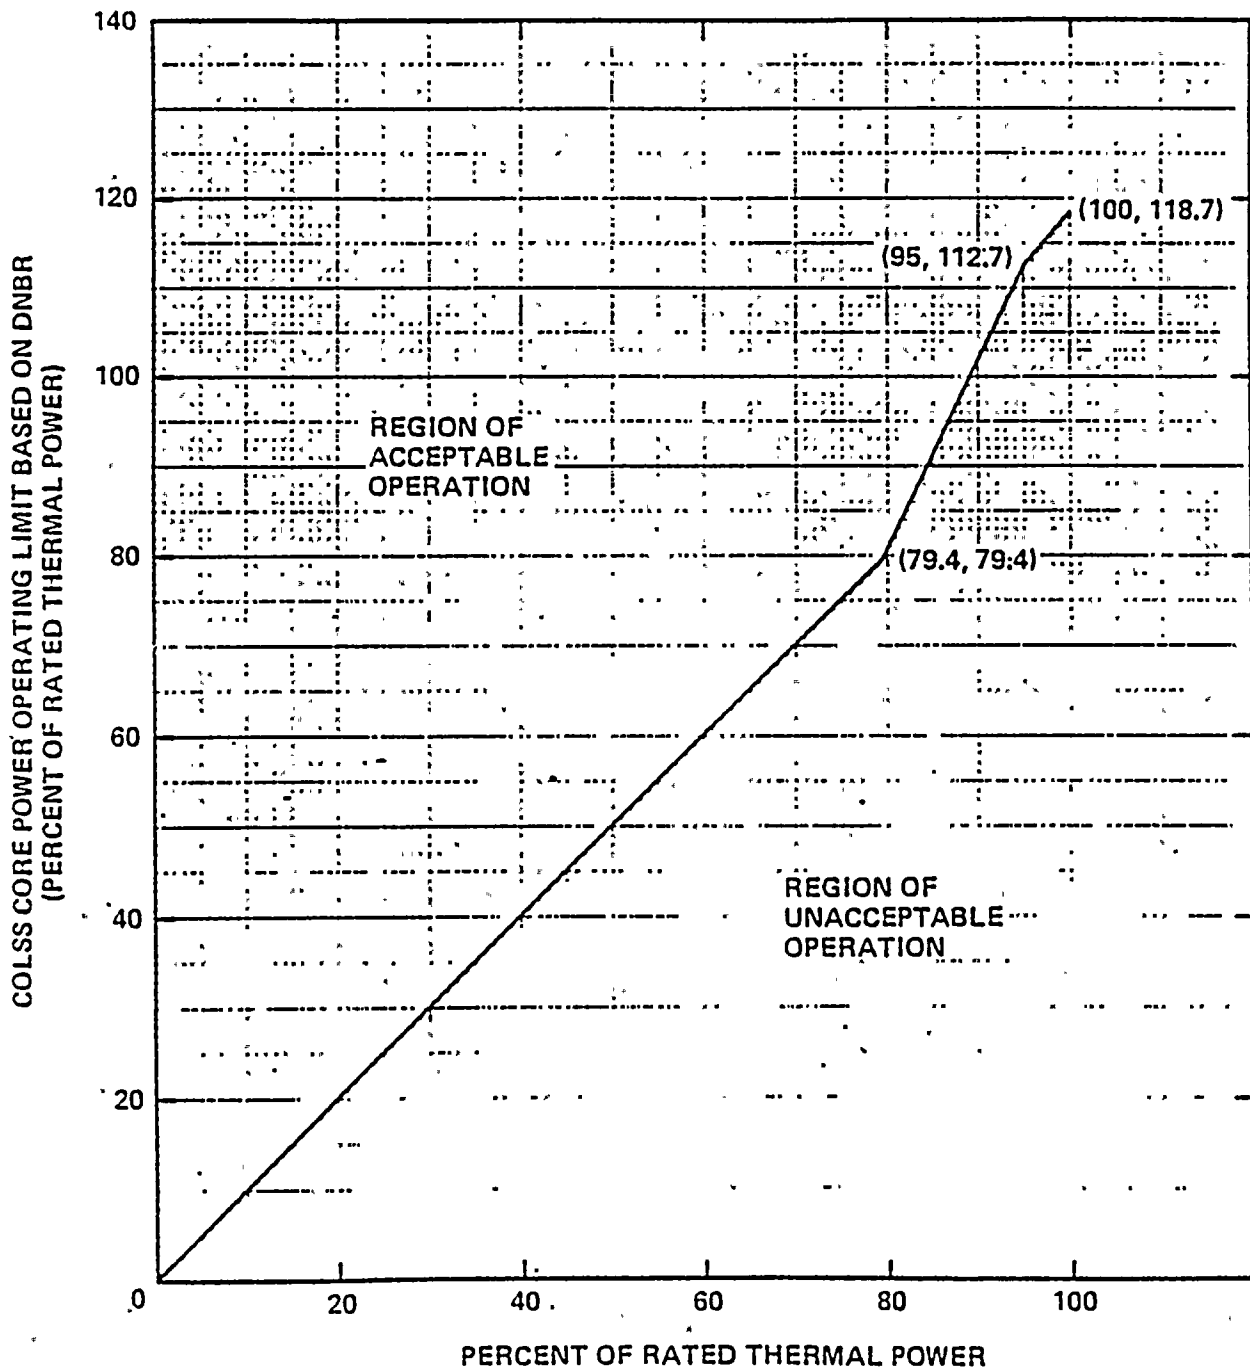






TABLE 3.3-2

REACTOR PROTECTIVE INSTRUMENTATION RESPONSE TIMES

<u>FUNCTIONAL UNIT</u>	<u>RESPONSE TIME</u>
I. TRIP GENERATION	
A. Process	
1. Pressurizer Pressure - High	≤ 1.15 seconds
2. Pressurizer Pressure - Low	≤ 1.15 seconds
3. Steam Generator Level - Low	≤ 1.15 seconds
4. Steam Generator Level - High	≤ 1.15 seconds
5. Steam Generator Pressure - Low	≤ 1.15 seconds
6. Containment Pressure - High	≤ 1.15 seconds
7. Reactor Coolant Flow - Low	≤ 0.65 second
8. Local Power Density - High	
a. Neutron Flux Power from Excore Neutron Detectors	≤ 0.75 second*
b. CEA Positions	≤ 1.35 second**
c. CEA Positions: CEAC Penalty Factor	≤ 0.75 second**
9. DNBR - Low	
a. Neutron Flux Power from Excore Neutron Detectors	≤ 0.75 second*
b. CEA Positions	≤ 1.35 second**
c. Cold Leg Temperature	≤ 0.75 second##
d. Hot Leg Temperature	≤ 0.75 second##
e. Primary Coolant Pump Shaft Speed	≤ 0.75 second#
f. Reactor Coolant Pressure from Pressurizer	≤ 0.75 second###
g. CEA Positions: CEAC Penalty Factor	≤ 0.75 second**
B. Excore Neutron Flux	
1. Variable Overpower Trip	≤ 0.55 second*
2. Logarithmic Power Level - High	
a. Startup and Operating	≤ 0.55 second^
b. Shutdown	≤ 0.55 second*

11  
 10  
 9  
 8  
 7  
 6  
 5  
 4  
 3  
 2  
 1



TABLE 3.3-2 (Continued)

REACTOR PROTECTIVE INSTRUMENTATION RESPONSE TIMES

<u>FUNCTIONAL UNIT</u>	<u>RESPONSE TIME</u>
C. Core Protection Calculator System	
1. CEA Calculators	Not Applicable
2. Core Protection Calculators	Not Applicable
D. Supplementary Protection System	
Pressurizer Pressure - High	≤ 1.15 second
II. RPS LOGIC	
A. Matrix Logic	Not Applicable
B. Initiation Logic	Not Applicable
III. RPS ACTUATION DEVICES	
A. Reactor Trip Breakers	Not Applicable
B. Manual Trip	Not Applicable

\* Neutron detectors are exempt from response time testing. The response time of the neutron flux signal portion of the channel shall be measured from the detector output or from the input of first electronic component in channel.

\*\* Response time shall be measured from the output of the sensor. Acceptable CEA sensor response shall be demonstrated by compliance with Specification 3.1.3.4.

#The pulse transmitters measuring pump speed are exempt from response time testing. The response time shall be measured from the pulse shaper input.

##Response time shall be measured from the output of the resistance temperature detector (sensor). RTD response time shall be measured at least once per 18 months. The measured response time of the slowest RTD shall be less than or equal to 13 seconds. Adjustments to the CPC addressable constants given in Table 3.3-2a shall be made to accommodate current values of the RTD time constants. If the RTD time constant for a CPC channel exceeds the value corresponding to the penalties currently in use, the affected channel(s) shall be declared inoperable until penalties appropriate to the new time constant are installed.

###Response time shall be measured from the output of the pressure transmitter. The transmitter response time shall be less than or equal to 0.7 second.

RECEIVED  
MAR 11 1974  
U.S. NUCLEAR REGULATORY COMMISSION  
WASHINGTON, D.C. 20545



FINAL DRAFT

TABLE 3.3-2a

INCREASES IN BERRO, BERR2, AND BERR4 VERSUS  
RTD DELAY TIMES

<u>RTD DELAY TIME</u> <u>(<math>\tau</math>)</u>	<u>BERRO</u> <u>INCREASE</u> <u>(%)</u>	<u>BERR2</u> <u>INCREASE</u> <u>(%)</u>	<u>BERR4</u> <u>INCREASE</u> <u>(%)</u>
$\tau \leq 8.0$ sec	0	0	0
$8.0 \text{ sec} < \tau \leq 10.0 \text{ sec}$	2.5	2.0	1.0
$10.0 \text{ sec} < \tau \leq 13.0 \text{ sec}$	6.0	4.0	6.0

NOTE: BERR term increases are not cumulative. For example, if the time constant changes from the range of  $8.0 < \tau \leq 10.0$  sec to the range  $10.0 < \tau \leq 13.0$ , the BERRO increase from its original ( $\tau \leq 8.0$  sec) value is 6.0 not  $2.5 + 6.0$ .

TABLE 4.3-1

REACTOR PROTECTIVE INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>FUNCTIONAL UNIT</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>CHANNEL FUNCTIONAL TEST</u>	<u>MODES IN WHICH SURVEILLANCE REQUIRED</u>
I. TRIP GENERATION				
A. Process				
1. Pressurizer Pressure - High	S	R	M	1, 2
2. Pressurizer Pressure - Low	S	R	M	1, 2
3. Steam Generator Level - Low	S	R	M	1, 2
4. Steam Generator Level - High	S	R	M	1, 2
5. Steam Generator Pressure - Low	S	R	M	1, 2, 3*, 4*
6. Containment Pressure - High	S	R	M	1, 2
7. Reactor Coolant Flow - Low	S	R	M	1, 2
8. Local Power Density - High	S	D (2, 4), R (4, 5)	M, R (6)	1, 2
9. DNBR - Low	S	D (2, 4), R (4, 5) M (8), S (7)	M, R (6)	1, 2
B. Excore Neutron Flux				
1. Variable Overpower Trip	S	D (2, 4), M (3, 4) Q (4)	M	1, 2
2. Logarithmic Power Level - High	S	R (4)	M and S/U (1)	1, 2, 3, 4, 5 and *
C. Core Protection Calculator System				
1. CEA Calculators	S	R	M, R (6)	1, 2
2. Core Protection Calculators	S	D (2, 4), R (4, 5) M (8), S (7)	M (9), R (6)	1, 2

RECEIVED  
JAN 10 1974

TABLE 4.3-1 (Continued)

REACTOR PROTECTIVE INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>FUNCTIONAL UNIT</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>CHANNEL FUNCTIONAL TEST</u>	<u>MODES IN WHICH SURVEILLANCE REQUIRED</u>
D. Supplementary Protection System				
Pressurizer Pressure - High	S	R	M	1, 2
II. RPS LOGIC				
A. Matrix Logic	N.A.	N.A.	M	1, 2, 3*, 4*, 5*
B. Initiation Logic	N.A.	N.A.	M	1, 2, 3*, 4*, 5*
III. RPS ACTUATION DEVICES				
A. Reactor Trip Breakers	N.A.	N.A.	M, R (10)	1, 2, 3*, 4*, 5*
B. Manual Trip	N.A.	N.A.	M	1, 2, 3*, 4*, 5*

DRAFT



TABLE 4.3-1 (Continued)

TABLE NOTATIONS

- \* - With reactor trip breakers in the closed position and the CEA drive system capable of CEA withdrawal, and fuel in the reactor vessel.
- (1) - Each STARTUP or when required with the reactor trip breakers closed and the CEA drive system capable of rod withdrawal, if not performed in the previous 7 days.
- (2) - Heat balance only (CHANNEL FUNCTIONAL TEST not included), above 15% of RATED THERMAL POWER; adjust the linear power level, the CPC delta T power and CPC nuclear power signals to agree with the calorimetric calculation if absolute difference is greater than 2%. During PHYSICS TESTS, these daily calibrations may be suspended provided these calibrations are performed upon reaching each major test power plateau and prior to proceeding to the next major test power plateau.
- (3) - Above 15% of RATED THERMAL POWER, verify that the linear power sub-channel gains of the excore detectors are consistent with the values used to establish the shape annealing matrix elements in the Core Protection Calculators.
- (4) - Neutron detectors may be excluded from CHANNEL CALIBRATION.
- (5) - After each fuel loading and prior to exceeding 70% of RATED THERMAL POWER, the incore detectors shall be used to determine the shape annealing matrix elements and the Core Protection Calculators shall use these elements.
- (6) - This CHANNEL FUNCTIONAL TEST shall include the injection of simulated process signals into the channel as close to the sensors as practicable to verify OPERABILITY including alarm and/or trip functions.
- (7) - Above 70% of RATED THERMAL POWER, verify that the total steady-state RCS flow rate as indicated by each CPC is less than or equal to the actual RCS total flow rate determined by either using the reactor coolant pump differential pressure instrumentation ~~(conservatively compensated for measurement uncertainties)~~ or by calorimetric calculations ~~(conservatively compensated for measurement uncertainties)~~ and if necessary, adjust the CPC addressable constant flow coefficients such that each CPC indicated flow is less than or equal to the actual flow rate. The flow measurement uncertainty may be included in the BERR1 term in the CPC and is equal to or greater than 4%.
- (8) - Above 70% of RATED THERMAL POWER, verify that the total steady-state RCS flow rate as indicated by each CPC is less than or equal to the actual RCS total flow rate determined by either using the reactor ~~coolant~~ pump differential pressure instrumentation and the ultrasonic flow meter adjusted pump curves ~~(conservatively compensated for measurement uncertainties)~~ or calorimetric calculations ~~(conservatively compensated for measurement uncertainties)~~.
- (9) - The monthly CHANNEL FUNCTIONAL TEST shall include verification that the correct values of addressable constants are installed in each OPERABLE CPC per Specification 2.2.2.
- (10) - At least once per 18 months and following maintenance or adjustment of the reactor trip breakers, the CHANNEL FUNCTIONAL TEST shall include independent verification of the undervoltage and shunt trips.

**FINAL DRAFT**

## INSTRUMENTATION

### 3/4.3.2 ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION

#### LIMITING CONDITION FOR OPERATION

---

3.3.2 The Engineered Safety Features Actuation System (ESFAS) instrumentation channels and bypasses shown in Table 3.3-3 shall be OPERABLE with their trip setpoints set consistent with the values shown in the Trip Setpoint column of Table 3.3-4 and with RESPONSE TIMES as shown in Table 3.3-5.

APPLICABILITY: As shown in Table 3.3-3.

#### ACTION:

- a. With an ESFAS instrumentation channel trip setpoint less conservative than the value shown in the Allowable Values column of Table 3.3-4, declare the channel inoperable and apply the applicable ACTION requirement of Table 3.3-3 until the channel is restored to OPERABLE status with the trip setpoint adjusted consistent with the Trip Setpoint value.
- b. With an ESFAS instrumentation channel inoperable, take the ACTION shown in Table 3.3-3.

#### SURVEILLANCE REQUIREMENTS

---

4.3.2.1 Each ESFAS instrumentation channel shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL CALIBRATION and CHANNEL FUNCTIONAL TEST operations for the MODES and at the frequencies shown in Table 4.3-2.

4.3.2.2 The logic for the bypasses shall be demonstrated OPERABLE during the at power CHANNEL FUNCTIONAL TEST of channels affected by bypass operation. The total bypass function shall be demonstrated OPERABLE at least once per 18 months during CHANNEL CALIBRATION testing of each channel affected by bypass operation.

4.3.2.3 The ENGINEERED SAFETY FEATURES RESPONSE TIME of each ESFAS function shall be demonstrated to be within the limit at least once per 18 months. Each test shall include at least one channel per function such that all channels are tested at least once every N times 18 months where N is the total number of redundant channels in a specific ESFAS function as shown in the "Total No. of Channels" Column of Table 3.3-3.

TABLE 3.3-3

ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION

<u>ESFA SYSTEM FUNCTIONAL UNIT</u>	<u>TOTAL NO. OF CHANNELS</u>	<u>CHANNELS TO TRIP</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABLE MODES</u>	<u>ACTION</u>
I. SAFETY INJECTION (SIAS)					
A. Sensor/Trip Units					
1. Containment Pressure - High	4	2	3	1, 2, 3, 4	13*, 14*
2. Pressurizer Pressure - Low	4	2	3	1, 2, 3(a), 4	13*, 14*
B. ESFA System Logic					
1. Matrix Logic	6	1	3	1, 2, 3, 4	17
2. Initiation Logic	4(c)	2(d)	4	1, 2, 3, 4	12
3. Manual SIAS (Trip Buttons)	4(c)	2(d)	4	1, 2, 3, 4	12
C. Automatic Actuation Logic	2	1	2	1, 2, 3, 4	16
II. CONTAINMENT ISOLATION (CIAS)					
A. Sensor/Trip Units					
1. Containment Pressure - High	4	2	3	1, 2, 3	13*, 14*,
2. Pressurizer Pressure - Low	4	2	3	1, 2, 3(a)	13*, 14*
B. ESFA System Logic					
1. Matrix Logic	6	1	3	1, 2, 3	17
2. Initiation Logic	4(c)	2(d)	4	1, 2, 3, 4	12

END OF PAGE

## ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION

<u>ESFA SYSTEM FUNCTIONAL UNIT</u>	<u>TOTAL NO. OF CHANNELS</u>	<u>CHANNELS TO TRIP</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABLE MODES</u>	<u>ACTION</u>
<b>II. CONTAINMENT ISOLATION (Continued)</b>					
3. Manual CIAS (Trip Buttons)	4(c)	2(d)	4	1, 2, 3, 4	12
4. Manual SIAS (Trip Buttons)	4(c)	2(d)	4	1, 2, 3, 4	12
C. Automatic Actuation Logic	2	1	2	1, 2, 3, 4	16
<b>III. CONTAINMENT SPRAY (CSAS)</b>					
<b>A. Sensor/Trip Units</b>					
Containment Pressure -- High - High	4	2	3	1, 2, 3	13*, 14*
<b>B. ESFA System Logic</b>					
1. Matrix Logic	6*	1	3	1, 2, 3	17
2. Initiation Logic	4(c)	2(d)	4	1, 2, 3, 4	12
3. Manual CSAS (Trip Buttons)	4(c)	2(d)	4	1, 2, 3, 4	12
C. Automatic Actuation Logic	2	1	2	1, 2, 3, 4	16

THE  
D  
E  
F

TABLE 3.3-3 (Continued)

ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION

<u>ESFA SYSTEM FUNCTIONAL UNIT</u>	<u>TOTAL NO. OF CHANNELS</u>	<u>CHANNELS TO TRIP</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABLE MODES</u>	<u>ACTION</u>
IV. MAIN STEAM LINE ISOLATION (MSIS)					
A. Sensor/Trip Units					
1. Steam Generator Pressure - Low	4/steam generator	2/steam generator	3/steam generator	1, 2, 3(b), 4	13*, 14*
2. Steam Generator Level - High	4/steam generator	2/steam generator	3/steam generator	1, 2, 3, 4	13*, 14*
3. Containment Pressure - High	4	2	3	1, 2, 3, 4	13*, 14*
B. ESFA System Logic					
1. Matrix Logic	6	1	3	1, 2, 3, 4	17
2. Initiation Logic	4(c)	2(d)	4	1, 2, 3, 4	12
3. Manual MSIS (Trip Buttons)	4(c)	2(d)	4	1, 2, 3, 4	12
C. Automatic Actuation Logic	2	1	2	1, 2, 3, 4	16

FINAL  
DRAFT

TABLE 3.3-3 (Continued)

ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION

<u>ESFA SYSTEM FUNCTIONAL UNIT</u>	<u>TOTAL NO. OF CHANNELS</u>	<u>CHANNELS TO TRIP</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABLE MODES</u>	<u>ACTION</u>
V. RECIRCULATION (RAS)					
A. Sensor/Trip Units					
Refueling Water Storage Tank - Low	4	2	3	1, 2, 3	13*, 14*
B. ESFA System Logic					
1. Matrix Logic	6	1	3	1, 2, 3	17
2. Initiation Logic	4(c)	2(d)	4	1, 2, 3, 4	12
3. Manual RAS	4(c)	2(d)	4	1, 2, 3, 4	12
C. Automatic Actuation Logic	2	1	2	1, 2, 3, 4	16
VI. AUXILIARY FEEDWATER (SG-1)(AFAS-1)					
A. Sensor/Trip Units					
1. Steam Generator #1 Level - Low	4	2	3	1, 2, 3	13*, 14*
2. Steam Generator $\Delta$ Pressure - SG2 > SG1	4	2	3	1, 2, 3	13*, 14*

TABLE 3.3-3 (Continued)  
ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION

<u>ESFA SYSTEM FUNCTIONAL UNIT</u>	<u>TOTAL NO. OF CHANNELS</u>	<u>CHANNELS TO TRIP</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABLE MODES</u>	<u>ACTION</u>
VI. AUXILIARY FEEDWATER (SG-1)(AFAS-1) (Continued)					
B. ESFA System Logic					
1. Matrix Logic	6	1	3	1, 2, 3	17
2. Initiation Logic	4(c)	2(d)	4	1, 2, 3, 4	12
3. Manual AFAS	4(c)	2(d)	4	1, 2, 3, 4	15
C. Automatic Actuation Logic	2	1	2	1, 2, 3, 4	16
VII. AUXILIARY FEEDWATER (SG-2)(AFAS-2)					
A. Sensor/Trip Units					
1. Steam Generator #2 Level - Low	4	2	3	1, 2, 3	13*, 14*
2. Steam Generator Δ Pressure - SG1 > SG2	4	2	3	1, 2, 3	13*, 14*
B. ESFA System Logic					
1. Matrix Logic	6	1	3	1, 2, 3	17
2. Initiation Logic	4(c)	2(d)	4	1, 2, 3, 4	12
3. Manual AFAS	4(c)	2(d)	4	1, 2, 3, 4	15
C. Automatic Actuation Logic	2	1	2	1, 2, 3, 4	16
VIII. LOSS OF POWER (LOV)					
A. 4.16 kV Emergency Bus Under-voltage (Loss of Voltage)	4/Bus	2/Bus	3/Bus	1, 2, 3	13*, 14*
B. 4.16 kV Emergency Bus Under-voltage (Degraded Voltage)	4/Bus	2/Bus	3/Bus	1, 2, 3	13*, 14*
IX. CONTROL ROOM ESSENTIAL FILTRATION	2	1	1	All Modes	17A*

THIS PAGE OPEN FOR RECEIPT OF  
INFORMATION FROM THE APPLICANT

FINAL DRAFT

PALO VERDE - UNIT 1

3/4 3-22

FINAL DRAFT

TABLE 3.3-3 (Continued)

TABLE NOTATIONS

- (a) In MODES 3-6, the value may be decreased manually, to a minimum of 100 psia, as pressurizer pressure is reduced, provided the margin between the pressurizer pressure and this value is maintained at less than or equal to 400 psi; the setpoint shall be increased automatically as pressurizer pressure is increased until the trip setpoint is reached. Trip may be manually bypassed below 400 psia; bypass shall be automatically removed whenever pressurizer pressure is greater than or equal to 500 psia.
- (b) In MODES 3-6, the value may be decreased manually as steam generator pressure is reduced, provided the margin between the steam generator pressure and this value is maintained at less than or equal to 200 psi; the setpoint shall be increased automatically as steam generator pressure is increased until the trip setpoint is reached.
- (c) Four channels provided, arranged in a selective two-out-of-four configuration (i.e., one-out-of-two take twice).
- (d) The proper two-out-of-four combination.
- \* The provisions of Specification 3.0.4 are not applicable.

ACTION STATEMENTS

ACTION 12 - With the number of OPERABLE channels one less than the Total Number of Channels, restore the inoperable channel to OPERABLE status within 48 hours or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

ACTION 13 - With the number of channels OPERABLE one less than the Total Number of Channels, STARTUP and/or POWER OPERATION may continue provided the inoperable channel is placed in the bypassed or tripped condition within 1 hour. If the inoperable channel is bypassed, the desirability of maintaining this channel in the bypassed condition shall be reviewed in accordance with Specification 6.5.1.6.H. The channel shall be returned to OPERABLE status no later than during the next COLD SHUTDOWN.

With a channel process measurement circuit that affects multiple functional units inoperable or in test, bypass or trip all associated functional units as listed below.

Process Measurement Circuit

- |                                       |   |
|---------------------------------------|---|
| 1. Steam Generator Pressure - Low     | Steam Generator Pressure - Low<br>Steam Generator Level 1-Low (ESF)<br>Steam Generator Level 2-Low (ESF)    |
| 2. Steam Generator Level (Wide Range) | Steam Generator Level - Low (RPS)<br>Steam Generator Level 1-Low (ESF)<br>Steam Generator Level 2-Low (ESF) |



TABLE 3.3-3 (Continued)

ACTION STATEMENTS (Continued)

ACTION 14 - With the number of channels OPERABLE one less than the Minimum Channels OPERABLE, STARTUP and/or POWER OPERATION may continue provided the following conditions are satisfied:

- a. Verify that one of the inoperable channels has been bypassed and place the other inoperable channel in the tripped condition within 1 hour.
- b. All functional units affected by the bypassed/tripped channel shall also be placed in the bypassed/tripped condition as listed below:

Process Measurement Circuit	Functional Unit Bypassed/Tripped
1. Steam Generator Pressure - Low	Steam Generator Pressure - Low Steam Generator Level 1 - Low (ESF) Steam Generator Level 2 - Low (ESF)
2. Steam Generator Level - Low (Wide Range)	Steam Generator Level - Low (RPS) Steam Generator Level 1 - Low (ESF) Steam Generator Level 2 - Low (ESF)

STARTUP and/or POWER OPERATION may continue until the performance of the next required CHANNEL FUNCTIONAL TEST. Subsequent STARTUP and/or POWER OPERATION may continue if one channel is restored to OPERABLE status and the provisions of ACTION 14 are satisfied.

ACTION 15 - With the number of OPERABLE channels one less than the Total Number of Channels, restore the inoperable channel to OPERABLE status within 48 hours or be in at least HOT STANDBY within 6 hours and in HOT SHUTDOWN within the following 6 hours.

ACTION 16 - With the number of OPERABLE channels one less than the Total Number of Channels, be in at least HOT STANDBY within 6 hours and in at least HOT SHUTDOWN within the following 6 hours; however, one channel may be bypassed for up to 1 hour for surveillance testing provided the other channel is OPERABLE.

ACTION 17- With the number of OPERABLE channels one less than the Minimum Number of Channels, restore the inoperable channel to OPERABLE status within 48 hours or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

THIS PAGE OPEN PENDING RECEIPT OF  
INFORMATION FROM THE APPLICANT

ACTION 17A - WITH THE NUMBER OF OPERABLE CHANNELS LESS THAN THE minimum number of channels, operation may continue for up to 6 hours. AFTER 6 HOURS operation may continue PROVIDED ATLEAST 1 TRAIN OF ESSENTIAL FILTRATION IS IN OPERATION, OTHERWISE, BE IN HOT STANDBY WITH IN THE next 6 hours AND IN COLD SHUTDOWN WITHIN THE following 30 hours.

TABLE 3.3-4

ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION TRIP VALUES

<u>ESFA SYSTEM FUNCTIONAL UNIT</u>	<u>TRIP SETPOINT</u>	<u>ALLOWABLE VALUES</u>
I. SAFETY INJECTION (SIAS)		
A. Sensor/Trip Units		
1. Containment Pressure - High	$\leq 3.0$ psig	$\leq 3.2$ psig
2. Pressurizer Pressure - Low	$\geq 1837$ psia <sup>(1)</sup>	$\geq 1822$ psia <sup>(1)</sup>
B. ESFA System Logic	Not Applicable	Not Applicable
C. Actuation Systems	Not Applicable	Not Applicable
II. CONTAINMENT ISOLATION (CIAS)		
A. Sensor/Trip Units		
1. Containment Pressure - High	$\leq 3.0$ psig	$\leq 3.2$ psig
2. Pressurizer Pressure - Low	$\geq 1837$ psia <sup>(1)</sup>	$\geq 1822$ psia <sup>(1)</sup>
B. ESFA System Logic	Not Applicable	Not Applicable
C. Actuation Systems	Not Applicable	Not Applicable
III. CONTAINMENT SPRAY (CSAS)		
A. Sensor/Trip Units		
Containment Pressure High - High	$\leq 8.5$ psig	$\leq 8.9$ psig
B. ESFA System Logic	Not Applicable	Not Applicable
C. Actuation Systems	Not Applicable	Not Applicable
IV. MAIN STEAM LINE ISOLATION (MSIS)		
A. Sensor/Trip Units		
1. Steam Generator Pressure - Low	$\geq 919$ psia <sup>(3)</sup>	$\geq 912$ psia <sup>(3)</sup>
2. Steam Generator Level - High	$\leq 91.0\%$ NR <sup>(2)</sup>	$\leq 91.5\%$ NR <sup>(2)</sup>
3. Containment Pressure - High	$\leq 3.0$ psig	$\leq 3.2$ psig
B. ESFA System Logic	Not Applicable	Not Applicable
C. Actuation Systems	Not Applicable	Not Applicable

FINAL DRAFT

TABLE 3.3-4 (Continued)

ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION TRIP VALUES

<u>ESFA SYSTEM FUNCTIONAL UNIT</u>	<u>TRIP VALUES</u>	<u>ALLOWABLE VALUES</u>
V. RECIRCULATION (RAS)		
A. Sensor/Trip Units	7.4%	7.9 ≥ % TAP SPAN ≥ 6.9
Refueling Water Storage Tank - Low	≥ <del>6.9</del> % of Span	≥ <del>8.4</del> % of Span
B. ESFA System Logic	Not Applicable	Not Applicable
C. Actuation System	Not Applicable	Not Applicable
VI. AUXILIARY FEEDWATER (SG-1)(AFAS-1)		.....
A. Sensor/Trip Units		
1. Steam Generator #1 Level - Low	≥ 25.8% WR <sup>(4)</sup>	≥ 25.3% WR <sup>(4)</sup>
2. Steam Generator Δ Pressure - SG2 > SG1	≤ 185 psid	≤ 192 psid
B. ESFA System Logic	Not Applicable	Not Applicable
C. Actuation Systems	Not Applicable	Not Applicable
VII. AUXILIARY FEEDWATER (SG-2)(AFAS-2)		
A. Sensor/Trip Units		
1. Steam Generator #2 Level - Low	≥ 25.8% WR <sup>(4)</sup>	≥ 25.3% WR <sup>(4)</sup>
2. Steam Generator Δ Pressure - SG1 > SG2	≤ 185 psid	≤ 192 psid
B. ESFA System Logic	Not Applicable	Not Applicable
C. Actuation Systems	Not Applicable	Not Applicable
VIII. LOSS OF POWER		
A. 4.16 kV Emergency Bus Undervoltage (Loss of Voltage)	≥ 3250 volts	≥ 3250 volts
B. 4.16 kV Emergency Bus Undervoltage (Degraded Voltage)	2930 to 3744 volts with a 35-second maximum time delay	2930 to 3744 volts with a 35-second maximum time delay
IX. CONTROL ROOM ESSENTIAL FILTRATION	≥ 2 x 10 <sup>-6</sup> μCi/cc	<del>10<sup>-6</sup> to 10<sup>-6</sup></del> μCi/cc ≤ 2x10 <sup>-6</sup>

FINAL DRAFT



**FINAL DRAFT**

TABLE 3.3-4 (Continued)

TABLE NOTATIONS

- (1) In MODES 3-6, value may be decreased manually, to a minimum of 100 psia, as pressurizer pressure is reduced, provided the margin between the pressurizer pressure and this value is maintained at less than or equal to 400 psi; the setpoint shall be increased automatically as pressurizer pressure is increased until the trip setpoint is reached. Trip may be manually bypassed below 400 psia; bypass shall be automatically removed whenever pressurizer pressure is greater than or equal to 500 psia.
- (2) % of the distance between steam generator upper and lower level narrow range instrument nozzles.
- (3) In MODES 3-6, value may be decreased manually as steam generator pressure is reduced, provided the margin between the steam generator pressure and this value is maintained at less than or equal to 200 psi; the setpoint shall be increased automatically as steam generator pressure is increased until the trip setpoint is reached.
- (4) % of the distance between steam generator upper and lower level wide range instrument nozzles.

TABLE 3.3-5

ENGINEERED SAFETY FEATURES RESPONSE TIMES

<u>INITIATING SIGNAL AND FUNCTION</u>	<u>RESPONSE TIME IN SECONDS</u>
1. Manual	
a. SIAS	
Safety Injection (ECCS)	Not Applicable
Containment Isolation	Not Applicable
Containment Purge Valve Isolation	Not Applicable
b. CSAS	
Containment Spray	Not Applicable
c. CIAS	
Containment Isolation	Not Applicable
d. MSIS	
Main Steam Isolation	Not Applicable
e. RAS	
Containment Sump Recirculation	Not Applicable
f. AFAS	
Auxiliary Feedwater Pumps	Not Applicable

TABLE 3.3-5 (Continued)

## ENGINEERED SAFETY FEATURES RESPONSE TIMES

INITIATING SIGNAL AND FUNCTION	RESPONSE TIME IN SECONDS
--------------------------------	--------------------------

2. Pressurizer Pressure - Low

- |                            |                     |
|----------------------------|---------------------|
| a. Safety Injection (HPSI) | $\leq 30^*/30^{**}$ |
| b. Safety Injection (LPSI) | $\leq 30^*/30^{**}$ |
| c. Containment Isolation   |                     |

- |                                    |                     |
|------------------------------------|---------------------|
| 1. CIAS actuated mini-purge valves | $\leq 15^*/25^{**}$ |
| 2. Other CIAS actuated valves      | $\leq 59^*/59^{**}$ |

10.6\*/10.6\*\*  
31\*/31\*\*

3. Containment Pressure - High

- |                            |                     |
|----------------------------|---------------------|
| a. Safety Injection (HPSI) | $\leq 30^*/30^{**}$ |
| b. Safety Injection (LPSI) | $\leq 30^*/30^{**}$ |
| c. Containment Isolation   |                     |

- |                                    |                     |
|------------------------------------|---------------------|
| 1. CIAS actuated mini-purge valves | $\leq 15^*/25^{**}$ |
| 2. Other CIAS actuated valves      | $\leq 59^*/59^{**}$ |

10.6\*/10.6\*\*  
31\*/31\*\*

d. Main Steam Isolation

- |  |                         |
|--|-------------------------|
| 1. MSIS actuated MSIV's                  | $\leq 5.6^*/5.6^{**}$   |
| 2. MSIS actuated MFIV's                  | $\leq 10.6^*/10.6^{**}$ |
| 3. <del>Other MSIS actuated valves</del> | $\leq 59^*/59^{**}$     |

27\*/17\*\*

4. Containment Pressure - High-High

- |                      |                     |
|----------------------|---------------------|
| a. Containment Spray | $\leq 33^*/23^{**}$ |
|----------------------|---------------------|

5. Steam Generator Pressure - Low

a. Main Steam Isolation

- |  |                         |
|--|-------------------------|
| 1. MSIS actuated MSIV's                  | $\leq 5.6^*/5.6^{**}$   |
| 2. MSIS actuated MFIV's                  | $\leq 10.6^*/10.6^{**}$ |
| 3. <del>Other MSIS actuated valves</del> | $\leq 59^*/59^{**}$     |

5.6\*/5.6\*\*  
10.6\*/10.6\*\*  
59\*/59\*\*

6. Refueling Water Storage Tank - Low

- |                                   |                     |
|-----------------------------------|---------------------|
| a. Containment Sump Recirculation | $\leq 45^*/45^{**}$ |
|-----------------------------------|---------------------|

7. Steam Generator Level - Low

- |  |                     |
|--|---------------------|
| a. Auxiliary Feedwater (Motor Drive)   | $\leq 46^*/23^{**}$ |
| b. Auxiliary Feedwater (turbine drive) | $\leq 30^*/30^{**}$ |

46\*/23\*\*  
46\*

# FINAL DRAFT

TABLE 3.3-5 (Continued)

ENGINEERED SAFETY FEATURES RESPONSE TIMES

<u>INITIATING SIGNAL AND FUNCTION</u>	<u>RESPONSE TIME IN SECONDS</u>
8. Steam Generator Level - High	
a. Main Steam Isolation	
1. MSIS actuated MSIV's	$\leq 5.6^*/5.6^{**}$
2. MSIS actuated MFIV's	$\leq 10.6^*/10.6^{**}$
<del>3. Other MSIS actuated valves</del>	<del><math>\leq 59^*/59^{**}</math></del>
9. Steam Generator $\Delta P$ -High-Coincident With Steam Generator Level Low	
a. Auxiliary Feedwater Isolation from the Ruptured Steam Generator	$\leq \text{N.A.}/15^{**}$ $16^*/16^{**}$
10. Control Room Essential Filtration Actuation	$\leq 180^*/\leq 180^{**}$
11. 4.16 kV Emergency Bus Undervoltage (Degraded Voltage)	
Loss of Power 90% system voltage	$\leq 35.0$
12. 4.16 kV Emergency Bus Undervoltage (loss of Voltage)	
Loss of Power	$\leq 2.4$

TABLE NOTATIONS

\*Diesel generator starting and sequence loading delays included. Response time limit includes movement of valves and attainment of pump or blower discharge pressure.

\*\*Diesel generator starting delays not included. Offsite power available. Response time limit includes movement of valves and attainment of pump or blower discharge pressure.



TABLE 4.3-2

ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>ESFA SYSTEM FUNCTIONAL UNIT</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>CHANNEL FUNCTIONAL TEST</u>	<u>MODES FOR WHICH SURVEILLANCE IS REQUIRED</u>
I. SAFETY INJECTION (SIAS)				
A. Sensor/Trip Units				
1. Containment Pressure - High	S	R	M	1, 2, 3, 4
2. Pressurizer Pressure - Low	S	R	M	1, 2, 3, 4
B. ESFA System Logic				
1. Matrix Logic	NA	NA	M	1, 2, 3, 4
2. Initiation Logic	NA	NA	M	1, 2, 3, 4
3. Manual SIAS	NA	NA	M	1, 2, 3, 4
C. Automatic Actuation Logic	NA	NA	SA (1)(2)(3) <del>M(1)(2)(3)</del>	1, 2, 3, 4
II. CONTAINMENT ISOLATION (CIAS)				
A. Sensor/Trip Units				
1. Containment Pressure - High	S	R	M	1, 2, 3
2. Pressurizer Pressure - Low	S	R	M	1, 2, 3
B. ESFA System Logic				
1. Matrix Logic	NA	NA	M	1, 2, 3, 4
2. Initiation Logic	NA	NA	M	1, 2, 3, 4
3. Manual CIAS	NA	NA	M	1, 2, 3, 4
4. Manual SIAS	NA	NA	M	1, 2, 3, 4

TABLE 4.3-2 (Continued)

ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>ESFA SYSTEM FUNCTIONAL UNIT</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>CHANNEL FUNCTIONAL TEST</u>	<u>MODES FOR WHICH SURVEILLANCE IS REQUIRED</u>
II. CONTAINMENT ISOLATION (Continued)				
C. Automatic Actuation Logic	NA	NA	<del>SA</del> M(1) (2) (3)	1, 2, 3, 4
III. CONTAINMENT SPRAY (CSAS)				
A. Sensor/Trip Units				
1. Containment Pressure -- High - High	S	R	M	1, 2, 3
B. ESFA System Logic				
1. Matrix Logic	NA	NA	M	1, 2, 3, 4
2. Initiation Logic	NA	NA	M	1, 2, 3, 4
3. Manual CSAS	NA	NA	M	1, 2, 3, 4
C. Automatic Actuation Logic	NA	NA	<del>SA</del> M(1) (2) (3)	1, 2, 3, 4

1  
 2  
 3  
 4  
 5  
 6  
 7  
 8  
 9  
 10  
 11  
 12  
 13  
 14  
 15  
 16  
 17  
 18  
 19  
 20  
 21  
 22  
 23  
 24  
 25  
 26  
 27  
 28  
 29  
 30  
 31  
 32  
 33  
 34  
 35  
 36  
 37  
 38  
 39  
 40  
 41  
 42  
 43  
 44  
 45  
 46  
 47  
 48  
 49  
 50  
 51  
 52  
 53  
 54  
 55  
 56  
 57  
 58  
 59  
 60  
 61  
 62  
 63  
 64  
 65  
 66  
 67  
 68  
 69  
 70  
 71  
 72  
 73  
 74  
 75  
 76  
 77  
 78  
 79  
 80  
 81  
 82  
 83  
 84  
 85  
 86  
 87  
 88  
 89  
 90  
 91  
 92  
 93  
 94  
 95  
 96  
 97  
 98  
 99  
 100

TABLE 4.3-2 (Continued)

ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>ESFA SYSTEM FUNCTIONAL UNIT</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>CHANNEL FUNCTIONAL TEST</u>	<u>MODES FOR WHICH SURVEILLANCE IS REQUIRED</u>
IV. MAIN STEAM LINE ISOLATION (MSIS)				
A. Sensor/Trip Units				
1. Steam Generator Pressure - Low	S	R	M	1, 2, 3, 4
2. Steam Generator Level - High	S	R	M	1, 2, 3, 4
3. Containment Pressure - High	S	R	M	1, 2, 3, 4
B. ESFA System Logic				
1. Matrix Logic	NA	NA	M	1, 2, 3, 4
2. Initiation Logic	NA	NA	M	1, 2, 3, 4
3. Manual MSIS	NA	NA	M	1, 2, 3, 4
C. Automatic Actuation Logic	NA	NA	<sup>SA</sup> M(1) (2) (3)	1, 2, 3, 4

 1  
2  
3  
4  
5  
6  
7  
8  
9  
10  
11  
12  
13  
14  
15  
16  
17  
18  
19  
20  
21  
22  
23  
24  
25  
26  
27  
28  
29  
30  
31  
32  
33  
34  
35  
36  
37  
38  
39  
40  
41  
42  
43  
44  
45  
46  
47  
48  
49  
50  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65  
66  
67  
68  
69  
70  
71  
72  
73  
74  
75  
76  
77  
78  
79  
80  
81  
82  
83  
84  
85  
86  
87  
88  
89  
90  
91  
92  
93  
94  
95  
96  
97  
98  
99  
100

TABLE 4.3-2 (Continued)

ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>ESFA SYSTEM FUNCTIONAL UNIT</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>CHANNEL FUNCTIONAL TEST</u>	<u>MODES FOR WHICH SURVEILLANCE IS REQUIRED</u>
V. RECIRCULATION (RAS)				
A. Sensor/Trip Units				
Refueling Water Storage Tank - Low	S	R	M	1, 2, 3
B. ESFA System Logic				
1. Matrix Logic	NA	NA	M	1, 2, 3, 4
2. Initiation Logic	NA	NA	M	1, 2, 3, 4
3. Manual RAS	NA	NA	M	1, 2, 3, 4
C. Automatic Actuation Logic	NA	NA	<del>SA</del> M(1) (2) (3)	1, 2, 3, 4
VI. AUXILIARY FEEDWATER (SG-1)(AFAS-1)				
A. Sensor/Trip Units				
1. Steam Generator #1 Level - Low	S	R	M	1, 2, 3
2. Steam Generator $\Delta$ Pressure SG2 > SG1	S	R	M	- 1, 2, 3

PALO VERDE - UNIT 1

3/4 3-34

FINAL DRAFT

## ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>ESFA SYSTEM FUNCTIONAL UNIT</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>CHANNEL FUNCTIONAL TEST</u>	<u>MODES FOR WHICH SURVEILLANCE IS REQUIRED</u>
VI. AUXILIARY FEEDWATER (SG-1)(AFAS-1) (Continued)				
B. ESFA System Logic				
1. Matrix Logic	NA	NA	M	1, 2, 3, 4
2. Initiation Logic	NA	NA	M	1, 2, 3, 4
3. Manual AFAS	NA	NA	M	1, 2, 3, 4
C. Automatic Actuation Logic	NA	NA	<del>SA</del> M(1) (2) (3)	1, 2, 3, 4
VII. AUXILIARY FEEDWATER (SG-2)(AFAS-2)				
A. Sensor/Trip Units				
1. Steam Generator #2 Level - Low	S	R	M	1, 2, 3
2. Steam Generator Δ Pressure SG1 > SG2	S	R	M	1, 2, 3
B. ESFA System Logic				
1. Matrix Logic	NA	NA	M	1, 2, 3, 4
2. Initiation Logic	NA	NA	M	1, 2, 3, 4
3. Manual AFAS	NA	NA	M	1, 2, 3, 4
C. Automatic Actuation Logic	NA	NA	<del>SA</del> M(1) (2) (3)	1, 2, 3, 4
VIII. LOSS OF POWER (LOV)				
A. 4.16 kV Emergency Bus Under-voltage (Loss of Voltage)	S	R	R	1, 2, 3, 4
B. 4.16 kV Emergency Bus Under-voltage (Degraded Voltage)	S	R	R	1, 2, 3, 4

[illegible]

TABLE 4.3-2 (Continued)

TABLE NOTATION

- (1) Each train or logic channel shall be tested at least every <sup>184</sup>~~62~~ days on a STAGGERED TEST BASIS.
- (2) Testing of automatic actuation logic shall include energization/deenergization of each initiation relay and verification of proper operation of each initiation relay.
- (3) A subgroup relay test shall be performed which shall include the energization/deenergization of each subgroup relay and verification of the OPERABILITY of each subgroup relay. Relays LISTED BELOW <sup>184</sup> and are exempt from testing during POWER OPERATION but shall be tested at least once per 18 months during REFUELING and during each COLD SHUTDOWN condition unless tested within the previous ~~62~~ days.

ACTUATION DEVICES THAT CANNOT BE TESTED AT POWER			
TRAIN A		TRAIN B	
ESF FUNCTION	ACTUATION DEVICE	ESF FUNCTION	ACTUATION DEVICE
SIAS A	K108	SIAS B	K108
SIAS A	K409	SIAS B	K409
CIAS A	K202	CIAS B	K204
CIAS A	K204	CIAS B	K205
CIAS A	K205	CSAS B	K304
CSAS A	K304	MSIS B	K305
MSIS A	K305	MSIS B	K404
MSIS A	K404	AFAS 1B	K113
AFAS 1A	K211	AFAS 1B	K211
AFAS 2A	K112	AFAS 2B	K112

IN THE CASE OF THE FOLLOWING RELAYS ONE OR MORE pieces of EQUIPMENT CANNOT BE ACTUATED, BUT CAN BE RACKED OUT, BYPASSED OR ETC. WHICH WILL NOT PRECLUDE THE RELAY FROM BEING TESTED BUT WILL NOT ACTUATE THE EQUIPMENT ASSOCIATED WITH THE RELAY

SIAS A K401  
 SIAS A K410  
 SIAS A K412  
 CIAS A K203  
 CIAS A K210  
 RAS A K104  
 RAS A K312  
 RAS A K405

SIAS B K301  
 SIAS B K308  
 CIAS B K203  
 CIAS B K210  
 RAS B K104  
 RAS B K312  
 RAS B K405



13  
FINAL DRAFT

## INSTRUMENTATION

### 3/4.3.3 MONITORING INSTRUMENTATION

#### RADIATION MONITORING INSTRUMENTATION

#### LIMITING CONDITION FOR OPERATION

---

3.3.3.1 The radiation monitoring instrumentation channels shown in Table 3.3-6 shall be OPERABLE with their alarm/trip setpoints within the specified limits.

APPLICABILITY: As shown in Table 3.3-6.

ACTION:

- a. With a radiation monitoring channel alarm/trip setpoint exceeding the value shown in Table 3.3-6, adjust the setpoint to within the limit within 4 hours or declare the channel inoperable.
- b. With the number of channels OPERABLE one less than the Minimum Channels OPERABLE requirement, take the ACTION shown in Table 3.3-6.
- c. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

---

4.3.3.1 Each radiation monitoring instrumentation channel shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL CALIBRATION, and CHANNEL FUNCTIONAL TEST operations for the MODES and at the frequencies shown in Table 4.3-3.



TABLE 3.3-6

RADIATION MONITORING INSTRUMENTATION

<u>INSTRUMENT</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABLE MODES</u>	<u>ALARM/TRIP SETPOINT</u>	<u>MEASUREMENT RANGE</u>	<u>ACTION</u>
1. Area Monitors					
A. Fuel Pool Area RU-31	1	**	$\leq 15\text{mR/hr}$	$10^{-1}$ to $10^4\text{mR/hr}$	22 & 24
B. New Fuel Area RU-19	1	*	$\leq 15\text{mR/hr}$	$10^{-1}$ to $10^4\text{mR/hr}$	22
C. Containment RU-148 & RU-149	2	1,2,3,4	$\leq 10\text{R/hr}$	$1\text{R/hr}$ to $10^7\text{R/hr}$	27
D. Containment Power Access Purge Exhaust RU-37 & RU-38	1	#	$\leq 2.5\text{mR/hr}$	$10^{-1}$ to $10^4\text{mR/hr}$	25
E. Main Steam					
1) RU-139 A&B	1	1,2,3,4	##	$10^{-3}$ to $10^4\text{R/hr}$	27
2) RU-140 A&B	1	1,2,3,4	##	$10^{-3}$ to $10^4\text{R/hr}$	27
2. Process Monitors					
A. Containment Building Atmosphere RU-1	2	1,2,3,4			23 & 27
1) Particulate			$\leq 2.3 \times 10^{-6} \mu\text{Ci/cc}$ Cs-137	$10^{-9}$ to $10^{-4} \mu\text{Ci/cc}$	
2) Gaseous			$\leq 6.6 \times 10^{-2} \mu\text{Ci/cc}$ Xe-133	$10^{-6}$ to $10^{-1} \mu\text{Ci/cc}$	
B. Noble Gas Monitors Control Room Ventilation Intake RU-29 & RU-30	1	ALL MODES	$\leq 2 \times 10^{-6} \mu\text{Ci/cc}$	$10^{-6}$ to $10^{-1} \mu\text{Ci/cc}$	26
3. Post Accident Sampling System	1	1,2,3	N.A.	N.A.	27/28

\*With fuel in the storage pool or building.

\*\*With irradiated fuel in the storage pool.

#When purge is being used.

##Three (3) times background in  $\mu\text{Rem/hour}$ .

RECEIVED

1M /  
**FINAL DRAFT**

TABLE 3.3-6 (Continued)

ACTION STATEMENTS

- ACTION 22 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, perform area surveys of the monitored area with portable monitoring instrumentation at least once per 24 hours.
- ACTION 23 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, comply with the ACTION requirements of Specification (3.4.5.1).
- ACTION 24 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, comply with the ACTION requirements of Specification (3.9.12) or operate the fuel building essential ventilation system while handling irradiated fuel.
- ACTION 25 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, comply with the ACTION requirements of Specification (3.9.9).
- ACTION 26 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, within 1 hour initiate and maintain operation of the control room emergency ventilation system in the recirculation mode of operation.
- ACTION 27 - With the number of OPERABLE Channels less than required by the Minimum Channels OPERABLE requirement, either restore the inoperable channel(s) to OPERABLE status within 72 hours, or:
1. ~~Complete the actions of "A" or "B".~~
    - ☒ A. Initiate the Preplanned Alternate Sampling Program of Section 6.16 to monitor the appropriate parameter(s).
    - ☒ B. For process monitors, place moveable air monitor in-line. or take grab sample at least once per 12 hours.
  2. Prepare and submit a Special Report to the Commission pursuant to Specification 6.9.2 within 14 days following the event outlining the action taken, the cause of the inoperability, and the plans and schedule for restoring the system to OPERABLE status.

*NO-MONITORS IN TABLE*

*Delete because covered by action 23*

TABLE 4.3-3

RADIATION MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>CHANNEL FUNCTIONAL TEST</u>	<u>MODES FOR WHICH SURVEILLANCE IS REQUIRED</u>
1. Area Monitors				
A. Fuel Pool Area RU-31	S	R	M	**
B. New Fuel Area RU-19	S	R	M	*
C. Containment Power Access Purge Exhaust RU-37 & RU-38	P#	R	P###,W##	##
D. Containment RU-148 & RU-149	S	R	M	1,2,3,4
E. Main Steam RU-139 A&B RU-140 A&B	S	R	M	1,2,3,4
2. Process Monitors				
A. Containment Building Atmosphere RU-1				
1) Particulate	S	R	M	1,2,3,4
2) Gaseous	S	R	M	1,2,3,4
B. Control Room Ventilation Intake RU-29 & RU-30	S	R	M	All MODES
3. Post Accident Sampling System	N.A.	R	<del>H.A.</del> ***	1,2,3

\*With fuel in the storage pool or building.

\*\*With irradiated fuel in the storage pool.

#If purge is in service for greater than 12 hours, perform once per 12-hour period.

##When purge system is in operation.

###The functional test should consist of, but not be limited to, a verification of system isolation capability by the insertion of a simulated alarm condition.

\*\*\* THE FUNCTIONAL TEST SHOULD CONSIST OF BUT NOT BE LIMITED TO A VERIFICATION OF SYSTEM SAMPLING CAPABILITIES

RECEIVED  
FBI  
JAN 10 1974

**FINAL DRAFT**

INSTRUMENTATION

INCORE DETECTORS

LIMITING CONDITION FOR OPERATION

---

3.3.3.2 The incore detection system shall be OPERABLE with:

- a. At least 75% of all incore detector locations, and
- b. A minimum of two quadrant symmetric incore detector locations per core quadrant.

An OPERABLE incore detector location shall consist of a fuel assembly containing a fixed detector string with a minimum of four OPERABLE rhodium detectors or an OPERABLE movable incore detector capable of mapping the location.

APPLICABILITY: When the incore detection system is used for monitoring:

- a. AZIMUTHAL POWER TILT,
- b. Radial Peaking Factors,
- c. Local Power Density,
- d. DNB Margin.

ACTION:

- a. With the incore detection system inoperable, do not use the system for the above applicable monitoring or calibration functions.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

---

4.3.3.2 The incore detection system shall be demonstrated OPERABLE:

- a. By performance of a CHANNEL CHECK within 24 hours prior to its use if the system has just been returned to OPERABLE status or if 7 days or more have elapsed since last use and at least once per 7 days thereafter when required for monitoring the AZIMUTHAL POWER TILT, radial peaking factors, local power density or DNB margin:
- b. At least once per 18 months by performance of a CHANNEL CALIBRATION operation which exempts the neutron detectors but includes all electronic components. The fixed incore neutron detectors shall be calibrated prior to installation in the reactor core.

## INSTRUMENTATION

### SEISMIC INSTRUMENTATION

#### LIMITING CONDITION FOR OPERATION

---

3.3.3.3 The seismic monitoring instrumentation shown in Table 3.3-7 shall be OPERABLE.

APPLICABILITY: At all times.

ACTION:

- a. With one or more seismic monitoring instruments inoperable for more than 30 days, prepare and submit a Special Report to the Commission pursuant to Specification 6.9.2 within the next 10 days outlining the cause of the malfunction and the plans for restoring the instrument(s) to OPERABLE status.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

---

4.3.3.3.1 Each of the above seismic monitoring instruments shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK, CHANNEL CALIBRATION and CHANNEL FUNCTIONAL TEST operations at the frequencies shown in Table 4.3-4.

4.3.3.3.2 Each of the above seismic monitoring instruments actuated during a seismic event (greater than or equal to 0.02g) shall have a CHANNEL CALIBRATION performed within 5 days. Data shall be retrieved from actuated instruments and analyzed to determine the magnitude of the vibratory ground motion. A Special Report shall be prepared and submitted to the Commission pursuant to Specification 6.9.2 within 10 days describing the magnitude, frequency spectrum, and resultant effect upon facility features important to safety.



TABLE 3.3-7

## SEISMIC MONITORING INSTRUMENTATION

### INSTRUMENTS AND SENSOR LOCATIONS

MINIMUM  
INSTRUMENT  
OPERABLE

#### 1. Triaxial Accelerometers

MOTOR  
HOUSING

- |    |  |   |
|----|--|---|
| a. | Tendon Gallery Floor, 55' level  | 1 |
| b. | R.C.P., <del>Upper Support</del> , 129'6" level  | 1 |
| c. | Steam Generator Base, 101'9" level   | 1 |
| d. | Control Building Floor, 74' level  | 1 |
| e. | Auxiliary Building Floor 40' level   | 1 |
| f. | 25' E. of Turbine Bldg. W. side x<br>189'9" S. of Turbine Bldg. S. Side<br>on ground (Ref. Plant N.) | 1 |

#### 2. Peak Reading Accelerograph

- |    |   |   |
|----|---|---|
| a. | Aux. Bldg., Valve Gallery, Class<br>1 Pipe, 78'7" level | 1 |
|----|---|---|

#### 3. Seismic Triggers

- |    |   |   |
|----|---|---|
| a. | Tendon Gallery Floor, 55' level<br>(Setpoint 0.02 g)          | 1 |
| b. | Containment Operating Floor, 140'<br>level (Setpoint 0.010 g) | 1 |

#### 4. Digital Cassette Recorders

- |    |                               |   |
|----|-------------------------------|---|
| a. | Control Room Area, 140' level | 1 |
| b. | Control Room Area, 140' level | 1 |
| c. | Control Room Area, 140' level | 1 |
| d. | Control Room Area, 140' level | 1 |
| e. | Control Room Area, 140' level | 1 |
| f. | Control Room Area, 140' level | 1 |

#### 5. Seismic Switches

- |    |                                 |   |
|----|---------------------------------|---|
| a. | Tendon Gallery Floor, 55' level | 1 |
|----|---------------------------------|---|

	Horizontal	Vertical
Setpoint OBE	0.18 g	0.17 g
Setpoint SSE	0.31 g	0.34 g

# FINAL DRAFT

TABLE 4.3-4

SEISMIC MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>INSTRUMENTS AND SENSOR LOCATIONS</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>CHANNEL FUNCTIONAL TEST</u>
1. Triaxial Accelerometers			
a. Tendon Gallery Floor, 55' level	N.A.	R	SA
<i>MOTOR HOUSING</i> b. <del>R.C.P., Upper Support, 129'6" level</del>	N.A.	R	SA
c. Steam Generator Base, 101'9" level	N.A.	R	SA
d. Control Building Floor, 74' level	N.A.	R	SA
e. Auxiliary Building Floor 40' level	N.A.	R	SA
f. 25' E. of Turbine Bldg. W. side x 189'9" S. of Turbine Bldg. S. Side on ground (Ref. Plant N.)	N.A.	R	SA
2. Peak Reading Accelerograph			
a. Aux. Bldg., Valve Gallery, Class 1 Pipe, 78'7" level	N.A.	R	NA
3. Seismic Triggers			
a. Tendon Gallery Floor, 55' level	N.A.	R	SA
b. Containment Operating Floor, 140' level	N.A.	R	SA
4. Digital Cassette Recorders			
a. Control Room Area, 140' level	M	R	SA
b. Control Room Area, 140' level	M	R	SA
c. Control Room Area, 140' level	M	R	SA
d. Control Room Area, 140' level	M	R	SA
e. Control Room Area, 140' level	M	R	SA
f. Control Room Area, 140' level	M	R	SA
5. Seismic Switches			
a. Tendon Gallery Floor, 55' level	M	R	SA



## INSTRUMENTATION

### METEOROLOGICAL INSTRUMENTATION

#### LIMITING CONDITION FOR OPERATION

---

3.3.3.4 The meteorological monitoring instrumentation channels shown in Table 3.3-8 shall be OPERABLE.

APPLICABILITY: At all times.

ACTION:

- a. With one or more required meteorological monitoring channels inoperable for more than 7 days, prepare and submit a Special Report to the Commission pursuant to Specification 6.9.2 within the next 10 days outlining the cause of the malfunction and the plans for restoring the channel(s) to OPERABLE status.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

---

4.3.3.4 Each of the above meteorological monitoring instrumentation channels shall be demonstrated OPERABLE by the performance of the CHANNEL CHECK and CHANNEL CALIBRATION operations at the frequencies shown in Table 4.3-5.

TABLE 3.3-8

METEOROLOGICAL MONITORING INSTRUMENTATION

<u>INSTRUMENT</u>	<u>LOCATION</u>	<u>MINIMUM OPERABLE</u>
1. WIND SPEED		
a. 0* to 50 mph,	Nominal Elev. 35 feet	1
b. 0* to 50 mph,	Nominal Elev. 200 feet	1
2. WIND DIRECTION		
a. 0°-360°-180°,	Nominal Elev. 35 feet	1
b. 0°-360°-180°,	Nominal Elev. 200 feet	1
3. AIR TEMPERATURE - DELTA T		
a. -6°F to 6°F,	Nominal Elev. 35 feet-200 feet	1

\*Wind speeds less than 0.6 MPH will be reported as 0.

FINAL DRAFT

TABLE 4.3-5

METEOROLOGICAL MONITORING INSTRUMENTATION

SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL CALIBRATION</u>
1. WIND SPEED		
a. Nominal Elev. 35 feet	D	SA
b. Nominal Elev. 200 feet	D	SA
2. WIND DIRECTION		
a. Nominal Elev. 35 feet	D	SA
b. Nominal Elev. 200 feet	D	SA
3. AIR TEMPERATURE - DELTA T		
a. Nominal Elev. 35 feet - 200 feet	D	SA



## INSTRUMENTATION

### REMOTE SHUTDOWN INSTRUMENTATION *system*

#### LIMITING CONDITION FOR OPERATION

3.3.3.5 The remote shutdown system disconnect switches, power, controls and monitoring instrumentation channels shown in Table 3.3-9 shall be OPERABLE.

APPLICABILITY: MODES 1 and 2.

#### ACTION:

- a. With the number of OPERABLE remote shutdown monitoring channels less than required by Table 3.3-9, restore the inoperable channel(s) to OPERABLE status within 7 days, or be in HOT STANDBY within the next 12 hours.
- b. With one or more remote shutdown system disconnect switches or power or control circuits inoperable, restore the inoperable switch(s)/circuit(s) to OPERABLE status within 7 days, or be in HOT STANDBY within the next 12 hours.
- c. The provisions of Specification 3.0.4 are not applicable.

*tech spec*  
OR ISSUE CHANGES PER 6.8 THAT IDENTIFIES  
ALTERNATE DISCONNECT METHODS OR POWER OR  
CONTROL SWITCHES FOR Remote shutdown

#### SURVEILLANCE REQUIREMENTS

4.3.3.5 The Remote Shutdown System shall be demonstrated operable:

- a. By performance of the CHANNEL CHECK and CHANNEL CALIBRATION operations at the frequencies shown in Table 4.3-6 for each remote shutdown monitoring instrumentation channel:
- b. By operation of each remote shutdown system disconnect switch and power and control circuit including the actuated components at least once per 18 months.

TABLE 3.3-9

REMOTE SHUTDOWN INSTRUMENTATION, DISCONNECT SWITCHES AND CONTROL *Circuits* ~~INSTRUMENTS~~

<u>INSTRUMENTATION</u>	<u>READOUT LOCATION</u>	<u>MINIMUM CHANNELS OPERABLE</u>
1. Log Neutron Power Level	Remote Shutdown Panel	2
2. Reactor Coolant Hot Leg Temperature	Remote Shutdown Panel	1/loop
3. Reactor Coolant Cold Leg Temperature	Remote Shutdown Panel	1/loop
4. Pressurizer Pressure	Remote Shutdown Panel	1
5. Pressurizer Level	Remote Shutdown Panel	2
6. Steam Generator Pressure	Remote Shutdown Panel	2/steam generator
7. Steam Generator Level	Remote Shutdown Panel	2/steam generator
8. Refueling Water Tank Level	Remote Shutdown Panel	2
9. Charging Line Pressure	Remote Shutdown Panel	1
10. Charging Line Flow	Remote Shutdown Panel	1
11. Shutdown Cooling Heat Exchanger Temperatures	Remote Shutdown Panel	2
12. Shutdown Cooling Flow	Remote Shutdown Panel	2
13. Auxiliary Feedwater Flow Rate	Remote Shutdown Panel	2/steam generator

FINAL DRAFT



# FINAL DRAFT

## DISCONNECT SWITCHES

## SWITCH LOCATION

- |   |                      |
|---|----------------------|
| 1. SG 1 line 2 Atmospheric Dump<br>Valve <del>HY-178A</del> <del>SGB-HY-178A</del>              | RSP                  |
| 2. SG 2 line 1 Atmospheric Dump<br>Valve <del>HY-185A</del> <del>SGB-HY-185A</del>              | RSP                  |
| 3. Auxiliary Spray Valve<br><del>HY-203</del> <del>CHB-HY-203</del>                             | RSP                  |
| 4. Letdown to Regenerative<br>Heat Exchanger Isolation, <del>UV-515</del> <del>CHB-UV-515</del> | RSP                  |
| 5. Reactor Coolant Pump<br>Controlled Bleedoff, <del>HY-505</del> <del>CHB-UV-505</del>         | RSP                  |
| 6. Auxiliary Feedwater Pump<br>B to SG 1 Control Valve, <del>HY-30</del> <del>AFB-HY-30</del>   | RSP                  |
| 7. Auxiliary Feedwater Pump<br>B to SG 2 Control Valve, <del>HY-31</del> <del>AFB-HY-31</del>   | RSP                  |
| 8. Auxiliary Feedwater Pump<br>B to SG 1 Block Valve, <del>HY-34</del> <del>AFB-HY-34</del>     | RSP                  |
| 9. Auxiliary Feedwater Pump<br>B to SG 2 Block Valve, <del>HY-35</del> <del>AFB-HY-35</del>     | RSP                  |
| 10. Pressurizer Backup Heaters Banks<br>B10, B18, A05 Control                                   | RSP                  |
| 11. Safety Injection Tank 2A<br>Vent Control SIB-HV-613   | RSP                  |
| 12. Safety Injection Tank 2B<br>Vent Control SIB-HV-623   | RSP                  |
| 13. Safety Injection Tank 1A<br>Vent Control SIB-HV-633   | RSP                  |
| 14. Safety Injection Tank 1B<br>Vent Control SIB-HV-643   | RSP                  |
| 15. Safety Injection Tank Vent<br>Valves Power Supply <del>SIB-HS-18A</del>                     | RSP                  |
| 16. SG 1 line 2 ADV<br><del>HY-178B</del> <del>SGB-HY-178B</del>                                | RSP                  |
| 17. SG 2 line 1 ADV<br><del>HY-185B</del> <del>SGB-HY-185B</del>                                | RSP                  |
| 18. Control BLDG Battery Room D<br>Essential Exhaust Fan 'HJB-JOIA' ( <del>PHB-3207</del> )     | PHB-3205 M3206       |
| 19. Control BLDG Battery Room B<br>Essential Exhaust Fan 'HJB-JOIB' ( <del>PHB-3205</del> )     | PHB-3205 M3207       |
| 20. Battery Charger D Control<br>Room Circuits  | PHB-3209 AND PKD-H14 |
| 21. ESF Switchgear Room<br>Essential AHU & <del>HJB-203</del>                                   | PHB-3205             |
| 22. LPSI Pump & Breaker<br>Control <del>SIB-PO1</del>   | PBB-S04F             |
| 23. Diesel Generator B Breaker<br>Control   | PBB-S04B             |
| 24. Essential Spray Pond Pump <del>SIB-PO1</del><br>& Breaker Control                           | PBB-S04C             |



# FINAL DRAFT

## DISCONNECT SWITCHES

## SWITCH LOCATION

25.	Essential Chiller <del>8</del> ECB-PO1 Breaker Control	PBB-S04G
26.	E-PBB-S04J-4.16KV Feeder Breaker to Load Center L-32	PBB-S04J
27	E-PBB-S04H-4.16KV Feeder Breaker to Load Center L-34	PBB-S04H
28.	E-PBB-S04N-4.16KV Feeder Breaker to Load Center L-36	PBB-S04N
29	Auxiliary Feedwater Pump AFB-PO1 B Breaker Control	PBB-S04S
30.	<del>Essential Cooling Water</del> <del>Pump 8 Breaker Control</del> EWB-PO1	PBB-S04M
31	E-PGB-L32B2-480V Main Feeder Breaker to Load Center L-32	PGB-L32B2
32.	E-PGB-L34B2-480V Main Feeder Breaker to Load Center L-34	PGB-L34B2
33	E-PGB-L36B2-480V Main Feeder Breaker to Load Center L-36	PGB-L36B2
34.	Charging Pump No. 2 CHB-PO1 Supply Breaker CHB-PO1	PGB-L32C4
35.	Diesel Engine Control Switch 2A	DGB-C01
36.	Diesel Engine Control Switch 2B	DGB-C01
37.	Diesel Generator Control Switch	DGB-C01
38	Diesel Generator Essential Exhaust Fan 8 HPB-PO1	DGB-C01
39.	Diesel Generator Fuel Oil Transfer Pump 8 DFB-PO1	DGB-C01
40	Battery Charger BD Control Room Circuits-PKB-H16	PHB-M3425
41	Battery Charger B Control Room Circuits PKB-H12	PHB-M3627
42	125 VDC Battery B BREAKER Control Room Circuits	PKB-M4201
43.	125 VDC Battery D BREAKER Control Room Circuits	PKD-M4401
44.	CS Pump B Discharge to SD HX B SI-HV-689	PHB-M3804
45.	Shutdown Cooling LPSI Suction <del>SI-HV-656</del> SIB-HV-656	PHB-M3605
46.	LPSI-CS- from SD HX B X-Tie <del>SI-HV-695</del> SIB-HV-695	PHB-M3810
47	Shutdown Cooling Warmup Bypass <del>SI-HV-690</del> SIB-HV-690	PHB-M3800 <sup>3806</sup>
48.	LPSI-CS- to SD HS B Crosstie <del>SI-HV-694</del> SIB-HV-694	PHB-M3414
49.	SD HX "B" to Rc Loops 2A/2B <del>SI-HV-696</del> SIB-HV-696	PHB-M3415



# FINAL DRAFT

## DISCONNECT SWITCHES

## SWITCH LOCATION

50	LPSI-SD HX "B" Bypass SI-HV-307	PHB-M3803
51.	LPSI Pump "B" Recirc SI-UV-668	PHB-M3609
52	LPSI Pump "B" Suction from RWT SI-HV-692	PHB-M3805
53.	SD Cooling LPSI Pump "B" Suction SI-UV-652	PHB-M3604
54.	SD Cooling LPSI Pump "B" Suction SI-UV-654	PKD-B44
55	LPSI Header "B" to RC Loop 2A SI-UV-615	PHB-M3606
56	LPSI Header "B" to RC Loop 2B SI-UV-625	PHB-M3621
57.	VCT Outlet Isolation CHN-HB-501	NHN-M7208
58.	RWT Gravity Feed CHN-HV-536	NHN-M7209
59.	Shutdown Cooling Temperature Control SIB-HV-658	PHB-M3412
60.	Shutdown Cooling Heat Exchanger Bypass Valve SIB-HV-693	PHB-M3413
61	4.16 KV Bus PBB-S04 Feeder from XFMR NBN-X04	PBB-S04K
62.	4.16 KV Bus PBB-S04 Feeder from XFMR NBN-X03	PBB-S04L
63.	ELECTRICAL PENETRATION ROOM B ACU HAB-Z06	PHB-M3631
64	CONTROL ROOM HVAC ISOLATION DAMPERS HJB-M01/HJB-M55	
65.	O.S.A. Supply Damper HJB-M02	
66.	O.S.A. Supply Damper HJB-M03	
67.	R.C.S. Sample Isolation Valve SSA-UV-203	
68.	R.C.S. Sample Isolation Valve SSB-UV-200	

# FINAL DRAFT

## CONTROL CIRCUITS

## SWITCH LOCATION

1. Auxiliary Feedwater Pump B to S/G 1 Isolation Valve AFB-UV34	RSP
2. Auxiliary Feedwater Pump B to S/B 1 Control Valve AFB-HV30	RSP
3. Auxiliary Feedwater Pump B to S/G 2 Isolation Valve AFB-UV35	RSP
4. Auxiliary Feedwater Pump B to S/G 2 Control Valve AFB-HV31	RSP
5. Auxiliary Feedwater Pump AFB-P01	PBB-S04S
6. Charging Pump No. 2 CHB-P01	PGB-L32C4
7. Pressurizer Auxiliary Spray Valve CHB-HV203	RSP
8. Pressurizer Backup Heater Bank	RSP
9. Letdown to Regen HX Isolation Valve CHB-UV515	RSP
10. RCP Cont Bleedoff Valve CHB-HV505	RSP
11. Volume Control Tank Outlet Isolation Valve CHN-HV501	NHN-M7208
12. RWT Gravity Feed Isolation Valve CHN-HV536	NHN-M7209
13. S/G 1 line 2 Atmospheric Dump Valve Control <del>SGB-HIC</del> 1788	RSP
14. S/G line 2 Atmospheric Dump Isol. Valve <del>HY-170A</del> SGB-HY-178A	RSP
15. S/G 1 line 2 Atmospheric Dump Isol. Valve <del>HY-170B</del> SGB-HY-178A	RSP
16. S/G 2 line Atmospheric Dump Valve Control <del>SGB-HIC</del> HIC-185A	RSP
17. S/G 2 line 1 Atmospheric Dump Isol. Valve <del>HY-185A</del> SGB-HY-185A	RSP
18. S/G 2 line Atmospheric Dump Isol. Valve <del>HY-185B</del> SGB-HY-185B	RSP
19. Diesel Generator B Output Breaker	PBB-S04B
20. Diesel Generator Building Essential Exhaust Fan HDB-J01	DGB-B01
21. Diesel Generator B Fuel Oil Transfer Pump DFB-P01	DGB-B01
22. 4.16 KV to 480V LC L34 Supply Breaker	PBB-S04H
23. 4.16KV to 480V LC L32 Supply Breaker	PBB-S04J
24. 4.16KV to 480V LC L36 Supply Breaker	PBB-S04N
25. 480V LC L32 Supply Breaker	PGB-L32B2
26. 480V LC L34 Supply Breaker	PGB-L34B2

# FINAL DRAFT

## CONTROL CIRCUITS

## SWITCH LOCATION

27. 480V LC L36 Supply Breaker	PGB-L36B2
28. Battery Charger PKB-H12 Supply Breaker	PHB-M3627
29. Battery Charger PKD-H14 Supply Breaker	PHB-M3209
*30. Backup Battery Charger PKB-H16 Supply Breaker	PHB-M3425
31. Voltage Regulator PNB-V26 Supply Breaker	PHB-M3626
32. Voltage Regulator PNB-V28 Supply Breaker	PHB-M310
33. Essential Spray Pond Pump SPB-P01	PBB-S04C
34. Essential Cooling Water Pump EWB-P01	PBB-S04M
35. Essential Chilled Water Chiller ECB-E01	PBB-S04G
36. Battery Room D Essential Exhaust Fan HJB-J01A	PHB-M3206
37. Battery Room B Essential Exhaust Fan HJB-J01B	PHB-M3207
38. ESF Switchgear Room B Essential AHU HJB-J01B-203	PHB-M3203
39. Electrical Penetration Room B ACU Fan HAB-Z06	PHB-M3631
40. SIT Vent Valves Power Supply SIB-HS-18A	RSP
41. SIT 2A Vent Valve SIB-HV613	RSP
42. SIT 2B Vent Valve SIB-HV623	RSP
43. SIT 1A Vent Valve SIB-HV633	RSP
44. SIT 1B Vent Valve SIB-HV643	RSP
45. LPSI Pump B SIB-P01	PBB-S04F
46. Containment Spray Pump B Discharger to SD HX "B" Valve SIB-HV689	PHB-M3804
47. LPSI Containment Spray from SD HX "B" X-tie Valve SIB-HV695	PHB-M3810
48. Shutdown Cooling LPSI Suction Valve SIB-UV656 H	PHB-M3605
49. Shutdown Cooling Warmup Bypass Valve SIB-UV690	PHB-M3806
50. LPSI Containment Spray to SD HX "B" X-tie Valve SIB-UV694 H	PHB-M3414

\* Not required unless Battery Charger PKB-H12 or PKD-H14 is inoperable.



# FINAL DRAFT

<u>CONTROL CIRCUITS</u>	<u>SWITCH LOCATION</u>
51. SD HX "B" to RC Loops 2A/2B Valve SIB-UV696	PHB-M3415
52. LPSI SD HX "B" Bypass Valve SIB-HV307	PHB-M3803
53. LPSI Pump B Recirc. Valve SIB-UV688	PHB-M3609
54. LPSI Pump B Suction From RWT SIB-HV692	PHB-M3805
55. RC Loop to Shutdown Cooling Valve SIB-UV652	PHB-M3604
56. RC Loop to Shutdown Cooling Valve SIB-UV654	PKD-B44
57. LPSI Header B to RC Loop 2A Valve SIB-UV615	PHB-M3606
58. LPSI Header B to RC Loop 2B Valve SIB-UV625	PHB-M3621
59. SD "B" TEMPERATURE CONTROL VALVE SIB-HV-658	PHB-M3412
60. CONTROL ROOM VENTILATION ISOLATION DAMPERS HTB-M01/HTB-M55	
61. O.S.A. Supply DAMPER HTB-M02	
62. O.S.A. Supply DAMPER HTB-M03	
63. DIESEL GENERATOR "B" EMERGENCY START	
64. NORMAL OFFSITE POWER Supply BREAKER	PBB-S04K
65. ALTERNATE OFFSITE POWER Supply BREAKER	PBB-S04L
66. BATTERY "B" BREAKER	PKB-M4201
67. BATTERY "D" BREAKER	PKD-M4401
68. RCS SAMPLE ISOLATION VALVE SSA-UV-203	
69. RCS SAMPLE ISOLATION VALVE SSB-UV-200	
70. SHUTDOWN COOLING Temp. CONTROL VALVE SIB-HV-658	PHB-M3412
71. SHUTDOWN COOLING Heat EXCHANGER Bypass VALVE SIB-HV-693	PHB-M3413





TABLE 4.3-6

REMOTE SHUTDOWN INSTRUMENTATION  
SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL CALIBRATION</u>
1. Log Neutron Power Level	M	R
2. Reactor Coolant Hot Leg Temperature (2)	M	R
3. Reactor Coolant Cold Leg Temperature (2)	M	R
4. Pressurizer Pressure	M	R
5. Pressurizer Level	M	R
6. Steam Generator Pressure	M	R
7. Steam Generator Level	M	R
8. Refueling Water Tank Level	M	R
9. Charging Line Pressure	M	R
10. Charging Line Flow	M	R
11. Shutdown Cooling Heat Exchanger Temperatures	M	R
12. Shutdown Cooling Flow	M	R
13. Auxiliary Feedwater Flow Rate	M	R

FINAL DRAFT

INSTRUMENTATION

POST-ACCIDENT MONITORING INSTRUMENTATION

LIMITING CONDITION FOR OPERATION

3.3.3.6 The post-accident monitoring instrumentation channels shown in Table 3.3-10 shall be OPERABLE.

APPLICABILITY: MODES 1, 2, and 3.

ACTION:

- a. With the number of OPERABLE post-accident monitoring channels less than the Required Number of Channels shown in Table 3.3-10, either restore the inoperable channel to OPERABLE status within 7 days, or be in HOT SHUTDOWN within the next 12 hours.
- b. With the number of OPERABLE post-accident monitoring channels less than the Minimum Channels OPERABLE requirements of Table 3.3-10; either restore the inoperable channel(s) to OPERABLE status within 48 hours or be in at least HOT SHUTDOWN within the next 12 hours.
- b The provisions of Specification 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

4.3.3.6 Each post-accident monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK and CHANNEL CALIBRATION operations at the frequencies shown in Table 4.3-7.

a. WITH ONE OR MORE ACCIDENT MONITORING INSTRUMENTATION CHANNELS INOPERABLE, TAKE THE ACTION SHOWN IN TABLE 3.3-10

TABLE 3.3-10

POST-ACCIDENT MONITORING INSTRUMENTATION

<u>INSTRUMENT</u>	<u>REQUIRED NUMBER OF CHANNELS</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>ACTION</u>
1. Containment Pressure	2	1	28,29
2. Reactor Coolant Outlet Temperature - $T_{hot}$ (Wide Range)	2	1/loop	28,29
3. Reactor Coolant Inlet Temperature - $T_{cold}$ (Wide Range)	2	1/loop	28,29
4. Pressurizer Pressure - Wide Range	2	1	28,29
5. Pressurizer Water Level	2	1	28,29
6. Steam Generator Pressure	2/steam generator	1/steam generator	28,29
7. Steam Generator Water Level - Wide Range	2/steam generator	1/steam generator	28,29
8. Refueling Water Storage Tank Water Level	2	1	28,29
9. Auxiliary Feedwater Flow Rate	2	1	28,29
10. Reactor Cooling System Subcooling Margin Monitor	2	1	28,29
11. Pressurizer Safety Valve Position Indicator	1/valve	1/valve	28,29
12. Containment Water Level (Narrow Range)	2	1	28,29
13. Containment Water Level (Wide Range)	2	1	28,29
14. Core Exit Thermocouples	4/core quadrant	2/core quadrant	28,29
15. Reactor Vessel Water Level	2/16*	NA	30
16. Neutron Flux Monitor (Power Range)	4	2	28,29

\* TWO-OUT-OF-16 SENSORS, AT NON ADJACENT LEVELS, ONE OF WHICH MUST BE IN THE LOWER FOUR SENSORS LEVELS

RECEIVED  
JUL 11 1979

TABLE 4.3-7

POST-ACCIDENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT</u>	<u>CHANNEL CHECK</u>	<u>CHANNEL CALIBRATION</u>
1. Containment Pressure	M	R
2. Reactor Coolant Outlet Temperature - $T_{hot}$ (Wide Range)	M	R
3. Reactor Coolant Inlet Temperature - $T_{cold}$ (Wide Range)	M	R
4. Pressurizer Pressure - Wide Range	M	R
5. Pressurizer Water Level	M	R
6. Steam Generator Pressure	M	R
7. Steam Generator Water Level - Wide Range	M	R
8. Refueling Water Storage Tank Water Level	M	R
9. Auxiliary Feedwater Flow Rate	M	R
10. Reactor Coolant System Subcooling Margin Monitor	M	R
11. Pressurizer Safety Valve Position Indicator	M	R
12. Containment Water Level (Narrow Range)	M	R
13. Containment Water Level (Wide Range)	M	R
14. Core Exit Thermocouples	M	R
15. Reactor Vessel Water Level	M	R
16. Neutron Flux Monitor (Power Range)	M	R

FINAL DRAFT

#### Action 28

WITH THE NUMBER OF OPERABLE POST-ACCIDENT MONITORING CHANNELS LESS THAN THE REQUIRED NUMBER OF CHANNELS SHOWN IN TABLE 3.3-10, EITHER RESTORE THE INOPERABLE CHANNEL TO OPERABLE STATUS WITHIN 7 DAYS, OR BE IN HOT SHUTDOWN WITHIN THE NEXT 12 HOURS

#### Action 29

WITH THE NUMBER OF OPERABLE POST-ACCIDENT MONITORING CHANNELS LESS THAN THE MINIMUM CHANNELS OPERABLE REQUIREMENTS OF TABLE 3.3-10, EITHER RESTORE THE INOPERABLE CHANNEL(S) TO OPERABLE STATUS WITHIN 48 HOURS OR BE IN AT LEAST HOT SHUTDOWN WITHIN THE NEXT 12 HOURS.

#### Action 30

WITH THE NUMBER OF OPERABLE ACCIDENT MONITORING SENSORS LESS THAN THE REQUIRED NUMBER OF SENSORS, EITHER RESTORE THE SYSTEM TO OPERABLE STATUS WITHIN 48 HOURS OR:

1. INITIATE AN ALTERNATE METHOD TO  
THE REACTOR VESSEL INVENTORY;
2. PREPARE AND SUBMIT A SPECIAL REPORT  
TO THE COMMISSION PURSUANT TO  
SPECIFICATION 6.9.2 WITHIN 30 DAYS  
FOLLOWING THE EVENT OUTLINING THE  
ACTION TAKEN, THE CAUSE OF THE  
INOPERABILITY AND THE PLANS AND  
SCHEDULE FOR RESTORING THE SYSTEM  
TO OPERABLE STATUS; AND
3. RESTORE THE SYSTEM TO OPERABLE  
STATUS AT THE NEXT SCHEDULED  
REFUELING

## INSTRUMENTATION

### FIRE DETECTION INSTRUMENTATION

#### LIMITING CONDITION FOR OPERATION

---

3.3.3.7 As a minimum, the fire detection instrumentation for each FPER detection zone shown in Table 3.3-11 shall be OPERABLE.

APPLICABILITY: Whenever equipment protected by the fire detection instrument is required to be OPERABLE.

#### ACTION:

- a. With any, but not more than one-half the total in any fire zone Function X fire detection instrument shown in Table 3.3-11 inoperable, restore the inoperable instrument(s) to OPERABLE status within 14 days or within the next 1 hour establish a fire watch patrol to inspect the zone(s) with the inoperable instrument(s) at least once per hour, unless the instrument(s) is located inside the containment, then inspect that containment zone at least once per 8 hours or monitor the containment air temperature at least once per hour at the locations listed in Specification 4.6.1.5.
- b. With more than one-half of the Function X fire detection instruments in any fire zone shown in Table 3.3-11 inoperable, or with any Function Y fire detection instruments shown in Table 3.3-11 inoperable, or with any two or more adjacent fire detection instruments shown in Table 3.3-11 inoperable, within 1 hour establish a fire watch patrol to inspect the zone(s) with the inoperable instrument(s) at least once per hour, unless the instrument(s) is located inside the containment, then inspect that containment zone at least once per 8 hours or monitor the containment air temperature at least once per hour at the locations listed in Specification 4.6.1.5.
- c. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

---

4.3.3.7.1 Each of the above required fire detection instruments which are accessible during plant operation shall be demonstrated OPERABLE at least once per 6 months by performance of a CHANNEL FUNCTIONAL TEST. Fire detectors which are not accessible during plant operation shall be demonstrated OPERABLE by the performance of a CHANNEL FUNCTIONAL TEST during each COLD SHUTDOWN exceeding 24 hours unless performed in the previous 6 months.

4.3.3.7.2 The NFPA Standard 72D supervised circuits supervision associated with the detector alarms of each of the above required fire detection instruments shall be demonstrated OPERABLE at least once per 6 months.





# FINAL DRAFT

TABLE 3.3-11

FIRE DETECTION INSTRUMENTS

<u>FPER FIRE ZONE</u>	<u>ELEVATION</u>	<u>INSTRUMENT LOCATION</u>	<u>TOTAL NUMBER OF INSTRUMENTS*</u>		
			<u>HEAT (x/y)</u>	<u>FLAME (x/y)</u>	<u>SMOKE (x/y)</u>
<u>BUILDING - CONTROL</u>					
1	74'	Essential Chiller Rm. - Train A			24/0
2	74'	Essential Chiller Rm. - Train B			21/0
3A	74'	Cable Shaft - Train A			1/0
3B	74'	Cable Shaft - Train B			1/0
86A	74-156'4"	Deadspace Compartment - Train A	0/1		0/3
86B	74-156'4"	Deadspace Compartment - Train B	0/1		0/3
4A	100'	Cable Shaft - Train A			1/0
4B	100'	Cable Shaft - Train B			1/0
5A	100'	ESF Switchgear Room - Train A	0/5		0/18 s
5B	100'	ESF Switchgear Room - Train B	0/5		0/18 s
6A	100'	DC Equip. Rm. - Train A (Channel C)			2/0
6B	100'	DC Equip. Rm. - Train B (Channel D)			2/0
7A	100'	DC Equip. Rm. - Train A (Channel A)			2/0
7B	100'	DC Equip. Rm. - Train B (Channel B)			2/0
8A	100'	Battery Rm. - Train A (Channel C)	0/2		0/2
8B	100'	Battery Rm. - Train B (Channel D)	0/2		0/2



# FINAL DRAFT

TABLE 3.3-11 (Continued)

FIRE DETECTION INSTRUMENTS

<u>FIRE ZONE</u>	<u>ELEVATION</u>	<u>INSTRUMENT LOCATION</u>	<u>TOTAL NUMBER OF INSTRUMENTS*</u>		
			<u>HEAT</u> (x/y)	<u>FLAME</u> (x/y)	<u>SMOKE</u> (x/y)
9A	100'	Battery Rm. - Train A (Channel A)	0/2		0/2
9B	100'	Battery Rm. - Train B (Channel B)	0/2		0/2
10A	100'	Remote Shutdown Rm. - Train A	0/1		1/0
10B	100'	Remote Shutdown Rm. - Train B	0/1		1/0
11A	120'	Cable Shaft - Train A			1/0
11B	120'	Cable Shaft - Train B			1/0
14	120'	Lower Cable Spreading Rm. System 1 System 2 System 3 System 4 System 5 System 6	0/1 0/1 0/1 0/1 0/1 0/1		0/6 0/6 0/8 0/8 0/8 0/8
15A	140'	Cable Shaft - Train A			1/0
15B	140'	Cable Shaft - Train B			1/0
17	140'	Control Rm. - MCB's & Relay Cabinets	4/0		113/0
18A	160'	Cable Shaft - Train A			1/0
18B	160'	Cable Shaft - Train B			1/0
20	160'	Upper Cable Spreading Rm. System 1 System 2 System 3 System 4 System 5	0/1 0/1 0/1 0/1 0/1		0/12 0/8 0/8 0/8 0/8

# FINAL DRAFT

TABLE 3.3-11 (Continued)  
FIRE DETECTION INSTRUMENTS

FPER FIRE ZONE	ELEVATION	INSTRUMENT LOCATION	TOTAL NUMBER OF INSTRUMENTS*		
			HEAT (x/y)	FLAME (x/y)	SMOKE (x/y)
<u>BUILDING - DIESEL GENERATOR</u>					
21A	100'	Diesel Generator - Train A	0/3	0/4	
21B	100'	Diesel Generator - Train B	0/3	0/4	
22A	100'	Diesel Generator Control Rm. - Train A			1/0
22B	100'	Diesel Generator Control Rm. - Train B			1/0
24A	115'	Combustion Air Intake Rm. - Train A			1/0
24B	115'	Combustion Air Intake Rm. - Train B			1/0
23A	131'	Fuel Oil Day Tank - Train A	0/1		
23B	131'	Fuel Oil Day Tank - Train B	0/1		
25A	131'	Exhaust Silencer Rm. - Train A		3/0	
25B	131'	Exhaust Silencer Rm. - Train B		3/0	
<u>BUILDING - FUEL</u>					
28	100'	Spent Fuel Pool Cooling and Cleanup Pump Areas			3/0
<u>BUILDING - AUXILIARY</u>					
88A	51'-6"	West Corridors			6/0
88B	51'-6"	East Corridors			6/0
32A	51'-6"	LPSI Pump Rm. - Train A			0/2
32B	51'-6"	LPSI Pump Rm. - Train B			0/2



# FINAL DRAFT

TABLE 3.3-11 (Continued)

FIRE DETECTION INSTRUMENTS

<u>FIRE ZONE</u>	<u>ELEVATION</u>	<u>INSTRUMENT LOCATION</u>	<u>TOTAL NUMBER OF INSTRUMENTS*</u>		
			<u>HEAT</u> (x/y)	<u>FLAME</u> (x/y)	<u>SMOKE</u> (x/y)
34A	70'	ECW Pump Rm. - Train A			2/0
34B	70'	ECW Pump Rm. - Train B			2/0
35A	70'	Shutdown Cooling Ht. x Chgr. Train A			4/0
35B	70'	Shutdown Cooling Ht. x Chgr. Train B			4/0
36	70'	REACTOR MAKEUP AND BORIC ACID MAKEUP ROOM			1/0
37C	70' & 88'	Piping Penetration Rm. - Train A			5/0
37D	70' & 88'	Piping Penetration Rm. - Train B			4/0
37B	70'	Corridors - East			11/0
37A	70'	Corridors - West			11/0
39A	88'	Pipeways - Train A			8/0
39B	88'	Pipeways - Train B			8/0
42A	100'	Elect. Penetration Rm. - Tr. A (Chan. C)	0/1		0/25
42B	100'	Elect. Penetration Rm. - Tr. B (Chan. B)	0/1		0/24
42C	100'	Corridors - East & Southeast	0/2		3/35
42D	100'	Corridor - West	0/1		2/29
46A	100'	Charging Pump and Valve Gallery Rm. - Train A			0/3
46B	100'	Charging Pump and Valve Gallery Rm. - Train B			0/3
46E	100'	Charging Pump and Valve Gallery Rm. - Train E			0/3

TABLE 3.3-11 (Continued)  
FIRE DETECTION INSTRUMENTS

FPER FIRE ZONE	ELEVATION	INSTRUMENT LOCATION	TOTAL NUMBER OF INSTRUMENTS*		
			HEAT (x/y)	FLAME (x/y)	SMOKE (x/y)
47A	120'	Elect. Penetration Rm. - Tr. A (Chan. A)	0/1		0/28
47B	120'	Elect. Penetration Rm. - Tr. B (Chan. D)	0/1		0/24
48	120'	ECW Surge Tanks Corridor - Tr. A & B			3/0
50B	120'	Valve Gallery			1/0
51B	120'	Spray Chemical Storage Tk Rm.			1/0
52A	120'	Central Corridor - West	0/1		5/17
52D	120'	Central Corridor - East	0/1		7/18
54	120'	Reactor Trip Switchgear Rm.	<del>1/0</del>		6/0
56B	140'	Storage and Elect. Equip. Rm. - East			<del>6/0</del> 1/0
57I	140'	Clothing Issue and Men's Locker Rm.			5/0
57J	140'	Women's Locker, Clean Storage and Lunch Rms.			7/0
57N	140'	Corridor Area			4/0
<u>BUILDING - CONTAINMENT**</u>					
66A&66B	100' & 120'	Southwest and Southeast Perimeter	1/0		
67A&67B	100'	Northwest and Northeast Perimeter	1/0		
66A	120'	Southwest Perimeter	1/0		
66B	120'	Southeast Perimeter	1/0		
67A&67B	120'	Northwest and Northeast Perimeter	3/0		





TABLE 3.3-11 (Continued)

FIRE DETECTION INSTRUMENTS

<u>FIRE ZONE</u>	<u>ELEVATION</u>	<u>INSTRUMENT LOCATION</u>	<u>TOTAL NUMBER OF INSTRUMENTS*</u>		
			<u>HEAT</u> (x/y)	<u>FLAME</u> (x/y)	<u>SMOKE</u> (x/y)
63A	120'	No. 1 RCPs and SG Area			6/0
63B	120'	No. 2 RCPs and SG Area			5/0
66A & 66B 67A & 67B	140'	Southwest, Southeast, Northwest and Northeast Perimeters	1/0		
63A	140'	No. 1 RCPs and SG Area			5/0
63B	140'	No. 2 RCPs and SG Area			5/0
70	140'	Refueling Pool and Canal Area			4/0
71A	140'	North Preaccess Normal AFU Area			2/0
71B	140	South Preaccess Normal AFU Area			2/0
<u>MAIN STEAM SUPPORT STRUCTURE</u>					
72	80'	Turbine Driven Aux. Feedpump Rm.			0/3
73	80'	Motor Driven Aux. Feedpump Rm.			1/1
74A	100', 120' & 140'	Main Steam Isol. & Dump Valve Area North			0/6
74B	100', 120' & 140'	Main Steam Isol. & Dump Valve Area South			0/6
<u>OUTSIDE AREAS</u>					
83		Condensate Storage Tank Pump House			2/0

FINAL DRAFT

TABLE 3.3-11 (Continued)  
FIRE DETECTION INSTRUMENTS

<u>PPER FIRE ZONE</u>	<u>ELEVATION</u>	<u>INSTRUMENT LOCATION</u>	<u>TOTAL NUMBER OF INSTRUMENTS*</u>		
			<u>HEAT (x/y)</u>	<u>FLAME (x/y)</u>	<u>SMOKE (x/y)</u>
84A		Spray Pond Pump House - Train A			1/0
84B		Spray Pond Pump House - Train B			1/0

\*\* The fire detection instruments located within the containment are not required to be OPERABLE during the performance of Type A containment leakage rate tests.

\*(x/y): x is the number of instruments associated with early fire detection and notification only.

y is the number of instruments associated with actuation of fire suppression systems and early fire detection and notification.

**FINAL DRAFT**

INSTRUMENTATION

LOOSE-PART DETECTION INSTRUMENTATION

LIMITING CONDITION FOR OPERATION

---

3.3.3.8 The loose-part detection system shall be OPERABLE with all sensors specified in Table 3.3-12.

APPLICABILITY: MODES 1 and 2.

ACTION:

- a. With one or more loose-part detection system channels inoperable for more than 30 days, prepare and submit a Special Report to the Commission pursuant to Specification 6.9.2 within the next 10 days outlining the cause of the malfunction and the plans for restoring the channel(s) to OPERABLE status.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

---

4.3.3.8 Each channel of the loose-part detection system shall be demonstrated OPERABLE by performance of:

- a. a CHANNEL CHECK at least once per 24 hours,
- b. a CHANNEL FUNCTIONAL TEST at least once per 31 days, and
- c. a CHANNEL CALIBRATION at least once per 18 months.

FINAL DRAFT

TABLE 3.3-12

LOOSE PARTS SENSOR LOCATIONS

<u>INSTRUMENT NO.</u>	<u>LOCATION</u>
JSVNYE - 1	UPPER VESSEL A (STUD BOLTS)
JSVNYE - 2	UPPER VESSEL B (STUD BOLTS)
JSVNYE - 3	LOWER VESSEL A (INCORE NOZZLE)
JSVNYE - 4	LOWER VESSEL B (INCORE NOZZLE)
JSVNYE - 5	SG-1A (HOT LEG)
JSVNYE - 6	SG-1B (COLD LEG 1A)
JSVNYE - 7	SG-2A (HOT LEG)
JSVNYE - 8	SG-2B (COLD LEG 2A)

FINAL DRAFT

INSTRUMENTATION

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

LIMITING CONDITION FOR OPERATION

3.3.3.9 The radioactive gaseous effluent monitoring instrumentation channels shown in Table 3.3-13 shall be OPERABLE with their alarm/trip setpoints set to ensure that the limits of Specification 3.11.2.1 are not exceeded. The alarm/trip setpoints of these channels shall be determined and adjusted in accordance with the methodology and parameters in the ODCM.

APPLICABILITY: As shown in Table 3.3-13.

ACTION:

*Low Range.*

- a. With a<sup>^</sup>radioactive gaseous effluent monitoring instrumentation channel alarm/trip setpoint less conservative than required by the above Specification, immediately suspend the release of radioactive gaseous effluents monitored by the affected channel, or declare the channel inoperable, or change the setpoint so it is acceptably conservative.
- b. With less than the minimum number of radioactive gaseous effluent monitoring instrumentation channels OPERABLE, take the ACTION shown in Table 3.3-13. Restore the inoperable instrumentation to OPERABLE status within 30 days and, if unsuccessful, explain in the next Semi-annual Radioactive Effluent Release Report why this inoperability was not corrected within the time specified.
- c. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

4.3.3.9 Each radioactive gaseous effluent monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, SOURCE CHECK, CHANNEL CALIBRATION, and CHANNEL FUNCTIONAL TEST operations at the frequencies shown in Table 4.3-8.

TABLE 3.3-13RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

<u>INSTRUMENT</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABILITY</u>	<u>ACTION</u>
1. GASEOUS RADWASTE SYSTEM			
a. Noble Gas Activity Monitor - Providing Alarm and Automatic Termination of Release #RU-12	1	#	35
b. Flow Rate Monitor	1	#	36
2. GASEOUS RADWASTE SYSTEM EXPLOSIVE GAS MONITORING SYSTEM			
a. Hydrogen Monitor	2	**	39
b. Oxygen Monitor	2	**	39

FINAL DRAFT

## RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

	<u>INSTRUMENT</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABILITY</u>	<u>ACTION</u>
3.	CONDENSER EVACUATION SYSTEM			
A.	Low Range Monitors			
a.	Noble Gas Activity Monitor #RU-141	1	1, 2, 3, 4	37
b.	Iodine Sampler	1	1, 2, 3, 4	40
c.	Particulate Sampler	1	1, 2, 3, 4	40
d.	Flow Rate Monitor	1	1, 2, 3, 4	36
e.	Sampler Flow Rate Measuring Device	1	1, 2, 3, 4	36
B.	High Range Monitors			
a.	Noble Gas Activity Monitor #RU-142	1	1, 2, 3, 4	<del>37</del> , 42
b.	Iodine Sampler	1	1, 2, 3, 4	<del>40</del> , 42
c.	Particulate Sampler	1	1, 2, 3, 4	<del>40</del> , 42
d.	Sampler Flow Rate Measuring Device	1	1, 2, 3, 4	<del>36</del> , 42
4.	PLANT VENT SYSTEM			
A.	Low Range Monitors			
a.	Noble Gas Activity Monitor #RU-143	1	*	37
b.	Iodine Sampler	1	*	40
c.	Particulate Sampler	1	*	40
d.	Flow Rate Monitor	1	*	36
e.	Sampler Flow Rate Measuring Device	1	*	36

Does it apply  
low range continuous  
sampling  
NO FLOW THROUGH  
MONITOR ONLY.  
comes on after  
accident

~~140~~  
~~140~~  
~~140~~  
~~140~~  
~~140~~

TABLE 3.3-13 (Continued)

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

<u>INSTRUMENT</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABILITY</u>	<u>ACTION</u>
4. PLANT VENT SYSTEM (Continued)			
B. High Range Monitors			
a. Noble Gas Activity Monitor #RU-144	1	*	<del>37</del> ,42
b. Iodine Sampler	1	*	<del>40</del> ,42
c. Particulate Sampler	1	*	<del>40</del> ,42
d. Sampler Flow Rate Measuring Device	1	*	<del>36</del> ,42
5. FUEL BUILDING VENTILATION SYSTEM			
A. Low Range Monitors			
a. Noble Gas Activity Monitor #RU-145	1	##	37,41
b. Iodine Sampler	1	##	40
c. Particulate Sampler	1	##	40
d. Flow Rate Monitor	1	##	36
e. Sampler Flow Rate Measuring Device	1	##	36
B. High Range Monitors			
a. Noble Gas Activity Monitor #RU-146	1	##	<del>37</del> ,41,42
b. Iodine Sampler	1	##	<del>40</del> ,42
c. Particulate Sampler	1	##	<del>40</del> ,42
d. Sampler Flow Rate Measuring Device	1	##	<del>36</del> ,42

FINAL DRAFT



TABLE 3.3-13 (Continued)

TABLE NOTATION

- \* At all times.
- \*\* During GASEOUS RADWASTE SYSTEM operation.
- # During waste gas release.
- ## In MODES 1, 2, 3, and 4 or when irradiated fuel is in the fuel storage pool.

- ACTION 35 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, the contents of the tank(s) may be released to the environment provided that prior to initiating the release:
- a. At least two independent samples of the tank's contents are analyzed, and
  - b. At least two technically qualified members of the facility staff independently verify the release rate calculations and discharge valve lineup;
- Otherwise, suspend release of radioactive effluents via this pathway.
- ACTION 36 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided the flow rate is estimated at least once per 4 hours.
- ACTION 37 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided the actions of (A) or (B) are performed:
- A. Initiate the Preplanned Alternate Sampling Program of Section 6.16 to monitor the appropriate parameter(s).
  - B. Place moveable air monitors in-line or take grab samples at least once per 12 hours.
- ACTION 38 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, immediately suspend PURGING of radioactive effluents via this pathway.
- ACTION 39 - With the number of channels OPERABLE one less than required by the Minimum Channels OPERABLE requirement, operation of the GASEOUS RADWASTE SYSTEM may continue provided grab samples are taken and analyzed daily. With both channels inoperable operation may continue provided grab samples are taken and analyzed (1) every 4 hours during degassing operations, and (2) daily during other operations.

TABLE 3.3-13 (Continued)

TABLE NOTATION

- ACTION 40 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via the effected pathway may continue provided samples are continuously collected with auxiliary sampling equipment as required in Table 4.11-2 within one hour after the channel has been declared inoperable.
- ACTION 41 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirements, comply with the ACTION b of Specification 3.9.12 or operate the fuel building essential ventilation system while moving irradiated fuel.
- ACTION 42 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, prepare and submit a Special Report to the Commission pursuant to Specification 6.9.2 within ~~14~~ days following the event outlining the action taken, the cause of the inoperability, and the plans and schedule for restoring the system to OPERABLE status.

30

RESTORE THE CHANNEL TO OPERABLE  
WITHIN 72 HOURS OR

TABLE 4.3-8

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT</u>	<u>CHANNEL CHECK</u>	<u>SOURCE CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>CHANNEL FUNCTIONAL TEST</u>	<u>MODES IN WHICH SURVEILLANCE IS REQUIRED.</u>
1. GASEOUS RADWASTE SYSTEM					
a. Noble Gas Activity Monitor - Providing Alarm and Automatic Termination of Release RU-12	P	P	R(3)	Q(1),P###	<i>Q(1),P###</i>
b. Flow Rate Monitor	P	N.A.	R	Q,P###	<i>Q,P###</i>
2. GASEOUS RADWASTE SYSTEM EXPLOSIVE GAS MONITORING SYSTEM					
a. Hydrogen Monitor (continuous)	D	N.A.	Q(4)	M	**
b. Hydrogen Monitor (sequential)	D	N.A.	Q(4)	M	**
c. Oxygen Monitor (continuous)	D	N.A.	Q(5)	M	**
d. Oxygen Monitor (sequential)	D	N.A.	Q(5)	M	**

PREPARED BY  
 DATE  
 CHECKED BY  
 DATE  
 APPROVED BY  
 DATE



## RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT</u>	<u>CHANNEL CHECK</u>	<u>SOURCE CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>CHANNEL FUNCTIONAL TEST</u>	<u>MODES IN WHICH SURVEILLANCE IS REQUIRED</u>
3. CONDENSER EVACUATION SYSTEM (RU-141 and RU-142)					
a. Noble Gas Activity Monitor	D	M	R(3)	Q(2)	1, 2, 3, 4
b. Iodine Sampler	N.A.	N.A.	N.A.	N.A.	1, 2, 3, 4
c. Particulate Sampler	N.A.	N.A.	N.A.	N.A.	1, 2, 3, 4
d. Flow Rate Monitor	D	N.A.	R	Q	1, 2, 3, 4
e. Sampler Flow Rate Measuring Device	D	N.A.	R	Q	1, 2, 3, 4
4. PLANT VENT SYSTEM (RU-143 and RU-144)					
a. Noble Gas Activity Monitor	D	M	R(3)	Q(2)	*
b. Iodine Sampler	N.A.	N.A.	N.A.	N.A.	*
c. Particulate Sampler	N.A.	N.A.	N.A.	N.A.	*
d. Flow Rate Monitor	D	N.A.	R	Q	*
e. Sampler Flow Rate Measuring Device	D	N.A.	R	Q	*

1877-78  
1878-79  
1879-80  
1880-81  
1881-82  
1882-83  
1883-84  
1884-85  
1885-86  
1886-87  
1887-88  
1888-89  
1889-90  
1890-91  
1891-92  
1892-93  
1893-94  
1894-95  
1895-96  
1896-97  
1897-98  
1898-99  
1899-00  
1900-01  
1901-02  
1902-03  
1903-04  
1904-05  
1905-06  
1906-07  
1907-08  
1908-09  
1909-10  
1910-11  
1911-12  
1912-13  
1913-14  
1914-15  
1915-16  
1916-17  
1917-18  
1918-19  
1919-20  
1920-21  
1921-22  
1922-23  
1923-24  
1924-25  
1925-26  
1926-27  
1927-28  
1928-29  
1929-30  
1930-31  
1931-32  
1932-33  
1933-34  
1934-35  
1935-36  
1936-37  
1937-38  
1938-39  
1939-40  
1940-41  
1941-42  
1942-43  
1943-44  
1944-45  
1945-46  
1946-47  
1947-48  
1948-49  
1949-50  
1950-51  
1951-52  
1952-53  
1953-54  
1954-55  
1955-56  
1956-57  
1957-58  
1958-59  
1959-60  
1960-61  
1961-62  
1962-63  
1963-64  
1964-65  
1965-66  
1966-67  
1967-68  
1968-69  
1969-70  
1970-71  
1971-72  
1972-73  
1973-74  
1974-75  
1975-76  
1976-77  
1977-78  
1978-79  
1979-80  
1980-81  
1981-82  
1982-83  
1983-84  
1984-85  
1985-86  
1986-87  
1987-88  
1988-89  
1989-90  
1990-91  
1991-92  
1992-93  
1993-94  
1994-95  
1995-96  
1996-97  
1997-98  
1998-99  
1999-00  
2000-01  
2001-02  
2002-03  
2003-04  
2004-05  
2005-06  
2006-07  
2007-08  
2008-09  
2009-10  
2010-11  
2011-12  
2012-13  
2013-14  
2014-15  
2015-16  
2016-17  
2017-18  
2018-19  
2019-20  
2020-21  
2021-22  
2022-23  
2023-24  
2024-25  
2025-26  
2026-27  
2027-28  
2028-29  
2029-30  
2030-31  
2031-32  
2032-33  
2033-34  
2034-35  
2035-36  
2036-37  
2037-38  
2038-39  
2039-40  
2040-41  
2041-42  
2042-43  
2043-44  
2044-45  
2045-46  
2046-47  
2047-48  
2048-49  
2049-50  
2050-51  
2051-52  
2052-53  
2053-54  
2054-55  
2055-56  
2056-57  
2057-58  
2058-59  
2059-60  
2060-61  
2061-62  
2062-63  
2063-64  
2064-65  
2065-66  
2066-67  
2067-68  
2068-69  
2069-70  
2070-71  
2071-72  
2072-73  
2073-74  
2074-75  
2075-76  
2076-77  
2077-78  
2078-79  
2079-80  
2080-81  
2081-82  
2082-83  
2083-84  
2084-85  
2085-86  
2086-87  
2087-88  
2088-89  
2089-90  
2090-91  
2091-92  
2092-93  
2093-94  
2094-95  
2095-96  
2096-97  
2097-98  
2098-99  
2099-00  
2100-01  
2101-02  
2102-03  
2103-04  
2104-05  
2105-06  
2106-07  
2107-08  
2108-09  
2109-10  
2110-11  
2111-12  
2112-13  
2113-14  
2114-15  
2115-16  
2116-17  
2117-18  
2118-19  
2119-20  
2120-21  
2121-22  
2122-23  
2123-24  
2124-25  
2125-26  
2126-27  
2127-28  
2128-29  
2129-30  
2130-31  
2131-32  
2132-33  
2133-34  
2134-35  
2135-36  
2136-37  
2137-38  
2138-39  
2139-40  
2140-41  
2141-42  
2142-43  
2143-44  
2144-45  
2145-46  
2146-47  
2147-48  
2148-49  
2149-50  
2150-51  
2151-52  
2152-53  
2153-54  
2154-55  
2155-56  
2156-57  
2157-58  
2158-59  
2159-60  
2160-61  
2161-62  
2162-63  
2163-64  
2164-65  
2165-66  
2166-67  
2167-68  
2168-69  
2169-70  
2170-71  
2171-72  
2172-73  
2173-74  
2174-75  
2175-76  
2176-77  
2177-78  
2178-79  
2179-80  
2180-81  
2181-82  
2182-83  
2183-84  
2184-85  
2185-86  
2186-87  
2187-88  
2188-89  
2189-90  
2190-91  
2191-92  
2192-93  
2193-94  
2194-95  
2195-96  
2196-97  
2197-98  
2198-99  
2199-00  
2200-01  
2201-02  
2202-03  
2203-04  
2204-05  
2205-06  
2206-07  
2207-08  
2208-09  
2209-10  
2210-11  
2211-12  
2212-13  
2213-14  
2214-15  
2215-16  
2216-17  
2217-18  
2218-19  
2219-20  
2220-21  
2221-22  
2222-23  
2223-24  
2224-25  
2225-26  
2226-27  
2227-28  
2228-29  
2229-30  
2230-31  
2231-32  
2232-33  
2233-34  
2234-35  
2235-36  
2236-37  
2237-38  
2238-39  
2239-40  
2240-41  
2241-42  
2242-43  
2243-44  
2244-45  
2245-46  
2246-47  
2247-48  
2248-49  
2249-50  
2250-51  
2251-52  
2252-53  
2253-54  
2254-55  
2255-56  
2256-57  
2257-58  
2258-59  
2259-60  
2260-61  
2261-62  
2262-63  
2263-64  
2264-65  
2265-66  
2266-67  
2267-68  
2268-69  
2269-70  
2270-71  
2271-72  
2272-73  
2273-74  
2274-75  
2275-76  
2276-77  
2277-78  
2278-79  
2279-80  
2280-81  
2281-82  
2282-83  
2283-84  
2284-85  
2285-86  
2286-87  
2287-88  
2288-89  
2289-90  
2290-91  
2291-92  
2292-93  
2293-94  
2294-95  
2295-96  
2296-97  
2297-98  
2298-99  
2299-00  
2300-01  
2301-02  
2302-03  
2303-04  
2304-05  
2305-06  
2306-07  
2307-08  
2308-09  
2309-10  
2310-11  
2311-12  
2312-13  
2313-14  
2314-15  
2315-16  
2316-17  
2317-18  
2318-19  
2319-20  
2320-21  
2321-22  
2322-23  
2323-24  
2324-25  
2325-26  
2326-27  
2327-28  
2328-29  
2329-30  
2330-31  
2331-32



TABLE 4.3-8 (Continued)

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT</u>	<u>CHANNEL CHECK</u>	<u>SOURCE CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>CHANNEL FUNCTIONAL TEST</u>	<u>MODES IN WHICH SURVEILLANCE IS REQUIRED</u>
5. FUEL BUILDING VENTILATION SYSTEM (RU-145 and RU-146)					
a. Noble Gas Activity Monitor	D	M	R(3)	Q(2)	##
b. Iodine Sampler	N.A.	N.A.	N.A.	N.A.	##
c. Particulate Sampler	N.A.	N.A.	N.A.	N.A.	##
d. Flow Rate Monitor	D	N.A.	R	Q	##
e. Sampler Flow Rate Measuring Device	D	N.A.	R	Q	##

END  
OF  
PAGE

TABLE 4.3-8 (Continued)

TABLE NOTATIONS

- \* At all times.
- \*\* During GASEOUS RADWASTE SYSTEM operation.
- # During waste gas release.
- ## During MODES 1, 2, 3 or 4 or with irradiated fuel in the fuel storage pool.
- ### Functional test should consist of, but not be limited to, a verification of system isolation capability by the insertion of a simulated alarm condition.
- (1) The CHANNEL FUNCTIONAL TEST shall also demonstrate that automatic isolation of this pathway and control room alarm annunciation occurs if any of the following conditions exists:
  1. Instrument indicates measured levels above the alarm/trip setpoint.
  2. Circuit failure.
  3. Instrument indicates a downscale failure.
  4. Instrument controls not set in operate mode.
- (2) The CHANNEL FUNCTIONAL TEST shall also demonstrate that control room alarm annunciation occurs if any of the following conditions exists:
  1. Instrument indicates measured levels above the alarm setpoint.
  2. Circuit failure.
  3. Instrument indicates a downscale failure.
  4. Instrument controls not set in operate mode.
- (3) The initial CHANNEL CALIBRATION shall be performed using one or more of the reference standards certified by the National Bureau of Standards (NBS) or using standards that have been obtained from suppliers that participate in measurement assurance activities with NBS. These standards shall permit calibrating the system over its intended range of energy and measurement range. For subsequent CHANNEL CALIBRATION, sources that have been related to the initial calibration shall be used.
- (4) The CHANNEL CALIBRATION shall include the use of standard gas samples containing a nominal:
  1. One volume percent hydrogen, balance nitrogen, and
  2. Four volume percent hydrogen, balance nitrogen.
- (5) The CHANNEL CALIBRATION shall include the use of standard gas samples containing a nominal:
  1. One volume percent oxygen, balance nitrogen, and
  2. Four volume percent oxygen, balance nitrogen.



**FINAL DRAFT**

### 3/4.4 REACTOR COOLANT SYSTEM

#### 3/4.4.1 REACTOR COOLANT LOOPS AND COOLANT CIRCULATION

##### STARTUP AND POWER OPERATION

##### LIMITING CONDITION FOR OPERATION

---

3.4.1.1 Both reactor coolant loops and both reactor coolant pumps in each loop shall be in operation.

APPLICABILITY: MODES 1 and 2.\*

ACTION:

With less than the above required reactor coolant pumps in operation, be in at least HOT STANDBY within 1 hour.

##### SURVEILLANCE REQUIREMENTS

---

4.4.1.1 The above required reactor coolant loops shall be verified to be in operation and circulating reactor coolant at least once per 12 hours.

\*See Special Test Exception 3.10.3.

## REACTOR COOLANT SYSTEM

### HOT STANDBY

#### LIMITING CONDITION FOR OPERATION

---

3.4.1.2 The reactor coolant loops listed below shall be OPERABLE and at least one of these reactor coolant loops shall be in operation.\*

- a. Reactor Coolant Loop 1 and its associated steam generator and at least one associated reactor coolant pump.
- b. Reactor Coolant Loop 2 and its associated steam generator and at least one associated reactor coolant pump.

APPLICABILITY: MODE 3.

#### ACTION:

- a. With less than the above required reactor coolant loops OPERABLE, restore the required loops to OPERABLE status within 72 hours or be in HOT SHUTDOWN within the next 12 hours.
- b. With no reactor coolant loop in operation, suspend all operations involving a reduction in boron concentration of the Reactor Coolant System and immediately initiate corrective action to return the required reactor coolant loop to operation.

#### SURVEILLANCE REQUIREMENTS

---

4.4.1.2.1 At least the above required reactor coolant pumps, if not in operation, shall be determined to be OPERABLE once per 7 days by verifying correct breaker alignments and indicated power availability.

4.4.1.2.2 At least one reactor coolant loop shall be verified to be in operation and circulating reactor coolant at least once per 12 hours.

4.4.1.2.3 The required steam generator(s) shall be determined OPERABLE verifying the secondary side water level to be  $\geq 25\%$  indicated wide range level at least once per 12 hours.

---

\*All reactor coolant pumps may be deenergized for up to 1 hour provided (1) no operations are permitted that would cause dilution of the Reactor Coolant System boron concentration, and (2) core outlet temperature is maintained at least 10°F below saturation temperature.

## REACTOR COOLANT SYSTEM

### HOT SHUTDOWN

#### LIMITING CONDITION FOR OPERATION

---

3.4.1.3 At least two of the loop(s)/train(s) listed below shall be OPERABLE and at least one reactor coolant and/or shutdown cooling loops shall be in operation.\*

- a. Reactor Coolant Loop 1 and its associated steam generator and at least one associated reactor coolant pump,\*\*
- b. Reactor Coolant Loop 2 and its associated steam generator and at least one associated reactor coolant pump,\*\*
- c. Shutdown Cooling Train A,
- d. Shutdown Cooling Train B.

APPLICABILITY: MODE 4.

#### ACTION:

- a. With less than the above required reactor coolant and/or shutdown cooling loops OPERABLE, immediately initiate corrective action to return the required loops to OPERABLE status as soon as possible; if the remaining OPERABLE loop is a shutdown cooling loop, be in COLD SHUTDOWN within 24 hours.
- b. With no reactor coolant or shutdown cooling loop in operation, suspend all operations involving a reduction in boron concentration of the Reactor Coolant System and immediately initiate corrective action to return the required coolant loop to operation.

---

\*All reactor coolant pumps and shutdown cooling pumps may be deenergized for up to 1 hour provided (1) no operations are permitted that would cause dilution of the Reactor Coolant System boron concentration, and (2) core outlet temperature is maintained at least 10°F below saturation temperature.

\*\*A reactor coolant pump shall not be started with one or more of the Reactor Coolant System cold leg temperatures less than or equal to 255°F during cooldown, or 295°F during heatup, unless the secondary water temperature (saturation temperature corresponding to steam generator pressure) of each steam generator is less than 100°F above each of the Reactor Coolant System cold leg temperatures.

## REACTOR COOLANT SYSTEM

### HOT SHUTDOWN

#### SURVEILLANCE REQUIREMENTS

---

4.4.1.3.1 The required reactor coolant pump(s), if not in operation, shall be determined to be OPERABLE once per 7 days by verifying correct breaker alignments and indicated power availability.

4.4.1.3.2 The required steam generator(s) shall be determined OPERABLE by verifying the secondary side water level to be  $\geq 25\%$  indicated wide range level at least once per 12 hours.

4.4.1.3.3 At least one reactor coolant or shutdown cooling loop shall be verified to be in operation and circulating reactor coolant at a flow rate greater than or equal to 4000 gpm at least once per 12 hours.

REACTOR COOLANT SYSTEM

COLD SHUTDOWN - LOOPS FILLED

LIMITING CONDITION FOR OPERATION

---

3.4.1.4.1 At least one shutdown cooling loop shall be OPERABLE and in operation\*, and either:

- a. One additional shutdown cooling loop shall be OPERABLE#, or
- b. The secondary side water level of at least two steam generators shall be greater than 25% indicated wide range level.

APPLICABILITY: MODE 5 with reactor coolant loops filled##.

ACTION:

- a. With less than the above required loops OPERABLE or with less than the required steam generator level, immediately initiate corrective action to return the required loops to OPERABLE status or to restore the required level as soon as possible.
- b. With no shutdown cooling loop in operation, suspend all operations involving a reduction in boron concentration of the Reactor Coolant System and immediately initiate corrective action to return the required shutdown cooling loop to operation.

SURVEILLANCE REQUIREMENTS

---

4.4.1.4.1.1 The secondary side water level of both steam generators when required shall be determined to be within limits at least once per 12 hours.

4.4.1.4.1.2 At least one shutdown cooling loop shall be determined to be in operation and circulating reactor coolant at a flow rate of greater than or equal to 4000 gpm at least once per 12 hours.

#One shutdown cooling loop may be inoperable for up to 2 hours for surveillance testing provided the other shutdown cooling loop is OPERABLE and in operation.

##A reactor coolant pump shall not be started with one or more of the Reactor Coolant System cold leg temperatures less than or equal to 255°F during cooldown, or 295°F during heatup, unless the secondary water temperature saturation temperature corresponding to steam generator pressure) of each steam generator is less than 100°F above each of the Reactor Coolant System cold leg temperatures.

\*The shutdown cooling pump may be deenergized for up to 1 hour provided (1) no operations are permitted that would cause dilution of the Reactor Coolant System boron concentration, and (2) core outlet temperature is maintained at least 10°F below saturation temperature.

## REACTOR COOLANT SYSTEM

### COLD SHUTDOWN - LOOPS NOT FILLED

#### LIMITING CONDITION FOR OPERATION

---

3.4.1.4.2 Two shutdown cooling loops shall be OPERABLE<sup>#</sup> and at least one shutdown cooling loop shall be in operation.\*

APPLICABILITY: MODE 5 with reactor coolant loops not filled.

ACTION:

- a. With less than the above required loops OPERABLE, immediately initiate corrective action to return the required loops to OPERABLE status as soon as possible.
- b. With no shutdown cooling loop in operation, suspend all operations involving a reduction in boron concentration of the Reactor Coolant System and immediately initiate corrective action to return the required shutdown cooling loop to operation.

#### SURVEILLANCE REQUIREMENTS

---

4.4.1.4.2 At least one shutdown cooling loop shall be determined to be in operation and circulating reactor coolant at a flow rate of greater than or equal to 4000 gpm at least once per 12 hours.

<sup>#</sup>One shutdown cooling loop may be inoperable for up to 2 hours for surveillance testing provided the other shutdown cooling loop is OPERABLE and in operation.

\*The shutdown cooling pump may be de-energized for up to 1 hour provided (1) no operations are permitted that would cause dilution of the Reactor Coolant System boron concentration, and (2) core outlet temperature is maintained at least 10°F below saturation temperature.



**FINAL DRAFT**

REACTOR COOLANT SYSTEM

3/4.4.2 SAFETY VALVES

SHUTDOWN

LIMITING CONDITION FOR OPERATION

---

3.4.2.1 A minimum of one pressurizer code safety valve shall be OPERABLE with a lift setting of 2500 psia  $\pm$  1%.\*

APPLICABILITY: MODE 4.

ACTION:

- a. With no pressurizer code safety valve OPERABLE, immediately suspend all operations involving positive reactivity changes and place an OPERABLE shutdown cooling loop into operation.
- b. The provisions of Specification 3.0.4 may be suspended for up to 12 hours for entering into and during operation in MODE 4 for purposes of setting the pressurizer code safety valves under ambient (HOT) conditions provided a preliminary cold setting was made prior to heatup.

SURVEILLANCE REQUIREMENTS

---

4.4.2.1 No additional Surveillance Requirements other than those required by Specification 4.0.5.

---

\*The lift setting pressure shall correspond to ambient conditions of the valve at nominal operating temperature and pressure.



FINAL DRAFT

REACTOR COOLANT SYSTEM

OPERATING

LIMITING CONDITION FOR OPERATION

---

3.4.2.2 All pressurizer code safety valves shall be OPERABLE with a lift setting of 2500 psia  $\pm$  1%.\*

APPLICABILITY: MODES 1, 2, and 3.

ACTION:

With one pressurizer code safety valve inoperable, either restore the inoperable valve to OPERABLE status within 15 minutes or be in at least HOT STANDBY within 6 hours and in HOT SHUTDOWN within the following 6 hours with the shutdown cooling system suction line relief valves aligned to provide overpressure protection for the Reactor Coolant System.

SURVEILLANCE REQUIREMENTS

---

4.4.2.2 No additional Surveillance Requirements other than those required by Specification 4.0.5.

---

\*The lift setting pressure shall correspond to ambient conditions of the valve at nominal operating temperature and pressure.

## REACTOR COOLANT SYSTEM

FINAL DRAFT

### 3/4.4.3 PRESSURIZER

#### PRESSURIZER

#### LIMITING CONDITION FOR OPERATION

---

3.4.3.1 The pressurizer shall be OPERABLE with a minimum steady-state water level of greater than or equal to 27% indicated level (425 cubic feet) and a maximum steady-state water level of less than or equal to 56% indicated level (948 cubic feet) and at least two groups of pressurizer heaters capable of being powered from Class 1E buses each having a nominal capacity of at least 150 kW.

APPLICABILITY: MODES 1, 2, and 3.

#### ACTION:

- a. With only one group of the above required pressurizer heaters OPERABLE, restore at least two groups to OPERABLE status within 72 hours or be in at least HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.
- b. With the pressurizer otherwise inoperable, restore the pressurizer to OPERABLE status within 1 hour, or be in at least HOT STANDBY with the reactor trip breakers open within 6 hours and in HOT SHUTDOWN within the following 6 hours.

#### SURVEILLANCE REQUIREMENTS

---

4.4.3.1.1 The pressurizer water volume shall be determined to be within its limits at least once per 12 hours.

4.4.3.1.2 The capacity of the above required groups of pressurizer heaters shall be verified to be at least 150 kW at least once per 92 days.

4.4.3.1.3 The emergency power supply for the pressurizer heaters shall be demonstrated OPERABLE at least once per 18 months by verifying that on an Engineered Safety Features Actuation test signal concurrent with a loss-of-offsite power:

- a. The pressurizer heaters are automatically shed from the emergency power sources, and
- b. The pressurizer heaters can be reconnected to their respective buses manually from the control room.

FINAL DRAFT

REACTOR COOLANT SYSTEM

AUXILIARY SPRAY

LIMITING CONDITION FOR OPERATION

---

3.4.3.2 Both auxiliary spray valves shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

- a. With only one group of the above required auxiliary spray valves OPERABLE, restore both valves to OPERABLE status within 72 hours or be in at least HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.
- b. With none of the above required auxiliary spray valves OPERABLE, restore at least one valve to OPERABLE status within the next 6 hours or be in at least HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.

SURVEILLANCE REQUIREMENTS

---

4.4.3.2.1 The auxiliary spray valves shall be verified to have power available to each valve every 24 hours.

4.4.3.2.2 The auxiliary spray valves shall be cycled at least once per 18 months.

FINAL DRAFT

REACTOR COOLANT SYSTEM

3/4.4.4 STEAM GENERATORS

LIMITING CONDITION FOR OPERATION

---

3.4.4 Each steam generator shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

With one or more steam generators inoperable, restore the inoperable generator(s) to OPERABLE status prior to increasing  $T_{cold}$  above 210°F.

SURVEILLANCE REQUIREMENTS

---

4.4.4.0 Each steam generator shall be demonstrated OPERABLE by performance of the following augmented inservice inspection program.

4.4.4.1 Steam Generator Sample Selection and Inspection - Each steam generator shall be determined OPERABLE during shutdown by selecting and inspecting at least the minimum number of steam generators specified in Table 4.4-1.

4.4.4.2 Steam Generator Tube Sample Selection and Inspection - The steam generator tube minimum sample size, inspection result classification, and the corresponding action required shall be as specified in Table 4.4-2. The inservice inspection of steam generator tubes shall be performed at the frequencies specified in Specification 4.4.4.3 and the inspected tubes shall be verified acceptable per the acceptance criteria of Specification 4.4.4.4. The tubes selected for each inservice inspection shall include at least 3% of the total number of tubes in all steam generators; the tubes selected for these inspections shall be selected on a random basis except:

- a. Where experience in similar plants with similar water chemistry indicates critical areas to be inspected, then at least 50% of the tubes inspected shall be from these critical areas.
- b. The first sample of tubes selected for each inservice inspection (subsequent to the preservice inspection) of each steam generator shall include:

FINAL DRAFT

REACTOR COOLANT SYSTEM

SURVEILLANCE REQUIREMENTS (Continued)

1. All nonplugged tubes that previously had detectable wall penetrations (greater than 20%).
  2. Tubes in those areas where experience has indicated potential problems.
  3. A tube inspection (pursuant to Specification 4.4.4.4a.8.) shall be performed on each selected tube. If any selected tube does not permit the passage of the eddy current probe for a tube inspection, this shall be recorded and an adjacent tube shall be selected and subjected to a tube inspection.
- c. The tubes selected as the second and third samples (if required by Table 4.4-2) during each inservice inspection may be subjected to a partial tube inspection provided:
1. The tubes selected for these samples include the tubes from those areas of the tube sheet array where tubes with imperfections were previously found.
  2. The inspections include those portions of the tubes where imperfections were previously found.

The results of each sample inspection shall be classified into one of the following three categories:

Category

Inspection Results

- |     |  |
|-----|--|
| C-1 | Less than 5% of the total tubes inspected are degraded tubes and none of the inspected tubes are defective.  |
| C-2 | One or more tubes, but not more than 1% of the total tubes inspected are defective, or between 5% and 10% of the total tubes inspected are degraded tubes. |
| C-3 | More than 10% of the total tubes inspected are degraded tubes or more than 1% of the inspected tubes are defective.  |

Note: In all inspections, previously degraded tubes must exhibit significant (greater than 10%) further wall penetrations to be included in the above percentage calculations.

SURVEILLANCE REQUIREMENTS (Continued)

---

4.4.4.3 Inspection Frequencies - The above required inservice inspections of steam generator tubes shall be performed at the following frequencies:

- a. The first inservice inspection shall be performed after 6 Effective Full Power Months but within 24 calendar months of initial criticality. Subsequent inservice inspections shall be performed at intervals of not less than 12 nor more than 24 calendar months after the previous inspection. If two consecutive inspections following service under AVT conditions, not including the preservice inspection, result in all inspection results falling into the C-1 category or if two consecutive inspections demonstrate that previously observed degradation has not continued and no additional degradation has occurred, the inspection interval may be extended to a maximum of once per 40 months.
- b. If the results of the inservice inspection of a steam generator conducted in accordance with Table 4.4-2 at 40 month intervals fall into Category C-3, the inspection frequency shall be increased to at least once per 20 months. The increase in inspection frequency shall apply until the subsequent inspections satisfy the criteria of Specification 4.4.4.3a.; the interval may then be extended to a maximum of once per 40 months.
- c. Additional, unscheduled inservice inspections shall be performed on each steam generator in accordance with the first sample inspection specified in Table 4.4-2 during the shutdown subsequent to any of the following conditions:
  1. Primary-to-secondary tubes leaks (not including leaks originating from tube-to-tube sheet welds) in excess of the limits of Specification 3.4.5.2.
  2. A seismic occurrence greater than the Operating Basis Earthquake.
  3. A loss-of-coolant accident requiring actuation of the engineered safeguards.
  4. A main steam line or feedwater line break.

REACTOR COOLANT SYSTEM

SURVEILLANCE REQUIREMENTS (Continued)

---

4.4.4.4 Acceptance Criteria

a. As used in this Specification

1. Imperfection means an exception to the dimensions, finish, or contour of a tube from that required by fabrication drawings or specifications. Eddy-current testing indications below 20% of the nominal tube wall thickness, if detectable, may be considered as imperfections.
2. Degradation means a service-induced cracking, wastage, wear, or general corrosion occurring on either inside or outside of a tube.
3. Degraded Tube means a tube containing imperfections greater than or equal to 20% of the nominal wall thickness caused by degradation.
4. % Degradation means the percentage of the tube wall thickness affected or removed by degradation.
5. Defect means an imperfection of such severity that it exceeds the plugging limit. A tube containing a defect is defective.
6. Plugging Limit means the imperfection depth at or beyond which the tube shall be removed from service and is equal to 40% of the nominal tube wall thickness.
7. Unserviceable describes the condition of a tube if it leaks or contains a defect large enough to affect its structural integrity in the event of an Operating Basis Earthquake, a loss-of-coolant accident, or a steam line or feedwater line break as specified in 4.4.4.3c., above.
8. Tube Inspection means an inspection of the steam generator tube from the point of entry (hot leg side) completely around the U-bend to the top support of the cold leg.
9. Preservice Inspection means an inspection of the full length of each tube in each steam generator performed by eddy current techniques prior to service to establish a baseline

REACTOR COOLANT SYSTEMSURVEILLANCE REQUIREMENTS (Continued)

---

condition of the tubing. This inspection was performed prior to the field hydrostatic test and prior to initial POWER OPERATION using the equipment and techniques expected to be used during subsequent inservice inspections.

- b. The steam generator shall be determined OPERABLE after completing the corresponding actions (plug all tubes exceeding the plugging limit and all tubes containing through-wall cracks) required by Table 4.4-2.

#### 4.4.4.5 Reports

- a. Within 15 days following the completion of each inservice inspection of steam generator tubes, the number of tubes plugged in each steam generator shall be reported to the Commission in a Special Report pursuant to Specification 6.9.2.
- b. The complete results of the steam generator tube inservice inspection shall be submitted to the Commission in a Special Report pursuant to Specification 6.9.2 within 12 months following completion of the inspection. This Special Report shall include:
  - 1. Number and extent of tubes inspected.
  - 2. Location and percent of wall-thickness penetration for each indication of an imperfection.
  - 3. Identification of tubes plugged.
- c. Results of steam generator tube inspections which fall into Category C-3 shall be reported in a Special Report to the Commission pursuant to Specification 6.9.2 within 30 days and prior to resumption of plant operation and shall provide a description of investigations conducted to determine cause of the tube degradation and corrective measures taken to prevent recurrence.





TABLE 4.4-1

MINIMUM NUMBER OF STEAM GENERATORS TO BE  
INSPECTED DURING INSERVICE INSPECTION

The inservice inspection may be limited to one steam generator on a rotating schedule encompassing 6% of the tubes if the results of the first or previous inspections indicate that all steam generators are performing in a like manner. Note that under some circumstances, the operating conditions in one or more steam generators may be found to be more severe than those in other steam generators. Under such circumstances the sample sequence shall be modified to inspect the most severe conditions.

TABLE 4.4-2

STEAM GENERATOR TUBE INSPECTION

1ST SAMPLE INSPECTION			2ND SAMPLE INSPECTION		3RD SAMPLE INSPECTION	
Sample Size	Result	Action Required	Result	Action Required	Result	Action Required
A minimum of S Tubes per S. G.	C-1	None	N. A.	N. A.	N. A.	N. A.
	C-2	Plug defective tubes and inspect additional 2S tubes in this S. G.	C-1	None	N. A.	N. A.
			C-2	Plug defective tubes and inspect additional 4S tubes in this S. G.	C-1	None
					C-2	Plug defective tubes
					C-3	Perform action for C-3 result of first sample
			C-3	Perform action for C-3 result of first sample	N. A.	N. A.
	C-3	Inspect all tubes in this S. G., plug de- fective tubes and inspect 2S tubes in each other S. G.  Notification to NRC pursuant to §50.72 (b)(2) of 10 CFR Part 50	All other S. G.s are C-1	None	N. A.	N. A.
			Some S. G.s C-2 but no additional S. G. are C-3	Perform action for C-2 result of second sample	N. A.	N. A.
			Additional S. G. is C-3	Inspect all tubes in each S. G. and plug defective tubes. Notification to NRC pursuant to §50.72 (b)(2) of 10 CFR Part 50	N. A.	N. A.

$S = 3 \frac{N}{n} \%$  Where N is the number of steam generators in the unit, and n is the number of steam generators inspected during an inspection

FINAL DRAFT

REACTOR COOLANT SYSTEM

3/4.4.5 REACTOR COOLANT SYSTEM LEAKAGE

LEAKAGE DETECTION SYSTEMS

LIMITING CONDITION FOR OPERATION

---

3.4.5.1 The following Reactor Coolant System leakage detection systems shall be OPERABLE:

- a. A containment atmosphere particulate radioactivity monitoring system,
- b. The containment sump level and flow monitoring system, and
- c. The containment atmosphere gaseous radioactivity monitoring system.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

With only two of the above required leakage detection systems OPERABLE, operation may continue for up to 30 days provided grab samples of the containment atmosphere are obtained and analyzed at least once per 24 hours when the required gaseous and/or particulate radioactivity monitoring system is inoperable; otherwise, be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

---

4.4.5.1 The leakage detection systems shall be demonstrated OPERABLE by:

- a. Containment atmosphere gaseous and particulate monitoring system-performance of CHANNEL CHECK, CHANNEL CALIBRATION and CHANNEL FUNCTIONAL TEST at the frequencies specified in Table 4.3-3,
- b. Containment sump level and flow monitoring system-performance of CHANNEL CALIBRATION at least once per 18 months.



## REACTOR COOLANT SYSTEM

### OPERATIONAL LEAKAGE

#### LIMITING CONDITION FOR OPERATION

---

3.4.5.2 Reactor Coolant System leakage shall be limited to:

- a. No PRESSURE BOUNDARY LEAKAGE,
- b. 1 gpm UNIDENTIFIED LEAKAGE,
- c. 1 gpm total primary-to-secondary leakage through all steam generators, and 720 gallons per day through any one steam generator,
- d. 10 gpm IDENTIFIED LEAKAGE from the Reactor Coolant System, and
- e. 1 gpm leakage at a Reactor Coolant System pressure of  $2250 \pm 20$  psia from any Reactor Coolant System pressure isolation valve specified in Table 3.4-1.

APPLICABILITY: MODES 1, 2, 3, and 4

#### ACTION:

- a. With any PRESSURE BOUNDARY LEAKAGE, be in at least HOT STANDBY within 6 hours and in COLD SHUTDOWN within the following 30 hours.
- b. With any Reactor Coolant System leakage greater than any one of the limits, excluding PRESSURE BOUNDARY LEAKAGE and leakage from Reactor Coolant System pressure isolation valves, reduce the leakage rate to within limits within 4 hours or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- c. With any Reactor Coolant System pressure isolation valve leakage greater than the above limit, isolate the high pressure portion of the affected system from the low pressure portion within 4 hours by use of at least one closed manual or deactivated automatic valve, or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- d. With RCS leakage alarmed and confirmed in a flow path with no flow rate indicators, commence an RCS water inventory balance within 1 hour to determine the leak rate.

#### SURVEILLANCE REQUIREMENTS

---

4.4.5.2.1 Reactor Coolant System leakages shall be demonstrated to be within each of the above limits by:

- a. Monitoring the containment atmosphere gaseous and particulate radioactivity monitor at least once per 12 hours.
- b. Monitoring the containment sump inventory and discharge at least once per 12 hours.

REACTOR COOLANT SYSTEM

SURVEILLANCE REQUIREMENTS (Continued)

---

- c. Performance of a Reactor Coolant System water inventory balance at least once per 72 hours.
- d. Monitoring the reactor head flange leakoff system at least once per 24 hours.

4.4.5.2.2 Each Reactor Coolant System pressure isolation valve specified in Table 3.4-1 shall be demonstrated OPERABLE by verifying leakage to be within its limit:

- a. At least once per 18 months,
- b.\* Prior to entering MODE 2 whenever the plant has been in COLD SHUTDOWN for 72 hours or more and if leakage testing has not been performed in the previous 9 months,
- c. Prior to returning the valve to service following maintenance, repair or replacement work on the valve,
- d.\* Within 24 hours following valve actuation due to automatic or manual action or flow through the valve,
- e.\* Within 72 hours following a system response to an Engineered Safety Feature actuation signal.

The provisions of Specification 4.0.4 are not applicable for entry into MODE 3 or 4.

\*The provisions of Specifications 4.4.5.2.2.b, 4.4.5.2.2.d, and 4.4.5.2.2.e are not applicable for valves UV 651, UV 652, UV 653 and UV 654 due to position indication of valves in the control room.

FINAL DRAFT

TABLE 3.4-1

REACTOR COOLANT SYSTEM PRESSURE ISOLATION VALVES

VALVE	DESCRIPTION
1) <del>SIV-237</del> SIE-V237	LOOP 1A RC/SI CHECK
2) <del>SIV-247</del> SIE-V247	LOOP 1B RC/SI CHECK
3) <del>SIV-217</del> SIE-V217	LOOP 2A RC/SI CHECK
4) <del>SIV-227</del> SIE-V227	LOOP 2B RC/SI CHECK
5) <del>SIV-235</del> SIE-V235	LOOP 1A SIT CHECK
6) <del>SIV-245</del> SIE-V245	LOOP 1B SIT CHECK
7) <del>SIV-215</del> SIE-V215	LOOP 2A SIT CHECK
8) <del>SIV-225</del> SIE-V225	LOOP 2B SIT CHECK
9) <del>SIV-542</del> SIE-V542	LOOP 1A SI HEADER CHECK
10) <del>SIV-543</del> SIE-V543	LOOP 1B SI HEADER CHECK
11) <del>SIV-540</del> SIE-V540	LOOP 2A SI HEADER CHECK
12) <del>SIV-541</del> SIE-V541	LOOP 2B SI HEADER CHECK
13) <del>SIV-522</del> SIA-V522	LOOP 1 HP LONG TERM RECIRCULATION CHECK
14) <del>SIV-523</del> SIA-V523	LOOP 1 HP LONG TERM RECIRCULATION CHECK
15) <del>SIV-532</del> SIB-V532	LOOP 2 HP LONG TERM RECIRCULATION CHECK
16) <del>SIV-533</del> SIB-V533	LOOP 2 HP LONG TERM RECIRCULATION CHECK
17) <del>UV-651*,#</del> SIA-UV651*,#	LOOP 1 SHUTDOWN COOLING ISOLATION
18) <del>UV-652*,#</del> SIB-UV652*,#	LOOP 2 SHUTDOWN COOLING ISOLATION
19) <del>UV-653*,#</del> SIC-UV653*,#	LOOP 1 SHUTDOWN COOLING ISOLATION
20) <del>UV-654*,#</del> SFD-UV654*,#	LOOP 2 SHUTDOWN COOLING ISOLATION

\*Testing per Specification 4.4.5.2.2.d is not applicable due to positive indication of valve position in the control room.

- #1. Leakage rates less than or equal to 1.0 gpm are considered acceptable.
2. Leakage rates greater than 1.0 gpm but less than or equal to 5.0 gpm are considered acceptable if the latest measured rate has not exceeded the rate determined by previous test by an amount that reduces the margin between measured leakage rate and the maximum permissible rate of 5.0 gpm by 50% or greater.
3. Leakage rates greater than 1.0 gpm but less than or equal to 5.0 gpm are considered unacceptable if the latest measured rate exceeded the rate determined by the previous test by an amount that reduces the margin between measured leakage rate and the maximum permissible rate of 5.0 gpm by 50% or greater.
4. Leakage rates greater than 5.0 gpm are considered unacceptable.

SAME STATEMENT  
AS 3.4.5.2.c



FINAL DRAFT

REACTOR COOLANT SYSTEM

3/4.4.6 CHEMISTRY

LIMITING CONDITION FOR OPERATION

---

3.4.6 The Reactor Coolant System chemistry shall be maintained within the limits specified in Table 3.4-2.

APPLICABILITY: At all times.

ACTION:

MODES 1, 2, 3, and 4:

- a. With any one or more chemistry parameter in excess of its Steady State Limit but within its Transient Limit, restore the parameter to within its Steady State Limit within 24 hours or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- b. With any one or more chemistry parameter in excess of its Transient Limit, be in at least HOT STANDBY within 6 hours and in COLD SHUTDOWN within the following 30 hours.

At All Other Times:

With the concentration of either chloride or fluoride in the Reactor Coolant System in excess of its Steady State Limit for more than 24 hours or in excess of its Transient Limit, reduce the pressurizer pressure to less than or equal to 500 psia, if applicable, and perform an engineering evaluation to determine the effects of the out-of-limit condition on the structural integrity of the Reactor Coolant System; determine that the Reactor Coolant System remains acceptable for continued operation prior to increasing the pressurizer pressure above 500 psia or prior to proceeding to MODE 4.

SURVEILLANCE REQUIREMENTS

---

4.4.6 The Reactor Coolant System chemistry shall be determined to be within the limits by analysis of those parameters at the frequencies specified in Table 4.4-3.

FINAL DRAFT

TABLE 3.4-2  
REACTOR COOLANT SYSTEM  
CHEMISTRY

<u>PARAMETER</u>	<u>STEADY STATE LIMIT</u>	<u>TRANSIENT LIMIT</u>
DISSOLVED OXYGEN*	$\leq 0.10$ ppm	$\leq 1.00$ ppm
CHLORIDE	$\leq 0.15$ ppm	$\leq 1.50$ ppm
FLUORIDE	$\leq 0.10$ ppm	$\leq 1.00$ ppm

\*Limit not applicable with  $T_{\text{cold}}$  less than or equal to 250°F.

FINAL DRAFT

TABLE 4.4-3

REACTOR COOLANT SYSTEM

CHEMISTRY LIMITS SURVEILLANCE REQUIREMENTS

<u>PARAMETER</u>	<u>SAMPLE AND ANALYSIS FREQUENCY</u>
DISSOLVED OXYGEN*	At least once per 72 hours
CHLORIDE	At least once per 72 hours
FLUORIDE	At least once per 72 hours

\*Not required with  $T_{\text{cold}}$  less than or equal to 250°F

## REACTOR COOLANT SYSTEM

### 3/4.4.7 SPECIFIC ACTIVITY

#### LIMITING CONDITION FOR OPERATION

---

3.4.7 The specific activity of the primary coolant shall be limited to:

- a. Less than or equal to 1.0 microcurie/gram DOSE EQUIVALENT I-131, and
- b. Less than or equal to  $100/\bar{E}$  microcuries/gram.

APPLICABILITY: MODES 1, 2, 3, 4, and 5.

#### ACTION:

MODES 1, 2, and 3\*:

- a. With the specific activity of the primary coolant greater than 1.0 microcurie/gram DOSE EQUIVALENT I-131 but within the allowable limit (below and to the left of the line) shown on Figure 3.4-1, operation may continue for up to 48 hours provided that the cumulative operating time under these circumstances does not exceed 800 hours in any consecutive 12 month period. With the total cumulative operating time at a primary coolant specific activity greater than 1.0 microcurie/gram DOSE EQUIVALENT I-131 exceeding 500 hours in any consecutive 6 month period, prepare and submit a Special Report to the Commission pursuant to Specification 6.9.2 within 30 days indicating the number of hours above this limit. The provisions of Specification 3.0.4 are not applicable.
- b. With the specific activity of the primary coolant greater than 1.0 microcurie/gram DOSE EQUIVALENT I-131 for more than 48 hours during one continuous time interval or exceeding the limit line shown on Figure 3.4-1, be in at least HOT STANDBY with  $T_{cold}$  less than 500°F within 6 hours.
- c. With the specific activity of the primary coolant greater than  $100/\bar{E}$  microcuries/gram, be in at least HOT STANDBY with  $T_{cold}$  less than 500°F within 6 hours.

---

\* With  $T_{cold}$  greater than or equal to 500°F.

## REACTOR COOLANT SYSTEM

### LIMITING CONDITION FOR OPERATION (Continued)

#### ACTION: (Continued)

MODES 1, 2, 3, 4, and 5:

- d. With the specific activity of the primary coolant greater than 1 microcurie/gram DOSE EQUIVALENT I-131 or greater than 100/ $\bar{E}$  microcuries/gram, perform the sampling and analysis requirements of item 4.(a) of Table 4.4-4 until the specific activity of the primary coolant is restored to within its limits. A Special Report shall be prepared and submitted to the Commission pursuant to Specification 6.9.2 within 30 days with a copy to the Director, Nuclear Reactor Regulation, Attention: Chief, Core Performance Branch, and Chief, Accident Evaluation Branch, U.S. Nuclear Regulatory Commission, Washington, D.C. 20555. This report shall contain the results of the specific activity analyses together with the following information:
  1. Reactor power history starting 48 hours prior to the first sample in which the limit was exceeded,
  2. Fuel burnup by core region,
  3. Clean-up flow history starting 48 hours prior to the first sample in which the limit was exceeded,
  4. History of degassing operation, if any, starting 48 hours prior to the first sample in which the limit was exceeded. and
  5. The time duration when the specific activity of the primary coolant exceeded 1 microcurie/gram DOSE EQUIVALENT I-131.

### SURVEILLANCE REQUIREMENTS

4.4.7 The specific activity of the primary coolant shall be determined to be within the limits by performance of the sampling and analysis program of Table 4.4-4.



PRIMARY COOLANT SPECIFIC ACTIVITY SAMPLE

### TYPE OF MEASUREMENT AND ANALYSIS

### MODES IN WHICH SAMPLE AND ANALYSIS REQUIRED

1. Gross Activity Determination	At least once per 72 hours	1, 2, 3, 4
2. Isotopic Analysis for DOSE EQUIVALENT I-131 Concentration	1 per 14 days	1
3. Radiochemical for $\bar{E}$ Determination	1 per 6 months*	1
4. Isotopic Analysis for Iodine Including I-131, I-133, and I-135	(a) Once per 4 hours, whenever the specific activity exceeds 1.0 $\mu\text{Ci}/\text{gram}$ , DOSE EQUIVALENT I-131 or 100/ $\bar{E}$ $\mu\text{Ci}/\text{gram}$ , and	1#, 2#, 3#, 4#, 5#
	(b) One sample between 2 and 6 hours following a THERMAL POWER change exceeding 15% of the RATED THERMAL POWER within a 1-hour period. One sample is sufficient if plant has gone through a SHUTDOWN or if transient is complete in 6 hours.	1, 2, 3

#. Until the specific activity of the primary coolant system is restored within its limits.

\* Sample to be taken after a minimum of 2 EFPD and 20 days of POWER OPERATION have elapsed since reactor was last subcritical for 48 hours or longer.

# THE

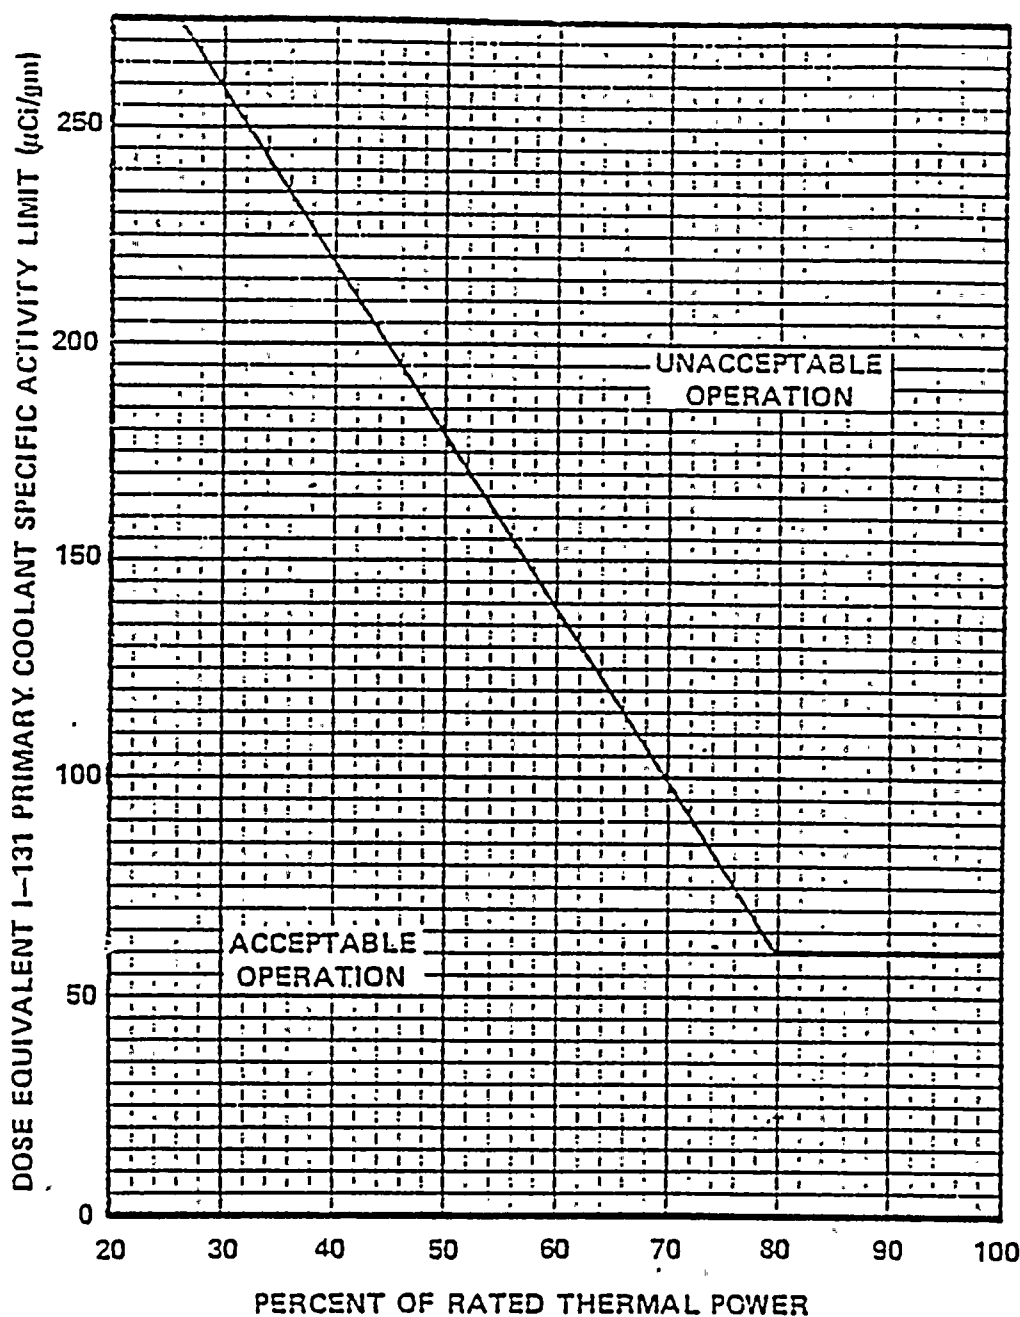


FIGURE 3.4-1

DOSE EQUIVALENT I-131 PRIMARY COOLANT SPECIFIC ACTIVITY LIMIT VERSUS  
PERCENT OF RATED THERMAL POWER WITH THE PRIMARY COOLANT SPECIFIC  
ACTIVITY > 1.0  $\mu\text{Ci/GRAM}$  DOSE EQUIVALENT I-131



## REACTOR COOLANT SYSTEM

### 3/4.4.8 PRESSURE/TEMPERATURE LIMITS

## REACTOR COOLANT SYSTEM

### LIMITING CONDITION FOR OPERATION

3.4.8.1 The Reactor Coolant System (except the pressurizer) temperature and pressure shall be limited in accordance with the limit lines shown on Figure 3.4-2 during heatup, cooldown, criticality, and inservice leak and hydrostatic testing with:

- a. A maximum heatup rate of 20°F per hour with the RCS cold leg temperature less than or equal to 95°F, 40°F per hour with RCS cold leg temperature greater than 95°F but less than or equal to 400°F, and 100°F per hour with RCS cold leg temperature greater than 400°F.
- b. A maximum cooldown rate of 20°F per hour with RCS cold leg temperature less than or equal to 100°F, 40°F per hour with RCS cold leg temperature greater than 100°F but less than or equal to 130°F, and 100°F per hour with RCS cold leg temperature greater than 130°F.
- c. A maximum temperature change of 10°F in any 1-hour period during inservice hydrostatic and leak testing operations.

APPLICABILITY: At all times. \*

### ACTION:

With any of the above limits exceeded, restore the temperature and/or pressure to within the limit within 30 minutes; perform an engineering evaluation to determine the effects of the out-of-limit condition on the structural integrity of the Reactor Coolant System; determine that the Reactor Coolant System remains acceptable for continued operations or be in at least HOT STANDBY within the next 6 hours and reduce the RCS  $T_{cold}$  and pressure to less than 210°F and 500 psia, respectively, within the following 30 hours.

### SURVEILLANCE REQUIREMENTS

4.4.8.1.1 The Reactor Coolant System temperature and pressure shall be determined to be within the limits at least once per 30 minutes during system heatup, cooldown, and inservice leak and hydrostatic testing operations.

4.4.8.1.2 The reactor vessel material irradiation surveillance specimens shall be removed and examined, to determine changes in material properties, at the intervals required by 10 CFR Part 50 Appendix H in accordance with the schedule in Table 4.4-5. The results of these examinations shall be used to update Figure 3.4-2.

\* SEE SPECIAL TEST EXCEPTION 3.10.5

PALO VERDE - UNIT 1

✓ 3/4 4-29

FIGURE 3.4-2  
RCS PRESS/TEMP LIMITS  
0-10 YRS.

FINAL DRAFT

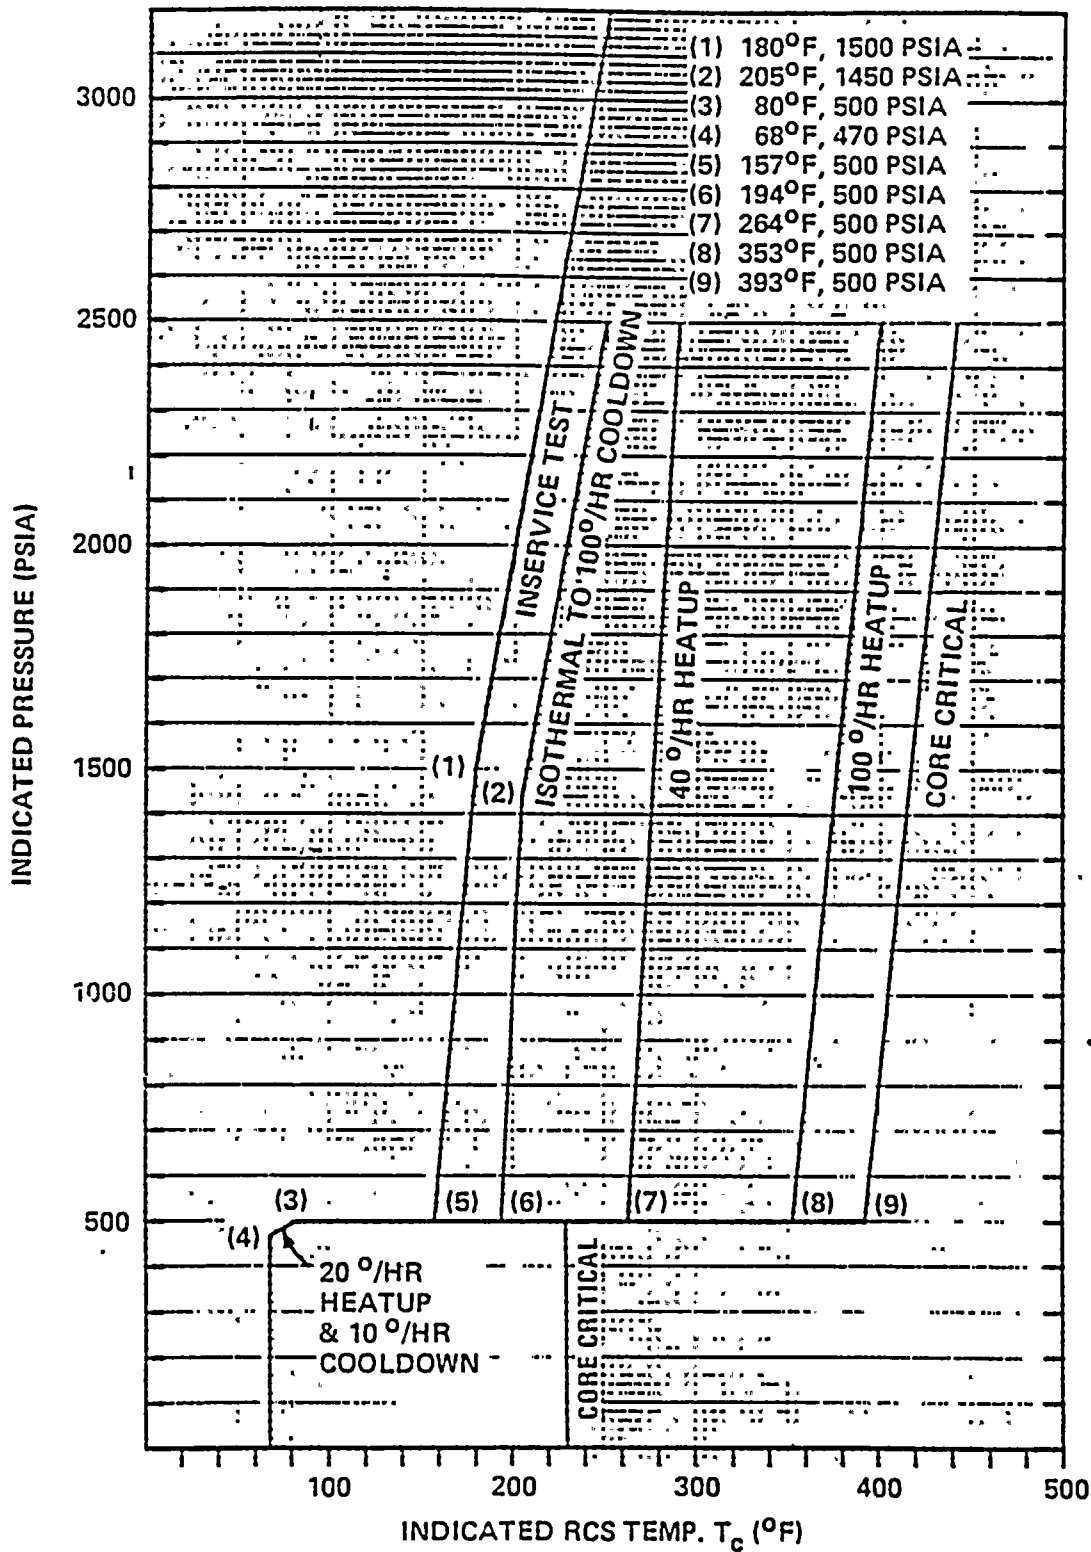


FIGURE 3/4 3.4-2

RCS PRESS/TEMP LIMITS (0 - 10 YRS) FULL POWER OPERATION

TABLE 4.4-5

REACTOR VESSEL MATERIAL SURVEILLANCE PROGRAM - WITHDRAWAL SCHEDULE

<u>CAPSULE NUMER</u>	<u>VESSEL LOCATION</u>	<u>LEAD FACTOR</u>	<u>WITHDRAWAL TIME (EFPY)</u>
1	38°	1.5	8 - 10
2	43°	1.5	Standby
3	137°	1.5	4 - 5
4	142°	1.5	Standby
5	230°	1.5	12 - 15
6	310°	1.5	18 - 24

PALO VERDE - UNIT 1

3/4 4-31

FINAL  
DRAFT

REACTOR COOLANT SYSTEM

PRESSURIZER HEATUP/COOLDOWN LIMITS

LIMITING CONDITION FOR OPERATION

---

3.4.8.2 The pressurizer temperature shall be limited to:

- a. A maximum heatup rate of 200°F per hour, and
- b. A maximum cooldown rate of 200°F per hour.

APPLICABILITY: At all times.

ACTION:

With the pressurizer temperature limits in excess of any of the above limits, restore the temperature to within the limits within 30 minutes; perform an engineering evaluation to determine the effects of the out-of-limit condition on the structural integrity of the pressurizer; determine that the pressurizer remains acceptable for continued operation or be in at least HOT STANDBY within the next 6 hours and reduce the pressurizer pressure to less than 500 psig within the following 30 hours.

SURVEILLANCE REQUIREMENTS

---

4.4.8.2.1 The pressurizer temperatures shall be determined to be within the limits at least once per 30 minutes during system heatup or cooldown.

4.4.8.2.2 The spray water temperature differential shall be determined for use in Table 5.7-2 for each cycle of main spray with less than four reactor coolant pumps operating and for each cycle of auxiliary spray operation.

## REACTOR COOLANT SYSTEM

### OVERPRESSURE PROTECTION SYSTEMS

#### LIMITING CONDITION FOR OPERATION

3.4.8.3 Both shutdown cooling system (SCS) suction line relief valves with lift settings of less than or equal to 467 psig shall be OPERABLE and aligned to provide overpressure protection for the Reactor Coolant System.

APPLICABILITY: When the reactor vessel head is installed and the temperature of one or more of the RCS cold legs is less than or equal to:

- a. 255°F during cooldown
- b. 295°F during heatup

#### ACTION:

- a. With one SCS relief valve inoperable, restore the inoperable valve to OPERABLE status within seven days or reduce  $T_{cold}$  to less than 200°F and, depressurize and vent the RCS through a greater than or equal to 16 square inch vent(s) within the next eight hours. Do not start a reactor coolant pump if the steam generator secondary water temperature is greater than 100°F above any RCS cold leg temperature.
- b. With both SCS relief valves inoperable, reduce  $T_{cold}$  to less than 200°F and, depressurize and vent the RCS through a greater than or equal to 16 square inch vent(s) within eight hours. Do not start a reactor coolant pump if the steam generator secondary water temperature is greater than 100°F above any RCS cold leg temperature.
- c. In the event either the SCS suction line relief valves or an RCS vent(s) are used to mitigate an RCS pressure transient, a Special Report shall be prepared and submitted to the Commission pursuant to Specification 6.9.2 within 30 days. The report shall describe the circumstances initiating the transient, the effect of the SCS suction line relief valves or RCS vent(s) on the transient and any corrective action necessary to prevent recurrence.
- d. The provisions of Specification 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

4.4.8.3.1 Each SCS suction line relief valve shall be verified to be aligned to provide overpressure protection for the RCS once every 8 hours during

- a. Cooldown with the RCS temperature less than or equal to 255°F.
- b. Heatup with the RCS temperature less than or equal to 295°F.

4.4.8.3.2 The SCS suction line relief valves shall be verified OPERABLE with the required setpoint at least once per 18 months.

## REACTOR COOLANT SYSTEM

### 3/4.4.9 STRUCTURAL INTEGRITY

#### LIMITING CONDITION FOR OPERATION

---

3.4.9 The structural integrity of ASME Code Class 1, 2, and 3 components shall be maintained in accordance with Specification 4.4.9.

APPLICABILITY: ALL MODES

ACTION:

- a. With the structural integrity of any ASME Code Class 1 component(s) not conforming to the above requirements, restore the structural integrity of the affected component(s) to within its limit or isolate the affected component(s) prior to increasing the Reactor Coolant System temperature more than 50°F above the minimum temperature required by NDT considerations.
- b. With the structural integrity of any ASME Code Class 2 component(s) not conforming to the above requirements, restore the structural integrity of the affected component(s) to within its limit or isolate the affected component(s) prior to increasing the Reactor Coolant System temperature above 210°F.
- c. With the structural integrity of any ASME Code Class 3 component(s) not conforming to the above requirements, restore the structural integrity of the affected component to within its limit or isolate the affected component from service.
- d. The provisions of Specification 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

---

4.4.9 In addition to the requirements of Specification 4.0.5, each reactor coolant pump flywheel shall be inspected per the recommendations of Regulatory Position C.4.b of Regulatory Guide 1.14, Revision 0, October 27, 1971.

## REACTOR COOLANT SYSTEM

FINAL DRAFT

### 3/4.4.10 REACTOR COOLANT SYSTEM VENTS

#### LIMITING CONDITION FOR OPERATION

3.4.10 Both reactor coolant system vent paths from the reactor vessel head shall be OPERABLE and closed.

APPLICABILITY: MODES 1, 2, 3 and 4

#### ACTION:

- a. With only one of the above required reactor vessel head vent paths OPERABLE, restore both paths to OPERABLE status within 72 hours or be in at least HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.
- b. With none of the above required reactor vessel head vent paths OPERABLE, restore at least one path to OPERABLE status within the next 6 hours or be in at least HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.

#### SURVEILLANCE REQUIREMENTS

4.4.10 Each Reactor Coolant System vent path shall be demonstrated OPERABLE at least once per 18 months, *by: WHEN RCS TEMPERATURE AND PRESSURE ARE SUFFICIENTLY LOW ENOUGH TO AVOID PERSONAL INJURY AND EQUIPMENT DAMAGE*

- a. Verifying all manual isolation valves in each vent path are locked in the open position.
- b. Cycling each vent through at least one complete cycle from the control room.
- c. Verifying flow through the reactor coolant system vent paths during venting.

FINAL DRAFT

3/4.5 EMERGENCY CORE COOLING SYSTEMS (ECCS)

3/4.5.1 SAFETY INJECTION TANKS

LIMITING CONDITION FOR OPERATION

3.5.1 Each Reactor Coolant System safety injection tank shall be OPERABLE with:

- The isolation valve key-locked open and power to the valve removed,
- A contained borated water level of between 1802 cubic feet, and 1914 cubic feet,
- A boron concentration between 2000 and 4400 ppm of boron, and
- A nitrogen cover-pressure of between 600 and 625 psig.
- Nitrogen vent valves closed and power removed.\*\*
- Nitrogen vent valves are capable of being operated upon restoration of power.

APPLICABILITY: MODES 1\*, 2\*, 3,\*†, and 4\*†.

ACTION:

- With one safety injection tank inoperable, except as a result of a closed isolation valve, restore the inoperable tank to OPERABLE status within 1 hour or be in at least HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.
- With one safety injection tank inoperable due to the isolation valve being closed, either immediately open the isolation valve or be in at least HOT STANDBY within 1 hour and be in HOT SHUTDOWN within the next 12 hours.

SURVEILLANCE REQUIREMENTS

4.5.1 Each safety injection tank shall be demonstrated OPERABLE:

- At least once per 12 hours by:
  - Verifying the contained borated water volume and nitrogen cover-pressure in the tanks is within the above limits, and

With pressurizer pressure greater than or equal to 1750 psia. When pressurizer pressure is less than 1750 psia, at least three safety injection tanks must be OPERABLE, each with a minimum pressure of 254 psig and a maximum pressure of 625 psig, and a contained borated water volume of between 60% wide range indication (1415 cubic feet) and 72% narrow range indication (1914 cubic feet). With all four safety injection tanks OPERABLE, each tank shall have a minimum pressure of 254 psig and a maximum pressure of 625 psig, and a contained borated water volume of between 39% wide range indication (962 cubic feet) and 72% narrow range indication (1914 cubic feet). In MODE 4 with pressurizer pressure less than 430 psia, the safety injection tanks may be isolated.

\*See Special Test Exceptions 3.10.6 and 3.10.8.

\*\*Nitrogen vent valves may be cycled as necessary to maintain the required nitrogen cover pressure per Specification 3.5.1d.

PALO VERDE - UNIT 1

3/4 5-1

corresponding to 81% wide range tank

1837

1837

0% narrow range (corresponding to

0% narrow range (corresponding to

corresponding to 81% wide range indication or





FINAL DRAFT

EMERGENCY CORE COOLING SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

---

2. Verifying that each safety injection tank isolation valve is open and the nitrogen vent valves are closed.
- b. At least once per 31 days and within 6 hours after each solution level increase of greater than or equal to 7% of tank narrow range level by verifying the boron concentration of the safety injection tank solution is between 2000 and 4400 ppm.
- c. At least once per 31 days when the RCS pressure is above 700 psig, by verifying that power to the isolation valve operator is removed.
- d. At least once per 18 months by verifying that each safety injection tank isolation valve opens automatically under each of the following conditions:
  1. When an actual or simulated RCS pressure signal exceeds 515 psia, and
  2. Upon receipt of a safety injection actuation (SIAS) test signal.
- e. At least once per 18 months by verifying OPERABILITY of RCS-SIT differential pressure alarm by simulating RCS pressure > 715 psia with SIT pressure < 600 psig.
- f. At least once per 18 months, when SITs are isolated, by verifying the SIT nitrogen vent valves can be opened.
- g. At least once per 31 days, by verifying that power is removed from the nitrogen vent valves.

FINAL DRAFT

EMERGENCY CORE COOLING SYSTEMS

3/4.5.2 ECCS SUBSYSTEMS - T<sub>cold</sub> GREATER THAN OR EQUAL TO 350°F

LIMITING CONDITION FOR OPERATION

3.5.2 Two independent Emergency Core Cooling System (ECCS) subsystems shall be OPERABLE with each subsystem comprised of:

- a. One OPERABLE high-pressure safety injection pump,
- b. One OPERABLE low-pressure safety injection pump, and
- c. An independent OPERABLE flow path capable of taking suction from the refueling water tank on a safety injection actuation signal and automatically transferring suction to the containment sump on a recirculation actuation signal.

APPLICABILITY: MODES 1, 2, and 3\*.

ACTION:

- a. With one ECCS subsystem inoperable, restore the inoperable subsystem to OPERABLE status within 72 hours or be in at least HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.
- b. In the event the ECCS is actuated and injects water into the Reactor Coolant System, a Special Report shall be prepared and submitted to the Commission pursuant to Specification 6.9.2 within 90 days describing the circumstances of the actuation and the total accumulated actuation cycles to date. The current value of the usage factor for each affected injection nozzle shall be provided in this Special Report whenever its value exceeds 0.70.

\*With pressurizer pressure greater than or equal to ~~1750~~<sup>1837</sup> psia.

## EMERGENCY CORE COOLING SYSTEMS

FINAL DRAFT

### SURVEILLANCE REQUIREMENTS

4.5.2 Each ECCS subsystem shall be demonstrated OPERABLE:

- a. At least once per 12 hours by verifying that the following valves are in the indicated positions with the valves key-locked shut:

<u>Valve Number</u>	<u>Valve Function</u>	<u>Valve Position</u>
1. SIA HV-604	1. HOT LEG INJECTION	1. SHUT
2. SIC HV-321	2. HOT LEG INJECTION	2. SHUT
3. SIB HV-609	3. HOT LEG INJECTION	3. SHUT
4. SID HV-331	4. HOT LEG INJECTION	4. SHUT

- b. At least once per 31 days by:

1. Verifying that each valve (manual, power-operated, or automatic) in the flow path that is not locked, sealed, or otherwise secured in position, is in its correct position, and
2. Verifying that the ECCS piping is full of water by venting the ECCS pump casings and accessible discharge piping high points.

- c. By a visual inspection which verifies that no loose debris (rags, trash, clothing, etc.) is present in the containment which could be transported to the containment sump and cause restriction of the pump suction during LOCA conditions. This visual inspection shall be performed:

1. For all accessible areas of the containment prior to establishing CONTAINMENT INTEGRITY, and
2. For all the affected areas within containment at the completion of containment entry when CONTAINMENT INTEGRITY is established.

- d. At least once per 18 months by:

Not App to Unit Casing

EMERGENCY CORE COOLING SYSTEMS

FINAL DRAFT

SURVEILLANCE REQUIREMENTS (Continued)

1. A visual inspection of the containment sump and verifying that the subsystem suction inlets are not restricted by debris and that the sump components (trash racks, screens, etc.) show no evidence of structural distress or corrosion.
  2. Verifying that a minimum total of 464 cubic feet of solid granular trisodium phosphate dodecahydrate (TSP) is contained within the TSP storage baskets.
  3. Verifying that when a representative sample of  $0.055 \pm 0.001$  lb of TSP from a TSP storage basket is submerged, without agitation, in  $1.0 \pm 0.05$  gallons of  $77 \pm 9$  °F borated water from the RWT, the pH of the mixed solution is raised to greater than or equal to 7 within 4 hours.
- e. At least once per 18 months, during shutdown, by:
1. Verifying that each automatic valve in the flow path actuates to its correct position on (SIAS and RAS) test signal(s).
  2. Verifying that each of the following pumps start automatically upon receipt of a safety injection actuation test signal:
    - a. High pressure safety injection pump.
    - b. Low pressure safety injection pump.
  3. Verifying that on a recirculation actuation test signal, the containment sump isolation valves open, the HPSI, LPSI and CS pump minimum bypass recirculation flow line isolation valves and combined SI mini-flow valve close, and the LPSI pumps stop.
- f. By verifying that each of the following pumps develops the differential <sup>INDICATED</sup> ~~indicated~~ pressure at or greater than their respective minimum allowable recirculation flow when tested pursuant to Specification 4.0.5:
1. High pressure safety injection pump greater than or equal to ~~1930~~ psid.
  2. Low pressure safety injection pump greater than or equal to ~~195~~ psid.

1761

1165

## EMERGENCY CORE COOLING SYSTEMS

### SURVEILLANCE REQUIREMENTS (Continued)

- g. By verifying the correct position of each electrical and/or mechanical position stop for the following ECCS throttle valves:

1. Within 4 hours following completion of each valve stroking operation or maintenance on the valve when the ECCS subsystems are required to be OPERABLE.
2. At least once per 18 months.

#### LPSI System Valve Number

1. SIB-UV 615, SIA-UV 306
2. SIB-UV 625, SIB-UV 307
3. SIA-UV 635
4. SIA-UV 645

#### Hot Leg Injection Valve Number

1. SIA-HV 604
2. SIB-HV 609
3. SIC-HV 321
4. SID-HV 331

- h. By performing a flow balance test, during shutdown, following completion of modifications to the ECCS subsystems that alter the subsystem flow characteristics and verifying the following flow rates:

#### HPSI System - Single Pump

The sum of the injection line flow rates, excluding the highest flow rate, is greater than or equal to 816 gpm.

#### LPSI System - Single Pump

1. Injection Loop 1, total flow equal to  $4900 \pm 100$  gpm
2. Injection Legs 1A and 1B when tested individually, with the other leg isolated, shall be within 100 gpm of each other.
3. Injection Loop 2, total flow equal to  $4900 \pm 100$  gpm
4. Injection Legs 2A and 2B when tested individually, with the other leg isolated, shall be within 100 gpm of each other.

#### Simultaneous Hot Leg and Cold Leg Injection - Single Pump

1. Hot Leg, flow equal to  $545 \pm 20$  gpm
2. Cold Leg, flow equal to  $545 \pm 20$  gpm

## EMERGENCY CORE COOLING SYSTEMS

3/4.5.3 ECCS SUBSYSTEMS -  $T_{\text{cold}}$  LESS THAN 350°F

### LIMITING CONDITION FOR OPERATION

3.5.3 As a minimum, one ECCS subsystem comprised of the following shall be OPERABLE:

- a. An OPERABLE high pressure safety injection pump, and
- b. An OPERABLE flow path capable of taking suction from the refueling water tank on a safety injection actuation signal and automatically transferring suction to the containment sump on a recirculation actuation signal.

APPLICABILITY: MODES (3\* and) 4.

*made  
3 = 350°F*

### ACTION:

- a. With no ECCS subsystem OPERABLE, restore at least one ECCS subsystem to OPERABLE status within 1 hour or be in COLD SHUTDOWN within the next 20 hours.
- b. In the event the ECCS is actuated and injects water into the Reactor Coolant System, a Special Report shall be prepared and submitted to the Commission pursuant to Specification 6.9.2 within 90 days describing the circumstances of the actuation and the total accumulated actuation cycles to date. The current value of the usage factor for each affected safety injection nozzle shall be provided in this Special Report whenever its value exceeds 0.70.

## SURVEILLANCE REQUIREMENTS

4.5.3 The ECCS subsystem shall be demonstrated OPERABLE per the applicable surveillance requirements of Specification 4.5.2.

[\*With pressurizer pressure less than 1750 psia.]

*1837*





## EMERGENCY CORE COOLING SYSTEMS

### 3/4.5.4 REFUELING WATER TANK

#### LIMITING CONDITION FOR OPERATION

---

3.5.4 The refueling water tank (RWT) shall be OPERABLE with:

- a. A minimum borated water volume as specified in Figure 3.1-2 of Specification 3.1.2.5, and
- b. A boron concentration between 4000 and 4400 ppm of boron, and
- c. A solution temperature between 60°F and 120°F.

APPLICABILITY: MODES 1, 2, 3, and 4.

#### ACTION:

With the refueling water tank inoperable, restore the tank to OPERABLE status within 1 hour or be in at least HOT STANDBY within 6 hours and in COLD SHUTDOWN within the following 30 hours.

#### SURVEILLANCE REQUIREMENTS

---

4.5.4 The RWT shall be demonstrated OPERABLE:

- a. At least once per 7 days by:
  1. Verifying the contained borated water volume in the tank, and
  2. Verifying the boron concentration of the water.
- b. At least once per 24 hours by verifying the RWT temperature when the (outside) air temperature is outside the 60°F to 120°F range.

## 3/4.6 CONTAINMENT SYSTEMS

### 3/4.6.1 PRIMARY CONTAINMENT

#### CONTAINMENT INTEGRITY

#### LIMITING CONDITION FOR OPERATION

---

3.6.1.1 Primary CONTAINMENT INTEGRITY shall be maintained..

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

Without primary CONTAINMENT INTEGRITY, restore CONTAINMENT INTEGRITY within 1 hour or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

#### SURVEILLANCE REQUIREMENTS

---

4.6.1.1 Primary CONTAINMENT INTEGRITY shall be demonstrated:

- a. At least once per 31 days by verifying that all penetrations\* not capable of being closed by OPERABLE containment automatic isolation valves and required to be closed during accident conditions are closed by valves, blind flanges, or deactivated automatic valves secured in their positions except as provided in Table 3.6-1 of Specification 3.6.3.
- b. By verifying that each containment air lock is in compliance with the requirements of Specification 3.6.1.3.
- c. After each closing of each penetration subject to Type B testing, except containment air locks, if opened following a Type A or B test, by leak rate testing the seal with gas at P<sub>a</sub> 49.2 psig and verifying that when the measured leakage rate for<sup>a</sup> these seals is added to the leakage rates determined pursuant to Specification 4.6.1.2d. for all other Type B and C penetrations, the combined leakage rate is less than or equal to 0.60 L<sub>a</sub>.

---

\* Except valves, blind flanges, and deactivated automatic valves which are located inside the containment and are locked, sealed, or otherwise secured in the closed position. These penetrations shall be verified closed during each COLD SHUTDOWN except that such verification need not be performed more often than once per 92 days.

## CONTAINMENT SYSTEMS

### CONTAINMENT LEAKAGE

#### LIMITING CONDITION FOR OPERATION

3.6.1.2 Containment leakage rates shall be limited to:

- a. An overall integrated leakage rate of:
  1. Less than or equal to  $L_a$ , 0.10% by weight of the containment air per 24 hours at  $P_a$ , 49.2 psig, or
  2. Less than or equal to  $L_t$ , 0.05% by weight of the containment air per 24 hours at a reduced pressure of  $P_t$ , 24.6 psig.
- b. A combined leakage rate of less than or equal to  $0.60 L_a$  for all penetrations and valves subject to Type B and C tests, when pressurized to  $P_a$ .

APPLICABILITY: MODES 1, 2, 3, and 4.

#### ACTION:

With either (a) the measured overall integrated containment leakage rate exceeding  $0.75 L_a$  or  $0.75 L_t$ , as applicable, or (b) with the measured combined leakage rate for all penetrations and valves subject to Types B and C tests exceeding  $0.60 L_a$ , restore the overall integrated leakage rate to less than or equal to  $0.75 L_a$  or less than or equal to  $0.75 L_t$ , as applicable, and the combined leakage rate for all penetrations and valves subject to Type B and C tests to less than or equal to  $0.60 L_a$  prior to increasing the Reactor Coolant System temperature above 210°F.

#### SURVEILLANCE REQUIREMENTS

4.6.1.2 The containment leakage rates shall be demonstrated at the following test schedule and shall be determined in conformance with the criteria specified in Appendix J of 10 CFR Part 50 using the methods and provisions of ANSI N45.4 - 1972:

- a. Three Type A tests (Overall Integrated Containment Leakage Rate) shall be conducted at  $40 \pm 10$  month intervals during shutdown at either  $P_a$  49.2 psig or at  $P_t$  24.6 psig during each 10-year service period. <sup>a</sup>The third test of each set shall be conducted during the shutdown for the 10-year plant inservice inspection!



SURVEILLANCE REQUIREMENTS (Continued)

- b. If any periodic Type A test fails to meet either  $0.75 L_a$  or  $0.75 L_t$ , the test schedule for subsequent Type A tests shall be reviewed and approved by the Commission. If two consecutive Type A tests fail to meet either  $0.75 L_a$  or  $0.75 L_t$ , a Type A test shall be performed at least every 18 months until two consecutive Type A tests meet either  $0.75 L_a$  or  $0.75 L_t$  at which time the above test schedule may be resumed.
- c. The accuracy of each Type A test shall be verified by a supplemental test which:
  - 1. Confirms the accuracy of the Type A test by verifying that the supplemental test result  $L_s$  minus the sum of the Type A test result,  $L_{am}$ , and the superimposed leak rate,  $L_o$ , is equal to or less than  $0.25 L_a$ .
  - 2. Has a duration sufficient to establish accurately the change in leakage rate between the Type A test and the supplemental test.
  - 3. Requires that the rate at which gas is injected into the containment or bled from the containment during the supplemental test is between  $0.75 L_a$  and  $1.25 L_a$ .
- d. Type B and C tests shall be conducted with gas at  $P_a$ , 49.2 psig, at intervals no greater than 24 months except for tests involving:
  - 1. Air locks,
  - 2. Purge supply and exhaust isolation valves with resilient material seals.
- e. Purge supply and exhaust isolation valves with resilient material seals shall be tested and demonstrated OPERABLE per Specifications 4.6.1.7.3 and 4.6.1.7.4.
- f. Air locks shall be tested and demonstrated OPERABLE per Specification 4.6.1.3.
- g. The provisions of Specification 4.0.2 are not applicable.

## CONTAINMENT SYSTEMS

**FINAL DRAFT**

### CONTAINMENT AIR LOCKS

#### LIMITING CONDITION FOR OPERATION

---

3.6.1.3 Each containment air lock shall be OPERABLE with:

- a. Both doors closed except when the air lock is being used for normal transit entry and exit through the containment, then at least one air lock door shall be closed, and
- b. An overall air lock leakage rate of less than or equal to  $0.05 L_a$  at  $P_a$ , 49.2 psig.

APPLICABILITY: MODES 1, 2, 3, and 4.

#### ACTION:

- a. With one containment air lock door inoperable:
  1. Maintain at least the OPERABLE air lock door closed and either restore the inoperable air lock door to OPERABLE status within 24 hours or lock the OPERABLE air lock door closed. Operation may then continue until performance of the next required overall air lock leakage test provided that the OPERABLE air lock door is verified to be locked closed at least once per 31 days, or
  2. Be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
  3. The provisions of Specification 3.0.4 are not applicable.
- b. With the containment air lock inoperable, except as the result of an inoperable air lock door, maintain at least one air lock door closed; restore the inoperable air lock to OPERABLE status within 24 hours or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

#### SURVEILLANCE REQUIREMENTS

---

4.6.1.3 Each containment air lock shall be demonstrated OPERABLE:

- a. Within 72 hours following each closing, except when the air lock is being used for multiple entries, then at least once per 72 hours, by verifying seal leakage to be less than or equal to  $0.01 L_a$  when determined with the volume between the door seals pressurized to greater than or equal to  $14.5 \pm 0.5$  psig, for at least 15 minutes,

CONTAINMENT SYSTEMS

**FINAL DRAFT**

SURVEILLANCE REQUIREMENTS (Continued)

---

- b. By conducting overall air lock leakage tests at not less than  $P_a$ , 49.2 psig, and verifying the overall air lock leakage rate is within its limit:
  - 1. At least once per 6 months<sup>#</sup>, and
  - 2. Prior to establishing CONTAINMENT INTEGRITY when maintenance has been performed on the air lock that could affect the air lock sealing capability.\*
- c. At least once per 6 months by verifying that only one door in each air lock can be opened at a time.

<sup>#</sup>The provisions of Specification 4.0.2 are not applicable.

\*This constitutes an exemption to Appendix J of 10 CFR Part 50.

FINAL DRAFT

CONTAINMENT SYSTEMS

INTERNAL PRESSURE

LIMITING CONDITION FOR OPERATION

---

3.6.1.4 Primary containment internal pressure shall be maintained between -0.3 and 2.5 psig.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

With the containment internal pressure outside of the limits above, restore the internal pressure to within the limits within 1 hour or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

---

4.6.1.4 The primary containment internal pressure shall be determined to be within the limits at least once per 12 hours.



## CONTAINMENT SYSTEMS

### AIR TEMPERATURE

#### LIMITING CONDITION FOR OPERATION

---

3.6.1.5 Primary containment, average air temperature shall not exceed 120°F.

APPLICABILITY: MODES 1, 2, 3, and 4.

#### ACTION:

With the containment average air temperature greater than 120°F, reduce the average air temperature to within the limit within 8 hours, or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

## SURVEILLANCE REQUIREMENTS

---

4.6.1.5 The primary containment average air temperature shall be the arithmetical average of the temperatures at any five of the following locations and shall be determined at least once per 24 hours:

#### Location

- a. Elevation 85'0"
- b. Elevation 85'0"
- c. Elevation 126'0"
- d. Elevation 126'0"
- e. Elevation 145'0"
- f. Elevation 188'0"
- g. Elevation 188'0"



## CONTAINMENT SYSTEMS

### CONTAINMENT VESSEL STRUCTURAL INTEGRITY

#### LIMITING CONDITION FOR OPERATION

---

3.6.1.6 The structural integrity of the containment vessel shall be maintained at a level consistent with the acceptance criteria in Specification 4.6.1.6.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

- a. With the structural integrity at a level below the acceptance criteria of Specification 4.6.1.6 except for Specification 4.6.1.6.2a.4), restore the containment vessel to the required level of integrity within 15 days, perform an engineering evaluation of the containment vessel structural integrity and provide a Special Report to the Commission within 30 days in accordance with Specification 6.9.2; or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- b. With the structural integrity at a level below the acceptance criteria of Specification 4.6.1.6.2a.4), restore the containment vessel to the required level of integrity within 72 hours, perform an engineering evaluation of the containment vessel structural integrity and provide a Special Report to the Commission within 15 days in accordance with Specification 6.9.2; or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

#### SURVEILLANCE REQUIREMENTS

---

4.6.1.6.1 The structural integrity of the containment vessel shall be demonstrated at the end of 1, 3 and 5 years following the initial containment vessel structural integrity test and at 5-year intervals thereafter. All of the acceptance testing of tendon and visual examinations of end anchorages, adjacent concrete surfaces and containment vessel surfaces shall be performed sequentially and within the same time frame.

4.6.1.6.2 The structural integrity of the tendons shall be demonstrated by:

- a. Determining from a random but representative sample of at least 10 tendons (6 hoop and 4 inverted U) that each group (hoop, and inverted U) has an observed lift-off force within the predicted limits for that group. For each subsequent inspection one tendon from each group shall be kept unchanged to develop a history and to correlate the observed data. The procedure of inspection and the tendon acceptance criteria shall be as follows:

CONTAINMENT SYSTEMS

**FINAL DRAFT**

CONTAINMENT VESSEL STRUCTURAL INTEGRITY

SURVEILLANCE REQUIREMENTS (Continued)

---

- 1) If the measured prestressing force of the selected tendon in a group lies above the prescribed lower limit, the lift-off test is considered to be a positive indication of the sample tendon's acceptability;
  - 2) If the measured prestressing force of the selected tendon in a group lies between the prescribed lower limit and 90% of the prescribed lower limit, two tendons, one on each side of this tendon, shall be checked for their prestressing forces. If the prestressing forces of these two tendons are above 95% of the prescribed lower limits for tendons, all three tendons shall be restored to the required level of integrity, and the tendon group shall be considered acceptable. If the measured prestressing force of any two tendons falls below 95% of the prescribed lower limits of the tendons, additional lift-off testing shall be done to detect the cause and extent of such occurrence;
  - 3) If the measured prestressing force of any tendon lies below 90% of the prescribed lower limit, the defective tendon shall be completely detensioned and additional lift-off testing shall be performed to determine the cause and extent of such occurrence;
  - 4) If the average of all measured prestressing forces for each group (corrected for average condition) is found to be less than the minimum required prestress level at anchorage location for that group, the condition shall be considered as below the acceptance criteria for containment vessel structural integrity; and
  - 5) Unless there is degradation of the containment vessel below the acceptance criteria during the first three inspections, the sample population for subsequent inspections shall include at least 6 tendons (3 hoop and 3 inverted U).
- b. Performing tendon detensioning, inspections, and material tests on a previously stressed tendon from each group. A randomly selected tendon from each group shall be completely detensioned in order to identify broken or damaged wires. A previously stresses tendon wire or strands from one tendon of each group shall be removed for testing and examination over the entire length to determine (which should include the broken wire if so identified) that:
- 1) The tendon wires are free of corrosion, cracks, and damage;
  - 2) There are no changes in the presence or physical appearance of the sheathing filler-grease; and

## CONTAINMENT SYSTEMS

### CONTAINMENT VESSEL STRUCTURAL INTEGRITY

**FINAL DRAFT**

#### SURVEILLANCE REQUIREMENTS (Continued)

- 3) A minimum tensile strength of 240,000 psi (guaranteed ultimate strength of the tendon material) exists for at least three wire samples (one from each end and one at mid-length) cut from each removed wire. Failure of any one of the wire samples to meet the minimum tensile strength test is evidenced that structural integrity is below the acceptance criteria.
  - c. Performing tendon retensioning of those tendons detensioned for inspection to at least force level recorded prior to detensioning or the predicted value, whichever is greater, with the tolerance within minus zero to plus 6%, except that the final seating force shall be such that the stress in the wire or strand shall not exceed 70% of the guaranteed ultimate tensile strength of the tendons. During retensioning of these tendons, the stress in the tendon shall not exceed 80% of its ultimate strength, and the changes in load and elongation shall be measured simultaneously at a minimum of three approximately equally spaced levels of force between zero and the seating force. If the elongation corresponding to a specific load differs by more than 10% from that recorded during installation, an investigation shall be made to ensure that the difference is not related to wire failures or slips of wires in anchorages; and
  - d. Verifying the OPERABILITY of the sheathing filler-grease by assuring:
    - 1) No voids in excess of 5% of the net duct volume,
    - 2) Minimum grease coverage exists for the different parts of the anchorage system, and
    - 3) The chemical properties of the filler material are within the tolerance limits specified as follows:

Water content	0 - 5% by wt.
Chlorides	0 - 10 ppm
Nitrates	0 - 10 ppm
Sulfides	0 - 5 ppm
Reserved Alkalinity	0 - 50% of the installed value
(Base Numbers)	(installed value 0-5 for older grease).
- 4.6.1.6.3 As an assurance of the structural integrity of the containment vessel, tendon anchorage assembly hardware (such as bearing plates, stressing washers, wedges, and buttonheads) of all tendons selected for inspection shall be visually examined. For those containments in multiple unit plants for which only visual inspection need be performed, tendon anchorages selected for inspection shall be visually examined to the extent practical without dismantling the load-bearing components of the anchorages. The surrounding concrete shall also be checked visually for indication of any abnormal condition.

## CONTAINMENT SYSTEMS

FINAL DRAFT

### CONTAINMENT VESSEL STRUCTURAL INTEGRITY

#### SURVEILLANCE REQUIREMENTS (Continued)

---

4.6.1.6.4 The exterior surface of the containment vessel shall be visually examined to detect areas of large spall, severe scaling, D-cracking in an area of 25 sq. ft. or more, other surface deterioration or disintegration, or grease leakage, each of which can be considered as evidence that the structural integrity is below the acceptance criteria.

4.6.1.6.5 Reports Any abnormal degradation of the containment structure detected during the above required tests and inspections shall be reported to the Commission in a Special Report pursuant to Specification 6.9.2 within 30 days. This report shall include a description of the tendon condition, the condition of the concrete (especially at tendon anchorages), the inspection procedure, the tolerances on cracking, and the corrective actions taken.

FINAL DRAFT

TABLE 4.6-1

TENDON SURVEILLANCE - FIRST YEAR

Tendon No.	Visual Inspection	Monitor Forces	Detension Tendon	Remove Wire	Test Wire
V32	X	X	No	No	No
V43	X	X	No	No	No
V62	X	X	X	X	X
V75*	X	X	A	A	A
H13-007*	X	X	X	X	X
H13-021	X	X	No	No	No
H21-037	X	X	No	No	No
H21-044	X	X	No	No	No
H32-016	X	X	No	No	No
H32-030	X	X	A	A	A

Notes:

1. "X" means the tendon shown shall be inspected for the stated requirements during this surveillance.
2. "A" means the tendon shown shall be inspected for the stated requirements during the next or second surveillance.
3. "No" means that inspection is not required for that tendon.
4. "\*" means control tendon.

# FINAL DRAFT

TABLE 4.6-2

TENDON LIFT-OFF FORCE FIRST YEAR  
U-TENDONS

TENDON NUMBER	TENDON END	MAXIMUM (kips)	MINIMUM (kips)
V32	Shop	1463	1343
	Field	1510	1386
V43	Shop	1436	1364
	Field	1486	1364
V62	Shop	1475	1354
	Field	1486	1364
V75	Shop	1527	1402
	Field	1504	1380

HOOP TENDONS

TENDON NUMBER	TENDON END	MAXIMUM (kips)	MINIMUM (kips)
H13-007	Shop	1428	1300
	Field	1451	1321
H13-021	Shop	1515	1380
	Field	1491	1358
H21-037	Shop	1505	1371
	Field	1446	1317
H21-044	Shop	1484	1360
	Field	1530	1403
H32-016	Shop	1411	1282
	Field	1457	1324
H32-030	Shop	1473	1330
	Field	1473	1330



## CONTAINMENT SYSTEMS

### CONTAINMENT VENTILATION SYSTEM

#### LIMITING CONDITION FOR OPERATION

3.6.1.7 Each containment purge supply and exhaust isolation valve shall be OPERABLE and:

- a. Each 42-inch containment purge supply and exhaust isolation valve shall be sealed closed.
- b. The 8-inch containment purge supply and exhaust isolation valves shall be sealed closed to the maximum extent practicable but may be open for purge system operation for pressure control, for ALARA and respirable air quality considerations for personnel entry and for surveillance tests that require the valve to be open.

APPLICABILITY: MODES 1, 2, 3, and 4.

#### ACTION:

- a. With a 42-inch containment purge supply and/or exhaust isolation valve(s) open or not sealed closed, close and/or seal close the open valve(s) or isolate the penetration within 4 hours, otherwise be in at least HOT SHUTDOWN within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- b. With an 8-inch containment purge supply and/or exhaust isolation valve(s) open for reasons other than given in 3.6.1.7.b above, close the open 8-inch valve(s) or isolate the penetration(s) within 4 hours, otherwise be in at least HOT SHUTDOWN within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- c. With a containment purge supply and/or exhaust isolation valve(s) having a measured leakage rate exceeding the limits of Specifications 4.6.1.7.2 and/or 4.6.1.7.3, restore the inoperable valve(s) to OPERABLE status or isolate the penetrations such that the measured leakage rate does not exceed the limits of Specifications 4.6.1.7.2 and/or 4.6.1.7.3 within 24 hours, otherwise be in at least HOT SHUTDOWN within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

#### SURVEILLANCE REQUIREMENTS

4.6.1.7.1 Each containment purge supply and exhaust isolation valve shall be verified to be sealed closed at least once per 31 days. *not opened*

4.6.1.7.2 At least once per 6 months on a STAGGERED TEST BASIS each sealed closed 42-inch containment purge supply and exhaust isolation valve with resilient material seals shall be demonstrated OPERABLE by verifying that the measured leakage rate is less than or equal to  $0.05 L_a$  when pressurized to  $P_a$ .

4.6.1.7.3 At least once per 92 days each 8-inch containment purge supply and exhaust isolation valve with resilient material seals shall be demonstrated OPERABLE by verifying that the measured leakage rate is less than or equal to  $0.01 L_a$  when pressurized to  $P_a$ .

## CONTAINMENT SYSTEMS

### 3/4.6.2 DEPRESSURIZATION AND COOLING SYSTEMS

#### CONTAINMENT SPRAY SYSTEM

#### LIMITING CONDITION FOR OPERATION

3.6.2.1 Two independent containment spray systems shall be OPERABLE with each spray system capable of taking suction from the RWT on a containment spray actuation signal and automatically transferring suction to the containment sump on a recirculation actuation signal. Each spray system flow path from the containment sump shall be via an OPERABLE shutdown cooling heat exchanger.

APPLICABILITY: MODES 1, 2, 3, and 4.\*

#### ACTION:

With one containment spray system inoperable, restore the inoperable spray system to OPERABLE status within 72 hours or be in at least HOT STANDBY within the next 6 hours; restore the inoperable spray system to OPERABLE status within the next 48 hours or be in COLD SHUTDOWN within the following 30 hours.

#### SURVEILLANCE REQUIREMENTS

4.6.2.1 Each containment spray system shall be demonstrated OPERABLE:

- a. At least once per 31 days by verifying that each valve (manual, power-operated, or automatic) in the flow path is positioned to take suction from the RWT on a containment spray actuation (CSAS) test signal.
- b. By verifying that each pump develops an indicated differential pressure of greater than or equal to 270 psid at greater than or equal the minimum allowable recirculation flowrate when tested pursuant to Specification 4.0.5. 273
- c. At least once per 31 days by verifying that the system piping is full of water to the 60 inch level in the containment spray header (>115 foot level).
- d. At least once per 18 months, during shutdown, by:
  1. Verifying that each automatic valve in the flow path actuates to its correct position on a containment spray actuation (CSAS) and recirculation actuation (RAS) test signal.
  2. Verifying that upon a recirculation actuation test signal, the containment sump isolation valves open and that a recirculation mode flow path via an OPERABLE shutdown cooling heat exchanger is established.

\*Only when shutdown cooling is not in operation.

CONTAINMENT SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

---

3. Verifying that each spray pump starts automatically on a safety injection actuation (SIAS) and on a containment spray actuation (CSAS) test signal.
- e. At least once per 5 years by performing an air or smoke flow test through each spray header and verifying each spray nozzle is unobstructed.

## CONTAINMENT SYSTEMS

### IODINE REMOVAL SYSTEM

#### LIMITING CONDITION FOR OPERATION

3.6.2.2 The iodine removal system shall be OPERABLE with:

- a. An spray chemical addition tank containing a level of between 90% and 100% (816 and 896 gallons) of between 33% and 35% by weight  $N_2H_4$  solution, and
- b. Two spray chemical addition pumps each capable of adding  $N_2H_4$  solution from the spray chemical addition tank to a containment spray system pump flow.

APPLICABILITY: MODES 1, 2, 3, and 4.

#### ACTION:

With the iodine removal system inoperable, restore the system to OPERABLE status within 72 hours or be in at least HOT STANDBY within the next 6 hours; restore the iodine removal system to OPERABLE status within the next 48 hours or be in COLD SHUTDOWN within the following 30 hours.

#### SURVEILLANCE REQUIREMENTS

4.6.2.2 The iodine removal system shall be demonstrated OPERABLE:

- a. At least once per 31 days by verifying that each valve (manual, power-operated, or automatic) in the flow path that is not locked, sealed, or otherwise secured in position, is in its correct position.
- b. At least once per 6 months by:
  1. Verifying the contained solution volume in the tank, and
  2. Verifying the concentration of the  $N_2H_4$  solution by chemical analysis.
- c. By verifying that on recirculation flow, each spray chemical addition pump develops a discharge pressure of 100 psig when tested pursuant to Specification 4.0.5.
- d. At least once per 18 months, during shutdown, by
  1. Verifying that each automatic valve in the flow path actuates to its correct position on a containment spray actuation (CSAS) test signal, and
  2. Verifying that each spray chemical addition pump starts automatically on a CSAS test signal.

CONTAINMENT SYSTEMS

FINAL DRAFT

SURVEILLANCE REQUIREMENTS (Continued)

- e. At least once per 5 years by verifying each solution flow rate from the following drain connections in the iodine removal system:
  - 1. SIA-V253 Pump discharge line  $0.63 \pm 0.02$  gpm.
  - 2. SIB-V254 Pump discharge line  $0.63 \pm 0.02$  gpm.

## CONTAINMENT SYSTEMS

FINAL DRAFT

### 3/4.6.3 CONTAINMENT ISOLATION VALVES

#### LIMITING CONDITION FOR OPERATION

3.6.3 The containment isolation valves specified in Table 3.6-1 shall be OPERABLE with isolation times as shown in Table 3.6-1.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

SECTION A, B & C OF

1. With one or more of the isolation valve(s) specified in Table 3.6-1 inoperable, maintain at least one isolation valve OPERABLE in each affected penetration that is open and either:

- a. Restore the inoperable valve(s) to OPERABLE status within 4 hours, or
- b. Isolate each affected penetration within 4 hours by use of at least one deactivated automatic valve secured in the isolation position,\* or
- c. Isolate the affected penetration within 4 hours by use of at least one closed manual valve or blind flange;\* or
- d. Be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

2. WITH ONE OR MORE OF THE VALVES SPECIFIED IN SECTIONS E, F AND G OF TABLE 3.6-1 INOPERABLE, THE APPROPRIATE ACTION STATEMENT(S) OF THOSE LIMITING CONDITIONS FOR OPERATION PERTAINING TO THE VALVE OR SYSTEM DOWN WHICH IT IS INSTALLED SHALL BE SURVEILLANCE REQUIREMENTS IF APPLICABLE.

#### SECTIONS A, B AND C OF

4.6.3.1 The isolation valves specified in Table 3.6-1 shall be demonstrated OPERABLE prior to returning the valve to service after maintenance, repair, or replacement work is performed on the valve or its associated actuator, control, or power circuit by performance of a cycling test and verification of isolation time.

#### SECTIONS A, B AND C OF

4.6.3.2 Each isolation valve specified in Table 3.6-1 shall be demonstrated OPERABLE during the COLD SHUTDOWN or REFUELING MODE at least once per 18 months by:

- a. Verifying that on a CIAS, CSAS or SIAS test signal, each isolation valve actuates to its isolation position.
- b. Verifying that on a Containment Radiation-High test signal, all containment purge valves actuate to their isolation position.

\*The inoperable isolation valve(s) may be part of a system(s). Isolating the affected penetration(s) may affect the use of the system(s). Consider the technical specification requirements on the affected system(s) and act accordingly.

FINAL DRAFT

CONTAINMENT SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

SECTIONS A, B AND C

4.6.3.3 The isolation time of each power operated or automatic valve of<sup>1</sup>  
of Table 3.6-1 shall be determined to be within its limit when tested pursuant  
to Specification 4.0.5.

INSERT

4.6.3.4 The check valves specified in Section D of TABLE 3.6-1 shall be demonstrated OPERABLE pursuant to 10 CFR 50, Appendix J, with the exception of those check valves footnoted as "Not Type C Tested"

4.6.3.5 The isolation valves specified in Sections E, F, and G of TABLE 3.6-1 shall be demonstrated OPERABLE as required by Specification 4.0.5 and the Surveillance Requirements associated with those Limiting Condition for Operation pertaining to each valve or system in which it is installed. Valves secured\*\* in their actuated position are considered operable pursuant to this specification

4.6.3.6 The manual isolation valves specified in Section H of Table 3.6-1 shall be demonstrated OPERABLE pursuant to Surveillance Requirement 4.6.1.1.a of Specification 3.6.1.1

\*\* Locked, sealed, or otherwise prevented from unintentional operation.





# FINAL DRAFT

TABLE 3.6-1  
CONTAINMENT ISOLATION VALVES

VALVE NUMBER	PENETRATION NUMBER	FUNCTION	MAXIMUM ACTUATION TIME (SECONDS)
A. CONTAINMENT ISOLATION (CIAS)			
RDA-UV 023	9	Containment radwaste sump pump to LRS holdup tank	<del>10</del> 30
RDB-UV 024	9	Containment radwaste sump pump to LRS holdup tank	5
<sup>B</sup> RD-UV 407	9	Containment radwaste sump post-accident sampling system	5
SGB-HV 200 <sup>#</sup>	11	Downcomer feedwater chemical injection	1
SGB-HV 201 <sup>#</sup>	12	Downcomer feedwater chemical injection	1
SIA-UV 708 <sup>#</sup>	23	Containment recirc sump to post-accident sampling system	5
HCB-UV 044	25A	Containment air radioactivity monitor (inlet)	12
HCA-UV 045	25A	Containment air radioactivity monitor (inlet)	12
HCA-UV 046	25B	Containment air radioactivity monitor (outlet)	12
HCA-UV 047	25B	Containment air radioactivity monitor (outlet)	12
[ SIA-UV 682	28	Safety Injection Tank drain line	5]
GAA-UV 0 <sup>9</sup> 22	29	N <sub>2</sub> to steam generator and reactor drain tank	10
GAA-UV 0 <sup>9</sup> 71	30	N <sub>2</sub> to SI tanks	10

NOT CLOSED ON  
CIAS See  
pg 6-31

# FINAL DRAFT

TABLE 3.6-1 (Continued)  
CONTAINMENT ISOLATION VALVES

VALVE NUMBER	PENETRATION NUMBER	FUNCTION	MAXIMUM ACTUATION TIME (SECONDS)
A. CONTAINMENT ISOLATION (CIAS) (Continued)			
HPA-UV 001	35	Containment to hydrogen recombiner	12
HPA-UV 003	35	Containment to hydrogen recombiner	12
HPB-UV 002	36	Containment to hydrogen recombiner	12
HPA-UV 005	38	Containment to hydrogen recombiner	12
HPB-UV 004	36	H <sub>2</sub> recombiner return to containment (inlet)	12
HPA-UV 023	38	H <sub>2</sub> control system	5
HPB-UV 006	39	H <sub>2</sub> recombiner return to containment (inlet)	12
CHA-UV 516	40	Letdown line from RC loop 2B to regenerative heat exchanger and letdown heat exchanger	5
CHB-UV 523	40	Letdown line from RC loop 2B to regenerative heat exchanger and letdown heat exchanger	5
CHB-UV 924	40	Letdown line to post-accident sampling system	5
SSB-UV 201	42A	Pressurizer sample surge line	5
SSA-UV 204	42A	Pressurizer sample surge line	5
SSB-UV 202	42B	Pressurizer sample surge line	5
SSA-UV 205	42B	Pressurizer sample surge line	5
SSB-UV 200	42C	Pressurizer sample surge line	5
SSA-UV 203	42C	Pressurizer sample surge line	5

FINAL DRAFT

TABLE 3.6-1 (Continued)  
CONTAINMENT ISOLATION VALVES

VALVE NUMBER	PENETRATION NUMBER	FUNCTION	MAXIMUM ACTUATION TIME (SECONDS)
A. CONTAINMENT ISOLATION (CIAS) (Continued)			
CHA-UV 560	44	Reactor Drain tank to pre-holdup ion exchanger	5
CHB-UV 561	44	Reactor train tank to pre-holdup ion exchanger	5
CHA-UV 580	45	Makeup to reactor drain tank	5
CH-UV 715	45	Makeup to reactor drain tank post- accident sampling system	5
GRA-UV 001	52	RDT vent to WG surge tank	12
GRB-UV 002	52	RDT vent to WG surge tank	10
WCB-UV 63	60	Normal chilled water to containment ACU (inlet)	10
WCB-UV 61	61	Normal chilled water to containment ACU (outlet)	10
WCA-UV 62	61	Normal chilled water to containment ACU (outlet)	10

# - Valve exempt from Type C testing

FINAL DRAFT

TABLE 3.6-1 (Continued)  
CONTAINMENT ISOLATION VALVES

VALVE NUMBER	PENETRATION NUMBER	FUNCTION	MAXIMUM ACTUATION TIME (SECONDS)
B. CONTAINMENT PURGE (CPIAS) *			
CPA-UV 002A	56	Containment purge (inlet)	12
CPB-UV 003A	56	Containment purge (inlet)	12
CPA-UV 002B	57	Containment purge (outlet)	12
CPB-UV 003B	57	Containment purge (outlet)	12
CPA-UV 004A	78	Containment purge (inlet)	8
CPB-UV 005A	78	Containment purge (inlet)	8
CPA-UV 004B	79	Containment purge (outlet)	8
CPB-UV 005B	79	Containment purge (outlet)	8

\* ALSO ISOLATED ON LEAS



TABLE 3.6-1 (Continued)  
CONTAINMENT ISOLATION VALVES

VALVE NUMBER	PENETRATION NUMBER	FUNCTION	MAXIMUM ACTUATION TIME (SECONDS)
C. CONTAINMENT SPRAY (CSAS)			
IAA-UV-002	31	Service air to reactor containment inst. air	<del>5</del> 10
NCB-UV-401	33	NC water to RCP motor bearing lube oil and air coolers	<del>5</del> 10
NCB-UV-403	34	NC water to RCP motor bearing lube oil and air coolers	<del>5</del> 10
NCA-UV-402	34	NC water to RCP motor bearing lube oil and air coolers	<del>5</del> 10
CHB-UV-505	43	RC pump seal bleedoff	5
CHA-UV-506	43	RC pump seal bleedoff	5

TABLE 3.6-1 (Continued)  
CONTAINMENT ISOLATION VALVES

VALVE NUMBER	PENETRATION NUMBER	FUNCTION	MAXIMUM ACTUATION TIME (SECONDS)
D. CHECK VALVES			
SGE-V 642 <sup>#</sup>	11	Feedwater downcomer	N.A.
SGE-V 652 <sup>#</sup>	11	Feedwater downcomer	N.A.
SGE-V 653 <sup>#</sup>	12	Feedwater downcomer	N.A.
SGE-V 693 <sup>#</sup>	12	Feedwater downcomer	N.A.
GAE-V 015	29	N <sub>2</sub> to steam generator and reactor drain tank	N.A.
GAE-V 011	30	N <sub>2</sub> to SI tanks	N.A.
IAE-V 021	31	Service air to reactor containment instrument air header	N.A.
NCE-V 118	33	NC water to RCP motor bearing lube oil and air coolers	N.A.
HPA-V 002	38	H <sub>2</sub> recombiner return to containment	N.A.
HPB-V 004	39	H <sub>2</sub> recombiner return to containment	N.A.
CHE-V 494	45	Makeup to reactor drain tank	N.A.
WCE-V 039	60	Normal chilled water to containment ACU	N.A.

#Not Type C tested



# FINAL DRAFT

TABLE 3.6-1 (Continued)  
CONTAINMENT ISOLATION VALVES

VALVE NUMBER	PENETRATION NUMBER	FUNCTION	MAXIMUM ACTUATION TIME (SECONDS)
D. CHECK VALVES (continued)			
FPE-V 090	7	Containment fire protection	N.A.
SGE-V 003#	8	Steam generator feedwater	N.A.
SGE-V 007#	8	Steam generator feedwater	N.A.
SGE-V 005#	10	Steam generator feedwater	N.A.
SGE-V 006#	10	Steam generator feedwater	N.A.
SIE-V 113#	13	HPSI to RC loop 2A	N.A.
SIE-V 123#	14	HPSI to RC loop 2B	N.A.
SIE-V 133#	15	HPSI to RC loop 1A	N.A.
SIE-V 143#	16	HPSI to RC loop 1B	N.A.
SIE-V 114#	17	LPSI to RC loop 2A	N.A.
SIE-V 124#	18	LPSI to RC loop 2B	N.A.
SIE-V 134#	19	LPSI to RC loop 1A	N.A.
SIE-V 144#	20	LPSI to RC loop 1B	N.A.
SIA-V 164	21	Shutdown cooling heat exchanger 1 to containment spray header 1	N.A.
SIB-V 165	22	Shutdown cooling heat exchanger 2 to containment spray header 2	N.A.

#Not Type C tested

TABLE 3.6-1 (Continued)  
CONTAINMENT ISOLATION VALVES

VALVE NUMBER	PENETRATION NUMBER	FUNCTION	MAXIMUM ACTUATION TIME (SECONDS)
D. CHECK VALVES (Continued)			
CHE-V M70	41	Regenerative heat exchanger to RC loop 2A	N.A.
IAE-V 073	59	Containment service air utility station	N.A.
SIB-V 533	67	Long term recirculation loop 2	N.A.
CHE-V 835	72	RC pump seal injection water to RCP 1A, 1B, 2A, 2B	N.A.
AFE-V 079 <sup>#</sup>	75	Steam generator 1 auxiliary feedwater	N.A.
AFE-V 080 <sup>#</sup>	76	Steam generator 2 auxiliary feedwater	N.A.
SIA-V 523	77	Long term recirculation loop 1	N.A.

FINAL DRAFT

TABLE 3.6-1 (Continued)  
CONTAINMENT ISOLATION VALVES

VALVE NUMBER	PENETRATION NUMBER	FUNCTION	MAXIMUM ACTUATION TIME (SECONDS)
E. SAFETY/RELIEF VALVES			
SIA-PSV 151	23	Containment recirculation sump to containment spray, LPSI and HPSI headers 1A & 1B	N.A.
SIB-PSV 140#	24	Containment recirculation sump to containment spray, LPSI and HPSI headers 2A & 2B	N.A.
SIB-PSV 189	26	From shutdown cooling RC Loop 2	N.A.
SIA-PSV 179	27	From shutdown cooling RC Loop 1	N.A.
SIE-PSV 474	28	Safety injection drain relief	N.A.

2  
COVERED BY  
T.S.  
3.4.8.3

# FINAL DRAFT

TABLE 3.6-1 (Continued)  
CONTAINMENT ISOLATION VALVES

VALVE NUMBER	PENETRATION NUMBER	FUNCTION	MAXIMUM ACTUATION TIME (SECONDS)
	<b>F</b>	<b><del>P.</del> NORMALLY OPEN - ESF ACTUATED CLOSED</b>	
SG-UV 170 #	1	Main steam isolation	N.A.
SG-UV 171#	2	Main steam isolation	N.A.
SGE-UV 169#	1 & 2	Main steam isolation bypass	N.A.
SG-UV 180#	3	Main steam isolation	N.A.
SG-UV 181#	4	Main steam isolation	N.A.
SGE-UV 183#	3 & 4	Main steam isolation bypass	N.A.
<sup>A</sup> <del>SGE</del> -UV 1133#	1-4	Steam trap/bypass	N.A.
<sup>A</sup> <del>SGE</del> -UV 1134#	1-4	Steam trap/bypass	N.A.
<sup>B</sup> <del>SGE</del> -UV 1135A#	1-4	Steam trap/bypass	N.A.
<sup>B</sup> <del>SGE</del> -UV 1135B#	1-4	Steam trap/bypass	N.A.
<sup>B</sup> <del>SGE</del> -UV 1136A#	1-4	Steam trap/bypass	N.A.
<sup>B</sup> <del>SGE</del> -UV 1136B#	1-4	Steam trap/bypass	N.A.
SGA-UV 174#	8	Steam generator feedwater	N.A.
SGB-UV 132 <sup>#</sup>	8	Steam generator feedwater	N.A.
SGB-UV 137 <sup>#</sup>	10	Steam generator feedwater	N.A.
SGA-UV 177 <sup>#</sup>	10	Steam generator feedwater	N.A.
SGB-UV 130#	11	Downcomer FIV	N.A.
SGA-UV 172#	11	Downcomer FIV	N.A.
SGB-UV 135#	12	Downcomer FIV	N.A.

covered by T.S.  
3.7.1.4

#Not Type C tested



TABLE 3.6-1 (Continued)

CONTAINMENT ISOLATION VALVES

VALVE NUMBER	PENETRATION NUMBER	FUNCTION	MAXIMUM ACTUATION TIME (SECONDS)
F. NORMALLY OPEN - ESF ACTUATED CLOSED (Continued)			
SGA-UV 175#	12	Downcomer FIV	N.A.
SIA-UV 682#	28	SI drain from drain tank	N.A.
SGA-UV 211#	37A	Steam generator blowdown sample	N.A.
SGB-UV 228#	37A	Steam generator blowdown sample	N.A.
SGA-UV 204#	37B	Steam generator blowdown sample	N.A.
SGB-UV 219#	37B	Steam generator blowdown sample	N.A.
SGA-UV 500P#	46	Steam generator blowdown to SCCS	N.A.
SGB-UV 500Q#	46	Steam generator blowdown to SCCS	N.A.
SGB-UV 500R#	47	Steam generator blowdown to SCCS	N.A.
SGA-UV 500S#	47	Steam generator blowdown to SCCS	N.A.
SGB-UV 226#	48	Steam generator blowdown to downcomer blowdown sample	N.A.
SGA-UV 227#	48	Steam generator blowdown to downcomer blowdown sample	N.A.
SGA-UV 220#	49	Steam generator blowdown to downcomer blowdown sample	N.A.
SGB-UV 221#	49	Steam generator blowdown to downcomer blowdown sample	N.A.
SGB-UV 224#	63A	SG2 blowdown sample	N.A.
SGA-UV 225#	63A	SG2 blowdown sample	N.A.
SGB-UV 222#	63B	SG2 blowdown sample	N.A.
SGA-UV 223#	63B	SG2 blowdown sample	N.A.

#Not Type C tested



# FINAL DRAFT

TABLE 3.6-1 (Continued)  
CONTAINMENT ISOLATION VALVES

VALVE NUMBER	PENETRATION NUMBER	FUNCTION	MAXIMUM ACTUATION TIME (SECONDS)
		6. REQUIRED OPEN DURING ACCIDENT CONDITIONS	
SID-UV 654	26	From shutdown cooling RC loop 2	N.A.
SIB-UV 656	26	From shutdown cooling RC loop 2	N.A.
SIB-HV 690	26	From shutdown cooling RC loop 2	N.A.
SIC-UV 653	27	From shutdown cooling RC loop 1	N.A.
SIA-UV 655	27	From shutdown cooling RC loop 1	N.A.
SIA-HV 691	27	From shutdown cooling RC loop 1	N.A.
HCC-HV 076#	32A	Containment pressure monitor	N.A.
HPA-HV 007A	35	Containment to hydrogen monitor	N.A.
HPB-HV 008A	36	Containment to hydrogen monitor	N.A.
HPA-HV 007B	38	Hydrogen monitor to containment	N.A.
HPB-HV 008B	39	Hydrogen monitor to containment	N.A.
CHA-HV 524	41	Regenerative heat exchanger to RC loop 2A	N.A.
HCA-HV 074#	54A	Containment pressure monitor	N.A.
HCB-HV 075#	55A	Containment pressure monitor	N.A.
HCD-HV 077#	62A	CB pressure monitor	N.A.
SID-HV 331	67	Long-term recirculation loop 2	N.A.
CHB-HV 255	72	RC pump seal injection water to RCP 1A, 1B, 2A, 2B	N.A.
SIC-HV 321	77	Long-term recirculation loop 1	N.A.
SGA-UV 134#	2	Main steam to auxiliary feedwater turbine	N.A.
SGA-UV 134A#	2	Main steam to auxiliary feedwater turbine bypass.	N.A.

#Not Type C tested

PALO VERDE - UNIT 1

3/4 6-32



# FINAL DRAFT

TABLE 3.6-1 (Continued)  
CONTAINMENT ISOLATION VALVES

VALVE NUMBER	PENETRATION NUMBER	FUNCTION	MAXIMUM ACTUATION TIME (SECONDS)
<p align="center">6. REQUIRED OPEN DURING ACCIDENT CONDITIONS (Continued)</p>			
SGA-UV 138#	3	Main steam to auxiliary feedwater turbine	N.A.
SGA-UV 138A#	3	Main steam to auxiliary feedwater turbine bypass	N.A.
SIB-UV 616#	13	HPSI to RC loop 2A	N.A.
SIA-UV 617#	13	HPSI to RC loop 2A	N.A.
SIB-UV 626#	14	HPSI to RC loop 2B	N.A.
SIA-UV 627#	14	HPSI to RC loop 2B	N.A.
SIB-UV 636#	15	HPSI to RC loop 1A	N.A.
SIA-UV 637#	15	HPSI to RC loop 1A	N.A.
SIB-UV 646#	16	HPSI to RC loop 1B	N.A.
SIA-UV 647#	16	HPSI to RC loop 1B	N.A.
SIB-UV 615#	17	LPSI to RC loop 2A	N.A.
SIB-UV 625#	18	LPSI to RC loop 2B	N.A.
SIA-UV 635#	19	LPSI to RC loop 1A	N.A.
SIA-UV 645#	20	LPSI to RC loop 1B	N.A.
SIA-UV 672	21	Shutdown cooling heat exchanger 1 to containment spray header 1	N.A.
SIB-UV 671	22	Shutdown cooling heat exchanger 2 to containment spray header 2	N.A.

#Not Type C tested

# FINAL DRAFT

TABLE 3.6-1 (Continued)  
CONTAINMENT ISOLATION VALVES

VALVE NUMBER	PENETRATION NUMBER	FUNCTION	MAXIMUM ACTUATION TIME (SECONDS)
G 3/4 REQUIRED OPEN DURING ACCIDENT CONDITIONS (Continued)			
SIA-UV 673#	23	Containment recirculation sump to containment spray, LPSI and HPSI headers 1A & 1B	N.A.
SIA-UV 674#	23	Containment recirculation sump to containment spray, LPSI and HPSI headers 1A & 1B	N.A.
SIB-UV 675#	24	Containment recirculation sump to containment spray, LPSI and HPSI headers 2A & 2B	N.A.
SIB-UV 676#	24	Containment recirculation sump to containment spray, LPSI and HPSI headers 2A & 2B	N.A.
AFB-UV 034#	75	Steam generator 1 auxiliary feedwater	N.A.
AFC-UV 036#	75	Steam generator 1 auxiliary feedwater	N.A.
AFB-UV 035#	76	Steam generator 2 auxiliary feedwater	N.A.
AFA-UV 037#	76	Steam generator 2 auxiliary feedwater	N.A.

#Not Type C tested

TABLE 3.6-1 (continued)  
CONTAINMENT ISOLATION VALVES

VALVE NUMBER	PENETRATION NUMBER	FUNCTION	MAXIMUM ACTUATION TIME (SECONDS)
H. NORMALLY CLOSED/POST ACCIDENT CLOSED VALVES			
SGE-V-603#	1	N <sub>2</sub> blanket supply/N <sub>2</sub> vent	N.A.
SGE-V-611#	3	N <sub>2</sub> blanket supply/N <sub>2</sub> vent	N.A.
DWE-V 061*	6	Containment demineralized water stations	N.A.
DWE-V 062*	6	Containment demineralized water stations	N.A.
FPE-V 089*	7	Fire protection containment	N.A.
SIE-V 463*	28	Safety injection <del>drain from</del> drain tank	N.A.
CHE-V 854*	41	Chemical addition unit to regenerative heat exchanger	N.A.
PCE-V. 070	50	Fuel pool cooling	N.A.
PCE-V 071	50	Fuel pool cooling	N.A.
PCE-V 075	51	Refueling pool cleanup	N.A.
PCE-V 076	51	Refueling pool cleanup	N.A.
IAE-V 072*	59	Containment service air utility station	N.A.

\*May be opened on an intermittent basis under administrative control.

FINAL DRAFT

CONTAINMENT SYSTEMS

3/4.6.4 COMBUSTIBLE GAS CONTROL

HYDROGEN MONITORS

LIMITING CONDITION FOR OPERATION

---

3.6.4.1 Two independent containment hydrogen monitors shall be OPERABLE.

APPLICABILITY: MODES 1 and 2.

ACTION:

- a. With one hydrogen monitor inoperable, restore the inoperable monitor to OPERABLE status within 30 days or be in at least HOT STANDBY within the next 6 hours.
- b. With both hydrogen monitors inoperable, restore at least one monitor to OPERABLE status within 72 hours or be in at least HOT STANDBY within the next 6 hours.
- c. WITH ONE HYDROGEN MONITOR INOPERABLE, THE PROVISIONS OF SPECIFICATION 3.0.4 ARE NOT APPLICABLE

SURVEILLANCE REQUIREMENTS

---

4.6.4.1 Each hydrogen monitor shall be demonstrated OPERABLE by the performance of a CHANNEL CHECK at least once per 12 hours, a CHANNEL FUNCTIONAL TEST at least once per 31 days, and at least once per 92 days on a STAGGERED TEST BASIS by performing a CHANNEL CALIBRATION using sample gases containing a nominal:

- a. One volume percent hydrogen, balance nitrogen.
- b. Four volume percent hydrogen, balance nitrogen.

FINAL DRAFT

CONTAINMENT SYSTEMS

ELECTRIC HYDROGEN RECOMBINERS

LIMITING CONDITION FOR OPERATION

---

3.6.4.2 Two portable independent containment hydrogen recombiner systems shared among the three units shall be OPERABLE.

APPLICABILITY: MODES 1 and 2.

ACTION:

With one hydrogen recombiner system inoperable, restore the inoperable system to OPERABLE status within 30 days or meet the requirements of Specification 3.6.4.3, or be in at least HOT STANDBY within the next 6 hours.

SURVEILLANCE REQUIREMENTS

---

4.6.4.2 Each hydrogen recombiner system shall be demonstrated OPERABLE:

- a. At least once per 6 months by:
  1. Verifying through a visual examination that there is no evidence of abnormal conditions within the recombiner enclosure and control console.
  2. Operating the air blast heat exchanger fan motor and enclosed blower motor continuously for at least 30 minutes.
- b. At least once per year by:
  1. Performing a CHANNEL CALIBRATION of recombiner instrumentation.
  2. Performing a "Low-Level Test-Heater Power Off" and "Low-Level Test-Heater Power On" test and verifying that the recombiner temperature increases to and is maintained at  $600 \pm 25^{\circ}\text{F}$  for at least one hour. With power off and a simulated input signal of  $1280^{\circ}\text{F}$ , verify the OPERABILITY of all control circuits. When this test is conducted, the air blast heat exchanger fan motor and enclosed blower motor shall be operated continuously for at least 30 minutes.
- c. At least once per 5 years by performing a Recombiner System "High-Level Test" and verifying that the recombiner temperature increases to and is maintained at  $1200 \pm 50^{\circ}\text{F}$  for at least one hour.

**FINAL DRAFT**

CONTAINMENT SYSTEMS

HYDROGEN PURGE CLEANUP SYSTEM

LIMITING CONDITION FOR OPERATION

---

3.6.4.3 A containment hydrogen purge cleanup system, shared among the three units, shall be OPERABLE and capable of being powered from a minimum of one OPERABLE emergency bus.

APPLICABILITY: MODES 1\* and 2.\*

ACTION:

With the containment hydrogen purge cleanup system inoperable and one hydrogen recombiner OPERABLE as determined by Specification 4.6.4.2, restore the hydrogen purge cleanup system to OPERABLE status within 30 days or be in at least HOT STANDBY within the next 6 hours.

SURVEILLANCE REQUIREMENTS

---

4.6.4.3 The hydrogen purge cleanup system shall be demonstrated OPERABLE:

- a. At least once per 31 days by initiating flow through the HEPA filters and charcoal adsorbers and verifying that the system operates for at least 15 minutes.
- b. At least once per 18 months or (1) after any structural maintenance on the HEPA filter or charcoal adsorber housings, or (2) following painting, fire, or chemical release in any ventilation zone communicating with the system by:
  1. Verifying that the cleanup system satisfies the in-place testing acceptance criteria and uses the test procedures of Regulatory Positions C.5.a, C.5.c, and C.5.d of Regulatory Guide 1.52, Revision 2, March 1978, and the system flow rate is 50 scfm  $\pm$  10%.
  2. Verifying within 31 days after removal that a laboratory analysis of a representative carbon sample obtained in accordance with Regulatory Position C.6.b of Regulatory Guide 1.52, Revision 2, March 1978, meets the laboratory testing criteria of Regulatory Position C.6.a of Regulatory Guide 1.52, Revision 2, March 1978.

---

\*With less than two hydrogen recombiners OPERABLE.



SURVEILLANCE REQUIREMENTS (Continued)

---

3. Verifying a system flow rate of 50 scfm  $\pm$  10% during system operation when tested in accordance with ANSI N510-1980.
- c. After every 720 hours of charcoal adsorber operation by verifying within 31 days after removal that a laboratory analysis of a representative carbon sample obtained in accordance with Regulatory Position C.6.b of Regulatory Guide 1.52, Revision 2, March 1978, meets the laboratory testing criteria of Regulatory Position C.6.a of Regulatory Guide 1.52, Revision 2, March 1978.
- d. At least once per 18 months by:
  1. Verifying that the pressure drop across the combined HEPA filters, pre-filters and charcoal adsorber banks is less than 8.4 inches Water Gauge while operating the system at a flow rate of 50 scfm  $\pm$  10%.
  2. Verifying that the heaters dissipate at least 0.5 kW when tested in accordance with ANSI N510-1980.
- e. After each complete or partial replacement of a HEPA filter bank by verifying that the HEPA filter banks remove greater than or equal to 99% of the DOP when they are tested in-place in accordance with ANSI N510-1980 while operating the system at a flow rate of 50 scfm  $\pm$  10%.
- f. After each complete or partial replacement of a charcoal adsorber bank by verifying that the charcoal adsorbers remove greater than or equal to 99.95% of a halogenated hydrocarbon refrigerant test gas when they are tested in-place in accordance with ANSI N510-1980 while operating the system at a flow rate of 50 scfm  $\pm$  10%.



FINAL DRAFT

### 3/4.7 PLANT SYSTEMS

#### 3/4.7.1 TURBINE CYCLE

##### SAFETY VALVES

##### LIMITING CONDITION FOR OPERATION

---

3.7.1.1 All main steam safety valves shall be OPERABLE with lift settings as specified in Table 3.7-1.

APPLICABILITY: MODES 1, 2, 3, and 4\*.

ACTION:

- a. With both reactor coolant loops and associated steam generators in operation and with one or more\*\* main steam safety valves inoperable per steam generator, operation in MODES 1, 2, and 3 may proceed provided that within 4 hours, either all the inoperable valves are restored to OPERABLE status or the Power Level-High trip setpoint is reduced per Table 3.7-2; otherwise, be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- b. Operation in MODES 3 and 4\* may proceed with one reactor coolant loop and associated steam generator in operation, provided that there are no more than four inoperable main steam safety valves associated with the operating steam generator; otherwise, be in COLD SHUTDOWN within the following 30 hours.
- c. The provisions of Specification 3.0.4 are not applicable.

##### SURVEILLANCE REQUIREMENTS

---

4.7.1.1 No additional Surveillance Requirements other than those required by Specification 4.0.5.

---

\* Until the steam generators are no longer required for heat removal.

\*\* The maximum number of inoperable safety valves on any operating steam generator is four (4).



TABLE 3.7-1  
STEAM LINE SAFETY VALVES PER LOOPS

<u>VALVE NUMBER</u>		<u>LIFT SETTING (<math>\pm 1\%</math>)*</u>	<u>MINIMUM RATED CAPACITY**</u>
<u>S/G No. 1</u>	<u>S/G No. 2</u>		
a. PSV 572	PSV 554	1250 psig	941,543 lb/hr
b. PSV 579	PSV 561	1250 psig	941,543 lb/hr
c. PSV 573	PSV 555	1290 psig	971,332 lb/hr
d. PSV 578	PSV 560	1290 psig	971,332 lb/hr
e. PSV 574	PSV 556	1315 psig	989,950 lb/hr
f. PSV 575	PSV 557	1315 psig	989,950 lb/hr
g. PSV 576	PSV 558	1315 psig	989,950 lb/hr
h. PSV 577	PSV 559	1315 psig	989,950 lb/hr
i. PSV 691	PSV 694	1315 psig	989,950 lb/hr
j. PSV 692	PSV 695	1315 psig	989,950 lb/hr

\*The lift setting pressure shall correspond to ambient conditions at the valve at nominal operating temperature and pressure.

\*\*Capacity is rated at lift setting +3% accumulation.

RECEIVED

TABLE 3.7-2

VARIABLE  
↑  
MAXIMUM ALLOWABLE VARIABLE STEADY STATE POWER LEVEL AND OVERPOWER  
HIGH TRIP SETPOINT WITH INOPERABLE STEAM LINE SAFETY VALVES  
~~DURING TWO LOOP OPERATION WITH FOUR PUMPS OPERATING~~

MAXIMUM NUMBER OF INOPERABLE  
SAFETY VALVES ON ANY OPERATING  
STEAM GENERATOR

1

2

3

4

MAXIMUM VARIABLE OVERPOWER  
TRIP SETPOINT  
(% OF RATED THERMAL POWER)

108.0

97.1

86.2

75.3

MAXIMUM ALLOWABLE  
STEADY STATE POWER LEVEL  
(% OF RATED THERMAL POWER)

98.2

87.3

76.4

65.5

END  
PAGE 1

FINAL DRAFT

PLANT SYSTEMS

AUXILIARY FEEDWATER SYSTEM

LIMITING CONDITION FOR OPERATION

---

3.7.1.2 At least three independent steam generator auxiliary feedwater pumps and associated flow paths shall be OPERABLE with:

- a. Two feedwater pumps, each capable of being powered from separate OPERABLE emergency busses, and
- b. One feedwater pump capable of being powered from an OPERABLE steam supply system.

APPLICABILITY: MODES 1, 2, 3, and 4\*.

ACTION:

- a. With one auxiliary feedwater pump inoperable, restore the required auxiliary feedwater pumps to OPERABLE status within 72 hours or be in at least HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours.
- b. With two auxiliary feedwater pumps inoperable be in at least HOT STANDBY within 6 hours and in HOT SHUTDOWN within the following 6 hours.
- c. With three auxiliary feedwater pumps inoperable, immediately initiate corrective action to restore at least one auxiliary feedwater pump to OPERABLE status as soon as possible.

SURVEILLANCE REQUIREMENTS

---

4.7.1.2 Each auxiliary feedwater pump shall be demonstrated OPERABLE:

- a. At least once per 31 days on a STAGGERED TEST BASIS by:
  1. Testing the turbine-driven pump and both motor-driven pumps pursuant to Specification 4.0.5. The provisions of Specification 4.0.4 are not applicable for the turbine-driven pump for entry into MODE 3.
  2. Verifying that each valve (manual, power-operated, or automatic) in the flow path that is not locked, sealed, or otherwise secured in position, is in its correct position.
  3. Verifying that all manual valves in the suction lines from the primary AFW supply tank (condensate storage tank CTE-T01) to each AFW pump, and the manual discharge line valve of each AFW pump are locked, sealed or otherwise secured in the open position.

\*Until the steam generators are no longer required for heat removal.



## PLANT SYSTEMS

### SURVEILLANCE REQUIREMENTS (Continued)

- b. At least once per 18 months during shutdown by:
  - 1. Verifying that each automatic valve in the flow path actuates to its correct position upon receipt of an auxiliary feedwater actuation test signal.
  - 2. Verifying that each pump that starts automatically upon receipt of an auxiliary feedwater actuation test signal will start automatically upon receipt of an auxiliary feedwater actuation test signal.
- c. Prior to startup following any refueling shutdown or cold shutdown of 30 days or longer, by verifying on a STAGGERED TEST BASIS (by means of a flow test) that the normal flow path from the condensate storage tank to each of the steam generators through one of the essential auxiliary feedwater pumps delivers at least 750 gpm at 1250 psig or equivalent.  
1270 PSIA
- d. The provisions of Specification 4.0.4 are not applicable for entry into MODE 3 or MODE 4 for the turbine-driven pump.

## PLANT SYSTEMS

### CONDENSATE STORAGE TANK

#### LIMITING CONDITION FOR OPERATION

3.7.1.3 The condensate storage tank (CST) shall be OPERABLE with a level of at least 23 feet (300,000 gallons).

APPLICABILITY: MODES 1, 2, 3, # and 4.\*#

#### ACTION:

With the condensate storage tank inoperable, within 4 hours either:

- a. Restore the CST to OPERABLE status or be in at least HOT STANDBY within the next 6 hours and in HOT SHUTDOWN within the following 6 hours, or
- b. Demonstrate the OPERABILITY of the reactor makeup water tank as a backup supply to the auxiliary feedwater pumps and restore the condensate storage tank to OPERABLE status within 7 days or be in at least HOT STANDBY within the next 6 hours and in HOT SHUTDOWN with a OPERABLE shutdown cooling loop in operation within the following 6 hours.

#### SURVEILLANCE REQUIREMENTS

4.7.1.3.1 The condensate storage tank shall be demonstrated OPERABLE at least once per 12 hours by verifying the level (contained water volume) is within its limits when the tank is the supply source for the auxiliary feedwater pumps.

4.7.1.3.2 The reactor makeup water tank shall be demonstrated OPERABLE at least once per 12 hours whenever the reactor makeup water tank is the supply source for the auxiliary feedwater pumps by verifying:

- a. That the reactor makeup water tank supply line to the auxiliary feed system isolation valve is open, and
- b. That the reactor makeup water tank contains a water level of at least 26 feet (300,000 gallons).

\*Until the steam generators are no longer required for heat removed.

#Not applicable when cooldown is in progress.



FINAL DRAFT

PLANT SYSTEMS

ACTIVITY

LIMITING CONDITION FOR OPERATION

---

3.7.1.4 The specific activity of the secondary coolant system shall be less than or equal to 0.10 microcurie/gram DOSE EQUIVALENT I-131.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

With the specific activity of the secondary coolant system greater than 0.10 microcurie/gram DOSE EQUIVALENT I-131, be in at least HOT STANDBY within 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

---

4.7.1.4 The specific activity of the secondary coolant system shall be determined to be within the limit by performance of the sampling and analysis program of Table 4.7-1.



FINAL DRAFT

TABLE 4.7-1

SECONDARY COOLANT SYSTEM SPECIFIC ACTIVITY  
SAMPLE AND ANALYSIS PROGRAM

TYPE OF MEASUREMENT  
AND ANALYSIS

SAMPLE AND ANALYSIS  
FREQUENCY

- |   |  |
|---|--|
| 1. Gross Activity Determination                                 | At least once per 72 hours   |
| 2. Isotopic Analysis for DOSE<br>EQUIVALENT I-131 Concentration | (a) 1 per 31 days, whenever<br>the gross activity determina-<br>tion indicates iodine con-<br>centrations greater than 10%<br>of the allowable limit.<br><br>(b) 1 per 6 months, whenever the<br>gross activity determination<br>indicates iodine concentra-<br>tions below 10% of the<br>allowable limit. |

FINAL DRAFT

PLANT SYSTEMS

MAIN STEAM LINE ISOLATION VALVES

LIMITING CONDITION FOR OPERATION

---

3.7.1.5 Each main steam line isolation valve shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

MODE 1:

With one main steam line isolation valve inoperable but open, POWER OPERATION may continue provided the inoperable valve is restored to OPERABLE status within 4 hours; otherwise, be in at least MODE 2 within the next 6 hours.

MODES 2, 3, and 4:

With one main steam line isolation valve inoperable, subsequent operation in MODE 2, 3, or 4 may proceed provided:

- a. The isolation valve is maintained closed.
- b. The provisions of Specification 3.0.4 are not applicable.

Otherwise, be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

---

4.7.1.5.1 Each main steam line isolation valve shall be demonstrated OPERABLE by verifying full closure within ~~5.0~~ <sup>4.6</sup> seconds when tested pursuant to Specification 4.0.5.

4.7.1.5.2 The provisions of Specification 4.0.4 are not applicable for entry into MODE 3 or MODE 4 to perform the surveillance testing of Specification 4.7.1.5.1 provided the testing is performed within 12 hours after achieving normal operating steam pressure and normal operating temperature for the secondary side to perform the test.

FINAL DRAFT

PLANT SYSTEMS

ATMOSPHERE DUMP VALVES

LIMITING CONDITION FOR OPERATION

---

3.7.1.6 The atmospheric dump valves shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4.\*

ACTION:

With less than one atmospheric dump valve per steam generator OPERABLE, restore the required atmospheric dump valve to OPERABLE status within 72 hours; or be in at least HOT STANDBY within the next 6 hours.

SURVEILLANCE REQUIREMENTS

---

4.7.1.6 Each atmospheric dump valve shall be demonstrated OPERABLE:

- a. At least once per 24 hours by verifying that the nitrogen accumulator tank is at a pressure  $\geq$  400 PSIG.
- b. Prior to startup following any refueling shutdown or cold shutdown of 30 days or longer, verify that all valves will open and close fully.

---

\*When steam generators are being used for decay heat removal.

FINAL DRAFT

PLANT SYSTEMS

3/4.7.2 STEAM GENERATOR PRESSURE/TEMPERATURE LIMITATION

LIMITING CONDITION FOR OPERATION

---

3.7.2 The temperature of the secondary coolant in the steam generators shall be greater than 120°F when the pressure of the secondary coolant in the steam generator is greater than 230 psig.

APPLICABILITY: At all times.

ACTION:

With the requirements of the above specification not satisfied:

- a. Reduce the steam generator pressure to less than or equal to 230 psig within 30 minutes, and
- b. Perform an engineering evaluation to determine the effect of the overpressurization on the structural integrity of the steam generator. Determine that the steam generator remains acceptable for continued operation prior to increasing its temperatures above 200°F.

SURVEILLANCE REQUIREMENTS

---

4.7.2 The pressure in the secondary side of the steam generators shall be determined to be less than 230 psig at least once per 12 hours when the temperature of the secondary coolant is less than 120°F.

## PLANT SYSTEMS

### 3/4.7.3 ESSENTIAL COOLING WATER SYSTEM

#### LIMITING CONDITION FOR OPERATION

---

3.7.3 At least two independent essential cooling water loops shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

With only one essential cooling water loop OPERABLE, restore at least two loops to OPERABLE status within 72 hours or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

#### SURVEILLANCE REQUIREMENTS

---

4.7.3 At least two essential cooling water loops shall be demonstrated OPERABLE:

- a. At least once per 31 days by verifying that each valve (manual, power-operated, or automatic) servicing safety-related equipment that is not locked, sealed, or otherwise secured in position, is in its correct position.
- b. At least once per 18 months during shutdown, by verifying that each automatic valve servicing safety-related equipment actuates to its correct position on an SIAS test signal.
- c. At least once per 18 months during shutdown, by verifying that the essential cooling water pumps start on an SIAS test signal.
- d. At least once per 18 months during shutdown, by verifying that each valve (manual, power-operated, or automatic) servicing safety-related equipment that is locked, sealed, or otherwise secured in position, is in its correct position.

FINAL DRAFT

PLANT SYSTEMS

3/4.7.4 ESSENTIAL SPRAY POND SYSTEM

LIMITING CONDITION FOR OPERATION

---

3.7.4 At least two independent essential spray pond loops shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

With only one essential spray pond loop OPERABLE, restore at least two loops to OPERABLE status within 72 hours or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

---

4.7.4.1 At least two essential spray pond loops shall be demonstrated OPERABLE at least once per 31 days by verifying that each valve (manual, power-operated, or automatic) servicing safety-related equipment that is not locked, sealed, or otherwise secured in position, is in its correct position.

4.7.4.2 Once per 18 months during shutdown, verify that each valve (manual, power-operated, or automatic) servicing safety-related equipment that is locked, sealed, or otherwise secured in position, is in its correct position.



PLANT SYSTEMS

3/4.7.5 ULTIMATE HEAT SINK

LIMITING CONDITION FOR OPERATION

---

3.7.5 The ultimate heat sink shall be OPERABLE with two essential spray ponds each with:

- a. A minimum water depth of 12 feet, and
- b. An average water temperature of less than or equal to 105°F.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

With the requirements of the above specification not satisfied, be in at least HOT STANDBY within 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

---

4.7.5 The ultimate heat sink shall be determined OPERABLE at least once per 24 hours by verifying the average water temperature and water depth to be within their limits for each essential spray pond.

## PLANT SYSTEMS

FINAL DRAFT

### 3/4.7.6 ESSENTIAL CHILLED WATER SYSTEM

#### LIMITING CONDITION FOR OPERATION

3.7.6 At least two independent essential chilled water loops shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4.

#### ACTION:

- a. With only one essential chilled water loop OPERABLE, restore at least two loops to OPERABLE status within 7 days or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- b. With only one ~~emergency~~ <sup>ESSENTIAL</sup> chilled water system OPERABLE:
  1. Within 1 hour verify that the normal HVAC system is providing space cooling to the vital power distribution rooms that depend on the inoperable essential chilled water system for space cooling, and
  2. Within 8 hours establish OPERABILITY of the safe shutdown systems which do not depend on the inoperable essential chilled water system (one train each of boration, pressurizer heaters and auxiliary feedwater), and
  3. Within 24 hours establish OPERABILITY of all required systems, subsystems, trains, components, and devices that depend on the remaining ~~OPERABILITY~~ <sup>OPERABLE</sup> essential chilled water system for space cooling.

If these conditions are not satisfied within the specified time, be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

#### SURVEILLANCE REQUIREMENTS

4.7.6.1 At least two essential chilled water loops shall be demonstrated OPERABLE at least once per 31 days by verifying that each valve (manual, power-operated, or automatic) servicing safety-related equipment that is not locked, sealed, or otherwise secured in position, is in its correct position.

4.7.6.2 Once per 18 months during shutdown, verify that each valve (manual, power-operated, or automatic) servicing safety-related equipment that is locked, sealed, or otherwise secured in position, is in its correct position.

## PLANT SYSTEMS

### 3/4.7.7 CONTROL ROOM ESSENTIAL FILTRATION SYSTEM

#### LIMITING CONDITION FOR OPERATION

---

3.7.7 Two independent control room essential filtration systems shall be OPERABLE.

APPLICABILITY: All MODES.

#### ACTION:

MODES 1, 2, 3, and 4:

With one control room essential filtration system inoperable, restore the inoperable system to OPERABLE status within 7 days or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

MODES 5 and 6:

- a. With one control room essential filtration system inoperable, restore the inoperable system to OPERABLE status within 7 days or initiate and maintain operation of the remaining OPERABLE control room essential filtration system in the recirculation mode.
- b. With both control room essential filtration systems inoperable, or with the OPERABLE control room essential filtration system, required to be in the recirculation mode by ACTION a., not capable of being powered by an OPERABLE emergency power source, suspend all operations involving CORE ALTERATIONS or positive reactivity changes.

#### SURVEILLANCE REQUIREMENTS

---

4.7.7 Each control room essential filtration system shall be demonstrated OPERABLE:

- a. At least once per 31 days on a STAGGERED TEST BASIS by initiating, from the control room, flow through the HEPA filters and charcoal adsorbers and verifying that the system operates for at least 15 minutes.
- b. At least once per 18 months or (1) after any structural maintenance on the HEPA filter or charcoal adsorber housings, or (2) following painting, fire, or chemical release in any ventilation zone communicating with the system by:

SURVEILLANCE REQUIREMENTS (Continued)

1. Verifying that the cleanup system satisfies the in-place testing acceptance criteria and uses the test procedures of Regulatory Positions C.5.a, C.5.c and C.5.d of Regulatory Guide 1.52, Revision 2, March 1978, and the system flow rate is 28,600 cfm  $\pm$  10%.
  2. Verifying within 31 days after removal that a laboratory analysis of a representative carbon sample obtained in accordance with Regulatory Position C.6.b of Regulatory Guide 1.52, Revision 2, March 1978, meets the laboratory testing criteria of Regulatory Position C.6.a of Regulatory Guide 1.52, Revision 2, March 1978.
  3. Verifying a system flow rate of 28,600 cfm  $\pm$  10% during system operation when tested in accordance with ANSI N510-1980.
- c. After every 720 hours of charcoal adsorber operation by verifying within 31 days after removal that a laboratory analysis of a representative carbon sample obtained in accordance with Regulatory Position C.6.b of Regulatory Guide 1.52, Revision 2, March 1978, meets the laboratory testing criteria of Regulatory Position C.6.a of Regulatory Guide 1.52, Revision 2, March 1978.
- d. At least once per 18 months by:
1. Verifying that the pressure drop across the combined HEPA filters, pre-filters, and charcoal adsorber banks is less than 8.4 inches Water Gauge while operating the system at a flow rate of 28,600 cfm  $\pm$  10%.
  2. Verifying that on a Control Room Essential Filtration Actuation Signal and on a SIAS, the system is automatically placed into a filtration mode of operation with flow through the HEPA filters and charcoal adsorber banks.
  3. Verifying that the system maintains the control room at a positive pressure of greater than or equal to 1/8-inch Water Gauge relative to adjacent areas during system operation at a makeup flow rate to the control room of less than or equal to 1000 cfm.
  4. Verifying that the emergency chilled water system will maintain the control room environment at a temperature less than or equal to 80°F for a period of 30 minutes.

SURVEILLANCE REQUIREMENTS (Continued)

---

- e. After each complete or partial replacement of a HEPA filter bank by verifying that the HEPA filter banks remove greater than or equal to 99% of the DOP when they are tested in-place in accordance with ANSI N510-1980 while operating the system at a flow rate of 28,600 cfm  $\pm$  10%.
- f. After each complete or partial replacement of a charcoal adsorber bank by verifying that the charcoal adsorbers remove greater than or equal to 99.95% of a halogenated hydrocarbon refrigerant test gas when they are tested in-place in accordance with ANSI N510-1980 while operating the system at a flow rate of 28,600 cfm  $\pm$  10%.

## PLANT SYSTEMS

FINAL DRAFT

### 3/4.7.8 ESF PUMP ROOM AIR EXHAUST CLEANUP SYSTEM

#### LIMITING CONDITION FOR OPERATION

---

3.7.8 Two independent ESF pump room air exhaust cleanup systems shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

With one ESF pump room air exhaust cleanup system inoperable, restore the inoperable system to OPERABLE status within 7 days or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

#### SURVEILLANCE REQUIREMENTS

---

4.7.8 Each ESF pump room air exhaust cleanup system shall be demonstrated OPERABLE:

- a. At least once per 31 days on a STAGGERED TEST BASIS by initiating, from the control room, flow through the HEPA filters and charcoal adsorbers and verifying that the system operates for at least 15 minutes.
- b. At least once per 18 months or (1) after any structural maintenance on the HEPA filter or charcoal adsorber housings, or (2) following painting, fire, or chemical release in any ventilation zone communicating with the system by:

SURVEILLANCE REQUIREMENTS (Continued)

1. Verifying that the cleanup system satisfies the in-place testing acceptance criteria and uses the test procedures of Regulatory Positions C.5.a, C.5.c and C.5.d of Regulatory Guide 1.52, Revision 2, March 1978, and the system flow rate is 6000 cfm  $\pm$  10%.
  2. Verifying within 31 days after removal that a laboratory analysis of a representative carbon sample obtained in accordance with Regulatory Position C.6.b of Regulatory Guide 1.52, Revision 2, March 1978, meets the laboratory testing criteria of Regulatory Position C.6.a of Regulatory Guide 1.52, Revision 2, March 1978.
  3. Verifying a system flow rate of 6000 cfm  $\pm$  10% during system operation when tested in accordance with ANSI N510-1980.
- c. After every 720 hours of charcoal adsorber operation by verifying within 31 days after removal that a laboratory analysis of a representative carbon sample obtained in accordance with Regulatory Position C.6.b of Regulatory Guide 1.52, Revision 2, March 1978, meets the laboratory testing criteria of Regulatory Position C.6.a of Regulatory Guide 1.52, Revision 2, March 1978.
- d. At least once per 18 months by:
1. Verifying that the pressure drop across the combined HEPA filters, pre-filters, and charcoal adsorber banks is less than 8.4 inches Water Gauge while operating the system at a flow rate of 6000 cfm  $\pm$  10%.
  2. Verifying that the system starts on an SIAS test signal.
- e. After each complete or partial replacement of an HEPA filter bank by verifying that the HEPA filter banks remove greater than or equal to 99% of the DOP when they are tested in-place in accordance with ANSI N510-1980 while operating the system at a flow rate of 6000 cfm  $\pm$  10%.
- f. After each complete or partial replacement of a charcoal adsorber bank by verifying that the charcoal adsorbers remove greater than or equal to 99.95% of a halogenated hydrocarbon refrigerant test gas when they are tested in-place in accordance with ANSI N510-1980 while operating the system at a flow rate of 6000 cfm  $\pm$  10%.

## PLANT SYSTEMS

### 3/4.7.9 SNUBBERS

#### LIMITING CONDITION FOR OPERATION

---

3.7.9. All hydraulic and mechanical snubbers shall be OPERABLE. The only snubbers excluded from this requirement are those installed on nonsafety-related systems and then only if their failure or failure of the system on which they are installed, would have no adverse effect on any safety-related system.

APPLICABILITY: MODES 1, 2, 3, and 4. MODES 5 and 6 for snubbers located on systems required OPERABLE in those MODES.

#### ACTION:

With one or more snubbers inoperable on any system, within 72 hours replace or restore the inoperable snubber(s) to OPERABLE status and perform an engineering evaluation per Specification 4.7.9g. on the attached component or declare the attached system inoperable and follow the appropriate ACTION statement for that system.

#### SURVEILLANCE REQUIREMENTS

---

4.7.9 Each snubber shall be demonstrated OPERABLE by performance of the following augmented inservice inspection program and the requirements of Specification 4.0.5.

##### a. Inspection Types

As used in this specification, type of snubber shall mean snubbers of the same design and manufacturer, irrespective of capacity.

##### b. Visual Inspections

Snubbers are categorized as inaccessible or accessible during reactor operation. Each of these groups (inaccessible and accessible) may be inspected independently according to the schedule below. The first inservice visual inspection of each type of snubber shall be performed after 4 months but within 10 months of commencing POWER OPERATION and shall include all hydraulic and mechanical snubbers. If all snubbers of each type are found OPERABLE during the first inservice visual inspection, the second inservice visual inspection of that type shall be performed at the first refueling outage. Otherwise, subsequent visual inspections of a given type shall be performed in accordance with the following schedule:



## PLANT SYSTEMS

### SURVEILLANCE REQUIREMENTS (Continued)

<u>No. of Inoperable Snubbers of Each Type per Inspection Period</u>	<u>Subsequent Visual Inspection Period*#</u>
0	18 months $\pm$ 25%
1	12 months $\pm$ 25%
2	6 months $\pm$ 25%
3,4	124 days $\pm$ 25%
5,6,7	62 days $\pm$ 25%
8 or more	31 days $\pm$ 25%

#### c. Visual Inspection Acceptance Criteria

Visual inspections shall verify that: (1) there are no visible indications of damage or impaired OPERABILITY and (2) attachments to the foundation or supporting structure are secure, and (3) fasteners for attachment of the snubber to the component and to the snubber anchorage are secure. Snubbers which appear inoperable as a result of visual inspections may be determined OPERABLE for the purpose of establishing the next visual inspection interval, provided that: (1) the cause of the rejection is clearly established and remedied for that particular snubber and for other snubbers irrespective of type on that system that may be generically susceptible; and (2) the affected snubber is functionally tested in the as-found condition and determined OPERABLE per Specifications 4.7.9f. When a fluid port of a hydraulic snubber is found to be uncovered, the snubber shall be declared inoperable and cannot be determined OPERABLE via functional testing unless the test is started with the piston in the as-found setting, extending the piston rod in the tension mode direction. All snubbers connected to an inoperable common hydraulic fluid reservoir shall be counted as inoperable snubbers. Snubbers which appear inoperable during an area post maintenance inspection, area walkdown, or Transient Event Inspection shall not be considered inoperable for the purpose of establishing the Subsequent Visual Inspection Period provided that the cause of the inoperability is clearly established and remedied for that particular snubber and for the other snubbers, irrespective of type, that may be generally susceptible.

#### d. Transient Event Inspection

An inspection shall be performed of all hydraulic and mechanical snubbers attached to sections of systems that have experienced unexpected, potentially damaging transients as determined from a review of operational data and a visual inspection of the systems within 6 months following such an event. In addition to satisfying

\*The inspection interval for each type of snubber on a given system shall not be lengthened more than one step at a time unless a generic problem has been identified and corrected; in that event the inspection interval may be lengthened one step the first time and two steps thereafter if no inoperable snubbers of that type are found on that system.

#The provisions of Specification 4.0.2 are not applicable.

## PLANT SYSTEMS

## SURVEILLANCE REQUIREMENTS (Continued)

the visual inspection acceptance criteria, freedom-of-motion of mechanical snubbers shall be verified using at least one of the following: (1) manually induced snubber movement; or (2) evaluation of in-place snubber piston setting; or (3) stroking the mechanical snubber through its full range of travel.

e. Functional Tests

During the first refueling shutdown and at least once per 18 months thereafter during shutdown, a representative sample of snubbers shall be tested using one of the following sample plans. The sample plan shall be selected prior to the test period and cannot be changed during the test period. The NRC Regional Administrator shall be notified in writing of the sample plan selected prior to the test period or the sample plan used in the prior test period shall be implemented:

- 1) At least 10% of the total of each type of snubber shall be functionally tested either in-place or in a bench test. For each snubber of a type that does not meet the functional test acceptance criteria of Specification 4.7.9f., an additional 10% of that type of snubber shall be functionally tested until no more failures are found or until all snubbers of that type have been functionally tested; or
- 2) A representative sample of each type of snubber shall be functionally tested in accordance with Figure 4.7-1. "C" is the total number of snubbers of a type found not meeting the acceptance requirements of Specification 4.7.9f. The cumulative number of snubbers of a type tested is denoted by "N". At the end of each day's testing, the new values of "N" and "C" (previous day's total plus current day's increments) shall be plotted on Figure 4.7-1. If at any time the point plotted falls in the "Reject" region all snubbers of that type shall be functionally tested. If at any time the point plotted falls in the "Accept" region, testing of snubbers of that type may be terminated. When the point plotted lies in the "Continue Testing" region, additional snubbers of that type shall be tested until the point falls in the "Accept" region or the "Reject" region, or all the snubbers of that type have been tested. Testing equipment failure during functional testing may invalidate that day's testing and allow that day's testing to resume anew at a later time, providing all snubbers tested with the failed equipment during the day of equipment failure are retested.
- 3) An initial representative sample of 55 snubbers shall be functionally tested. For each snubber type which does not meet the functional test acceptance criteria, another sample of at least one-half the size of the initial sample shall be tested until the total number tested is equal to the initial sample size multiplied by the factor,  $1 + C/2$ , where "C" is the number of snubbers found which do not meet the functional test acceptance criteria. The results from this sample plan shall be plotted using an "Accept" line which follows the equation  $N = 55(1 + C/2)$ . Each snubber point should be plotted as soon

## PLANT SYSTEMS

### SURVEILLANCE REQUIREMENTS (Continued)

---

as the snubber is tested. If the point plotted falls on or below the "Accept" line, testing of that type of snubber may be terminated. If the point plotted falls above the "Accept" line, testing must continue until the point falls in the "Accept" region or all the snubbers of that type have been tested.

The representative sample selected for the functional test sample plans shall be randomly selected from the snubbers of each type and reviewed before beginning the testing. The review shall ensure as far as practical that they are representative of the various configurations, operating environments, range of size, and capacity of snubbers of each type. Snubbers placed in the same locations as snubbers which failed the previous functional test shall be retested at the time of the next functional test but shall not be included in the sample plan. If during the functional testing, additional sampling is required due to failure of only one type of snubber, the functional testing results shall be reviewed at the time to determine if additional samples should be limited to the type of snubber which has failed the functional testing.

#### f. Functional Test Acceptance Criteria

The snubber functional test shall verify that:

- 1) Activation (restraining action) is achieved within the specified range in both tension and compression;
- 2) Snubber bleed, or release rate where required, is present in both tension and compression, within the specified range;
- 3) For mechanical snubbers, the force required to initiate or maintain motion of the snubber is within the specified range in both directions of travel; and
- 4) For snubbers specifically required not to displace under continuous load, the ability of the snubber to withstand load without displacement.

Testing methods may be used to measure parameters indirectly or parameters other than those specified if those results can be correlated to the specified parameters through established methods.

#### g. Functional Test Failure Analysis

An engineering evaluation shall be made of each failure to meet the functional test acceptance criteria to determine the cause of the failure. The results of this evaluation shall be used, if applicable, in selecting snubbers to be tested in an effort to determine the OPERABILITY of other snubbers irrespective of type which may be subject to the same failure mode.



## PLANT SYSTEMS

### SURVEILLANCE REQUIREMENTS (Continued)

For the snubbers found inoperable, an engineering evaluation shall be performed on the components to which the inoperable snubbers are attached. The purpose of this engineering evaluation shall be to determine if the components to which the inoperable snubbers are attached were adversely affected by the inoperability of the snubbers in order to ensure that the component remains capable of meeting the designed service.

If any snubber selected for functional testing either fails to lock up or fails to move, i.e., frozen-in-place, the cause will be evaluated and if caused by manufacturer or design deficiency all snubbers of the same type subject to the same defect shall be functionally tested. This testing requirement shall be independent of the requirements stated in Specification 4.7.9e. for snubbers not meeting the functional test acceptance criteria.

#### h. Functional Testing of Repaired and Replaced Snubbers

Snubbers which fail the visual inspection or the functional test acceptance criteria shall be repaired or replaced. Replacement snubbers and snubbers which have repairs which might affect the functional test result shall be tested to meet the functional test criteria before installation in the unit. These snubbers shall have met the acceptance criteria subsequent to their most recent service, and the functional test must have been performed within 12 months before being installed in the unit.

#### i. Snubber Seal Replacement Program

The service life of hydraulic and mechanical snubbers shall be monitored to ensure that the service life is not exceeded between surveillance inspections. The maximum expected service life for various seals, springs, and other critical parts shall be determined and established based on engineering information and shall be extended or shortened based on monitored test results and failure history. Critical parts shall be replaced so that the maximum service life will not be exceeded during a period when the snubber is required to be OPERABLE. The parts replacements shall be documented and the documentation shall be retained in accordance with Specification 6.10.2.



FINAL DRAFT

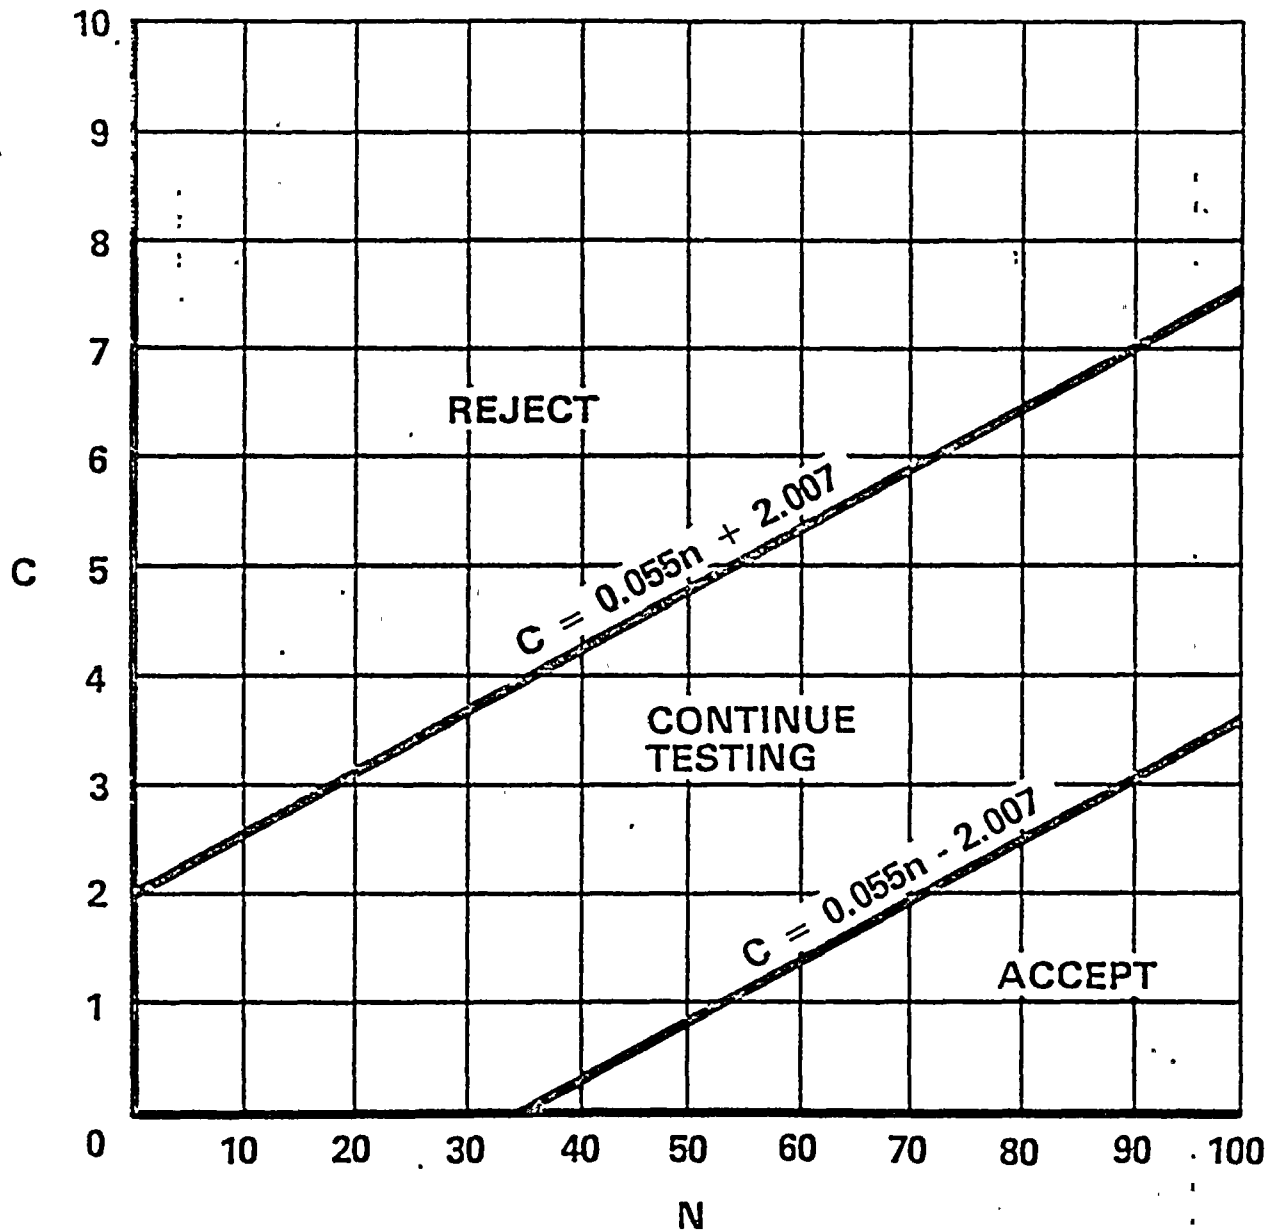


FIGURE 4.7-1

SAMPLING PLAN FOR SNUBBER FUNCTIONAL TEST





## PLANT SYSTEMS

### 3/4.7.10 SEALED SOURCE CONTAMINATION

#### LIMITING CONDITION FOR OPERATION

---

3.7.10 Each sealed source containing radioactive material either in excess of 100 microcuries of beta and/or gamma emitting material or 5 microcuries of alpha emitting material shall be free of greater than or equal to 0.005 microcurie of removable contamination.

APPLICABILITY: At all times.

#### ACTION:

- a. With a sealed source having removable contamination in excess of the above limit, immediately withdraw the sealed source from use and either:
  1. Decontaminate and repair the sealed source, or
  2. Dispose of the sealed source in accordance with Commission Regulations.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

---

4.7.10.1 Test Requirements - Each sealed source shall be tested for leakage and/or contamination by:

- a. The licensee, or
- b. Other persons specifically authorized by the Commission or an Agreement State.

The test method shall have a detection sensitivity of at least 0.005 microcurie per test sample.

4.7.10.2 Test Frequencies - Each category of sealed sources (excluding startup sources and fission detectors previously subjected to core flux) shall be tested at the frequencies described below.

- a. Sources in use - At least once per 6 months for all sealed sources containing radioactive material:
  1. With a half-life greater than 30 days (excluding Hydrogen 3), and
  2. In any form other than gas.

PLANT SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

---

- b. Stored sources not in use - Each sealed source and fission detector shall be tested prior to use or transfer to another licensee unless tested within the previous 6 months. Sealed sources and fission detectors transferred without a certificate indicating the last test date shall be tested prior to being placed into use.
- c. Startup sources and fission detectors - Each sealed startup source and fission detector shall be tested within 31 days prior to being subjected to core flux or installed in the core and following repair or maintenance to the source or detector.

4.7.10.3 Reports - A report shall be prepared and submitted to the Commission on an annual basis if sealed source or fission detector leakage tests reveal the presence of greater than or equal to 0.005 microcurie of removable contamination.

## PLANT SYSTEMS

### 3/4.7.11 FIRE SUPPRESSION SYSTEMS

#### FIRE SUPPRESSION WATER SYSTEM

#### LIMITING CONDITION FOR OPERATION

---

3.7.11.1 The fire suppression water system shall be OPERABLE with:

- a. Three 50% capacity fire suppression pumps, each with a capacity of 1500 gpm  $\pm$  10%, with their discharge aligned to the fire suppression header,
- b. Two separate water supply tanks, each with a minimum contained volume of 300,000 gallons (23 feet 1.5 inches), and
- c. An OPERABLE flow path capable of taking suction from the T01-A tank and the T01-B tank and transferring the water through distribution piping with OPERABLE sectionalizing control or isolation valves to the yard hydrant curb valves, the last valve ahead of the water flow alarm device on each sprinkler or hose standpipe, and the last valve ahead of the deluge valve on each deluge or spray system required to be OPERABLE per Specifications 3.7.11.2, 3.7.11.5, and 3.7.11.6.

APPLICABILITY: At all times.

#### ACTION:

- a. With one pump and/or one water supply inoperable, restore the inoperable equipment to OPERABLE status within 7 days or provide an alternate backup pump or supply. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.
- b. With the fire suppression water system otherwise inoperable, establish a backup fire suppression water system within 24 hours.

#### SURVEILLANCE REQUIREMENTS

---

4.7.11.1.1 The fire suppression water system shall be demonstrated OPERABLE:

- a. At least once per 7 days by verifying the contained water supply volume.
- b. At least once per 31 days by starting the electric motor-driven pump and operating it for at least 15 minutes on recirculation flow.
- c. At least once per 31 days by verifying that each valve (manual, power-operated, or automatic) in the flow path is in its correct position, when required to be operable.



## PLANT SYSTEMS

### SURVEILLANCE REQUIREMENTS (Continued)

- d. At least once per 6 months by performance of a system flush.
  - e. At least once per 12 months by cycling each testable valve in the flow path through at least one complete cycle of full travel.
  - f. At least once per 18 months by performing a system functional test which includes simulated automatic actuation of the system throughout its operating sequence, and:
    - 1. Verifying that each pump develops 1500 gpm  $\pm$  10% at a system head of 125 psig by recording readings for at least 3 points on the test curve,
    - 2. Cycling each valve in the flow path that is not testable during plant operation through at least one complete cycle of full travel, and
    - 3. Verifying that each fire suppression pump starts sequentially to maintain the fire suppression water system pressure greater than or equal to 85 psig.
  - g. At least once per 3 years by performing a flow test of the system in accordance with Chapter 5, Section 11 of the Fire Protection Handbook, 14th Edition, published by the National Fire Protection Association.
- 4.7.11.1.2 The fire pump diesel engines shall be demonstrated OPERABLE:
- a. At least once per 31 days on a STAGGERED TEST BASIS by verifying:
    - 1. The diesel fuel oil day storage tanks each contain at least 315 gallons of fuel, and
    - 2. The diesel engines start from ambient conditions and operate for at least 30 minutes on recirculation flow.
  - b. At least once per 92 days by verifying that a sample of diesel fuel from the fuel storage tank, obtained in accordance with ASTM-D270-75, is within the acceptable limits specified in Table 1 of ASTM D975-77 when checked for viscosity, water, and sediment.
  - c. At least once per 18 months during shutdown, by subjecting the diesels to an inspection in accordance with procedures prepared in conjunction with its manufacturer's recommendations for the class of service.
- 4.7.11.1.3 Each fire pump diesel starting 24-volt battery bank and charger shall be demonstrated OPERABLE:

FINAL DRAFT

PLANT SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

---

- a. At least once per 7 days by verifying that:
  - 1. The electrolyte level of each battery is above the plates, and
  - 2. The overall battery voltage is greater than or equal to 24 volts.
- b. At least once per 92 days by verifying that the specific gravity is appropriate for continued service of the battery.
- c. At least once per 18 months by verifying that:
  - 1. The batteries, cell plates, and battery racks show no visual indication of physical damage or abnormal deterioration, and
  - 2. The battery-to-battery and terminal connections are clean, tight, free of corrosion, and coated with anticorrosion material.

PLANT SYSTEMS

SPRAY AND/OR SPRINKLER SYSTEMS

LIMITING CONDITION FOR OPERATION

---

3.7.11.2 The spray and/or sprinkler systems, listed in Table 3.7-3, shall be OPERABLE.

APPLICABILITY: Whenever equipment protected by the spray/sprinkler system is required to be OPERABLE.

ACTION:

- a. With one or more of the above required spray and/or sprinkler systems inoperable, within 1 hour establish a continuous fire watch with backup fire suppression equipment for those areas in which redundant systems or components could be damaged; for other areas, establish an hourly fire watch patrol.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

---

4.7.11.2 Each of the above required spray and/or sprinkler systems shall be demonstrated OPERABLE:

- a. At least once per 31 days by verifying that each valve (manual, power-operated, or automatic) in the flow path is in its correct position.
- b. At least once per 12 months by cycling each testable valve in the flow path through at least one complete cycle of full travel.
- c. At least once per 18 months:
  1. By performing a system functional test which includes simulated automatic actuation of the system, and:
    - a) Verifying that the automatic valves in the flow path actuate to their correct positions on a thermal/smoke test signal, and
    - b) Cycling each valve in the flow path that is not testable during plant operation through at least one complete cycle of full travel.





**FINAL DRAFT**

PLANT SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

---

2. By a visual inspection of the dry pipe spray and sprinkler headers to verify their integrity, and
  3. By a visual inspection of each nozzle's spray area to verify the spray pattern is not obstructed.
- d. At least once per 3 years by performing an air flow test through each open head spray/sprinkler header and verifying each open head spray/sprinkler nozzle is unobstructed.

TABLE 3.7-3

## SPRAY AND/OR SPRINKLER SYSTEMS

1. Lower Cable Spreading Room Zone 14 - Control Building 120 ft Elevation

- a. System 1.
- b. System 2.
- c. System 3.
- d. System 4.
- e. System 5.
- f. System 6.

2. Upper Cable Spreading Room Zone 20 - Control Building 160 ft Elevation

3. Diesel Generator Room, Train A, Zone 21A Diesel Generator Building 100 ft Elevation

4. Diesel Generator Room, Train B, Zone 21B Diesel Generator Building 100 ft Elevation

5. Fuel Oil Day Tank Vault, Train A, Zone 23A Diesel Generator Building 131 ft Elevation

6. Fuel Oil Day Tank Vault, Train B, Zone 23B Diesel Generator Building 131 ft Elevation

7. Low Pressure Safety Injection Pump Room, Train B, Zone 32A Auxiliary Building 40 ft & 51 ft 6 inch Elevation

8. Electrical Penetration Room, Train A (Channel C) Zone 42A - Auxiliary Building 100 ft Elevation

9. Electrical Penetration Room, Train B (Channel B) Zone 42B - Auxiliary Building 100 ft Elevation

10. Charging Pumps A, B and E Zones 46A, 46B AND 46C Corridors, Zone 42C - Auxiliary Building 100 ft Elevation

11. Corridors, Zone 42D - Auxiliary Building 100 ft Elevation

12. Electrical Penetration Room, Train A (Channel A) Zone 47A - Auxiliary Building 120 ft Elevation

13. Electrical Penetration Room, Train B (Channel D) Zone 47B - Auxiliary Building 120 ft Elevation

14. Central Corridors, Zone 52A - Auxiliary Building 120 ft Elevation

15. Central Corridors, Zone 52D - Auxiliary Building 120 ft Elevation

16. Turbine-Driven Auxiliary Feed Pump Room Zone 72 - Main Steam Support Structure 81 FT ELEVATION

17. Compartments between Auxiliary & Control Buildings, between 74 ft & 156 ft 4 inch Elevation on Train A, Zone 86A.

18. Compartments between Auxiliary & Control Buildings, between 74 ft & 156 ft 4 inch Elevation on Train B, Zone 86B.

19. Main Steam Support Structure 100 ft through 140 ft Elevation.

TRAIN A

ZONE 74 A

Pg 3/4 7-34A

INSERT 1

- a. System 1
- b. System 2
- c. System 3
- d. System 4
- e. System 5

INSERT 2

- 8. LOW PRESSURE SAFETY INJECTION  
PUMP ROOM, TRAIN B; ZONE 32 B  
AUXILIARY BUILDING 40 FT. AND  
51 FT 6 IN. ELEVATION

FINAL DRAFT

PLANT SYSTEMS

CO<sub>2</sub> SYSTEMS

LIMITING CONDITION FOR OPERATION

3.7.11.3 The following low pressure CO<sub>2</sub> systems shall be OPERABLE.

- a. ESF Switchgear Room; one Train A, one Train B Zone 5A<sup>AND 5B</sup>Control Building 100 ft Elevation
- b. Battery Rooms; one Train A (Channel C) one Train B (Channel D) Zone 8A<sup>AND 8B</sup>Control Building 100 ft Elevation
- c. Battery Rooms; one Train A (Channel A) one Train B (Channel B) Zone 9A<sup>AND 9B</sup>Control Building 100 ft Elevation

APPLICABILITY: Whenever equipment protected by the CO<sub>2</sub> system is required to be OPERABLE.

ACTION:

- a. With one or more of the above required CO<sub>2</sub> systems inoperable, within 1 hour establish a continuous fire watch with backup fire suppression equipment for those areas in which redundant systems or components could be damaged; for other areas, establish an hourly fire watch patrol.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

4.7.11.3.1 Each of the above required CO<sub>2</sub> systems shall be demonstrated OPERABLE at least once per 31 days by verifying that each valve (manual, power operated, or automatic) in the flow path is in its correct position.

4.7.11.3.2 Each of the above required low pressure CO<sub>2</sub> systems shall be demonstrated OPERABLE:

- a. At least once per 7 days by verifying the CO<sub>2</sub> storage tank weight to be greater than 10000 lb and pressure to be greater than 275 psig, and

FINAL DRAFT

PLANT SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

- b. At least once per 18 months by verifying:
1. The system, including associated ventilation dampers, actuates manually and automatically, upon receipt of a simulated actuation signal, and
  2. ~~Flow from each nozzle~~ By visual inspection to verify that there are no obstructions in the discharge path of the nozzles or during a "Puff Test."

## PLANT SYSTEMS

### FIRE HOSE STATIONS

#### LIMITING CONDITION FOR OPERATION

---

3.7.11.4 The fire hose stations shown in Table 3.7-4 shall be OPERABLE.

**APPLICABILITY:** Whenever equipment in the areas protected by the fire hose stations is required to be OPERABLE, except that fire hose stations located in containment shall have their containment isolation valves closed in MODES 1, 2, 3, 4\*, and 5\*.

#### ACTION:

- a. With one or more of the fire hose stations shown in Table 3.7-4 inoperable, provide a gated wye on the nearest OPERABLE hose station. One outlet of the wye shall be connected to the standard length of hose provided for the OPERABLE hose station. The second outlet of the wye shall be connected to a length of hose sufficient to provide coverage for the area left unprotected by the inoperable hose station. The above action shall be accomplished within one hour if the inoperable fire hose is the primary means of fire suppression; otherwise provide the additional hose in 24 hours.

The hose for the unprotected area shall be stored at the OPERABLE hose station. Signs identifying the purpose and location of the fire hose and related valves shall be mounted above the hose and at the inoperable hose station.

- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

---

4.7.11.4 Each of the fire hose stations shown in Table 3.7-4 shall be demonstrated OPERABLE:

- a. At least once per 31 days by visual inspection of the stations accessible during plant operation to assure all required equipment is at the station.
- b. At least once per 18 months by:
  1. Visual inspection of the stations not accessible during plant operations to assure all required equipment is at the station.
  2. Removing the hose for inspection and reracking, and
  3. Inspecting all gaskets and replacing any degraded gaskets in the couplings.

---

\*If maintenance is to be performed in containment during MODE 4 or 5, the fire hose stations located in containment shall have their containment isolation valves open during the period the maintenance is being performed.

FINAL DRAFT

PLANT SYSTEMS

SURVEILLANCE REQUIREMENTS (Continued)

---

- c. At least once per 3 years by:
  - 1. Partially opening each hose station valve to verify valve OPERABILITY and no flow blockage.
  - 2. Conducting a hose hydrostatic test at a pressure of 150 psig or at least 50 psig above maximum fire main operating pressure, whichever is greater.

TABLE 3.7-4  
FIRE HOSE STATIONS

<u>LOCATION</u>	<u>ELEVATION</u>	<u>HOSE RACK IDENTIFICATION</u>
Containment NE	80'	HS #01
Containment SE	80'	HS #02
Containment SW	80'	HS #03
Containment NW	80'	HS #04
Containment NE	100'	HS #05
Containment SE	100'	HS #06
Containment SW	100'	HS #07
Containment NW	100'	HS #08
Containment NE	120'	HS #09
Containment SE	120'	HS #10
Containment SW	120'	HS #11
Containment NW	120'	HS #12
Containment <del>SE</del> NE	140'	HS #13
Containment SW	140'	HS #14
Auxiliary Bldg. North Corridor - W	40'	HS #17
Auxiliary Bldg. North Corridor - E	40'	HS #18
Auxiliary Bldg. North Corridor - W	51'6"	HS #21
Auxiliary Bldg. North Corridor - E	51'6"	HS #22
Auxiliary Bldg. SE	70'	HS #23
Auxiliary Bldg. SW	70'	HS #24
Auxiliary Bldg. NW	70'	HS #25
Auxiliary Bldg. North Center Corridor	70'	HS #26
Auxiliary Bldg. NE	70'	HS #27
Auxiliary Bldg. NW	88'	HS #30
Auxiliary Bldg. NE	88'	HS #31
Auxiliary Bldg. SW	100'	HS #33
Auxiliary Bldg. East Corridor	120'	HS #37
Auxiliary Bldg. SW	120'	HS #38
Control Bldg. SW	74'	HS #86
Control Bldg. E	74'	HS #87
Control Bldg. SW	100'	HS #88
Control Bldg. East by Elevator	100'	HS #89
Control Bldg. SW	120'	HS #90
Control Bldg. SW	140'	HS #92
Control Bldg. SW	160'	HS #94
Control Bldg. SE	100'	HS #108
Fuel Bldg. South	100'	HS #97



## PLANT SYSTEMS

### YARD FIRE HYDRANTS AND HYDRANT HOSE HOUSES

#### LIMITING CONDITION FOR OPERATION

---

3.7.11.5 The yard fire hydrants and associated hydrant hose houses shown in Table 3.7-5 shall be OPERABLE.

APPLICABILITY: Whenever equipment in the areas protected by the yard fire hydrants is required to be OPERABLE.

#### ACTION:

- a. With one or more of the yard fire hydrants or associated hydrant hose houses shown in Table 3.7-5 inoperable, within 1 hour have sufficient additional lengths of 2-1/2 inch diameter hose located in an adjacent OPERABLE hydrant hose house to provide service to the unprotected area(s) if the inoperable fire hydrant or associated hydrant hose house is the primary means of fire suppression; otherwise, provide the additional hose within 24 hours.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

---

4.7.11.5 Each of the yard fire hydrants and associated hydrant hose houses shown in Table 3.7-5 shall be demonstrated OPERABLE:

- a. At least once per 31 days by visual inspection of the hydrant hose house to assure all required equipment is at the hose house.
- b. At least once per 6 months by visually inspecting each yard fire hydrant for damage.
- c. At least once per 12 months by:
  1. Conducting a hose hydrostatic test at a pressure of 150 psig or at least 50 psig above maximum fire main operating pressure, whichever is greater.
  2. Inspecting all the gaskets and replacing any degraded gaskets in the couplings.
  3. Performing a flow check of each hydrant to verify its OPERABILITY.



FINAL DRAFT

TABLE 3.7-5

YARD FIRE HYDRANTS AND ASSOCIATED HYDRANT HOSE HOUSES

<u>LOCATION</u>	<u>HYDRANT NUMBER</u>
150' Plant North of Fuel Bldg.	F. H. #7
100' Plant West of Rad Waste Bldg.	F. H. #9
150' Plant Northwest of Fuel Bldg.	F. H. #8 *

\*NO HOSE HOUSE HOWEVER THE HOSE STATION  
IS USED TO SERVICISE CONDENSATE TRANSFER  
PUMP

NEW TECH SPEC REQUIRED  
BECHUSE OF DCP FP-124.

## PLANT SYSTEMS

## HALON SYSTEMS

### LIMITING CONDITION FOR OPERATION

3.7.11.6 The following Halon systems shall be OPERABLE.

- a. Train A Remote Shutdown Panel Room, Zone 10A - Control Building 100 ft. Elevation
- b. Train B Remote Shutdown Panel Room, Zone 10B - Control Building 100 ft. Elevation

APPLICABILITY: Whenever equipment protected by the Halon system is required to be OPERABLE.

### ACTION:

- a. With one or more of the above required Halon systems inoperable, within 1 hour establish a continuous fire watch with backup fire suppression equipment for those areas in which redundant systems or components could be damaged; for other areas, establish an hourly fire watch patrol.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

### SURVEILLANCE REQUIREMENTS

4.7.11.6 Each of the above required Halon systems shall be demonstrated OPERABLE:

- a. At least once per 31 days by verifying that each valve (manual, power-operated, or automatic) in the flow path is in its correct position.
- b. At least once per 6 months by verifying Halon storage tank weight to be at least 95% of full charge weight and pressure to be at least 90% of full charge pressure.
- c. At least once per 18 months by:
  1. Verifying the system, including associated ventilation dampers and fire door release mechanisms, actuates manually and automatically, upon receipt of a simulated test signal, and
  2. Performance of a flow test through headers and nozzles to assure no blockage.

## PLANT SYSTEMS

### 3/4.7.12 FIRE-RATED ASSEMBLIES

#### LIMITING CONDITION FOR OPERATION

---

3.7.12 All fire-rated assemblies (walls, floor/ceilings, cable tray enclosures, and other fire barriers) separating safety-related fire areas or separating portions of redundant systems important to safe shutdown within a fire area and all sealing devices in fire-rated assembly penetrations (fire doors, fire dampers, cable, piping and ventilation duct penetration seals) shall be OPERABLE.

APPLICABILITY: When the equipment in an affected area is required to be OPERABLE.

#### ACTION:

- a. With one or more of the above required fire-rated assemblies (including sealing devices) inoperable, within 1 hour either establish a continuous fire watch on at least one side of the affected assembly, or verify the OPERABILITY of the fire detectors on at least one side of the inoperable assembly and establish an hourly fire watch patrol.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

---

4.7.12.1 At least once per 18 months the above required fire-rated assemblies and penetration sealing devices shall be verified OPERABLE by:

- a. Performing a visual inspection of the exposed surfaces of each fire rated assembly.
- b. Performing a visual inspection of each fire damper and associated hardware.
- c. Performing a visual inspection of at least 10% of each type of sealed penetration. If apparent changes in appearance or abnormal degradations are found, a visual inspection of an additional 10% of each type of sealed penetration shall be made. This inspection process shall continue until a 10% sample with no apparent changes in appearance or abnormal degradation is found. Samples shall be selected such that each penetration seal will be inspected every 15 years.
- d. Performing a functional test of at least 10% of the fire dampers that are installed in fire barriers separating redundant trains important to safe shutdown. If any dampers fail to operate correctly, an additional 10% of the dampers shall be sampled. This process shall continue until a 10% sample is verified OPERABLE. Samples shall be selected such that each damper will be inspected every 15 years.

PLANT SYSTEMS

FINAL DRAFT

SURVEILLANCE REQUIREMENTS (Continued)

---

4.7.12.2 Each of the above required fire doors shall be verified OPERABLE by inspecting the automatic hold-open, release and closing mechanism and latches at least once per 6 months, and by verifying:

- a. That each locked-closed fire door is closed at least once per 7 days.
- b. That doors with automatic hold-open and release mechanisms are free of obstructions at least once per 24 hours.
- c. Performing a functional test at least once per 18 months.
- d. That each unlocked fire door without electrical supervision is closed at least once per 24 hours.

## PLANT SYSTEMS

### 3/4.7.13 SHUTDOWN COOLING SYSTEM

#### LIMITING CONDITION FOR OPERATION

---

3.7.13 Two independent shutdown cooling subsystems shall be OPERABLE, with each subsystem comprised of:

- a. One OPERABLE low pressure safety injection pump, and
- b. An independent OPERABLE flow path capable of taking suction from the RCS hot leg and discharging coolant through the shutdown cooling heat exchanger and back to the RCS through the cold leg injection lines.

APPLICABILITY: MODES 1, 2, and 3.

#### ACTION:

- a. With one shutdown cooling subsystem inoperable, restore the inoperable subsystem to OPERABLE status within 72 hours or be in at least HOT STANDBY within 1 hour, be in at least HOT SHUTDOWN within the next 6 hours and be in COLD SHUTDOWN within the next 30 hours and continue action to restore the required subsystem to OPERABLE status.
- b. With both shutdown cooling subsystems inoperable, restore one subsystem to OPERABLE status within 1 hour or be in at least HOT STANDBY within 1 hour and be in HOT SHUTDOWN within the next 6 hours and continue action to restore the required subsystems to OPERABLE status.
- c. With both shutdown cooling subsystems inoperable and both reactor coolant loops inoperable, initiate action to restore the required subsystems to OPERABLE status.

#### SURVEILLANCE REQUIREMENTS

---

4.7.13 Each shutdown cooling sybsystem shall be demonstrated OPERABLE:

Subsystem

- a. At least once per 18 months, during shutdown, by establishing shutdown cooling flow from the RCS hot legs, through the shutdown cooling heat exchangers, and returning to the RCS cold legs.
- b. At least once per 18 months, during shutdown, by testing the automatic and interlock action of the shutdown cooling system connections from the RCS. The shutdown cooling system suction valves shall not open when RCS pressure is greater than 410 psia. The shutdown cooling system suction valves located outside containment shall close automatically when RCS pressure is greater than 500 psia. The shutdown cooling system suction valve located inside containment shall close automatically when RCS pressure is greater than 700 psia.

FINAL DRAFT

PLANT SYSTEMS

3/4.7.14 CONTROL ROOM AIR TEMPERATURE

LIMITING CONDITION OF OPERATION

---

3.7.14 The control room air temperature shall be maintained less than or equal to 80°F.

APPLICABILITY: ALL MODES

ACTION:

With the control room air temperature greater than 80°F, reduce the air temperature to less than or equal to 80°F within 30 days or be in HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

SURVEILLANCE REQUIREMENTS

---

4.7.14 At least once per 12 hours, verify that the control room air temperature is less than or equal to 80°F.



## 3/4.8 ELECTRICAL POWER SYSTEMS

### 3/4.8.1 A.C. SOURCES

#### OPERATING

#### LIMITING CONDITION FOR OPERATION

3.8.1.1 As a minimum, the following A.C. electrical power sources shall be OPERABLE:

- a. Two physically independent circuits from the offsite transmission network to the switchyard and two physically independent circuits from the switchyard to the onsite Class 1E distribution system, and
- b. Two separate and independent diesel generators, each with:
  1. Separate day fuel tank with a minimum level of 2.75 feet (550 gallons of fuel), and
  2. A separate fuel storage system with a minimum level of 80% (71,500 gallons of fuel), and
  3. A separate fuel transfer pump.

APPLICABILITY: MODES 1, 2, 3, and 4.

#### ACTION:

- a. With either an offsite circuit or diesel generator of the above required A.C. electrical power sources inoperable, demonstrate the OPERABILITY of the remaining A.C. sources by performing Surveillance Requirements 4.8.1.1.1a. and 4.8.1.1.2a.4 within 1 hour and at least once per 8 hours thereafter; restore at least two offsite circuits and two diesel generators to OPERABLE status within 72 hours or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- b. With one offsite circuit and one diesel generator of the above required A.C. electrical power sources inoperable, demonstrate the OPERABILITY of the remaining A.C. sources by performing Surveillance Requirements 4.8.1.1.1a. and 4.8.1.1.2a.4. within 1 hour and at least once per 8 hours thereafter; restore at least one of the inoperable sources to OPERABLE status within 12 hours or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours. Restore at least two offsite circuits and two diesel generators to OPERABLE status within 72 hours from the time of initial loss or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- c. With one diesel generator inoperable in addition to ACTION a. or b. above, verify that:
  1. All required systems, subsystems, trains, components, and devices that depend on the remaining OPERABLE diesel generator as a source of emergency power are also OPERABLE, and
  2. When in MODE 1, 2, 3, or 4\*, the steam-driven auxiliary feed pump is OPERABLE.

If these conditions are not satisfied within 2 hours, be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

\*Until the steam generator is no longer required for heat removal.

## ELECTRICAL POWER SYSTEMS

### LIMITING CONDITION FOR OPERATION (Continued)

#### ACTION (Continued)

- d. With two of the above required offsite A.C. circuits inoperable, demonstrate the OPERABILITY of two diesel generators by performing Surveillance Requirement 4.8.1.1.2a.4. within 1 hour and at least once per 8 hours thereafter, unless the diesel generators are already operating; restore at least one of the inoperable offsite sources to OPERABLE status within 24 hours or be in at least HOT STANDBY within the next 6 hours. With only one offsite source restored, restore at least two offsite circuits to OPERABLE status within 72 hours from time of initial loss or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- e. With two of the above required diesel generators inoperable, demonstrate the OPERABILITY of two offsite A.C. circuits by performing Surveillance Requirement 4.8.1.1.1a. within 1 hour and at least once per 8 hours thereafter; restore at least one of the inoperable diesel generators to OPERABLE status within 2 hours or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours. Restore at least two diesel generators to OPERABLE status within 72 hours from time of initial loss or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

#### SURVEILLANCE REQUIREMENTS

4.8.1.1.1 Each of the above required independent circuits between the offsite transmission network and the onsite Class 1E distribution system shall be:

- a. Determined OPERABLE at least once per 7 days by verifying correct breaker alignments, indicated power availability, and
- b. Demonstrated OPERABLE at least once per 18 months during shutdown by transferring (manually) unit power supply from the normal circuit to the alternate circuit.

4.8.1.1.2 Each diesel generator shall be demonstrated OPERABLE:

- a. In accordance with the frequency specified in Table 4.8-1 on a STAGGERED TEST BASIS by:
  - 1. Verifying the fuel level in the day tank,
  - 2. Verifying the fuel level in the fuel storage tank,
  - 3. Verifying the fuel transfer pump can be started and transfers fuel from the storage system to the day tank,

## ELECTRICAL POWER SYSTEM

### SURVEILLANCE REQUIREMENTS (Continued)

4. Verifying the diesel starts from ambient condition and accelerates to at least 600 rpm in less than or equal to 10 seconds. The generator voltage and frequency shall be  $4160 \pm 420$  volts and  $60 \pm 1.2$  Hz within 10 seconds after the start signal. The diesel generator shall be started for this test by using one of the following signals:
  - a) Manual.
  - b) Simulated loss-of-offsite power by itself.
  - c) Simulated loss-of-offsite power in conjunction with an ESF actuation test signal.
  - d) An ESF actuation test signal by itself.
5. Verifying the generator is synchronized, loaded to greater than or equal to 5500 kW in less than or equal to 120 seconds, and operates with a load greater than or equal to 5500 kW for at least an additional 60 minutes, and
6. Verifying the diesel generator is aligned to provide standby power to the associated emergency busses.
- b. At least once per 31 days and after each operation of the diesel where the period of operation was greater than or equal to 1 hour by checking for and removing accumulated water from the day tanks.
- c. At least once per 92 days and from new fuel prior to its addition to the storage tanks by verifying that a sample obtained in accordance with ASTM-D270-1975 meets the following minimum requirements in accordance with the tests specified in ASTM-D975-1977:
  1. A water and sediment content of less than or equal to 0.05 volume percent;
  2. A kinematic viscosity at 40°C of greater than or equal to 1.9 centistokes, but less than or equal to 4.1 centistokes;
  3. A specific gravity as specified by the manufacturer at 60°F of greater than or equal to 0.80 but less than or equal to 0.99 or an API gravity at 60°F of greater than or equal to 11 degrees but less than or equal to 47 degrees;
  4. An impurity level of less than 2 mg of insolubles per 100 mL when tested in accordance with ASTM-D2274-70; analysis shall be completed within 7 days after obtaining the sample but may be performed after the addition of new fuel oil; and

**ELECTRICAL POWER SYSTEM****SURVEILLANCE REQUIREMENTS (Continued)**

5. The other properties specified in Table 1 of ASTM-D975-1977 and Regulatory Guide 1.137, Revision 1, October 1979, Position 2.a., when tested in accordance with ASTM-D975-1977; analysis shall be completed within 14 days after obtaining the sample but may be performed after the addition of new fuel oil.
- d. At least once per 18 months during shutdown by:
  1. Subjecting the diesel to an inspection in accordance with procedures prepared in conjunction with its manufacturer's recommendations for this class of standby service.
  2. Verifying the generator capability to reject a single largest load of greater than or equal to 839 kW (Train B AFW pump) or 696 kW (Train A HPSI pump) while maintaining voltage at  $4160 \pm 420$  volts and frequency at  $60 \pm 1.2$  Hz.
  3. Verifying the generator capability to reject a load of 5500 kW without tripping. The generator voltage shall not exceed 6240 volts during and following the load rejection.
  4. Simulating a loss-of-offsite power by itself, and:
    - a) Verifying deenergization of the emergency busses and load shedding from the emergency busses.
    - b) Verifying the diesel starts on the auto-start signal, energizes the emergency busses with permanently connected loads within 10 seconds, energizes the auto-connected shutdown loads through the load sequencer and operates for greater than or equal to 5 minutes while its generator is loaded with the shutdown loads. After energization, the steady state voltage and frequency of the emergency busses shall be maintained at  $4160 \pm 420$  volts and  $60 \pm 1.2$  Hz during this test.
  5. Verifying that on an ESF actuation test signal (without loss-of-offsite power) the diesel generator starts on the auto-start signal and operates on standby for greater than or equal to 5 minutes. The steady-state generator voltage and frequency shall be  $4160 \pm 420$  volts and  $60 \pm 1.2$  Hz within 10 seconds after the auto-start signal; the generator voltage and frequency shall be maintained within these limits during this test.
  6. Simulating a loss-of-offsite power in conjunction with an ESF actuation test signal, and.

FINAL DRAFT

ELECTRICAL POWER SYSTEM

SURVEILLANCE REQUIREMENTS (Continued)

- 60 ± 1.2 / - 0.3 Hz
- a) Verifying deenergization of the emergency busses and load shedding from the emergency busses.
  - b) Verifying the diesel starts on the auto-start signal, energizes the emergency busses with permanently connected loads within 10 seconds, energizes the auto-connected emergency (accident) loads through the load sequencer and operates for greater than or equal to 5 minutes while its generator is loaded with the emergency loads. After energization, the steady-state voltage and frequency of the emergency busses shall be maintained at 4160 ± 420 volts and ~~60 ± 1.2 Hz~~ during this test.
  - c) Verifying that all automatic diesel generator trips, except engine overspeed, generator differential, and low lube oil pressure, are automatically bypassed upon loss of voltage on the emergency bus, upon a safety injection actuation signal <sup>OR</sup> upon AFAS. <sup>covered by loss of voltage</sup> [or upon loss of offsite power.]
7. Verifying the diesel generator operates for at least 24 hours. During the first 2 hours of this test, the diesel generator shall be loaded to greater than or equal to 6050 kW and during the remaining 22 hours of this test, the diesel generator shall be loaded to greater than or equal to 5500 kW. The generator voltage and frequency shall be 4160 ± 420 volts and 60 ± 1.2 Hz within 10 seconds after the start signal; the steady-state generator voltage and frequency shall be maintained within these limits during this test. Within 5 minutes after completing this 24 hour test, perform Surveillance Requirement 4.8.1.1.2d.6.b.
8. Verifying that the auto-connected loads to each diesel generator do not exceed the continuous rating of 5500 kW.
9. Verifying the diesel generator's capability to:
- a) Synchronize with the offsite power source while the generator is loaded with its emergency loads upon a simulated restoration of offsite power, .
  - b) Transfer its loads to the offsite power source, and
  - c) Be restored to its standby (not running) status.
10. Verifying that with the diesel generator operating in a test mode (connected to its bus), a simulated safety injection signal overrides the test mode by (1) returning the diesel generator to standby operation (running unloaded) and (2) automatically energizes the emergency loads with offsite power.

## ELECTRICAL POWER SYSTEMS

### SURVEILLANCE REQUIREMENTS (Continued)

11. Verifying that the fuel transfer pump transfers fuel from each fuel storage tank to the day tank of each diesel via the installed cross connection lines.
12. Verifying that the automatic load sequence timer is OPERABLE with the interval between each load block within  $\pm 1$  second of its design interval.
13. Verifying that the following diesel generator lockout features prevent diesel generator starting only when required:
  - a) (turning gear engaged)
  - b) (emergency stop)
- e. At least once per 10 years or after any modifications which could affect diesel generator interdependence by starting the diesel generators simultaneously, during shutdown, and verifying that the diesel generators accelerate to at least 600 rpm (steady-state generator voltage and frequency of  $4160 \pm 420$  volts and  $60 \pm 1.2$  Hz) in less than or equal to 10 seconds.
- f. At least once per 10 years by:
  1. Draining each fuel oil storage tank, removing the accumulated sediment and cleaning the tank using a sodium hypochlorite solution or the equivalent, and
  2. Performing a pressure test of those portions of the diesel fuel oil system designed to Section III, subsection ND of the ASME Code at a test pressure equal to 110% of the system design pressure.

4.8.1.1.3 Reports - All diesel generator failures, valid or nonvalid, shall be reported to the Commission within 30 days in a Special Report pursuant to Specification 6.9.2. Reports of diesel generator failures shall include the information recommended in Regulatory Position C.3.b of Regulatory Guide 1.108, Revision 1, August 1977. If the number of failures in the last 100 valid tests (on a per nuclear unit basis) is greater than or equal to 7, the report shall be supplemented to include the additional information recommended in Regulatory Position C.3.b of Regulatory Guide 1.108, Revision 1, August 1977.

4.8.1.1.4 Verify that the cathodic protection system is OPERABLE at the following time intervals:

1. Verify at least once per 92 days that the cathodic protection rectifiers are OPERABLE and have been inspected in accordance with Regulatory Guide 1.137.
2. Verify at least once per 18 months that the cathodic protection is OPERABLE and providing adequate protection against corrosion in accordance with Regulatory Guide 1.137.

If any other metallic structures (e.g., buildings, new or modified piping systems, conduit) are placed in the ground in the vicinity of the fuel oil storage system or if the original system is modified, the adequacy and frequency of inspections of the cathodic protection system shall be re-evaluated and adjusted in accordance with Regulatory Guide 1.137.

TABLE 4.3-1  
DIESEL GENERATOR TEST SCHEDULE

Number of Failures In  
Last 100 Valid Tests.\*

Test Frequency

$\leq 1$	At least once per 31 days
2	At least once per 14 days
3	At least once per 7 days
$\geq 4$	At least once per 3 days

\*Criteria for determining number of failures and number of valid tests shall be in accordance with Regulatory Position C.2.e of Regulatory Guide 1.108, Revision 1, August 1977, where the last 100 tests are determined on a per nuclear unit basis. For the purposes of this test schedule, only valid tests conducted after the Operating License issuance date shall be included in the computation of the "last 100 valid tests". Entry into this test schedule shall be made at the 31 day test frequency.





**FINAL DRAFT**

## ELECTRICAL POWER SYSTEMS

### A.C. SOURCES

#### SHUTDOWN

### LIMITING CONDITION FOR OPERATION

---

3.8.1.2 As a minimum, the following A.C. electrical power sources shall be OPERABLE:

- a. One circuit between the offsite transmission network and the onsite Class 1E distribution system, and
- b. One diesel generator with:
  1. Day tank with a minimum level of 2.75 feet (550 gallons of fuel),
  2. A fuel storage system with a minimum level of 80% (71,500 gallons of fuel), and
  3. A fuel transfer pump.

APPLICABILITY: MODES 5 and 6.

#### ACTION:

With less than the above minimum required A.C. electrical power sources OPERABLE, immediately suspend all operations involving CORE ALTERATIONS, positive reactivity changes, movement of irradiated fuel, or crane operation with loads over the fuel storage pool. In addition, when in MODE 5 with the reactor coolant loops not filled, or in MODE 6 with the water level less than 23 feet above the reactor vessel flange, immediately initiate corrective action to restore the required sources to OPERABLE status as soon as possible.

### SURVEILLANCE REQUIREMENTS

---

4.8.1.2 The above required A.C. electrical power sources shall be demonstrated OPERABLE by the performance of each of the Surveillance Requirements of 4.8.1.1.1, 4.8.1.1.2 (except for Requirement 4.8.1.1.2a.5.) and 4.8.1.1.3.

1A /  
FINAL DRAFT

## ELECTRICAL POWER SYSTEMS

### 3/4.8.2 D.C. SOURCES

#### OPERATING

#### LIMITING CONDITION FOR OPERATION

---

3.8.2.1 As a minimum the D.C. trains listed in Table 3.8-1 shall be OPERABLE and energized.

APPLICABILITY: MODES 1, 2, 3, and 4.

#### ACTION:

- a. With one of the required D.C. trains inoperable, restore the inoperable D.C. trains to OPERABLE status within 2 hours or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- b. With one of the required chargers inoperable, either provide charging capability to the affected channel with the associated backup battery charger, or demonstrate the OPERABILITY of its associated battery bank by performing Surveillance Requirement 4.8.2.1a.1. within 1 hour, and at least once per 8 hours thereafter. If any Category A limit in Table 4.8-2 is not met, declare the battery inoperable.

#### SURVEILLANCE REQUIREMENTS

---

4.8.2.1 Each 125-volt battery bank and charger shall be demonstrated OPERABLE:

- a. At least once per 7 days by verifying that:
  1. The parameters in Table 4.8-2 meet the Category A limits, and
  2. The total battery terminal voltage is greater than or equal to 129 volts on float charge.

## ELECTRICAL POWER SYSTEMS

### SURVEILLANCE REQUIREMENTS (Continued)

---

- b. At least once per 92 days and within 7 days after a battery discharge with battery terminal voltage below 105 volts, or battery overcharge with battery terminal voltage above 145 volts, by verifying that:
  - 1. The parameters in Table 4.8-2 meet the Category B limits,
  - 2. There is no visible corrosion at either terminals or connectors, or the connection resistance of these items is less than  $150 \times 10^{-6}$  ohms, and
  - 3. The average electrolyte temperature of six connected cells is above 60°F.
- c. At least once per 18 months by verifying that:
  - 1. The cells, cell plates, and battery racks show no visual indication of physical damage or abnormal deterioration,
  - 2. The cell-to-cell and terminal connections are clean, tight, and coated with anticorrosion material,
  - 3. The resistance of each cell-to-cell and terminal connection is less than or equal to  $150 \times 10^{-6}$  ohms, and
  - 4. The battery charger will supply at least 400 amperes for batteries A and B and 300 amperes for batteries C and D at 125 volts for at least 8 hours.
- d. At least once per 18 months, during shutdown, by verifying that the battery capacity is adequate to supply and maintain in OPERABLE status all of the actual or simulated emergency loads for the design duty cycle when the battery is subjected to a battery service test.
- e. At least once per 60 months, during shutdown, by verifying that the battery capacity is at least 80% of the manufacturer's rating when subjected to a performance discharge test. This performance discharge test may be performed in lieu of the battery service test required by Surveillance Requirement 4.8.2.1d.
- f. Annual performance discharge tests of battery capacity shall be given to any battery that shows signs of degradation or has reached 85% of the service life expected for the application. Degradation is indicated when the battery capacity drops more than 10% of rated capacity from its average on previous performance tests, or is below 90% of the manufacturer's rating.

FINAL DRAFT

TABLE 3.8-1

D.C. ELECTRICAL SOURCES

Train A

CHANNEL A

125V bus E-PKA-M41

125V D.C. battery bank  
E-PKA-F11

Battery charger E-PKA-H11

or

Backup battery charger  
E-PKA-H15 (AC)

CHANNEL C

125V D.C. bus E-PKC-M43

125 V D.C. battery bank  
E-PKC-F13

Battery charger E-PKC-H13

or

Backup battery charger  
E-PKA-H15. (AC)

Train B

CHANNEL B

125V D.C. bus E-PKB-M42

125V D.C. battery bank  
E-PKB-F12

Battery charger E-PKB-H12

or

Backup battery charger  
E-PKB-H16 (BD)

CHANNEL D

125V D.C. bus E-PKD-M44

125V D.C. battery bank  
E-PKD-F14

Battery charger E-PKD-H14

or

Backup battery charger  
E-PKB-H16 (BD)



TABLE 4.8-2

BATTERY SURVEILLANCE REQUIREMENTS

Parameter	CATEGORY A <sup>(1)</sup>		CATEGORY B <sup>(2)</sup>
	Limits for each designated pilot cell	Limits for each connected cell	Allowable <sup>(3)</sup> value for each connected cell
Electrolyte Level	>Minimum level indication mark, and $\leq \frac{1}{4}$ " above maximum level indication mark	>Minimum level indication mark, and $\leq \frac{1}{4}$ " above maximum level indication mark	Above top of plates, and not overflowing
Float Voltage	$\geq 2.13$ volts	$\geq 2.13$ volts(a)	$> 2.07$ volts
Specific Gravity(b)		$\geq 1.195$	Not more than 0.020 below the average of all connected cells
	$\geq 1.200(c)$	Average of all connected cells $\geq 1.205$	Average of all connected cells $\geq 1.195(c)$

- (1) For any Category A parameter(s) outside the limit(s) shown, the battery may be considered OPERABLE provided that within 24 hours all the Category B measurements are taken and found to be within their allowable values, and provided all Category A and B parameter(s) are restored to within limits within the next 6 days.
- (2) For any Category B parameter(s) outside the limit(s) shown, the battery may be considered OPERABLE provided that the Category B parameters are within their allowable values and provided the Category B parameter(s) are restored to within limits within 7 days.
- (3) Any Category B parameter not within its allowable value, declare the battery inoperable.
  - (a) Corrected for average electrolyte temperature.
  - (b) Corrected for electrolyte temperature and level.
  - (c) Or battery charging current is less than 2 amps when on charge.

ELECTRICAL POWER SYSTEMS

D.C. SOURCES

SHUTDOWN

LIMITING CONDITION FOR OPERATION

---

3.8.2.2 As a minimum, one D.C. train as listed in Table 3.8-1 shall be OPERABLE and energized.

APPLICABILITY: MODES 5 and 6.

ACTION:

- a. With a required battery bank inoperable, immediately suspend all operations involving CORE ALTERATIONS, positive reactivity changes or movement of irradiated fuel; initiate corrective action to restore the required D.C. train to OPERABLE status as soon as possible.
- b. With a required charger inoperable, either provide charging capability to the affected channel with the associated backup battery charger, or demonstrate the OPERABILITY of its associated battery bank by performing Surveillance Requirement 4.8.2.1a.1. within 1 hour, and at least once per 8 hours thereafter. If any Category A limit in Table 4.8-2 is not met, declare the battery inoperable.

SURVEILLANCE REQUIREMENTS

---

4.8.2.2 The above required 125-volt battery banks and chargers shall be demonstrated OPERABLE per Surveillance Requirement 4.8.2.1.





## ELECTRICAL POWER SYSTEMS

### 3/4.8.3 ONSITE POWER DISTRIBUTION SYSTEMS

#### OPERATING

#### LIMITING CONDITION FOR OPERATION

3.8.3.1 The following electrical busses shall be energized in the specified manner with tie breakers open between redundant busses within the unit.

- a. Train "A" A.C. emergency busses consisting of:
  - 1. 4160-volt ESF Bus #E-PBA-S03
  - 2. 480-volt ESF Load Center #E-PGA-L31
    - a. MCC E-PHA-M31
  - 3. 480-volt ESF Load Center #E-PGA-L33
    - a. MCC E-PHA-M33
    - b. MCC E-PHA-M37
  - 4. 480-volt ESF Load Center #E-PGA-L35
    - a. MCC E-PHA-M35
- b. Train "B" A.C. emergency busses consisting of:
  - 1. 4160-volt ESF Bus #E-PBB-S04
  - 2. 480-volt ESF Load Center #E-PGB-L32
    - a. MCC E-PHB-M32
    - b. MCC E-PHB-M38
  - 3. 480-volt ESF Load Center #E-PGB-L34
    - a. MCC E-PHB-M34
  - 4. 480-volt ESF Load Center #E-PGB-L36
    - a. MCC E-PHB-M36
- c. 120-volt Channel A Vital A.C. Bus #E-PNA-D25 energized from its associated inverter connected to D.C. Channel A.\*
- d. 120-volt Channel B Vital A.C. Bus #E-PNB-D26 energized from its associated inverter connected to D.C. Channel B.\*
- e. 120-volt Channel C Vital A.C. Bus #E-PNC-D27 energized from its associated inverter connected to D.C. Channel C.\*
- f. 120-volt Channel D Vital A.C. Bus #E-PND-D28 energized from its associated inverter connected to D.C. Channel D.\*
- g. 125-volt D.C. Channel A energized from Battery Bank E-PKA-F11.
- h. 125-volt D.C. Channel B energized from Battery Bank E-PKB-F12.
- i. 125-volt D.C. Channel C energized from Battery Bank E-PKC-F13.
- j. 125-volt D.C. Channel D energized from Battery Bank E-PKD-F14.

\*Two inverters may be disconnected from their D.C. bus for up to 24 hours, as necessary, for the purpose of performing an equalizing charge on their associated battery bank provided (1) their vital busses are energized, and (2) the vital busses associated with the other battery bank are energized from their associated inverters and connected to their associated D.C. bus.

FINAL DRAFT

## ELECTRICAL POWER SYSTEMS

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

- a. With one of the required divisions of A.C. ESF busses not fully energized, reenergize the division within 8 hours or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- b. With one A.C. vital bus either not energized from its associated inverter, or with the inverter not connected to its associated D.C. bus: (1) reenergize the A.C. vital bus within 2 hours or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours and (2) reenergize the A.C. vital bus from its associated inverter connected to its associated D.C. bus within 24 hours or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.
- c. With one D.C. bus not energized from its associated battery bank, reenergize the D.C. bus from its associated battery bank within 2 hours or be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

## SURVEILLANCE REQUIREMENTS

4.8.3.1 The specified busses shall be determined energized in the required manner at least once per 7 days by verifying correct breaker alignment and indicated voltage on the busses.

FINAL DRAFT

ELECTRICAL POWER SYSTEMS

ONSITE POWER DISTRIBUTION SYSTEMS

SHUTDOWN

LIMITING CONDITION FOR OPERATION

---

3.8.3.2 As a minimum, the following electrical busses shall be energized in the specified manner:

- a. One train of A.C. emergency busses consisting of one 4160-volt A.C. ESF bus, and three 480-volt A.C. load centers and their associated four class 1E-MCCs.
- b. Two 120-volt A.C. channel vital busses energized from their associated inverters connected to their respective D.C. channels.
- c. One 125-volt D.C. train with both required channels energized from their associated battery banks.

APPLICABILITY: MODES 5 and 6.

ACTION:

With any of the above required electrical busses not energized in the required manner, immediately suspend all operations involving CORE ALTERATIONS, positive reactivity changes, or movement of irradiated fuel, initiate corrective action to energize the required electrical busses in the specified manner as soon as possible.

SURVEILLANCE REQUIREMENTS

---

4.8.3.2 The specified busses shall be determined energized in the required manner at least once per 7 days by verifying correct breaker alignment and indicated voltage on the busses.



## ELECTRICAL POWER SYSTEMS

### 3/4.8.4 ELECTRICAL EQUIPMENT PROTECTIVE DEVICES

#### CONTAINMENT PENETRATION CONDUCTOR OVERCURRENT PROTECTIVE DEVICES

#### LIMITING CONDITION FOR OPERATION

---

3.8.4.1 All containment penetration conductor overcurrent protective devices shown in Table 3.8-2 shall be OPERABLE.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

With one or more of the above required containment penetration conductor overcurrent protective devices shown in Table 3.8-2 inoperable:

- a. Restore the protection device(s) to OPERABLE status or deenergize the circuit(s) by tripping the associated backup circuit breaker or racking out or removing the inoperable device within 72 hours and declare the affected system or component inoperable and verify the backup circuit breaker to be tripped or the inoperable circuit breaker racked out at least once per 7 days thereafter; the provisions of Specification 3.0.4 are not applicable to overcurrent devices in circuits which have their backup circuit breakers tripped, or
- b. Be in at least HOT STANDBY within the next 6 hours and in COLD SHUTDOWN within the following 30 hours.

#### SURVEILLANCE REQUIREMENTS

---

4.8.4.1 All containment penetration conductor overcurrent protective devices shown in Table 3.8-2 shall be demonstrated OPERABLE: <sup>(Except Fuses)</sup>

- a. At least once per 18 months:
  1. By verifying that the medium voltage (4-15 kV) circuit breakers are OPERABLE by selecting, on a rotating basis, at least 10% of the circuit breakers of each voltage level, and performing the following:
    - (a) A CHANNEL CALIBRATION of the associated protection relays, and
    - (b) An integrated system functional test which includes simulated automatic actuation of the system and verifying that each relay and associated circuit breakers and control circuits function as designed and as specified in Table 3.8-2.



SURVEILLANCE REQUIREMENTS (Continued)

- (c) For each circuit breaker found inoperable during these functional tests, an additional representative sample of at least 10% of all the circuit breakers of the inoperable type shall also be functionally tested until no more failures are found or all circuit breakers of that type have been functionally tested.
2. By selecting and functionally testing a representative sample of at least 10% of each type of lower voltage circuit breakers. Circuit breakers selected for functional testing shall be selected on a rotating basis. Testing of these circuit breakers shall consist of injecting a current with a value equal to 300% of the pickup of the long-time delay trip element and 150% of the pickup of the short-time delay trip element, and verifying that the circuit breaker operates within the time delay band width for that current specified by the manufacturer. The instantaneous element shall be tested by injecting a current equal to ~~±20% of the pickup value of the element~~ and verifying that the circuit breaker trips instantaneously with no ~~inter~~ <sup>Apparent</sup> time delay. Molded case circuit breaker testing shall also follow this procedure except that generally no more than two trip elements, time delay and instantaneous, will be involved. Circuit breakers found inoperable during functional testing shall be restored to OPERABLE status prior to resuming operation. For each circuit breaker found inoperable during these functional tests, an additional representative sample of at least 10% of all the circuit breakers of the inoperable type shall also be functionally tested until no more failures are found or all circuit breakers of that type have been functionally tested.
- b. At least once per 60 months by subjecting each circuit breaker to an inspection and preventive maintenance in accordance with procedures prepared in conjunction with its manufacturer's recommendations.





# FINAL DRAFT

TABLE 3.8-2

CONTAINMENT PENETRATION CONDUCTOR

OVERCURRENT PROTECTIVE DEVICES

<u>PRIMARY DEVICE NUMBER</u>	<u>BACKUP DEVICE NUMBER</u>	<u>SERVICE DESCRIPTION</u>
E-NHN-M1006	E-NHN-M1002B	SG WET LAYUP RECIRC. PUMP M-SGN-P01B
E-NHN-M1017	E-NHN-M1002B	CTMT/RADWASTE SUMP PUMP M-RDN-P03
E-NHN-M1003	E-NHN-M1002A	RCP 1B CONTROLLED BLEEDOFF VLV J-RCE-HV-431
E-NHN-M1004	E-NHN-M1002A	RCP 1B HP. COOLER INLET VLV J-RCN-HV-447
E-NHN-M1005	E-NHN-M1002A	RCP 1B HP COOLER OUTLET VLV J-RCN-HV-451
E-NHN-M1010	E-NHN-M1002A	REACTOR CAVITY FAN B DISCHARGE DAMPER M-HCN-M02B
E-NHN-M1014	E-NHN-M1002A	REACTOR CAVITY SUMP PUMP M-RDN-P01A
E-NHN-M2808	E-NHN-M2832C	RCP 2B CONTROL BLEEDOFF VLV J-RCE-HV-433
E-NHN-M2813	E-NHN-M2832C	RCP 2B HI PRESSURE COOLER INLET VLV J-RCN-HV-449
E-NHN-M1009	E-NHN-M1002A	RCP 2B HI PRESSURE COOLER OUTLET VLV J-RCN-HV-453
E-NHN-M1306	E-NHN-M1314A	SG 2 HOT LEG BLDWN ISO VLV J-SGE-HV-42
E-NHN-M1307	E-NHN-M1314A	SG 2 COLD LEG BLDWN ISO VLV J-SGE-HV-44
E-NHN-M1311	E-NHN-M1314D	WET LAY UP RECIRC PUMP M-SGN-P01A
E-NHN-M1316	E-NHN-M1314C	RCPT (30A) FOR SEAL CRANE ASSY MOTOR E-NHN-122A; E-NHN-122B
E-NHN-M1339	E-NHN-M1314C	MOVABLE INCORE DETECTOR DRIVE MACHINE M-RIN-M03A

# FINAL DRAFT

TABLE 3.8-2 (Continued)

CONTAINMENT PENETRATION CONDUCTOR

OVERCURRENT PROTECTIVE DEVICES

<u>PRIMARY DEVICE NUMBER</u>	<u>BACKUP DEVICE NUMBER</u>	<u>SERVICE DESCRIPTION</u>
E-NHN-M1321	E-NHN-M1344B	WELDING RCPT'S E-NHN-I107A B, C, D
E-NHN-M1331	E-NHN-M1314B	REACTOR CAVITY SUMP PUMP M-RDN-P01B
E-NHN-M1341	E-NHN-M1314B	REACTOR CAVITY FAN C DISCH DAMPER M-HCN-M02C
E-NHN-M1342	E-NHN-M1314B	CEDM ACU A INTAKE DAMPER M-HCN-M03A
E-NHN-M1343	E-NHN-M1314B	CEDM ACU B INTAKE DAMPER M-HCN-M03B
E-NHN-M1323	E-NHN-M1344A	REACTOR COOLANT OIL LIFT PUMP 2A M-RCN-P02C
E-NHN-M1332	E-NHN-M1344A	CTMT RADWASTE SUMP EAST M-RDN-P02
E-NHN-M1503	E-NHN-M1502A	RCP 1A CONTROL BLEEDOFF VLV J-RCE-HV-430
E-NHN-M1504	E-NHN-M1502A	RCP 2A CONTROL BLEEDOFF VLV J-RCE-HV-432
E-NHN-M1505	E-NHN-M1502A	RCP 1A HI PRESSURE COOLER INLET VLV J-RCN-HV-446
E-NHN-M1506	E-NHN-M1502A	RCP 2A HI PRESSURE COOLER INLET VLV J-RCN-HV-448
E-NHN-M1507	E-NHN-M1502A	RCP 1A HI PRESSURE COOLER OUTLET VLV J-RCN-HV-450
E-NHN-M1511	E-NHN-M1535A	WELDING RCPT'S E-NHN-I12A, B, C
E-NHN-M1508	E-NHN-M1502B	RCP 2A HI PRESSURE COOLER OUTLET VLV J-RCN-HV-452
E-NHN-M1509	E-NHN-M1502B	REACTOR CAVITY FAN A DISCH DAMPER M-HCN-M02A

TABLE 3.8-2 (Continued)

CONTAINMENT PENETRATION CONDUCTOR

OVERCURRENT PROTECTIVE DEVICES

<u>PRIMARY DEVICE NUMBER</u>	<u>BACKUP DEVICE NUMBER</u>	<u>SERVICE DESCRIPTION</u>
E-NHN-M1533	E-NHN-M1502B	REACTOR CAVITY FAN D DISCH DAMPER M-HCN-M02D
E-NHN-M1534	E-NHN-M1535	CTMT BLDG MONO HOIST 1 TON M-ZCN-009
E-NHN-M1517	E-NHN-M1535	REACTOR COOLANT OIL LIFT PUMP M-RCN-P02A
E-NHN-M1902	E-NHN-M1917A	REACTOR CAVITY NORM CLG FAN M-HCN-A03A
E-NHN-M1904	E-NHN-M1917B	REACTOR CAVITY NORM CLG FAN M-HCN-A03C
E-NHN-M1907	E-NHN-M1917	CEDM NORM ACU-A HEXCH OUTLET VLV J-NCN-HV-485
E-NHN-M1911	E-NHN-M1917	CTMT NORM ACU-C CHILLED WTR INLET VLV J-WCN-HV-59
E-NHN-M1912	E-NHN-M1917	CTMT NORM ACU-A CHILLED WTR INLET VLV J-WCN-HV-57
E-NHN-M2008	E-NHN-M2010	CEDM NORM ACU-B HEXCH OUTLET VLV J-NCN-HV-486
E-NHN-M2003	E-NHN-M2010	CTMT NORM ACU-B CHILL WATER INLET VLV J-WCN-HV-58
E-NHN-M2004	E-NHN-M2010	CTMT NORM ACU-D CHILL WATER INLET VLV J-WCN-HV-60
E-NHN-M2006	E-NHN-M2010A	REACTOR CAVITY NORM CLG FAN M-HCN-A03B
E-NHN-M2007	E-NHN-M2016	REACTOR CAVITY NORM CLG FAN M-HCN-A03D
E-NHN-M2803	E-NHN-M2827A	CEDM ACU C INTAKE DAMPER M-HCN-M03C
E-NHN-M2804	E-NHN-M2827A	CEDM ACU D INTAKE DAMPER M-HCN-M03D

**FINAL DRAFT**TABLE 3.8-2 (Continued)CONTAINMENT PENETRATION CONDUCTOROVERCURRENT PROTECTIVE DEVICES

<u>PRIMARY DEVICE NUMBER</u>	<u>BACKUP DEVICE NUMBER</u>	<u>SERVICE DESCRIPTION</u>
E-NHN-M2805	E-NHN-M2827A	SG1 COLD LEG BLOWDOWN ISO VLV J-SGE-HV-41
E-NHN-M2806	E-NHN-M2827B	SG HOT LEG BLOWDOWN ISOLATION VALVE J-SGE-HV43
E-NHN-M2827	E-NHN-M2827A	REACTOR COOL PUMP OIL LIFT PUMP 1B M-RCN-P02B
E-NHN-M2828	E-NHN-M2827A	REACTOR COOLANT PUMP OIL LIFT PUMP 2B M-RCN-P02D
E-NHN-M2809	E-NHN-M2827C	CONTAINMENT EQUIP HATCH J-ZCN-E02
E-NHN-M2811	E-NHN-M2832A	30A RECEPTACLES FOR CTMT BLDG JIB CRANE
E-NHN-M2818	E-NHN-M2832A	30A RECEPTACLES FOR SEAL CRANE ASSY MOT
E-NHN-M2817	E-NHN-M2832B	CTMT BLDG MONORAIL HOIST 1 TON M-ZCN-G03
E-NHN-M2819	E-NHN-M2832B	30A RECEPTACLES FOR CTMT BLDG JIB CRANE G04 A, B
E-NHN-M2820	E-NHN-M2832D	CTMT BLDG ELEV #2 CONTROLLER J-ZCN-E01
E-NHN-M2821	E-NHN-M2828C	MULTIPLE STUD TENSIONER M-ZCN-M15
E-NHN-M2822	E-NHN-M2828B	WELDING RECPTS E-NHN-I09 B, C, D
E-NHN-M2801A	E-NHN-M2827B	FUEL TRANSFER SYS CONTROL CONSOLE E-PCE-D02
E-NHN-M2833	E-NHN-M2827B	REFUELING MACHINE E-PCE- J02
E-NHN-M2833A	E-NHN-M2827B	CEA CHANGE PLATFORM E-PCE- J01

TABLE 3.8-2 (Continued)

CONTAINMENT PENETRATION CONDUCTOROVERCURRENT PROTECTIVE DEVICES

<u>PRIMARY DEVICE NUMBER</u>	<u>BACKUP DEVICE NUMBER</u>	<u>SERVICE DESCRIPTION</u>
E-NHN-M7102	E-NHN-M7104	CONTAINMENT NORMAL ACU A DISCHARGE DAMPER M-HCN-M01A
E-NHN-M7103	E-NHN-M7104	CONTAINMENT NORMAL ACU C DISCHARGE DAMPER M-HCN-M01C
E-NHN-M7114	E-NHN-7113	PZR NORMAL COOLING FAN M-HCN-A06A
E-NHN-M2816	E-NHN-M2832C	CTMT BLDG MONORAIL HOIST-2 TON M-ZCN-G08
E-NHN-M2834A	E-NHN-M2832C	MOVABLE INCORE DETECTOR DRIVE MACH #2 M-RIN-M03B
E-NHN-M7202	E-NHN-M7204	CTM NORM ACU B DISCH DAMPER M-HCN-M01B
E-NHN-M7203	E-NHN-M7204	CTM NORM ACU D DISCH DAMPER M-HCN-M01D
E-NHN-M7214	E-NHN-M7213	PZR NORMAL COOLING FAN M-HCN-A06B
E-PGA-L31E2	E-NGN-B31E2 (FUSE)	CONTAINMENT NORMAL ACU FAN M-HCN-A01A
E-PGA-L31E3	E-NGN-B31E3 (FUSE)	CEDM NORMAL ACU FAN M-HCN-A02A
E-PGB-L32E3	E-NGN-B32E3 (FUSE)	PRESSURIZER BACKUP HEATERS M-RCE-B18, B10, A5
E-PGB-L32E2	E-NGN-B32E2 (FUSE)	CEDM NORMAL ACU FAN M-HCN-A02B
E-PGA-L33D2	E-NGN-B33D2 (FUSE)	CONTAINMENT NORMAL ACU FAN M-HCN-A01C
E-PGA-L33D4	E-NGN-B33D4 (FUSE)	PRESSURIZER BACKUP HTR, M-RCE B1, B9, A14
E-PGA-L33D3	E-NGN-B33D3 (FUSE)	CEDM NORMAL ACU FAN M-HCN-A02C

TABLE 3.8-2 (Continued)

CONTAINMENT PENETRATION CONDUCTOR

OVERCURRENT PROTECTIVE DEVICES

<u>PRIMARY DEVICE NUMBER</u>	<u>BACKUP DEVICE NUMBER</u>	<u>SERVICE DESCRIPTION</u>
E-PGB-L34D2	E-NGN-B34D2 (FUSE)	CEDM NORMAL ACU FAN M-HCN-A01D
E-PGB-L34D3	E-NGN-B34D3 (FUSE)	CEDM NORMAL ACU FAN M-HCN-A02D
E-PGB-L36D3	E-NGN-B3603 (FUSE)	CTMT NOR ACU FAN M-HCN-A01B
E-PHA-M3318	E-PHA-M3334	SAFETY INJECT TANK 4 ISOL VLV J-SIA-UV-644
E-PHA-M3316	E-PHA-M3316A	SAFETY INJECT TANK 3 ISOL VLV J-SIA-UV-634
E-PHB-M3404	E-PHB-M3405B	NCWS RET INT CTMT ISOL VLV J-NCB-UV-403
E-PHA-M3519	E-PHA-M3521A	CTMT PRG PWR ACCESS MODE ISO VLV J-CPA-UV-48
E-PHA-M3521	E-PHA-M3517	CTMT PRG RFL MODE ISO VLV J-CPA-UV-2B
E-PHA-M3503	E-PHA-M3507A.	SHUT DN CLG ISOL LOOP 1 VLV J-SIA-UV-651
E-PHA-M3508	E-PHA-M3511A	CTMT/RAD SUMP CTMT INT ISO VLV J-RDA-UV-23
E-PHA-M3512	E-PHA-M3513A	CTMT SUMP ISOL TRAIN A VLV J-SIA-UV-673
E-PHB-M3622	E-PHB-M3629	CTMT PRG REFULING MODE ISO VLV J-CPB-UV-3A
E-PHB-M3604	E-PHB-M3604A	SHUT DN CLG ISOL LOOP 2 VLV J-SIB-UV-652
E-PHB-M3619	E-PHB-M3641A	SAFETY INJECTION TANK ISOL VLV J-SIB-UV-614
E-PHB-M3624	E-PHA-M3607A	CTMT PRG PWR ACCESS MODE ISO VLV J-CPB-UV-5A



TABLE 3.8-2 (Continued)

CONTAINMENT PENETRATION CONDUCTOROVERCURRENT PROTECTIVE DEVICES

<u>PRIMARY DEVICE NUMBER</u>	<u>BACKUP DEVICE NUMBER</u>	<u>SERVICE DESCRIPTION</u>
E-PHB-M3613	E-PHB-M3613A	CTMT SUMP ISOL TRAIN B VLV J-SIB-UV-675
E-PHB-M3618	E-PHB-M3641	SAFETY INJECTION TANK 2 ISO VLV J-SIB-UV-624
E-PHA-M3704	E-PHA-M3703A	WASTE GAS HEADER CONTAINMENT ISOLATION VALVE GRA UV1
E-PHA-M3715	E-PHA-M3719	H <sub>2</sub> CONT TRAIN A UPSTM SUP ISO VLV J-HPA-UV-1
E-PHB-M3816	E-PHB-M3836	H <sub>2</sub> CTMT TRAIN B UPSTM SUP ISO VLV J-HPB-UV-2
E-PHB-M3811	E-PHB-M3813A	NORM CHIL WTR RETURN CTMT ISO VLV J-WCB-UV-61
E-PKD-B44	E-PKD-M4411	SHUTDOWN CLG ISOL VLV J-SID-UV-654
E-PKC-B43	E-PKC-M4311	SHUTDOWN COOLING ISOL VLV J-SIC-UV-653
E-NNN-D1113	E-NNN-D11	MOVABLE INCORE DRIVE SYS #I 800VA, M-RIN-M03A VIA E-RIN-J01A
E-NNN-D1213	E-NNN-D12	MOVABLE INCORE DRIVE SYS #II 800VA, M-RIN-M03B VIA E-RIN-J01A
E-NNN-D1526	E-NNN-D15	RCP INSTN LOCAL PNL J-RCN-E02
E-NNN-D1525	E-NNN-D15	RCP INSTN LOCAL PNL J-RCN-E01
E-NNN-D1626	E-NNN-D16	RCP INSTN LOCAL PNL J-RCN-E04
E-NNN-D1625	E-NNN-D16	RCP INSTN LOCAL PNL J-RCN-E03
E-QAN-B02	E-QAN-D05 CKT 2, 4, 6	LIGHTING PANEL E-QAN-D05B CTMT BLDG EL 100'



FINAL DRAFT

TABLE 3.8-2 (Continued)

CONTAINMENT PENETRATION CONDUCTOR

OVERCURRENT PROTECTIVE DEVICES

<u>PRIMARY DEVICE NUMBER</u>	<u>BACKUP DEVICE NUMBER</u>	<u>SERVICE DESCRIPTION</u>
E-QAN-B03	E-QAN-D05 CKT 7, 9, 11	LIGHTING PANEL E-QAN-D05C CTMT BLDG EL 100'
E-QAN-B04	E-QAN-D05 CKT 8, 10, 12	LIGHTING PANEL E-QAN-D05D CTMT BLDG EL 140'
E-QAN-B05	E-QAN-D05 CKT 19, 21, 23	LIGHTING PANEL E-QAN-D05F CTMT BLDG EL 140'
E-QAN-B06	E-QAN-D05 CKT 13, 15, 17	LIGHTING PANEL E-QAN-D05E CTMT BLDG EL 140'
E-QBN-B01	E-QBN-D91 CKT 19, 21, 23	LIGHTING PANEL E-QBN-D73A CTMT BLDG EL 100'
E-QBN-B02	E-QBN-D91 CKT 20, 22, 24	LIGHTING PANEL E-QBN-D73B CTMT BLDG EL 140'
E-NHN-D1514	E-NHN-M1526	TO OPERATION CAMERA JB# 2
E-RCN-D0101	E-NGN-L11C2	PZR BU HTR M-RCE-B07, B13, A01
E-NAN-D2614	E-NHN-M2618	TO OPERATION CAMERA JB# 1
E-RCN-D0102	E-NGN-L11C2	PZR BU HTR M-RCE-B03, A09, A15
E-RCN-D0302	E-NGN-L11C3	PZR BU HTR M-RCE-B04, A11, A16
E-RCN-D0301	E-NGN-L11C3	PZR BU HTR M-RCE-A02, A07, A13
E-RCN-D0202	E-NGN-L12C2	PZR BU HTR M-RCE-B06, B12, A18
E-RCN-D0201	E-NGN-L12C2	PZR BU HTR M-RCE-B16, A04, A08
E-RCN-D0402	E-NGN-L12C3	PZR BU HTR M-RCE-B15, A03, A10
E-RCN-D0401	E-NGN-L12C3	PZR BU HTR M-RCE-A17, A06, A12



# FINAL DRAFT

TABLE 3.8-2 (Continued)  
CONTAINMENT PENETRATION CONDUCTOR  
OVERCURRENT PROTECTIVE DEVICES

<u>PRIMARY DEVICE NUMBER</u>	<u>BACKUP DEVICE NUMBER</u>	<u>SERVICE DESCRIPTION</u>
E-NAN-S01M	E-NAN-S01A E-NAN-S03B	RCP M-RCE-P01A (C.E. NO. 1A)
E-NAN-S01L	E-NAN-S01A E-NAN-S03B	RCP M-RCE-P01C (C.E. NO. 2A)
E-NAN-S02L	E-NAN-S02A E-NAN-S04B	RCP M-RCE-P01B (C.E. NO. 1B)
E-NAN-S02-M	E-NAN-S02A E-NAN-S04B	RCP M-RCE-P01D (C.E. NO. 2B)
E-NGN-L03C2	FUSE IN BKR.	CTMT NOR DUCT HTR M-HCN-E01C
E-NGN-L03C3	FUSE IN BKR.	CTMT NOR DUCT HTR M-HCN-E01D
E-NGN-L03D2	FUSE IN BKR.	CTMT POLAR CRANE M-ZCN-G01
E-NGN-L06C2	E-NGN-B06C2 (FUSE)	CTMT PRE-ACCESS NORM AFU FAN M-HCN-F01A
E-NGN-L09C4	E-NGN-B09C4 (FUSE)	CTMT PRE-ACCESS NORM AFU FAN M-HCN-F01B
E-NGN-L10C2	FUSE IN BKR.	CTMT NORM DUCT HTR M-HCN-E01A
E-NGN-L10C3	FUSE IN BKR.	CTMT NORM DUCT HTR M-HCN- E01B
E-NGN-L11C4	E-NGN-L11B2	PROPORTIONAL HTR BANK M-RCE-B2, B8, B14
E-NGN-L12C4	E-NGN-L12B2	PROPORTIONAL HTR BANK M-RCE-B5, B11, B17
CEA 06 CB101	F101, F102, F103	CEA 06
CEA 08 CB102	F104, F105, F106	CEA 08
CEA 10 CB103	F107, F108, F109	CEA 10

TABLE 3.8-2 (Continued)

CONTAINMENT PENETRATION CONDUCTOR

OVERCURRENT PROTECTIVE DEVICES

<u>PRIMARY DEVICE NUMBER</u>	<u>BACKUP DEVICE NUMBER</u>	<u>SERVICE DESCRIPTION</u>
CEA 12 CB104	F110, F111, F112	CEA 12
CEA 07 CB101	F101, F102, F103	CEA 07
CEA 09 CB102	F104, F105, F106	CEA 09
CEA 11 CB103	F107, F108, F109	CEA 11
CEA 13 CB104	F110, F111, F112	CEA 13
CEA 74 CB101	F101, F102, F103	CEA 74
CEA 76 CB102	F104, F105, F106	CEA 76
CEA 78 CB103	F107, F108, F109	CEA 78
CEA 80 CB104	F110, F111, F112	CEA 80
CEA 75 CB101	F101, F102, F103	CEA 75
CEA 77 CB102	F104, F105, F106	CEA 77
CEA 79 CB103	F107, F108, F109	CEA 79
CEA 81 CB104	F110, F111, F112	CEA 81
CEA 22 CB101	F101, F102, F103	CEA 22
CEA 24 CB102	F104, F105, F106	CEA 24
CEA 26 CB103	F107, F108, F109	CEA 26
CEA 28 CB104	F110, F111, F112	CEA 28
CEA 23 CB101	F101, F102, F103	CEA 23
CEA 25 CB102	F104, F105, F106	CEA 25

TABLE 3.8-2 (Continued)

CONTAINMENT PENETRATION CONDUCTOROVERCURRENT PROTECTIVE DEVICES

<u>PRIMARY DEVICE NUMBER</u>	<u>BACKUP DEVICE NUMBER</u>	<u>SERVICE DESCRIPTION</u>
CEA 27 CB103	F107, F108, F109	CEA 27
CEA 29 CB104	F110, F111, F112	CEA 29
CEA 34 CB101	F101, F102, F103	CEA 34
CEA 36 CB102	F104, F105, F106	CEA 36
CEA 38 CB103	F107, F108, F109	CEA 38
CEA 40 CB104	F110, F111, F112	CEA 40
CEA 35 CB101	F101, F102, F103	CEA 35
CEA 37 CB102	F104, F105, F106	CEA 37
CEA 39 CB103	F107, F108, F109	CEA 39
CEA 41 CB104	F110, F111, F112	CEA 41
CEA 55 CB101	F101, F102, F103	CEA 55
CEA 58 CB102	F104, F105, F106	CEA 58
CEA 61 CB103	F107, F108, F109	CEA 61
CEA 64 CB104	F110, F111, F112	CEA 64
CEA 54 CB101	F101, F102, F103	CEA 54
CEA 57 CB102	F104, F105, F106	CEA 57
CEA 60 CB103	F107, F108, F109	CEA 60
CEA 63 CB104	F110, F111, F112	CEA 63
CEA 56 CB101	F101, F102, F103	CEA 56
CEA 59 CB102	F104, F105, F106	CEA 59

TABLE 3.8-2 (Continued)  
CONTAINMENT PENETRATION CONDUCTOR  
OVERCURRENT PROTECTION DEVICES

<u>PRIMARY DEVICE NUMBER</u>	<u>BACKUP DEVICE NUMBER</u>	<u>SERVICE DESCRIPTION</u>
CEA 62 CB103	F107, F108, F109	CEA 62
CEA 65 CB104	F110, F111, F112	CEA 65
CEA 66 CB101	F101, F102, F103	CEA 66
CEA 68 CB102	F104, F105, F106	CEA 68
CEA 70 CB103	F107, F108, F109	CEA 70
CEA 72 CB104	F110, F111, F112	CEA 72
CEA 67 CB101	F101, F102, F103	CEA 67
CEA 69 CB102	F104, F105, F106	CEA 69
CEA 71 CB103	F107, F108, F109	CEA 71
CEA 73 CB104	F110, F111, F112	CEA 73
CEA 02 CB101	F101, F102, F103	CEA 02
CEA 03 CB102	F104, F105, F106	CEA 03
CEA 04 CB103	F107, F108, F109	CEA 04
CEA 05 CB104	F110, F111, F112	CEA 05
CEA 42 CB101	F101, F102, F103	CEA 42
CEA 43 CB102	F104, F105, F106	CEA 43
CEA 44 CB103	F107, F108, F109	CEA 44
CEA 45 CB104	F110, F111, F112	CEA 45
CEA 82 CB101	F101, F102, F103	CEA 82
CEA 83 CB102	F104, F105, F106	CEA 83

FINAL DRAFT

TABLE 3.8-2 (Continued)

CONTAINMENT PENETRATION CONDUCTOR

OVERCURRENT PROTECTIVE DEVICES

<u>PRIMARY DEVICE NUMBER</u>	<u>BACKUP DEVICE NUMBER</u>	<u>SERVICE DESCRIPTION</u>
CEA 84 CB103	F107, F108, F109	CEA 84
CEA 85 CB104	F110, F111, F112	CEA 85
CEA 18 CB101	F101, F102, F103	CEA 18
CEA 19 CB102	F104, F105, F106	CEA 19
CEA 20 CB103	F107, F108, F109	CEA 20
CEA 21 CB104	F110, F111, F112	CEA 21
CEA 86 CB101	F101, F102, F103	CEA 86
CEA 87 CB102	F104, F105, F106	CEA 87
CEA 88 CB103	F107, F108, F109	CEA 88
CEA 89 CB104	F110, F111, F112	CEA 89
CEA 14 CB101	F101, F102, F103	CEA 14
CEA 15 CB102	F104, F105, F106	CEA 15
CEA 16 CB103	F107, F108, F109	CEA 16
CEA 17 CB104	F110, F111, F112	CEA 17
CEA 46 CB101	F101, F102, F103	CEA 46
CEA 48 CB102	F104, F105, F106	CEA 48
CEA 50 CB103	F107, F108, F109	CEA 50
CEA 52 CB104	F110, F111, F112	CEA 52
CEA 47 CB101	F101, F102, F103	CEA 47
CEA 49 CB102	F104, F105, F106	CEA 49

TABLE 3.8-2 (Continued)  
CONTAINMENT PENETRATION CONDUCTOR  
OVERCURRENT PROTECTIVE DEVICES

<u>PRIMARY DEVICE NUMBER</u>	<u>BACKUP DEVICE NUMBER</u>	<u>SERVICE DESCRIPTION</u>
CEA 51 CB103	F107, F108, F109	CEA 51
CEA 53 CB104	F110, F111, F112	CEA 53
CEA 30 CB101	F101, F102, F103	CEA 30
CEA 31 CB102	F104, F105, F106	CEA 31
CEA 32 CB103	F107, F108, F109	CEA 32
CEA 33 CB104	F110, F111, F112	CEA 33
CEA 01 CB101	F101, F102, F103	CEA 01
E-PHA-D33-03	E-PHA-M3333	INDICATING LIGHTS FOR VLV J-SIA-UV-634
E-PHA-D33-04	E-PHA-M3333	INDICATING LIGHTS FOR VLV J-SIA-UV-644
E-PHB-D36-01	E-PHA-M3639	INDICATING LIGHTS FOR VLV J-SIB-UV-614
E-PHB-D36-02	E-PHA-M3639	INDICATING LIGHTS FOR VLV J-SIB-UV-624
E-NHN-D28-04	E-NHN-M2831	CONTAINMENT PREACCESS NORMAL AFU MOTOR SPACE HEATER FOR M-MCN-FO1AH
E-NHN-D28-14	E-NHN-M2831	FLOW SWITCH J-HCN-FSL-29 FOR DUCT HEATERS M-HCN-E01A AND B
E-NHN-D28-16	E-NHN-M2831	CONTAINMENT AHU DUCT HEATERS M-HCN-E01A AND B TEMPERATURE CONTROL J-HCN-TC-29
E-NHN-D28-18	E-NHN-M2831	FLOW SWITCH J-HCN-FSL-31 FOR DUCT HEATERS M-HCN-E01C AND D
E-NHN-D13-04	E-NHN-M1330	CONTAINMENT ACU DUCT HEATERS M-HCN-E01C AND D TEMPERATURE CONTROLLER J-HCN-TC-31



TABLE 3.8-2 (Continued)  
CONTAINMENT PENETRATION CONDUCTOR  
OVERCURRENT PROTECTIVE DEVICES

<u>PRIMARY DEVICE NUMBER</u>	<u>BACKUP DEVICE NUMBER</u>	<u>SERVICE DESCRIPTION</u>
E-NHN-D13-22	E-NHN-M1330	STEAM GENERATOR WET LAYUP PUMP MOTOR SPACE HEATER M-SGN-P01AH
E-NHN-D15-01	E-NHN-M1527	REACTOR COOLANT PUMP MOTOR SPACE HEATER CONTACTOR M-RCE-P01B
E-NHN-D15-02	E-NHN-M1527	REACTOR COOLANT PUMP MOTOR SPACE HEATER CONTACTOR M-RCE-P01D1
E-NHN-D15-06	E-NHN-M1527	CONTAINMENT PREACCESS NORMAL AFU FAN MOTOR SPACE METER M-HCN-F01E
E-NHN-D10-01	E-NHN-M1028	REACTOR COOLANT PUMP MOTOR SPACE HEATER CONTACTOR M-RCE-P01AH
E-NHN-D10-02	E-NHN-M1028	REACTOR COOLANT PUMP MOTOR SPACE HEATER CONTACTOR M-RCE-P01CH
E-NHN-D10-20	E-NHN-M1028	STEAM GENERATOR WET LAYUP PUMP MOTOR SPACE HEATER M-SGN-P01B
E-NHN-D19-05	E-NHN-M1915	CEDM NORMAL ACU FAN MOTOR SPACE HEATER M-HCN-A02AH
E-NHN-D19-06	E-NHN-M1915	CEDM NORMAL ACU FAN MOTOR SPACE HEATER M-HCN-A02CH
E-NHN-D19-07	E-NHN-M1915	CONTAINMENT NORMAL ACU FAN MOTOR SPACE HEATER M-HCN-A01AH
E-NHN-D19-08	E-NHN-M1915	CONTAINMENT NORMAL ACU FAN MOTOR SPACE HEATER M-HCN-A01CH
E-NHN-D19-10	E-NHN-M1915	REACTOR CAVITY NORMAL COOLING FAN MOTOR SPACE HEATER M-HCN-A03AH
E-NHN-D19-12	E-NHN-M1915	REACTOR CAVITY NORMAL COOLING FAN MOTOR SPACE HEATER M-HCN-A03CH

TABLE 3.8-2 (Continued)

CONTAINMENT PENETRATION CONDUCTOR

OVERCURRENT PROTECTIVE DEVICES

<u>PRIMARY DEVICE NUMBER</u>	<u>BACKUP DEVICE NUMBER</u>	<u>SERVICE DESCRIPTION</u>
E-NHN-D20-05	E-NHN-M2014	CEDM NORMAL ACU FAN MOTOR SPACE HEATER M-HCN-A02BH
E-NHN-D20-06	E-NHN-M2014	CEDM NORMAL ACU FAN MOTOR SPACE HEATER M-HCN-A02DH
E-NHN-D20-07	E-NHN-M2014	CONTAINMENT NORMAL ACU FAN MOTOR SPACE HEATER M-HCN-A01D
E-NHN-D20-08	E-NHN-M2014	CONTAINMENT NORMAL ACU FAN MOTOR SPACE HEATER M-HCN-A01BH
E-NHN-D20-10	E-NHN-M2014	REACTOR CAVITY NORMAL COOLING FAN MOTOR SPACE HEATER M-HCN-A03BH
E-NHN-D20-12	E-NHN-M2014	REACTOR CAVITY NORMAL COOLING FAN MOTOR SPACE HEATER M-HCN-A03DH

**FINAL DRAFT**

TABLE 3.8-2 (Continued)

CONTAINMENT PENETRATION CONDUCTOR

OVERCURRENT PROTECTIVE DEVICES

<u>PRIMARY DEVICE NUMBER</u>	<u>BACKUP DEVICE NUMBER</u>	<u>SERVICE DESCRIPTION</u>
E-ZAB-C06 (FUSE)	E-PKB-D2221	SAFETY INJ TANK NITROGEN SUPPLY VALVE J-SIB-UV-622
E-ZAB-C06 (FUSE)	E-PKB-D2221	SAFETY INJ TANK VENT VALVE J-SIB-HV-613
E-ZAB-C06 (FUSE)	E-PKB-D2221	SAFETY INJ TANK VENT VALVE J-SIB-HV-623
E-ZAB-C06 (FUSE)	E-PKB-D2221	SAFETY INJ TANK VENT VALVE J-SIB-HV-633
E-ZAB-C06 (FUSE)	E-PKB-D2221	SAFETY INJ TANK VENT VALVE J-SIB-HV-643
E-ZJA-C01 (FUSE)	E-PAK-D2101	SAFETY INJ TANK NITROGEN SUPPLY VALVE J-SIA-HV-639
E-ZJA-C01 (FUSE)	E-PAK-D2101	SAFETY INJ TANK NITROGEN SUPPLY VALVE J-SIA-HV-649
E-ZJA-C03 (FUSE)	E-PAK-D2111	RCP CONTROLLED BLEEDOFF TO RDT VALVE J-CHA-HV-507
E-ZJA-C03 (FUSE)	E-PAK-D2111	LETDOWN LINE TO REGEN HEAT EXCH CTMT ISO VALVE J-CHA-HV-516
E-ZJA-C03 (FUSE)	E-PAK-D2111	RCP CONTROLLED BLEEDOFF TO VCT VALVE J-CHA-UV-506
E-ZJB-C01 (FUSE)	E-PKB-D2201	SAFETY INJ TANK FILL AND DRAIN VALVE J-SIB-UV-641
E-ZJB-C01 (FUSE)	E-PKB-D2201	SI TANK CHECK VALVE LEAKAGE ISO VALVE J-SIB-UV-648
E-ZJB-C01 (FUSE)	E-PKB-D2201	HOT LEG INJECT CHECK VLV LEAKAGE ISO VLV J-SIB-UV-322
E-ZJB-C01 (FUSE)	E-PKB-D2201	SAFETY INJ TANK NITROGEN SUPPLY VALVE J-SIB-UV-632



TABLE 3.8-2 (Continued)

CONTAINMENT PENETRATION CONDUCTOR

OVERCURRENT PROTECTIVE DEVICES

<u>PRIMARY DEVICE NUMBER</u>	<u>BACKUP DEVICE NUMBER</u>	<u>SERVICE DESCRIPTION</u>
E-ZJB-C01 (FUSE)	E-PKB-D2201	SAFETY INJ TANK NITROGEN SUPPLY VALVE J-SIB-UV-642
E-ZJB-C03 (FUSE)	E-PKB-D2211	LETDOWN LINE TO REGEN HEAT EXCH VALVE J-CHB-UV-515
E-ZJB-C03 (FUSE)	E-PKB-D2211	SAFETY INJ TANK FILL AND DRAIN VALVE J-SIB-UV-631
E-ZAA-C03 (FUSE)	E-PAK-D2109	REACTOR DRAIN TANK OUTLET ISOLATION VALVE J-CHAUV-560
E-ZAA-C03 (FUSE)	E-PAK-D2109	SI TANK RWT HDR CTMT ISOLATION VALVE J-SIA-UV-682
E-ZAA-C03 (FUSE)	E-PAK-D2109	REGENERATIVE HEAT EXCH TO AUX SPRAY VALVE J-CHA-HV-209
E-ZAA-C01 (FUSE)	E-PAK-D2110	SAMPLE CONTAINMENT ISOLATION VALVE J-SSA-UV-203
E-ZAA-C01 (FUSE)	E-PAK-D2110	SAMPLE CONTAINMENT ISOLATION VALVE J-SSA-UV-204
E-ZAA-C01 (FUSE)	E-PAK-D2110	SAMPLE CONTAINMENT ISOLATION VALVE J-SSA-UV-205
E-ZAA-C04 (FUSE)	E-PAK-D2102	PRESSURIZER VENT VALVE J-RCA-HV-103
E-ZAA-C05 (FUSE)	E-PAK-D2114	STEAM GEN BLOWDOWN CTMT ISOLATION VALVE J-SGA-UV-500P
E-ZAA-C05 (FUSE)	E-PAK-D2114	BLOWDOWN SAMPLE CTMT ISOLATION VALVE J-SGA-UV-204
E-ZAA-C05 (FUSE)	E-PAK-D2114	BLOWDOWN SAMPLE CTMT ISOLATION VALVE J-SGA-UV-211
E-ZAA-C05 (FUSE)	E-PAK-D2114	BLOWDOWN SAMPLE CTMT ISOLATION VALVE J-SGA-UV-220
E-ZAA-C06 (FUSE)	E-PAK-D2121	SAFETY INJ TANK NITROGEN SUPPLY VALVE J-SIA-HV-619

TABLE 3.8-2 (Continued)

CONTAINMENT PENETRATION CONDUCTOROVERCURRENT PROTECTIVE DEVICES

<u>PRIMARY DEVICE NUMBER</u>	<u>BACKUP DEVICE NUMBER</u>	<u>SERVICE DESCRIPTION</u>
E-ZAA-C06 (FUSE)	E-PKA-D2121	SAFETY INJ TANK NITROGEN SUPPLY VALVE J-SIA-HV-629
E-ZAA-C06 (FUSE)	E-PKA-D2121	SAFETY INJ TANK VENT VALVE J-SIA-HV-605
E-ZAA-C06 (FUSE)	E-PKA-D2121	SAFETY INJ TANK VENT VALVE J-SIA-HV-606
E-ZAA-C06 (FUSE)	E-PKA-D2121	SAFETY INJ TANK VENT VALVE J-SIA-HV-607
E-ZAA-C06 (FUSE)	E-PKA-D2121	SAFETY INJ TANK VENT VALVE J-SIA-HV-608
E-ZAA-C06 (FUSE)	E-PKA-D2121	RC SYSTEM VENT TO CTMT VALVE J-RCA-HV-106
E-ZAB-C03 (FUSE)	E-PKB-D2209	REGEN HEAT EXCH TO AUX SPRAY VALVE J-CHB-HV-203
E-ZAB-C03 (FUSE)	E-PKB-D2209	REACTOR COOLANT VENT VALVE J-RCB-HV-102
E-ZAB-C03 (FUSE)	E-PKB-D2209	SAFETY INJ TANK FILL AND DRAIN VALVE J-SIB-UV-611
E-ZAB-C03 (FUSE)	E-PKB-D2209	SI TANK CHECK VALVE LEAKAGE LINE ISO VALVE J-SIB-UV-618
E-ZAB-C01 (FUSE)	E-PKB-D2210	CTMT ATM RADIATION MONITORING ISO VALVE J-HCB-UV-44
E-ZAB-C01 (FUSE)	E-PKB-D2210	CTMT ATM RADIATION MONITORING ISO VALVE J-HCB-UV-47
E-ZAB-C04 (FUSE)	E-PKB-D2202	REACTOR COOLANT VENT VALVE J-RCB-HV-108
E-ZAB-C04 (FUSE)	E-PKB-D2202	SAFETY INJ TANK FILL AND DRAIN VALVE J-SIB-UV-621
E-ZAB-C04 (FUSE)	E-PKB-D2202	SI TANK CHECK VALVE LEAKAGE LINE ISO VALVE J-SIB-UV-628

# FINAL DRAFT

TABLE 3.8-2 (Continued)  
CONTAINMENT PENETRATION CONDUCTOR  
OVERCURRENT PROTECTIVE DEVICES

<u>PRIMARY DEVICE NUMBER</u>	<u>BACKUP DEVICE NUMBER</u>	<u>SERVICE DESCRIPTION</u>
E-ZAB-C05 (FUSE)	E-PKB-D2214	REACTOR COOLANT VENT VALVE J-RCB-HV-109
E-ZAB-C05 (FUSE)	E-PKB-D2214	STEAM GEN BLOWDOWN CTMT ISOLATION VALVE J-SGB-UV-500R
E-ZAB-C05 (FUSE)	E-PKB-D2214	BLOWDOWN SAMPLE CTMT ISOLATION VALVE J-SGB-UV-222
E-ZAB-C05 (FUSE)	E-PKB-D2214	BLOWDOWN SAMPLE CTMT ISOLATION VALVE J-SGB-UV-224
E-ZAB-C05 (FUSE)	E-PKB-D2214	BLOWDOWN SAMPLE CTMT ISOLATION VALVE J-SGB-UV-226
E-ZAB-C06 (FUSE)	E-PKB-D2221	REACTOR COOLANT VENT VALVE J-RCB-HV-105
E-ZAB-C06 (FUSE)	E-PKB-D2221	SAFETY INJ TANK NITROGEN SUPPLY VALVE J-SIB-UV-612
E-ZJB-C03 (FUSE)	E-PKB-D2211	SI TANK CHECK VLV LEAKAGE LINE ISO VALVE J-SIB-UV-638
E-ZJB-C03 (FUSE)	E-PKB-D2211	HOT LEG INJECT CHECK VLV LEAKAGE ISO VLV J-SIB-UV-332
E-ZAN-C01 (FUSE)	E-NKN-D4226	SEAL INJECT VALVES TO RCP J-CHE-FV-241
E-ZAN-C01 (FUSE)	E-NKN-D4224	SEAL INJECT VALVES TO RCP J-CHE-FV-242
E-ZAN-C01 (FUSE)	E-NKN-D4222	SEAL INJECT VALVES TO RCP J-CHE-FV-244
E-ZAN-C01 (FUSE)	E-NKN-D4224	POST ACDT SMPLG SYS ISO VALVE J-CHN-HV-923
E-ZAN-C01 (FUSE)	E-NKN-D4224	REACTOR VESSEL SEAL DRAIN TO RDT VALVE J-RCE-HV-403
E-ZAN-C01 (FUSE)	E-NKN-D4224	SI DRAIN TO REACTOR DRAIN TANK VALVE J-SIE-HV-661

FINAL DRAFT

TABLE 3.8-2 (Continued)

CONTAINMENT PENETRATION CONDUCTOR

OVERCURRENT PROTECTIVE DEVICES

<u>PRIMARY DEVICE NUMBER</u>	<u>BACKUP DEVICE NUMBER</u>	<u>SERVICE DESCRIPTION</u>
E-ZAN-C02 (FUSE)	E-NKN-D4216	SEAL INJECT VALVES TO RCP J-CHE-FV-243
E-ZAN-C02 (FUSE)	E-NKN-D4216	REGEN HEAT EXCH TO CHARGING LINE VALVE J-CHE-PDV-240
E-PGB-L32E2 (FUSE)	E-PGB-L32E2 (FUSE)	CEDM. NORM ACU FAN - B M-HCN-A02B
E-PGB-L34D2 (FUSE)	E-PGB-L34D2 (FUSE)	CTMT NORM ACU FAN - D M-HCN-A01D



## ELECTRICAL POWER SYSTEMS

### MOTOR-OPERATED VALVES THERMAL OVERLOAD PROTECTION AND BYPASS DEVICES

#### LIMITING CONDITION FOR OPERATION

---

3.8.4.2 The thermal overload protection of each valve shown in Table 3.8-3 shall be bypassed continuously or under accident conditions, as applicable, by an OPERABLE device integral with the motor starter.

APPLICABILITY: Whenever the motor-operated valve is required to be OPERABLE. :

#### ACTION:

With the thermal overload protection for one or more of the above required valves not bypassed continuously or under accident conditions, as applicable, by an OPERABLE integral bypass device, take administrative action to continuously bypass the thermal overload within 8 hours or declare the affected valve(s) inoperable and apply the appropriate ACTION Statement(s) for the affected valve(s).

#### SURVEILLANCE REQUIREMENTS

---

4.8.4.2.1 The thermal overload protection for the above required valves shall be verified to be bypassed continuously or under accident conditions, as applicable, by an OPERABLE integral bypass device by the performance of a CHANNEL FUNCTIONAL TEST of the bypass circuitry for those thermal overloads which are normally in force during plant operation and bypassed under accident conditions and by verifying that the thermal overload protection is bypassed for those thermal overloads which are continuously bypassed and temporarily placed in force only when the valve motors are undergoing periodic or maintenance testing:

- a. At least once per 18 months, and
- b. Following maintenance on the motor starter.

4.8.4.2.2 The thermal overload protection for the above required valves which are continuously bypassed shall be verified to be bypassed following testing during which the thermal overload protection was temporarily placed in force.



FINAL DRAFT

TABLE 3.8-3

MOTOR-OPERATED VALVES THERMAL OVERLOAD

PROTECTION AND/OR BYPASS DEVICES

<u>VALVE NUMBER</u>	<u>BYPASS DEVICE (Continuous) (Accident Conditions)</u>	<u>SYSTEM(S) AFFECTED</u>
J-SIA-UV-647	HPSI A Flow Control to Reactor Coolant Valve	Safety Injection Shutdown Clg. Sys.
J-SIA-UV-637	HPSI A Flow Control to Reactor Coolant Valve	Safety Injection Shutdown Clg. Sys.
J-SIA-HV-604	HPSI Pump A Long Term Cooling Valve	Safety Injection Shutdown Clg. Sys.
J-SIB-HV-609	HPSI Pump B Long Term Cooling Valve	Safety Injection Shutdown Clg. Sys.
J-SIA-HV-657	Shutdown Clg. Temp. Control Train A Valve	Safety Injection Shutdown Clg. Sys.
J-SIB-HV-658	Shutdown Clg. Temp. Control Train B Valve	Safety Injection Shutdown Clg. Sys.
J-SIA-HV-685	LPSI - Ctmt Spray Pump Cross Connect A Valve	Safety Injection Shutdown Clg. Sys.
J-SIB-HV-694	LPSI- Ctmt Spray Pump Cross Connect B Valve	Safety Injection Shutdown Clg. Sys.
J-SIA-HV-686	Ctmt Spray A Cross Connect Valve	Safety Injection Shutdown Clg. Sys.
J-SIB-HV-696	Ctmt Spray B Cross Connect Valve	Safety Injection Shutdown Clg. Sys.
J-SIA-HV-688	Shutdown Clg. Heat Exchange A Bypass Valve	Safety Injection Shutdown Clg. Sys.
J-SIB-HV-693	Shutdown Clg. Heat Exchange B Bypass Valve	Safety Injection Shutdown Clg. Sys.
J-SIA-UV-617	HPSI A Flow Control To React Coolant 2A Valve	Safety Injection Shutdown Clg. Sys.

FINAL DRAFT

TABLE 3.8-3 (Continued)  
MOTOR-OPERATED VALVES THERMAL OVERLOAD  
PROTECTION AND/OR BYPASS DEVICES

<u>VALVE NUMBER</u>	<u>BYPASS DEVICE</u> (Continuous) (Accident Conditions)	<u>SYSTEM(S)</u> <u>AFFECTED</u>
J-SIA-UV-627	HPSI A Flow Control To React Coolant 2B Valve	Safety Injection Shutdown Clg. Sys.
J-SIA-UV-645	LPSI Flow Control To React Coolant 1B Valve	Safety Injection Shutdown Clg. Sys.
J-SIA-UV-635	LPSI Flow Control To React Coolant 1A Valve	Safety Injection Shutdown Clg. Sys.
J-SIA-UV-644	Safety Injection Tank 1B Isolation Valve	Safety Injection Shutdown Clg. Sys.
J-SIA-UV-634	Safety Injection Tank 1A Isolation Valve	Safety Injection Shutdown Clg. Sys.
J-SIB-UV-616	HPSI B Flow Control To React Coolant 2A Valve	Safety Injection Shutdown Clg. Sys.
J-SIB-UV-626	HPSI B Flow Control To React Coolant 2B Valve	Safety Injection Shutdown Clg. Sys.
J-SIB-UV-636	HPSI B Flow Control To React Coolant 1A Valve	Safety Injection Shutdown Clg. Sys.
J-SIB-UV-646	HPSI B Flow Control To React Coolant 1B Valve	Safety Injection Shutdown Clg. Sys.
J-SIA-UV-655	Shutdown Clg. Ctmt Isolation Loop 1 Valve	Safety Injection Shutdown Clg. Sys.
J-SIB-UV-656	Shutdown Clg. Ctmt Isolation Loop 2 Valve	Safety Injection Shutdown Clg. Sys.
J-SIA-UV-664	Ctmt Spray Pump A To Refueling Water Tank Isolation Vlv.	Safety Injection Shutdown Clg. Sys.



# FINAL DRAFT

TABLE 3.8-3 (Continued)

MOTOR-OPERATED VALVES THERMAL OVERLOAD

PROTECTION AND/OR BYPASS DEVICES

<u>VALVE NUMBER</u>	<u>BYPASS DEVICE (Continuous) (Accident Conditions)</u>	<u>SYSTEM(S) AFFECTED</u>
J-SIB-UV-665	Ctmt Spray Pump B To Refueling Water Tank Isolation Vlv.	Safety Injection Shutdown Clg. Sys.
J-SIB-UV-615	LPSI Flow Control To React Coolant 2A Valve	Safety Injection Shutdown Clg. Sys.
J-SIB-UV-625	LPSI B Flow Control To React Coolant 2B Valve	Safety Injection Shutdown Clg. Sys.
J-SIA-UV-666	HPSI Pump A to Refueling Water Tank Isolation	Safety Injection Shutdown Clg. Sys.
J-SIB-UV-667	HPSI Pump B to Refueling Water Tank Isolation	Safety Injection Shutdown Clg. Sys.
J-SIA-UV-669	LPSI Pump A To Refueling Water Tank Isolation	Safety Injection Shutdown Clg. Sys.
J-SIB-UV-668	LPSI Pump B to Refueling Water Tank Isolation	Safety Injection Shutdown Clg. Sys.
J-SIA-UV-672	Ctmt Spray Control Train A Valve	Safety Injection Shutdown Clg. Sys.
J-SIB-UV-671	Ctmt Spray Control Train B Valve	Safety Injection Shutdown Clg. Sys.
J-SIA-UV-674	Ctmt Sump Isolation Train A Valve	Safety Injection Shutdown Clg. Sys.
J-SIB-UV-676	Ctmt Sump Isolation Train B Valve	Safety Injection Shutdown Clg. Sys.
J-SIA-UV-651	Shutdown Clg. Isolation Loop 1 Valve	Safety Injection Shutdown Clg. Sys.
J-SIB-UV-652	Shutdown Clg. Isolation Loop 2 Valve	Safety Injection Shutdown Clg. Sys.

TABLE 3.8-3 (Continued)  
MOTOR-OPERATED VALVES THERMAL OVERLOAD  
PROTECTION AND/OR BYPASS DEVICES

<u>VALVE NUMBER</u>	<u>BYPASS DEVICE (Continuous) (Accident Conditions)</u>	<u>SYSTEM(S) AFFECTED</u>
J-SIA-UV-673	Ctmt Sump Isolation Train A Valve	Safety Injection Shutdown Clg. Sys.
J-SIB-UV-675	Ctmt Sump Isolation Train B Valve	Safety Injection Shutdown Clg. Sys.
J-SIB-UV-614	Safety Injection Tank 2A Isolation Valve	Safety Injection Shutdown Clg. Sys.
J-SIB-UV-624	Safety Injection Tank 2B Isolation Valve	Safety Injection Shutdown Clg. Sys.
J-SIA-HV-684	Shutdown Clg. Heat Exchange Isolation Train A	Safety Injection Shutdown Clg. Sys.
J-SIB-HV-689	Shutdown Clg. Heat Exchange Isolation Train B	Safety Injection Shutdown Clg. Sys.
J-SIA-HV-683	LPSI Pump A Isolation Valve	Safety Injection Shutdown Clg. Sys.
J-SIB-HV-692	LPSI Pump B Isolation Valve	Safety Injection Shutdown Clg. Sys.
J-SIA-HV-691	Shutdown Clg. Loop 2 Warm-Up Bypass Valve	Safety Injection Shutdown Clg. Sys.
J-SIB-HV-690	Shutdown Clg. Loop 1 Warm-Up Bypass Valve	Safety Injection Shutdown Clg. Sys.
J-SIA-HV-698	HPSI Pump A Discharge Valve	Safety Injection Shutdown Clg. Sys.
J-SIB-HV-699	HPSI Pump B Discharge Valve	Safety Injection Shutdown Clg. Sys.
J-SIA-HV-306	LPSI Pump A Header Discharge Valve	Safety Injection Shutdown Clg. Sys.





TABLE 3.8-3 (Continued)

MOTOR-OPERATED VALVES THERMAL OVERLOAD

PROTECTION AND/OR BYPASS DEVICES

<u>VALVE NUMBER</u>	<u>BYPASS DEVICE (Continuous) (Accident Conditions)</u>	<u>SYSTEM(S) AFFECTED</u>
J-SIB-HV-307	LPSI Pump B Header Discharge Valve	Safety Injection Shutdown Clg. Sys.
J-SIA-HV-687	Ctmt Spray Isolation Train A Valve	Safety Injection Shutdown Clg. Sys.
J-SIB-HV-695	Ctmt Spray Isolation Train B Valve	Safety Injection Shutdown Clg. Sys.
J-SIA-HV-678	Shutdown Clg. Heat Exchange Isolation Train A	Safety Injection Shutdown Clg. Sys.
J-SIB-HV-679	Shutdown Clg. Heat Exchange Isolation Train B	Safety Injection Shutdown Clg. Sys.
J-SIC-UV-653	Shutdown Clg. Isolation Valve	Safety Injection Shutdown Clg. Sys.
J-SID-UV-654	Shutdown Clg. Isolation Valve	Safety Injection Shutdown Clg. Sys.
J-EWA-UV-65	ECW Loop A To/From NCW Cross Tie Valve	Essential Cooling Water System
J-EWA-UV-145	ECW Loop A To/From NCW Cross Tie Valve	Essential Cooling Water System
J-CTA-HV-1	Condensate Tank to Aux. Feedwater Pump Valve	Condensate Transfer & Storage Sys.
J-CTA-HV-4	Condensate Tank to Aux. Feedwater Pump Valve	Condensate Transfer & Storage Sys.
J-SGA-UV-134	SG-1 Aux. Feedwater Pump A Steam Supply	Main Steam System
J-SGA-UV-138	SG-2 Aux. Feedwater Pump A Steam Supply	Main Steam System



# FINAL DRAFT

TABLE 3.8-3 (Continued)  
MOTOR-OPERATED VALVES THERMAL OVERLOAD  
PROTECTION AND/OR BYPASS DEVICES

<u>VALVE NUMBER</u>	<u>BYPASS DEVICE</u> (Continuous) (Accident Conditions)	<u>SYSTEM(S)</u> <u>AFFECTED</u>
J-NCB-UV-401	NCWS Ctmt Isolation Valve	Nuclear Cooling Water System
J-NCA-UV-402	NCWS Ctmt Isolation Valve	Nuclear Cooling Water System
J-NCB-UV-403	NCWS Ctmt Isolation Valve	Nuclear Cooling Water System
J-AFB-HV-30	Aux. Feedwater Regulating Valve	Auxiliary Feed-water System
J-AFB-HV-31	Aux. Feedwater Regulating Valve	Auxiliary Feed-water System
J-AFB-UV-34	Aux. Feedwater Regulating Valve	Auxiliary Feed-water System
J-AFB-UV-35	Aux. Feedwater Regulating Valve	Auxiliary Feed-water System
J-AFA-HV-32	Aux. Feedwater Regulating Valve	Auxiliary Feed-water System
J-AFA-UV-37	Aux. Feedwater Isolation Valve	Auxiliary Feed-water System
J-AFC-UV-36	Aux. Feedwater Isolation Valve	Auxiliary Feed-water System
J-AFC-HV-33	Aux. Feedwater Regulating Valve	Auxiliary Feed-water System
J-CPA-UV-2A	Ctmt Purge Refueling Mode Isolation Valve	Containment Purge System
J-CPB-UV-3B	Ctmt Purge Refueling Mode Isolation Valve	Containment Purge System
J-CPA-UV-2B	Ctmt Purge Refueling Mode Isolation Valve	Containment Purge System

# FINAL DRAFT

TABLE 3.8-3 (Continued)

MOTOR-OPERATED VALVES THERMAL OVERLOAD.

PROTECTION AND/OR BYPASS DEVICES

<u>VALVE NUMBER</u>	<u>BYPASS DEVICE (Continuous) (Accident Conditions)</u>	<u>SYSTEM(S) AFFECTED</u>
J-CPB-UV-3A	Ctmt Purge Refueling Mode Isolation Valve	Containment Purge System
J-CPA-UV-4A	Ctmt Purge Power Access Mode Isolation Valve	Containment Purge System
J-CPB-UV-5B	Ctmt Purge Power Access Mode Isolation Valve	Containment Purge System
J-CPA-UV-4B	Ctmt Purge Power Access Mode Isolation Valve	Containment Purge System
J-CPB-UV-5A	Ctmt Purge Power Access Mode Isolation Valve	Containment Purge System
J-WCA-UV-62	Normal Chill Water Return Ctmt Isolation	Chilled Water System
J-WCB-UV-63	Normal Chill Water Supply Ctmt Isolation	Chilled Water System
J-WCB-UV-61	Normal Chill Water Return Ctmt Isolation	Chilled Water System
J-RDA-UV-23	Ctmt Radwaste Sumps Internal Isolation	Radioactive Waste Drain System
J-HPA-UV-3	H <sub>2</sub> Ctmt Train A Downstream Supply Isolation	Containment Hydrogen Control Sys.
J-HPA-UV-5	H <sub>2</sub> Ctmt Train A Return Isolation Valve	Containment Hydrogen Control Sys.
J-HPB-UV-4	H <sub>2</sub> Ctmt Train B Downstream Supply Isolation	Containment Hydrogen Control Sys.
J-HPB-UV-6	H <sub>2</sub> Ctmt Train B Return Isolation Valve	Containment Hydrogen Control Sys.

CHANGED to  
HYDRAULIC  
OPERATORS



FINAL DRAFT

TABLE 3.8-3 (Continued)

MOTOR-OPERATED VALVES THERMAL OVERLOAD

PROTECTION AND/OR BYPASS DEVICES

<u>VALVE NUMBER</u>	<u>BYPASS DEVICE</u> (Continuous) (Accident Conditions)	<u>SYSTEM(S)</u> <u>AFFECTED</u>
J-HPB-UV-2	H <sub>2</sub> Ctmt Train B Upstream Supply Isolation	Containment Hydrogen Control Sys.
J-HPA-UV-1	H <sub>2</sub> Ctmt Train A Upstream Supply Isolation	Containment Hydrogen Control Sys.
J-GRA-UV-1	Radioactive Drain Tk Gas Surge Hdr Internal Containment Isolation	Gaseous Radwaste System

## 3/4.9 REFUELING OPERATIONS

### 3/4.9.1 BORON CONCENTRATION

#### LIMITING CONDITION FOR OPERATION

---

3.9.1 With the reactor vessel head closure bolts less than fully tensioned or with the head removed, the boron concentration of all filled portions of the Reactor Coolant System and the refueling canal shall be maintained uniform and sufficient to ensure that the more restrictive of the following reactivity conditions is met:

- a. Either a  $K_{eff}$  of 0.95 or less, or
- b. A boron concentration of greater than or equal to 2150 ppm.

APPLICABILITY: MODE 6\*.

#### ACTION:

With the requirements of the above specification not satisfied, immediately suspend all operations involving CORE ALTERATIONS or positive reactivity changes and initiate and continue boration at greater than or equal to 40 gpm of a solution containing  $\geq 4000$  ppm boron or its equivalent until  $K_{eff}$  is reduced to less than or equal to 0.95 or the boron concentration is restored to greater than or equal to 2150 ppm, whichever is the more restrictive.

#### SURVEILLANCE REQUIREMENTS

---

4.9.1.1 The more restrictive of the above two reactivity conditions shall be determined prior to:

- a. Removing or unbolting the reactor vessel head, and
- b. Withdrawal of any full-length CEA in excess of 3 feet from its fully inserted position within the reactor pressure vessel.

4.9.1.2 The boron concentration of the Reactor Coolant System and the refueling canal shall be determined by chemical analysis at least once per 72 hours.

\*The reactor shall be maintained in MODE 6 whenever fuel is in the reactor vessel with the reactor vessel head closure bolts less than fully tensioned or with the head removed.





FINAL DRAFT

REFUELING OPERATIONS

3/4.9.2 INSTRUMENTATION

LIMITING CONDITION FOR OPERATION

---

3.9.2 As a minimum, two source range neutron flux monitors shall be OPERABLE and operating, each with continuous visual indication in the control room and one with audible indication in the containment and control room.

APPLICABILITY: MODE 6.

ACTION:

- a. With one of the above required monitors inoperable or not operating, immediately suspend all operations involving CORE ALTERATIONS or positive reactivity changes.
- b. With both of the above required monitors inoperable or not operating, determine the boron concentration of the Reactor Coolant System at least once per 12 hours.

SURVEILLANCE REQUIREMENTS

---

4.9.2 Each source range neutron flux monitor shall be demonstrated OPERABLE by performance of:

- a. A CHANNEL CHECK at least once per 12 hours,
- b. A CHANNEL FUNCTIONAL TEST within 8 hours prior to the initial start of CORE ALTERATIONS, and
- c. A CHANNEL FUNCTIONAL TEST at least once per 7 days.

LA /  
**FINAL DRAFT**

REFUELING OPERATIONS

3/4.9.3 DECAY TIME

LIMITING CONDITION FOR OPERATION

---

3.9.3 The reactor shall be subcritical for at least 100 hours.

APPLICABILITY: During movement of irradiated fuel in the reactor pressure vessel.

ACTION:

With the reactor subcritical for less than 100 hours, suspend all operations involving movement of irradiated fuel in the reactor pressure vessel.

SURVEILLANCE REQUIREMENTS

---

4.9.3 The reactor shall be determined to have been subcritical for at least 100 hours by verification of the date and time of subcriticality prior to movement of irradiated fuel in the reactor pressure vessel.

FINAL DRAFT

REFUELING OPERATIONS

3/4.9.4 CONTAINMENT BUILDING PENETRATIONS

LIMITING CONDITION FOR OPERATION

---

3.9.4 The containment building penetrations shall be in the following status:

- a. The equipment door closed and held in place by a minimum of four bolts,
- b. A minimum of one door in each airlock is closed, and
- c. Each penetration providing direct access from the containment atmosphere to the outside atmosphere shall be either:
  1. Closed by an isolation valve, blind flange, or manual valve, or
  2. Be capable of being closed by an OPERABLE automatic containment purge valve.

APPLICABILITY: During CORE ALTERATIONS or movement of irradiated fuel within the containment.

ACTION:

With the requirements of the above specification not satisfied, immediately suspend all operations involving CORE ALTERATIONS or movement of irradiated fuel in the containment building.

SURVEILLANCE REQUIREMENTS

---

4.9.4 Each of the above required containment building penetrations shall be determined to be either in its closed/isolated condition or capable of being closed by an OPERABLE automatic containment purge valve within 72 hours prior to the start of and at least once per 7 days during CORE ALTERATIONS or movement of irradiated fuel in the containment building by:

- a. Verifying the penetrations are in their closed/isolated condition, or
- b. Testing the containment purge valves per the applicable portions of Specification 4.9.9.

FINAL DRAFT

REFUELING OPERATIONS

3/4.9.5 COMMUNICATIONS

LIMITING CONDITION FOR OPERATION

---

3.9.5 Direct communications shall be maintained between the control room and personnel at the refueling station.

APPLICABILITY: During CORE ALTERATIONS.

ACTION:

When direct communications between the control room and personnel at the refueling station cannot be maintained, suspend all CORE ALTERATIONS.

SURVEILLANCE REQUIREMENTS

---

4.9.5 Direct communications between the control room and personnel at the refueling station shall be demonstrated within 1 hour prior to the start of and at least once per 12 hours during CORE ALTERATIONS.

## REFUELING OPERATIONS

FINAL DRAFT

### 3/4.9.6 REFUELING MACHINE

#### LIMITING CONDITION FOR OPERATION

3.9.6 The refueling machine shall be used for movement of fuel assemblies and shall be OPERABLE with:

- a. A minimum capacity of 3590 pounds and an overload cut off limit of less than or equal to 1556 (1727)\* pounds for the refueling machine:

APPLICABILITY: During movement of fuel assemblies within the refueling cavity.

#### ACTION:

With the above requirements for the refueling machine not satisfied, suspend use of the refueling machine from operations involving the movement of fuel assemblies.

#### SURVEILLANCE REQUIREMENTS

4.9.6.1 The refueling machine used for movement of fuel assemblies shall be demonstrated OPERABLE within 72 hours prior to the start of such operations by performing a load test of at least 3590 pounds and demonstrating an automatic load cut off when the refueling machine load exceeds 1556 (1727)\* pounds.

---

\*For initial fuel load only.

**FINAL DRAFT**

REFUELING OPERATIONS

3/4.9.7 CRANE TRAVEL - SPENT FUEL STORAGE POOL BUILDING

LIMITING CONDITION FOR OPERATION

---

3.9.7 Loads in excess of 2000 pounds shall be prohibited from travel over fuel assemblies in the storage pool.

APPLICABILITY: With fuel assemblies in the storage pool.

ACTION:

With the requirements of the above specification not satisfied, place the crane load in a safe condition.

SURVEILLANCE REQUIREMENTS

---

4.9.7 Crane interlocks and physical stops which prevent crane travel with loads in excess of 2000 pounds over fuel assemblies shall be demonstrated OPERABLE within 7 days prior to crane use and at least once per 7 days thereafter during crane operation.



REFUELING OPERATIONS

3/4.9.3 SHUTDOWN COOLING AND COOLANT CIRCULATION

HIGH WATER LEVEL

LIMITING CONDITION FOR OPERATION

---

3.9.8.1 At least one shutdown cooling loop shall be OPERABLE and in operation.\*

APPLICABILITY: MODE 6 when the water level above the top of the reactor pressure vessel flange is greater than or equal to .23 feet.

ACTION:

With no shutdown cooling loop OPERABLE and in operation, suspend all operations involving an increase in the reactor decay heat load or a reduction in boron concentration of the Reactor Coolant System and immediately initiate corrective action to return the required shutdown cooling loop to OPERABLE and operating status as soon as possible. Close all containment penetrations providing direct access from the containment atmosphere to the outside atmosphere within 4 hours.

SURVEILLANCE REQUIREMENTS

---

4.9.8.1 At least one shutdown cooling loop shall be verified to be in operation and circulating reactor coolant at a flow rate of greater than or equal to 4000 gpm at least once per 12 hours.

\*The shutdown cooling loop may be removed from operation for up to 1 hour per 8-hour period during the performance of CORE ALTERATIONS in the vicinity of the reactor pressure vessel hot legs or during surveillance testing.



## REFUELING OPERATIONS

### LOW WATER LEVEL

#### LIMITING CONDITION FOR OPERATION

---

3.9.8.2 Two independent shutdown cooling loops shall be OPERABLE and at least one shutdown cooling loop shall be in operation.\*

APPLICABILITY: MODE 6 when the water level above the top of the reactor pressure vessel flange is less than 23 feet.

#### ACTION:

- a. With less than the required shutdown cooling loops OPERABLE, immediately initiate corrective action to return the required loops to OPERABLE status, or to establish greater than or equal to 23 feet of water above the reactor pressure vessel flange, as soon as possible.
- b. With no shutdown cooling loop in operation, suspend all operations involving an increase in the reactor decay heat load or a reduction in boron concentration of the Reactor Coolant System and immediately initiate corrective action to return the required shutdown cooling loop to operation. Close all containment penetrations providing direct access from the containment atmosphere to the outside atmosphere within 4 hours.

#### SURVEILLANCE REQUIREMENTS

---

4.9.8.2 At least one shutdown cooling loop shall be verified to be in operation and circulating reactor coolant at a flow rate of greater than or equal to 4000 gpm at least once per 12 hours.

---

\* The shutdown cooling loop may be removed from operation for up to 1 hour per 8-hour period during the performance of CORE ALTERATIONS in the vicinity of the reactor pressure vessel hot legs *during Surveillance Testing*

FINAL DRAFT

REFUELING OPERATIONS

3/4.9.9 CONTAINMENT PURGE VALVE ISOLATION SYSTEM

LIMITING CONDITION FOR OPERATION

---

3.9.9 The containment purge valve isolation system shall be OPERABLE.

APPLICABILITY: During CORE ALTERATIONS or movement of irradiated fuel within the containment.

ACTION:

With the containment purge valve isolation system inoperable, close each of the containment purge penetrations providing direct access from the containment atmosphere to the outside atmosphere. The provisions of Specification 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

---

4.9.9 The containment purge valve isolation system shall be demonstrated OPERABLE within 72 hours prior to the start of and at least once per 7 days during CORE ALTERATIONS by verifying that containment purge valve isolation occurs on manual initiation, on CIAS and on CPIAS.

FINAL DRAFT

REFUELING OPERATIONS

3/4.9.10 WATER LEVEL - REACTOR VESSEL

FUEL ASSEMBLIES

LIMITING CONDITION FOR OPERATION

---

3.9.10.1 At least 23 feet of water shall be maintained over the top of the reactor pressure vessel flange.

APPLICABILITY: During movement of fuel assemblies within the reactor pressure vessel when either the fuel assemblies being moved or the fuel assemblies seated within the reactor pressure vessel are irradiated.

ACTION:

With the requirements of the above specification not satisfied, suspend all operations involving movement of fuel assemblies within the pressure vessel.

SURVEILLANCE REQUIREMENTS

---

4.9.10.1 The water level shall be determined to be at least its minimum required depth within 2 hours prior to the start of and at least once per 24 hours thereafter during movement of fuel assemblies.

**FINAL DRAFT**

REFUELING OPERATIONS

CEAs

LIMITING CONDITION FOR OPERATION

---

3.9.10.2 At least 23 feet of water shall be maintained over the top of the fuel seated in the reactor pressure vessel.

APPLICABILITY: During movement of CEAs within the reactor pressure vessel, when the fuel assemblies seated within the reactor pressure vessel are irradiated.

ACTION:

With the requirements of the above specification not satisfied, suspend all operations involving movement of CEAs within the pressure vessel.

SURVEILLANCE REQUIREMENTS

---

4.9.10.2 The water level shall be determined to be at least its minimum required depth within 2 hours prior to the start of and at least once per 24 hours thereafter during movement of CEAs.



FINAL DRAFT

REFUELING OPERATIONS

3/4.9.11 WATER LEVEL - STORAGE POOL

LIMITING CONDITION FOR OPERATION

---

3.9.11 At least 23 feet of water shall be maintained over the top of irradiated fuel assemblies seated in the storage racks.

APPLICABILITY: Whenever irradiated fuel assemblies are in the storage pool.

ACTION:

With the requirement of the specification not satisfied, suspend all movement of fuel assemblies and crane operations with loads in the fuel storage areas and restore the water level to within its limit within 4 hours.

SURVEILLANCE REQUIREMENTS

---

4.9.11 The water level in the storage pool shall be determined to be at least its minimum required depth at least once per 7 days when irradiated fuel assemblies are in the fuel storage pool.

REFUELING OPERATIONS

3/4.9.12 FUEL BUILDING ESSENTIAL VENTILATION SYSTEM

LIMITING CONDITION FOR OPERATION

---

3.9.12 Two independent fuel building essential ventilation systems shall be OPERABLE.

APPLICABILITY: Whenever irradiated fuel is in the storage pool.

ACTION:

- a. With one fuel building essential ventilation system inoperable, fuel movement within the storage pool or crane operation with loads over the storage pool may proceed provided the OPERABLE fuel building essential ventilation system is capable of being powered from an OPERABLE emergency power source. Restore the inoperable fuel building essential ventilation system to OPERABLE status within 7 days or suspend all operations involving movement of fuel within the storage pool or operation of the fuel handling machine over the storage pool.
- b. With no fuel building essential ventilation system OPERABLE, suspend all operations involving movement of fuel within the storage pool or crane operation with loads over the storage pool until at least one fuel building essential ventilation system is restored to OPERABLE status.
- c. The provisions of Specification 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

---

4.9.12 The above required fuel building essential ventilation systems shall be demonstrated OPERABLE:

- a. At least once per 31 days on a STAGGERED TEST BASIS by initiating, from the control room, flow through the HEPA filters and charcoal adsorbers and verifying that the system operates for at least 15 minutes.
- b. At least once per 18 months or (1) after any structural maintenance on the HEPA filter or charcoal adsorber housings, or (2) following painting, fire, or chemical release in any ventilation zone communicating with the system by:

**FINAL DRAFT**

REFUELING OPERATIONS

SURVEILLANCE REQUIREMENTS (Continued)

---

1. Verifying that the cleanup system satisfies the in-place testing acceptance criteria and uses the test procedures of Regulatory Positions C.5.a, C.5.c and C.5.d of Regulatory Guide 1.52, Revision 2, March 1978, and the system flow rate is 6000 cfm  $\pm$  10%.
  2. Verifying within 31 days after removal that a laboratory analysis of a representative carbon sample obtained in accordance with Regulatory Position C.6.b of Regulatory Guide 1.52, Revision 2, March 1978, meets the laboratory testing criteria of Regulatory Position C.6.a of Regulatory Guide 1.52, Revision 2, March 1978.
  3. Verifying a system flow rate of 6000 cfm  $\pm$  10% during system operation when tested in accordance with ANSI N510-1980.
- c. After every 720 hours of charcoal adsorber operation by verifying within 31 days after removal that a laboratory analysis of a representative carbon sample obtained in accordance with Regulatory Position C.6.b of Regulatory Guide 1.52, Revision 2, March 1978, meets the laboratory testing criteria of Regulatory Position C.6.a of Regulatory Guide 1.52, Revision 2, March 1978.
- d. At least once per 18 months by:
1. Verifying that the pressure drop across the combined HEPA filters, pre-filters, heaters, and charcoal adsorber banks is less than 8.4 inches Water Gauge while operating the system at a flow rate of 6000 cfm  $\pm$  10%.
  2. Verifying that on a high radiation test signal, the system automatically starts (unless already operating) and directs its exhaust flow through the HEPA filters and charcoal adsorber banks.
  3. Verifying that the system maintains the fuel building at a measurable negative pressure relative to the outside atmosphere during system operation.





REFUELING OPERATIONS

FINAL DRAFT

SURVEILLANCE REQUIREMENTS (Continued)

---

- e. After each complete or partial replacement of a HEPA filter bank by verifying that the HEPA filter banks remove greater than or equal to 99.0% of the DOP when they are tested in-place in accordance with ANSI N510-1980 while operating the system at a flow rate of 6000 cfm  $\pm$  10%.
- f. After each complete or partial replacement of a charcoal adsorber bank by verifying that the charcoal adsorbers remove greater than or equal to 99.95% of a halogenated hydrocarbon refrigerant test gas when they are tested in-place in accordance with ANSI N510-1980 while operating the system at a flow rate of 6000 cfm  $\pm$  10%.

## 3/4.10 SPECIAL TEST EXCEPTIONS

### 3/4.10.1 SHUTDOWN MARGIN

#### LIMITING CONDITION FOR OPERATION

3.10.1 The SHUTDOWN MARGIN requirement of Specification 3.1.1.1 may be suspended for measurement of CEA worth and shutdown margin provided reactivity equivalent to at least the highest estimated CEA worth is available for trip insertion from OPERABLE CEA(s), or the reactor is subcritical by at least the reactivity equivalent of the highest CEA worth.

APPLICABILITY: MODES 2 and 3.\*

#### ACTION:

- a. With any full-length CEA not fully inserted and with less than the above reactivity equivalent available for trip insertion, immediately initiate and continue boration at greater than or equal to 40 gpm of a solution containing greater than or equal to 4000 ppm boron or its equivalent until the SHUTDOWN MARGIN required by Specification 3.1.1.1 is restored.
- b. With all full-length CEAs fully inserted and the reactor subcritical by less than the above reactivity equivalent, immediately initiate and continue boration at greater than or equal to 40 gpm of a solution containing greater than or equal to 4000 ppm boron or its equivalent until the SHUTDOWN MARGIN required by Specification 3.1.1.1 is restored.

#### SURVEILLANCE REQUIREMENTS

4.10.1.1 The position of each full-length and part-length CEA required either partially or fully withdrawn shall be determined at least once per 2 hours.

4.10.1.2 Each CEA not fully inserted shall be demonstrated capable of full insertion when tripped from at least the 50% withdrawn position within 24 hours prior to reducing the SHUTDOWN MARGIN to less than the limits of Specification 3.1.1.1.

4.10.1.3 When in MODE 3, the reactor shall be determined to be subcritical by at least the reactivity equivalent of the highest estimated CEA worth or the reactivity equivalent of the highest estimated CEA worth is available for trip insertion from OPERABLE CEAs at least once per 2 hours by consideration of at least the following factors:

- a. Reactor Coolant System boron concentration,
- b. CEA position,
- c. Reactor Coolant System average temperature,
- d. Fuel burnup based on gross thermal energy generation,
- e. Xenon concentration, and
- f. Samarium concentration.

\* Operation in MODE 3 shall be limited to 6 consecutive hours.

**FINAL DRAFT**

SPECIAL TEST EXCEPTIONS

3/4.10.2 MODERATOR TEMPERATURE COEFFICIENT, GROUP HEIGHT, INSERTION, AND POWER DISTRIBUTION LIMITS

LIMITING CONDITION FOR OPERATION

3.10.2 The moderator temperature coefficient, group height, insertion, and power distribution limits of Specifications 3.1.1.3, 3.1.3.1, 3.1.3.5, 3.1.3.6, 3.2.2, 3.2.3, 3.2.7, and the Minimum Channels OPERABLE requirement of I.C.1 (CEA Calculators) of Table 3.3-1 may be suspended during the performance of PHYSICS TESTS provided:

- a. The THERMAL POWER is restricted to the test power plateau which shall not exceed 85% of RATED THERMAL POWER, and
- b. The limits of Specification 3.2.1 are maintained and determined as specified in Specification 4.10.2.2 below.

APPLICABILITY: MODES 1 and 2.

ACTION:

With any of the limits of Specification 3.2.1 being exceeded while the requirements of Specifications 3.1.1.3, 3.1.3.1, 3.1.3.5, 3.1.3.6, 3.2.2, 3.2.3, 3.2.7, and the Minimum Channels OPERABLE requirement of I.C.1 (CEA Calculators) of Table 3.3-1 are suspended, either:

- a. Reduce THERMAL POWER sufficiently to satisfy the requirements of Specification 3.2.1, or
- b. Be in HOT STANDBY within 6 hours.

SURVEILLANCE REQUIREMENTS

4.10.2.1 The THERMAL POWER shall be determined at least once per hour during PHYSICS TESTS in which the requirements of Specifications 3.1.1.3, 3.1.3.1, 3.1.3.5, 3.1.3.6, 3.2.2, 3.2.3, 3.2.7, or the Minimum Channels OPERABLE requirement of I.C.1 (CEA Calculators) of Table 3.3-1 are suspended and shall be verified to be within the test power plateau.

4.10.2.2 The linear heat rate shall be determined to be within the limits of Specification 3.2.1 by monitoring it continuously with the Incore Detector Monitoring System pursuant to the requirements of Specifications 4.2.1.3 and 3.3.3.2 during PHYSICS TESTS above 20% of RATED THERMAL POWER in which the requirements of Specifications 3.1.1.3, 3.1.3.1, 3.1.3.5, 3.1.3.6, 3.2.2, 3.2.3, 3.2.7, or the Minimum Channels OPERABLE requirement of I.C.1 (CEA Calculators) of Table 3.3-1 are suspended.

FINAL DRAFT

SPECIAL TEST EXCEPTIONS

3/4.10.3 REACTOR COOLANT LOOPS

LIMITING CONDITION FOR OPERATION

3.10.3 The limitations of Specification 3.4.1.1 and noted requirements of Tables 2.2-1 and 3.3-1 may be suspended during the performance of startup and PHYSICS TESTS, provided:

- a. The THERMAL POWER does not exceed 5% of RATED THERMAL POWER, and
- b. The reactor trip setpoints of the OPERABLE power level channels are set at less than or equal to 20% of RATED THERMAL POWER.
- c. Both reactor coolant loops, and at least one reactor coolant pump in each loop, ~~shall be~~ <sup>ARE</sup> in operation.

APPLICABILITY: During ~~STARTUP~~ <sup>LOW CAPS</sup> and PHYSICS TESTS.

ACTION:

With the THERMAL POWER <sup>WITH</sup> greater than 5% of RATED THERMAL POWER or ~~if~~ <sup>less than</sup> the above required reactor coolant loops ~~is~~ in operation and circulating reactor coolant, immediately trip the reactor.

SURVEILLANCE REQUIREMENTS

4.10.3.1 The THERMAL POWER shall be determined to be less than or equal to 5% of RATED THERMAL POWER at least once per hour during startup and PHYSICS TESTS.

4.10.3.2 Each logarithmic and variable overpower level neutron flux monitoring channel shall be subjected to a CHANNEL FUNCTIONAL TEST within 12 hours prior to initiating startup and PHYSICS TESTS.

4.10.3.3 The above required reactor coolant loops shall be verified to be in operation and circulating reactor coolant at least once per 12 hours.

FINAL DRAFT

SPECIAL TEST EXCEPTIONS

3/4.10.4 CEA POSITION, REGULATING CEA INSERTION LIMITS AND REACTOR COOLANT COLD LEG TEMPERATURE

LIMITING CONDITION FOR OPERATION

3.10.4 The requirements of Specifications 3.1.3.1, 3.1.3.6 and 3.2.6 may be suspended during the performance of PHYSICS TESTS to determine the isothermal temperature coefficient, moderator temperature coefficient, and power coefficient provided the limits of Specification 3.2.1 are maintained and determined as specified in Specification 4.10.4.2 below.

APPLICABILITY: MODES 1 and 2.

ACTION:

With any of the limits of Specification 3.2.1 being exceeded while the requirements of Specifications 3.1.3.1, 3.1.3.6 and 3.2.6 are suspended, either:

- a. Reduce THERMAL POWER sufficiently to satisfy the requirements of Specification 3.2.1, or
- b. Be in HOT STANDBY within 6 hours.

SURVEILLANCE REQUIREMENTS

4.10.4.1 The THERMAL POWER shall be determined at least once per hour during PHYSICS TESTS in which the requirements of Specifications 3.1.3.1, 3.1.3.6 and/or 3.2.6 are suspended and shall be verified to be within the test power plateau.

4.10.4.2 The linear heat rate shall be determined to be within the limits of Specification 3.2.1 by monitoring it continuously with the Incore Detector Monitoring System pursuant to the requirements of Specification 3.3.3.2 during PHYSICS TESTS above 20% of RATED THERMAL POWER in which the requirements of Specifications 3.1.3.1, 3.1.3.6 and/or 3.2.6 are suspended.

## SPECIAL TEST EXCEPTIONS

AND PRESSURE

### 3/4.10.5 MINIMUM TEMPERATURE<sup>A</sup> FOR CRITICALITY

#### LIMITING CONDITION FOR OPERATION

AND PRESSURE

3.10.5 The minimum temperature<sup>A</sup> for criticality limits of Specifications 3.1.1.4 AND 3.2.8 may be suspended during low temperature PHYSICS TESTS to a minimum temperature of 300°F ~~provided~~ AND A minimum pressure of 500 psia ~~provided~~:

- a. The THERMAL POWER does not exceed 5% of RATED THERMAL POWER.
- b. The reactor trip setpoints on the OPERABLE Variable Overpower trip channels are set at  $\leq 20\%$  of RATED THERMAL POWER, and
- c. The Reactor Coolant System temperature and pressure relationship is maintained within the acceptable region of operation required by Specification 3.4.8 except that the core critical line shown on Figure 3.4-2 does not apply.

APPLICABILITY: MODE 2\*.

#### ACTION:

- a. With the THERMAL POWER greater than 5% of RATED THERMAL POWER, immediately open the reactor trip breakers.
- b. With the Reactor Coolant System temperature and pressure relationship within the region of unacceptable operation on Figure 3.4-2, immediately open the reactor trip breakers and restore the temperature-pressure relationship to within its limit within 30 minutes; perform the engineering evaluation required by Specification 3.4.8.1 prior to the next reactor criticality.

#### SURVEILLANCE REQUIREMENTS

4.10.5.1 The Reactor Coolant System temperature and pressure relationship shall be verified to be within the acceptable region for operation of Figure 3.4-2 at least once per hour.

4.10.5.2 The THERMAL POWER shall be determined to be  $\leq 5\%$  of RATED THERMAL POWER at least once per hour.

4.10.5.3 The Reactor Coolant System temperature shall be verified to be greater than or equal to 300°F at least once per hour.

4.10.5.4 Each Logarithmic Power Level and Variable Overpower channel shall be subjected to a CHANNEL FUNCTIONAL TEST within 12 hours prior to initiating low temperature PHYSICS TESTS.

\*First core only, prior to first exceeding 5% RATED THERMAL POWER.

FINAL DRAFT

SPECIAL TEST EXCEPTIONS

3/4.10.6 SAFETY INJECTION TANKS

LIMITING CONDITION FOR OPERATION

---

3.10.6 The safety injection tank isolation valve requirement of Specification 3.5.1a. may be suspended during partial stroke testing of the low pressure safety injection check valves (SI-114, SI-124, SI-134, SI-144) provided:

- a. That power to the isolation valve is restored and the SIAS signal is not overridden.
- b. Only one isolation valve at a time is closed during the testing for no longer than 1 hour.
- c. That the valve is key locked opened with power removed before the next isolation valve is closed.

APPLICABILITY:

While partial stroke testing of the low pressure injection check valves during normal plant operation.

ACTION:

If the requirement of Specification 3.5.1a. was suspended to perform the Specification 3.10.6 partial stroke test and if any of the Specification 3.10.6 requirements are not met during the Specification 3.10.6 partial stroke testing, the Limiting Condition for Operation shall revert to Specification 3.5.1 and the 3.5.1 ACTION shall be applicable.

SURVEILLANCE REQUIREMENTS

---

4.10.6.1 A valve alignment shall be performed within 4 hours following completion of testing to verify that all valves operated during this testing are restored to their normal positions and that power is removed to the SIT isolation valves.



FINAL DRAFT

SPECIAL TEST EXCEPTIONS

3/4.10.7 SPENT FUEL POOL LEVEL

LIMITING CONDITION FOR OPERATION

---

3.10.7 The borated water source of Specifications 3.1.2.5a. and 3.1.2.6a. may be suspended during initial fuel load and startup provided:

- a. The THERMAL POWER does not exceed 5% of RATED THERMAL POWER, and
- b. The reactor trip setpoints of the OPERABLE power level channels are set at less than or equal to 20% of RATED THERMAL POWER.

APPLICABILITY: MODES 2, 3, 4, 5, and 6.

ACTION:

With the THERMAL POWER greater than 5% of RATED THERMAL POWER, immediately trip the reactor.

SURVEILLANCE REQUIREMENTS

---

4.10.7.1 The THERMAL POWER shall be determined to be less than or equal to 5% of RATED THERMAL POWER at least once per hour during startup and PHYSICS TESTS.

4.10.7.2 Each logarithmic and variable overpower level neutron flux monitoring channel shall be subjected to a CHANNEL FUNCTIONAL TEST within 12 hours prior to initiating startup and PHYSICS TESTS.

## SPECIAL TEST EXCEPTIONS

### 3/4.10.8 SAFETY INJECTION TANK PRESSURE

#### LIMITING CONDITION FOR OPERATION

---

3.10.8 The safety injection tank (SIT) pressure of Specification 3.5.1d. may be suspended for low temperature PHYSICS TESTS provided:

- a. The THERMAL POWER does not exceed 5% of RATED THERMAL POWER;
- b. The SITs have been filled per Specification 3.5.1b. and pressurized to 175 to 225 psig below the RCS pressure or not to go below 254 psig;
- c. All valves in the injection lines from the SITs to the RCS are open and the SITs are capable of injecting into the RCS if there is a decrease in RCS pressure.

APPLICABILITY: MODES 2 and 3.

#### ACTION:

If all the SITs do not meet the level and pressure requirements of Specification 3.10.8, restore all the SITs to meet these requirements or be in HOT STANDBY within 6 hours and be in HOT SHUTDOWN within the following 6 hours.

#### SURVEILLANCE REQUIREMENTS

---

4.10.8.1 The THERMAL POWER shall be determined to be less than 5% of RATED THERMAL POWER at least once per hour during low pressure PHYSICS TESTS.

4.10.8.2 Every 8 hours verify:

- a. All the SITs levels meet the requirements of Specification 3.5.1b.
- b. All the SITs pressures meet the requirements of Specification 3.10.8.
- c. The valve alignment from the SITs to the RCS has not changed.

FINAL DRAFT

3/4.11 RADIOACTIVE EFFLUENTS

3/4.11.1 SECONDARY SYSTEM LIQUID WASTE DISCHARGES TO ONSITE EVAPORATION PONDS  
CONCENTRATION

LIMITING CONDITION FOR OPERATION

3.11.1.1 The concentration of radioactive material discharged from secondary system liquid waste to the onsite evaporation ponds shall be limited to the lower limit of detectability (LLD) defined as  $5 \times 10^{-7}$   $\mu\text{Ci/ml}$  for the principal gamma emitters or  $1 \times 10^{-6}$   $\mu\text{Ci/ml}$  for I-131.

APPLICABILITY: MODES 1, 2, 3, and 4.

ACTION:

When any secondary system liquid waste discharge pathway concentration determined in accordance with the surveillance requirements given below exceeds the specified LLD, divert that discharge pathway to the liquid radwaste system without delay.

SURVEILLANCE REQUIREMENTS

4.11.1.1.1 Radioactive liquid wastes collected in the chemical waste neutralizer tank shall be sampled and analyzed prior to their batchwise discharge to the onsite evaporation pond in accordance with the sampling and analysis program specified in Table 4.11-1.

4.11.1.1.2 With the concentration of radioactive material in the chemical waste neutralizer tank exceeding the specified LLD, sample and analyze other secondary system discharge pathways in accordance with the sampling and analysis program specified in Table 4.11-1.

# FINAL DRAFT

TABLE 4.11-1

## RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS PROGRAM

SECONDARY SYSTEM LIQUID RELEASE PATHWAY	SAMPLING FREQUENCY	MINIMUM ANALYSIS FREQUENCY	TYPE OF ACTIVITY ANALYSIS	LOWER LIMIT OF DETECTION (LLD) <sup>a</sup> ( $\mu\text{Ci/mL}$ )
<b>A. Batch discharges<sup>b</sup></b>				
1. Chemical Waste Neutralizer Tank	P Each Batch	P Each Batch	Principal Gamma Emitters <sup>c</sup>	$5 \times 10^{-7}$
			I-131	$1 \times 10^{-6}$
2. Steam Generator Blowdown Low. TDS Sump*	P Each Batch	P Each Batch	Principal Gamma Emitters <sup>c</sup>	$5 \times 10^{-7}$
			I-131	$1 \times 10^{-6}$
3. Condensate Polishing Low TDS Sump*	P Each Batch	P Each Batch	Principal Gamma Emitters <sup>c</sup>	$5 \times 10^{-7}$
			I-131	$1 \times 10^{-6}$
<b>B. Continuous Releases<sup>d</sup></b>				
1. Turbine Building Sump*	D Grab Sample	D Grab Sample	Principal Gamma Emitters <sup>c</sup>	$5 \times 10^{-7}$
			I-131	$1 \times 10^{-6}$
2. Condenser Area Sumps*	D Grab Sample	D Grab Sample	Principal Gamma Emitters <sup>c</sup>	$5 \times 10^{-7}$
			I-131	$1 \times 10^{-6}$

\*Sampling and analysis for pathways 2 and 3 under batch discharges and 1 and 2 under continuous releases are required only when concentration for chemical waste neutralizer tank pathway exceeds the LLD.



TABLE 4.11-1 (Continued)

TABLE NOTATION

<sup>a</sup>The LLD is defined, for purposes of these specifications, as the smallest concentration of radioactive material in a sample that will yield a net count, above system background, that will be detected with 95% probability with only 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system, which may include radiochemical separation:

$$LLD = \frac{4.66 s_b}{E \cdot V \cdot 2.22 \times 10^6 \cdot Y \cdot \exp(-\lambda \Delta t)}$$

Where:

LLD is the "a priori" lower limit of detection as defined above, as microcuries per unit mass or volume,

$s_b$  is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate, as counts per minute,

E is the counting efficiency, as counts per disintegration,

V is the sample size in units of mass or volume,

$2.22 \times 10^6$  is the number of disintegrations per minute per microcurie,

Y is the fractional radiochemical yield, when applicable,

$\lambda$  is the radioactive decay constant for the particular radionuclide, and

$\Delta t$  for plant effluents is the elapsed time between the midpoint of sample collection and time of counting.

Typical values of E, V, Y, and  $\Delta t$  should be used in the calculation.

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as an a posteriori (after the fact) limit for a particular measurement.

<sup>b</sup>A batch release is the discharge of liquid wastes of a discrete volume. Prior to sampling for analyses, each batch shall be isolated, and then thoroughly mixed to assure representative sampling.

FINAL DRAFT

TABLE 4.11-1 (Continued)

TABLE NOTATION

<sup>c</sup>The principal gamma emitters for which the LLD specification applies include the following radionuclides: Mn-54, Fe-59, Co-58, Co-60, Zn-65, Mo-99, Cs-134, Cs-137, Ce-141, and Ce-144. This list does not mean that only these nuclides are to be considered. Other gamma peaks that are identifiable, together with those of the above nuclides, shall also be analyzed and reported in the Semiannual Radioactive Effluent Release Report pursuant to Specification 6.9.1.8.

<sup>d</sup>A continuous release is the discharge of liquid wastes of a nondiscrete volume, e.g., from a volume of a system that has an input flow during the continuous release.

## RADIOACTIVE EFFLUENTS

### DOSE

#### LIMITING CONDITION FOR OPERATION

---

3.11.1.2 The dose or dose commitment to a MEMBER OF THE PUBLIC from radioactive materials in liquid effluents released, from each reactor unit, to UNRESTRICTED AREAS (see Figures 5.1-3) shall be limited:

- a. During any calendar quarter <sup>5.1-1 And</sup> to less than or equal to 1.5 mrem to the total body and to less than or equal to 5 mrem to any organ, and
- b. During any calendar year to less than or equal to 3 mrem to the total body and to less than or equal to 10 mrem to any organ.

APPLICABILITY: At all times.

#### ACTION:

- a. With the calculated dose from the release of radioactive materials in liquid effluents exceeding any of the above limits, prepare and submit to the Commission within 30 days, pursuant to Specification 6.9.2, a Special Report that identifies the cause(s) for exceeding the limit(s) and defines the corrective actions that have been taken to reduce the releases and the proposed corrective actions to be taken to assure that subsequent releases will be in compliance with the above limits.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

---

4.11.1.2 Cumulative dose contributions from liquid effluents for the current calendar quarter and the current calendar year shall be determined in accordance with the methodology and parameters in the ODCM at least once per 31 days.



RADIOACTIVE EFFLUENTS

LIQUID HOLDUP TANKS

LIMITING CONDITION FOR OPERATION

---

3.11.1.3 The quantity of radioactive material contained in each outside temporary tank and the reactor makeup water tank shall be limited to less than or equal to 60 curies, excluding tritium and dissolved or entrained noble gases.

APPLICABILITY: At all times.

ACTION:

- a. With the quantity of radioactive material in any outside temporary tank or the reactor makeup water tank exceeding the above limit, immediately suspend all additions of radioactive material to the tank and within 48 hours reduce the tank contents to within the limit.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

---

4.11.1.3 The quantity of radioactive material contained in each outside temporary tank and the reactor makeup water tank shall be determined to be within the above limit by analyzing a representative sample of the tank's contents at least once per 7 days when radioactive materials are being added to the tank.



RADIOACTIVE EFFLUENTS

FINAL DRAFT

3/4.11.2 GASEOUS EFFLUENTS

DOSE RATE

LIMITING CONDITION FOR OPERATION

---

3.11.2.1 The dose rate due to radioactive materials released in gaseous effluents from the site (see Figures 5.1-1 and 5.1-3) shall be limited to the following:

- a. For noble gases: Less than or equal to 500 mrem/yr to the total body and less than or equal to 3000 mrem/yr to the skin, and
- b. For I-131 and I-133, for tritium, and for all radionuclides in particulate form with half-lives greater than 8 days: Less than or equal to 1500 mrem/yr to any organ.

APPLICABILITY: At all times.

ACTION:

With the dose rate(s) exceeding the above limits, immediately decrease the release rate to within the above limit(s).

SURVEILLANCE REQUIREMENTS

---

4.11.2.1.1 The dose rate due to noble gases in gaseous effluents shall be determined to be within the above limits in accordance with the methods and procedures of the ODCM.

4.11.2.1.2 The dose rate due to I-131, I-133, Tritium and all radionuclides in particulate form with half-lives greater than 8 days in gaseous effluents shall be determined to be within the above limits in accordance with the methods and procedures of the ODCM by obtaining representative samples and performing analyses in accordance with the sampling and analysis program specified in Table 4.11-2.

TABLE 4.11-2

## RADIOACTIVE GASEOUS WASTE SAMPLING AND ANALYSIS PROGRAM

GASEOUS RELEASE TYPE	SAMPLING FREQUENCY	MINIMUM ANALYSIS FREQUENCY	TYPE OF ACTIVITY ANALYSIS	LOWER LIMIT OF DETECTION (LLD) ( $\mu\text{Ci/ml}$ ) <sup>a</sup>
A. Waste Gas Storage Tank	<sup>P</sup> Each Tank Grab Sample	<sup>P</sup> Each Tank	Principal Gamma Emitters <sup>g</sup>	$1 \times 10^{-4}$
B. Containment Purge	<sup>P</sup> Each Purge <sup>b,c</sup> Grab Sample	<sup>P</sup> Each Purge <sup>b,c</sup>	Principal Gamma Emitters <sup>g</sup>	$1 \times 10^{-4}$
			H-3	$1 \times 10^{-6}$
C. 1. Condenser Vacuum Pump Exhaust	<sup>M</sup> <sup>b,e</sup> Grab Sample	<sup>M</sup> <sup>b</sup>	Principal Gamma Emitters <sup>g</sup>	$1 \times 10^{-4}$
2. Plant Vent	Sample		H-3	$1 \times 10^{-6}$
3. Fuel Bldg. Exhaust	Continuous <sup>f</sup>	<sup>4/m</sup> <sup>d</sup> Charcoal Sample	I-131	$1 \times 10^{-12}$
	Continuous <sup>f</sup>	<sup>4m</sup> <sup>d</sup> Particulate Sample	I-133	$1 \times 10^{-10}$
	Continuous <sup>f</sup>	<sup>M</sup> Composite Particulate Sample	Principal Gamma Emitters <sup>g</sup> (I-131, Others)	$1 \times 10^{-11}$
	Continuous <sup>f</sup>	<sup>M</sup> Composite Particulate Sample	Gross Alpha	$1 \times 10^{-11}$
	Continuous <sup>f</sup>	<sup>Q</sup> Composite Particulate Sample	Sr-89, Sr-90	$1 \times 10^{-11}$
D. All Radwaste Types as listed in A., B., and C. above.	Continuous <sup>f</sup>	Noble Gas Monitor	Noble Gases Gross Beta or Gamma	$1 \times 10^{-6}$

PALO VERDE - UNIT 1

3/4 11-8

FINAL COPY



TABLE 4.11-2 (Continued)

TABLE NOTATION

<sup>a</sup>The LLD is the smallest concentration of radioactive material in a sample that will yield a net count above background that will be detected with 95% probability with 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system (which may include radiochemical separation):

$$LLD = \frac{4.66 s_b}{E \cdot V \cdot 2.22 \times 10^6 \cdot Y \cdot \exp(-\lambda \Delta t)}$$

Where:

LLD is the "a priori" lower limit of detection as defined above (as pCi per unit mass or volume). Current literature defines the LLD as the detection capability for the instrumentation only and the MDC minimum detectable concentration, as the detection capability for a given instrument procedure and type of sample.

$s_b$  is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (as counts per minute),

E is the counting efficiency (as counts per transformation),

V is the sample size (in units of mass or volume),

2.22 is the number of transformations per minute per picocurie,

Y is the fractional radiochemical yield (when applicable),

$\lambda$  is the radioactive decay constant for the particular radionuclide, and

$\Delta t$  is the elapsed time between the midpoint of sample collection and time of counting (for plant effluents, not environmental samples).

The value of  $s_b$  used in the calculation of the LLD for a detection system shall be based on the actual observed variance of the background counting rate or of the counting rate of the blank samples (as appropriate) rather than on an unverified theoretically predicted variance. In calculating the LLD for a radionuclide determined by gamma-ray spectrometry the background should include the typical contributions of other radionuclides normally present in the samples. Typical values of E, V, Y, and  $\Delta t$  should be used in the calculation.

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as an a posteriori (after the fact) limit for a particular measurement.\*

\*For a more complete discussion of the LLD, and other detection limits, see the following:

- (1) HASL Procedures Manual, HASL-300 (revised annually).
- (2) Currie, L. A., "Limits for Qualitative Detection and Quantitative Determination - Application to Radiochemistry" Anal. Chem. 40, 586-93 (1968).
- (3) Hartwell, J. K., "Detection Limits for Radioisotopic Counting Techniques," Atlantic Richfield Hanford Company Report (ARH-2537 (June 22, 1972).



TABLE 4.11-2 (Continued)

TABLE NOTATION

- <sup>b</sup> Analyses shall also be performed following SHUTDOWN, STARTUP, or a THERMAL POWER change exceeding 15% of the RATED THERMAL POWER within a 1-hour period ~~unless~~ 1) analysis shows that the DOSE EQUIVALENT I-131 concentration in the primary coolant has increased more than a factor of 3; and 2) the noble gas activity monitor on the plant vent shows that effluent activity has increased by more than a factor of 3. If the associated noble gas vent monitor is inoperable, samples must be obtained as soon as possible. Analyses shall be performed within a four-hour period. This requirement does not apply to the Fuel Building Exhaust.
- <sup>c</sup> Sampling and analyses shall also be performed at least once per 31 days when purging time exceeds 30 days continuous.
- <sup>d</sup> Samples shall be changed at least ~~once per 7 days~~ <sup>4 TIMES A MONTH</sup> and analyses shall be completed within 48 hours after changing (or after removal from sampler). When samples collected for 24 hours are analyzed, the corresponding LLDs may be increased by a factor of 10.
- <sup>e</sup> Tritium grab samples shall be taken at least monthly from the ventilation exhaust from the spent fuel pool area, whenever spent fuel is in the spent fuel pool.
- <sup>f</sup> The ratio of the sample flow rate to the sampled stream flow rate shall be known for the time period covered by each dose or dose rate calculation made in accordance with Specifications 3.11.2.1, 3.11.2.2, and 3.11.2.3.
- <sup>g</sup> The principal gamma emitters for which the LLD specification applies include the following radionuclides: Kr-87, Kr-88, Xe-133, Xe-133m, Xe-135, and Xe-138 for gaseous emissions and Mn-54, Fe-59, Co-58, Co-60, Zn-65, Mo-99, Cs-134, Cs-137, Ce-141 and Ce-144 for particulate emissions. This list does not mean that only these nuclides are to be detected and reported. Other peaks which are measureable and identifiable, together with the above nuclides, shall also be identified and reported in the Semiannual Radioactive Effluent Release Report.



**FINAL DRAFT**

RADIOACTIVE EFFLUENTS

DOSE - NOBLE GASES

LIMITING CONDITION FOR OPERATION

---

3.11.2.2 The air dose due to noble gases released in gaseous effluents, from each reactor unit, to areas at and beyond the SITE BOUNDARY (see Figures 5.1-1 and 5.1-3) shall be limited to the following:

- a. During any calendar quarter: Less than or equal to 5 mrad for gamma radiation and less than or equal to 10 mrad for beta radiation and,
- b. During any calendar year: Less than or equal to 10 mrad for gamma radiation and less than or equal to 20 mrad for beta radiation.

APPLICABILITY: At all times.

ACTION

- a. With the calculated air dose from radioactive noble gases in gaseous effluents exceeding any of the above limits, prepare and submit to the Commission within 30 days, pursuant to Specification 6.9.2, a Special Report that identifies the cause(s) for exceeding the limit(s) and defines the corrective actions that have been taken to reduce the releases and the proposed corrective actions to be taken to assure that subsequent releases will be in compliance with the above limits.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

---

4.11.2.2 Cumulative dose contributions for the current calendar quarter and current calendar year for noble gases shall be determined in accordance with the methodology and parameters in the ODCM at least once per 31 days.

RADIOACTIVE EFFLUENTS

DOSE - IODINE-131, IODINE-133, TRITIUM, AND RADIONUCLIDES IN PARTICULATE FORM

LIMITING CONDITION FOR OPERATION

3.11.2.3 The dose to a MEMBER OF THE PUBLIC from iodine-131, iodine-133, tritium, and all radionuclides in particulate form with half-lives greater than 8 days in gaseous effluents released, from each reactor unit, to areas at and beyond the SITE BOUNDARY (see Figures 5.1-1 and 5.1-3) shall be limited to the following:

- a. During any calendar quarter: Less than or equal to 7.5 mrem to any organ and,
- b. During any calendar year: Less than or equal to 15 mrem to any organ.

APPLICABILITY: At all times.

ACTION:

- a. With the calculated dose from the release of iodine-131, iodine-133, tritium, and radionuclides in particulate form with half-lives greater than 8 days, in gaseous effluents exceeding any of the above limits, prepare and submit to the Commission within 30 days, pursuant to Specification 6.9.2, a Special Report that identifies the cause(s) for exceeding the limit and defines the corrective actions that have been taken to reduce the releases and the proposed corrective actions to be taken to assure that subsequent releases will be in compliance with the above limits.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

4.11.2.3 Cumulative dose contributions for the current calendar quarter and current calendar year for iodine-131, iodine-133, tritium, and radionuclides in particulate form with half-lives greater than 8 days shall be determined in accordance with the methodology and parameters in the ODCM at least once per 31 days.

## RADIOACTIVE EFFLUENTS

### GASEOUS RADWASTE TREATMENT

#### LIMITING CONDITION FOR OPERATION

---

3.11.2.4 The GASEOUS RADWASTE SYSTEM and the VENTILATION EXHAUST TREATMENT SYSTEM shall be used to reduce radioactive materials in gaseous waste prior to their discharge when the projected gaseous effluent air doses due to gaseous effluent releases, from each reactor unit, from the site (see Figures 5.1-1 and 5.1-3), when averaged over 31 days, would exceed 0.2 mrad for gamma radiation and 0.4 mrad for beta radiation. The VENTILATION EXHAUST TREATMENT SYSTEM shall be used to reduce radioactive materials in gaseous waste prior to their discharge when the projected doses due to gaseous effluent releases, from each reactor unit, to areas at and beyond the SITE BOUNDARY (see Figures 5.1-1 and 5.1-3) when averaged over 31 days would exceed 0.3 mrem to any organ of a MEMBER OF THE PUBLIC.

APPLICABILITY: At all times.

#### ACTION:

- a. With radioactive gaseous waste being discharged without treatment and in excess of the above limits, prepare and submit to the Commission within 30 days, pursuant to Specification 6.9.2, a Special Report which includes the following information:
  1. Identification of the inoperable equipment or subsystems and the reason for inoperability,
  2. Action(s) taken to restore the inoperable equipment to OPERABLE status, and
  3. Summary description of action(s) taken to prevent a recurrence.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

---

4.11.2.4 Doses due to gaseous releases from the site shall be projected at least once per 31 days, in accordance with the methodology and parameters in the ODCM.

RADIOACTIVE EFFLUENTS

EXPLOSIVE GAS MIXTURE

LIMITING CONDITION FOR OPERATION

3.11.2.5 The concentration of oxygen in the waste gas holdup system shall be limited to less than or equal to 2% by volume whenever the hydrogen concentration exceeds 4% by volume.

APPLICABILITY: At all times.

ACTION:

- a. With the concentration of oxygen in the waste gas holdup system greater than 2% by volume but less than or equal to 4% by volume, reduce the oxygen concentration to the above limit within 48 hours.
- b. With the concentration of oxygen in the waste gas holdup system greater than 4% by volume, immediately suspend all additions of waste gases to the system and reduce the concentration of oxygen to less than 4% by volume within 6 hours.
- c. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

4.11.2.5 The concentration of hydrogen or oxygen in the waste gas holdup system shall be determined to be within the above limits by continuously monitoring the waste gases in the waste gas holdup system with the hydrogen and oxygen monitors required OPERABLE by Table 3.3-12 of Specification 3.3.3.9.

FINAL DRAFT

RADIOACTIVE EFFLUENTS

GAS STORAGE TANKS

LIMITING CONDITION FOR OPERATION

---

3.11.2.6 The quantity of radioactivity contained in each gas storage tank shall be limited to less than or equal to 170,000 curies noble gases (considered as Xe-133).

APPLICABILITY: At all times.

ACTION:

- a. With the quantity of radioactive material in any gas storage tank exceeding the above limit, immediately suspend all additions of radioactive material to the tank and within 48 hours reduce the tank contents to within the limit.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

---

4.11.2.6 The quantity of radioactive material contained in each gas storage tank shall be determined to be within the above limit at least once per 7 days when radioactive materials are being added to the tank and the quantity of radioactivity contained in the tank is less than or equal to one-half of the above limit; otherwise, determine the quantity of radioactive material contained in the tank at least once per 24 hours during addition.

FINAL DRAFT

RADIOACTIVE EFFLUENTS

3/4.11.3 SOLID RADIOACTIVE WASTE

LIMITING CONDITION FOR OPERATION

3.11.3 The solid radwaste system shall be OPERABLE and used, as applicable in accordance with a PROCESS CONTROL PROGRAM, for the SOLIDIFICATION and packaging of radioactive wastes to ensure meeting the requirements of 10 CFR Part 20 and of 10 CFR Part 71 prior to shipment of radioactive wastes from the site.

APPLICABILITY: At all times.

ACTION:

- a. With the packaging requirements of 10 CFR Part 20 and/or 10 CFR Part 71 not satisfied, suspend shipments of defectively packaged solid radioactive wastes from the site.
- b. With the solid radwaste system inoperable for more than 31 days, prepare and submit to the Commission within 30 days pursuant to Specification 6.9.2 a Special Report which includes the following information:
  1. Identification of the inoperable equipment or subsystems and the reason for inoperability.
  2. Action(s) taken to restore the inoperable equipment to OPERABLE status,
  3. A description of the alternative used for SOLIDIFICATION and packaging of radioactive wastes, and
  4. Summary description of action(s) taken to prevent a recurrence.
- c. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

4.11.3.1 The solid radwaste system shall be demonstrated OPERABLE at least once per 92 days by:

- a. Operating the solid radwaste system at least once in the previous 92 days in accordance with the PROCESS CONTROL PROGRAM, or
- b. Verification of the existence of a valid contract for SOLIDIFICATION to be performed by a contractor in accordance with a PROCESS CONTROL PROGRAM.



FINAL DRAFT

RADIOACTIVE EFFLUENTS

SURVEILLANCE REQUIREMENTS (Continued).

---

4.11.3.2 THE PROCESS CONTROL PROGRAM shall be used to verify the SOLIDIFICATION of at least one representative test specimen from at least every tenth batch of each type of wet radioactive waste (e.g., spent resins, evaporator bottoms, and boric acid solutions).

- a. If any test specimen fails to verify SOLIDIFICATION, the SOLIDIFICATION of the batch under test shall be suspended until such time as additional test specimens can be obtained, alternative SOLIDIFICATION parameters can be determined in accordance with the PROCESS CONTROL PROGRAM, and a subsequent test verifies SOLIDIFICATION. SOLIDIFICATION of the batch may then be resumed using the alternative SOLIDIFICATION parameters determined by the PROCESS CONTROL PROGRAM.
- b. If the initial test specimen from a batch of waste fails to verify SOLIDIFICATION, the PROCESS CONTROL PROGRAM shall provide for the collection and testing of representative test specimens from each consecutive batch of the same type of wet waste until at least three consecutive initial test specimens demonstrate SOLIDIFICATION. The PROCESS CONTROL PROGRAM shall be modified as required, as provided in Specification 6.13, to assure SOLIDIFICATION of subsequent batches of waste.





## RADIOACTIVE EFFLUENTS

### 3/4.11.4 TOTAL DOSE

#### LIMITING CONDITION FOR OPERATION

3.11.4 The annual (calendar year) dose or dose commitment to any MEMBER OF THE PUBLIC due to releases of radioactivity and to radiation from uranium fuel cycle sources shall be limited to less than or equal to 25 mrem to the total body or any organ, except the thyroid, which shall be limited to less than or equal to 75 mrem.

APPLICABILITY: At all times.

#### ACTION:

- a. With the calculated doses from the release of radioactive materials in liquid and gaseous effluents exceeding twice the limits of Specifications 3.11.1.2a., 3.11.1.2b., 3.11.2.2a., 3.11.2.2b., 3.11.2.3a., or 3.11.2.3b., calculations should be made including direct radiation contributions from the reactor units and from outside storage tanks to determine whether the above limits of Specification 3.11.4 have been exceeded. If such is the case, prepare and submit to the Commission within 30 days, pursuant to Specification 6.9.2, a Special Report that defines the corrective action to be taken to reduce subsequent releases to prevent recurrence of exceeding the above limits and includes the schedule for achieving conformance with the above limits. This Special Report, as defined in 10 CFR 20.405c, shall include an analysis that estimates the radiation exposure (dose) to a MEMBER OF THE PUBLIC from uranium fuel cycle sources, including all effluent pathways and direct radiation, for the calendar year that includes the release(s) covered by this report. It shall also describe levels of radiation and concentrations of radioactive material involved, and the cause of the exposure levels or concentrations. If the estimated dose(s) exceeds the above limits, and if the release condition resulting in violation of 40 CFR Part 190 has not already been corrected, the Special Report shall include a request for a variance in accordance with the provisions of 40 CFR Part 190. Submittal of the report is considered a timely request, and a variance is granted until staff action on the request is complete.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

4.11.4.1 Cumulative dose contributions from liquid and gaseous effluents shall be determined in accordance with Specifications 4.11.1.2, 4.11.2.2, and 4.11.2.3, and in accordance with the methodology and parameters in the ODCM.

4.11.4.2 Cumulative dose contributions from direct radiation from the reactor units and from radwaste storage tanks shall be determined in accordance with the methodology and parameters in the ODCM. This requirement is applicable only under conditions set forth in Specification 3.11.4a.

FINAL DRAFT

### 3/4.12 RADIOLOGICAL ENVIRONMENTAL MONITORING

#### 3/4.12.1 MONITORING PROGRAM

##### LIMITING CONDITION FOR OPERATION

3.12.1 The radiological environmental monitoring program shall be conducted as specified in Table 3.12-1.

APPLICABILITY: At all times.

ACTION:

- a. With the radiological environmental monitoring program not being conducted as specified in Table 3.12-1, prepare and submit to the Commission, in the Annual Radiological Environmental Operating Report required by Specification 6.9.1.7, a description of the reasons for not conducting the program as required and the plans for preventing a recurrence.
- b. With the level of radioactivity as the result of plant effluents in an environmental sampling medium at a specified location exceeding the reporting levels of Table 3.12-2 when averaged over any calendar quarter, prepare and submit to the Commission within 30 days, pursuant to Specification 6.9.2, a Special Report that identifies the cause(s) for exceeding the limit(s) and defines the corrective actions to be taken to reduce radioactive effluents so that the potential annual dose\* to A MEMBER OF THE PUBLIC is less than the calendar year limits of Specifications 3.11.1.2, 3.11.2.2, and 3.11.2.3. When more than one of the radionuclides in Table 3.12-2 are detected in the sampling medium, this report shall be submitted if:

$$\frac{\text{concentration (1)}}{\text{reporting level (1)}} + \frac{\text{concentration (2)}}{\text{reporting level (2)}} + \dots \geq 1.0$$

When radionuclides other than those in Table 3.12-2 are detected and are the result of plant effluents, this report shall be submitted if the potential annual dose\* to A MEMBER OF THE PUBLIC is equal to or greater than the calendar year limits of Specifications 3.11.1.2, 3.11.2.2, and 3.11.2.3. This report is not required if the measured level of radioactivity was not the result of plant effluents; however, in such an event, the condition shall be reported and described in the Annual Radiological Environmental Operating Report.

- c. With milk or fresh leafy vegetable samples unavailable from one or more of the sample locations required by Table 3.12-1, identify locations for obtaining replacement samples and add them to the radiological environmental monitoring program within 30 days. The specific

\*The methodology and parameters used to estimate the potential annual dose to a MEMBER OF THE PUBLIC shall be indicated in this report.

FINAL DRAFT

RADIOLOGICAL ENVIRONMENTAL MONITORING

LIMITING CONDITION FOR OPERATION (Continued)

---

ACTION: (Continued)

locations from which samples were unavailable may then be deleted from the monitoring program. Pursuant to Specification 6.9.1.8, identify the cause of the unavailability of samples and identify the new location(s) for obtaining replacement samples in the next Semiannual Radioactive Effluent Release Report and also include in the report a revised figure(s) and table for the ODCM reflecting the new location(s).

- d. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

---

4.12.1 The radiological environmental monitoring samples shall be collected pursuant to Table 3.12-1 from the specific locations given in the table and figure(s) in the ODCM, and shall be analyzed pursuant to the requirements of Table 3.12-1, and the detection capabilities required by Table 4.12-1.

FINAL DRAFT

TABLE 3.12-1

RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

EXPOSURE PATHWAY AND/OR SAMPLE	NUMBER OF REPRESENTATIVE SAMPLES AND SAMPLE LOCATIONS <sup>a</sup>	SAMPLING AND COLLECTION FREQUENCY <sup>a</sup>	TYPE AND FREQUENCY OF ANALYSIS <sup>e</sup>
Airborne			
Radioiodine and partic- ulates	<p>Samples from 5 locations: 3 samples at or near the SITE BOUNDARIES (#14A, 15, 21) in different sectors of the highest calculated annual average ground level D/Q.*</p> <p>1 sample (#40) from areas of special interest, which is from the vicinity of a community having the highest calculated annual average D/Q. #40</p> <p>1 sample (#66) from a control location 15-30 km (10-20 mi) distant and in the least prevalent wind direction.</p>	<p>Continuous sampling collected weekly,<sup>c</sup> or more frequently if required by dust loading</p>	<p>Gross beta weekly; I-131 weekly; gamma isotopic analysis monthly; composite of filters<sup>d,e</sup></p>
Direct radiation <sup>b</sup>	<p>40 stations (#6-45) with two or more dosimeters for measuring dose rate continuously, placed as follows: an inner ring of stations at the site boundary and an outer ring in the 4-to-5 mi range from the site with a station in each sector of each ring, except the WNW sector, which is inaccessible (16 sectors x 2 rings minus 1 = 31 sta- tions). 7 additional stations are in local schools and population centers; 2 other stations are used as controls.</p>	<p>Quarterly</p>	<p>Gamma dose quarterly</p>

\*D/Q refers to average annual relative ground deposition rate.

# FINAL DRAFT

TABLE 3.12-1 (Continued)  
RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

EXPOSURE PATHWAY AND/OR SAMPLE	NUMBER OF REPRESENTATIVE SAMPLES AND SAMPLE LOCATIONS <sup>a</sup>	SAMPLING AND COLLECTION FREQUENCY <sup>a</sup>	TYPE AND FREQUENCY OF ANALYSIS <sup>e</sup>
Waterborne			
Surface	Water storage reservoir (#60) evaporation pond (#59)	Monthly composite of weekly grab sample	Gamma isotopic analysis monthly; tritium quarterly
Ground	2 onsite wells <sup>g</sup> (#57, 58)	Quarterly grab sample	Tritium and gamma isotopic analysis quarterly
Drinking (well)	3 wells from surrounding residences (#46, 48, 49)	Monthly composite of weekly grab sample	Gross beta and gamma isotopic analysis monthly; tritium quarterly <sup>h</sup>
Ingestion			
Milk	Samples from milking animals in 3 locations (#50, 51, 53) within 5 km distance having the highest dose potential. If there are none, 1 sample from milking animals in each of 3 areas between 5 and 8 km distant where doses are calculated to be greater than 1 mrem per year.*  One sample from milking animals at a control location #56 (#6), 15 to 30 km distant and in the least prevalent wind direction.	Semimonthly for animals on pasture; other- wise, monthly	Gamma isotopic analysis and radio- iodine semi-monthly when animals are on pasture or monthly <sup>h</sup> at other times
Food products	Local farms (#14, 46, 47) of highest predicted annual average ground level D/Q, one sample of each principal class of food products from any area that is irrigated by water in which plant liquid wastes have been discharged**	At harvest <sup>i</sup>	Gamma isotopic analysis and radio- iodine monthly <sup>h</sup>

\*The dose shall be calculated for the maximum organ and age group using the methodology and parameters in the ODCM.

\*\*When samples are not available, 4 existing supplemental airborne radioiodine sample locations will be used.

TABLE 3.12-1 (Continued)TABLE NOTATIONS

<sup>a</sup>The number, media, frequency, and location of sampling may vary from site to site. It is recognized that, at times, it may not be possible or practical to obtain samples of the media of choice at the most desired location or time. In these instances suitable alternative media and locations may be chosen for the particular pathway in question and submitted for acceptance. Actual locations (distance and direction) from the site shall be provided in Table 7-1 and Figure 7-1 in the ODCM. Refer to Regulatory Guide 4.1, "Programs for Monitoring Radioactivity in the Environs of Nuclear Power Plants."

<sup>b</sup>Regulatory Guide 4.13 provides guidance for thermoluminescence dosimetry (TLD) systems used for environmental monitoring. One or more instruments, such as a pressurized ion chamber, for measuring and recording dose rate continuously may be used in place of, or in addition to, integrating dosimeters. For the purposes of this table, a thermoluminescent dosimeter may be considered to be one phosphor, and two or more phosphors in a packet may be considered as two or more dosimeters. Film badges should not be used for measuring direct radiation.

<sup>c</sup>Canisters for the collection of radioiodine in air are subject to channeling. These devices should be carefully checked before operation in the field or several should be mounted in series to prevent loss of iodine.

<sup>d</sup>Particulate sample filters shall be analyzed for gross beta 24 hours or more after sampling to allow for radon and thoron daughter decay. If gross beta activity in air or water is greater than 10 times the yearly mean of control samples for any medium, gamma isotopic analysis should be performed on the individual samples.

<sup>e</sup>Gamma isotopic analysis means the identification and quantification of gamma-emitting radionuclides that may be attributable to the effluents from the facility.

<sup>f</sup>The purpose of this sample is to obtain background information. If it is not practical to establish control locations in accordance with the distance and wind direction criteria, other sites that provide valid background data may be substituted.

<sup>g</sup>Groundwater samples should be taken when this source is tapped for drinking or irrigation purposes in areas where the hydraulic gradient or recharge properties are suitable for contamination.

TABLE 3.12-1 (Continued)

TABLE NOTATIONS (Continued)

<sup>h</sup>The dose shall be calculated for the maximum organ and age group, using the methodology contained in Regulatory Guide 1.109, Rev. 1, and the actual parameters particular to the site.

<sup>i</sup>If harvest occurs more than once a year, sampling should be performed during each discrete harvest. If harvest occurs continuously, sampling should be monthly. Attention shall be paid to including samples of tuberous and root food products.



TABLE 3.12-2

REPORTING LEVELS FOR RADIOACTIVITY CONCENTRATIONS IN ENVIRONMENTAL SAMPLES

## REPORTING LEVELS

ANALYSIS	WATER (pCi/l)	AIRBORNE PARTICULATE OR GASES (pCi/m <sup>3</sup> )	MILK (pCi/l)	FOOD PRODUCTS (pCi/kg, wet)
H-3	20,000*			
Mn-54	1,000			
Fe-59	400			
Co-58	1,000			
Co-60	300			
Zn-65	300			
Zr-Nb-95	400			
I-131	2	0.9	3	100
Cs-134	30	10	60	1,000
Cs-137	50	20	70	2,000
Ba-La-140	200		300	

\*For drinking water samples. This is 40 CFR Part 141 value. If no drinking pathway exists, a value of 30,000 pCi/l may be used.

RECEIVED  
MAY 1967



TABLE 4.12-1

DETECTION CAPABILITIES FOR ENVIRONMENTAL SAMPLE ANALYSIS<sup>a</sup>LOWER LIMIT OF DETECTION (LLD)<sup>b</sup>

ANALYSIS	WATER (pCi/l)	AIRBORNE PARTICULATE OR GAS (pCi/m <sup>3</sup> )	MILK (pCi/l)	FOOD PRODUCTS (pCi/kg, wet)
Gross beta	4	0.01		
H-3	2000			
Mn-54	15			
Fe-59	30			
Co-58, -60	15			
Zn-65	30			
Zr-95	30			
Nb-95	15			
I-131	1 <sup>c</sup>	0.07	1	60
Cs-134	15	0.05	15	60
Cs-137	18	0.06	18	80
Ba-140	60		60	
La-140	15		15	

Note: This list does not mean that only these nuclides are to be detected and reported. Other peaks that are measureable and identifiable, together with the above nuclides, shall also be identified and reported. IF NO DRINKING PATHWAY EXISTS, A VALUE OF 30000 pCi/l may be used

FINAL  
DATE

TABLE 4.12-1 (Continued)

TABLE NOTATION

<sup>a</sup>Guidance for detection capabilities for thermoluminescent dosimeters used for environmental measurements is given in Regulatory Guide 4.13.

<sup>b</sup>Table 4.12-1 indicates acceptable detection capabilities for radioactive materials in environmental samples. These detection capabilities are tabulated in terms of the lower limits of detection (LLDs). The LLD is defined, for purposes of this guide, as the smallest concentration of radioactive material in a sample that will yield a net count (above system background) that will be detected with 95% probability with only 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system (which may include radiochemical separation):

$$LLD = \frac{4.66 s_b}{E \cdot V \cdot 2.22 \cdot Y \cdot \exp(-\lambda \Delta t)}$$

Where:

LLD is the "a priori" lower limit of detection as defined above (as picocuries per unit mass or volume).

$s_b$  is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (as counts per minute)

E is the counting efficiency (as counts per disintegration)

V is the sample size (in units of mass or volume)

2.22 is the number of disintegrations per minute per picocurie

Y is the fractional radiochemical yield (when applicable)

$\lambda$  is the radioactive decay constant for the particular radionuclide

$\Delta t$  for environmental samples is the elapsed time between sample collection (or end of the sample collection period) and time of counting

FINAL DRAFT

TABLE 4.12-1 (Continued)

TABLE NOTATION

In calculating the LLD for a radionuclide determined by gamma-ray spectrometry the background should include the typical contributions of other radionuclides normally present in the samples (e.g., potassium-40 in milk samples). Typical values of E, V, Y, and Wt should be used in the calculation.

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as an a posteriori (after the fact) limit for a particular measurement. Analyses shall be performed in such a manner that the stated LLDs will be achieved under routine conditions. Occasionally background fluctuations, unavoidable small sample sizes, the presence of interfering nuclides, or other uncontrollable circumstances may render these LLDs unachievable. In such cases, the contributing factors shall be identified and described in the Annual Radiological Environmental Operating Report.

<sup>c</sup> LLD for drinking water samples. If no drinking water pathway exists, the LLD of gamma isotopic analysis may be used.

## RADIOLOGICAL ENVIRONMENTAL MONITORING

### 3/4.12.2 LAND USE CENSUS

#### LIMITING CONDITION FOR OPERATION

3.12.2 A land use census shall be conducted and shall identify within a distance of 8 km (5 miles) the location in each of the 16 meteorological sectors of the nearest milk animal, the nearest residence and the nearest garden\* of greater than 50 m<sup>2</sup> (500 ft<sup>2</sup>) producing broad leaf vegetation.

APPLICABILITY: At all times.

#### ACTION:

- a. With a land use census identifying a location(s) that yields a calculated dose or dose commitment greater than the values currently being calculated in Specification 4.11.2.3, identify the new location(s) in the next Semiannual Radioactive Effluent Release Report, pursuant to Specification 6.9.1.8.
- b. With a land use census identifying a location(s) that yields a calculated dose or dose commitment (via the same exposure pathway) 20% greater than at a location from which samples are currently being obtained in accordance with Specification 3.12.1, add the new location(s) to the radiological environmental monitoring program within 30 days. The sampling location(s), excluding the control station location, having the lowest calculated dose or dose commitment(s), via the same exposure pathway, may be deleted from this monitoring program after (October 31) of the year in which this land use census was conducted. Pursuant to Specification 6.9.1.8, identify the new location(s) in the next Semiannual Radioactive Effluent Release Report and also include in the report a revised figure(s) and table for the ODCM reflecting the new location(s).
- c. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

4.12.2 The land use census shall be conducted during the growing season at least once per 12 months using that information that will provide the best results, such as by a door-to-door survey, aerial survey, or by consulting local agriculture authorities. The results of the land use census shall be included in the Annual Radiological Environmental Operating Report pursuant to Specification 6.9.1.7..

\*Broad leaf vegetation sampling of at least three different kinds of vegetation may be performed at the SITE BOUNDARY in each of two different direction sectors with the highest predicted D/Qs in lieu of the garden census. Specifications for broad leaf vegetation sampling in Table 3.12-1 shall be followed, including analysis of control samples.

FINAL DRAFT

RADIOLOGICAL ENVIRONMENTAL MONITORING

3/4.12.3 INTERLABORATORY COMPARISON PROGRAM

LIMITING CONDITION FOR OPERATION

---

3.12.3 Analyses shall be performed on radioactive materials supplied as part of an Interlaboratory Comparison Program that has been approved by the Commission that correspond to samples required by Table 3.12-1.

APPLICABILITY: At all times.

ACTION:

- a. With analyses not being performed as required above, report the corrective actions taken to prevent a recurrence to the Commission in the Annual Radiological Environmental Operating Report pursuant to Specification 6.9.1.7.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

---

4.12.3 The Interlaboratory Comparison Program shall be described in the ODCM. A summary of the results obtained as part of the above required Interlaboratory Comparison Program and in accordance with the methodology and parameters in the ODCM shall be included in the Annual Radiological Environmental Operating Report pursuant to Specification 6.9.1.7.





FINAL DRAFT

BASES  
FOR  
SECTIONS 3.0 AND 4.0  
LIMITING CONDITIONS FOR OPERATION  
AND  
SURVEILLANCE REQUIREMENTS

FINAL DRAFT

NOTE

The BASES contained in the succeeding pages summarize the reasons for the specifications of Sections 3.0 and 4.0 but in accordance with 10 CFR 50.36 are not a part of these Technical Specifications.



## 3/4.0 APPLICABILITY

### BASES

---

The specifications of this section provide the general requirements applicable to each of the Limiting Conditions for Operation and Surveillance Requirements within Section 3/4.

3.0.1 This specification defines the applicability of each specification in terms of defined OPERATIONAL MODES or other specified conditions and is provided to delineate specifically when each specification is applicable.

3.0.2 This specification defines those conditions necessary to constitute compliance with the terms of an individual Limiting Condition for Operation and associated ACTION requirement.

3.0.3 This specification delineates the measures to be taken for circumstances not directly provided for in the ACTION statements and whose occurrence would violate the intent of a specification. For example, Specification 3.6.2.1 requires two containment spray systems to be OPERABLE and provides explicit ACTION requirements if one spray system is inoperable. Under the terms of Specification 3.0.3, if both of the required containment spray systems are inoperable, within 1 hour measures must be initiated to place the unit in at least HOT STANDBY within the next 6 hours, in at least HOT SHUTDOWN within the following 6 hours, and in COLD SHUTDOWN in the subsequent 24 hours.

3.0.4 This specification provides that entry into an OPERATIONAL MODE or other specified applicability condition must be made with (a) the full complement of required systems, equipment, or components OPERABLE and (b) all other parameters as specified in the Limiting Conditions for Operation being met without regard for allowable deviations and out of service provisions contained in the ACTION statements.

The intent of this provision is to ensure that facility operation is not initiated with either required equipment or systems inoperable or other specified limits being exceeded.

Exceptions to this specification have been provided for a limited number of specifications when startup with inoperable equipment would not affect plant safety. These exceptions are stated in the ACTION statements of the appropriate specifications.

BASES

4.0.1 This specification provides that surveillance activities necessary to ensure the Limiting Conditions for Operation are met and will be performed during the OPERATIONAL MODES or other conditions for which the Limiting Conditions for Operation are applicable. Provisions for additional surveillance activities to be performed without regard to the applicable OPERATIONAL MODES or other conditions are provided in the individual surveillance requirements. Surveillance requirements for Special Test Exceptions need only be performed when the Special Test Exception is being utilized as an exception to an individual specification.

4.0.2 The provisions of this specification provide allowable tolerances for performing surveillance activities beyond those specified in the nominal surveillance interval. These tolerances are necessary to provide operational flexibility because of scheduling and performance considerations. The phrase "at least" associated with a surveillance frequency does not negate this allowable tolerance value and permits the performance of more frequent surveillance activities.

The tolerance values, taken either individually or consecutively over three test intervals, are sufficiently restrictive to ensure that the reliability associated with the surveillance activity is not significantly degraded beyond that obtained from the nominal specified interval.

4.0.3 The provisions of this specification set forth the criteria for determination of compliance with the OPERABILITY requirements of the Limiting Conditions for Operation. Under these criteria, equipment, systems, or components are assumed to be OPERABLE if the associated surveillance activities have been satisfactorily performed within the specified time interval. Nothing in this provision is to be construed as defining equipment, systems, or components OPERABLE, when such items are found or known to be inoperable although still meeting the surveillance requirements.

## BASES

4.0.4 This specification ensures that the surveillance activities associated with a Limiting Condition for Operation have been performed within the specified time interval prior to entry into an OPERATIONAL MODE or other applicable condition. The intent of this provision is to ensure that surveillance activities have been satisfactorily demonstrated on a current basis as required to meet the OPERABILITY requirements of the Limiting Condition for Operation.

Under the terms of this specification, for example, during initial plant startup or following extended plant outages, the applicable surveillance activities must be performed within the stated surveillance interval prior to placing or returning the system or equipment into OPERABLE status.

4.0.5 This specification ensures that inservice inspection of ASME Code Class 1, 2, and 3 components and inservice testing of ASME Code Class 1, 2, and 3 pumps and valves will be performed in accordance with a periodically updated version of Section XI of the ASME Boiler and Pressure Vessel Code and Addenda as required by 10 CFR 50.55a. Relief from any of the above requirements has been provided in writing by the Commission and is not a part of these Technical Specifications.

This specification includes a clarification of the frequencies for performing the inservice inspection and testing activities required by Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda. This clarification is provided to ensure consistency in surveillance intervals throughout these Technical Specifications and to remove any ambiguities relative to the frequencies for performing the required inservice inspection and testing activities.

Under the terms of this specification, the more restrictive requirements of the Technical Specifications take precedence over the ASME Boiler and Pressure Vessel Code and applicable Addenda. For example, the requirements of Specification 4.0.4 to perform surveillance activities prior to entry into an OPERATIONAL MODE or other specified applicability condition takes precedence over the ASME Boiler and Pressure Vessel Code provision which allows pumps to be tested up to 1 week after return to normal operation. And for example, the Technical Specification definition of OPERABLE does not grant a grace period before a device that is not capable of performing its specified function is declared inoperable and takes precedence over the ASME Boiler and Pressure Vessel Code provision which allows a valve to be incapable of performing its specified function for up to 24 hours before being declared inoperable.

## 3/4.1 REACTIVITY CONTROL SYSTEMS

### BASES

---

#### 3/4.1.1 BORATION CONTROL

##### 3/4.1.1.1 and 3/4.1.1.2 SHUTDOWN MARGIN

A sufficient SHUTDOWN MARGIN ensures that (1) the reactor can be made subcritical from all operating conditions, (2) the reactivity transients associated with postulated accident conditions are controllable within acceptable limits assuming the insertion of the regulating CEAs are within the limits of Specification 3.1.3.6, and (3) the reactor will be maintained sufficiently subcritical to preclude inadvertent criticality in the shutdown condition.

SHUTDOWN MARGIN requirements vary throughout core life as a function of fuel depletion, RCS boron concentration, and RCS  $T_{cold}$ . The most restrictive condition occurs at EOL, with  $T_{cold}$  at no load operating temperature, and is associated with a postulated steam line break accident and resulting uncontrolled RCS cooldown. In the analysis of this accident, a minimum SHUTDOWN MARGIN of 6.0% delta k/k is required to control the reactivity transient. Accordingly, the SHUTDOWN MARGIN requirement is based upon this limiting condition and is consistent with the criteria used to establish the power dependent CEA insertion limits and with the assumptions used in the FSAR Safety Analysis.

With  $T_{cold}$  less than or equal to 210°F, the reactivity transients resulting from uncontrolled RCS cooldown are minimal and a 4%  $\Delta k/k$  SHUTDOWN MARGIN requirement is set to ensure that reactivity transients resulting from an inadvertent single CEA withdrawal event are minimal.

##### 3/4.1.1.3 MODERATOR TEMPERATURE COEFFICIENT (MTC)

The limitations on moderator temperature coefficient (MTC) are provided to ensure that the assumptions used in the accident and transient analysis remain valid through each fuel cycle. The surveillance requirements for measurement of the MTC during each fuel cycle are adequate to confirm the MTC value since this coefficient changes slowly due principally to the reduction in RCS boron concentration associated with fuel burnup. The confirmation that the measured MTC value is within its limit provides assurances that the coefficient will be maintained within acceptable values throughout each fuel cycle.

**FINAL DRAFT**

## REACTIVITY CONTROL SYSTEMS

### BASES

#### 3/4.1.1.4 MINIMUM TEMPERATURE FOR CRITICALITY

This specification ensures that the reactor will not be made critical with the Reactor Coolant System cold leg temperature less than 552°F. This limitation is required to ensure (1) the moderator temperature coefficient is within its analyzed temperature range, (2) the protective instrumentation is within its normal operating range, and (3) to ensure consistency with the FSAR safety analysis.

#### 3/4.1.2 BORATION SYSTEMS

The boron injection system ensures that negative reactivity control is available during each mode of facility operation. The components required to perform this function include (1) borated water sources, (2) charging pumps, (3) separate flow paths, and (4) an emergency power supply from OPERABLE diesel generators. ~~The 26 gpm value is based on the nominal flow of one charging pump less the reactor coolant pump bleedoff flow and with allowance for degradation.~~

With the RCS temperature above 210°F, a minimum of two separate and redundant boron injection systems are provided to ensure single functional capability in the event an assumed failure renders one of the systems inoperable. Allowable out-of-service periods ensure that minor component repair or corrective action may be completed without undue risk to overall facility safety from injection system failures during the repair period.

The boration capability of either system is sufficient to provide a SHUTDOWN MARGIN from expected operating conditions of 4% delta k/k after xenon decay and cooldown to 210°F. The maximum expected boration capability requirement occurs at EOL from full power equilibrium xenon conditions and requires 23,800 gallons of 4000 ppm borated water from either the refueling water tank or the spent fuel pool.

With the RCS temperature below 210°F one injection system is acceptable without single failure consideration on the basis of the stable reactivity condition of the reactor and the additional restrictions prohibiting CORE ALTERATIONS and positive reactivity changes in the event the single injection system becomes inoperable. The restrictions of one and only one operable charging pump whenever reactor coolant level is below the bottom of the pressurizer is based on the assumptions used in the analysis of the boron dilution event.

The boron capability required below 210°F is based upon providing a 4% delta k/k SHUTDOWN MARGIN after xenon decay and cooldown from 210°F to 120°F. This condition requires 9,700 gallons of 4000 ppm borated water from either the refueling water tank or the spent fuel pool.

THE NOMINAL CAPACITY OF EACH CHARGING PUMP IS 44 gpm AT ITS DISCHARGE. UP TO 16 gpm OF THIS MAY BE DIVERTED TO THE VOLUM CONTROL TANK VIA THE RCP CONTROL BLEEDOFF. INSTRUMENT INACCURACIES AND PUMP PERFORMANCE UNCERTAINTIES ARE LIMITED TO 29 gpm YIELDING THE 26 gpm VALUE



## REACTIVITY CONTROL SYSTEMS

### BASES

#### BORATION SYSTEMS (Continued)

The values of water volumes, temperatures, and boron concentration in the refueling water tank are provided to ensure that the assumptions used in the initial conditions of the LOCA Safety Analysis remain valid.

The OPERABILITY of one boron injection system during REFUELING ensures that this system is available for reactivity control while in MODE 6.

With the RCS temperature below 210°F while in MODES 5 and 6, a source of borated water is required to be available for reactivity control and makeup for losses due to contraction and evaporation. The requirement of 33,500 gallons of 4000 ppm borated water in either the refueling water tank or spent fuel pool ensures that this source is available.

The limits on contained water volume and boron concentration of the RWT also ensure a pH value of between 7.0 and 8.5 for the solution recirculated within containment after a LOCA. This pH band minimizes the evolution of iodine and minimizes the effect of chloride and caustic stress corrosion on mechanical systems and components.

#### 3/4.1.2.7 BORON DILUTION ALARMS

The startup channel high neutron flux alarms alert the operator to an inadvertent boron dilution. Both channels must be operating to assure detection of a boron dilution event by the high neutron flux alarms. If one or both of the alarms are inoperable at any time, the bases for ACTION statements are as follows:

- a. One startup channel high neutron flux alarm not operating:

With only one startup channel high neutron flux alarm OPERABLE while in MODE 3, 4, 5, or 6, a single failure to the alarm could prevent detection of boron dilution. By periodic monitoring of the RCS boron concentration by either boronmeter or RCS sampling, a decrease in the boron concentration during an inadvertent boron dilution event will be observed. This provides alternate methods of detection of boron dilution with sufficient time for termination of the event before complete loss of SHUTDOWN MARGIN and return to criticality.

- b. Both startup channel high neutron flux alarms not operating:

When both startup channel high neutron flux alarms are inoperable, there is no means of alarming on high neutron flux when subcritical. ~~Therefore, simultaneous use of boronmeter and RCS sampling to monitor the RCS boron concentration provides diverse and redundant indications of an inadvertent boron dilution.~~ Therefore, either simultaneous use of the boronmeter and RCS sampling or independent collection and analysis of two RCS samples to monitor the RCS boron concentration provides alternate indications of inadvertent boron dilution. This will allow detection with sufficient time for termination of boron dilution ~~and before complete loss of SHUTDOWN MARGIN and return to criticality~~.

**FINAL DRAFT**

## REACTIVITY CONTROL SYSTEMS

### BASES

#### 3/4.1.3 MOVABLE CONTROL ASSEMBLIES

The specifications of this section ensure that (1) acceptable power distribution limits are maintained, (2) the minimum SHUTDOWN MARGIN is maintained, and (3) the potential effects of CEA misalignments are limited to acceptable levels.

The ACTION statements which permit limited variations from the basic requirements are accompanied by additional restrictions which ensure that the original design criteria are met.

The ACTION statements applicable to a stuck or untrippable CEA, to two or more inoperable CEAs, and to a large misalignment (greater than or equal to 19 inches) of two or more CEAs, require a prompt shutdown of the reactor since either of these conditions may be indicative of a possible loss of mechanical functional capability of the CEAs and in the event of a stuck or untrippable CEA, the loss of SHUTDOWN MARGIN.

For small misalignments (less than 19 inches) of the CEAs, there is (1) a small effect on the time-dependent long-term power distributions relative to those used in generating LCOs and LSSS setpoints, (2) a small effect on the available SHUTDOWN MARGIN, and (3) a small effect on the ejected CEA worth used in the safety analysis. Therefore, the ACTION statement associated with small misalignments of CEAs permits a 1-hour time interval during which attempts may be made to restore the CEA to within its alignment requirements. The 1-hour time limit is sufficient to (1) identify causes of a misaligned CEA, (2) take appropriate corrective action to realign the CEAs, and (3) minimize the effects of xenon redistribution.

The CPCs provide protection to the core in the event of a large misalignment (greater than or equal to 19 inches) of a CEA by applying appropriate penalty factors to the calculation to account for the misaligned CEA. However, this misalignment would cause distortion of the core power distribution. This distribution may, in turn, have a significant effect on (1) the available SHUTDOWN MARGIN, (2) the time-dependent long-term power distributions relative to those used in generating LCOs and LSSS setpoints, and (3) the ejected CEA worth used in the safety analysis. Therefore, the ACTION statement associated with the large misalignment of a CEA requires a prompt realignment of the misaligned CEA.

The ACTION statements applicable to misaligned or inoperable CEAs include requirements to align the OPERABLE CEAs in a given group with the inoperable CEA. Conformance with these alignment requirements bring the core, within a short period of time, to a configuration consistent with that assumed in generating LCO and LSSS setpoints. However, extended operation with CEAs significantly inserted in the core may lead to perturbations in (1) local burnup, (2) peaking factors, and (3) available SHUTDOWN MARGIN which are more adverse than the conditions assumed to exist in the safety analyses and LCO

REACTIVITY CONTROL SYSTEMSBASESMOVABLE CONTROL ASSEMBLIES (Continued)

and LSSS setpoints determination. Therefore, time limits have been imposed on operation with inoperable CEAs to preclude such adverse conditions from developing.

Operability of at least two CEA position indicator channels is required to determine CEA positions and thereby ensure compliance with the CEA alignment and insertion limits. The CEA "Full In" and "Full Out" limits provide an additional independent means for determining the CEA positions when the CEAs are at either their fully inserted or fully withdrawn positions. Therefore, the ACTION statements applicable to inoperable CEA position indicators permit continued operations when the positions of CEAs with inoperable position indicators can be verified by the "Full In" or "Full Out" limits.

CEA positions and OPERABILITY of the CEA position indicators are required to be verified on a nominal basis of once per 12 hours with more frequent verifications required if an automatic monitoring channel is inoperable. These verification frequencies are adequate for assuring that the applicable LCOs are satisfied.

The maximum CEA drop time restriction is consistent with the assumed CEA drop time used in the safety analyses. Measurement with  $T_{\text{cold}}$  greater than or equal to 552°F and with all reactor coolant pumps operating ensures that the measured drop times will be representative of insertion times experienced during a reactor trip at operating conditions.

Several design steps were employed to accommodate the possible CEA guide tube wear which could arise from CEA vibrations when fully withdrawn. Specifically, a programmed insertion schedule will be used to cycle the CEAs between the full out position ("FULL OUT" LIMIT) and 3.0 inches inserted over the fuel cycle. This cycling will distribute the possible guide tube wear over a larger area, thus minimizing any effects. To accommodate this programmed insertion schedule, the fully withdrawn position was redefined, in some cases, to be 144.75 inches or greater.

The establishment of LSSS and LCOs requires that the expected long- and short-term behavior of the radial peaking factors be determined. The long-term behavior relates to the variation of the steady-state radial peaking factors with core burnup and is affected by the amount of CEA insertion assumed, the portion of a burnup cycle over which such insertion is assumed and the expected power level variation throughout the cycle. The short-term behavior relates to transient perturbations to the steady-state radial peaks due to radial xenon redistribution. The magnitudes of such perturbations depend upon the expected use of the CEAs during anticipated power reductions

## REACTIVITY CONTROL SYSTEMS

### BASES

#### MOVABLE CONTROL ASSEMBLIES (Continued)

and load maneuvering. Analyses are performed based on the expected mode of operation of the NSSS (base load maneuvering, etc.) and from these analyses CEA insertions are determined and a consistent set of radial peaking factors defined. The Long Term Steady State and Short Term Insertion Limits are determined based upon the assumed mode of operation used in the analyses and provide a means of preserving the assumptions on CEA insertions used. The limits specified serve to limit the behavior of the radial peaking factors within the bounds determined from analysis. The actions specified serve to limit the extent of radial xenon redistribution effects to those accommodated in the analyses. The Long and Short Term Insertion Limits of Specification 3.1.3.6 are specified for the plant which has been designed for primarily base loaded operation but which has the ability to accommodate a limited amount of load maneuvering.

The Transient Insertion Limits of Specification 3.1.3.6 and the Shutdown CEA Insertion Limits of Specification 3.1.3.5 ensure that (1) the minimum SHUT-DOWN MARGIN is maintained, and (2) the potential effects of a CEA ejection accident are limited to acceptable levels. Long-term operation at the Transient Insertion Limits is not permitted since such operation could have effects on the core power distribution which could invalidate assumptions used to determine the behavior of the radial peaking factors.

*OPERATING*  
The PVNGS CPC and COLSS systems are responsible for the safety and monitoring functions, respectively, of the reactor core. COLSS monitors the DNB Power Operation Limit (POL) and various operating parameters to help the operator maintain plant operation within the limiting conditions for operation (LCO). Operating within the LCO guarantees that in the event of an Anticipated Operational Occurrence (AOO), the CPCs will provide a reactor trip in time to prevent unacceptable fuel damage.

The COLSS reserves the Required Overpower Margin (ROPM) to account for the Loss of Flow (LOF) transient which is the limiting AOO for the PVNGS plants. When the COLSS is Out of Service (COOS), the monitoring function is performed via the CPC calculation of DNBR in conjunction with a Technical Specification COOS Limit ~~Time~~ which restricts the reactor power sufficiently to preserve the ROM.

#### LINE (FIGURE 3.2-2)

The reduction of the CEA deviation penalties in accordance with the CEAC (Control Element Assembly Calculator) sensitivity reduction program has been performed. This task involved setting many of the inward single CEA deviation penalty factors to 1.0. An inward CEA deviation event in effect would not be accompanied by the application of the CEA deviation penalty in either the CPC DNB and LHR (Linear Heat Rate) calculations for those CEAs with the reduced penalty factors. The protection for an inward CEA deviation event is thus accounted for separately.

FINAL DRAFT

REACTIVITY CONTROL SYSTEMS

BASES

---

MOVABLE CONTROL ASSEMBLIES (Continued)

If an inward CEA deviation event occurs, the current CPC algorithm applies two penalty factors to each of the DNB and LHR calculations. The first, a static penalty factor, is applied upon detection of the event. The second, a xenon redistribution penalty, is applied linearly as a function of time after the CEA drop. The expected margin degradation for the inward CEA deviation event for which the penalty factor has been reduced is accounted for in two ways. The ROPM reserved in COLSS is used to account for some of the margin degradation. If the combination of the static and xenon redistribution penalties exceeds the reserved ROPM, a power reduction in accordance with the curve in Figure 3.1-2B is required. In addition, the part length CEA maneuvering is restricted in accordance with Figure 3.1-2A to justify reduction of the PLR deviation penalty factors.

The technical specification permits plant operation if both CEACs are considered inoperable for safety purposes after this period.

### 3/4.2 POWER DISTRIBUTION LIMITS

#### BASES

---

#### 3/4.2.1 LINEAR HEAT RATE

The limitation on linear heat rate ensures that in the event of a LOCA, the peak temperature of the fuel cladding will not exceed 2200°F.

Either of the two core power distribution monitoring systems, the Core Operating Limit Supervisory System (COLSS) and the Local Power Density channels in the Core Protection Calculators (CPCs), provide adequate monitoring of the core power distribution and are capable of verifying that the linear heat rate does not exceed its limits. The COLSS performs this function by continuously monitoring the core power distribution and calculating a core power operating limit corresponding to the allowable peak linear heat rate. Reactor operation at or below this calculated power level assures that the limits of 14.0 kW/ft are not exceeded.

The COLSS calculated core power and the COLSS calculated core power operating limits based on linear heat rate are continuously monitored and displayed to the operator. A COLSS alarm is annunciated in the event that the core power exceeds the core power operating limit. This provides adequate margin to the linear heat rate operating limit for normal steady-state operation. Normal reactor power transients or equipment failures which do not require a reactor trip may result in this core power operating limit being exceeded. In the event this occurs, COLSS alarms will be annunciated. If the event which causes the COLSS limit to be exceeded results in conditions which approach the core safety limits, a reactor trip will be initiated by the Reactor Protective Instrumentation. The COLSS calculation of the linear heat rate includes appropriate penalty factors which provide, with a 95/95 probability/confidence level, that the maximum linear heat rate calculated by COLSS is conservative with respect to the actual maximum linear heat rate existing in the core. These penalty factors are determined from the uncertainties associated with planar radial peaking measurement, engineering heat flux uncertainty, axial densification, software algorithm modelling, computer processing, rod bow, and core power measurement.

Parameters required to maintain the operating limit power level based on linear heat rate, margin to DNB, and total core power are also monitored by the CPCs (assuming minimum core power of 20% of RATED THERMAL POWER). The 20% RATED THERMAL POWER threshold is due to the neutron flux detector system being inaccurate below 20% core power. Core noise level at low power is too large to obtain usable detector readings. Therefore, in the event that the COLSS is not being used, operation within the limits of Figure 3.2-2 can be maintained by utilizing a predetermined local power density margin and a total core power limit in the CPC trip channels. The above listed uncertainty and penalty factors plus those associated with the CPC startup test acceptance criteria are also included in the CPCs.

## POWER DISTRIBUTION LIMITS

### BASES

#### 3/4.2.2 PLANAR RADIAL PEAKING FACTORS

Limiting the values of the PLANAR RADIAL PEAKING FACTORS ( $F_{xy}^C$ ) used in the COLSS and CPCs to values equal to or greater than the measured PLANAR RADIAL PEAKING FACTORS ( $F_{xy}^m$ ) provides assurance that the limits calculated by COLSS and the CPCs remain valid. Data from the incore detectors are used for determining the measured PLANAR RADIAL PEAKING FACTORS. A minimum core power at 20% of RATED THERMAL POWER is assumed in determining the PLANAR RADIAL PEAKING FACTORS. The 20% RATED THERMAL POWER threshold is due to the neutron flux detector system being inaccurate below 20% core power. Core noise level at low power is too large to obtain usable detector readings. The periodic surveillance requirements for determining the measured PLANAR RADIAL PEAKING FACTORS provides assurance that the PLANAR RADIAL PEAKING FACTORS used in COLSS and the CPCs remain valid throughout the fuel cycle. Determining the measured PLANAR RADIAL PEAKING FACTORS after each fuel loading prior to exceeding 70% of RATED THERMAL POWER provides additional assurance that the core was properly loaded.

#### 3/4.2.3 AZIMUTHAL POWER TILT - $T_q$

The limitations on the AZIMUTHAL POWER TILT are provided to ensure that design safety margins are maintained. An AZIMUTHAL POWER TILT greater than 0.10 is not expected and if it should occur, operation is restricted to only those conditions required to identify the cause of the tilt. The tilt is normally calculated by COLSS. A minimum core power of 20% of RATED THERMAL POWER is assumed by the CPCs in its input to COLSS for calculation of AZIMUTHAL POWER TILT. The 20% RATED THERMAL POWER threshold is due to the neutron flux detector system being inaccurate below 20% core power. Core noise level at low power is too large to obtain usable detector readings. The surveillance requirements specified when COLSS is out of service provide an acceptable means of detecting the presence of a steady-state tilt. It is necessary to explicitly account for power asymmetries because the radial peaking factors used in the core power distribution calculations are based on an untilted power distribution.

The AZIMUTHAL POWER TILT is equal to  $(P_{\text{tilt}}/P_{\text{untilt}})-1.0$  where:

AZIMUTHAL POWER TILT is measured by assuming that the ratio of the power at any core location in the presence of a tilt to the untilted power at the location is of the form:

$$P_{\text{tilt}}/P_{\text{untilt}} = 1 + T_q g \cos(\theta - \theta_0)$$

where:

$T_q$  is the peak fractional tilt amplitude at the core periphery

$g$  is the radial normalizing factor

$\theta$  is the azimuthal core location

$\theta_0$  is the azimuthal core location of maximum tilt





POWER DISTRIBUTION LIMITSBASESAZIMUTHAL POWER TILT -  $T_q$  (Continued)

$P_{\text{tilt}}/P_{\text{untilt}}$  is the ratio of the power at a core location in the presence of a tilt to the power at that location with no tilt.

The AZIMUTHAL POWER TILT allowance used in the CPCs is defined as the value of CPC addressable constant TR-1.0.

3/4.2.4 DNBR MARGIN

The limitation on DNBR as a function of AXIAL SHAPE INDEX represents a conservative envelope of operating conditions consistent with the safety analysis assumptions and which have been analytically demonstrated adequate to maintain an acceptable minimum DNBR throughout all anticipated operational occurrences, of which the loss of flow transient is the most limiting. Operation of the core with a DNBR at or above this limit provides assurance that an acceptable minimum DNBR will be maintained in the event of a loss of flow transient.

Either of the two core power distribution monitoring systems, the Core Operating Limit Supervisory System (COLSS) and the DNBR channels in the Core Protection Calculators (CPCs), provide adequate monitoring of the core power distribution and are capable of verifying that the DNBR does not violate its limits. The COLSS performs this function by continuously monitoring the core power distribution and calculating a core operating limit corresponding to the allowable minimum DNBR. Reactor operation at or below this calculated power level assures that the limits of Figure 3.2-1 are not violated. The COLSS calculation of core power operating limit based on DNBR includes appropriate penalty factors which provide, with a 95/95 probability/confidence level, that the core power limits calculated by COLSS (based on the minimum DNBR Limit) is conservative with respect to the actual core power limit. These penalty factors are determined from the uncertainties associated with planar radial peaking measurement, engineering heat flux, state parameter measurement, software algorithm modelling, computer processing, rod bow, and core power measurement.

Parameters required to maintain the margin to DNB and total core power are also monitored by the CPCs. Therefore, in the event that the COLSS is not being used, operation within the limits of Figure 3.2-2 can be maintained by utilizing a predetermined DNBR as a function of AXIAL SHAPE INDEX and by monitoring the CPC trip channels. The above listed uncertainty and penalty factors are also included in the CPCs which assume a minimum core power of 20% of RATED THERMAL POWER. The 20% RATED THERMAL POWER threshold is due to the neutron flux detector system being inaccurate below 20% core power. Core noise level at low power is too large to obtain usable detector readings.

The DNBR penalty factors listed in Specification 4.2.4.4 are penalties used to accommodate the effects of rod bow. The amount of rod bow in each assembly is dependent upon the average burnup experienced by that assembly. Fuel assemblies that incur higher average burnup will experience a greater magnitude of rod bow. Conversely, lower burnup assemblies will experience less rod bow. The penalty for each batch required to compensate for rod bow is determined from a batch's maximum average assembly burnup applied to the batch's maximum integrated planar-radial power peak. A single net penalty for COLSS and CPC is then determined from the penalties associated with each batch, accounting for the offsetting margins due to the lower radial power peaks in the higher burnup batches.

## POWER DISTRIBUTION LIMITS

### BASES ---

#### 3/4.2.5 RCS FLOW RATE

This specification is provided to ensure that the actual RCS total flow rate is maintained at or above the minimum value used in the safety analyses.

#### 3/4.2.6 REACTOR COOLANT COLD LEG TEMPERATURE

This specification is provided to ensure that the actual value of reactor, coolant cold leg temperature is maintained within the range of values used in the safety analyses.

#### 3/4.2.7 AXIAL SHAPE INDEX

This specification is provided to ensure that the actual value of the core average AXIAL SHAPE INDEX is maintained within the range of values used in the safety analyses.

#### 3/4.2.8 PRESSURIZER PRESSURE

This specification is provided to ensure that the actual value of pressurizer pressure is maintained within the range of values used in the safety analyses.

FINAL DRAFT

### 3/4.3 INSTRUMENTATION

#### BASES

#### 3/4.3.1 and 3/4.3.2 REACTOR PROTECTIVE AND ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION

The OPERABILITY of the reactor protective and Engineered Safety Features Actuation Systems instrumentation and bypasses ensures that (1) the associated Engineered Safety Features Actuation action and/or reactor trip will be initiated when the parameter monitored by each channel or combination thereof reaches its setpoint, (2) the specified coincidence logic is maintained, (3) sufficient redundancy is maintained to permit a channel to be out of service for testing, or maintenance, and (4) sufficient system functional capability is available from diverse parameters.

The OPERABILITY of these systems is required to provide the overall reliability, redundancy, and diversity assumed available in the facility design for the protection and mitigation of accident and transient conditions. The integrated operation of each of these systems is consistent with the assumptions used in the safety analyses.

The design of the Control Element Assembly Calculators (CEAC) provides reactor protection in the event one or both CEACs become inoperable. If one CEAC is in test or inoperable, verification of CEA position is performed at least every 4 hours. If the second CEAC fails, the CPCs in conjunction with plant Technical Specifications will use DNBR and LPD penalty factors and increased DNBR and LPD margin to restrict reactor operation to a power level that will ensure safe operation of the plant. If the margins are not maintained, a reactor trip will occur.

Insert  
from PG  
B 3/4 3-2

The surveillance requirements specified for these systems ensure that the overall system functional capability is maintained comparable to the original design standards. The periodic surveillance tests performed at the minimum frequencies are sufficient to demonstrate this capability.

The measurement of response time at the specified frequencies provides assurance that the protective and ESF action function associated with each channel is completed within the time limit assumed in the safety analyses. No credit was taken in the analyses for those channels with response times indicated as not applicable.

Response time may be demonstrated by any series of sequential, overlapping, or total channel test measurements provided that such tests demonstrate the total channel response time as defined. Sensor response time verification may be demonstrated by either (1) in place, onsite, or offsite test measurements or (2) utilizing replacement sensors with certified response times.

~~Insert~~  
M

#### 3/4.3.3 MONITORING INSTRUMENTATION

##### 3/4.3.3.1 RADIATION MONITORING INSTRUMENTATION

The OPERABILITY of the radiation monitoring channels ensures that:  
(1) the radiation levels are continually measured in the areas served by the

## INSTRUMENTATION

### BASES

individual channels and (2) the alarm or automatic action is initiated when the radiation level trip setpoint is exceeded.

An analysis was done to specify a minimum power level below which an additional power reduction is unnecessary even if there is a CEA misalignment with CEACs out of service.

This work is the completion of the CEAC's Out of Service (OOS) work. This analysis improves ANPP Unit 1, Cycle 1 power capability from about 75% to greater than about 90% with both CEACs out of service.

The analysis determined a Power Operating Limit (POL) power and assumed a CEA misalignment occurred from this power level. The power penalty factor that would accommodate changes in radial peaks and one hour xenon redistribution that would occur if there were a CEA misalignment with CEACs out of service. The quotient of the POL power and the CEA misalignment Power Penalty factor is the maximum power (50% power) at which DNBR SAFDL violation will occur even if there is a CEA misalignment from POL conditions. Below this power, extra thermal margin will be available to the plant. Thus, for CEA misalignment, power reduction below this limiting power is unnecessary.

The lowest core power for a POL was calculated to be 70% of rated power. This was based on the following worst COLSS fluid conditions.

High Temperature :	580°F
Low Pressure :	1785 psia
ASI :	-.3
Underflow fraction:	0.865
Low Flow :	95% of full flow
High Radial Peak :	1.70 (Bank 5+4+PLR; PDIL = 40% Power)

### 3/4.3.3.2 INCORE DETECTORS

The OPERABILITY of the incore detectors with the specified minimum complement of equipment ensures that the measurements obtained from use of this system accurately represent the spatial neutron flux distribution of the reactor core.

### 3/4.3.3.3 SEISMIC INSTRUMENTATION

The OPERABILITY of the seismic instrumentation ensures that sufficient capability is available to promptly determine the magnitude of a seismic event and evaluate the response of those features important to safety. This capability is required to permit comparison of the measured response to that used in the design basis for the facility to determine if plant shutdown is required pursuant to Appendix A of 10 CFR Part 100. The instrumentation is consistent with the recommendations of Regulatory Guide 1.12, "Instrumentation for Earthquakes," April 1974 as identified in the PVNGS FSAR.

Does EN Basis  
3/4.3.1  
move to  
B 3/4.3.1

## INSTRUMENTATION

### BASES

#### 3/4.3.3.4 METEOROLOGICAL INSTRUMENTATION

The OPERABILITY of the meteorological instrumentation ensures that sufficient meteorological data are available for estimating potential radiation doses to the public as a result of routine or accidental release of radioactive materials to the atmosphere. This capability is required to evaluate the need for initiating protective measures to protect the health and safety of the public and is consistent with the recommendations of Regulatory Guide 1.23 "Onsite Meteorological Programs," February 1972. Wind speeds less than 0.6 MPH cannot be measured by the meteorological instrumentation.

#### 3/4.3.3.5 REMOTE SHUTDOWN INSTRUMENTATION <sup>System</sup>

The OPERABILITY of the remote shutdown <sup>System</sup> instrumentation ensures that sufficient capability is available to permit safe shutdown and maintenance of HOT STANDBY of the facility from locations outside of the control room. This capability is required in the event control room habitability is lost and is consistent with General Design Criterion 19 of 10 CFR Part 50.

The parameters selected to be monitored ensure that (1) the condition of the reactor is known, (2) conditions in the RCS are known, (3) the steam generators are available for residual heat removal, (4) a source of water is available for makeup to the RCS, and (5) the charging system is available to makeup water to the RCS.

The OPERABILITY of the remote shutdown <sup>System</sup> instrumentation insures that a fire will not preclude achieving safe shutdown. The remote shutdown system instrumentation, control and power circuits and disconnect switches necessary to eliminate effects of the fire and allow operation of instrumentation, control and power circuits required to achieve and maintain a safe shutdown condition are independent of areas where a fire could damage systems normally used to shutdown the reactor. This capability is consistent with General Design Criterion 3 and Appendix R to 10 CFR 50.

#### 3/4.3.3.6 POST-ACCIDENT MONITORING INSTRUMENTATION

The OPERABILITY of the post-accident monitoring instrumentation ensures that sufficient information is available on selected plant parameters to monitor and assess these variables following an accident. This capability is consistent with the recommendations of Regulatory Guide 1.97, "Instrumentation for Light-Water-Cooled Nuclear Plants to Assess Plant Conditions During and Following an Accident," December 1975 and NUREG 0578, "TMI-2 Lessons Learned Task Force Status Report and Short-Term Recommendations."

The containment high range area monitors (RU-148 & RU-149) and the main steamline radiation monitors (RU-139 A&B and RU-140 A&B) are in Table 3.3-6. The high range effluent monitors and samplers (RU-142, RU-144 and RU-146) are in Table 3.3-13. The containment hydrogen monitors are in Specification 3/4.6.5.1. The Post Accident Sampling System (RCS coolant) is in Table 3.3-6.

← INSERT



BY	DATE	SUBJECT	SHEET NO. _____ of _____
CHECKED BY	DATE		JOB NO. _____

### INSERT 3.3.5

THE ALTERNATE SUCCESS PATH(S) ENSURE THAT SUFFICIENT CAPABILITY IS ~~AVAILABLE~~ AVAILABLE TO PERMIT SHUTDOWN AND MAINTENANCE OF COLD SHUTDOWN OF THE FACILITY BY RELYING ON ADDITIONAL OPERATOR ACTIONS AT LOCAL CONTROL STATIONS RATHER THAN AT THE RSP.

INSERT B<sup>3</sup>/4 3.3.6.

### Basis

THE SUBCOOLED MARGIN MONITOR (SMM), THE HEAT JUNCTION THERMOCOUPLE (HJTC), AND THE CORE EXIT THERMOCOUPLES (CET) COMPRISE THE INADEQUATE CORE COOLING (ICC) INSTRUMENTATION REQUIRED BY ITEM II.F.2 NUREG-0737, THE POST TMI-2 ACTION PLAN. THE FUNCTION OF THE ICC INSTRUMENTATION IS TO ENHANCE THE ABILITY OF THE PLANT OPERATOR TO DIAGNOSE THE APPROACH TO EXISTENCE OF, AND RECOVERY FROM ICC. ADDITIONALLY, THEY AID IN TRACKING REACTOR COOLANT INVENTORY. THESE INSTRUMENTS ARE INCLUDED IN THE TECHNICAL SPECIFICATIONS AT THE REQUEST OF NRC GENERAL LETTER 83-37. THESE ARE NOT REQUIRED BY THE ACCIDENT ANALYSIS, NOR TO BRING THE PLANT TO COLD SHUTDOWN.

INSTRUMENTATIONBASES3/4.3.3.7 FIRE DETECTION INSTRUMENTATION

OPERABILITY of the fire detection instrumentation ensures that adequate warning capability is available for the prompt detection of fires and that fire suppression systems, that are actuated by fire detectors, will discharge extinguishing agent in a timely manner. Prompt detection and suppression of fires will reduce the potential for damage to safety-related equipment and is an integral element in the overall facility fire protection program.

Fire detectors that are used to actuate fire suppression systems represent a more critically important component of a plant's fire protection program than detectors that are installed solely for early fire warning and notification. Consequently, the minimum number of operable fire detectors must be greater.

The loss of detection capability for fire suppression systems, actuated by fire detectors, represents a significant degradation of fire protection for any area. As a result, the establishment of a fire watch patrol must be initiated at an earlier stage than would be warranted for the loss of detectors that provide only early fire warning. The establishment of frequent fire patrols in the affected areas is required to provide detection capability until the inoperable instrumentation is restored to OPERABILITY.

The FPER (Fire Protection Evaluation Report) fire zones listed in Table 3.3-11, Fire Detection Instruments, are discussed in Section 9B of the PVNGS FSAR.

3/4.3.3.8 LOOSE-PART DETECTION INSTRUMENTATION

The OPERABILITY of the loose-part detection instrumentation ensures that sufficient capability is available to detect loose metallic parts in the primary system and avoid or mitigate damage to primary system components. The allowable out-of-service times and surveillance requirements are consistent with the recommendations of Regulatory Guide 1.133, "Loose-Part Detection Program for the Primary System of Light-Water-Cooled Reactors," May 1981.

3/4.3.3.9 RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

The radioactive gaseous effluent instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in gaseous effluents during actual or potential releases of gaseous effluents. The alarm/trip setpoints for these instruments shall be calculated and adjusted in accordance with the methodology and parameters in the ODCM to ensure that the alarm/trip will occur prior to exceeding the limits of 10 CFR Part 20. This instrumentation also includes provisions for monitoring (and controlling) the concentrations of potentially explosive gas mixtures in the GASEOUS RADWASTE SYSTEM. The OPERABILITY and use of this instrumentation is consistent with the requirements of General Design Criteria 60, 63, and 64 of Appendix A to 10 CFR Part 50.





FINAL DRAFT

### 3/4.4 REACTOR COOLANT SYSTEM

#### BASES

#### 3/4.4.1 REACTOR COOLANT LOOPS AND COOLANT CIRCULATION

The plant is designed to operate with both reactor coolant loops and associated reactor coolant pumps in operation, and maintain DNBR above 1.231 during all normal operations and anticipated transients. In MODES 1 and 2 with one reactor coolant loop not in operation, this specification requires that the plant be in at least HOT STANDBY within 1 hour.

In MODE 3, a single reactor coolant loop provides sufficient heat removal capability for removing decay heat; however, single failure considerations require that two loops be OPERABLE.

In MODE 4, and in MODE 5 with reactor coolant loops filled, a single reactor coolant loop or shutdown cooling loop provides sufficient heat removal capability for removing decay heat; but single failure considerations require that at least two loops (either shutdown cooling or RCS) be OPERABLE. Thus, if the reactor coolant loops are not OPERABLE, this specification requires that two shutdown cooling loops be OPERABLE.

In MODE 5 with reactor coolant loops not filled, a single shutdown cooling loop provides sufficient heat removal capability for removing decay heat; but single failure considerations, and the unavailability of the steam generators as a heat removing component, require that at least two shutdown cooling loops be OPERABLE.

The operation of one reactor coolant pump or one shutdown cooling pump provides adequate flow to ensure mixing, prevent stratification, and produce gradual reactivity changes during boron concentration reductions in the Reactor Coolant System. A flow rate of at least 4000 gpm will circulate one equivalent Reactor Coolant System volume of 12,097 cubic feet in approximately 23 minutes. The reactivity change rate associated with boron reductions will, therefore, be within the capability of operator recognition and control.

The restrictions on starting a reactor coolant pump in MODES 4 and 5, with one or more RCS cold legs less than or equal to 255°F during cooldown or 295°F during heatup are provided to prevent RCS pressure transients, caused by energy additions from the secondary system, which could exceed the limits of Appendix G to 10 CFR Part 50. The RCS will be protected against overpressure transients and will not exceed the limits of Appendix G by restricting starting of the RCPs to when the secondary water temperature of each steam generator is less than 100°F above each of the RCS cold leg temperatures.

#### 3/4.4.2 SAFETY VALVES

The pressurizer code safety valves operate to prevent the RCS from being pressurized above its Safety Limit of 2750 psia. Each safety valve is designed to relieve a minimum of 460,000 lb per hour of saturated steam at the valve setpoint. The relief capacity of a single safety valve is adequate to relieve any overpressure condition which could occur during shutdown. In the event that no safety valves are OPERABLE, an operating shutdown cooling loop, connected to the RCS, provides overpressure relief capability and will prevent RCS overpressurization.

REACTOR COOLANT SYSTEMBASESSAFETY VALVES (Continued)

During operation, all pressurizer code safety valves must be OPERABLE to prevent the RCS from being pressurized above its Safety Limit of 2750 psia. The combined relief capacity of these valves is sufficient to limit the system pressure to within its Safety Limit of 2750 psia following a complete loss of turbine generator load while operating at RATED THERMAL POWER and assuming no reactor trip until the first Reactor Protective System trip setpoint (Pressurizer Pressure-High) is reached (i.e., there is no direct reactor trip on the loss of turbine) and also assuming no operation of the steam dump valves.

Demonstration of the safety valves' lift settings will occur only during shutdown and will be performed in accordance with the provisions of Section XI of the ASME Boiler and Pressure Vessel Code.

3/4.4.3 PRESSURIZER

An OPERABLE pressurizer provides pressure control for the Reactor Coolant System during operations with both forced reactor coolant flow and with natural circulation flow. The minimum water level in the pressurizer assures the pressurizer heaters, which are required to achieve and maintain pressure control, remain covered with water to prevent failure, which could occur if the heaters were energized uncovered. The maximum water level in the pressurizer ensures that this parameter is maintained within the envelope of operation assumed in the safety analysis. The maximum water level also ensures that the RCS is not a hydraulically solid system and that a steam bubble will be provided to accommodate pressure surges during operation. The steam bubble also protects the pressurizer code safety valves against water relief. The requirement to verify that on an Engineered Safety Features Actuation test signal concurrent with a loss-of-offsite power the pressurizer heaters are automatically shed from the emergency power sources is to ensure that the non-Class 1E heaters do not reduce the reliability of or overload the emergency power source. The requirement that a minimum number of pressurizer heaters be OPERABLE enhances the capability to control Reactor Coolant System pressure and establish and maintain natural circulation.

The auxiliary pressurizer spray is required to depressurize the RCS by cooling the pressurizer steam space to permit the plant to enter shutdown cooling. The auxiliary pressurizer spray is required during those periods when normal pressurizer spray is not available, such as during natural circulation and during the later stages of a normal RCS cooldown. The auxiliary pressurizer spray also distributes boron to the pressurizer when normal pressurizer spray is not available. Use of the auxiliary pressurizer spray is required during the recovery from a steam generator tube rupture and a small loss of coolant accident.



REACTOR COOLANT SYSTEMBASES3/4.4.4 STEAM GENERATORS

The surveillance requirements for inspection of the steam generator tubes ensure that the structural integrity of this portion of the RCS will be maintained. The program for inservice inspection of steam generator tubes is based on a modification of Regulatory Guide 1.83, Revision 1. Inservice inspection of steam generator tubing is essential in order to maintain surveillance of the conditions of the tubes in the event that there is evidence of mechanical damage or progressive degradation due to design, manufacturing errors, or inservice conditions that lead to corrosion.

Inservice inspection of steam generator tubing also provides a means of characterizing the nature and cause of any tube degradation so that corrective measures can be taken.

The plant is expected to be operated in a manner such that the secondary coolant will be maintained within those chemistry limits found to result in negligible corrosion of the steam generator tubes. If the secondary coolant chemistry is not maintained within these limits, localized corrosion may likely result in stress corrosion cracking. The extent of cracking during plant operation would be limited by the limitation of steam generator tube leakage between the primary coolant system and the secondary coolant system (primary-to-secondary leakage = 0.5 gpm per steam generator). Cracks having a primary-to-secondary leakage less than this limit during operation will have an adequate margin of safety to withstand the loads imposed during normal operation and by postulated accidents. Operating plants have demonstrated that primary-to-secondary leakage of 0.5 gpm per steam generator can readily be detected by radiation monitors of steam generator blowdown. Leakage in excess of this limit will require plant shutdown and an unscheduled inspection, during which the leaking tubes will be located and plugged.

Wastage-type defects are unlikely with proper chemistry treatment of the secondary coolant. However, even if a defect should develop in service, it will be found during scheduled inservice steam generator tube examinations. Plugging will be required for all tubes with imperfections exceeding the plugging limit of 40% of the tube nominal wall thickness. Steam generator tube inspections of operating plants have demonstrated the capability to reliably detect degradation that has penetrated 20% of the original tube wall thickness.

Whenever the results of any steam generator tubing inservice inspection fall into Category C-3, these results will be promptly reported to the Commission pursuant to Specification 6.9.1 prior to the resumption of plant operation. Such cases will be considered by the Commission on a case-by-case basis and may result in a requirement for analysis, laboratory examinations, tests, additional eddy-current inspection, and revision of the Technical Specifications, if necessary.



FINAL DRAFT

## REACTOR COOLANT SYSTEM

### BASES

---

#### 3/4.4.5 REACTOR COOLANT SYSTEM LEAKAGE

##### 3/4.4.5.1 LEAKAGE DETECTION SYSTEMS

The RCS leakage detection systems required by this specification are provided to monitor and detect leakage from the reactor coolant pressure boundary. Containment sump flow is provided by monitoring the rate of sump level increase prior to the sump being pumped down, and is alarmed at the equivalent of 1 gpm leakage into the sump. These detection systems are consistent with the recommendations of Regulatory Guide 1.45, "Reactor Coolant Pressure Boundary Leakage Detection Systems," May 1973.

##### 3/4.4.5.2 OPERATIONAL LEAKAGE

Industry experience has shown that while a limited amount of leakage is expected from the RCS, the unidentified portion of this leakage can be reduced to a threshold value. A threshold value of less than 1 gpm is sufficiently low to ensure early detection of additional leakage.

The 10 gpm IDENTIFIED LEAKAGE limitation provides allowances for a limited amount of leakage from known sources whose presence will not interfere with the detection of UNIDENTIFIED LEAKAGE by the leakage detection systems.

The surveillance requirements for RCS pressure isolation valves provide added assurance of valve integrity thereby reducing the probability of valve failure and consequent intersystem LOCA. Leakage from the RCS pressure isolation valves is IDENTIFIED LEAKAGE and will be considered as a portion of the allowable limit.

The total steam generator tube leakage limit of 1 gpm for both steam generators ensures that the dosage contribution from the tube leakage will be limited to less than Part 100 guidelines for infrequent and limiting fault events. The 1 gpm limit is consistent with the assumptions used in the analysis of these accidents. The 0.5 gpm leakage limit per steam generator ensures that steam generator tube integrity is maintained in the event of a main steam line rupture or under LOCA conditions.

PRESSURE BOUNDARY LEAKAGE of any magnitude may be indicative of an impending failure of the pressure boundary. Therefore, the presence of any PRESSURE BOUNDARY LEAKAGE requires the unit to be promptly placed in COLD SHUTDOWN.

##### 3/4.4.6 CHEMISTRY

The limitations on Reactor Coolant System chemistry ensure that corrosion of the Reactor Coolant System is minimized and reduces the potential for Reactor Coolant System leakage or failure due to stress corrosion. Maintaining

## REACTOR COOLANT SYSTEM

### BASES

#### CHEMISTRY (Continued)

the chemistry within the Steady State Limits provides adequate corrosion protection to ensure the structural integrity of the Reactor Coolant System over the life of the plant. The associated effects of exceeding the oxygen, chloride, and fluoride limits are time and temperature dependent. Corrosion studies show that operation may be continued with contaminant concentration levels in excess of the Steady State Limits, up to the Transient Limits, for the specified limited time intervals without having a significant effect on the structural integrity of the Reactor Coolant System. The time interval permitting continued operation within the restrictions of the Transient Limits provides time for taking corrective actions to restore the contaminant concentrations to within the Steady State Limits.

The surveillance requirements provide adequate assurance that concentrations in excess of the limits will be detected in sufficient time to take corrective action.

#### 3/4.4.7 SPECIFIC ACTIVITY

The limitations on the specific activity of the primary coolant ensure that the resulting 2-hour doses at the site boundary will not exceed an appropriately small fraction of Part 100 limits following a steam generator tube rupture accident in conjunction with an assumed steady state primary-to-secondary steam generator leakage rate of 1.0 gpm and a concurrent loss-of-offsite electrical power. The values for the limits on specific activity represent limits based upon a parametric evaluation by the NRC of typical site locations. These values are conservative in that specific site parameters of the Palo Verde site, such as site boundary location and meteorological conditions, were not considered in this evaluation.

The ACTION statement permitting POWER OPERATION to continue for limited time periods with the primary coolant's specific activity greater than 1.0 microcurie/gram DOSE EQUIVALENT I-131, but within the allowable limit shown on Figure 3.4-1, accommodates possible iodine spiking phenomenon which may occur following changes in THERMAL POWER. Operation with specific activity levels exceeding 1.0 microcurie/gram DOSE EQUIVALENT I-131 but within the limits shown on Figure 3.4-1 must be restricted to no more than 800 hours per year (approximately 10% of the unit's yearly operating time) since the activity levels allowed by Figure 3.4-1 increase the 2-hour thyroid dose at the site boundary by a factor of up to 20 following a postulated steam generator tube rupture. The reporting of cumulative operating time over 500 hours in any 6 month consecutive period with greater than 1.0 microcurie/gram DOSE EQUIVALENT I-131 will allow sufficient time for Commission evaluation of the circumstances prior to reaching the 800-hour limit.



FINAL DRAFT

## REACTOR COOLANT SYSTEM

### BASES

#### SPECIFIC ACTIVITY (Continued)

Reducing  $T_{\text{cold}}$  to less than 500°F prevents the release of activity should a steam generator tube rupture since the saturation pressure of the primary coolant is below the lift pressure of the atmospheric steam relief valves. The surveillance requirements provide adequate assurance that excessive specific activity levels in the primary coolant will be detected in sufficient time to take corrective action. Information obtained on iodine spiking will be used to assess the parameters associated with spiking phenomena. A reduction in frequency of isotopic analyses following power changes may be permissible if justified by the data obtained.

#### 3/4.4.8 PRESSURE/TEMPERATURE LIMITS

SO AS NOT TO EXCEED THE LIMIT LINES OF FIGURE 3.4-2.

ALL components in the Reactor Coolant System are designed to withstand the effects of cyclic loads due to system temperature and pressure changes. These cyclic loads are introduced by normal load transients, reactor trips, and startup and shutdown operations. The various categories of load cycles used for design purposes are provided in Chapters 3 and 5 of the FSAR. During startup and shutdown, the rates of temperature and pressure changes are limited *THIS ENSURES* so that the maximum specified heatup and cooldown rates are consistent with the design assumptions and satisfy the stress limits for cyclic operation.

During heatup, the thermal gradients in the reactor vessel wall produce thermal stresses which vary from compressive at the inner wall to tensile at the outer wall. These thermal induced compressive stresses *AT THE INNER WALL* tend to alleviate the tensile stresses induced by the internal pressure ~~but because of higher neutron fluence may be controlling.~~

~~The heatup analysis also covers the determination of pressure temperature limitations for the case in which the outer wall of the vessel becomes the controlling location. The thermal gradients established during heatup produce tensile stresses at the outer wall of the vessel. These stresses are additive to the pressure induced tensile stresses which are already present. The thermal induced stresses at the outer wall of the vessel are tensile and are dependent on both the rate of heatup and the time along the heatup ramp. Consequently, each heatup rate of interest must be analyzed on an individual basis for both the inner and outer wall.~~

*THERMAL*  
MAGNITUDE OF THE THERMAL STRESSES AT EITHER LOCATION IS

The heatup and cooldown limit curves (Figures 3.4-2 and 3.4-3) are composite curves which were prepared by determining the most conservative case, with either the inside or outside wall controlling, for any heatup or cooldown rates of up to 100°F per hour. The heatup and cooldown curves were prepared based upon the most limiting value of the predicted adjusted reference temperature at the end of the service period indicated on Figures 3.4-2 and 3.4-3.

## REACTOR COOLANT SYSTEM

### BASES

#### PRESSURE/TEMPERATURE LIMITS (Continued)

The reactor vessel materials have been tested to determine their initial  $RT_{NDT}$ ; the results of these tests are shown in Table B 3/4.4-1. Reactor operation and resultant fast neutron ( $E$  greater than 1 MeV) irradiation will cause an increase in the  $RT_{NDT}$ . Therefore, an adjusted reference temperature, based upon the fluence and residual element content, can be predicted using Figure B 3/4.4-1 and the recommendations of Regulatory Guide 1.99, Revision 1, "Effects of Residual Elements on Predicted Radiation Damage to Reactor Vessel Materials." The heatup and cooldown limit curves Figures 3.4-2 and 3.4-3 include predicted adjustments for this shift in  $RT_{NDT}$  at the end of the applicable service period, as well as adjustments for possible errors in the pressure and temperature sensing instruments.

The actual shift in  $RT_{NDT}$  of the vessel material will be established periodically during operation by removing and evaluating, in accordance with ASTM E185-73 and Appendix H of 10 CFR 50, reactor vessel material irradiation surveillance specimens installed near the inside wall of the reactor vessel in the core area. Since the neutron spectra at the irradiation samples and vessel inside radius are essentially identical, the measured transition shift for a sample can be applied with confidence to the adjacent section of the reactor vessel. The heatup and cooldown curves must be recalculated when the delta  $RT_{NDT}$  determined from the surveillance capsule is different from the calculated delta  $RT_{NDT}$  for the equivalent capsule radiation exposure.

The pressure-temperature limit lines shown on Figure 3.4-2 for reactor criticality and for inservice leak and hydrostatic testing have been provided to assure compliance with the minimum temperature requirements of Appendix G to 10 CFR Part 50. The reactor vessel material irradiation surveillance specimens are removed and examined to determine changes in material properties. The results of these examinations shall be used to update Figure 3.4-2 based on the greater of the following:

- (1) the actual shift in reference for plates M-6701-2 and M-4311-1 and weld 101-142 as determined by impact testing, or
- (2) the predicted shift in reference temperature for the limiting weld and plate as determined by RG 1.99, "Effects of Residual Elements on Predicted Radiation Damage to Reactor Vessel Materials."

The maximum  $RT_{NDT}$  for all Reactor Coolant System pressure-retaining materials, with the exception of the reactor pressure vessel, has been determined to be 40°F. The Lowest Service Temperature limit line shown on ~~Figures 3.4-2 and 3.4-3~~ is based upon this  $RT_{NDT}$  since Article NB-2332 (Summer Addenda of 1972) of Section III of the ASME Boiler and Pressure Vessel Code requires the Lowest Service Temperature to be  $RT_{NDT} + 100^\circ\text{F}$  for piping, pumps, and valves. Below this temperature, the system pressure must be limited to a maximum of 20% of the system's hydrostatic test pressure of 3125 psia. However, based upon the 10 CFR Part 50 Appendix G analysis, the isothermal condition for the reactor vessel is more restrictive than the Lowest Service Temperature line. Therefore, only the isothermal line is shown on Figure 3.4-2.

The number of reactor vessel irradiation surveillance specimens and the frequencies for removing and testing these specimens are provided in Table 4.4-3 to assure compliance with the requirements of Appendix H to 10 CFR Part 50.

TABLE B 3/4.4-1  
REACTOR VESSEL TOUGHNESS  
(FORGINGS)

PIECE NO.	CODE NO.	MATERIAL	VESSEL LOCATION	DROP WEIGHT RESULTS (°F)	RT NDT(b) (°F)	TEMPERATURE OF CHARPY V-NOTCH*		MINIMUM UPPER SHELF C. ENERGY FOR LONGITUDINAL DIRECTION-ft lb
						@ 30 ft - lb	@ 50 ft - lb	
128-101	M-6703-1	SA 508-CL2	Inlet Nozzle	-20	0	+20	+60	N.A.
128-101	M-6703-2	SA 508-CL2	Inlet Nozzle	+10	+10	-25	+10	N.A.
128-101	M-6703-3	SA 508-CL2	Inlet Nozzle	-10	-10	-27	+18	N.A.
128-101	M-6703-4	SA 508-CL2	Inlet Nozzle	0	0	+5	+42	N.A.
131-102	M-4307-1	SA 508-CL2	Outlet Nozzle Safe End	-10	+10	+30	+68	N.A.
131-102	M-4307-2	SA 508-CL2	Outlet Nozzle Safe End	-10	+10	+30	+68	N.A.
128-501	M-6708-1	SA 508-CL2	Inlet Nozzle Extension	+20	+20	-10	+10	N.A.
128-501	M-6708-2	SA 508-CL2	Inlet Nozzle Extension	+20	+20	-10	+10	N.A.
128-501	M-6708-3	SA 508-CL2	Inlet Nozzle Extension	+20	+20	-20	+20	N.A.
128-501	M-6708-4	SA 508-CL2	Inlet Nozzle Extension	+20	+20	-20	+20	N.A.
128-301	M-4304-1	SA 508-CL2	Outlet Nozzle	-10	-10	-35**	-10**	N.A.
128-301	M-4304-2	SA 508-CL2	Outlet Nozzle	-10	-10	-35**	-10**	N.A.
131-101	M-6712-1	SA 508-CL1	Inlet Nozzle Safe End	-10	-10	+10	+45	N.A.
131-101	M-6712-2	SA 508-CL1	Inlet Nozzle Safe End	-10	-10	+10	+45	N.A.
131-101	M-6712-3	SA 508-CL1	Inlet Nozzle Safe End	-10	-10	+7	+50	N.A.
131-101	M-6712-4	SA 508-CL1	Inlet Nozzle Safe End	-10	-10	+7	+50	N.A.
126-101	M-6705-1	SA 508-CL2	Vessel Flange	-70	-70	-78	-28	N.A.
106-101	M-6706-1	SA 508-CL2	Closure Head Flange	-70	-70	-80	-54	N.A.

N.A. = Not Applicable (no minimum upper shelf requirement).

\* = Lower bound curve values.

\*\* = Average of three test results.

(a) = Determined per applicable ASME-BPV-Code Sect. III, Subsection NB, Article NB-2331-(a-1,2,3).

(b) = 0° and 180° specimens had the same values.

RECEIVED  
JAN 11 1977

TABLE B 3/4.4-1 (Continued)  
REACTOR VESSEL TOUGHNESS  
(PLATES)

PIECE NO.	CODE NO.	MATERIAL	VESSEL LOCATION	DROP WEIGHT RESULTS (°F)	RT <sub>NDT</sub> (°F)	TEMPERATURE OF CHARPY V-NOTCH*		MINIMUM UPPER SHELF C <sub>v</sub> ENERGY FOR LONGITUDINAL DIRECTION-ft lb
						@ 30 ft - lb	@ 50 ft - lb	
142-102	M-4311-1	SA 533-GRB-CL1	Lower Shell Plate	-10	-10	-6	+40	134
142-102	M-4311-2	SA 533-GRB-CL1	Lower Shell Plate	-40	-40	-24	-8	127
142-102	M-4311-3	SA 533-GRB-CL1	Lower Shell Plate	-20	-20	-7	+14	142
124-102	M-6701-1	SA 533-GRB-CL1	Intermed. Shell Plate	-40	+30	+44	+90	83
124-102	M-6701-2	SA 533-GRB-CL1	Intermed. Shell Plate	-50	+40	+56	+98	96
124-102	M-6701-3	SA 533-GRB-CL1	Intermed. Shell Plate	-30	+40	+39	+89	100
122-102	M-6701-4	SA 533-GRB-CL1	Upper Shell Plate	-30	+60	+82	+120	N.A.
122-102	M-6701-5	SA 533-GRB-CL1	Upper Shell Plate	-30	+40	+49	+98	N.A.
122-102	M-6701-6	SA 533-GRB-CL1	Upper Shell Plate	-30	+40	+42	+96	N.A.
102-102A	M-6709-1	SA 533-GRB-CL1	Closure Head Dome	-20	+10	+36	+66	N.A.
102-102B	M-6709-2	SA 533-GRB-CL1	Closure Head Dome	-70	-20	+4	+37	N.A.
150-102	M-6715-1	SA 533-GRB-CL1	Bottom Head Dome	-30	-30	+2	+30	N.A.
150-102	M-6715-2	SA 533-GRB-CL1	Bottom Head Dome	-40	-10	+26	+50	N.A.

(a) = Determined per applicable ASME-BPV-Code Sect. III, Subsection NB; Article NB-2331-(a-1,2,3).

N.A. = Not Applicable (no minimum upper shelf requirement).

\* = Lower bound curve values of transverse specimens.

RECEIVED  
 BUREAU OF  
 NUCLEAR ENERGY

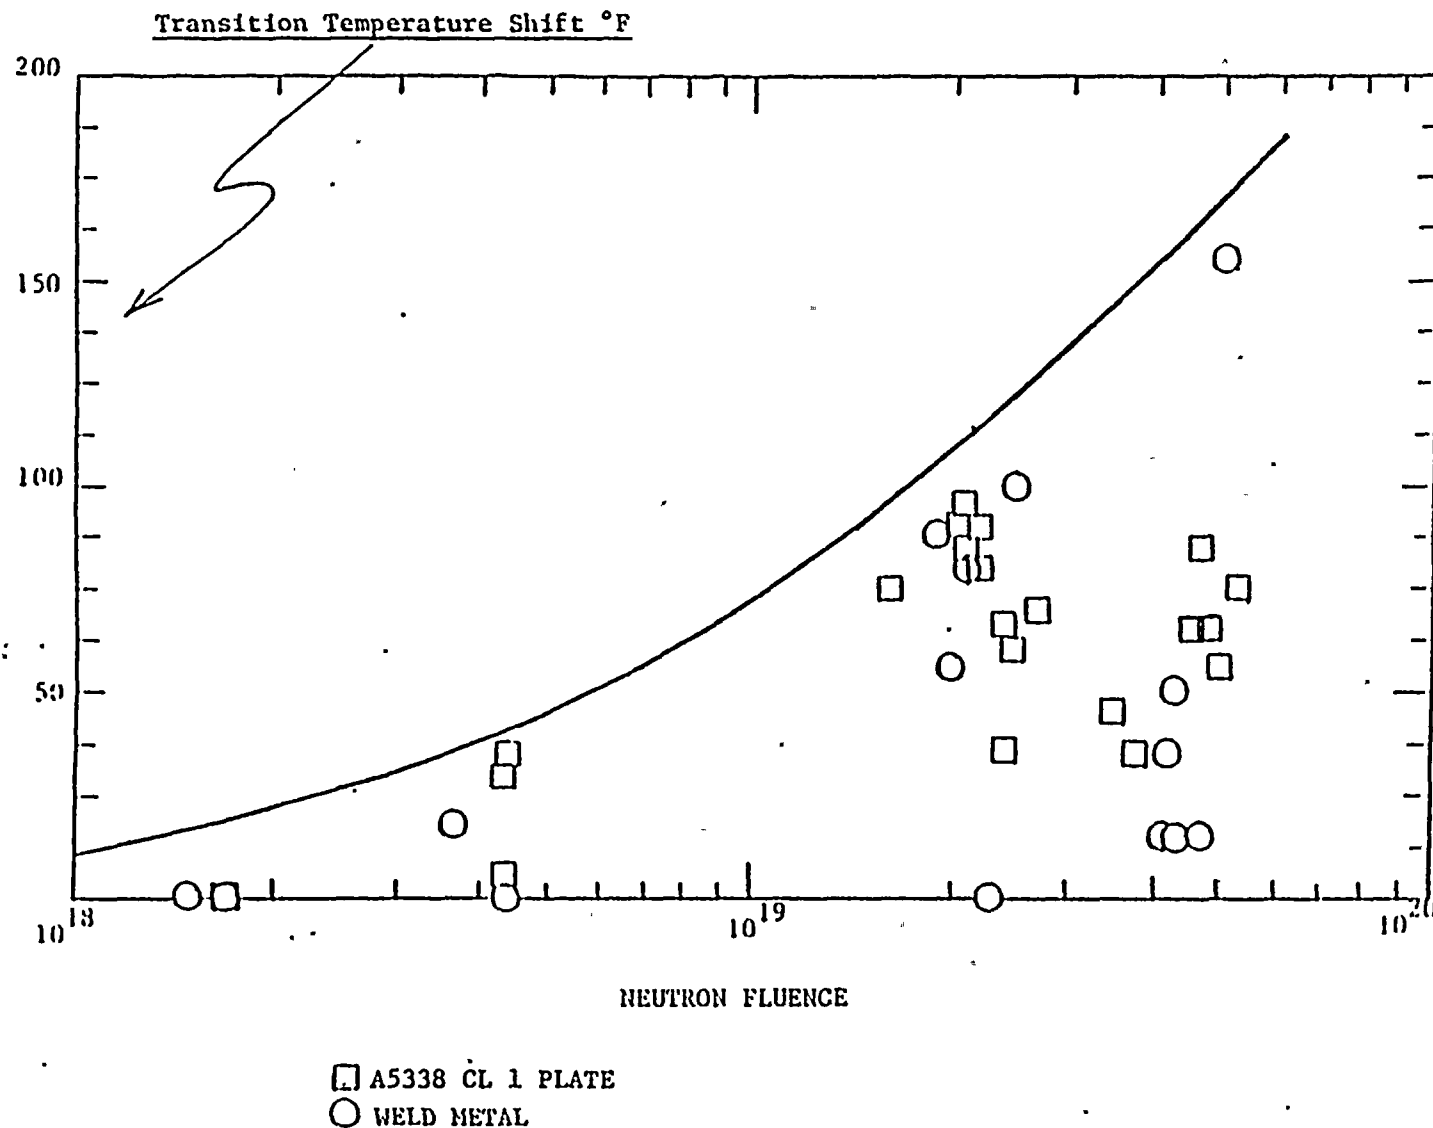


FIGURE B 3/4.4-1

NIL-DUCTILITY TRANSITION TEMPERATURE INCREASE AS A FUNCTION OF FAST ( $E > 1$  MeV)  
NEUTRON FLUENCE (550°F IRRADIATION)

FINAL  
COPY

FINAL DRAFT

## REACTOR COOLANT SYSTEM

### BASES

#### PRESSURE/TEMPERATURE LIMITS (Continued)

The limitations imposed on the pressurizer heatup and cooldown rates and spray water temperature differential are provided to assure that the pressurizer is operated within the design criteria assumed for the fatigue analysis performed in accordance with the ASME Code requirements.

The OPERABILITY of two shutdown cooling suction line relief valves, one located in each shutdown cooling suction line, while maintaining the limits imposed on the RCS heatup and cooldown rates, ensures that the RCS will be protected from pressure transients which could exceed the limits of Appendix G to 10 CFR Part 50 when one or more of the RCS cold legs are less than or equal to 255°F during cooldown and 295°F during heatup. Either one of the two SCS suction line relief valves provides relieving capability to protect the RCS from overpressurization when the transient is limited to either (1) the start of an idle RCP with the secondary water temperature of the steam generator less than or equal to 100°F above the RCS cold leg temperatures or (2) the inadvertent safety injection actuation with two HPSI pumps injecting into a water-solid RCS with full charging capacity and with letdown isolated. These events are the most limiting energy and mass addition transients, respectively, when the RCS is at low temperatures.

#### 3/4.4.9 STRUCTURAL INTEGRITY

The inservice inspection and testing programs for ASME Code Class 1, 2, and 3 components ensure that the structural integrity and operational readiness of these components will be maintained at an acceptable level throughout the life of the plant. These programs are in accordance with Section XI of the ASME Boiler and Pressure Vessel Code and applicable Addenda as required by 10 CFR 50.55a(g) except where specific written relief has been granted by the Commission pursuant to 10 CFR 50.55a (g) (6) (i).

Components of the Reactor Coolant System were designed to provide access to permit inservice inspections in accordance with Section XI of the ASME Boiler and Pressure Vessel Code, 1974 Edition and Addenda through Summer 1975.

#### 3/4.4.10 REACTOR COOLANT SYSTEM VENTS

Reactor Coolant System vents are provided to exhaust noncondensable gases and/or steam from the primary system that could inhibit natural circulation core cooling. The OPERABILITY of at least one Reactor Coolant System vent path from the reactor vessel head ensures the capability exists to perform this function.

The valve redundancy of the Reactor Coolant System vent paths serves to minimize the probability of inadvertent or irreversible actuation while ensuring that a single failure of a vent valve, power supply, or control system does not prevent isolation of the vent path.

The function, capabilities, and testing requirements of the Reactor Coolant System vent systems are consistent with the requirements of Item II.B.1 of NUREG-0737.

## INSERT A

The limitations imposed on the RCS heatup and cooldown rates are provided to assure low temperature overpressure protection (LTOP) with the two shutdown cooling suction line relief valves operable. Figure B 3/4.4-2 provides the limits of Appendix G to 10 CFR Part 50 for various heatup and cooldown rates. At low temperatures with the relief valves aligned to the RCS, it is necessary to restrict heatup and cooldown rates to assure that the P/T limits are not exceeded. During worst case transients, RCS peak pressures can reach the relief valve setpoint, 467 psig, plus accumulation. At temperatures greater than 255°F during cooldown and 295°F during heatup, the heatup and cooldown rate limitations assure the limits of Appendix G to 10 CFR 50 will not be exceeded with overpressure protection provided by the primary safety valves.





FINAL DRAFT

### 3/4.5 EMERGENCY CORE COOLING SYSTEMS (ECCS)

#### BASES

#### 3/4.5.1 SAFETY INJECTION TANKS

The OPERABILITY of each of the Safety Injection System (SIS) safety injection tanks ensures that a sufficient volume of borated water will be immediately forced into the reactor core through each of the cold legs in the event the RCS pressure falls below the pressure of the safety injection tanks. This initial surge of water into the RCS provides the initial cooling mechanism during large RCS pipe ruptures.

The limits on safety injection tank volume, boron concentration, and pressure ensure that the safety injection tanks will adequately perform their function in the event of a LOCA in MODE 1, 2, 3, or 4.

A minimum of 25% narrow range corresponding to 1790 cubic feet and a maximum of 75% narrow range corresponding to 1927 cubic feet of borated water are used in the safety analysis as the volume in the SITs. To allow for instrument accuracy, 28% narrow range corresponding to 1802 cubic feet and 72% narrow range corresponding to 1914 cubic feet, are specified in the Technical Specification.

A minimum of 593 psig and a maximum pressure of 632 psig are used in the safety analysis. To allow for instrument accuracy 600 psig minimum and 625 psig maximum are specified in the Technical Specification.

A boron concentration of 2000 ppm minimum and 4400 ppm maximum are used in the safety analysis.

The SIT isolation valves are not single failure proof; therefore, whenever the valves are open power shall be removed from these valves and the switch keylocked open. These precautions ensure that the SITs are available during a Limiting Fault.

The SIT nitrogen vent valves are not single failure proof against depressurizing the SITs by spurious opening. Therefore, power to the valves is removed while they are closed to ensure the safety analysis assumption of four pressurized SITs.

All of the SIT nitrogen vent valves are required to be operable so that, given a single failure, all four SITs may still be vented during post-LOCA long-term cooling. Venting the SITs provides for SIT depressurization capability which ensures the timely establishment of shutdown cooling entry conditions as assumed by the safety analysis for small break LOCAs.

The limits for operation with a safety injection tank inoperable for any reason except an isolation valve closed minimizes the time exposure of the plant to a LOCA event occurring concurrent with failure of an additional safety injection tank which may result in unacceptable peak cladding temperatures. If a closed isolation valve cannot be immediately opened, the full capability of one safety injection tank is not available and prompt action is required to place the reactor in a MODE where this capability is not required.

For MODES 3 and 4 operation with pressurizer pressure less than 1750 psia the Technical Specifications require a minimum of 57% wide range corresponding

FINAL DRAFT

## EMERGENCY CORE COOLING SYSTEMS (ECCS)

### BASES

#### SAFETY INJECTION TANKS (Continued)

to 1361 cubic feet and a maximum of 75% narrow range corresponding to 1927 cubic feet of borated water per tank, when three safety injection tanks are operable and a minimum of 36% wide range corresponding to 908 cubic feet and a maximum of 75% narrow range corresponding to 1927 cubic feet per tank, when four safety injection tanks are operable at a minimum pressure of 235 psig and a maximum pressure of 625 psig. To allow for instrument inaccuracy, 60% wide range instrument corresponding to 1415 cubic feet, and 72% narrow range instrument corresponding to 1914 cubic feet, when three safety injection tanks are operable, and 39% wide range instrument corresponding to 962 cubic feet, and 72% narrow range instrument corresponding to 1914 cubic feet, when four SITs are operable, are specified in the Technical Specifications. To allow for instrument inaccuracy 254 psig is specified in the Technical Specifications.

#### 3/4.5.2 and 3/4.5.3 ECCS SUBSYSTEMS

The OPERABILITY of two separate and independent ECCS subsystems with the RCS temperatures greater than or equal to 350°F ensures that sufficient emergency core cooling capability will be available in the event of a LOCA assuming the loss of one subsystem through any single failure consideration. Either subsystem operating in conjunction with the safety injection tanks is capable of supplying sufficient core cooling to limit the peak cladding temperatures within acceptable limits for all postulated break sizes ranging from the double-ended break of the largest RCS cold leg pipe downward. In addition, each ECCS subsystem provides long-term core cooling capability in the recirculation mode during the accident recovery period.

With the RCS temperature below 350°F, one OPERABLE ECCS subsystem is acceptable without single failure consideration on the basis of the stable reactivity condition of the reactor and the limited core cooling requirements.

The trisodium phosphate dodecahydrate (TSP) stored in dissolving baskets located in the containment basement is provided to minimize the possibility of corrosion cracking of certain metal components during operation of the ECCS following a LOCA. The TSP provided this protection by dissolving in the sump water and causing its final pH to be raised to greater than or equal to 7.0.

The surveillance requirements provided to ensure OPERABILITY of each component ensure that at a minimum, the assumptions used in the safety analyses are met and that subsystem OPERABILITY is maintained. Surveillance requirements for throttle valve position stops and flow balance testing provide

## EMERGENCY CORE COOLING SYSTEMS

### BASES

#### ECCS SUBSYSTEMS (Continued)

assurance that proper ECCS flows will be maintained in the event of a LOCA.\* Maintenance of proper flow resistance and pressure drop in the piping system to each injection point is necessary to: (1) prevent total pump flow from exceeding runout conditions when the system is in its minimum resistance configuration, (2) provide the proper flow split between injection points in accordance with the assumptions used in the ECCS-LOCA analyses, and (3) provide an acceptable level of total ECCS flow to all injection points equal to or above that assumed in the ECCS-LOCA analyses. The requirement to dissolve a representative sample of TSP in a sample of RWT water provides assurance that the stored TSP will dissolve in borated water at the postulated post-LOCA temperatures.

The term "minimum bypass recirculation flow," as used in Specification 4.5.2e.3. and 4.5.2f., refers to that flow directed back to the RWT from the ECCS pumps for pump protection. Testing of the ECCS pumps under the condition of minimum bypass recirculation flow in Specification 4.5.2f. verifies that the performance of the ECCS pumps supports the safety analysis minimum RCS pressure assumption at zero delivery to the RCS.

#### 3/4.5.4 REFUELING WATER TANK

The OPERABILITY of the refueling water tank (RWT) as part of the ECCS ensures that a sufficient supply of borated water is available for injection by the ECCS in the event of a LOCA. The limits on RWT minimum volume and boron concentration ensure that (1) sufficient water plus 10% margin is available to permit 20 minutes of engineered safety features pump operation, and (2) the reactor will remain subcritical in the cold condition following mixing of the RWT and the RCS water volumes with all control rods inserted except for the most reactive control assembly. These assumptions are consistent with the LOCA analyses.

\*The following test conditions, which apply during flow balance tests, ensure that the ECCS subsystems are adequately tested.

1. The pressurizer pressure is at atmospheric pressure.
2. The miniflow bypass recirculation lines are aligned for injection.
3. For LPSI system, (add/subtract) 6.4 gpm (to/from) the 4900 gpm requirement for every foot by which the difference of RWT water level above the RWT RAS setpoint level (exceeds/is less than) the difference of RCS water level above the cold leg centerline.

**FINAL DRAFT**

## EMERGENCY CORE COOLING SYSTEMS

### BASES

---

#### REFUELING WATER TANK (Continued)

The contained water volume limit includes an allowance for water not usable because of tank discharge line location or other physical characteristics.

The limits on contained water volume and boron concentration of the RWT also ensure a pH value of between 7.0 and 8.5 for the solution recirculated within containment after a LOCA. This pH band minimizes the evolution of iodine and minimizes the effect of chloride and caustic stress corrosion on mechanical systems and components.

The limit on the RWT solution temperature ensures that the assumptions used in the LOCA analyses remain valid.

FINAL DRAFT

### 3/4.6 CONTAINMENT SYSTEMS

#### BASES

---

#### 3/4.6.1 PRIMARY CONTAINMENT

##### 3/4.6.1.1 CONTAINMENT INTEGRITY

Primary CONTAINMENT INTEGRITY ensures that the release of radioactive materials from the containment atmosphere will be restricted to those leakage paths and associated leak rates assumed in the safety analyses. This restriction, in conjunction with the leakage rate limitation, will limit the site boundary radiation doses to within the limits of 10 CFR Part 100 during accident conditions.

##### 3/4.6.1.2 CONTAINMENT LEAKAGE

The limitations on containment leakage rates ensure that the total containment leakage volume will not exceed the value assumed in the safety analyses at the peak accident pressure,  $P_a$ . As an added conservatism, the measured overall integrated leakage rate is further limited to less than or equal to  $0.75 L_p$  or less than or equal to  $0.75 L_t$ , as applicable during performance of the periodic tests to account for possible degradation of the containment leakage barriers between leakage tests.

The surveillance testing for measuring leakage rates are consistent with the requirements of Appendix J of 10 CFR Part 50.

##### 3/4.6.1.3 CONTAINMENT AIR LOCKS

The limitations on closure and leak rate for the containment air locks are required to meet the restrictions on CONTAINMENT INTEGRITY and containment leak rate. Surveillance testing of the air lock seals provides assurance that the overall air lock leakage will not become excessive due to seal damage during the intervals between air lock leakage tests.



## CONTAINMENT SYSTEMS

### BASES

---

#### 3/4.6.1.4 INTERNAL PRESSURE

The limitations on containment internal pressure ensure that (1) the containment structure is prevented from exceeding its design negative pressure differential with respect to the outside atmosphere of 4 psig and (2) the containment peak pressure does not exceed the design pressure of 60 psig during LOCA conditions.

The maximum peak pressure expected to be obtained from a LOCA event is 49.2 psig. The limit of 2.5 psig for initial positive containment pressure will limit the total pressure to 49.2 psig which is less than the design pressure (60 psig) and is consistent with the safety analyses.

#### 3/4.6.1.5 AIR TEMPERATURE

The limitation on containment average air temperature ensures that the overall containment average air temperature does not exceed the initial temperature condition assumed in the safety analysis.

#### 3/4.6.1.6 CONTAINMENT STRUCTURAL INTEGRITY

This limitation ensures that the structural integrity of the containment will be maintained comparable to the original design standards for the life of the facility. Structural integrity is required to ensure that the containment will withstand the maximum pressure of 49.2 psig in the event of a LOCA. The containment design pressure is 60 psig. The measurement of containment tendon lift-off force; the tensile tests of the tendon wires or strands; the examination and testing of the sheathing filler grease; and the visual examination of tendon anchorage assembly hardware, surrounding concrete and the exterior surfaces of the containment are sufficient to demonstrate this capability. The tendon wire or strand samples will also be subjected to tests. All of the required testing and visual examinations should be performed in a time frame that permits a comparison of the results for the same operating history.

The Surveillance Requirements for demonstrating the containment's structural integrity are in compliance with the recommendations of Regulatory Guide 1.35, "Inservice Surveillance of UngROUTED Tendons in Prestressed Concrete Containment Structures," Revision 3, 1984, and Regulatory Guide 1.35.1, "Determining Prestressing Forces for Inspection of Prestressed Concrete Containments," 1984.

The required Special Reports from any engineering evaluation of containment abnormalities shall include a description of the tendon condition, the condition of the concrete (especially at tendon anchorages), the inspection procedures, the tolerances on cracking, the results of the engineering evaluation, and the corrective actions taken.





171

FINAL DRAFT

## CONTAINMENT SYSTEMS

### BASES

---

#### 3/4.6.1.7 CONTAINMENT VENTILATION SYSTEM

The 42-inch containment purge supply and exhaust isolation valves are required to be closed during plant operation since these valves have not been demonstrated capable of closing during a LOCA or steam line break accident. Maintaining these valves closed during plant operations ensures that excessive quantities of radioactive materials will not be released via the containment purge system. To provide assurance that the 42-inch valves cannot be inadvertently opened, they are sealed closed in accordance with Standard Review Plan 6.2.4 which includes mechanical devices to seal or lock the valve closed, or prevent power from being supplied to the valve operator.

The use of the containment purge lines is restricted to the 8-inch purge supply and exhaust isolation valves since, unlike the 42-inch valves, the 8-inch valves will close during a LOCA or steam line break accident and therefore the site boundary dose guidelines of 10 CFR Part 100 would not be exceeded in the event of an accident during purging operations.

Leakage integrity tests with a maximum allowable leakage rate for purge supply and exhaust isolation valves will provide early indication of resilient material seal degradation and will allow the opportunity for repair before gross leakage failure develops. The 0.60 L<sub>h</sub> leakage limit shall not be exceeded when the leakage rates determined by the leakage integrity tests of these valves are added to the previously determined total for all valves and penetrations subject to Type B and C tests.

#### 3/4.6.2 DEPRESSURIZATION AND COOLING SYSTEMS

##### 3/4.6.2.1 CONTAINMENT SPRAY SYSTEM

The OPERABILITY of the containment spray system ensures that containment depressurization and cooling capability will be available in the event of a LOCA. The pressure reduction and resultant lower containment leakage rate are consistent with the assumptions used in the safety analyses.

The containment spray system and the containment cooling system are redundant to each other in providing post-accident cooling of the containment atmosphere. However, the containment spray system also provides a mechanism for removing iodine from the containment atmosphere and therefore the time requirements for restoring an inoperable spray system to OPERABLE status have been maintained consistent with that assigned other inoperable ESF equipment.

##### 3/4.6.2.2 IODINE REMOVAL SYSTEM

The OPERABILITY of the iodine removal system ensures that sufficient N<sub>2</sub>H<sub>4</sub> is added to the containment spray in the event of a LOCA. The limits on N<sub>2</sub>H<sub>4</sub> volume and concentration ensure adequate chemical available to remove iodine from the containment atmosphere following a LOCA.

## CONTAINMENT SYSTEMS

### BASES

#### 3/4.6.3 CONTAINMENT ISOLATION VALVES

The OPERABILITY of the containment isolation valves ensures that the containment atmosphere will be isolated from the outside environment in the event of a release of radioactive material to the containment atmosphere and is consistent with the requirements of GDC 54 through 57 of Appendix A to 10 CFR 50. Containment isolation within the time limits specified for those isolation valves designed to close automatically ensures that the release of radioactive material to the environment will be consistent with the assumptions used in the analyses for a LOCA. Such valves are listed in Sections A and B of Table 3.6-1 and Surveillance requirements to verify OPERABILITY of these valves are explicitly stated in 4.6.3.1 thru 4.6.3.3. Check valves located inside containment are considered OPERABLE provided their leak rate is within limits when tested pursuant to 10 CFR 50 Appendix J.

Section <sup>H</sup>C of Table 3.6-1 contains a listing of manual and self actuated (check) valves that are normally closed and assumed to be closed under design basis accident conditions, but which may be opened intermittently for service, maintenance or test during normal operation provided adequate administrative controls are implemented to ensure operator action is taken to close such valves in the event of an accident.

All valves in Section A, B or C are considered OPERABLE for containment isolation purpose if they are indeed locked, sealed or otherwise secured in the closed position and leakage through the affected flow path is shown to be within limits when tested pursuant to 10 CFR 50 Appendix J.

#### FAND G

Section ~~D~~ of Table 3.6-1 contains a listing of valves assumed to be open or to open automatically on an ESFAS signal to prevent or mitigate the consequences of the design basis accident. Surveillance requirement 4.6.1.1.a is not applicable to such valves. The OPERABILITY of such valves is determined by ESFAS response time testing of specification 3/4.3.2. Valves in Section <sup>F</sup>E that are locked, sealed or otherwise secured in their open position will permit performance of their safety function and are, therefore, considered OPERABLE pursuant to this specification.

#### FAND G

*The footnoted check valves are not Type C tested in accordance with 10 CFR 50 Appendix J. Because they are either required open during accident conditions or they are on the secondary side of the steam <sup>GENERATOR</sup> ~~operating~~. In the event of a LOCA, the steam generator tubes can be water sealed by flooding the steam generator, and therefore Type C tests are not performed*

~~SAN ONOFRE - UNIT 2~~

*PALC VERDE - UNIT 1*

*B 3/4 6-4*



FINAL DRAFT

CONTAINMENT SYSTEMS

BASES

---

3/4.6.3 CONTAINMENT ISOLATION VALVES

The OPERABILITY of the containment automatic isolation valves ensures that the containment atmosphere will be isolated from the outside environment in the event of a release of radioactive material to the containment atmosphere or pressurization of the containment and is consistent with the requirements of GDC 54 through GDC 57 of Appendix A to 10 CFR Part 50. Containment isolation within the time limits specified for those isolation valves designed to close automatically ensures that the release of radioactive material to the environment will be consistent with the assumptions used in the analyses for a LOCA.

3/4.6.4 COMBUSTIBLE GAS CONTROL

The OPERABILITY of the equipment and systems required for the detection and control of hydrogen gas ensures that this equipment will be available to maintain the hydrogen concentration within containment below its flammable limit during post-LOCA conditions. Either recombiner unit (or the purge system) is capable of controlling the expected hydrogen generation associated with (1) zirconium-water reactions, (2) radiolytic decomposition of water and (3) corrosion of metals within containment. These hydrogen control systems are consistent with the recommendations of Regulatory Guide 1.7, "Control of Combustible Gas Concentrations in Containment Following a LOCA," March 1971.

505

# FINAL DRAFT

## 3/4.7 PLANT SYSTEMS

The valves are sized to pass  
A minimum of 102% of the  
Rated Thermal Power at  
102% of Design Power

### BASES

#### 3/4.7.1 TURBINE CYCLE

##### 3/4.7.1.1 SAFETY VALVES

THE ADEQUACY OF THIS  
RELIEVING CAPACITY IS  
DEMONSTRATED BY

The OPERABILITY of the main steam safety valves (MSSVs) limit secondary system pressure to within 110% (1397 psia) of the design pressure (1270 psia) during the most severe anticipated operational transient. For design purposes, ~~a turbine trip (without reactor trip or cutback) from RATED THERMAL POWER with a coincident loss of condenser heat sink (i.e., no steam bypass) is assumed. The combined relieving capacity of the pressurizer safety valves, and the heat removal capacity of the MSSVs, is sufficient to maintain the Reactor Coolant System pressure below NRC acceptance criteria (120% of design pressure for large feedwater line breaks and 110% of design pressure for all other events).~~

CSA ELECTION

OVERPRESSURIZATION

The specified valve lift settings and relieving capacities are in accordance with the requirements of Section III of the ASME Boiler and Pressure Vessel Code, 1974 Edition. The total relieving capacity for all twenty MSSVs at 110% of system design pressure (adjusted for 50 psi pressure drop to valves inlet) is  $19.44 \times 10^6$  lbm/hr. This capacity is less than the total rated capacity of  $19.53 \times 10^6$  lbm/hr given in Table 3.7-1 as the MSSVs are operating at an inlet pressure below rated conditions. At these same secondary pressure conditions, the total steam flow at 102% (2% uncertainty) of 3817 MWt (RATED THERMAL POWER plus 17 MWt pump heat input) is  $17.83 \times 10^6$  lbm/hr. The ratio of this total steam flow to the total capacity is 109.2%.

STARTUP and/or POWER OPERATION is allowable with MSSVs inoperable if the maximum allowable power level is reduced to a value equal to the product of the ratio of the number of MSSVs available per steam generator to the total number of MSSVs per steam generator with the ratio of the total steam flow to available relieving capacity.

$$\text{Allowable Power Level} = \left( \frac{10-N}{10} \right) \times 109.2$$

Although the variable high power reactor trip <sup>OVER</sup> is not relied on for the limiting overpressure events, the ceiling on this trip is also reduced to an amount over the allowable power level equal to the BAND given for this trip in Table 2.2-1.

$$SP = \text{Allowable Power Level} + 9.8$$

where:

SP = reduced reactor trip setpoint in percent of RATED THERMAL POWER. This is a ratio of the available relieving capacity over the total steam flow at rated power.

## PLANT SYSTEMS

### BASES

#### SAFETY VALVES (continued)

- 10 . = total number of secondary safety valves for one steam generator.
- N = number of inoperable main steam safety valves on the steam generator with the greater number of inoperable valves.
- 109.2 = ratio of main steam safety valve relieving capacity of 110% steam generator design pressure to calculated steam flow rate at 100% plant power + 2% uncertainty (see above text)
- 9.8 = BAND between the maximum thermal power and the variable over-power trip setpoint ceiling

#### 3/4.7.1.2 AUXILIARY FEEDWATER SYSTEM

The OPERABILITY of the auxiliary feedwater system ensures that the Reactor Coolant System can be cooled down to less than 350°F from normal operating conditions in the event of a total loss-of-offsite power.

Each electric-driven auxiliary feedwater pump is capable of delivering a minimum feedwater flow of 750 gpm at a pressure of 1260 psia to the entrance of the steam generators. The steam-driven auxiliary feedwater pump is capable of delivering a minimum feedwater flow of 750 gpm at a pressure of 1260 psia to the entrance of the steam generators. This capacity is sufficient to ensure that adequate feedwater flow is available to remove decay heat and reduce the Reactor Coolant System temperature to less than 350°F when the shutdown cooling system may be placed into operation.

#### 3/4.7.1.3 CONDENSATE STORAGE TANK

The OPERABILITY of the condensate storage tank ensures that a minimum water volume of 300,000 gallons is available to maintain the Reactor Coolant System at HOT STANDBY for 8 hours followed by an orderly cooldown to the shutdown cooling entry (350°F) temperature with concurrent total loss-of-site power, and also ensures that sufficient water is available to maintain the RCS at HOT STANDBY conditions for 8 hours with steam discharge to atmosphere concurrent with total loss-of-offsite power. The contained water volume limit includes an allowance for water not usable because of tank discharge line location or other physical characteristics.

PLANT SYSTEMSBASES

---

3/4.7.1.4 ACTIVITY

The limitations on secondary system specific activity ensure that the resultant offsite radiation dose will be limited to a small fraction of 10 CFR Part 100 limits in the event of a steam line rupture. This dose also includes the effects of a coincident 1 gpm primary-to-secondary tube leak in the steam generator of the affected steam line and a concurrent loss-of-offsite electrical power. These values are consistent with the assumptions used in the safety analyses.

3/4.7.1.5 MAIN STEAM LINE ISOLATION VALVES

The OPERABILITY of the main steam line isolation valves ensures that no more than one steam generator will blow down in the event of a steam line rupture. This restriction is required to (1) minimize the positive reactivity effects of the Reactor Coolant System cooldown associated with the blowdown, and (2) limit the pressure rise within containment in the event the steam line rupture occurs within containment. The OPERABILITY of the main steam isolation valves within the closure times of the surveillance requirements are consistent with the assumptions used in the safety analyses.

3/4.7.1.6 ATMOSPHERIC DUMP VALVES

The limitation on maintaining the nitrogen accumulator at a pressure  $\geq 400$  psig is to ensure that a sufficient volume of nitrogen is in the accumulator to operate the associated ADV which holds the plant at hot standby while dissipating core decay heat or which allows a flow of sufficient steam to maintain a controlled reactor cooldown rate. A pressure of 400 psig retains sufficient nitrogen volume for 4 hours of operation at hot standby plus 6.5 hours of operation to reach cold shutdown under natural circulation conditions in the event of failure of the normal control air system.

3/4.7.2 STEAM GENERATOR PRESSURE/TEMPERATURE LIMITATION

The limitation on steam generator pressure and temperature ensures that the pressure induced stresses in the steam generators do not exceed the maximum allowable fracture toughness stress limits. The limitations to 120°F and 230 psig are based on a steam generator RT<sub>NDT</sub> of 40°F and are sufficient to prevent brittle fracture.

3/4.7.3 ESSENTIAL COOLING WATER SYSTEM

The OPERABILITY of the essential cooling water system ensures that sufficient cooling capacity is available for continued operation of safety-related equipment during normal and accident conditions. The redundant cooling capacity of this system, assuming a single failure, is consistent with the assumptions used in the safety analyses.





## PLANT SYSTEMS

### BASES

---

#### 3/4.7.4 ESSENTIAL SPRAY POND SYSTEM

The OPERABILITY of the essential spray pond system ensures that sufficient cooling capacity is available for continued operation of equipment during normal and accident conditions. The redundant cooling capacity of this system, assuming a single failure, is consistent with the assumptions used in the safety analyses.

#### 3/4.7.5 ULTIMATE HEAT SINK

The limitations on the ultimate heat sink level and temperature ensure that sufficient cooling capacity is available to either (1) provide normal cooldown of the facility, or (2) to mitigate the effects of accident conditions within acceptable limits.

The limitations on minimum water level and maximum temperature are based on providing a 27-day cooling water supply to safety-related equipment without exceeding their design basis temperature and is consistent with the intent of the recommendations of Regulatory Guide 1.27, "Ultimate Heat Sink for Nuclear Plants," March 1974.

#### 3/4.7.6 ESSENTIAL CHILLED WATER SYSTEM

The OPERABILITY of the essential chilled water system ensures that sufficient cooling capacity is available for continued operation of equipment and control room habitability during accident conditions. The redundant cooling capacity of this system, assuming a single failure, is consistent with the assumptions used in the safety analyses.

The Essential Chilled Water System (ECWS), in conjunction with respective emergency HVAC units, is required in accordance with Specification Definition 1.18 to provide heat removal in maintaining the various Engineered Safety Features (ESFs) room space design temperatures below the associated equipment qualification limits for the range of Design Basis Accident conditions. The normal HVAC system is redundant to the emergency HVAC system in maintaining the space design conditions of required safety systems during normal operating conditions and Design Basis Accident Conditions not involving seismic events or loss of offsite power. A seven (7) day Action requirement is for a single ECWS out of service, based on the high reliability of offsite power and availability of the normal HVAC system. The normal HVAC system contains two 100% redundant chillers. Action requirements are provided to ensure operability of the vital bus inverters and emergency battery chargers, by verifying within one hour that the normal HVAC system is providing space cooling to the vital power distribution rooms. The Action requirement is provided to establish within 8 hours operability of the safe shutdown systems which do not depend on the inoperable ECWS. The 8 hour period provides a reasonable time in which to establish operability of this complement of key safety systems. This requirement ensures that a functional train of safe shutdown equipment is available to put the plant in a safe, stable condition for the most probable abnormal operational occurrences. An Action requirement of 24 hours is provided to establish operability of the remaining required safety systems which do not depend on the inoperable ECWS.

PLANT SYSTEMSBASES3/4.7.7 CONTROL ROOM ESSENTIAL FILTRATION SYSTEM

The OPERABILITY of the control room essential filtration system ensures that the control room will remain habitable for operations personnel during and following all credible accident conditions. The OPERABILITY of this system in conjunction with control room design provisions is based on limiting the radiation exposure to personnel occupying the control room to 5 rem or less whole body, or its equivalent. This limitation is consistent with the requirements of General Design Criterion 19 of Appendix A, 10 CFR Part 50.

3/4.7.8 ESF PUMP ROOM AIR EXHAUST CLEANUP SYSTEM

The OPERABILITY of the ESF pump room air exhaust cleanup system ensures that radioactive materials leaking from the ECCS equipment within the pump room following a LOCA are filtered prior to reaching the environment. The operation of this system and the resultant effect on offsite dosage calculations was assumed in the safety analyses.

3/4.7.9 SNUBBERS

All snubbers are required OPERABLE to ensure that the structural integrity of the reactor coolant system and all other safety-related systems is maintained during and following a seismic or other event initiating dynamic loads. Snubbers excluded from this inspection program are those installed on nonsafety-related systems and then only if their failure or failure of the system on which they are installed, would have no adverse effect on any safety-related system.

Snubbers are classified and grouped by design and manufacturer but not by size. For example, mechanical snubbers utilizing the same design features of the 2-kip, 10-kip, and 100-kip capacity manufactured by Company "A" are of the same type. The same design mechanical snubbers manufactured by Company "B" for the purposes of this Technical Specification would be of a different type, as would hydraulic snubbers from either manufacturer.

A list of individual snubbers with detailed information of snubber location and size and of system affected shall be available at the plant in accordance with Section 50.71(c) of 10 CFR Part 50. The accessibility of each snubber shall be determined and approved by the Plant Review Board. The determination shall be based upon the existing radiation levels and the expected time to perform a visual inspection in each snubber location as well as other factors associated with accessibility during plant operations (e.g., temperature, atmosphere, location, etc.), and the recommendations of Regulatory Guides 8.8 and 8.10. The addition or deletion of any hydraulic or mechanical snubber shall be made in accordance with Section 50.59 of 10 CFR Part 50.

The visual inspection frequency is based upon maintaining a constant level of snubber protection. Therefore, the required inspection interval varies inversely with the observed snubber failures and is determined by the number

FINAL DRAFT

PLANT SYSTEMS

BASES

SNUBBERS (Continued)

of inoperable snubbers found during an inspection. In order to establish the inspection frequency for each type of snubber, it was assumed that the frequency of failures and initiating events is constant with time and that the failure of any snubber could cause that system to be unprotected and to result in failure during an assumed initiating event. Inspections performed before that interval has elapsed may be used as a new reference point to determine the next inspection. However, the results of such early inspections performed before the original required time interval has elapsed (nominal time less 25%) may not be used to lengthen the required inspection interval. Any inspection whose results require a shorter inspection interval will override the previous schedule.

The acceptance criteria are to be used in the visual inspection to determine OPERABILITY of the snubbers.

To provide assurance of snubber functional reliability one of three functional testing methods are used with the stated acceptance criteria:

1. Functionally test 10% of a type of snubber with an additional 10% tested for each functional testing failure, or
2. Functionally test a sample size and determine sample acceptance or rejection using Figure 4.7-1, or
3. Functionally test a representative sample size and determine sample acceptance or rejection using the stated equation.

Figure 4.7-1 was developed using "Wald's Sequential Probability Ratio Plan" as described in "Quality Control and Industrial Statistics" by Acheson J. Duncan.

Permanent or other exemptions from the surveillance program for individual snubbers may be granted by the Commission if a justifiable basis for exemption is presented and, if applicable, snubber life destructive testing was performed to qualify the snubbers for the applicable design conditions at either the completion of their fabrication or at a subsequent date. Snubbers so exempted shall be listed in the list of individual snubbers indicating the extent of the exemptions.

The service life of a snubber is established via manufacturer input and information through consideration of the snubber service conditions and associated installation and maintenance records (newly installed snubber, seal replaced, spring replaced, in high radiation area, in high temperature area, etc.). The requirement to monitor the snubber service life is included to ensure that the snubbers periodically undergo a performance evaluation in view of their age and operating conditions. These records will provide statistical bases for future consideration of snubber service life.

FINAL DRAFT

PLANT SYSTEMS

BASES

---

3/4.7.10 SEALED SOURCE CONTAMINATION

The limitations on removable contamination for sources requiring leak testing, including alpha emitters, is based on 10 CFR 70.39(c) limits for plutonium. This limitation will ensure that leakage from byproduct, source, and special nuclear material sources will not exceed allowable intake values.

Sealed sources are classified into three groups according to their use, with surveillance requirements commensurate with the probability of damage to a source in that group. Those sources which are frequently handled are required to be tested more often than those which are not. Sealed sources which are continuously enclosed within a shielded mechanism (i.e. sealed sources within radiation monitoring or boron measuring devices) are considered to be stored and need not be tested unless they are removed from the shield mechanism.

3/4.7.11 FIRE SUPPRESSION SYSTEMS

The OPERABILITY of the fire suppression systems ensures that adequate fire suppression capability is available to confine and extinguish fires occurring in any portion of the facility where safety-related equipment is located. The fire suppression system consists of the water system, spray and/or sprinklers, CO<sub>2</sub>, fire hose stations, and yard fire hydrants. The collective capability of the fire suppression systems is adequate to minimize potential damage to safety-related equipment and is a major element in the facility fire protection program.

In the event that portions of the fire suppression systems are inoperable, alternate backup fire fighting equipment is required to be made available in the affected area(s) until the inoperable equipment is restored to service. When the inoperable fire fighting equipment is intended for use as a backup means of fire suppression, a longer period of time is allowed to provide an alternate means of fire fighting than if the inoperable equipment is the primary means of fire suppression.

The surveillance requirements provide assurance that the minimum OPERABILITY requirements of the fire suppression systems are met. An allowance is made for ensuring a sufficient volume of CO<sub>2</sub> in the CO<sub>2</sub> storage tank by verifying either the weight or the level of the tank.

In the event the fire suppression water system becomes inoperable, immediate corrective measures must be taken since this system provides the major fire suppression capability of the plant. The requirement for a 24-hour report to the Commission provides for prompt evaluation of the acceptability of the corrective measures to provide adequate fire suppression capability for the continued protection of the nuclear plant.

FINAL DRAFT

## PLANT SYSTEMS

### BASES

---

#### 3/4.7.12 FIRE-RATED ASSEMBLIES

The OPERABILITY of the fire barriers and barrier penetrations ensure that fire damage will be limited. These design features minimize the possibility of a single fire involving more than one fire area prior to detection and extinguishment. The fire barriers, fire barrier penetrations for conduits, cable trays and piping, fire dampers, and fire doors are periodically inspected and functionally tested to verify their OPERABILITY.

#### 3/4.7.13 SHUTDOWN COOLING SYSTEM

The OPERABILITY of two separate and independent shutdown cooling subsystems ensures that the capability of initiating shutdown cooling in the event of an accident exists even assuming the most limiting single failure occurs. The safety analysis assumes that shutdown cooling can be initiated when conditions permit.

The limits of operation with one shutdown cooling inoperable for any reason minimize the time exposure of the plant to an accident event occurring concurrent with the failure of a component on the other shutdown cooling subsystem.

#### 3/4.7.14 CONTROL ROOM AIR TEMPERATURE

Maintaining the control room air temperature less than or equal to 80°F ensures that (1) the ambient air temperature does not exceed the allowable air temperature for continuous duty rating for the equipment and instrumentation in the control room and (2) the control room will remain habitable for operations personnel during plant operation. The 30 days to return the control room air temperature to less than or equal to 80°F in the Action Statement is consistent with the equipment qualification program for the control room.

FINAL DRAFT

### 3/4.8 ELECTRICAL POWER SYSTEMS

#### BASES

#### 3/4.8.1, 3/4.8.2 and 3/4.8.3 A.C. SOURCES, D.C SOURCES and ONSITE POWER DISTRIBUTION SYSTEMS

The OPERABILITY of the A.C. and D.C. power sources and associated distribution systems during operation ensures that sufficient power will be available to supply the safety-related equipment required for (1) the safe shutdown of the facility and (2) the mitigation and control of accident conditions within the facility. The minimum specified independent and redundant A.C. and D.C. power sources and distribution systems satisfy the requirements of General Design Criterion 17 of Appendix "A" to 10 CFR 50.

The ACTION requirements specified for the levels of degradation of the power sources provide restriction upon continued facility operation commensurate with the level of degradation. The OPERABILITY of the power sources are consistent with the initial condition assumptions of the safety analyses and are based upon maintaining at least one redundant set of onsite A.C. and D.C. power sources and associated distribution systems OPERABLE during accident conditions coincident with an assumed loss-of-offsite power and single failure of the other onsite A.C. source. The A.C. and D.C. source allowable out-of-service times are based on Regulatory Guide 1.93, "Availability of Electrical Power Sources," December 1974. When one diesel generator is inoperable, there is an additional ACTION requirement to verify that all required systems, subsystems, trains, components, and devices that depend on the remaining OPERABLE diesel generator as a source of emergency power are also OPERABLE, and that the steam-driven auxiliary feedwater pump is OPERABLE. This requirement is intended to provide assurance that a loss-of-offsite power event will not result in a complete loss of safety function of critical systems during the period one of the diesel generators is inoperable. The term verify as used in this context means to administratively check by examining logs or other information to determine if certain components are out-of-service for maintenance or other reasons. It does not mean to perform the surveillance requirements needed to demonstrate the OPERABILITY of the component.

The OPERABILITY of the minimum specified A.C. and D.C. power sources and associated distribution systems during shutdown and refueling ensures that (1) the facility can be maintained in the shutdown or refueling condition for extended time periods and (2) sufficient instrumentation and control capability is available for monitoring and maintaining the unit status.

The surveillance requirements for demonstrating the OPERABILITY of the diesel generators are in accordance with the recommendations of Regulatory Guides 1.9 "Selection of Diesel Generator Set Capacity for Standby Power Supplies," March 10, 1971, and 1.108 "Periodic Testing of Diesel Generator Units Used as Onsite Electric Power Systems at Nuclear Power Plants," Revision 1, August 1977, and 1.137, "Fuel Oil Systems for Standby Diesel Generators," Revision 1, October 1979.



ELECTRICAL POWER SYSTEMSBASESA.C. SOURCES, D.C. SOURCES AND ONSITE POWER DISTRIBUTION SYSTEMS (Continued)

The surveillance requirement for demonstrating the OPERABILITY of the Station batteries are based on the recommendations of Regulatory Guide 1.129, "Maintenance Testing and Replacement of Large Lead Storage Batteries for Nuclear Power Plants," February 1978, and IEEE Std 450-1980, "IEEE Recommended Practice for Maintenance, Testing, and Replacement of Large Lead Storage Batteries for Generating Stations and Substations."

Verifying average electrolyte temperature above the minimum for which the battery was sized, total battery terminal voltage onfloat charge, connection resistance values and the performance of battery service and discharge tests ensures the effectiveness of the charging system, the ability to handle high discharge rates and compares the battery capacity at that time with the rated capacity.

Table 4.8-2 specifies the normal limits for each designated pilot cell and each connected cell for electrolyte level, float voltage and specific gravity. The limits for the designated pilot cells float voltage and specific gravity, greater than 2.13 volts and 0.010 below the manufacturer's full charge specific gravity or a battery charger current that had stabilized at a low value, is characteristic of a charged cell with adequate capacity. The normal limits for each connected cell for float voltage and specific gravity, greater than 2.13 volts and not more than 0.020 below the manufacturer's full charge specific gravity with an average specific gravity of all the connected cells not more than 0.010 below the manufacturer's full charge specific gravity, ensures the OPERABILITY and capability of the battery.

Operation with a battery cell's parameter outside the normal limit but within the allowable value specified in Table 4.8-2 is permitted for up to 7 days. During this 7-day period: (1) the allowable values for electrolyte level ensures no physical damage to the plates with an adequate electron transfer capability; (2) the allowable value for the average specific gravity of all the cells, not more than 0.020 below the manufacturer's recommended full charge specific gravity, ensures that the decrease in rating will be less than the safety margin provided in sizing; (3) the allowable value for an individual cell's specific gravity, ensures that an individual cell's specific gravity will not be more than 0.040 below the manufacturer's full charge specific gravity and that the overall capability of the battery will be maintained within an acceptable limit; and (4) the allowable value for an individual cell's float voltage, greater than 2.07 volts, ensures the battery's capability to perform its design function.



FINAL DRAFT

ELECTRICAL POWER SYSTEMS

BASES

---

3/4.8.4 ELECTRICAL EQUIPMENT PROTECTIVE DEVICES

Containment electrical penetrations and penetration conductors are protected by either deenergizing circuits not required during reactor operation or by demonstrating the OPERABILITY of primary and backup overcurrent protection circuit breakers during periodic surveillance.

The surveillance requirements applicable to lower voltage circuit breakers and fuses provide assurance of breaker and fuse reliability by testing at least one representative sample of each manufacturer's brand of circuit breaker and/or fuse. Each manufacturer's molded case and metal case circuit breakers and/or fuses are grouped into representative samples which are then tested on a rotating basis to ensure that all breakers and/or fuses are tested. If a wide variety exists within any manufacturer's brand of circuit breakers and/or fuses it is necessary to divide that manufacturer's breakers and/or fuses into groups and treat each group as a separate type of breaker or fuses for surveillance purposes.

The OPERABILITY of the motor-operated valves thermal overload protection and/or bypass devices ensures that these devices will not prevent safety related valves from performing their function. The surveillance requirements for demonstrating the OPERABILITY of these devices are in accordance with Regulatory Guide 1.106, "Thermal Overload Protection for Electric Motors on Motor Operated Valves," Revision 1, March 1977.



1/A

**FINAL DRAFT**

### 3/4.9 REFUELING OPERATIONS

#### BASES

---

#### 3/4.9.1 BORON CONCENTRATION

The limitations on reactivity conditions during REFUELING ensure that: (1) the reactor will remain subcritical during CORE ALTERATIONS, and (2) a uniform boron concentration is maintained for reactivity control in the water volume having direct access to the reactor vessel. These limitations are consistent with the initial conditions assumed for the boron dilution incident in the safety analyses. The value of 0.95 or less for  $K_{eff}$  includes a 1% delta k/k conservative allowance for uncertainties. Similarly, the boron concentration value of 2150 ppm or greater also includes a conservative uncertainty allowance of 50 ppm boron.

#### 3/4.9.2 INSTRUMENTATION

The OPERABILITY of the source range neutron flux monitors ensures that redundant monitoring capability is available to detect changes in the reactivity condition of the core.

#### 3/4.9.3 DECAY TIME

The minimum requirement for reactor subcriticality prior to movement of irradiated fuel assemblies in the reactor pressure vessel ensures that sufficient time has elapsed to allow the radioactive decay of the short lived fission products. This decay time is consistent with the assumptions used in the safety analyses.

#### 3/4.9.4 CONTAINMENT BUILDING PENETRATIONS

The requirements on containment penetration closure and OPERABILITY ensure that a release of radioactive material within containment will be restricted from leakage to the environment. The OPERABILITY and closure restrictions are sufficient to restrict radioactive material release from a fuel element rupture based upon the lack of containment pressurization potential while in the REFUELING MODE.

#### 3/4.9.5 COMMUNICATIONS

The requirement for communications capability ensures that refueling station personnel can be promptly informed of significant changes in the facility status or core reactivity condition during CORE ALTERATIONS.

FINAL DRAFT

## REFUELING OPERATIONS

### BASES

#### 3/4.9.6 REFUELING MACHINE

*THE MACHINE* The OPERABILITY requirements for the refueling machine ensure that: (1) ~~manipulator cranes~~ will be used for movement of fuel assemblies, (2) ~~each crane~~ has sufficient load capacity to lift a fuel assembly, including the CEA, and (3) the core internals and pressure vessel are protected from excessive lifting force in the event they are inadvertently engaged during lifting operations.

#### 3/4.9.7 CRANE TRAVEL - SPENT FUEL STORAGE POOL BUILDING

The restriction on movement of loads in excess of the nominal weight of a fuel assembly, CEA and associated handling tool over other fuel assemblies in the storage pool ensures that in the event this load is dropped (1) the activity release will be limited to that contained in a single fuel assembly, and (2) any possible distortion of fuel in the storage racks will not result in a critical array. This assumption is consistent with the activity release assumed in the safety analyses.

#### 3/4.9.8 SHUTDOWN COOLING AND COOLANT CIRCULATION

The requirement that at least one shutdown cooling loop be in operation, and circulate RCS at a flow rate equal to or greater than 4000 gpm ensures that (1) sufficient cooling capacity is available to remove decay heat and maintain the water in the reactor pressure vessel below 135°F as required during the REFUELING MODE, (2) sufficient coolant circulation is maintained through the reactor core to minimize the effects of a boron dilution incident and prevent boron stratification, and (3) the  $\Delta T$  across the core will be maintained at less than 75°F.

Without a shutdown cooling train in operation steam may be generated; therefore, the containment should be sealed off to prevent escape of any radioactivity, and any operations that would cause an increase in decay heat should be secured.

The requirement to have two shutdown cooling loops OPERABLE when there is less than 23 feet of water above the reactor pressure vessel flange, ensures that a single failure of the operating shutdown cooling loop will not result in a complete loss of decay heat removal capability. With the reactor vessel head removed and 23 feet of water above the reactor pressure vessel flange, a large heat sink is available for core cooling, thus in the event of a failure of the operating shutdown cooling loop, adequate time is provided to initiate emergency procedures to cool the core.

#### 3/4.9.9 CONTAINMENT PURGE VALVE ISOLATION SYSTEM

The OPERABILITY of this system ensures that the containment purge valves will be automatically isolated upon detection of high radiation levels within the containment. The OPERABILITY of this system is required to restrict the release of radioactive material from the containment atmosphere to the environment.

*Insert*

The requirement that at least one shutdown cooling loop be in operation and circulating reactor coolant at a flowrate  $\geq 4000$  gpm ensures that (1) sufficient coolant circulation is maintained through the reactor core to minimize the effects of a boron dilution incident and prevent boron stratification, and (2) that the  $\Delta T$  across the core will be maintained less than  $75^{\circ}\text{F}$  during the REFUELING MODE. The required flowrate of  $\geq 4000$  gpm ensures that 240 hours after reactor shutdown sufficient cooling capacity is available to remove decay heat and maintain the water in the reactor pressure vessel below  $135^{\circ}\text{F}$  as required during REFUELING MODE; this assumes a shutdown cooling heat exchanger cooling water flowrate of 14000 gpm, a cooling water inlet temperature of  $\leq 105^{\circ}\text{F}$  at  $\geq 27\frac{1}{2}$  hours after reactor shutdown, and the decay heat curve of CESSAR-F Figure 6.2.1-1 and reactor operation for two years at 4000 MWt.

FINAL DRAFT

## REFUELING OPERATIONS

### BASES

---

#### 3/4.9.10 and 3/4.9.11 WATER LEVEL - REACTOR VESSEL and STORAGE POOL

The restrictions on minimum water level ensure that sufficient water depth (at least 23 feet above the top of the spent fuel) is available to remove a nominal 99% of the assumed 10% iodine gas activity released from the rupture of an irradiated fuel assembly for a maximum fuel rod pressurization of 1200 psig. The minimum water depth is consistent with the assumptions of the safety analysis.

#### 3/4.9.12 FUEL BUILDING ESSENTIAL VENTILATION SYSTEM

The limitations on the fuel building essential ventilation system ensure that all radioactive material released from an irradiated fuel assembly will be filtered through the HEPA filters and charcoal adsorber prior to discharge to the atmosphere. The OPERABILITY of this system and the resulting iodine removal capacity are consistent with the assumptions of the safety analyses.

## 3/4.10 SPECIAL TEST EXCEPTIONS

### BASES

#### 3/4.10.1 SHUTDOWN MARGIN

This special test exception provides that a minimum amount of CEA worth is immediately available for reactivity control when tests are performed for CEAs worth measurement. This special test exception is required to permit the periodic verification of the actual versus predicted core reactivity condition occurring as a result of fuel burnup or fuel cycling operations. Although testing will be initiated from MODE 2, temporary entry into MODE 3 is necessary during some CEA worth measurements. A reasonable recovery time is available for return to MODE 2 in order to continue PHYSICS TESTING.

#### 3/4.10.2 MODERATOR TEMPERATURE COEFFICIENT, GROUP HEIGHT, INSERTION, AND POWER DISTRIBUTION LIMITS

This special test exception permits individual CEAs to be positioned outside of their normal group heights and insertion limits during the performance of such PHYSICS TESTS as those required to (1) measure CEA worth, (2) determine the reactor stability index and damping factor under xenon oscillation conditions, (3) determine power distributions for non-normal CEA configurations, (4) measure rod shadowing factors, and (5) measure temperature and power coefficients. Special test exception permits MTC to exceed limits in Specification 3.1.1.3 during performance of PHYSICS TESTS.

#### 3/4.10.3 REACTOR COOLANT LOOPS

This special test exception permits reactor criticality with less than four reactor coolant pumps in operation and is required to perform certain STARTUP and PHYSICS TESTS while at low THERMAL POWER levels.

#### 3/4.10.4 CEA POSITION, REGULATING CEA INSERTION LIMITS AND REACTOR COOLANT COLD LEG TEMPERATURE

This special test exception permits the CEAs to be positioned beyond the insertion limits and reactor coolant cold leg temperature to be outside limits during PHYSICS TESTS required to determine the isothermal temperature coefficient and power coefficient.

#### 3/4.10.5 MINIMUM TEMPERATURE <sup>And Pressure</sup> FOR CRITICALITY

This special test exception permits reactor criticality at <sup>And Pressure</sup> low THERMAL POWER levels with  $T_{cold}$  below the minimum critical temperature during PHYSICS TESTS which are required to verify the low temperature physics predictions and to ensure the adequacy of design codes for reduced temperature conditions. The Low Power Physics Testing Program at low temperature (300°F) is used to perform the following tests:

1. Biological shielding survey test
2. Isothermal temperature coefficient tests
3. CEA group tests
4. Boron worth tests
5. Critical configuration boron concentration

<sup>2</sup> And a pressure of 500 psia

FINAL DRAFT

### 3/4.10 SPECIAL TEST EXCEPTIONS

#### BASES

---

#### 3/4.10.6 SAFETY INJECTION TANKS

This special test exception permits testing the low pressure safety injection system check valves. The pressure in the injection header must be reduced below the head of the low pressure injection pump in order to get flow through the check valves. The safety injection tank (SIT) isolation valve must be closed in order to accomplish this. The SIT isolation valve is still capable of automatic operation in the event of an SIAS; therefore, system capability should not be affected.

#### 3/4.10.7 SPENT FUEL POOL LEVEL

This special test exception permits loading of the initial core with the spent fuel pool dry.

#### 3/4.10.8 SAFETY INJECTION TANK PRESSURE

This special test exception allows the performance of PHYSICS TESTS at low pressure/low temperature (600 psig, 320°F) conditions which are required to verify the low temperature physics predictions and to ensure the adequacy of design codes for reduced temperature conditions.



**FINAL DRAFT**

### 3/4.11 RADIOACTIVE EFFLUENTS

#### BASES

#### 3/4.11.1 SECONDARY SYSTEM LIQUID WASTE DISCHARGE TO ONSITE EVAPORATION PONDS

##### 3/4.11.1.1 CONCENTRATION

This specification is provided to ensure that at any time during the life of the nuclear station, the annual total body dose due to ground contamination of an UNRESTRICTED AREA, arising from transportation and deposition by wind of the accumulated activity discharged to the pond from the secondary system of the plant (if the pond gets dried up) on the UNRESTRICTED AREA, is within the guidelines of 10 CFR Part 20 for the above-mentioned postulated event.

Restricting the concentrations of the secondary liquid wastes discharged to the onsite evaporation ponds will restrict the quantity of radioactive material that can get accumulated in the ponds. This, in turn, provides assurance that in the event of an uncontrolled release of the pond's contents to an UNRESTRICTED AREA, the resulting total body annual exposure from ground contamination to a MEMBER OF THE PUBLIC at the nearest exclusion area boundary will be within 0.5 rem.

This specification applies to the secondary system liquid waste discharges of radioactive materials from all reactor units to the onsite evaporation ponds. Since the chemical neutralizer tank concentrations will bound concentrations in other secondary waste discharges, surveillance requirements stipulate that sampling and analysis of other secondary waste discharges need be performed only if the sampling and analysis of the contents of the chemical neutralizer tank shows that the neutralizer tank concentration exceeds the specified LLD.

The required detection capabilities for radioactive materials in the secondary liquid waste samples are tabulated in terms of the lower limits of detection (LLDs). Detailed discussion of the LLD, and other detection limits can be found in HASL Procedures Manual, HASL-300 (revised annually), Currie, L. A., "Limits for Qualitative Detection and Quantitative Determination - Application to Radiochemistry," Anal. Chem. 40, 586-93 (1968), and Hartwell, J. K., "Detection Limits for Radioanalytical Counting Techniques," Atlantic Richfield Hanford Company Report ARH-SA-215 (June 1975).

##### 3/4.11.1.2 DOSE

This specification is provided to implement the requirements of Sections II.A, III.A and IV.A of Appendix I, 10 CFR Part 50. The Limiting Condition for Operation implements the guides set forth in Section II.A of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive material in liquid effluents to UNRESTRICTED AREAS will be kept "as low as is reasonably achievable." Also, for fresh water sites with drinking water supplies that can be potentially affected by plant operations, there is reasonable assurance that the operation of the facility will not result in radionuclide concentrations in the finished drinking water that are in excess of the requirements of 40 CFR Part 141. The dose calculation methodology and parameters in the ODCM implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data, such that the actual exposure of a MEMBER OF THE PUBLIC through appropriate pathways is unlikely to be substantially underestimated. The equations specified in the ODCM for calculating the doses due to the actual release rates of radioactive materials in liquid effluents are consistent with

FINAL DRAFT

## RADIOACTIVE EFFLUENTS

### BASES

---

the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I," Revision 1, October 1977 and Regulatory Guide 1.113, "Estimating Aquatic Dispersion of Effluents from Accidental and Routine Reactor Releases for the Purpose of Implementing Appendix I," April 1977.

This specification applies to the release of liquid effluents from each reactor at the site. For units with shared radwaste treatment systems, the liquid effluents from the shared system are proportioned among the units sharing that system.

#### 3/4.11.1.3 LIQUID HOLDUP TANKS

The tanks listed in this specification include all those outdoor radwaste tanks that are not surrounded by liners, dikes, or walls capable of holding the tank contents and that do not have tank overflows and surrounding area drains connected to the liquid radwaste treatment system.

Restricting the quantity of radioactive material contained in the specified tanks provides assurance that in the event of an uncontrolled release of the tanks' contents, the resulting concentrations would be less than the limits of 10 CFR Part 20, Appendix B, Table II, Column 2, at the nearest potable water supply and the nearest surface water supply in an UNRESTRICTED AREA.

The limit of 60 curies is based on the analyses given in Section 2.4 of the PVNGS FSAR and on the amount of soluble (not gaseous) radioactivity in the Refueling Water Tank in Table 2.4-26.

#### 3/4.11.2 GASEOUS EFFLUENTS

##### 3/4.11.2.1 DOSE RATE.

This specification is provided to ensure that the dose at any time at and beyond the SITE BOUNDARY from gaseous effluents from all units on the site will be within the annual dose limits of 10 CFR Part 20 to UNRESTRICTED AREAS. The annual dose limits are the doses associated with the concentrations of 10 CFR Part 20, Appendix B, Table II, Column 1. These limits provide reasonable assurance that radioactive material discharged in gaseous effluents will not result in the exposure of a MEMBER OF THE PUBLIC in an UNRESTRICTED AREA, either within or outside the SITE BOUNDARY, to annual average concentrations exceeding the limits specified in Appendix B, Table II of 10 CFR Part 20 (10 CFR Part 20.106(b)). For MEMBERS OF THE PUBLIC who may at times be within the SITE BOUNDARY, the occupancy of that MEMBER OF THE PUBLIC will usually be sufficiently low to compensate for any increase in the atmospheric diffusion factor above that for the SITE BOUNDARY. Examples of calculations for such MEMBERS OF THE PUBLIC, with the appropriate occupancy factors, shall be given in the ODCM. The specified release rate limits restrict, at all times, the corresponding gamma and beta dose rates above background to a MEMBER OF THE PUBLIC at or beyond the SITE BOUNDARY to less than or equal to 500 mrem/year

FINAL DRAFT

## RADIOACTIVE EFFLUENTS

### BASES

---

#### DOSE RATE (Continued)

to the total body or to less than or equal to 3000 mrem/year to the skin. These release rate limits also restrict, at all times, the corresponding thyroid dose rate above background to a child via the inhalation pathway to less than or equal to 1500 mrem/year.

This specification applies to the release of radioactive materials in gaseous effluents from all reactor units at the site.

The required detection capabilities for radioactive materials in gaseous waste samples are tabulated in terms of the lower limits of detection (LLDs). Detailed discussion of the LLD, and other detection limits can be found in HASL Procedures Manual, HASL-300 (revised annually), Currie, L. A., "Limits for Qualitative Detection and Quantitative Determination - Application to Radiochemistry," Anal. Chem. 40, 586-93 (1968), and Hartwell, J. K., "Detection Limits for Radioanalytical Counting Techniques," Atlantic Richfield Hanford Company Report ARH-SA-215 (June 1975).

#### 3/4.11.2.2 DOSE - NOBLE GASES

This specification is provided to implement the requirements of Sections II.B, III.A and IV.A of Appendix I, 10 CFR Part 50. The Limiting Condition for Operation implements the guides set forth in Section II.B of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive material in gaseous effluents to UNRESTRICTED AREAS will be kept "as low as is reasonably achievable." The surveillance requirements implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data such that the actual exposure of a MEMBER OF THE PUBLIC through appropriate pathways is unlikely to be substantially underestimated. The dose calculation methodology and parameters established in the ODCM for calculating the doses due to the actual release rates of radioactive noble gases in gaseous effluents are consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I," Revision 1, October 1977 and Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water Cooled Reactors," Revision 1, July 1977. The ODCM equations provided for determining the air doses at and beyond the SITE BOUNDARY are based upon the historical average atmospheric conditions.

This specification applies to the release of radioactive materials in gaseous effluents from each reactor unit at the site.

RADIOACTIVE EFFLUENTSBASES3/4.11.2.3 DOSE - IODINE-131, IODINE-133, TRITIUM, AND RADIONUCLIDES IN PARTICULATE FORM

This specification is provided to implement the requirements of Sections II.C, III.A and IV.A of Appendix I, 10 CFR Part 50. The Limiting Conditions for Operation are the guides set forth in Section II.C of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive materials in gaseous effluents to UNRESTRICTED AREAS will be kept "as low as is reasonably achievable." The ODCM calculational methods specified in the surveillance requirements implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data, such that the actual exposure of a MEMBER OF THE PUBLIC through appropriate pathways is unlikely to be substantially underestimated. The ODCM calculational methodology and parameters for calculating the doses due to the actual release rates of the subject materials are consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I," Revision 1, October 1977 and Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water-Cooled Reactors," Revision 1, July 1977. These equations also provide for determining the actual doses based upon the historical average atmospheric conditions. The release rate specifications for iodine-131, iodine-133, tritium, and radionuclides in particulate form with half-lives greater than 8 days are dependent upon the existing radionuclide pathways to man, in the areas at and beyond the SITE BOUNDARY. The pathways that were examined in the development of these calculations were: (1) individual inhalation of airborne radionuclides, (2) deposition of radionuclides onto green leafy vegetation with subsequent consumption by man, (3) deposition onto grassy areas where milk animals and meat-producing animals graze with consumption of the milk and meat by man, and (4) deposition on the ground with subsequent exposure of man.

This specification applies to the release of radioactive materials in gaseous effluents from each reactor unit at the site.

3/4.11.2.4 GASEOUS RADWASTE TREATMENT

The OPERABILITY of the GASEOUS RADWASTE SYSTEM and the VENTILATION EXHAUST TREATMENT SYSTEM ensures that the systems will be available for use whenever gaseous effluents require treatment prior to release to the environment. The requirement that the appropriate portions of these systems be used, when specified, provides reasonable assurance that the releases of radioactive materials in gaseous effluents will be kept "as low as is reasonably achievable." This specification implements the requirements of 10 CFR 50.36a, General Design Criterion 60 of Appendix A to 10 CFR Part 50, and the design objectives given in Section II.D of Appendix I to 10 CFR Part 50. The specified limits governing the use of appropriate portions of the systems were specified as a suitable fraction of the dose design objectives set forth in Sections II.B and II.C of Appendix I, 10 CFR Part 50, for gaseous effluents.

FINAL DRAFT

## RADIOACTIVE EFFLUENTS

### BASES

#### GASEOUS RADWASTE TREATMENT (Continued)

This specification applies to the release of radioactive materials in gaseous effluents from each reactor unit at the site.

##### 3/4.11.2.5 EXPLOSIVE GAS MIXTURE

This specification is provided to ensure that the concentration of potentially explosive gas mixtures contained in the waste gas holdup system is maintained below the flammability limits of hydrogen and oxygen. (Automatic control features are included in the system to prevent the hydrogen and oxygen concentrations from reaching these flammability limits. These automatic control features include isolation of the source of hydrogen and/or oxygen, automatic diversion to recombiners, or injection of dilutants to reduce the concentration below the flammability limits.) Maintaining the concentration of hydrogen and oxygen below their flammability limits provides assurance that the releases of radioactive materials will be controlled in conformance with the requirements of General Design Criterion 60 of Appendix A to 10 CFR Part 50.

##### 3/4.11.2.6 GAS STORAGE TANKS

This specification considers postulated radioactive releases due to a waste gas system leak or failure, and limits the quantity of radioactivity contained in each pressurized gas storage tank in the GASEOUS RADWASTE SYSTEM to assure that a release would be substantially below the guidelines of 10 CFR Part 100 for a postulated event.

Restricting the quantity of radioactivity contained in each gas storage tank provides assurance that in the event of an uncontrolled release of the tank's contents, the resulting total body exposure to a MEMBER OF THE PUBLIC at the nearest exclusion area boundary will not exceed 0.5 rem. This is consistent with Standard Review Plan 11.3, Branch Technical Position ETSB 11-5, "Postulated Radioactive Releases Due to a Waste Gas System Leak or Failure," in NUREG-0800, July 1981.

##### 3/4.11.3 SOLID RADIOACTIVE WASTE

This specification addresses the requirements of General Design Criterion 60 of Appendix A to 10 CFR Part 50. The process parameters included in establishing the PROCESS CONTROL PROGRAM may include, but are not limited to waste type, waste pH, waste/liquid/solidification agent/catalyst ratios, waste oil content, waste principal chemical constituents, and mixing and curing times.

##### 3/4.11.4 TOTAL DOSE

This specification is provided to meet the dose limitations of 40 CFR Part 190 that have been incorporated into 10 CFR Part 20 by 46 FR 18525. The specification requires the preparation and submittal of a Special Report whenever the calculated doses from plant generated radioactive effluents and

FINAL DRAFT

RADIOACTIVE EFFLUENTS

BASES

---

TOTAL DOSE (Continued)

direct radiation exceed 25 mrems to the total body or any organ, except the thyroid, which shall be limited to less than or equal to 75 mrems. For sites containing up to four reactors, it is highly unlikely that the resultant dose to a MEMBER OF THE PUBLIC will exceed the dose limits of 40 CFR Part 190 if the individual reactors remain within twice the dose design objectives of Appendix I, and if direct radiation doses from the reactor units and outside storage tanks are kept small. The Special Report will describe a course of action that should result in the limitation of the annual dose to a MEMBER OF THE PUBLIC to within the 40 CFR Part 190 limits. For the purposes of the Special Report, it may be assumed that the dose commitment to the MEMBER OF THE PUBLIC from other uranium fuel cycle sources is negligible, with the exception that dose contributions from other nuclear fuel cycle facilities at the same site or within a radius of 8 km must be considered. If the dose to any MEMBER OF THE PUBLIC is estimated to exceed the requirements of 40 CFR Part 190, the Special Report with a request for a variance (provided the release conditions resulting in violation of 40 CFR Part 190 have not already been corrected), in accordance with the provisions of 40 CFR Part 190.11 and 10 CFR Part 20.405c, is considered to be a timely request and fulfills the requirements of 40 CFR Part 190 until NRC staff action is completed. The variance only relates to the limits of 40 CFR Part 190, and does not apply in any way to the other requirements for dose limitation of 10 CFR Part 20, as addressed in Specifications 3.11.1.1 and 3.11.2.1. An individual is not considered a MEMBER OF THE PUBLIC during any period in which he/she is engaged in carrying out any operation that is part of the nuclear fuel cycle.

3/4.12 RADIOLOGICAL ENVIRONMENTAL MONITORINGBASES

---

3/4.12.1 MONITORING PROGRAM

The radiological environmental monitoring program required by this specification provides representative measurements of radiation and of radioactive materials in those exposure pathways and for those radionuclides that lead to the highest potential radiation exposures of MEMBERS OF THE PUBLIC resulting from the station operation. This monitoring program implements Section IV.B.2 of Appendix I to 10 CFR Part 50 and thereby supplements the radiological effluent monitoring program by verifying that the measurable concentrations of radioactive materials and levels of radiation are not higher than expected on the basis of the effluent measurements and the modeling of the environmental exposure pathways. Guidance for this monitoring program is provided by the Radiological Assessment Branch Technical Position on Environmental Monitoring. The initially specified monitoring program will be effective for at least the first 3 years of commercial operation. Following this period, program changes may be initiated based on operational experience.

The required detection capabilities for environmental sample analyses are tabulated in terms of the lower limits of detection (LLDs). The LLDs required by Table 4.12-1 are considered optimum for routine environmental measurements in industrial laboratories. It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as an a posteriori (after the fact) limit for a particular measurement.

Detailed discussion of the LLD, and other detection limits, can be found in HASL Procedures Manual, HASL-300 (revised annually), Currie, L. A., "Limits for Qualitative Detection and Quantitative Determination - Application to Radiochemistry," Anal. Chem. 40, 586-93 (1968), and Hartwell, J. K., "Detection Limits for Radioanalytical Counting Techniques," Atlantic Richfield Hanford Company Report ARH-SA-215 (June 1975).

FINAL DRAFT

### 3/4.12 RADIOLOGICAL ENVIRONMENTAL MONITORING

#### BASES

---

#### 3/4.12.2 LAND USE CENSUS

This specification is provided to ensure that changes in the use of areas at and beyond the SITE BOUNDARY are identified and that modifications to the radiological environmental monitoring program are made if required by the results of this census. The best information from the door-to-door survey, from aerial survey or from consulting with local agricultural authorities shall be used. This census satisfies the requirements of Section IV.B.3 of Appendix I to 10 CFR Part 50. Restricting the census to gardens of greater than 50 m<sup>2</sup> provides assurance that significant exposure pathways via leafy vegetables will be identified and monitored since a garden of this size is the minimum required to produce the quantity (26 kg/year) of leafy vegetables assumed in Regulatory Guide 1.109 for consumption by a child. To determine this minimum garden size, the following assumptions were made: (1) 20% of the garden was used for growing broad leaf vegetation (i.e., similar to lettuce and cabbage), and (2) a vegetation yield of 2 kg/m<sup>2</sup>.

#### 3/4.12.3 INTERLABORATORY COMPARISON PROGRAM

The requirement for participation in an approved Interlaboratory Comparison Program is provided to ensure that independent checks on the precision and accuracy of the measurements of radioactive material in environmental sample matrices are performed as part of the quality assurance program for environmental monitoring in order to demonstrate that the results are valid for the purposes of Section IV.B.2 of Appendix I to 10 CFR Part 50.



## 5.0 DESIGN FEATURES

### 5.1 SITE

#### SITE AND EXCLUSION BOUNDARIES

5.1.1 The site and exclusion boundaries shall be as shown in Figure 5.1-1.

#### LOW POPULATION ZONE

5.1.2 The low population zone shall be as shown in Figure 5.1-2.

#### GASEOUS RELEASE POINTS

5.1.3 The gaseous release points shall be as shown in Figure 5.1-3.

### 5.2 CONTAINMENT

#### CONFIGURATION

5.2.1 The reactor containment building is a steel lined, prestressed concrete building of cylindrical shape, with a dome roof and having the following design features:


- a. Nominal inside diameter = 146 feet.
- b. Nominal inside height = 206.5 feet.
- c. Minimum thickness of concrete walls = 3 feet, 8 inches.
- d. Minimum thickness of concrete roof = 3 feet, 8 inches.
- e. Minimum thickness of concrete floor pad = 10.5 feet.
- f. Nominal thickness of steel liner = 0.25 inch.
- g. Nominal net free volume =  $2.6 \times 10^6$  cubic feet.

#### DESIGN PRESSURE AND TEMPERATURE

5.2.2 The reactor containment building is designed and shall be maintained for a maximum internal pressure of 60 psig and a temperature of 300°F.



FINAL DRAFT


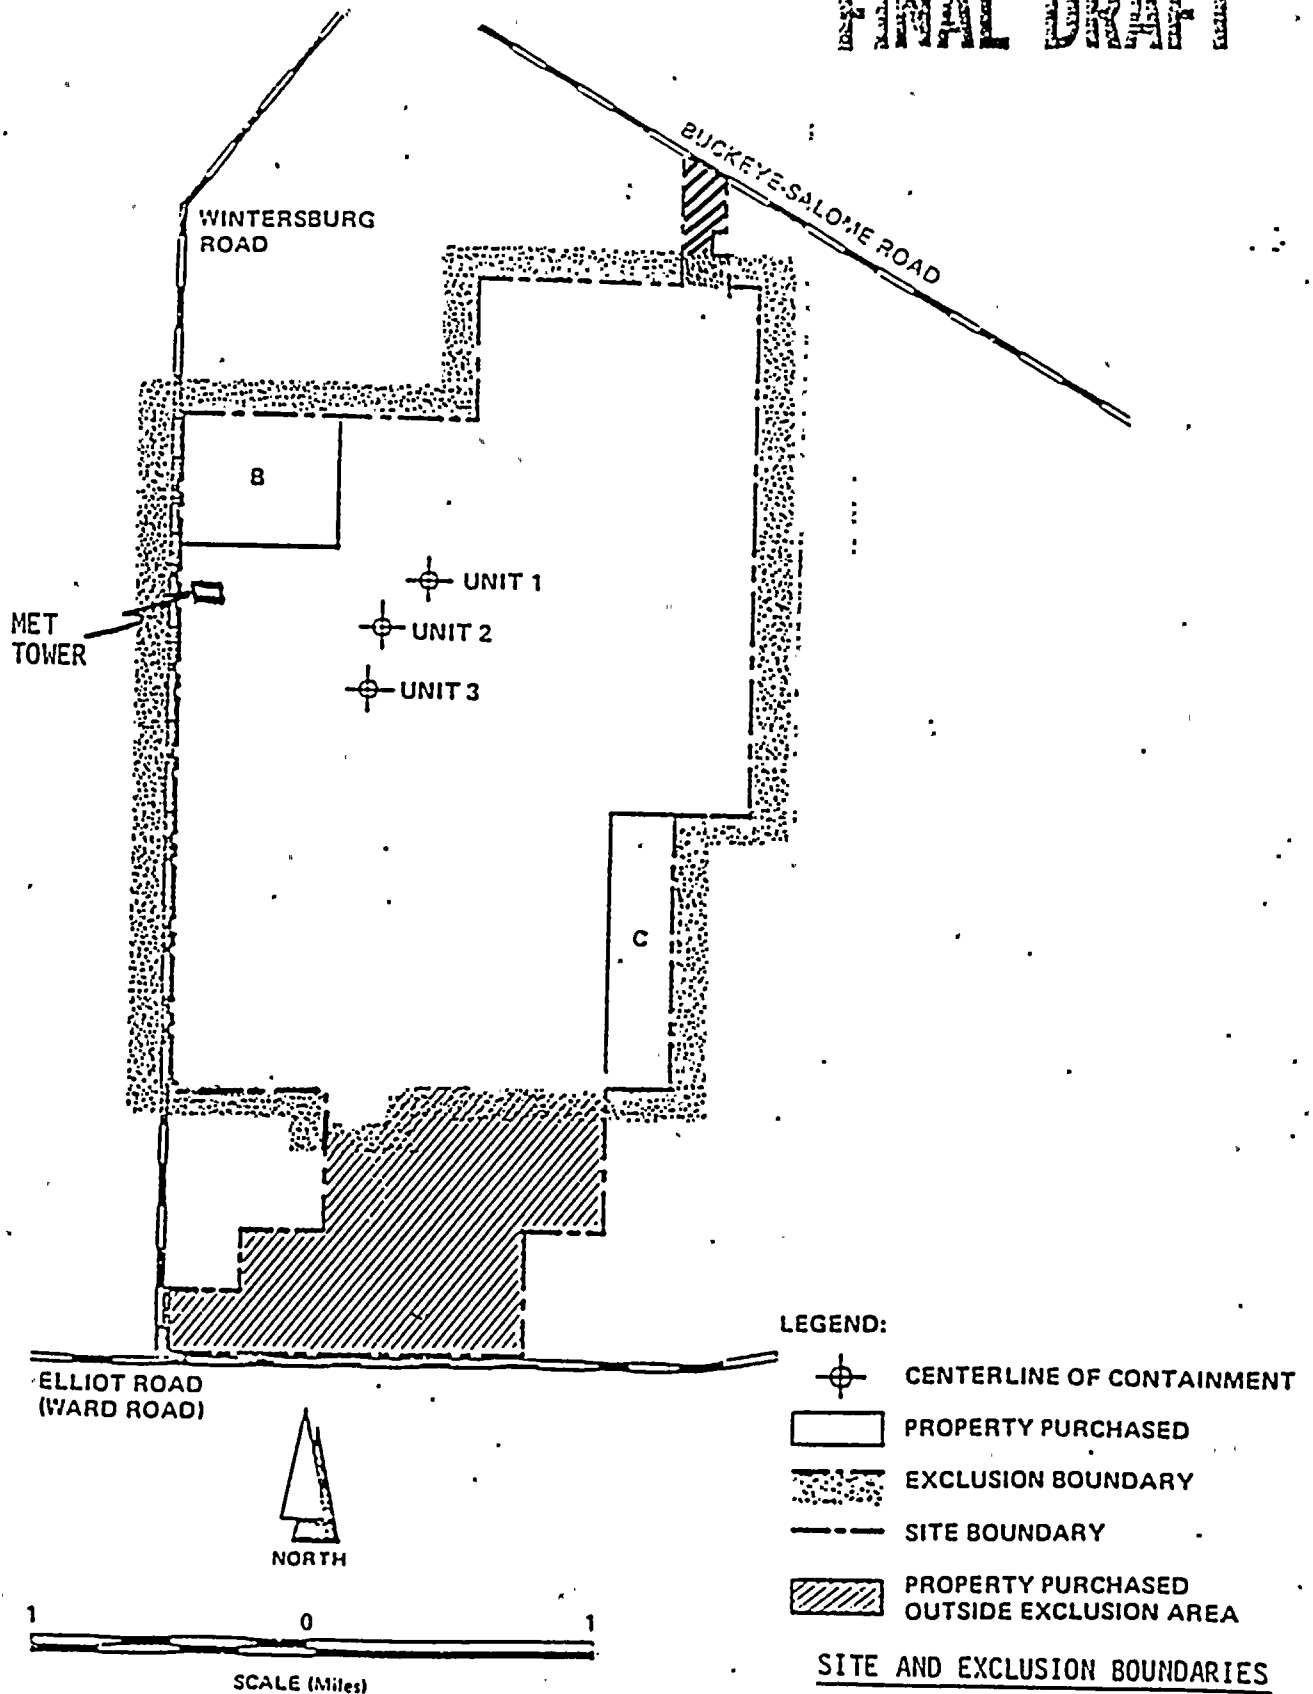


FINAL DRAFT

- LEGEND
- HARD SURFACE, HEAVY-DUTY ROAD
  - - - - - HARD SURFACE, MEDIUM-DUTY ROAD
  - - - - - UNIMPROVED LIGHT-DUTY ROAD
  - ..... UNIMPROVED DIRT ROAD
  - ..... TRAIL
  - ..... RAILROAD - SHIPPIE TRAIL
  - ..... RAILROAD - PASSENGER TRACK
  - ..... BRIDGE
  - ..... OVERPASS
  - ..... TUNNEL
  - ..... FERRY
  - ..... OVERPASS - UNDERPASS
  - ..... INDICATING PLACE OF EMPLOYMENT, ETC.




GRAPHIC SCALE IN MILES

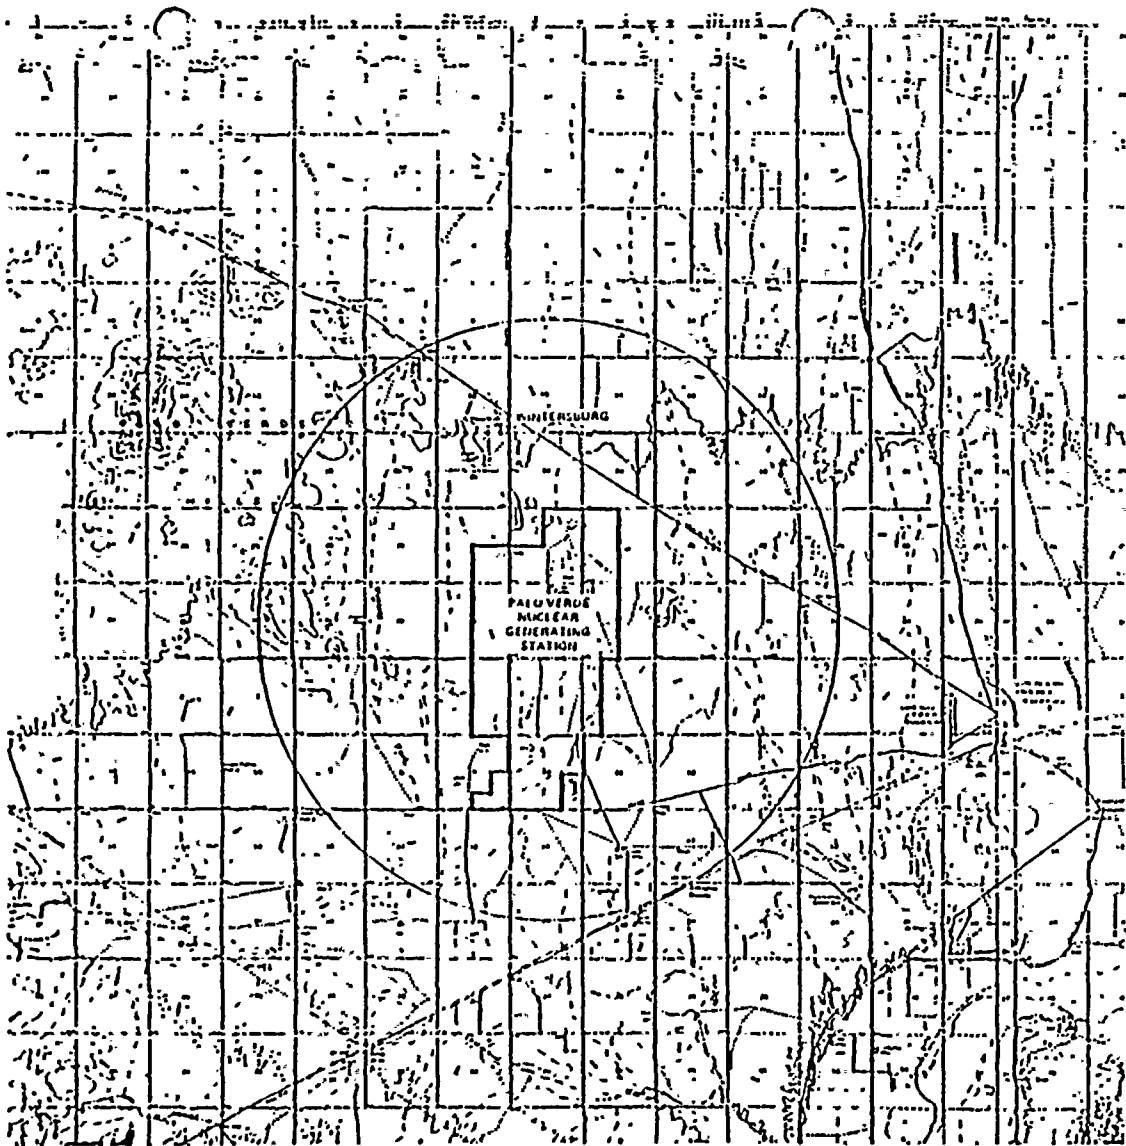

LOW POPULATION ZONE  
PALO VERDE NUCLEAR GENERATING STATION

FIGURE 5.1-2

Palo Verde Nuclear Generating Station  
 Unit 1  
 Typical Exhaust Points  
 5-4

 Palo Verde Nuclear Generating Station	TYPICAL EXHAUST POINTS
---	------------------------

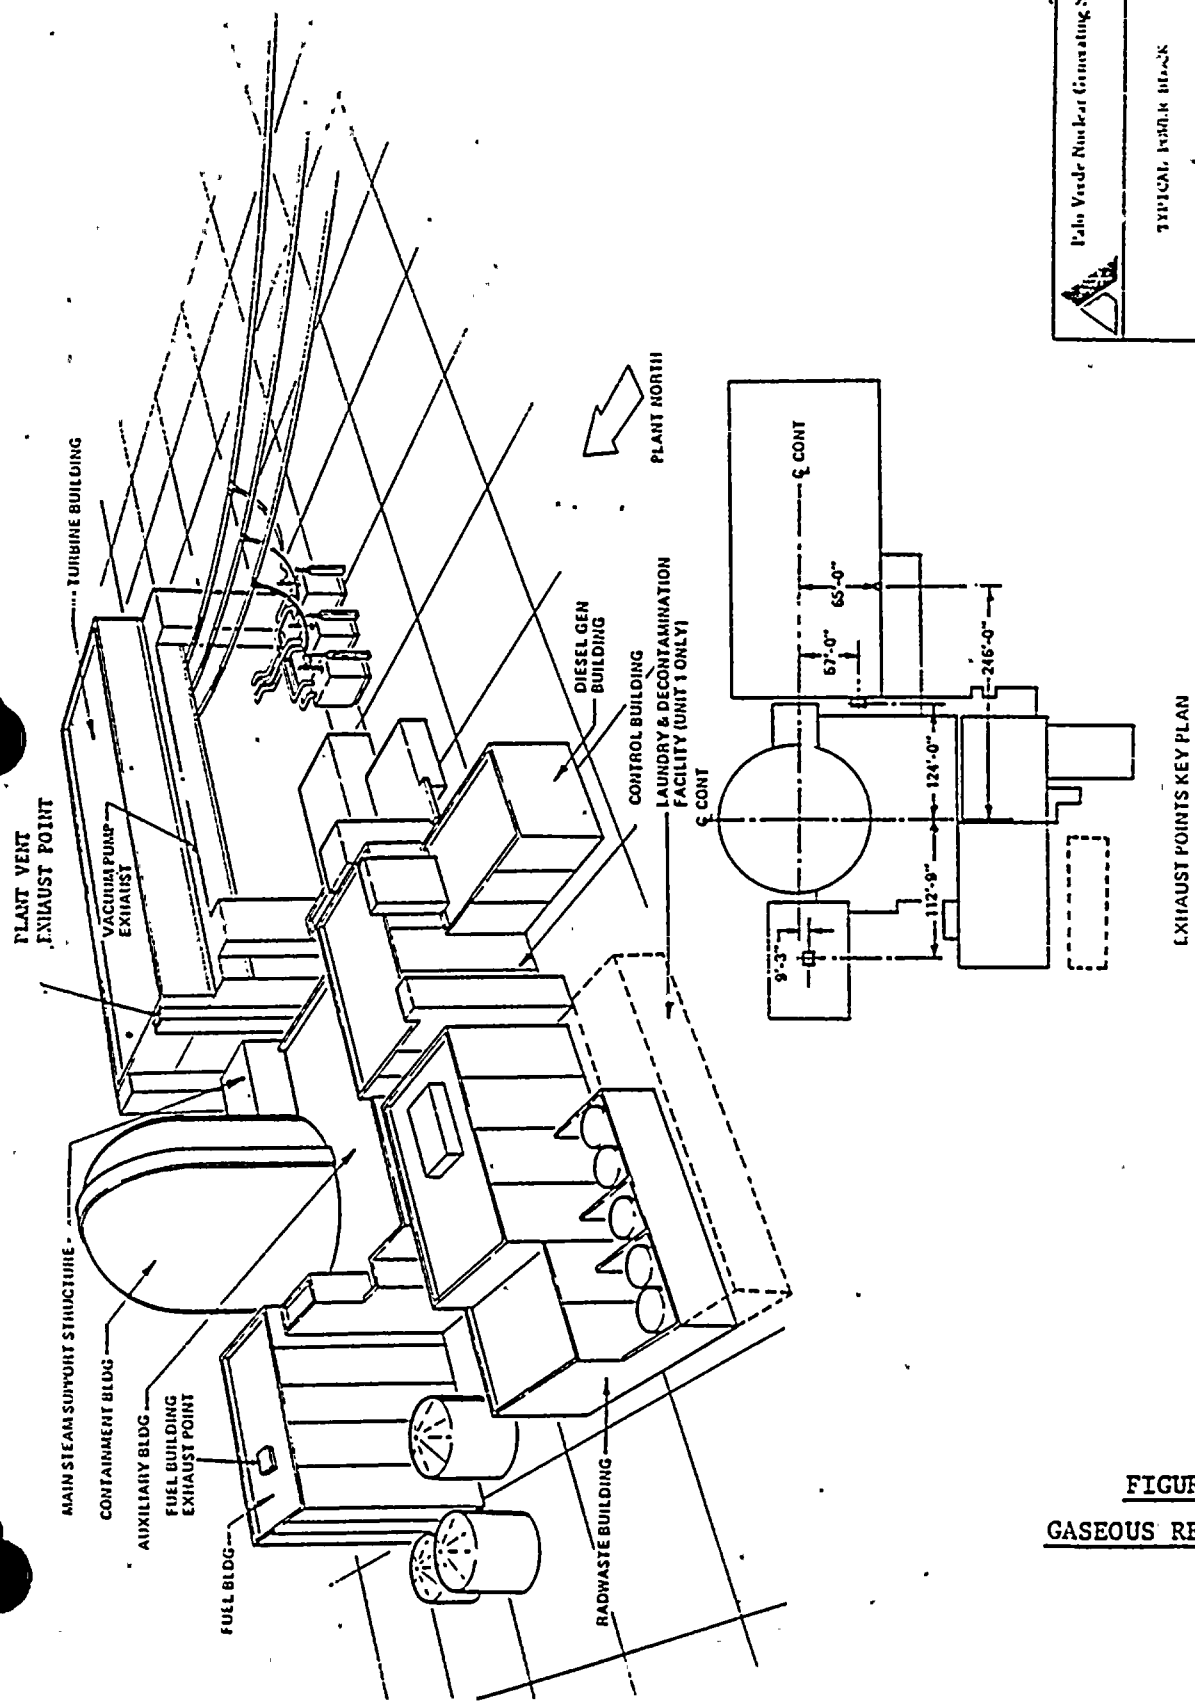


FIGURE 5.1-3  
 GASEOUS RELEASE POINTS



## DESIGN FEATURES

---

### 5.3 REACTOR CORE

#### FUEL ASSEMBLIES

5.3.1 The reactor core shall contain 241 fuel assemblies with each fuel assembly containing 236 fuel rods or burnable poison rods clad with Zircaloy-4. Each fuel rod shall have a nominal active fuel length of 150 inches and contain a maximum total weight of approximately 1950 grams uranium. Each burnable poison rod shall have a nominal active poison length of 136 inches. The initial core loading shall have a maximum enrichment of 3.35 weight percent U-235. Reload fuel shall be similar in physical design to the initial core loading and shall have a maximum enrichment of 4 weight percent U-235.

#### CONTROL ELEMENT ASSEMBLIES

5.3.2 The reactor core shall contain 76 full-length and 13 part-length control element assemblies.

### 5.4 REACTOR COOLANT SYSTEM

#### DESIGN PRESSURE AND TEMPERATURE

5.4.1 The Reactor Coolant System is designed and shall be maintained:

- a. In accordance with the code requirements specified in Section 5.2 of the FSAR with allowance for normal degradation pursuant of the applicable surveillance requirements,
- b. For a pressure of 2500 psia, and
- c. For a temperature of 650°F, except for the pressurizer which is 700°F.

#### VOLUME

5.4.2 The total water and steam volume of the Reactor Coolant System is 13,900 + 300/-0 cubic feet at a nominal  $T_{avg}$  of 593°F.

## DESIGN FEATURES

---

### 5.5 METEOROLOGICAL TOWER LOCATION

5.5.1 The meteorological tower shall be located as shown on Figure 5.1-1.

### 5.6 FUEL STORAGE

#### 5.6.1 CRITICALITY

5.6.1.1 The spent fuel storage racks are designed and shall be maintained with:

- a. A  $k_{eff}$  equivalent to less than or equal to 0.95 when flooded with unborated water, which includes a conservative allowance of 2.6%  $\Delta k/k$  for uncertainties as described in Section 9.1 of the FSAR.
- b. A nominal 9.5 inch center-to-center distance between fuel assemblies placed in the storage racks in a high density configuration.

5.6.1.2 The  $k_{eff}$  for new fuel for the first core loading stored dry in the spent fuel storage racks shall not exceed 0.98 when aqueous foam moderation is assumed.

#### DRAINAGE

5.6.2 The spent fuel storage pool is designed and shall be maintained to prevent inadvertent draining of the pool below elevation 137 feet - 6 inches.

#### CAPACITY

5.6.3 The spent fuel storage pool is designed and shall be maintained with a storage capacity limited to no more than 1329 fuel assemblies.

### 5.7 COMPONENT CYCLIC OR TRANSIENT LIMITS

5.7.1 The components identified in Table 5.7-1 are designed and shall be maintained within the cyclic or transient limits of Tables 5.7-1 and 5.7-2.



TABLE 5.7-1

COMPONENT CYCLIC OR TRANSIENT LIMITS

<u>COMPONENT</u>	<u>CYCLIC OR TRANSIENT LIMIT</u>	<u>DESIGN CYCLE OR TRANSIENT</u>
Reactor Coolant System	500 system heatup and cooldown cycles at rates $\leq 100^{\circ}\text{F/hr.}$	Heatup cycle - Temperature from $\leq 70^{\circ}\text{F}$ to $\geq 565^{\circ}\text{F}$ ; cooldown cycle - Temperature from $\geq 565^{\circ}\text{F}$ to $\leq 70^{\circ}\text{F}$ .
	500 pressurizer heatup and cooldown cycles at rates $\leq 200^{\circ}\text{F/hr.}$	Heatup cycle - Pressurizer temperature from $\leq 70^{\circ}\text{F}$ to $\geq 653^{\circ}\text{F}$ ; cooldown cycle - Pressurizer temperature from $\geq 653^{\circ}\text{F}$ to $\leq 70^{\circ}\text{F}$ .
	10 hydrostatic testing cycles.	RCS pressurized to 3125 psia with RCS temperature between $120^{\circ}\text{F}$ and $400^{\circ}\text{F}$ .
	480 reactor trip cycles, turbine trip cycles, and loss of reactor coolant flow.	Includes combinations of reactor trips due to operator errors, equipment malfunctions, and total loss of reactor .... coolant flow.
	200 seismic stress cycles.	Subjection to a seismic event equal to one-half the design basis earthquake (DBE).
	1 complete loss of secondary pressure cycle.	Loss of secondary pressure from either steam generator due to a complete double-ended break of a steam generator steam or feedwater nozzle.

FINAL DRAFT

### COMPONENT CYCLIC OR TRANSIENT LIMITS

<u>COMPONENT</u>	<u>CYCLIC OR TRANSIENT LIMIT</u>	<u>DESIGN CYCLE OR TRANSIENT</u>
	200 primary system leak test cycles	Leak test primary system at a pressure of 2250 psia at a temperature from 120°F to 400°F. <i>2a</i>
Pressurizer Spray Nozzle	Calculate usage factor per Table 5.7-2.	Main spray ( <del>less than four RCP</del> operating) with fluid $\Delta T_m > 200^\circ\text{F}$ . <i>ST</i>  Auxiliary spray with fluid $\Delta T_a > 200^\circ\text{F}$ .

$\Delta T_m$  = The difference in temperature between the pressurizer and main spray water as adjusted by the instrument correction factor.

$\Delta T_a$  = The difference in temperature between the pressurizer and Auxiliary spray water as adjusted by the instrument correction factor.

۱۰۰  
 ۱۰۱  
 ۱۰۲  
 ۱۰۳  
 ۱۰۴  
 ۱۰۵  
 ۱۰۶  
 ۱۰۷  
 ۱۰۸  
 ۱۰۹  
 ۱۱۰  
 ۱۱۱  
 ۱۱۲  
 ۱۱۳  
 ۱۱۴  
 ۱۱۵  
 ۱۱۶  
 ۱۱۷  
 ۱۱۸  
 ۱۱۹  
 ۱۲۰  
 ۱۲۱  
 ۱۲۲  
 ۱۲۳  
 ۱۲۴  
 ۱۲۵  
 ۱۲۶  
 ۱۲۷  
 ۱۲۸  
 ۱۲۹  
 ۱۳۰  
 ۱۳۱  
 ۱۳۲  
 ۱۳۳  
 ۱۳۴  
 ۱۳۵  
 ۱۳۶  
 ۱۳۷  
 ۱۳۸  
 ۱۳۹  
 ۱۴۰  
 ۱۴۱  
 ۱۴۲  
 ۱۴۳  
 ۱۴۴  
 ۱۴۵  
 ۱۴۶  
 ۱۴۷  
 ۱۴۸  
 ۱۴۹  
 ۱۵۰  
 ۱۵۱  
 ۱۵۲  
 ۱۵۳  
 ۱۵۴  
 ۱۵۵  
 ۱۵۶  
 ۱۵۷  
 ۱۵۸  
 ۱۵۹  
 ۱۶۰  
 ۱۶۱  
 ۱۶۲  
 ۱۶۳  
 ۱۶۴  
 ۱۶۵  
 ۱۶۶  
 ۱۶۷  
 ۱۶۸  
 ۱۶۹  
 ۱۷۰  
 ۱۷۱  
 ۱۷۲  
 ۱۷۳  
 ۱۷۴  
 ۱۷۵  
 ۱۷۶  
 ۱۷۷  
 ۱۷۸  
 ۱۷۹  
 ۱۸۰  
 ۱۸۱  
 ۱۸۲  
 ۱۸۳  
 ۱۸۴  
 ۱۸۵  
 ۱۸۶  
 ۱۸۷  
 ۱۸۸  
 ۱۸۹  
 ۱۹۰  
 ۱۹۱  
 ۱۹۲  
 ۱۹۳  
 ۱۹۴  
 ۱۹۵  
 ۱۹۶  
 ۱۹۷  
 ۱۹۸  
 ۱۹۹  
 ۲۰۰

۱۰۰  
 ۱۰۱  
 ۱۰۲  
 ۱۰۳  
 ۱۰۴  
 ۱۰۵  
 ۱۰۶  
 ۱۰۷  
 ۱۰۸  
 ۱۰۹  
 ۱۱۰  
 ۱۱۱  
 ۱۱۲  
 ۱۱۳  
 ۱۱۴  
 ۱۱۵  
 ۱۱۶  
 ۱۱۷  
 ۱۱۸  
 ۱۱۹  
 ۱۲۰  
 ۱۲۱  
 ۱۲۲  
 ۱۲۳  
 ۱۲۴  
 ۱۲۵  
 ۱۲۶  
 ۱۲۷  
 ۱۲۸  
 ۱۲۹  
 ۱۳۰  
 ۱۳۱  
 ۱۳۲  
 ۱۳۳  
 ۱۳۴  
 ۱۳۵  
 ۱۳۶  
 ۱۳۷  
 ۱۳۸  
 ۱۳۹  
 ۱۴۰  
 ۱۴۱  
 ۱۴۲  
 ۱۴۳  
 ۱۴۴  
 ۱۴۵  
 ۱۴۶  
 ۱۴۷  
 ۱۴۸  
 ۱۴۹  
 ۱۵۰  
 ۱۵۱  
 ۱۵۲  
 ۱۵۳  
 ۱۵۴  
 ۱۵۵  
 ۱۵۶  
 ۱۵۷  
 ۱۵۸  
 ۱۵۹  
 ۱۶۰  
 ۱۶۱  
 ۱۶۲  
 ۱۶۳  
 ۱۶۴  
 ۱۶۵  
 ۱۶۶  
 ۱۶۷  
 ۱۶۸  
 ۱۶۹  
 ۱۷۰  
 ۱۷۱  
 ۱۷۲  
 ۱۷۳  
 ۱۷۴  
 ۱۷۵  
 ۱۷۶  
 ۱۷۷  
 ۱۷۸  
 ۱۷۹  
 ۱۸۰  
 ۱۸۱  
 ۱۸۲  
 ۱۸۳  
 ۱۸۴  
 ۱۸۵  
 ۱۸۶  
 ۱۸۷  
 ۱۸۸  
 ۱۸۹  
 ۱۹۰  
 ۱۹۱  
 ۱۹۲  
 ۱۹۳  
 ۱۹۴  
 ۱۹۵  
 ۱۹۶  
 ۱۹۷  
 ۱۹۸  
 ۱۹۹  
 ۲۰۰  
 ۲۰۱  
 ۲۰۲  
 ۲۰۳  
 ۲۰۴  
 ۲۰۵  
 ۲۰۶  
 ۲۰۷  
 ۲۰۸  
 ۲۰۹  
 ۲۱۰  
 ۲۱۱  
 ۲۱۲  
 ۲۱۳  
 ۲۱۴  
 ۲۱۵  
 ۲۱۶  
 ۲۱۷  
 ۲۱۸  
 ۲۱۹  
 ۲۲۰  
 ۲۲۱  
 ۲۲۲  
 ۲۲۳  
 ۲۲۴  
 ۲۲۵  
 ۲۲۶  
 ۲۲۷  
 ۲۲۸  
 ۲۲۹  
 ۲۳۰  
 ۲۳۱  
 ۲۳۲  
 ۲۳۳  
 ۲۳۴  
 ۲۳۵  
 ۲۳۶  
 ۲۳۷  
 ۲۳۸  
 ۲۳۹  
 ۲۴۰  
 ۲۴۱  
 ۲۴۲  
 ۲۴۳  
 ۲۴۴  
 ۲۴۵  
 ۲۴۶  
 ۲۴۷  
 ۲۴۸  
 ۲۴۹  
 ۲۵۰  
 ۲۵۱  
 ۲۵۲  
 ۲۵۳  
 ۲۵۴  
 ۲۵۵  
 ۲۵۶  
 ۲۵۷  
 ۲۵۸  
 ۲۵۹  
 ۲۶۰  
 ۲۶۱  
 ۲۶۲  
 ۲۶۳  
 ۲۶۴  
 ۲۶۵  
 ۲۶۶  
 ۲۶۷  
 ۲۶۸  
 ۲۶۹  
 ۲۷۰  
 ۲۷۱  
 ۲۷۲  
 ۲۷۳  
 ۲۷۴  
 ۲۷۵  
 ۲۷۶  
 ۲۷۷  
 ۲۷۸  
 ۲۷۹  
 ۲۸۰  
 ۲۸۱  
 ۲۸۲  
 ۲۸۳  
 ۲۸۴  
 ۲۸۵  
 ۲۸۶  
 ۲۸۷  
 ۲۸۸  
 ۲۸۹  
 ۲۹۰  
 ۲۹۱  
 ۲۹۲  
 ۲۹۳  
 ۲۹۴  
 ۲۹۵  
 ۲۹۶  
 ۲۹۷  
 ۲۹۸  
 ۲۹۹  
 ۳۰۰  
 ۳۰۱  
 ۳۰۲  
 ۳۰۳  
 ۳۰۴  
 ۳۰۵  
 ۳۰۶  
 ۳۰۷  
 ۳۰۸  
 ۳۰۹  
 ۳۱۰  
 ۳۱۱  
 ۳۱۲  
 ۳۱۳  
 ۳۱۴  
 ۳۱۵  
 ۳۱۶  
 ۳۱۷  
 ۳۱۸  
 ۳۱۹  
 ۳۲۰  
 ۳۲۱  
 ۳۲۲  
 ۳۲۳  
 ۳۲۴  
 ۳۲۵  
 ۳۲۶  
 ۳۲۷  
 ۳۲۸  
 ۳۲۹  
 ۳۳۰  
 ۳۳۱  
 ۳۳۲  
 ۳۳۳  
 ۳۳۴  
 ۳۳۵  
 ۳۳۶  
 ۳۳۷  
 ۳۳۸  
 ۳۳۹  
 ۳۴۰  
 ۳۴۱  
 ۳۴۲  
 ۳۴۳  
 ۳۴۴  
 ۳۴۵  
 ۳۴۶  
 ۳۴۷  
 ۳۴۸  
 ۳۴۹  
 ۳۵۰  
 ۳۵۱  
 ۳۵۲  
 ۳۵۳  
 ۳۵۴  
 ۳۵۵  
 ۳۵۶  
 ۳۵۷  
 ۳۵۸  
 ۳۵۹  
 ۳۶۰  
 ۳۶۱  
 ۳۶۲  
 ۳۶۳  
 ۳۶۴  
 ۳۶۵  
 ۳۶۶  
 ۳۶۷  
 ۳۶۸  
 ۳۶۹  
 ۳۷۰  
 ۳۷۱  
 ۳۷۲  
 ۳۷۳  
 ۳۷۴  
 ۳۷۵  
 ۳۷۶  
 ۳۷۷  
 ۳۷۸  
 ۳۷۹  
 ۳۸۰  
 ۳۸۱  
 ۳۸۲  
 ۳۸۳  
 ۳۸۴  
 ۳۸۵  
 ۳۸۶  
 ۳۸۷  
 ۳۸۸  
 ۳۸۹  
 ۳۹۰  
 ۳۹۱  
 ۳۹۲  
 ۳۹۳  
 ۳۹۴  
 ۳۹۵  
 ۳۹۶  
 ۳۹۷  
 ۳۹۸  
 ۳۹۹  
 ۴۰۰  
 ۴۰۱  
 ۴۰۲  
 ۴۰۳  
 ۴۰۴  
 ۴۰۵  
 ۴۰۶  
 ۴۰۷  
 ۴۰۸  
 ۴۰۹  
 ۴۱۰  
 ۴۱۱  
 ۴۱۲  
 ۴۱۳  
 ۴۱۴  
 ۴۱۵  
 ۴۱۶  
 ۴۱۷  
 ۴۱۸  
 ۴۱۹  
 ۴۲۰  
 ۴۲۱  
 ۴۲۲  
 ۴۲۳  
 ۴۲۴  
 ۴۲۵  
 ۴۲۶  
 ۴۲۷  
 ۴۲۸  
 ۴۲۹  
 ۴۳۰  
 ۴۳۱  
 ۴۳۲  
 ۴۳۳  
 ۴۳۴  
 ۴۳۵  
 ۴۳۶  
 ۴۳۷  
 ۴۳۸  
 ۴۳۹  
 ۴۴۰  
 ۴۴۱  
 ۴۴۲  
 ۴۴۳  
 ۴۴۴  
 ۴۴۵  
 ۴۴۶  
 ۴۴۷  
 ۴۴۸  
 ۴۴۹  
 ۴۵۰  
 ۴۵۱  
 ۴۵۲  
 ۴۵۳  
 ۴۵۴  
 ۴۵۵  
 ۴۵۶  
 ۴۵۷  
 ۴۵۸  
 ۴۵۹  
 ۴۶۰  
 ۴۶۱  
 ۴۶۲  
 ۴۶۳  
 ۴۶۴  
 ۴۶۵  
 ۴۶۶  
 ۴۶۷  
 ۴۶۸  
 ۴۶۹  
 ۴۷۰  
 ۴۷۱

TABLE 5.7-2

PRESSURIZER SPRAY NOZZLE USAGE FACTOR

Main Spray				Auxiliary Spray			
$\Delta T_m$	$N_A$	$N$	$N/N_A$	$\Delta T_a$	$N_A$	$N$	$N/N_A$
201-250	7900			201-250	50000		
251-300	4500			251-300	2200		
301-350	2900			301-350	1300		
351-400	1900			351-400	850		
401-450	1200			401-450	550		
451-500	850			451-500	375		
501-550	555			501-550	225		
				551-600	150		
$\Sigma N/N_A =$ _____				$\Sigma N/N_A =$ _____			

## Cumulative Usage Factor

 $\Sigma N/N_A$  (Main Spray) \_\_\_\_\_

 $\Sigma N/N_A$  (Aux. Spray) \_\_\_\_\_

Total \_\_\_\_\_ = Cumulative Usage Factor

1  
2  
3  
4  
5  
6  
7  
8  
9  
10  
11  
12  
13  
14  
15  
16  
17  
18  
19  
20  
21  
22  
23  
24  
25  
26  
27  
28  
29  
30  
31  
32  
33  
34  
35  
36  
37  
38  
39  
40  
41  
42  
43  
44  
45  
46  
47  
48  
49  
50  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65  
66  
67  
68  
69  
70  
71  
72  
73  
74  
75  
76  
77  
78  
79  
80  
81  
82  
83  
84  
85  
86  
87  
88  
89  
90  
91  
92  
93  
94  
95  
96  
97  
98  
99  
100  
101  
102  
103  
104  
105  
106  
107  
108  
109  
110  
111  
112  
113  
114  
115  
116  
117  
118  
119  
120  
121  
122  
123  
124  
125  
126  
127  
128  
129  
130  
131  
132  
133  
134  
135  
136  
137  
138  
139  
140  
141  
142  
143  
144  
145  
146  
147  
148  
149  
150  
151  
152  
153  
154  
155  
156  
157  
158  
159  
160  
161  
162  
163  
164  
165  
166  
167  
168  
169  
170  
171  
172  
173  
174  
175  
176  
177  
178  
179  
180  
181  
182  
183  
184  
185  
186  
187  
188  
189  
190  
191  
192  
193  
194  
195  
196  
197  
198  
199  
200  
201  
202  
203  
204  
205  
206  
207  
208  
209  
210  
211  
212  
213  
214  
215  
216  
217  
218  
219  
220  
221  
222  
223  
224  
225  
226  
227  
228  
229  
230  
231  
232  
233  
234  
235  
236  
237  
238  
239  
240  
241  
242  
243  
244  
245  
246  
247  
248  
249  
250  
251  
252  
253  
254  
255  
256  
257  
258  
259  
260  
261  
262  
263  
264  
265  
266  
267  
268  
269  
270  
271  
272  
273  
274  
275  
276  
277  
278  
279  
280  
281  
282  
283  
284  
285  
286  
287  
288  
289  
290  
291  
292  
293  
294  
295  
296  
297  
298  
299  
300  
301  
302  
303  
304  
305  
306  
307  
308  
309  
310  
311  
312  
313  
314  
315  
316  
317  
318  
319  
320  
321  
322  
323  
324  
325  
326  
327  
328  
329  
330  
331  
332  
333  
334  
335  
336  
337  
338  
339  
340  
341  
342  
343  
344  
345  
346  
347  
348  
349  
350  
351  
352  
353  
354  
355  
356  
357  
358  
359  
360  
361  
362  
363  
364  
365  
366  
367  
368  
369  
370  
371  
372  
373  
374  
375  
376  
377  
378  
379  
380  
381  
382  
383  
384  
385  
386  
387  
388  
389  
390  
391  
392  
393  
394  
395  
396  
397  
398  
399  
400  
401  
402  
403  
404  
405  
406  
407  
408  
409  
410  
411  
412  
413  
414  
415  
416  
417  
418  
419  
420  
421  
422  
423  
424  
425  
426  
427  
428  
429  
430  
431  
432  
433  
434  
435  
436  
437  
438  
439  
440  
441  
442  
443  
444  
445  
446  
447  
448  
449  
450  
451  
452  
453  
454  
455  
456  
457  
458  
459  
460  
461  
462  
463  
464  
465  
466  
467  
468  
469  
470  
471  
472  
473  
474  
475  
476  
477  
478  
479  
480  
481  
482  
483  
484  
485  
486  
487  
488  
489  
490  
491  
492  
493  
494  
495  
496  
497  
498  
499  
500  
501  
502  
503  
504  
505  
506  
507  
508  
509  
510  
511  
512  
513  
514  
515  
516  
517  
518  
519  
520  
521  
522  
523  
524  
525  
526  
527  
528  
529  
530  
531  
532  
533  
534  
535  
536  
537  
538  
539  
540  
541  
542  
543  
544  
545  
546  
547  
548  
549  
550  
551  
552  
553  
554  
555  
556  
557  
558  
559  
560  
561  
562  
563  
564  
565  
566  
567  
568  
569  
570  
571  
572  
573  
574  
575  
576  
577  
578  
579  
580  
581  
582  
583  
584  
585  
586  
587  
588  
589  
590  
591  
592  
593  
594  
595  
596  
597  
598  
599  
600  
601  
602  
603  
604  
605  
606  
607  
608  
609  
610  
611  
612  
613  
614  
615  
616  
617  
618  
619  
620  
621  
622  
623  
624  
625  
626  
627  
628  
629  
630  
631  
632  
633  
634  
635  
636  
637  
638  
639  
640  
641  
642  
643  
644  
645  
646  
647  
648  
649  
650  
651  
652  
653  
654  
655  
656  
657  
658  
659  
660  
661  
662  
663  
664  
665  
666  
667  
668  
669  
670  
671  
672  
673  
674  
675  
676  
677  
678  
679  
680  
681  
682  
683  
684  
685  
686  
687  
688  
689  
690  
691  
692  
693  
694  
695  
696  
697  
698  
699  
700  
701  
702  
703  
704  
705  
706  
707  
708  
709  
710  
711  
712  
713  
714  
715  
716  
717  
718  
719  
720  
721  
722  
723  
724  
725  
726  
727  
728  
729  
730  
731  
732  
733  
734  
735  
736  
737  
738  
739  
740  
741  
742  
743  
744  
745  
746  
747  
748  
749  
750  
751  
752  
753  
754  
755  
756  
757  
758  
759  
760  
761  
762  
763  
764  
765  
766  
767  
768  
769  
770  
771  
772  
773  
774  
775  
776  
777  
778  
779  
780  
781  
782  
783  
784  
785  
786  
787  
788  
789  
790  
791  
792  
793  
794  
795  
796  
797  
798  
799  
800  
801  
802  
803  
804  
805  
806  
807  
808  
809  
810  
811  
812  
813  
814  
815  
816  
817  
818  
819  
820  
821  
822  
823  
824  
825  
826  
827  
828  
829  
830  
831  
832  
833  
834  
835  
836  
837  
838  
839  
840  
841  
842  
843  
844  
845  
846  
847  
848  
849  
850  
851  
852  
853  
854  
855  
856  
857  
858  
859  
860  
861  
862  
863  
864  
865  
866  
867  
868  
869  
870  
871  
872  
873  
874  
875  
876  
877  
878  
879  
880  
881  
882  
883  
884  
885  
886  
887  
888  
889  
890  
891  
892  
893  
894  
895  
896  
897  
898  
899  
900  
901  
902  
903  
904  
905  
906  
907  
908  
909  
910  
911  
912  
913  
914  
915  
916  
917  
918  
919  
920  
921  
922  
923  
924  
925  
926  
927  
928  
929  
930  
931  
932  
933  
934  
935  
936  
937  
938  
939  
940  
941  
942  
943  
944  
945  
946  
947  
948  
949  
950  
951  
952  
953  
954  
955  
956  
957  
958  
959  
960  
961  
962  
963  
964  
965  
966  
967  
968  
969  
970  
971  
972  
973  
974  
975  
976  
977  
978  
979  
980  
981  
982  
983  
984  
985  
986  
987  
988  
989  
990  
991  
992  
993  
994  
995  
996  
997  
998  
999  
1000  
1001  
1002  
1003  
1004  
1005  
1006  
1007  
1008  
1009  
1010  
1011  
1012  
1013  
1014  
1015  
1016  
1017  
1018  
1019  
1020  
1021  
1022  
1023  
1024  
1025  
1026  
1027  
1028  
1029  
1030  
1031  
1032  
1033  
1034  
1035  
1036  
1037  
1038  
1039  
1040  
1041  
1042  
1043  
1044  
1045  
1046  
1047  
1048  
1049  
1050  
1051  
1052  
1053  
1054  
1055  
1056  
1057  
1058  
1059  
1060  
1061  
1062  
1063  
1064  
1065  
1066  
1067  
1068  
1069  
1070  
1071  
1072  
1073  
1074  
1075  
1076  
1077  
1078  
1079  
1080  
1081  
1082  
1083  
1084  
1085  
1086  
1087  
1088  
1089  
1090  
1091  
1092  
1093  
1094  
1095  
1096  
1097  
1098  
1099  
1100  
1101  
1102  
1103  
1104  
1105  
1106  
1107  
1108  
1109  
1110  
1111  
1112  
1113  
1114  
1115  
1116  
1117  
1118  
1119  
1120  
1121  
1122  
1123  
1124  
1125  
1126  
1127  
1128  
1129  
1130  
1131  
1132  
1133  
1134  
1135  
1136  
1137  
1138  
1139  
1140  
1141  
1142  
1143  
1144  
1145  
1146  
1147  
1148  
1149  
1150  
1151  
1152  
1153  
1154  
1155  
1156  
1157  
1158  
1159  
1160  
1161  
1162  
1163  
1164  
1165  
1166  
1167  
1168  
1169  
1170  
1171  
1172  
1173  
1174  
1175  
1176  
1177  
1178  
1179  
1180  
1181  
1182  
1183  
1184  
1185  
1186  
1187  
1188  
1189  
1190  
1191  
1192  
1193  
1194  
1195  
1196  
1197  
1198  
1199  
1200  
1201  
1202  
1203  
1204  
1205  
1206  
1207  
1208  
1209  
1210  
1211  
1212  
1213  
1214  
1215  
1216  
1217  
1218  
1219  
1220  
1221  
1222  
1223  
1224  
1225  
1226  
1227  
1228  
1229  
1230  
1231  
1232  
1233  
1234  
1235  
1236  
1237  
1238  
1239  
1240  
1241  
1242  
1243  
1244  
1245  
1246  
1247  
1248  
1249  
1250  
1251  
1252  
1253  
1254  
1255  
1256  
1257  
1258  
1259  
1260  
1261  
1262  
1263  
1264  
1265  
1266  
1267  
1268  
1269  
1270  
1271  
1272  
1273  
1274  
1275  
1276  
1277  
1278  
1279  
1280  
1281  
1282  
1283  
1284  
1285  
1286  
1287  
1288  
1289  
1290  
1291  
1292  
1293  
1294  
1295  
1296  
1297  
1298  
1299  
1300  
1301  
1302  
1303  
1304  
1305  
1306  
1307  
1308  
1309  
1310  
1311  
1312  
1313  
1314  
1315  
1316  
1317  
1318  
1319  
1320  
1321  
1322  
1323  
1324  
1325  
1326  
1327  
1328  
1329  
1330  
1331  
1332  
1333  
1334  
1335  
1336  
1337  
1338  
1339  
1340  
1341  
1342  
1343  
1344  
1345  
1346  
1347  
1348  
1349  
1350  
1351  
1352  
1353  
1354  
1355  
1356  
1357  
1358  
1359  
1360  
1361  
1362  
1363  
1364  
1365  
1366  
1367  
1368  
1369  
1370  
1371  
1372  
1373  
1374  
1375  
1376  
1377  
1378  
1379  
1380  
1381  
1382  
1383  
1384  
1385  
1386  
1387  
1388  
1389  
1390  
1391  
1392  
1393  
1394  
1395  
1396  
1397  
1398  
1399  
1400  
1401  
1402  
1403  
1404  
1405  
1406  
1407  
1408  
1409  
1410  
1411  
1412  
1413  
1414  
1415  
1416  
1417  
1418  
1419  
1420  
1421  
1422  
1423  
1424  
1425  
1426  
1427  
1428  
1429  
1430  
1431  
1432  
1433  
1434  
1435  
1436  
1437  
1438  
1439  
1440  
1441  
1442  
1443  
1444  
1445  
1446  
1447  
1448  
1449  
1450  
1451  
1452  
1453  
1454  
1455  
1456  
1457  
1458  
1459  
1460  
1461  
1462  
1463  
1464  
1465  
1466  
1467  
1468  
1469  
1470  
1471  
1472  
1473  
1474  
1475  
1476  
1477  
1478  
1479  
1480  
1481  
1482  
1483  
1484  
1485  
1486  
1487  
1488  
1489  
1490  
1491  
1492  
1493  
1494  
1495  
1496  
1497  
1498  
1499  
1500  
1501  
1502  
1503  
1504  
1505  
1506  
1507  
1508  
1509  
1510  
1511  
1512  
1513  
1514  
1515  
1516  
1517  
1518  
1519  
1520  
1521  
1522  
1523  
1524  
1525  
1526  
1527  
1528  
1529  
1530  
1531  
1532  
1533  
1534  
1535  
1536  
1537  
1538  
1539  
1540  
1541  
1542  
1543  
1544  
1545  
1546  
1547  
1548  
1549  
1550  
1551  
1552  
1553  
1554  
1555  
1556  
1557  
1558  
1559  
1560  
1561  
1562  
1563  
1564  
1565  
1566  
1567  
1568  
1569  
1570  
1571  
1572  
1573  
1574  
1575  
1576  
1577  
1578  
1579  
1580  
1581  
1582  
1583  
1584  
1585  
1586  
1587  
1588  
1589  
1590  
1591  
1592  
1593  
1594  
1595  
1596  
1597  
1598  
1599  
1600  
1601  
1602  
1603  
1604  
1605  
1606  
1607  
1608  
1609  
1610  
1611  
1612  
1613  
1614  
1615  
1616  
1617  
1618  
1619  
1620  
1621  
1622  
1623  
1624  
1625  
1626  
1627  
1628  
1629  
1630  
1631  
1632  
1633  
1634  
1635  
1636  
1637  
1638  
1639  
1640  
1641  
1642  
1643  
1644  
1645  
1646  
1647  
1648  
1649  
1650  
1651  
1652  
1653  
1654  
1655  
1656  
1657  
1658  
1659  
1660  
1661  
1662  
1663  
1664  
1665  
1666  
1667  
1668  
1669  
1670  
1671  
1672  
1673  
1674  
1675  
1676  
1677  
1678  
1679  
1680  
1681  
1682  
1683  
1684  
1685  
1686  
1687  
1688  
1689  
1690  
1691  
1692  
1693  
1694  
1695  
1696  
1697  
1698  
1699  
1700  
1701  
1702  
1703  
1704  
1705  
1706  
1707  
1708  
1709  
1710  
1711  
1712  
1713  
1714  
1715  
1716  
1717  
1718  
1719  
1720  
1721  
1722  
1723  
1724  
1725  
1726  
1727  
1728  
1729  
1730  
1731  
1732  
1733  
1734  
1735  
1736  
1737  
1738  
1739  
1740  
1741  
1742  
1743  
1744  
1745  
1746  
1747  
1748  
1749  
1750  
1751  
1752  
1753  
1754  
1755  
1756  
1757  
1758  
1759  
1760  
1761  
1762  
1763  
1764  
1765  
1766  
1767  
1768  
1769  
1770  
1771  
1772  
1773  
1774  
1775  
1776  
1777  
1778  
1779  
1780  
1781  
1782  
1783  
1784  
1785  
1786  
1787  
1788  
1789  
1790  
1791  
1792  
1793  
1794  
1795  
1796  
1797  
1798  
1799  
1800  
1801  
1802  
1803  
1804  
1805  
1806  
1807  
1808  
1809  
1810  
1811  
1812  
1813  
1814  
1815  
1816  
1817  
1818  
1819  
1820  
1821  
1822  
1823  
1824  
1825  
1826  
1827  
1828  
1829  
1830  
1831  
1832  
1833  
1834  
1835  
1836  
1837  
1838  
1839  
1840  
1841  
1842  
1843  
1844  
1845  
1846  
1847  
1848  
1849  
1850  
1851  
1852  
1853  
1854  
1855  
1856  
1857  
1858  
1859  
1860  
1861  
1862  
1863  
1864  
1865  
1866  
1867  
1868  
1869  
1870  
1871  
1872  
1873  
1874  
1875  
1876  
1877  
1878  
1879  
1880  
1881  
1882  
1883  
1884  
1885  
1886  
1887  
1888  
1889  
1890  
1891  
1892  
1893  
1894  
1895  
1896  
1897  
1898  
1899  
1900  
1901  
1902  
1903  
1904  
1905  
1906  
1907  
1908  
1909  
1910  
1911  
1912  
1913  
1914  
1915  
1916  
1917  
1918  
1919  
1920  
1921  
1922  
1923  
1924  
1925  
1926  
1927  
1928  
1929  
1930  
1931  
1932  
1933  
1934  
1935  
1936  
1937  
1938  
1939  
1940  
1941  
1942  
1943  
1944  
1945  
1946  
1947  
1948  
1949  
1950  
1951  
1952  
1953  
1954  
1955  
1956  
1957  
1958  
1959  
1960  
1961  
1962  
1963  
1964  
1965  
1966  
1967  
1968  
1969  
1970  
1971  
1972  
1973  
1974  
1975  
1976  
1977  
1978  
1979  
1980  
1981  
1982  
1983  
1984  
1985  
1986  
1987  
1988  
1989  
1990  
1991  
1992  
1993  
1994  
1995  
1996  
1997  
1998  
1999  
2000  
2001  
2002  
2003  
2004  
2005  
2006  
2007  
2008  
2009  
2010  
2011  
2012  
2013  
2014  
2015  
2016  
2017  
2018  
2019  
2020  
2021  
2022  
2023  
2024  
2025  
2026  
2027  
2028  
2029  
2030  
2031  
2032  
2033  
2034  
2035  
2036  
2037  
2038  
2039  
2040  
2041  
2042  
2043  
2044  
2045  
2046  
2047  
2048  
2049  
2050  
2051  
2052  
2053

TABLE 5.7-2 (Continued)

Where:

$$\Delta T_a = (T_{101} - T_{229}) + 60$$

$$\Delta T_m = (T_{101} - T_{103* \text{ or } 104*}) + 70$$

NA = Allowable number of spray cycles

N = Number of cycles in  $\Delta T$  range indicated

Calculational Method:

1. The spray cycle is defined as any initiation and termination of main or auxiliary spray flow throughout the pressurizer spray nozzle.
2. If the difference between pressurizer water temperature and the spray water temperature exceeds 200°F each spray cycle and the corresponding temperature difference is logged.
3. The spray nozzle usage factor shall be calculated as follows:
  - A. Fill in Column "N" above.
  - B. Calculate " $N/N_A$ " (Divide N by  $N_A$ ).
  - C. Add Column " $N/N_A$ " to find  $\Sigma N/N_A$ .

$\Sigma N/N_A$  is the cumulative spray nozzle usage factor. If the cumulative usage factor is equal to or less than 0.65 no further action is required.
4. If the cumulative usage factor exceeds 0.65, subsequent pressurizer spray operation shall continue to be monitored and an engineering evaluation of nozzle fatigue shall be performed within 90 days. The evaluation shall determine that the nozzle remains acceptable for additional service beyond the 90 day period or subsequent spray operation shall be restricted so that the difference between the pressurizer water temperature and the spray water temperature shall be limited to less than or equal to 200°F when spray is operated.

\*Use lower of two temperatures.

FINAL DRAFT

## ADMINISTRATIVE CONTROLS

### 6.1 RESPONSIBILITY

#### PVNGS PLANT MANAGER

6.1.1 The ~~Director of Nuclear Operations~~ shall be responsible for overall unit operation and shall delegate in writing the succession to this responsibility during his absence.

6.1.2 The Shift Supervisor, or during his absence from the Control Room, a designated SRO, shall be responsible for the Control Room command function. A management directive to this effect, signed by the Vice President-Nuclear Production shall be reissued to all station personnel on an annual basis.

### 6.2 ORGANIZATION

#### OFFSITE

6.2.1 The offsite organization for unit management and technical support shall be as shown in Figure 6.2-1.

#### UNIT STAFF

6.2.2.1 The unit organization shall be as shown in Figure 6.2-2 and:

- a. Each on-duty shift shall be composed of at least the minimum shift crew composition shown in Table 6.2-1.
- b. At least one licensed Reactor Operator shall be in the Control Room when fuel is in the reactor. In addition, while the reactor is in MODE 1, 2, 3, or 4, at least one licensed Senior Reactor Operator shall be in the Control Room.
- c. A radiation protection technician\* shall be onsite when fuel is in the reactor.
- d. All CORE ALTERATIONS shall be observed and directly supervised by either a licensed Senior Reactor Operator or Senior Reactor Operator Limited to Fuel Handling who has no other concurrent responsibilities during this operation.
- e. A site Fire Team of at least five members shall be maintained onsite at all times\*. The Fire Team shall not include the Shift Supervisor, the STA, nor the 3 other members of the minimum shift crew necessary for safe shutdown of the unit and any personnel required for other essential functions during a fire emergency.

6.2.2.2 The unit staff working hours shall be as follows:

- a. Administrative procedures shall be developed and implemented to limit the working hours of unit staff who perform safety-related functions; e.g., Senior Reactor Operators, Reactor Operators, radiation protection technicians, auxiliary operators, and key maintenance personnel.

---

\*The radiation protection technician and Fire Team composition may be less than the minimum requirements for a period of time not to exceed 2 hours, in order to accommodate unexpected absence, provided immediate action is taken to fill the required positions.

## ADMINISTRATIVE CONTROLS

### UNIT STAFF (Continued)

- b. Adequate shift coverage shall be maintained without routine heavy use of overtime. The objective shall be to have operating personnel work a normal 8-hour day, 40-hour week while the plant is operating. However, in the event that unforeseen problems require substantial amounts of overtime to be used, or during extended periods of shutdown for refueling, major maintenance, or major plant modifications, on a temporary basis, the following guidelines shall be followed (this excludes the STA working hours):
- 1) An individual should not be permitted to work more than 16 hours straight, excluding shift turnover time.
  - 2) An individual should not be permitted to work more than 16 hours in any 24-hour period, nor more than 24 hours in any 48-hour period, nor more than 72 hours in any 7-day period, all excluding shift turnover time.
  - 3) A break of at least 8 hours should be allowed between work periods, including shift turnover time.
  - 4) Except during extended shutdown periods, the use of overtime should be considered on an individual basis and not for the entire staff on a shift.
- c. Any deviation from the above guidelines shall be authorized by the ~~Director of Nuclear Operations~~ or his designee who is at supervisory level or above, or higher levels of management, in accordance with established procedures and with documentation of the basis for granting the deviation. Controls shall be included in the procedures such that individual overtime shall be reviewed monthly by the ~~Director of Nuclear Operations~~ or his designee to assure that excessive hours have not been assigned. Routine deviation from the above guidelines is not authorized.

PINGS PLANT MANAGER

# FINAL DRAFT

DAIN VEDNE - UNIT 1

6-2

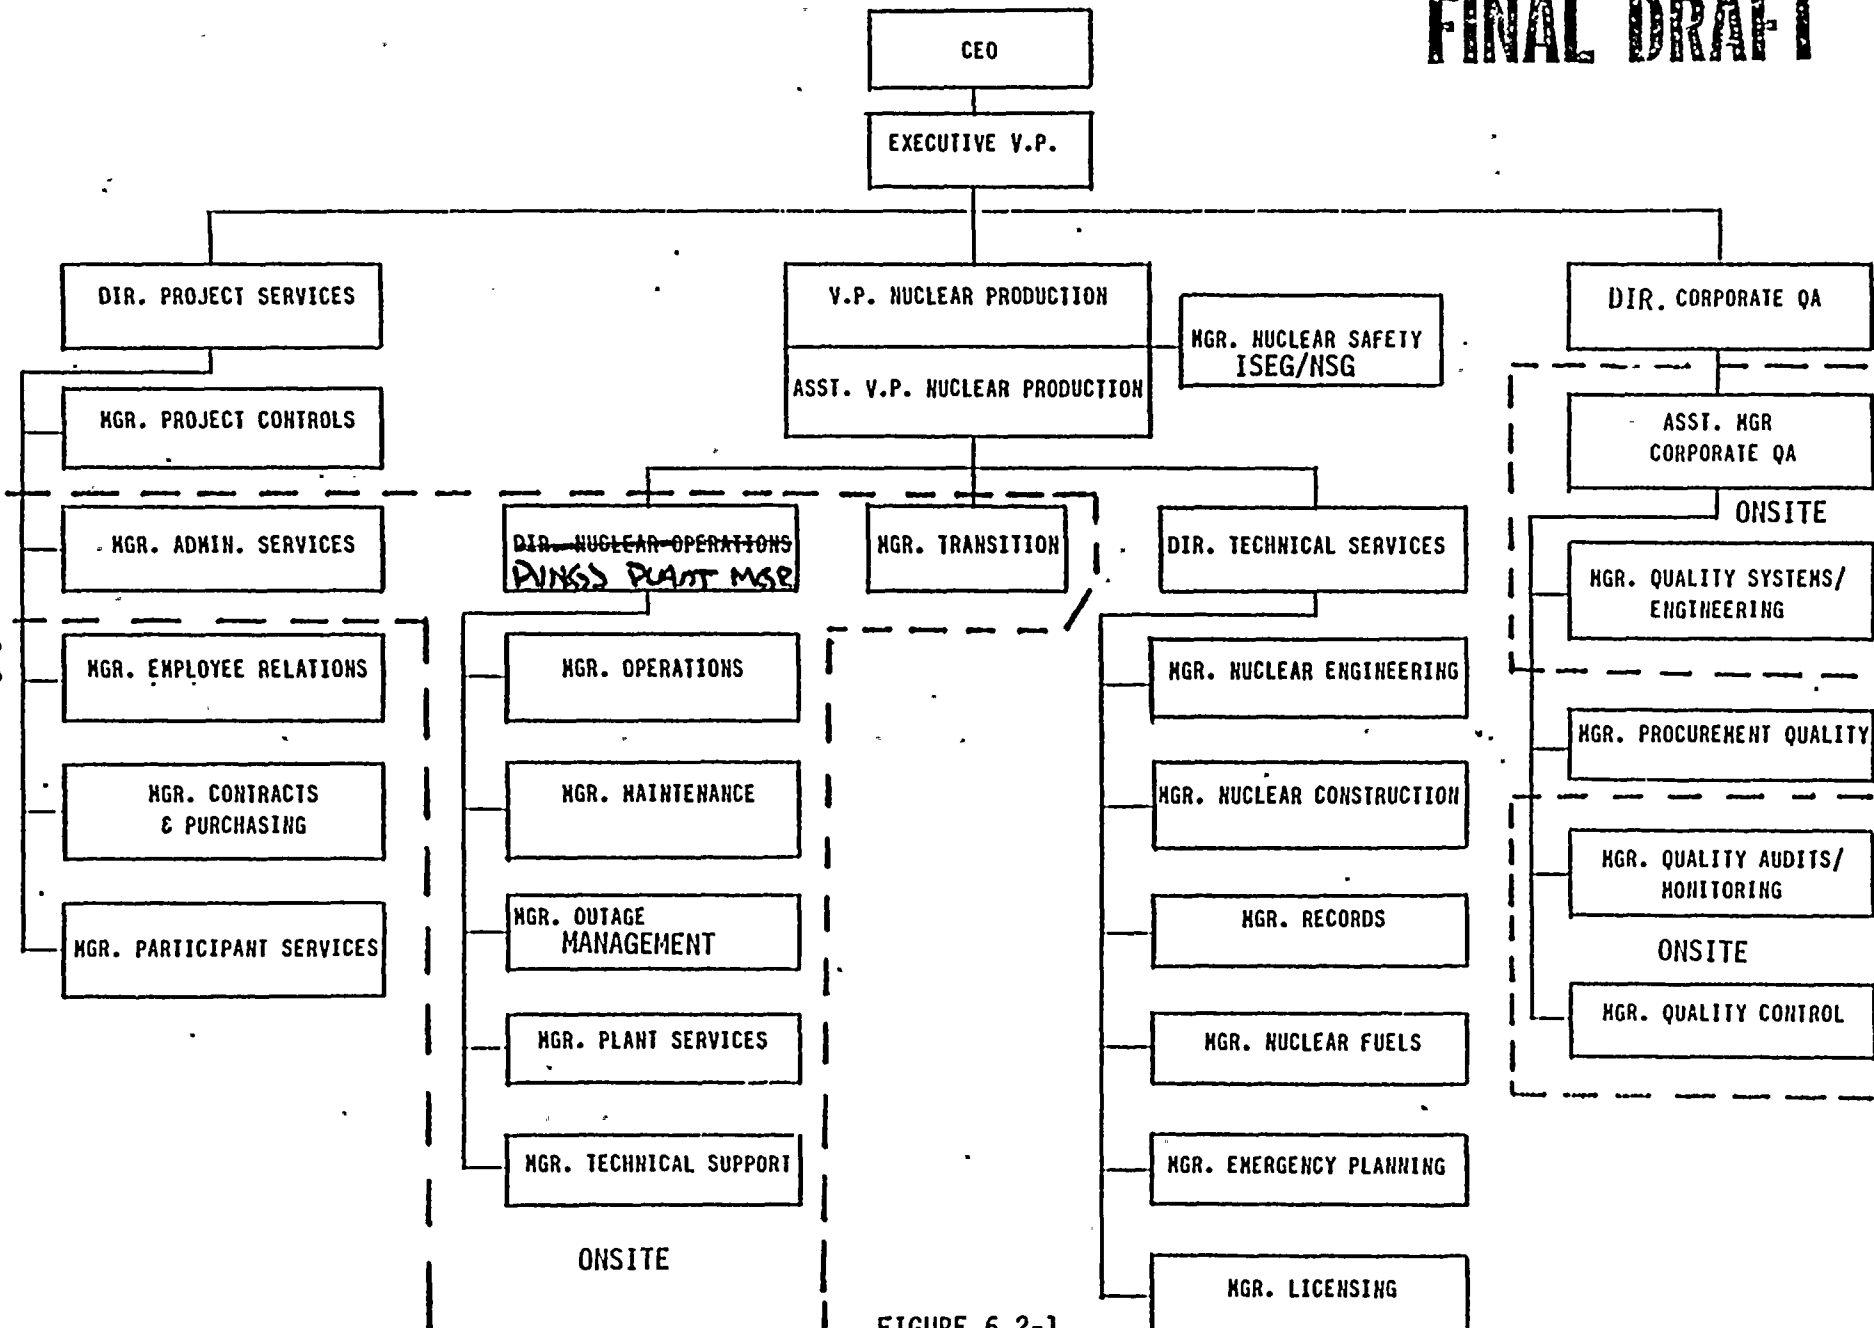


FIGURE 6.2-1  
OFFSITE ORGANIZATION

FINAL DRAFT

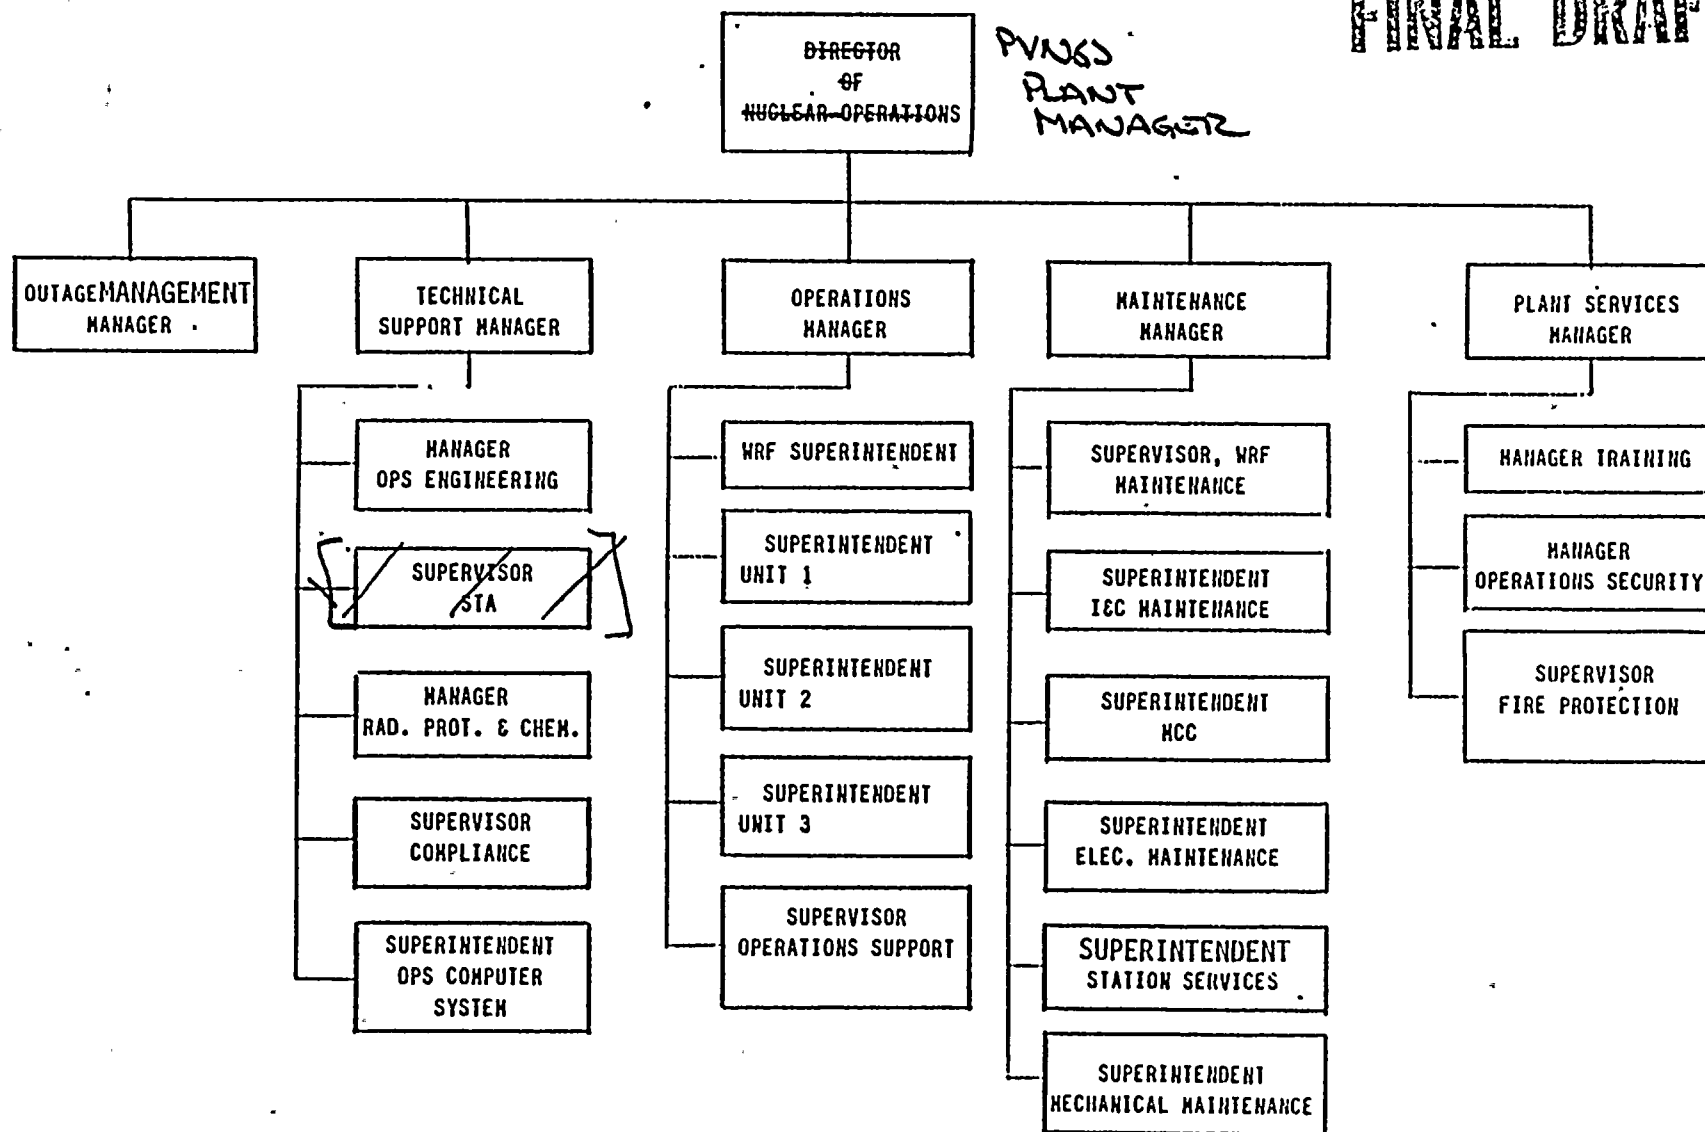


FIGURE 6.2-2

ONSITE UNIT ORGANIZATION



**FINAL DRAFT**

TABLE 6.2-1  
MINIMUM SHIFT CREW COMPOSITION

POSITION	NUMBER OF INDIVIDUALS REQUIRED TO FILL POSITION	
	MODE 1, 2, 3, OR 4	MODE 5 OR 6
SS	1	1
SRO	1	None
RO	2	1
AO	2	1
STA	1	None

SS - Shift Supervisor with a Senior Reactor Operators License  
SRO - Individual with a Senior Reactor Operators License  
RO - Individual with a Reactor Operators License  
AO - Nuclear Operator I or II  
STA - Shift Technical Advisor

Except for the Shift Supervisor, the Shift Crew Composition may be one less than the minimum requirements of Table 6.2-1 for a period of time not to exceed 2 hours in order to accommodate unexpected absence of on-duty shift crew members provided immediate action is taken to restore the Shift Crew Composition to within the minimum requirements of Table 6.2-1. This provision does not permit any shift crew position to be unmanned upon shift change due to an oncoming shift crewman being late or absent.

During any absence of the Shift Supervisor from the Control Room while the unit is in MODE 1, 2, 3, or 4, an individual (other than the Shift Technical Advisor) with a valid Senior Operator license shall be designated to assume the Control Room command function. During any absence of the Shift Supervisor from the Control Room while the unit is in MODE 5 or 6, an individual with a valid Senior Operator or Operator license shall be designated to assume the Control Room command function.

## ADMINISTRATIVE CONTROLS

### 6.2.3 INDEPENDENT SAFETY ENGINEERING GROUP (ISEG)

#### FUNCTION

6.2.3.1 The ISEG shall function to examine plant operating characteristics, NRC issuances, industry advisories, Licensee Event Reports, and other sources of plant design and operating experience information, including plants of similar design, which may indicate areas for improving plant safety.

#### COMPOSITION

6.2.3.2 The ISEG shall be composed of at least five, dedicated, full-time engineers located on site. Each shall have a Bachelor's Degree in engineering or related science and at least two years professional level experience in his field.

#### RESPONSIBILITIES

6.2.3.3 The ISEG shall be responsible for maintaining surveillance of plant activities to provide independent verification\* that these activities are performed correctly to reduce human errors as much as practical, and to detect potential nuclear safety hazards.

#### AUTHORITY

6.2.3.4 The ISEG shall make detailed recommendations for revised procedures, equipment modifications, maintenance activities, operations activities or other means of improving plant safety to the Manager of Nuclear Safety, ~~Director of Nuclear Operations~~ <sup>PNNGS</sup> and the Supervisor, Nuclear Safety Group (NSG). <sup>PLANT MANAGER</sup>

#### RECORDS

6.2.3.5 Records of activities performed by the ISEG shall be prepared, maintained, and forwarded each calendar month to the Manager of Nuclear Safety.

### 6.2.4 SHIFT TECHNICAL ADVISOR

6.2.4.1 The Shift Technical Advisor (STA) shall provide advisory technical support to the Shift Supervisor in the areas of thermal hydraulics, reactor engineering, and plant analysis with regard to the safe operation of the unit. The STA shall be onsite and shall be available in the control room within 10 minutes whenever one or more units are in MODE 1, 2, 3, or 4.

## 6.3 UNIT STAFF QUALIFICATIONS

6.3.1 Each member of the unit staff shall meet or exceed the minimum qualifications of ANS 3.1-1978 and Regulatory Guide 1.8, September 1975, except for the Radiation Protection and Chemistry Manager who shall meet or exceed the qualifications of Regulatory Guide 1.8, September 1975, and the Shift Technical Advisor who shall have a bachelor's degree or equivalent in a scientific or engineering discipline with specific training in plant design and plant operating characteristics, including transients and accidents.

\*Not responsible for sign-off function.

ADMINISTRATIVE CONTROLS

6.4 TRAINING

~~PNVGS PLANT MANAGER~~

6.4.1 A training program for the unit staff shall be maintained under the direction of the ~~Director of Nuclear Operations~~ or his designee and shall meet or exceed the requirements and recommendations of Section 5.0 of ANS 3.1-1978 and Appendix A of 10 CFR Part 55 and the supplemental requirements specified in Sections A and C of Enclosure 1 of the March 28, 1980 NRC letter to all licensees, and shall include familiarization with relevant industry operational experience.

6.5 REVIEW AND AUDIT

6.5.1 PLANT REVIEW BOARD (PRB)

FUNCTION

6.5.1.1 The Plant Review Board shall function to advise the ~~Director of Nuclear Operations~~ on all matters related to nuclear safety.

~~PNVGS PLANT MANAGER~~

COMPOSITION

6.5.1.2 The PRB shall be composed of the following personnel:

Member:	Technical Support Manager
Member:	Operations Manager
Member:	Maintenance Manager
Member:	Plant Services Manager
Member:	Engineering Manager
Member:	4-1, 4-2, 4-3 Operations Superintendent
Member:	STA Supervisor
Member:	<del>Training Manager</del> ILC SUPERINTENDENT
Member:	Radiation Protection and Chemistry Manager
Member:	Quality Systems/Engineering Manager

~~PNVGS PLANT MANAGER~~

The ~~Director of Nuclear Operations~~ shall designate the Chairman and Vice-Chairman in writing. The Chairman and Vice-Chairman may be from outside the members listed above provided that they meet ANSI Standard 3.1, 1978.

ALTERNATES

6.5.1.3 All alternate members shall be appointed in writing by the PRB Chairman to serve on a temporary basis; however, no more than two alternates shall participate as voting members in PRB activities at any one time.

MEETING FREQUENCY

6.5.1.4 The PRB shall meet at least once per calendar month and as convened by the PRB Chairman, Vice-Chairman, or his designated alternate.

FINAL DRAFT

## ADMINISTRATIVE CONTROLS

### QUORUM

6.5.1.5 The quorum of the PRB necessary for the performance of the PRB responsibility and authority provisions of these Technical Specifications shall consist of the Chairman, Vice-Chairman, or his designated alternate and five members including alternates.

### RESPONSIBILITIES

6.5.1.6 The PRB shall be responsible for:

- a. Review of all administrative control procedures and changes.
- b. Review of all proposed changes to Appendix "A" Technical Specifications.
- c. Investigation of all violations of the Technical Specifications including the preparation and forwarding of reports covering evaluation and recommendations to prevent recurrence to the Nuclear Safety Group (NSG).
- d. Review of REPORTABLE EVENTS requiring 24-hour written notification to the Commission.
- e. Review of unit operations to detect potential nuclear safety hazards.
- f. Performance of special reviews, investigations or analyses and reports thereon as requested by the ~~Director of Nuclear Operations~~ **PVNGS PLANT MANAGER**.
- g. Review and approval of using and entering values of CPC addressable constants outside the allowable range of Table 2.2-2.
- h. Review and documentation of judgment concerning prolonged operation in bypass, channel trip, and/or repair of defective protection channels of process variables placed in bypass since the last PRB meeting.

### AUTHORITY

6.5.1.7 The PRB shall:

- a. Render determinations in writing with regard to whether or not each item considered under Specification 6.5.1.6c. above constitutes an unreviewed safety question.
- b. Provide written notification within 24 hours to the Vice President-Nuclear Production, ~~NSG~~ and NSG of disagreement between the PRB and the ~~Director of Nuclear Operations~~; however, the ~~Director of Nuclear Operations~~ shall have responsibility for resolution of such disagreements pursuant to Specification 6.1.1 above.

**PVNGS PLANT MANAGER**



## ADMINISTRATIVE CONTROLS

### RECORDS

6.5.1.8 The PRB shall maintain written minutes of each PRB meeting that, at a minimum, document the results of all PRB activities performed under the responsibility and authority provisions of these Technical Specifications. Copies shall be provided to the ~~NSG~~ **PVNGS PLANT MANAGER AND**

### 6.5.2 TECHNICAL REVIEW AND CONTROL

#### ACTIVITIES

6.5.2.1 The ~~Director of Nuclear Operations (DNO)~~ **PVNGS PLANT MANAGER** shall assure that each procedure and program required by Specification 6.8 and other procedures which affect nuclear safety, and changes thereto, is prepared by a qualified individual/organization. Each such procedure, and changes thereto, shall be reviewed by an individual/group other than the individual/group which prepared the procedure, or changes thereto, but who may be from the same organization as the individual/group which prepared the procedure, or changes thereto.

6.5.2.2 Phase I - IV tests described in the FSAR that are performed by the plant operations staff shall be approved by the Manager of Technical Support or the Manager of Engineering as previously designated by the ~~Director of Nuclear Operations~~ **PVNGS PLANT MANAGER**. Test results shall be approved by the ~~Director of Nuclear Operations~~ or the Manager of Technical Support.

6.5.2.3 Proposed modifications to unit nuclear safety-related structures, systems and components shall be designed by a qualified individual/organization. Each such modification shall be reviewed by an individual/group other than the individual/group which designed the modification, but who may be from the same organization as the individual/group which designed the modification. Proposed modifications to nuclear safety-related structures, systems and components shall be approved prior to implementation by the ~~DNO~~ or by the Manager, Technical Support as previously designated by the ~~DNO~~ **PVNGS PLANT MANAGER**.

6.5.2.4 Individuals responsible for reviews performed in accordance with 6.5.2.1, 6.5.2.2, and 6.5.2.3 shall be members of the station supervisory staff, previously designated by the ~~DNO~~ to perform such reviews. Each such review shall include a determination of whether or not additional, cross-disciplinary, review is necessary. If deemed necessary, such review shall be performed by the appropriate designated review personnel.

6.5.2.5 Proposed tests and experiments which affect station nuclear safety and are not addressed in the FSAR or Technical Specifications shall be reviewed by the ~~DNO~~, the Manager Technical Support, the Manager Operations, or the Manager Maintenance.

6.5.2.6 Review of the station security program, and implementing procedures. Recommended changes shall be approved by the ~~DNO~~ and transmitted to the Vice President-Nuclear Production and to the NSG.

6.5.2.7 Review of the station emergency plan, and implementing procedures. Recommended changes shall be approved by the ~~DNO~~ and transmitted to the Vice President-Nuclear Operations and to the NSG.

6.5.2.8 The ~~DNO~~ shall assure the performance of a review by a qualified individual/organization of every unplanned onsite release of radioactive material to the environs including the preparation and forwarding of reports covering the evaluation, recommendations and disposition of the corrective action to prevent recurrence.

## ADMINISTRATIVE CONTROLS

### TECHNICAL REVIEW AND CONTROL (Continued)

6.5.2.9 The ~~ENO~~ <sup>PVNGS PLANT MANAGER</sup> shall assure the performance of a review by a qualified individual/organization of changes to the PROCESS CONTROL PROGRAM, OFFSITE DOSE CALCULATION MANUAL, radwaste treatment systems, and the Pre-planned Alternate Sampling Program.

6.5.2.10 Reports documenting each of the activities performed under Specifications 6.5.2.1 through 6.5.2.9 above shall be maintained. Copies shall be provided to the ~~Director of Nuclear Operations~~ <sup>PVNGS PLANT MANAGER</sup> and the Nuclear Safety Group.

### 6.5.3 NUCLEAR SAFETY GROUP (NSG)

#### FUNCTION

6.5.3.1 The NSG shall function to provide independent review and shall be responsible for the audit of designated activities in the areas of:

- a. nuclear power plant operations
- b. nuclear engineering
- c. chemistry and radiochemistry
- d. metallurgy
- e. instrumentation and control
- f. radiological safety
- g. mechanical and electrical engineering
- h. quality assurance practices

#### COMPOSITION

6.5.3.2 The NSG shall consist of a Supervisor and at least four staff specialists. The supervisor shall have a Bachelor's Degree in Engineering or the Physical Sciences. He will also have a minimum of 10 years experience in the power field with at least 3 of those years in the nuclear field. The NSG Supervisor will have at least 2 years of supervisor/managerial experience. Each staff specialist will have at least one of the following requirements:

- a. Eight years experience in one of the designated areas in Specification 6.5.3.1. One of these 8 years will be at Palo Verde Nuclear Generating Station.
- b. Bachelor's Degree in Engineering or a related science and 3 years of professional experience.

#### CONSULTANTS

6.5.3.3 Consultants shall be utilized as determined by the NSG Supervisor to provide expert advice to the NSG.

#### REVIEW

6.5.3.4 The NSG shall review:

- a. The safety evaluations program and its implementation for (1) changes to procedures, equipment, systems or facilities within the power block, and (2) tests or experiments completed under the provision of 10 CFR 50.59, to verify that such actions did not constitute an unreviewed safety question;

## ADMINISTRATIVE CONTROLS

### REVIEW (Continued)

- b. Proposed changes to procedures, equipment, systems or facilities within the power block which involve an unreviewed safety question as defined in 10 CFR 50.59;
- c. Proposed tests or experiments which involve an unreviewed safety question as defined in 10 CFR 50.59;
- d. Proposed changes to Technical Specifications or this Operating License;
- e. Violations of codes, regulations, orders, Technical Specifications, license requirements, or of internal procedures or instructions having nuclear safety significance;
- f. Significant operating abnormalities or deviations from normal and expected performance of unit equipment that affect nuclear safety;
- g. All REPORTABLE EVENTS requiring 24 hours written notification;
- h. All recognized indications of an unanticipated deficiency in some aspect of design or operation of structures, systems, or components that could affect nuclear safety; and
- i. Reports and meeting minutes of the PRB.

### AUDITS

6.5.3.5 Audits of unit activities shall be performed under the cognizance of the NSG. These audits shall encompass:

- a. The conformance of unit operation to provisions contained within the Technical Specifications and applicable license conditions at least once per 12 months.
- b. The performance, training, and qualifications of the entire unit staff at least once per 12 months.
- c. The results of actions taken to correct deficiencies occurring in unit equipment, structures, systems, or method of operation that affect nuclear safety at least once per 6 months.
- d. The performance of activities required by the Operational Quality Assurance Program to meet the criteria of Appendix B, 10 CFR Part 50, at least once per 24 months.
- e. Any other area of unit operation considered appropriate by the NSG or the Vice President-Nuclear Production.
- f. The fire protection programmatic controls including the implementing procedures at least once per 24 months by qualified licensee QA personnel.



ADMINISTRATIVE CONTROLS

AUDITS (Continued)

- g. The fire protection equipment and program implementation at least once per 12 months utilizing either a qualified offsite licensee fire protection engineer or an outside independent fire protection consultant. An outside independent fire protection consultant shall be used at least every third year.
- h. The radiological environmental monitoring program and the results thereof at least once per 12 months.
- i. The OFFSITE DOSE CALCULATION MANUAL and implementing procedures at least once per 24 months.
- j. The PROCESS CONTROL PROGRAM and implementing procedures for processing and packaging of radioactive wastes at least once per 24 months.
- k. The performance of activities required by the Operations Quality Assurance Criteria Manual to meet the provisions of Regulatory Guide 1.21, Revision 1, June 1974 and Regulatory Guide 4.1, Revision 1, April 1975 at least once per 12 months.
- l. The Pre-planned Alternate Sampling Program and implementing procedures at least once per 24 months.

AUTHORITY

6.5.3.6 The NSG shall report to and advise the Manager of Nuclear Safety on those areas of responsibility specified in Specifications 6.5.3.4 and 6.5.3.5.

RECORDS

6.5.3.7 Records of NSG activities shall be prepared and maintained. Report of reviews and audits shall be prepared monthly for the Manager of Nuclear Safety who will distribute it to the Vice President-Nuclear Production, ~~Director of Nuclear Operations~~, and to the management positions responsible for the areas audited.

MINES  
PLANT  
MANAGER

6.6 REPORTABLE EVENT ACTION

6.6.1 The following actions shall be taken for REPORTABLE EVENTS:

- a. The Commission shall be notified and a report submitted pursuant to the requirements of Section 50.73 to 10 CFR Part 50, and
- b. Each REPORTABLE EVENT requiring 24 hours written notification shall be reviewed by the PRB, and the results of this review shall be submitted to the ~~Manager of Nuclear Safety~~ and the Vice President-Nuclear Production.

supervision

Group

ADMINISTRATIVE CONTROLS

6.7 SAFETY LIMIT VIOLATION

6.7.1 The following actions shall be taken in the event a Safety Limit is violated:

- a. The NRC Operations Center shall be notified by telephone as soon as possible and in all cases within 1 hour. The Vice President-Nuclear Production, ~~Director of Nuclear Operations and Manager of Nuclear~~ <sup>Supervisor</sup> Safety, shall be notified within 24 hours. <sup>Group</sup> ~~2~~ <sup>PLUGS PLANT MANAGER</sup>
- b. A Safety Limit Violation Report shall be prepared. The report shall be reviewed by the PRB. This report shall describe (1) applicable circumstances preceding the violation, (2) effects of the violation upon facility components, systems, or structures, and (3) corrective action taken to prevent recurrence.
- c. The Safety Limit Violation Report shall be submitted to the Commission, the Supervisor of the NSG and the Vice President-Nuclear Production within 14 days of the violation.
- d. Critical operation of the unit shall not be resumed until authorized by the Commission.

6.8 PROCEDURES AND PROGRAMS

6.8.1 Written procedures shall be established, implemented, and maintained covering the activities referenced below:

- a. The applicable procedures recommended in Appendix A of Regulatory Guide 1.33, Revision 2, February 1978, and those required for implementing the requirements of NUREG-0737.
- b. Refueling operations.
- c. Surveillance and test activities of safety-related equipment.
- d. Security Plan implementation.
- e. Emergency Plan implementation.
- f. Fire Protection Program implementation.
- g. Modification of Core Protection Calculator (CPC) Addressable Constants.

NOTE: Modification to the CPC Addressable Constants based on information obtained through the Plant Computer - CPC data link shall not be made without prior approval of the PRB.

- h. PROCESS CONTROL PROGRAM implementation.
- i. OFFSITE DOSE CALCULATION MANUAL implementation.
- j. Quality Assurance Program for effluent and environmental monitoring, using the guidance in Regulatory Guide 1.21, Revision 1, June 1974 and Regulatory Guide 4.1, Revision 1, April 1975.
- k. Pre-planned Alternate Sampling Program implementation.

## ADMINISTRATIVE CONTROLS

6.8.2 Each program or procedure of Specification 6.8.1, and changes thereto, shall be reviewed as specified in Specification 6.5.1 and approved prior to implementation. Programs, and administrative control procedures shall be approved by the ~~Director of Nuclear Operations~~, or designated alternate who is at supervisory level or above. ~~Implementing procedures shall be approved by the Director of Nuclear Operations or cognizant department head, as designated by the Director of Nuclear Operations.~~ Programs and procedures of Specification 6.8.1 shall be reviewed periodically as set forth in administrative procedures.

AND Implementing  
procedures  
PUNGS  
PLANT  
MANAGER

6.8.3 Temporary changes to procedures of Specification 6.8.1 above may be made provided:

- a. The intent of the original procedure is not altered.
- b. The change is approved by two members of the plant supervisory staff, at least one of whom is the Shift Supervisor or Assistant Shift Supervisor on the unit affected.
- c. The change is documented, reviewed in accordance with Specification 6.5.1 and approved by the ~~Director of Nuclear Operations~~ or cognizant department head, as designated by the ~~Director of Nuclear Operations~~, within 14 days of implementation.

PUNGS  
PLANT  
MANAGER

6.8.4 The following programs shall be established, implemented, maintained, and shall be audited under the cognizance of the NSG at least once per 24 months:

### a. Primary Coolant Sources Outside Containment

A program to reduce leakage from those portions of systems outside containment that could contain highly radioactive fluids during a serious transient or accident to as low as practical levels. The systems include the recirculation portion of the high pressure safety injection system, the shutdown cooling portion of the low pressure safety injection system, the post-accident sampling subsystem of the reactor coolant sampling system, the containment spray system, the post-accident sample return piping of the radioactive waste gas system, the post-accident sampling return piping of the liquid radwaste system, and the post-accident containment atmosphere sampling piping of the hydrogen monitoring subsystem. The program shall include the following:

- (1) Preventive maintenance and periodic visual inspection requirements, and
- (2) Integrated leak test requirements for each system at refueling cycle intervals or less.

ADMINISTRATIVE CONTROLS

PROCEDURES AND PROGRAMS (Continued)

b. In-Plant Radiation Monitoring

A program which will ensure the capability to accurately determine the airborne iodine concentration in vital areas under accident conditions. This program shall include the following:

- (1) Training of personnel,
- (2) Procedures for monitoring, and
- (3) Provisions for maintenance of sampling and analysis equipment.

c. Secondary Water Chemistry

A program for monitoring of secondary water chemistry to inhibit steam generator tube degradation. This program shall include:

- (1) Identification of a sampling schedule for the critical variables and control points for these variables,
- (2) Identification of the procedures used to measure the values of the critical variables,
- (3) Identification of process sampling points, which shall include monitoring the discharge of the condensate pumps for evidence of condenser in-leakage,
- (4) Procedures for the recording and management of data,
- (5) Procedures defining corrective actions for all off-control point chemistry conditions, and
- (6) A procedure identifying (a) the authority responsible for the interpretation of the data, and (b) the sequence and timing of administrative events required to initiate corrective action.

d. Backup Method for Determining Subcooling Margin

A program which will ensure the capability to accurately monitor the Reactor Coolant System subcooling margin. This program shall include the following:

- (1) Training of personnel, and
- (2) Procedures for monitoring.

e. Post-accident Sampling

A program which will ensure the capability to obtain and analyze reactor coolant, radioactive iodines and particulates in plant

**FINAL DRAFT**

## ADMINISTRATIVE CONTROLS

### PROCEDURES AND PROGRAMS (Continued)

gaseous effluents, and containment atmosphere samples under accident conditions. The program shall include the following:

- (1) Training of personnel,
- (2) Procedures for sampling and analysis,
- (3) Provisions for maintenance of sampling and analysis equipment.

### 6.9. REPORTING REQUIREMENTS

#### ROUTINE REPORTS

6.9.1 In addition to the applicable reporting requirements of Title 10, Code of Federal Regulations, the following reports shall be submitted to the Regional Administrator of the Regional Office of the NRC unless otherwise noted.

#### STARTUP REPORT

6.9.1.1 A summary report of plant startup and power escalation testing shall be submitted following (1) receipt of an operating license, (2) amendment to the license involving a planned increase in power level, (3) installation of fuel that has a different design or has been manufactured by a different fuel supplier, and (4) modifications that may have significantly altered the nuclear, thermal, or hydraulic performance of the plant.

6.9.1.2 The Startup Report shall address each of the tests identified in the FSAR and shall include a description of the measured values of the operating conditions or characteristics obtained during the test program and a comparison of these values with design predictions and specifications. Any corrective actions that were required to obtain satisfactory operation shall also be described. Any additional specific details required in license conditions based on other commitments shall be included in this report.

6.9.1.3 Startup reports shall be submitted within (1) 90 days following completion of the startup test program (2) 90 days following resumption or commencement of commercial power operation, or (3) 9 months following initial criticality, whichever is earliest. If the Startup Report does not cover all three events (i.e., initial criticality, completion of startup test program, and resumption or commencement of commercial operation) supplementary reports shall be submitted at least every 3 months until all three events have been completed.

**FINAL DRAFT**

## ADMINISTRATIVE CONTROLS

### ANNUAL REPORTS\*

6.9.1.4 Annual reports covering the activities of the unit as described below for the previous calendar year shall be submitted prior to March 1 of each year. The initial report shall be submitted prior to March 1 of the year following initial criticality.

6.9.1.5 Reports required on an annual basis shall include a tabulation on an annual basis of the number of station, utility, and other personnel (including contractors) receiving exposures greater than 100 mrem/yr and their associated man-rem exposure according to work and job functions,\*\* e.g., reactor operations and surveillance, inservice inspection, routine maintenance, special maintenance (describe maintenance), waste processing, and refueling. The dose assignments to various duty functions may be estimated based on pocket dosimeter, TLD, or film badge measurements. Small exposures totalling less than 20% of the individual total dose need not be accounted for. In the aggregate, at least 80% of the total whole body dose received from external sources should be assigned to specific major work functions.

### MONTHLY OPERATING REPORT

6.9.1.6 Routine reports of operating statistics and shutdown experience, including documentation of all challenges to the safety valves, shall be submitted on a monthly basis to the Director, Office of Resource Management, U.S. Nuclear Regulatory Commission, Washington, D.C. 20555, with a copy to the Regional Administrator of the Regional Office of the NRC, no later than the 15th of each month following the calendar month covered by the report.

### ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT\*\*\*

6.9.1.7 Routine Annual Radiological Environmental Operating Reports covering the operation of the unit during the previous calendar year shall be submitted prior to May 1 of each year. The initial report shall be submitted prior to May 1 of the year following initial criticality.

---

\*A single submittal may be made for a multiple unit station. The submittal should combine those sections that are common to all units at the station.

\*\*This tabulation supplements the requirements of §20.407 of the 10 CFR Part 20.

\*\*\*A single submittal may be made for a multiple unit station.



FINAL DRAFT

## ADMINISTRATIVE CONTROLS

### ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORTS (Continued)

The Annual Radiological Environmental Operating Reports shall include summaries, interpretations, and an analysis of trends of the results of the radiological environmental surveillance activities for the report period, including a comparison with preoperational studies, with operational controls as appropriate, and with previous environmental surveillance reports, and an assessment of the observed impacts of the plant operation on the environment. The reports shall also include the results of land use censuses required by Specification 3.12.2.

The Annual Radiological Environmental Operating Reports shall include the results of analysis of all radiological environmental samples and of all environmental radiation measurements taken during the period pursuant to the locations specified in the Table and Figures in the ODCM, as well as summarized and tabulated results of these analyses and measurements in the format of the table in the Radiological Assessment Branch Technical Position, Revision 1, November 1979. In the event that some individual results are not available for inclusion with the report, the report shall be submitted noting and explaining the reasons for the missing results. The missing data shall be submitted as soon as possible in a supplementary report.

The reports shall also include the following: a summary description of the radiological environmental monitoring program; at least two legible maps\* covering all sampling locations keyed to a table giving distances and directions from the centerline of one reactor; the results of licensee participation in the Interlaboratory Comparison Program, required by Specification 3.12.3; discussion of all deviations from the sampling schedule of Table 3.12-1; and discussion of all analyses in which the LLD required by Table 4.12-1 was not achievable.

### SEMIANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT\*\*

6.9.1.8 Routine Semiannual Radioactive Effluent Release Reports covering the operation of the unit during the previous 6 months of operation shall be submitted within 60 days after January 1 and July 1 of each year. The period of the first report shall begin with the date of initial criticality.

The Semiannual Radioactive Effluent Release Reports shall include a summary of the quantities of radioactive liquid and gaseous effluents and solid waste released from the unit as outlined in Regulatory Guide 1.21, "Measuring, Evaluating, and Reporting Radioactivity in Solid Wastes and Releases of Radioactive Materials in Liquid and Gaseous Effluents from Light-Water-Cooled Nuclear Power Plants," Revision 1, June 1974, with data summarized on a quarterly basis following the format of Appendix B thereof.

---

\*One map shall cover stations near the SITE BOUNDARY; a second shall include the more distant stations.

\*\*A single submittal may be made for a multiple unit station. The submittal should combine those sections that are common to all units at the station; however, for units with separate radwaste systems, the submittal shall specify the releases of radioactive material from each unit.



FINAL DRAFT

ADMINISTRATIVE CONTROLS

SEMIANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT (Continued)

The Semiannual Radioactive Effluent Release Report to be submitted within 60 days after January 1 of each year shall include an annual summary of hourly meteorological data collected over the previous year. This annual summary may be either in the form of an hour-by-hour listing on magnetic tape of wind speed, wind direction, atmospheric stability, and precipitation (if measured), or in the form of joint frequency distributions of wind speed, wind direction, and atmospheric stability.\* This same report shall include an assessment of the radiation doses due to the radioactive liquid and gaseous effluents released from the unit or station during the previous calendar year. This same report shall also include an assessment of the radiation doses from radioactive liquid and gaseous effluents to MEMBERS OF THE PUBLIC due to their activities inside the SITE BOUNDARY (Figure 5.1-1) during the report period. All assumptions used in making these assessments, i.e., specific activity, exposure time and location, shall be included in these reports. The meteorological conditions concurrent with the time of release of radioactive materials in gaseous effluents, as determined by sampling frequency and measurement, shall be used for determining the gaseous pathway doses. The assessment of radiation doses shall be performed in accordance with the methodology and parameters in the OFFSITE DOSE CALCULATION MANUAL.

The Semiannual Radioactive Effluent Release Report to be submitted 60 days after January 1 of each year shall also include an assessment of radiation doses to the likely most exposed MEMBER OF THE PUBLIC from reactor releases and other nearby uranium fuel cycle sources, including doses from primary effluent pathways and direct radiation, for the previous calendar year to show conformance with 40 CFR Part 190, Environmental Radiation Protection Standards for Nuclear Power Operation. Acceptable methods for calculating the dose contribution from liquid and gaseous effluents are given in Regulatory Guide 1.109, Rev. 1, October 1977.

The Semiannual Radioactive Effluent Release Reports shall include the following information for each class of solid waste (as defined by 10 CFR Part 61) shipped offsite during the report period:

- a. Container volume,
- b. Total curie quantity (specify whether determined by measurement or estimate),
- c. Principal radionuclides (specify whether determined by measurement or estimate),
- d. Source of waste and processing employed (e.g., dewatered spent resin, compacted dry waste, evaporator bottoms),

\*In lieu of submission with the first half year Semiannual Radioactive Effluent Release Report, the licensee has the option of retaining this summary of required meteorological data on site in a file that shall be provided to the NRC upon request.



**ADMINISTRATIVE CONTROLS****SEMIANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT (Continued)**

- e. Type of container (e.g., LSA, Type A, Type B, Large Quantity), and
- f. Solidification agent or absorbent (e.g., cement, urea formaldehyde).

The Semiannual Radioactive Effluent Release Reports shall include a list and description of unplanned releases from the site to UNRESTRICTED AREAS of radioactive materials in gaseous and liquid effluents made during the reporting period.

The Semiannual Radioactive Effluent Release Reports shall include any changes made during the reporting period to the PROCESS CONTROL PROGRAM and to the OFFSITE DOSE CALCULATION MANUAL, as well as a listing of new locations for dose calculations and/or environmental monitoring identified by the land use census pursuant to Specification 3.12.2.

**SPECIAL REPORTS**

6.9.2 Special reports shall be submitted to the Regional Administrator of the Regional Office of the NRC within the time period specified for each report.

**6.10 RECORD RETENTION**

In addition to the applicable record retention requirements of Title 10, Code of Federal Regulations, the following records shall be retained for at least the minimum period indicated.

6.10.1 The following records shall be retained for at least 5 years:

- a. Records and logs of unit operation covering time interval at each power level.
- b. Records and logs of principal maintenance activities, inspections, repair and replacement of principal items of equipment related to nuclear safety.
- c. All REPORTABLE EVENTS submitted to the Commission.
- d. Records of surveillance activities; inspections and calibrations required by these Technical Specifications.
- e. Records of changes made to the procedures required by Specification 6.8.1.
- f. Records of radioactive shipments.
- g. Records of sealed source and fission detector leak tests and results.
- h. Records of annual physical inventory of all sealed source material of record.

ADMINISTRATIVE CONTROLSRECORD RETENTION (Continued)

6.10.2 The following records shall be retained for the duration of the unit Operating License:

- a. Records and drawing changes reflecting unit design modifications made to systems and equipment described in the FSAR.
- b. Records of new and irradiated fuel inventory, fuel transfers and assembly burnup histories.
- c. Records of radiation exposure for all individuals entering radiation control areas.
- d. Records of gaseous and liquid radioactive material released beyond the SITE BOUNDARY.
- e. Records of transient or operational cycles for those unit components identified in Tables 5.7-1 and 5.7-2.
- f. Records of reactor tests and experiments.
- g. Records of training and qualification for current members of the unit staff.
- h. Records of inservice inspections performed pursuant to these Technical Specifications.
- i. Records of quality assurance activities required by the QA Manual.
- j. Records of reviews performed for changes made to procedures or equipment or reviews of tests and experiments pursuant to 10 CFR 50.59.
- k. Records of PRB meetings and of NSG activities.
- l. Records of the service lives of all hydraulic and mechanical snubbers required by Specification 3.7.9 including the date at which the service life commences and associated installation and maintenance records.
- m. Records of audits performed under the requirements of Specifications 6.5.3.6 and 6.8.4.
- n. Records of analyses required by the radiological environmental monitoring program that would permit evaluation of the accuracy of the analysis at a later date. This should include procedures effective at specified times and QA records showing that these procedures were followed.
- o. Meteorological data, summarized and reported in a format consistent with the recommendations of Regulatory Guides 1.21 and 1.23.
- p. Records of secondary water sampling and water quality.

## ADMINISTRATIVE CONTROLS

### 6.11 RADIATION PROTECTION PROGRAM

6.11.1 Procedures for personnel radiation protection shall be prepared consistent with the requirements of 10 CFR Part 20 and shall be approved, maintained, and adhered to for all operations involving personnel radiation exposure.

### 6.12 HIGH RADIATION AREA

6.12.1 In lieu of the "control device" or "alarm signal" required by paragraph 20.203(c)(2) of 10 CFR Part 20, each high radiation area in which the intensity of radiation is greater than 100 mrem/hr but less than 1000 mrem/hr shall be barricaded and conspicuously posted as a high radiation area and entrance thereto shall be controlled by requiring issuance of a Radiation Exposure Permit (REP)\*. Any individual or group of individuals permitted to enter such areas shall be provided with or accompanied by one or more of the following:

- a. A radiation monitoring device which continuously indicates the radiation dose rate in the area.
- b. A radiation monitoring device which continuously integrates the radiation dose rate in the area and alarms when a preset integrated dose is received. Entry into such areas with this monitoring device may be made after the dose rate level in the area has been established and personnel have been made knowledgeable of them.
- c. A radiation protection qualified individual (i.e., qualified in radiation protection procedures) with a radiation dose rate monitoring device who is responsible for providing positive control over the activities within the area and shall perform periodic radiation surveillance at the frequency specified by the facility Radiation Protection Supervisor or his designated alternate in the REP.

6.12.2 In addition to the requirements of Specification 6.12.1, areas accessible to personnel with radiation levels such that a major portion of the body could receive in 1 hour a dose greater than 1000 mrem shall be provided with locked doors to prevent unauthorized entry, and the keys shall be maintained under the administrative control of the Shift Supervisor on duty and/or radiation protection supervision. Doors shall remain locked except during periods of access by personnel under an approved REP which shall specify the dose rate levels in the immediate work area and the maximum allowable stay time for individuals in that area. For individual areas accessible to

---

\*Radiation Protection personnel or personnel escorted by Radiation Protection personnel shall be exempt from the REP issuance requirement during the performance of their assigned radiation protection duties, provided they are otherwise following plant radiation protection procedures for entry into high radiation areas.

ADMINISTRATIVE CONTROLS

HIGH RADIATION AREA (Continued)

personnel with radiation levels such that a major portion of the body could receive in 1 hour a dose in excess of 1000 mrems\*, that are located within large areas, such as PWR containment, where no enclosure exists for purposes of locking, and no enclosure can be reasonably constructed around the individual areas, then that area shall be roped off, conspicuously posted and a flashing light shall be activated as a warning device. In lieu of the stay time specification of the REP, direct or remote (such as use of closed circuit TV cameras) continuous surveillance may be made by personnel qualified in radiation protection procedures to provide positive exposure control over the activities within the area.

6.13 PROCESS CONTROL PROGRAM (PCP)

6.13.1 The PCP shall be approved by the Commission prior to implementation.

6.13.2 Licensee-initiated changes to the PCP:

Shall be submitted to the Commission in the Semiannual Radioactive Effluent Release Report for the period in which the change(s) was made. This submittal shall contain:

- 1) Sufficiently detailed information to totally support the rationale for the change without benefit of additional or supplemental information; and
- 2) A determination that the change did not reduce the overall conformance of the solidified waste product to existing criteria for solid wastes.

6.14 OFFSITE DOSE CALCULATION MANUAL (ODCM)

6.14.1 The ODCM shall be approved by the Commission prior to implementation.

6.14.2 Licensee-initiated changes to the ODCM:

Shall be submitted to the Commission in the Semiannual Radioactive Effluent Release Report for the period in which the change(s) was made effective. This submittal shall contain:

---

\*Measurement made at 18 inches from source of radioactivity.



## ADMINISTRATIVE CONTROLS

### PROCESS CONTROL PROGRAM (Continued)

- 1) Sufficiently detailed information to totally support the rationale for the change without benefit of additional or supplemental information. Information submitted should consist of a package of those pages of the ODCM to be changed with each page numbered and provided with an approval and date box, together with appropriate analyses or evaluations justifying the change(s); and
- 2) A determination that the change will not reduce the accuracy or reliability of dose calculations or setpoint determinations.

### 6.15 MAJOR CHANGES TO RADIOACTIVE LIQUID, GASEOUS, AND SOLID WASTE TREATMENT SYSTEMS\*

#### 6.15.1 Licensee-initiated major changes to the radioactive waste systems (liquid, gaseous, and solid):

Shall be reported to the Commission in the Semiannual Radioactive Effluent Release Report for the period in which the evaluation was reviewed by the PRB. The discussion of each change shall contain:

- 1) A summary of the evaluation that led to the determination that the change could be made in accordance with 10 CFR 50.59.
- 2) Sufficient detailed information to totally support the reason for the change without benefit of additional or supplemental information;
- 3) A detailed description of the equipment, components, and processes involved and the interfaces with other plant systems;
- 4) An evaluation of the change, which shows the predicted releases of radioactive materials in liquid and gaseous effluents and/or quantity of solid waste that differ from those previously predicted in the license application and amendments thereto;
- 5) An evaluation of the change, which shows the expected maximum exposures to a MEMBER OF THE PUBLIC in the UNRESTRICTED AREA and to the general population that differ from those previously estimated in the license application and amendments thereto;

\*Licensees may choose to submit the information called for in this specification as part of the annual FSAR update.



1A  
FINAL DRAFT

## ADMINISTRATIVE CONTROLS

### MAJOR CHANGES TO RADIOACTIVE LIQUID, GASEOUS, AND SOLID WASTE TREATMENT SYSTEMS (Continued)

- 6) A comparison of the predicted releases of radioactive materials, in liquid and gaseous effluents and in solid waste, to the actual releases for the period prior to when the changes are to be made; and
- 7) An estimate of the exposure to plant operating personnel as a result of the change.

#### 6.16 PRE-PLANNED ALTERNATE SAMPLING PROGRAM (PASP)

6.16.1 The PASP, shall be approved by the Commission prior to implementation.

6.16.2 Licensee-initiated changes to the PASP:

Shall be submitted to the Commission in the Semiannual Radioactive Effluent Release Report for the period in which the change(s) was made. This submittal shall contain:

- 1) Sufficiently detailed information to totally support the rationale for the change without benefit of additional or supplemental information; and
- 2) A determination that the change did not reduce the overall effectiveness of the Gaseous Effluent Sampling Program.



ATTACHMENT B



## TYPOS

### PAGE

### COMMENTS

1-2	Item 1.7.a.2 Correct numbers.
2-5	Footnote 5, add % as noted.
2-6	Footnote 6 - Sentence left out in final draft identifying Tech. Spec. and proper Table.
3/4 1-8	4.1.2.2.b. "Charging Pump".
3/4 1-21	Action C change "within 1 hour" to where shown for sentence to read correctly.
3/4 1-22	Add Figure 3.1-4 to Action d.
3/4 1-32	Delete Reference to VCE 19028.
3/4 2-8	4.2.5 words "or equal to" left out. Needs to be added to agree with LCO.
3/4 3-5	Action 2 correct Reference is 6.5.1.6.H not 6.5.1.6.1.
3/4 3-16	The statement (conservatively compensated for measurement uncertainties) was to be deleted in Action 7 and 8.
3/4 3-23	Action 13 correct Reference is 6.5.1.6.H not 6.5.1.6.1.
3/4 3-25	Item II.A.2 add footnote (1) in both columns.
3/4 3-38	Item 1.c, 1.d, 2.A.1, ## note.
3/4 3-43	Item 1.b correct location of accelero-meter is in motor housing not upper support.
3/4 3-44	Item 1.b correct location of accelero-meter is in motor housing not upper support.
3/4 3-48	Change instrumentation to system in heading.
3/4 3-50	Corrections to Table.
3/4 3-51	Corrections to Table.
3/4 3-52	Corrections to Table.
3/4 3-53	Corrections to Table.
3/4 3-54	Corrections to Table.
3/4 3-55	Corrections to Table.
3/4 3-61-68	Table corrections and changes based on plant modifications.
3/4 3-76	Item 1.a and 1.b should be single # notes.
3/4 4-10	Delete "groups" APS doesn't use groups for Auxiliary Spray Valves.



TYPOS  
(Continued)

<u>PAGE</u>	<u>COMMENTS</u>
3/4 4-21	Correct valve identification numbers as discussed by Reviewer.
3/4 4-29	LCO b should be 10°F not 20°F. This agrees with the graph on Page 3/4 4-30.
3/4 5-3	Footnote should be 1837 psia not 1750.
3/4 5-5	4.5.2.f-the word indicated should be placed in front of the word differential.  4.5.2.f.1 - HPSI pump value is 1761 psid not 1830 psid. 4.5.2.f.2 - LPSI pump value is 165 psid not 195 psid.
3/4 5-7	Mode 3* and footnote to be deleted - mode 3 is 350°F, the Spec. is for 350°F.
3/4 6-8	LCO 4.6.1.7 should be 4.6.1.6.
3/4 6-10	4.6.1.6.2.c <u>TO</u> .
3/4 6-14	Action C numbers reflecting specs. changed 4.6.7.7.1 add ...insulation valve "not opened"...
3/4 6-15	4.6.2.1.b number is 273 psid.
3/4 6-21-35	Corrected valve numbers.
3/4 6-23	Reactor <u>Drain</u>
3/4 6-24	Corrected maximum actuation times to correspond with recent docketed material.
3/4 6-28	Add # note to AFE-V-079 and AFE-V-080.
3/4 6-30	Add # note to SGA-UV-174, 177 and SGB-UV-132, 137.
3/4 6-31	Add # note to SGA-UV-175, and SIA-UV-682.
3/4 6-34	Add # note to SIA-UV-673 and 6574 SIB-UV-675 and 676.
3/4 6-35	Add # note to FPE-V-089.
3/4 7-3	Correct title of Table 3.7-2 and reverse column order.
3/4 7-5	Item 5 should be 1270 psia instead of 1250 psia.
3/4 7-9	4.7.1.5.1 change the MISV closure time to <u>4.6</u> to agree with our response to RSB question.





TYPOS  
(Continued)

<u>PAGE</u>	<u>COMMENTS</u>
3/4 7-15	Action b should delete the "Emergency" and replace it with essential. Action b.3 replaced operability with operable.
3/4 7-23	4.7.9.e.2 add word "or" to end of paragraph.
3/4 7-30	Surv. number should be 4.7.11.1.3.
3/4 7-35	LCO A, B and C should have. Zones 5A and 5B. Zones 8A and 8B. Zones 9A and 9B.
3/4 7-36	Delete "flow from each nozzle".
3/4 7-39	Hose station 13 should be containment "NE".
3/4 7-44	4.7.13 <u>S</u> ubsystem.
3/4 8-1	3.8.1.1.b.1 delete "s" after tank.
3/4 8-22	..VLV J-SGE-HV- <u>4</u> 1.
3/4 8-25	Waste Gas Header.
3/4 9-9	Add to *...or during surveillance testing.
3/4 10-3	Delete "and" between startup physics testing. Replace "shall be" with are lower case on startup in applicability. Replace "if" with "with" in action statement. Delete is in action statement.
3/4 12-3	Location #56 should be #6.
3/4 12-4	Location #6 should be #56.
3/4 12-8	Add note to make consistent with Table 3.12-2.
5-1	Delete nominal to agree with FSAR.
5-8	2250 psia.
6-1	Director Nuclear Operations is now PVNGS Plant Manager.
6-2	Item C, Director Nuclear Operations is now PVNGS Plant Manager.



TYPOS  
(Continued)

<u>PAGE</u>	<u>COMMENTS</u>
6-3	Director Nuclear Operations is now PVNGS Plant Manager.
6-4	Director Nuclear Operations is now PVNGS Plant Manager. Delete STA Supervisor, no longer reports to Tech. Support Manager.
6-6	DNO - PVNGS Plant Manager.
6-7	DNO - PVNGS Plant Manager.
6-7	6.5.1.2 add Unit 1, Unit 2 and Unit 3 Operations Superintendent. Add I&C Superintendent. Delete Training Manager. Change Vice-Chairman to Vice-Chairmen.
6-8	DNO - PVNGS Plant Manager.
6-9	DNO - PVNGS Plant Manager.
6-10	DNO - PVNGS Plant Manager. 6.5.3.2.a, 6.5.2.1 goes to 6.5.3.1.
6-11	Delete word entire (6.5.3.5).
6-12	DNO - PVNGS Plant Manager. Change Manager of Nuclear Safety to Supervisor of Nuclear Safety Group (6.6.1).
6-13	6.7.1 Change Manager of Nuclear Safety to Supervisor of Nuclear Safety Group (6.6.1).
6-14	6.8.2 Reword to clarify change DNO - PVNGS Plant Manager.
6-17	Add *** to footnote.
6-21	6.10.2.m change 6.5.2.8 to 6.5.3.5.

1955

1955

1955

1955

1955

1955

1955

1955

1955

1955

1955

1955

1955

1955

1955

1955

1955

1955

1955

## CORRECTIONS

<u>PAGE</u>	<u>COMMENTS</u>
1-8	Add 4m to frequency notation. This will eliminate of taking double samples when the quarterly and weekly samples are due at the same time. This change is consistent with what St. Lucie was granted by the NRC.
B 2-6	Provide more accurate information for the basis section of the Steam Generator Level - High.
3/4 2-9	Action statement needs to be changed to agree with the new referenced graph. The new graph does not have a 30% RTP limit as the action statement states.
3/4 2-10	New graph.
3/4 2-12	Add special test exception to mode 2 for initial criticality.
3/4 3-8/9	This is an editorial change where the addition of the statement to Item A identifies the case where the CEAS out of service is for all rod deviations, whereas, Item B only covered the case for most rod deviations. This clarifies to the operators the action they need to take.
3/4 3-22	Information that APS needed to supply.
3/4 3-24	Information that APS needed to supply.
3/4 3-26	Item V.A. - new CE number. Item IX information that APS needed to supply.
3/4 3-29/30	Corrected Table per RSB questions.
3/4 3-31-36	ANPP-31035 dated November 1, 1984 provided this list of relays agreed upon by the NRC and APS that cannot be tested at power. The change to test relays to semi-annually was granted to SONGS Unit 3 by NRC letter dated September 24, 1984.
3/4 3-38	Item 3 Action 42 is applicable as per the rest of the TMI Items.



CORRECTIONS  
(Continued)

PAGE

COMMENTS

3/4 3-39

ACTION 27 - Reword as follows: with the number of OPERABLE channels less than required by the Minimum channels OPERABLE requirement, either restore the inoperable channel(s) to OPERABLE status within 72 hours, or:

1. For process monitors, place moveable air monitor in-line.

2. Ok as presently written.

Justification - Action "A" no longer applies to Table 3.3-6 because the previously affected monitors are no longer in this table. The second portion of Action "B" is completely covered by Action 23.

3/4 3-40

Item 3 - Make channel functional test represent how APS is going to functionally test the system.

3/4 3-48

Add statement to Action b allowing a means to fix the system before you start shutting the unit down.

3/4 3-49

Add to the title of the Table to reflect that disconnect switches and control circuits are in the tables.

3/4 3-57, 58,  
3-59A, & 59B

Change made to incorporate RVWL Tech. Spec. new action statement A and B have been accepted by the NRC in a SONGS 3 Tech. Spec. change.

The operability and action statements for the HJTCs are derived from the function prescribed by NRC generic letter 82-28 for this system, for reactor vessel inventory tracking. The availability of a minimum of one sensor in the lowest four levels and the requirement that there be at least two sensors operable in non-adjacent levels ensures





CORRECTIONS  
(Continued)

PAGE

COMMENTS

that this tracking function is maintained. The action statement (A) directs the operator to use an alternate method of monitoring reactor vessel inventory should the number be fewer than that which will provide acceptable inventory tracking and (B) instructs him to restore the system to an operable state at the earliest reasonable time; next refueling outage.

3/4 3-70 The words for ACTION a. and b. presented in the DRAFT were given to use by Mr. Wayne Meinke, NRC RAB to be in line with the model Tech. Specs. He stated this was important because of maintenance problems experienced by operational plants. Why then has the FINAL DRAFT been altered? Additionally, ACTION a. is now not appropriate since we have, at NRC direction, placed all the high range effluent monitors into the table. The suggested fix would be to add the words "low range" between "a radioactive" in ACTION a.

3/4 3-72/73 Delete ACTIONS 37, 40, and 36 from High Range Monitors. Justification: the High Range Monitor does not run unless in service thus, Actions are inappropriate.

3/4 3-75 ACTION 42 - Add "restore the channel to OPERABLE within 72 hours..." between "requirement, prepare" in the second line. This change will give the facility an opportunity to repair the inoperative equipment prior to creating a Special Report.

In discussions with Baltimore Gas and Electric Milstone Nuclear Plant, it was stated that NRC changed all 14 day Special Report requirements to 30 days. This change has already been accepted by the NRC and we would like the same requirement for PVNGS.

1944



CORRECTIONS  
(Continued)

<u>PAGE</u>	<u>COMMENTS</u>
3/4 4-21	Delete #1 it is the same as in LCO 3.4.5.2.E this is redundant.
3/4 4-29	Add * to applicability to cover initial criticality conditions.
3/4 4-35	Add sentence to 4.4.10 to ensure personnel and equipment safety when performing this test.
3/4 5-1	Add words to note to show correction between narrow range vs. wide range readings, this is to aide the operators.
3/4 5-4	4.5.2.b.2 APS design does not have any casing vents on ECCS pumps.
3/4 6-19	<p>LCO 3.6.3, its associated Action Statements. Surveillance Requirements and Table 3.6-1 have been revised to clarify determination of valve operability and the actions to be taken should a valve become inoperable. Sections A, B, &amp; C of Table 3.6-1 include only those valves assumed to close automatically within the specified time limits consistent with the LOCA analysis.</p> <p>I. The Action Statements have been modified as follows:</p> <p>A) Action Statement 1 has been modified to indicate that the existing requirements are only applicable to those valves assumed to automatically close within the specified time limits consistent with the LOCA analysis.</p> <p>B) Action Statement 2 has been added to those normally open or required open during accident condition valves. Applying the existing Action Statement to all valves listed in Table 3.6-1 could place the unit in an unsafe condition if applied to those valves required to be open under accident conditions.</p>



CORRECTIONS  
(Continued)

PAGE

COMMENTS

II. Surveillance Requirements 4.6.3.1, 4.6.3.2, and 4.6.3.3 have been modified to indicate their applicability to CIAS, CPIAS, and CSAS valves only.

Surveillance Requirement 4.6.3.4 has been added to ensure operability of the containment isolation check valves pursuant to 10 CFR 50, Appendix J.

Surveillance Requirement 4.6.3.5 has been added to clarify the operability of relief valves, normally open. ESF actuated closed, and required open under accident condition valves. Valves secured in their actuated position are considered operable pursuant to this specification, but may render a system inoperable pursuant to the system LCO in which the valve is installed.

Surveillance Requirement 4.6.3.6 has been added to clarify the operability of normally closed, post accident load valves that do not receive containment isolation signal. These valves are required operable per Specification 3.6.11 and are demonstrated operable per Surveillance Requirement 4.6.1.1.a.

3/4 6-29

Delete SIB-PSV-26 and 27 they are covered by another Tech. Spec. 3.4.8.3.

3/4 6-30

Delete main steam insulation valves. They are covered by Tech. Spec. 3.7.1.4.

3/4 6-21-35

Table corrections.

THE ... ..

... ..

... ..

... ..

... ..

... ..

... ..

... ..

... ..

... ..

... ..

... ..

... ..

... ..

... ..

CORRECTIONS

(Continued)

PAGE

COMMENTS

3/4 6-36

Add Action Statement C. The Spec. presently covers the cases for when you are operating, but doesn't cover the case when you are changing from modes 2 to 1 with 1 instrument inoperable. The addition of Item C is consistent in that Action A allows up to 30 days operation in mode 1 or 2 with 1 hydrogen monitor operable. With that time allowed to fix the inoperable monitor, it appears that the staff feels the plant can operate in a safe condition with no added risk to the health and safety to the public. By adding Action Statement C, there is not any additional risk to the health and safety to the public as applicable in Action A and we are still bound to fix the inoperable monitor within 30 days or bring the unit to hot standby.

3/4 7-34

Table corrections due to plant changes and better defined identification numbers.

3/4 7-39

Table corrections and additions.

3/4 7-41

Add \* to clarify actual condition/use of Hose Station 8.

3/4 7-41A

Add Halon Tech. Spec. based on completion of plant modification.

3/4 8-5

Add -0.3 Hz at 4.8.1.1.2.d.6.b per CE recommendation. This is to support safety analysis.

Delete "or upon loss of offsite power" it is already covered by first part of sentence (4.8.1.1.2.d.6.c) where it refers to loss of voltage.

3/4 8-17

Add to 4.8.4.1 "except fuses" to clarify surveillance statement.

3/4 8-18

4.8.4.1.a.2 change wording to clarify what is actually met and understood by APS Electrical Department.

3/4 8-47

Delete J-CPA-UV-4A, 4B J-CPA-UV-5A, 5B these valves are not MOV's they are now hydraulic operators.





CORRECTIONS  
(Continued)

<u>PAGE</u>	<u>COMMENTS</u>
3/4 10-5	Add comments on pressure in LCO. This is needed due to our initial criticality conditions.
3/4 11-5	LCO add Figure 5.1-1.
3/4 11-8	Item C Delete W for charcoal and particulate and add 4M. This will eliminate of taking double samples when the quarterly and weekly sample are required at the same time, to sample the same thing. This change has been granted to St. Lucie Unit 2 for the same reasons.
3/4 11-10	Item d delete "once per 7 days" and add "4 times a month" to make consistent with Table 4.11.2.
12-8	Tritium and add * note as done on page 12-7 except replace 30,000 with 3000. This change was previously granted but was apparently dropped in typing.
5-2	New Figure.

