

REGULATOR INFORMATION DISTRIBUTION SYSTEM (RIDS)


ACCESSION NBR:8503180265 DOC.DATE: 85/03/12 NOTARIZED: NO DOCKET #
 FACIL:STN-50-528 Palo Verde Nuclear Station, Unit 1, Arizona Publi 05000528
 STN-50-529 Palo Verde Nuclear Station, Unit 2, Arizona Publi 05000529
 STN-50-530 Palo Verde Nuclear Station, Unit 3, Arizona Publi 05000530
 AUTH.NAME AUTHOR AFFILIATION
 VAN BRUNT,E.E. Arizona Public Service Co.
 RECIP.NAME RECIPIENT AFFILIATION
 KNIGHTON,G.W. Licensing Branch 3

SUBJECT: Requests confirmation of interpretation of 10CFR50.59 re making changes, tests or experiments not described in SAR w/o prior NRC approval if change does not involve unreviewed safety questions or require Tech Spec change.

DISTRIBUTION CODE: A001D COPIES RECEIVED:LTR 1 ENCL 0 SIZE: 1 1
 TITLE: OR Submittal: General Distribution

NOTES:Standardized plant. 05000528
 OL:12/31/84
 Standardized plant. 05000529
 Standardized plant. 05000530

	RECIPIENT ID CODE/NAME		COPIES LTTR ENCL		RECIPIENT ID CODE/NAME		COPIES LTTR ENCL
	NRR LB3 BC	01	7				
INTERNAL:	ACRS	09	6		ADM/LFMB		1
	ELD/HDS3		1		NRR/DE/MTEB		1
	NRR/DL DIR		1		NRR/DL/ORAB		1
	NRR/DL/TSRG		1		NRR/DSI/METB		1
	NRR/DSI/RAB		1		<u>REG FILE</u>	04	1
	RGN5		1				
EXTERNAL:	LPDR	03	1		NRC PDR	02	1
	NSIC	05	1				

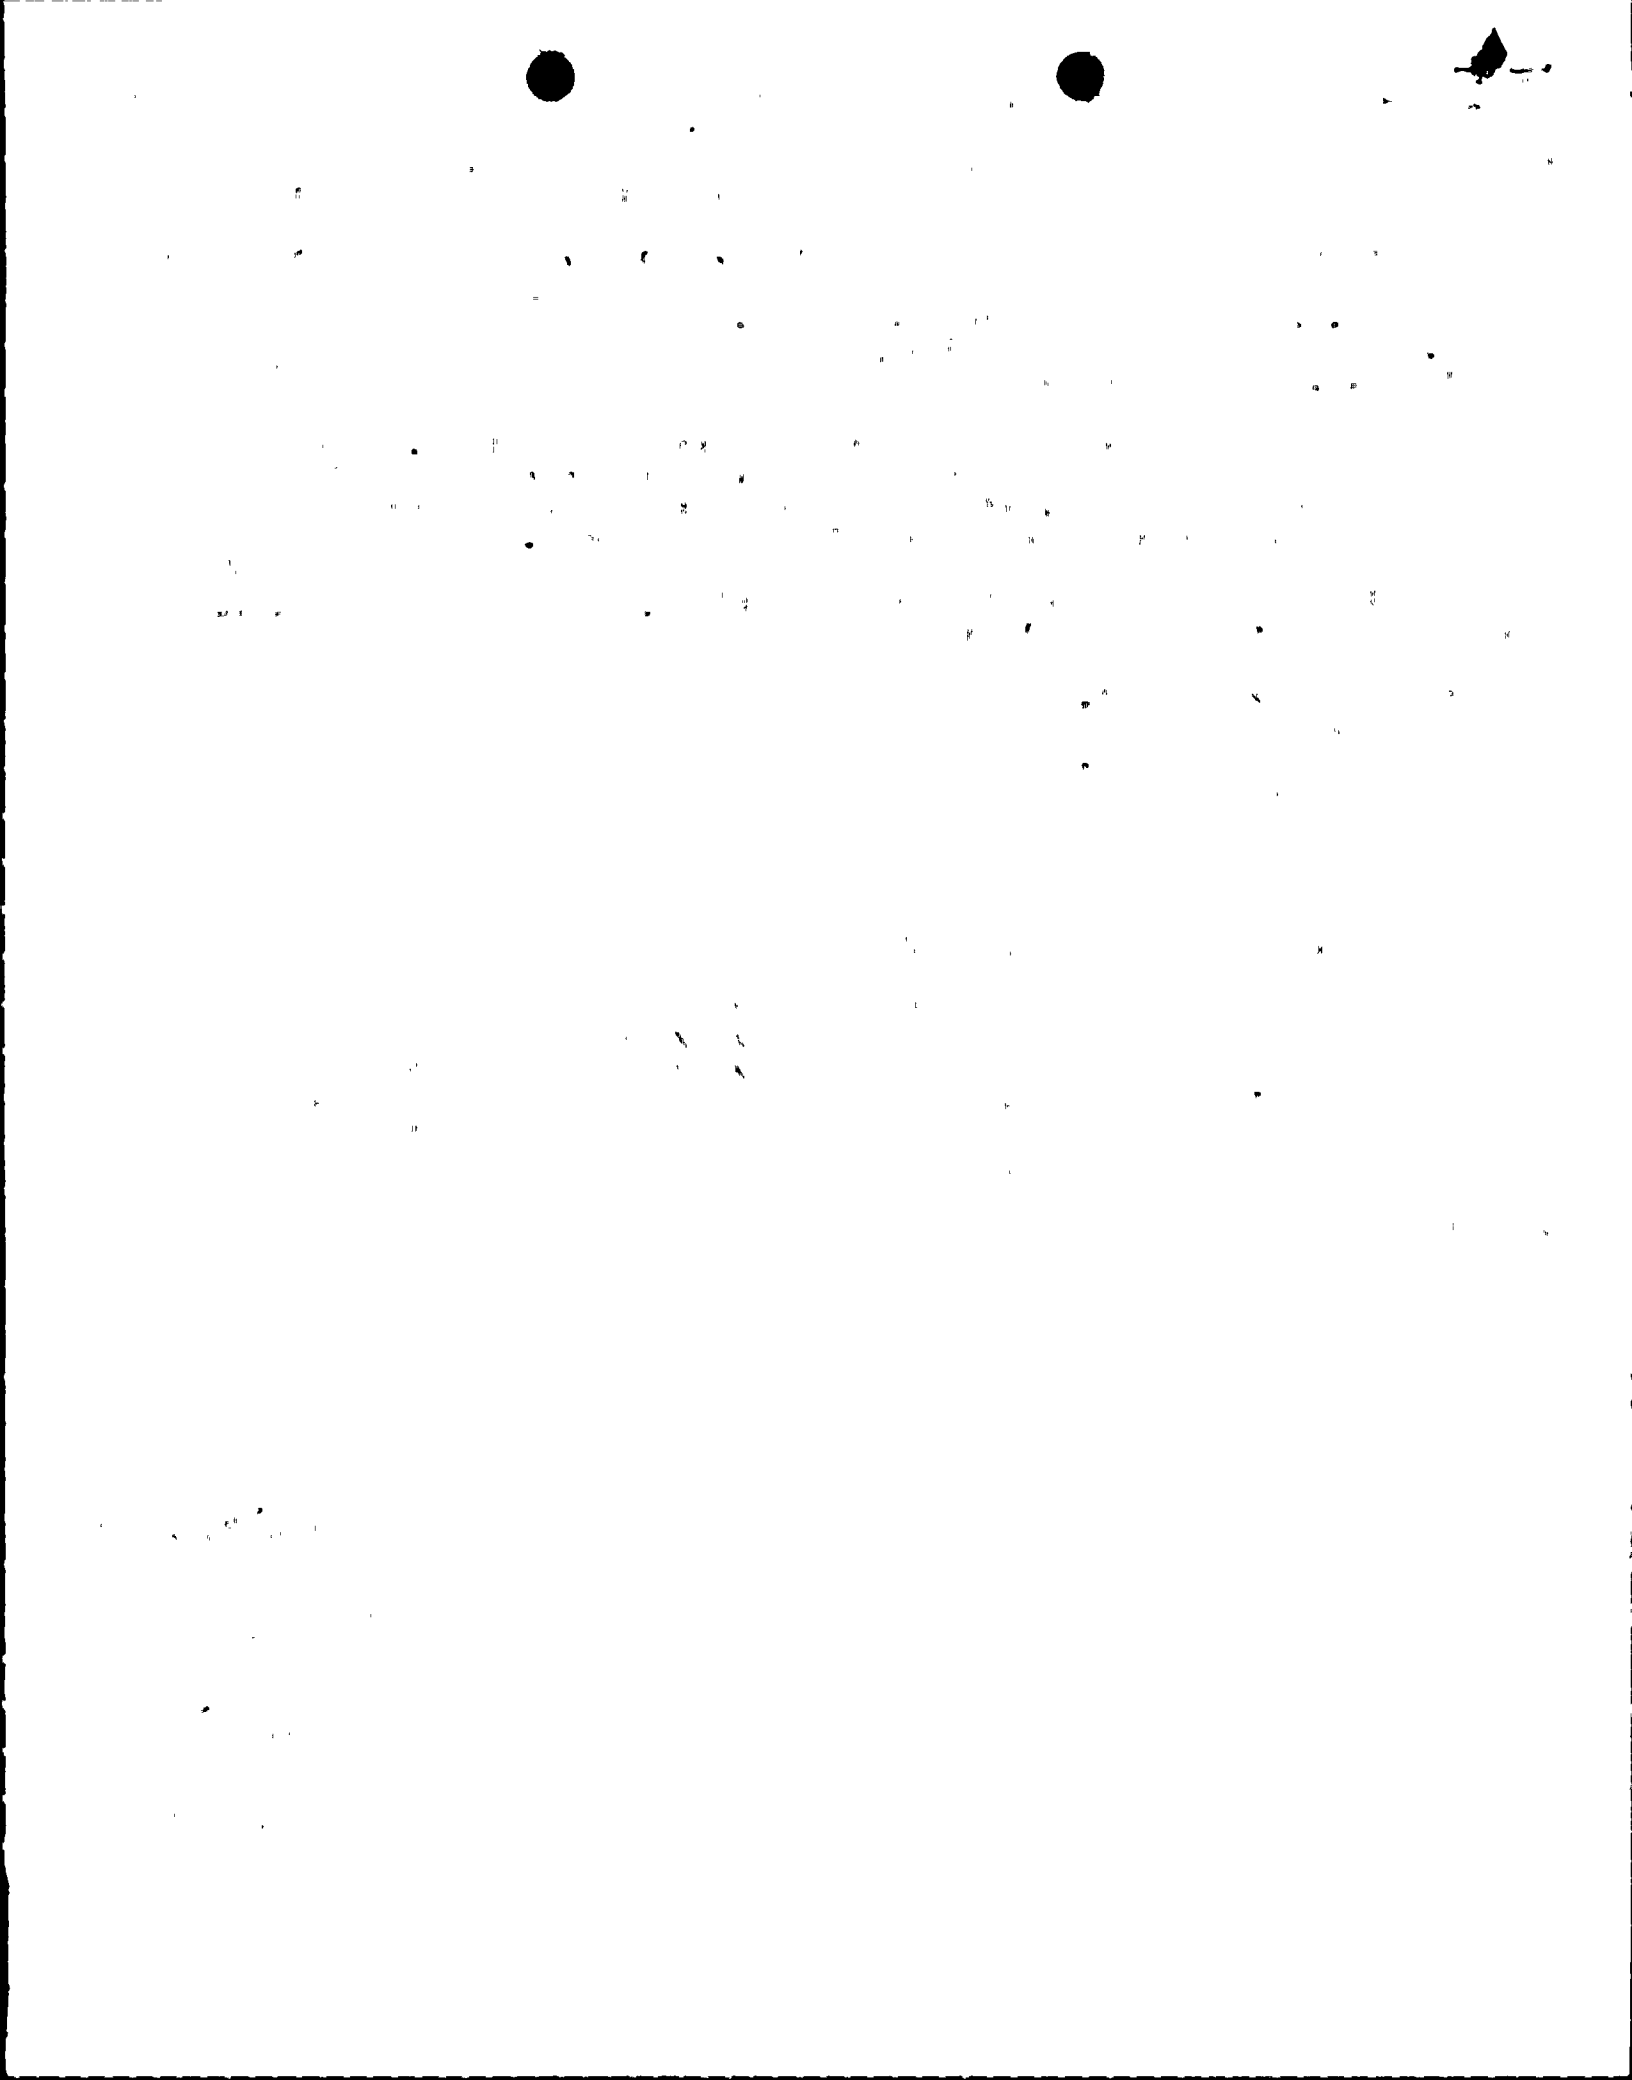



Arizona Nuclear Power Project

P.O. BOX 52034 • PHOENIX, ARIZONA 85072-2034

ANPP-32126-EEVB/WFQ
March 12, 1985

Director of Nuclear Reactor Regulation
Mr. George W. Knighton, Chief
Licensing Branch No. 3
Division of Licensing
U.S. Nuclear Regulatory Commission
Washington, D.C. 20555

Subject: Palo Verde Nuclear Generating Station (PVNGS)
Units 1, 2, and 3
Request for Interpretation of 10 CFR 50.59
Docket Nos. STN 50-528(License No. NPF-34)/529/530
File: 85-56-026

Dear Mr. Knighton:

Pursuant to 10 CFR 50.59, "Changes, tests and experiments", each holder of an operating license may make changes in the facility and/or procedures as described in the safety analysis report, or conduct tests or experiments not described in the safety analysis report, without prior Commission approval, if the change does not involve an unreviewed safety question (on the basis of a written safety evaluation) or require a technical specification change. In keeping with this philosophy, we believe that if a change is determined not to involve a change to the facility or procedures as described in the safety analysis report, or tests or experiments to be conducted are determined to have been described in the safety analysis report, and a change to technical specifications is not required, a written safety evaluation is not required. Basis for this opinion is contained in I&E Circular No. 80-18, dated August 22, 1980, and the I&E Inspection Manual (specific section for citation not available).

We request confirmation of this philosophy in the way of a formal interpretation pursuant to 10 CFR 50.3. Your response is requested in an expeditious manner.

Please contact Mr. William F. Quinn of my staff if you have any questions on this matter.

Very truly yours,

E. E. Van Brunt, Jr.
Executive Vice President
Project Director

EEVB/RMC/mb

cc: E. A. Licitra
R. P. Zimmerman
A. C. Gehr

8503180265 850312
PDR ADDCK 05000528
P PDR

Appl
1/0

