

# ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR:9001050320 DOC.DATE: 89/12/28 NOTARIZED: YES DOCKET #  
 FACIL:STN-50-528 Palo Verde Nuclear Station, Unit 1, Arizona Publi 05000528  
 STN-50-529 Palo Verde Nuclear Station, Unit 2, Arizona Publi 05000529  
 STN-50-530 Palo Verde Nuclear Station, Unit 3, Arizona Publi 05000530

AUTH.NAME AUTHOR AFFILIATION  
 CONWAY,W.F. Arizona Public Service Co. (formerly Arizona Nuclear Power  
 RECIP.NAME RECIPIENT AFFILIATION  
 Document Control Branch (Document Control Desk)

SUBJECT: Informs that review of Generic Ltr 89-10 re safety related motor-operated valve testing & surveillance complete.

DISTRIBUTION CODE: A064D COPIES RECEIVED:LTR 1 ENCL 0 SIZE: 2  
 TITLE: Response to Generic Ltr 89-10, "Safety-Related MOV Testing & Surveill

NOTES: 05000528  
 Standardized plant. 05000529  
 Standardized plant. 05000530

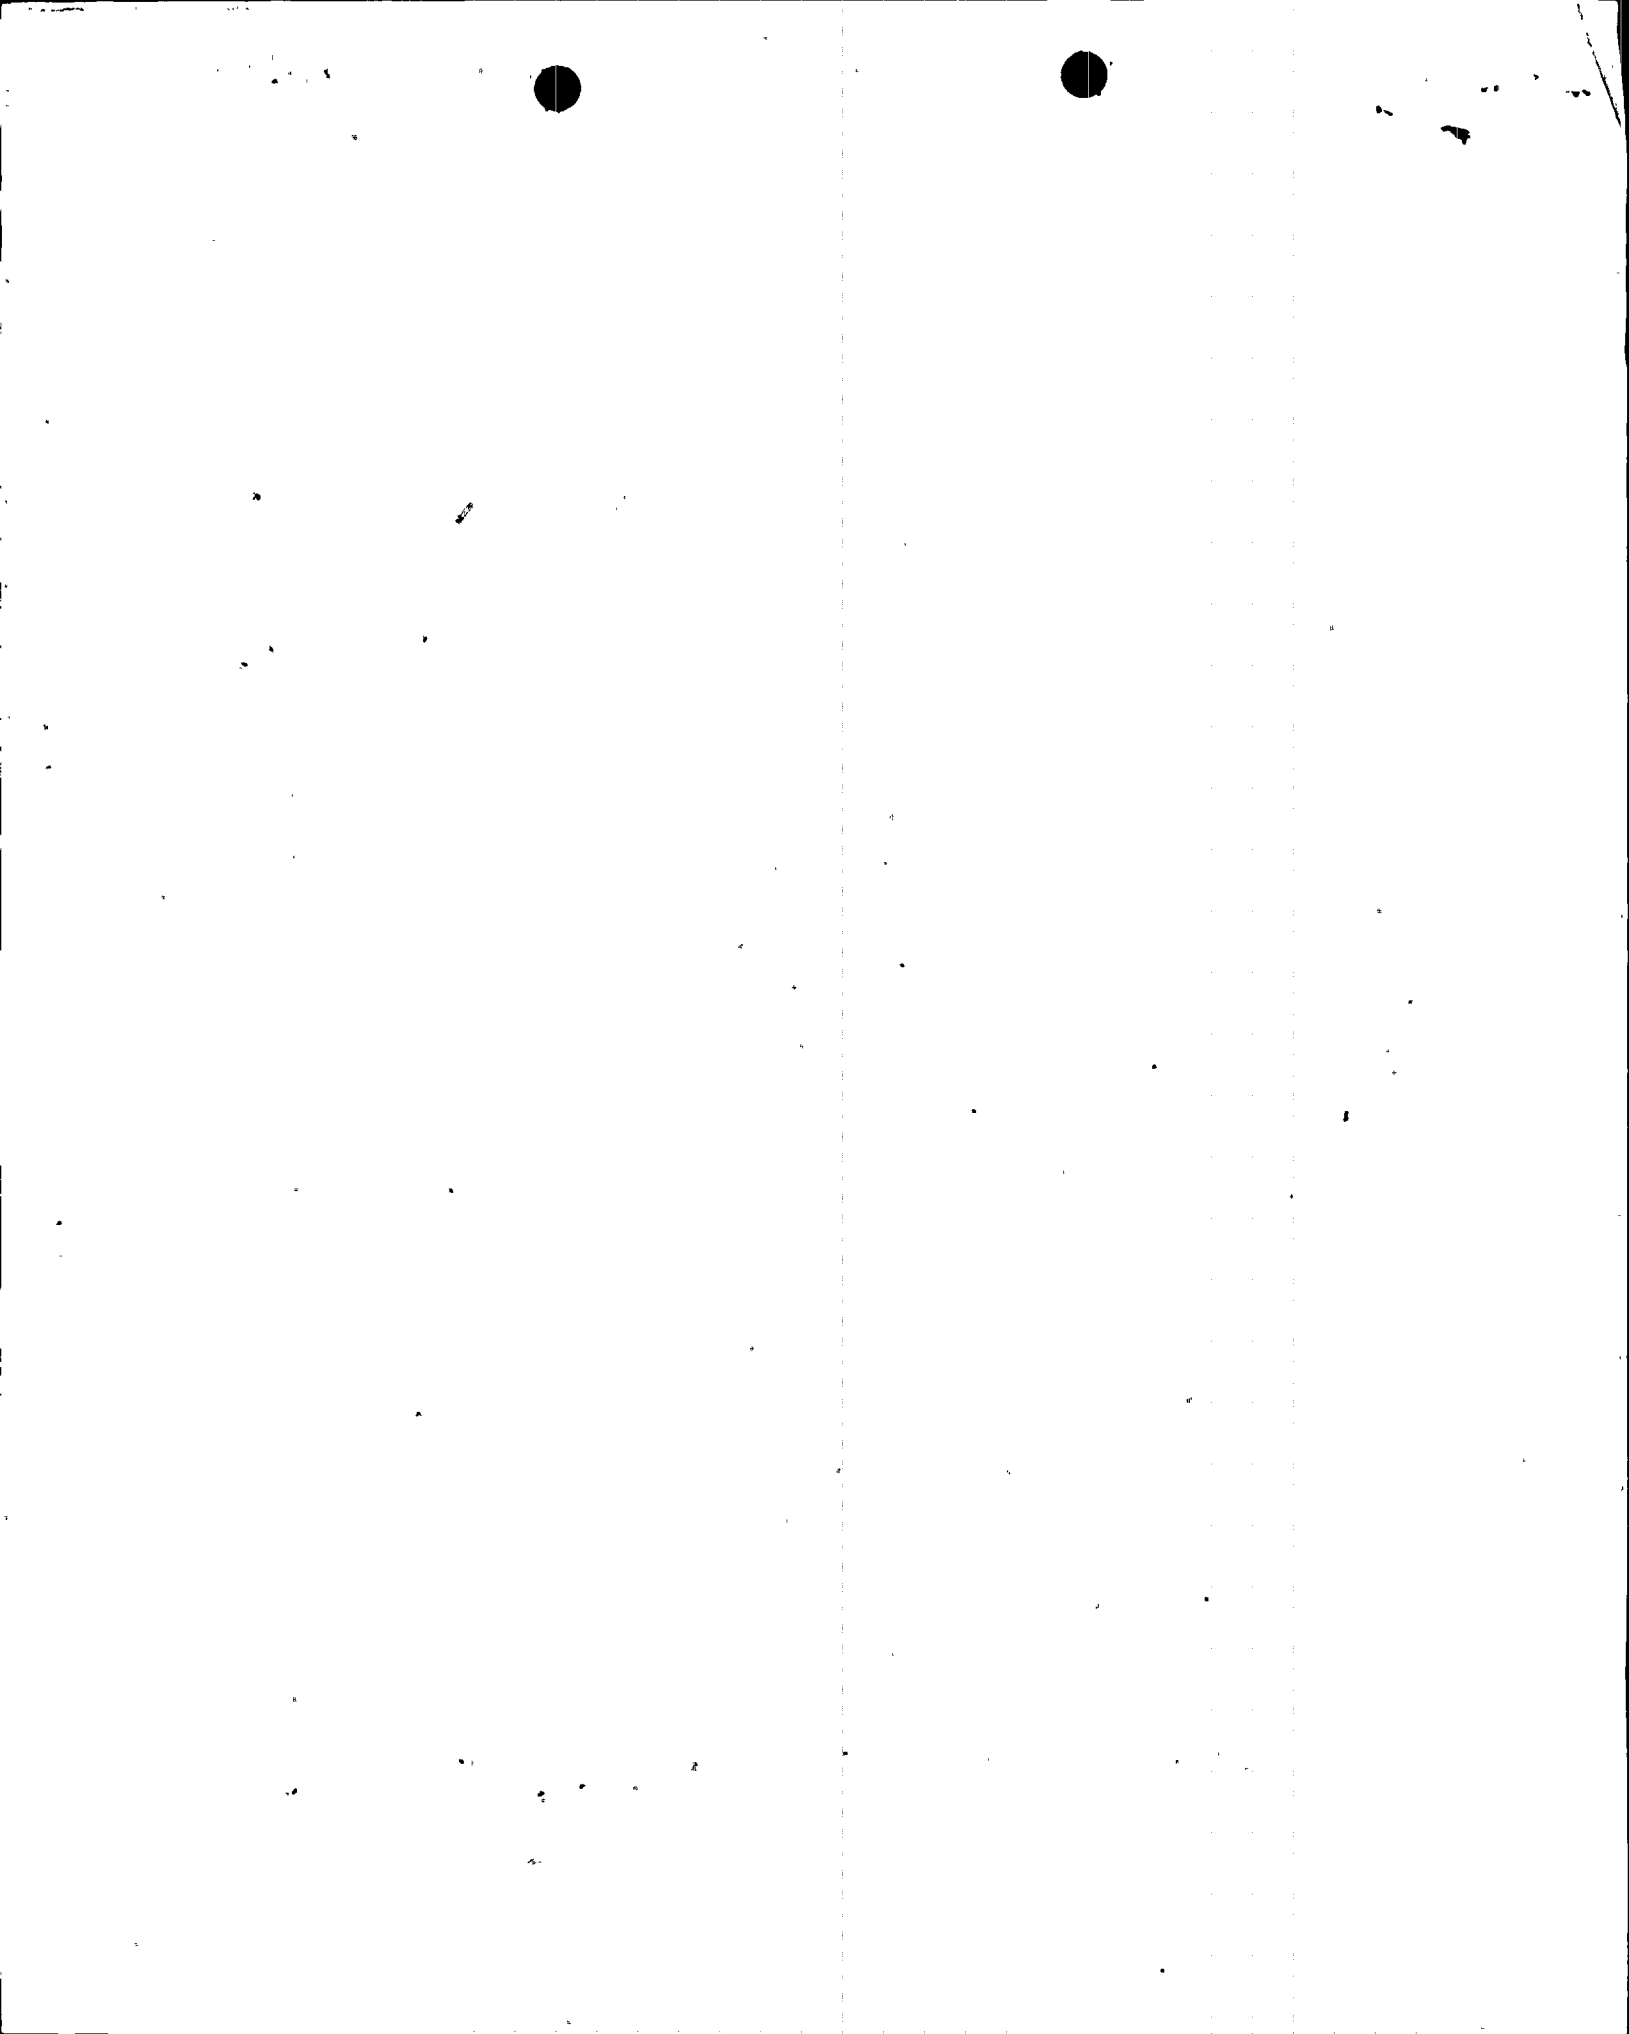
RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
PD5 LA	1	PD5 PD	1
CHAN,T	1	DAVIS,M.	1
INTERNAL: ACRS	1	NRR ROSS,T	1
NRR/DET/ECMB 9H	1	NUDOCS-ABSTRACT	1
REG FILE	1		
EXTERNAL: LPDR	1	NRC PDR	1
NSIC	1		
NOTES:	1		

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,  
 ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION  
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTTR 13 ENCL 1

MAH



Arizona Public Service Company

P.O. BOX 53999 • PHOENIX, ARIZONA 85072-3999

WILLIAM F. CONWAY  
EXECUTIVE VICE PRESIDENT  
NUCLEAR

161-02725-WFC/JST  
December 28, 1989

Docket Nos. STN 50-528/529/530

Document Control Desk  
U. S. Nuclear Regulatory Commission  
Mail Station P1-37  
Washington, D. C. 20555

Dear Sirs:

Subject: Palo Verde Nuclear Generating Station (PVNGS)  
Units 1, 2, and 3  
Generic Letter No. 89-10, "Safety Related Motor  
Operated Valve Testing and Surveillance"  
File: 89-056-026

Arizona Public Service Company has completed reviewing Generic Letter 89-10, "Safety Related Motor Operated Valve Testing and Surveillance." A multidiscipline Engineering Task Force has been formed to augment the current Palo Verde Motor Operated Valve Program to include the requirements of this Generic Letter. A schedule with the completion dates for requested actions in the Generic Letter will be prepared by June 28, 1990.

As motor operated valve performance data is obtained by Palo Verde and the Nuclear Industry the current assumptions of the Generic Letter may not be validated. In this case the commitment to testing every valve would not be necessary. Arizona Public Service will follow the progress of industry experience and evaluate the need for continued testing of motor operated valves on the basis of these and the Palo Verde test results. If findings in the industry and at Palo Verde indicate the testing outlined in Generic Letter 89-10 is not required to verify motor operated valve operability, this commitment to following the guidance in the Generic Letter will be revised.

Sincerely,



WFC/JST/jle

cc: T. L. Chan  
M. B. Davis  
J. B. Martin  
T. J. Polich  
A. C. Gehr  
A. H. Gutterman

9001050320 891228  
PDR ADDCK. 05000528  
P PNU

Aob4  
1/0



GA  
2  
2

1


476

2


161-02725-WFC/JST  
December 28, 1989

STATE OF ARIZONA     )  
                              ) ss.  
COUNTY OF MARICOPA   )

I, W. F. Conway, represent that I am Executive Vice President - Nuclear, that the foregoing document has been signed by me on behalf of Arizona Public Service Company with full authority to do so, that I have read such document and know its contents, and that to the best of my knowledge and belief, the statements made therein are true and correct.

  
\_\_\_\_\_  
W. F. Conway

Sworn to before me this 27<sup>th</sup> day of December, 1989.

  
\_\_\_\_\_  
Notary Public

My Commission Expires:

My Commission Expires June 5, 1992

