

# ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

## REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR:9001080075 DOC.DATE: 89/12/28 NOTARIZED: NO DOCKET #  
 FACIL:STN-50-529 Palo Verde Nuclear Station, Unit 2, Arizona Publi 05000529  
 AUTH.NAME AUTHOR AFFILIATION  
 LEVINE,J.M. Arizona Public Service Co. (formerly Arizona Nuclear Power  
 RECIP.NAME RECIPIENT AFFILIATION  
 Document Control Branch (Document Control Desk)

SUBJECT: Special Rept 2-SR-89-004, Suppl 1: on 890406, PASS inoperable  
 for greater than 7 days.

DISTRIBUTION CODE: IE22D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 3  
 TITLE: 50.73/50.9 Licensee Event Report (LER), Incident Rpt, etc.

NOTES: Standardized plant.

05000529

	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL		RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
	PD5 LA	1 1		PD5 PD	1 1
	CHAN, T	1 1		DAVIS, M.	1 1
INTERNAL:	ACRS MICHELSON	1 1		ACRS MOELLER	2 2
	ACRS WYLIE	1 1		AEOD/DOA	1 1
	AEOD/DSP/TPAB	1 1		AEOD/ROAB/DSP	2 2
	DEDRO	1 1		NRR/DET/ECMB 9H	1 1
	NRR/DET/EMEB9H3	1 1		NRR/DET/ESGB 8D	1 1
	NRR/DLPQ/LHFB11	1 1		NRR/DLPQ/LPEB10	1 1
	NRR/DOEA/OEAB11	1 1		NRR/DREP/PRPB11	2 2
	NRR/DST/SELB 8D	1 1		NRR/DST/SICB 7E	1 1
	NRR/DST/SPLB8D1	1 1		NRR/DST/SRXB 8E	1 1
	NUDOCS-ABSTRACT	1 1		<del>REG FILE 02</del>	1 1
	RES/DSIR/EIB	1 1		RGN5 FILE 01	1 1
EXTERNAL:	EG&G WILLIAMS, S	4 4		L ST LOBBY WARD	1 1
	LPDR	1 1		NRC PDR	1 1
	NSIC MAYS, G	1 1		NSIC MURPHY, G.A	1 1
	NUDOCS FULL TXT	1 1			
NOTES:		1 1			

### NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,  
 ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION  
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTTR 40 ENCL 40

IA2



**Arizona Public Service Company**

PALO VERDE NUCLEAR GENERATING STATION  
P.O. BOX 52034 • PHOENIX, ARIZONA 85072-2034

JAMES M. LEVINE  
VICE PRESIDENT  
NUCLEAR PRODUCTION

192-00610-JML/TDS/JEM  
December 28, 1989

U. S. Nuclear Regulatory Commission  
NRC Document Control Desk  
Washington, D.C. 20555

Dear Sirs:

Subject: Palo Verde Nuclear Generating Station (PVNGS)  
Unit 2  
Docket No. STN 50-529 (License No. NPF-51)  
Supplement to Special Report 2-SR-89-004  
File: 89-020-404

Attached please find Supplement Number 1 to Special Report 2-SR-89-004 prepared and submitted pursuant to Technical Specification 3.3.3.1 ACTION 28 and 6.9.2. This report discusses the Post Accident Sampling System being inoperable for more than 7 days. This Special Report is being supplemented to report the root cause of the event and any further corrective actions required.

If you have any questions, please contact T. D. Shriver, Compliance Manager, at (602) 393-2521.

Very truly yours,

*James M. Levine*  
For JML


JML/TDS/JEM/kj

Attachment

cc: W. F. Conway (all w/a)  
J. B. Martin  
T. J. Polich  
M. J. Davis  
A. C. Gehr

9001080075 891228  
PDR ADOCK 05000529  
S PDC

*TR22*  
11

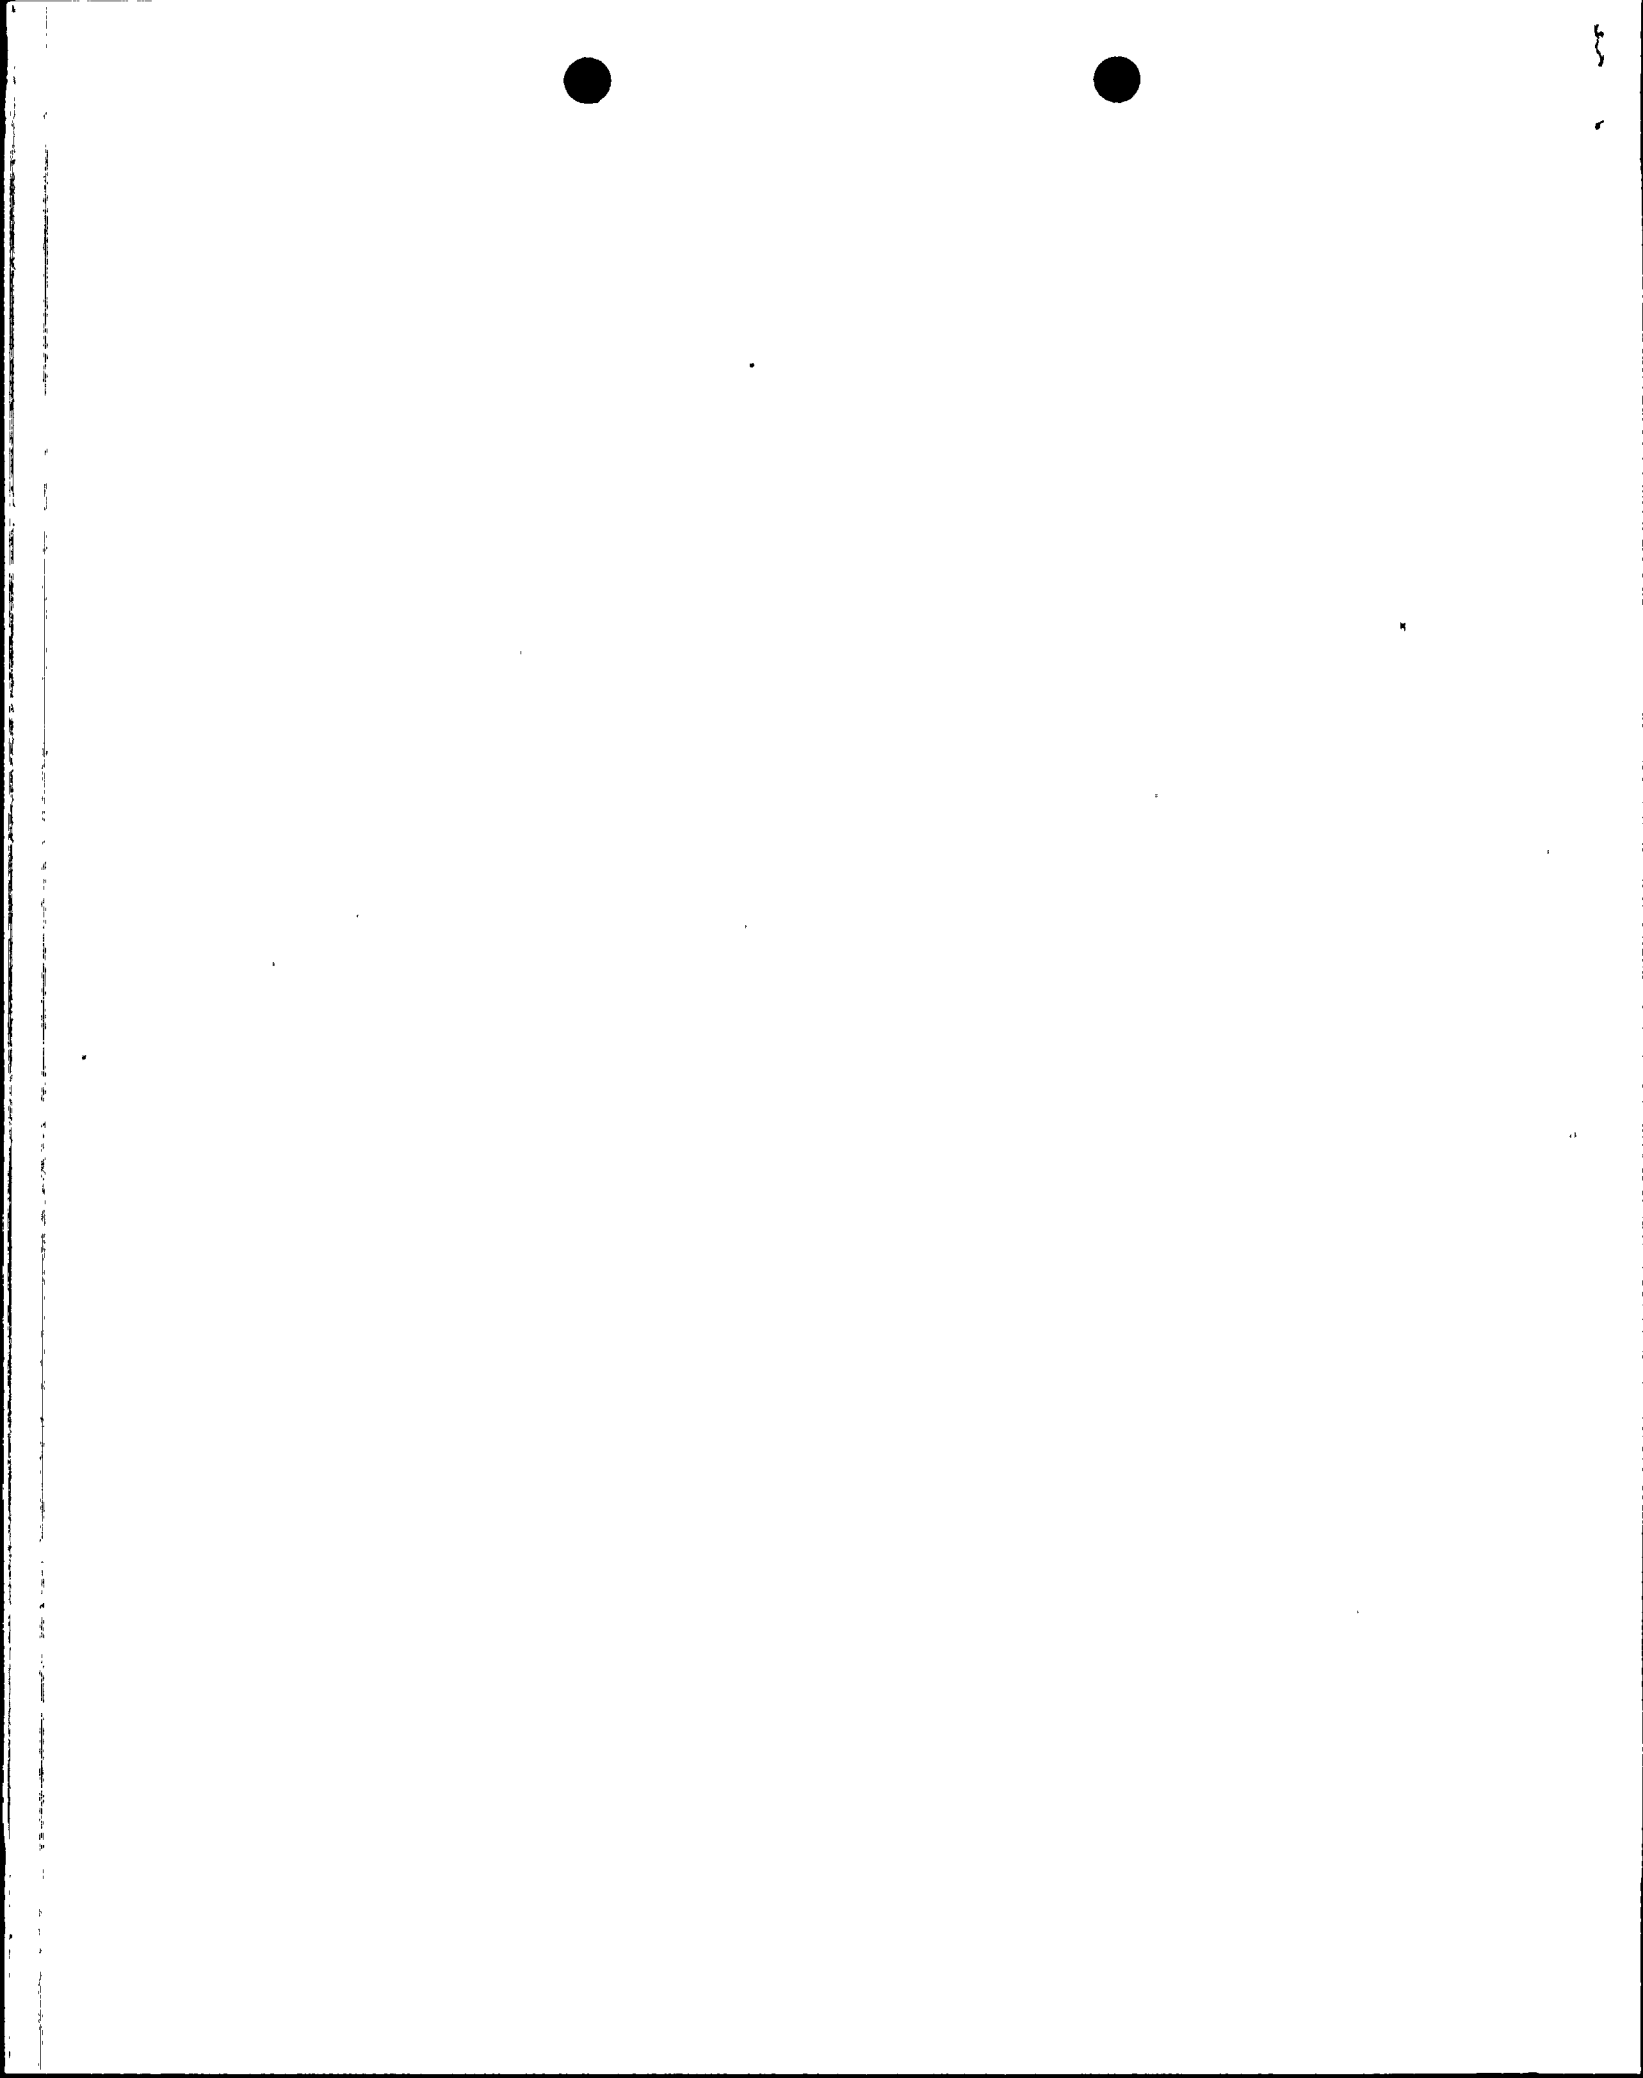

PALO VERDE NUCLEAR GENERATING STATION

PASS Inoperable for Greater Than 7 Days

License No. NPF-51

Docket No. 50-529

Special Report 2-SR-89-004-01

This Special Report is being submitted in accordance with Technical Specifications 3.3.3.1 ACTION 28-2 and 6.9.2 to report an event in which the Post Accident Sampling System (PASS) was inoperable for a period greater than 7 days. The 7 day limit for inoperability was exceeded at approximately 0800 MST on April 6, 1989.

At approximately 0800 MST on March 30, 1989, Palo Verde Unit 2 was in Mode 3 (HOT STANDBY) at approximately 565 degrees F Reactor Coolant System (RCS) temperature and approximately 2255 psia pressurizer pressure when PASS was declared inoperable due to the planned isolation of the demineralized water supply to PASS. In accordance with Technical Specification 3.3.3.1 ACTION 28-1 the Preplanned Alternate Sampling Program (PASP) was initiated at 1924 MST on April 3, 1989.

Prior to the event, at approximately 1630 MST on March 27, 1989, Palo Verde Unit 1 Chemistry personnel identified that a portion of the Demineralized Water System (DW) was contaminated. Subsequent investigation in Unit 1 identified backflow from the Reactor Coolant System Hot Leg Loop 1 sample line backwards through two (2) check valves and one (1) normally closed solenoid valve into the DW system. The DW system is connected into the RCS sample line to provide flush water for sample lines routed to the sample sink in the Chemistry Hot Laboratory. Flushing of the sample lines is to maintain radiation exposure As Low As Reasonably Achievable (ALARA) in the event that PASP is utilized for PASS.

On March 30, 1989, Unit 1 Operations personnel informed Units 2 and 3 personnel of the contamination of the Unit 1 DW lines. Unit 3 personnel investigated, but did not identify any contamination of the DW system. Unit 2 personnel investigated and identified contamination in the Unit 2 DW system. At approximately 0800 MST on March 30, 1989, Unit 2 personnel isolated the contaminated portion of the DW system by shutting isolation valve DWN-V-122. Shutting DWN-V-122 isolated several DW service lines including the DW supply to PASS and the DW supply to the RCS Hot Leg sample line that is used when PASP is being utilized. Unit 2 personnel determined that the valves in the DW supply line to PASP had leaked contaminated RCS back to the DW header. These valves were SSN-UV-564 (solenoid valve), SSN-V-856 (check valve), and SSN-V-857 (check valve). The DW supply line to PASS is required for operability of PASS, therefore, PASS was declared inoperable when DWN-V-122 was shut at approximately 0800 MST on March 30, 1989.

As an interim corrective action a Temporary Modification Request was approved on March 31, 1989. This modification isolates the DW system from the RCS Hot Leg sample line. This is accomplished by removing a section of the DW line



between the first check valve and the tee into the RCS sample line and then capping the two open ends of the line. The modification was completed in Unit 2 on April 9, 1989. After successful completion of Surveillance Test 74ST-2SS04 (PASS Functional Test) PASS was declared operable at 1140 MST on April 11, 1989. The modification was completed in Unit 1 on April 7, 1989 and in Unit 3 on May 7, 1989.

Additional sampling and analysis of the DW systems have been performed in Units 1, 2, and 3 since the modification was completed. No further radioactive contamination has been identified in the DW systems.

An engineering evaluation has determined the root cause of the event to be inadequate design. A Plant Change Request has been submitted to redesign the Nuclear Sampling system.

Additionally, an investigation is being performed to review other similar connections between contaminated systems and "clean" flushing water systems. This investigation will be conducted to determine if additional controls are required to preclude other situations of cross-contamination.

