

# ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

## REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 9001160197 DOC. DATE: 90/01/02 NOTARIZED: YES DOCKET #  
 FACIL: STN-50-528 Palo Verde Nuclear Station, Unit 1, Arizona Publi 05000528  
 STN-50-529 Palo Verde Nuclear Station, Unit 2, Arizona Publi 05000529  
 STN-50-530 Palo Verde Nuclear Station, Unit 3, Arizona Publi 05000530

AUTH. NAME AUTHOR AFFILIATION  
 CONWAY, W.F. Arizona Public Service Co. (formerly Arizona Nuclear Power  
 RECIP. NAME RECIPIENT AFFILIATION  
 Document Control Branch (Document Control Desk)

SUBJECT: Certifies that util implemented fitness for duty program, per  
 10CFR26.73.

DISTRIBUTION CODE: IE15D COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 2  
 TITLE: Fitness for Duty Inspection Report

NOTES: Standardized plant. 05000528  
 Standardized plant. 05000529  
 Standardized plant. 05000530


RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
PD5 LA	1 1	PD5 PD	1 1
CHAN, T	1 1	DAVIS, M.	1 1
INTERNAL: NRR/DRIS/RSGB9D	1 1	NUDOCS-ABSTRACT	1 1
REG FILE 01	1 1	RGN5 02	1 1
EXTERNAL: LPDR	1 1	NRC PDR	1 1
NSIC	1 1		
NOTES:	1 1		

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,  
 ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION  
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTTR 12 ENCL ~~12~~ 0

MA4

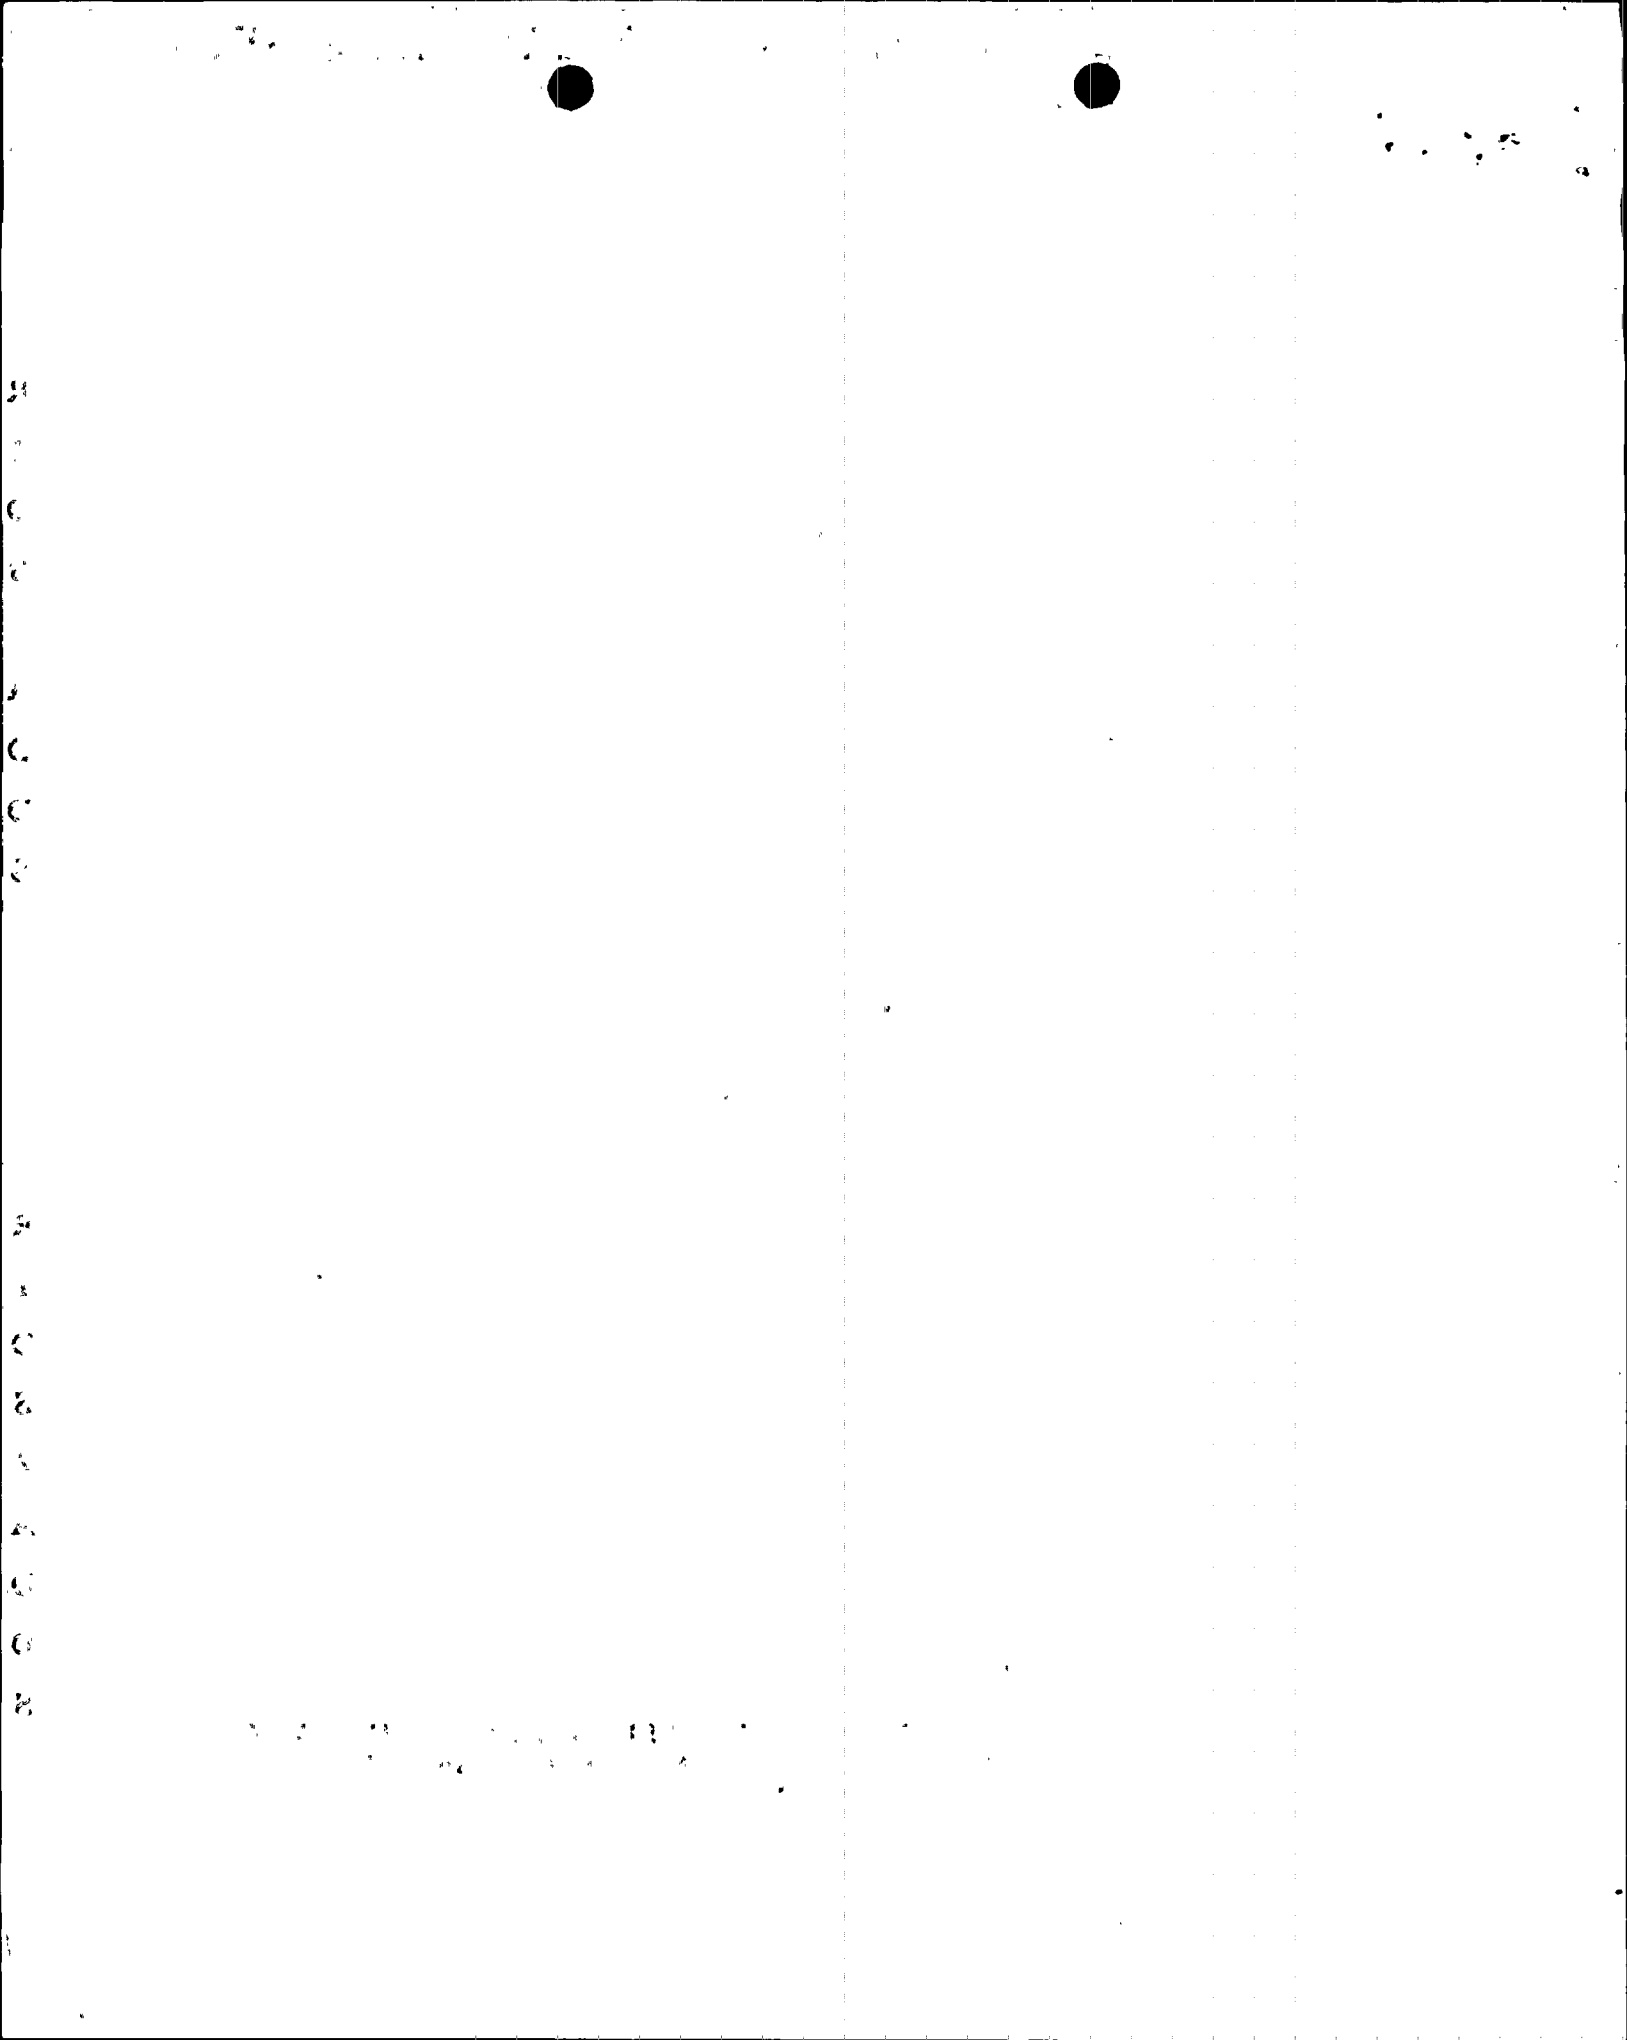

**Arizona Public Service Company**

P.O. BOX 53999 • PHOENIX, ARIZONA 85072-3999

**WILLIAM F. CONWAY**  
EXECUTIVE VICE PRESIDENT  
NUCLEAR

161-02731-WFC/SKW  
January 2, 1990

Docket Nos. STN 50-528/529/530

Document Control Desk  
U. S. Nuclear Regulatory Commission  
Mail Station P1-37  
Washington, D. C. 20555

Dear Sirs:

Subject: Palo Verde Nuclear Generating Station (PVNGS)  
Units 1, 2, & 3  
Fitness for Duty Implementation  
File: 89-056-026

This letter certifies in accordance with 10 CFR 26.73 Palo Verde Nuclear Generating Station (PVNGS) has implemented the Fitness for Duty program. PVNGS has more stringent cutoff levels for marijuana metabolites and amphetamines. The marijuana metabolites cutoff level for PVNGS is 20 ng/ml. The cutoff level at PVNGS for amphetamines is 300 ng/ml.

Please contact A. C. Rogers of my staff at (602) 340-4041 for any questions.


Sincerely,




WFC/SKW/jle

cc: G. W. Knighton  
T. L. Chan  
M. J. Davis  
J. B. Martin  
T. J. Polich  
A. H. Gutterman

9001160197 900102  
PDR ADOCK 05000528  
P PDC



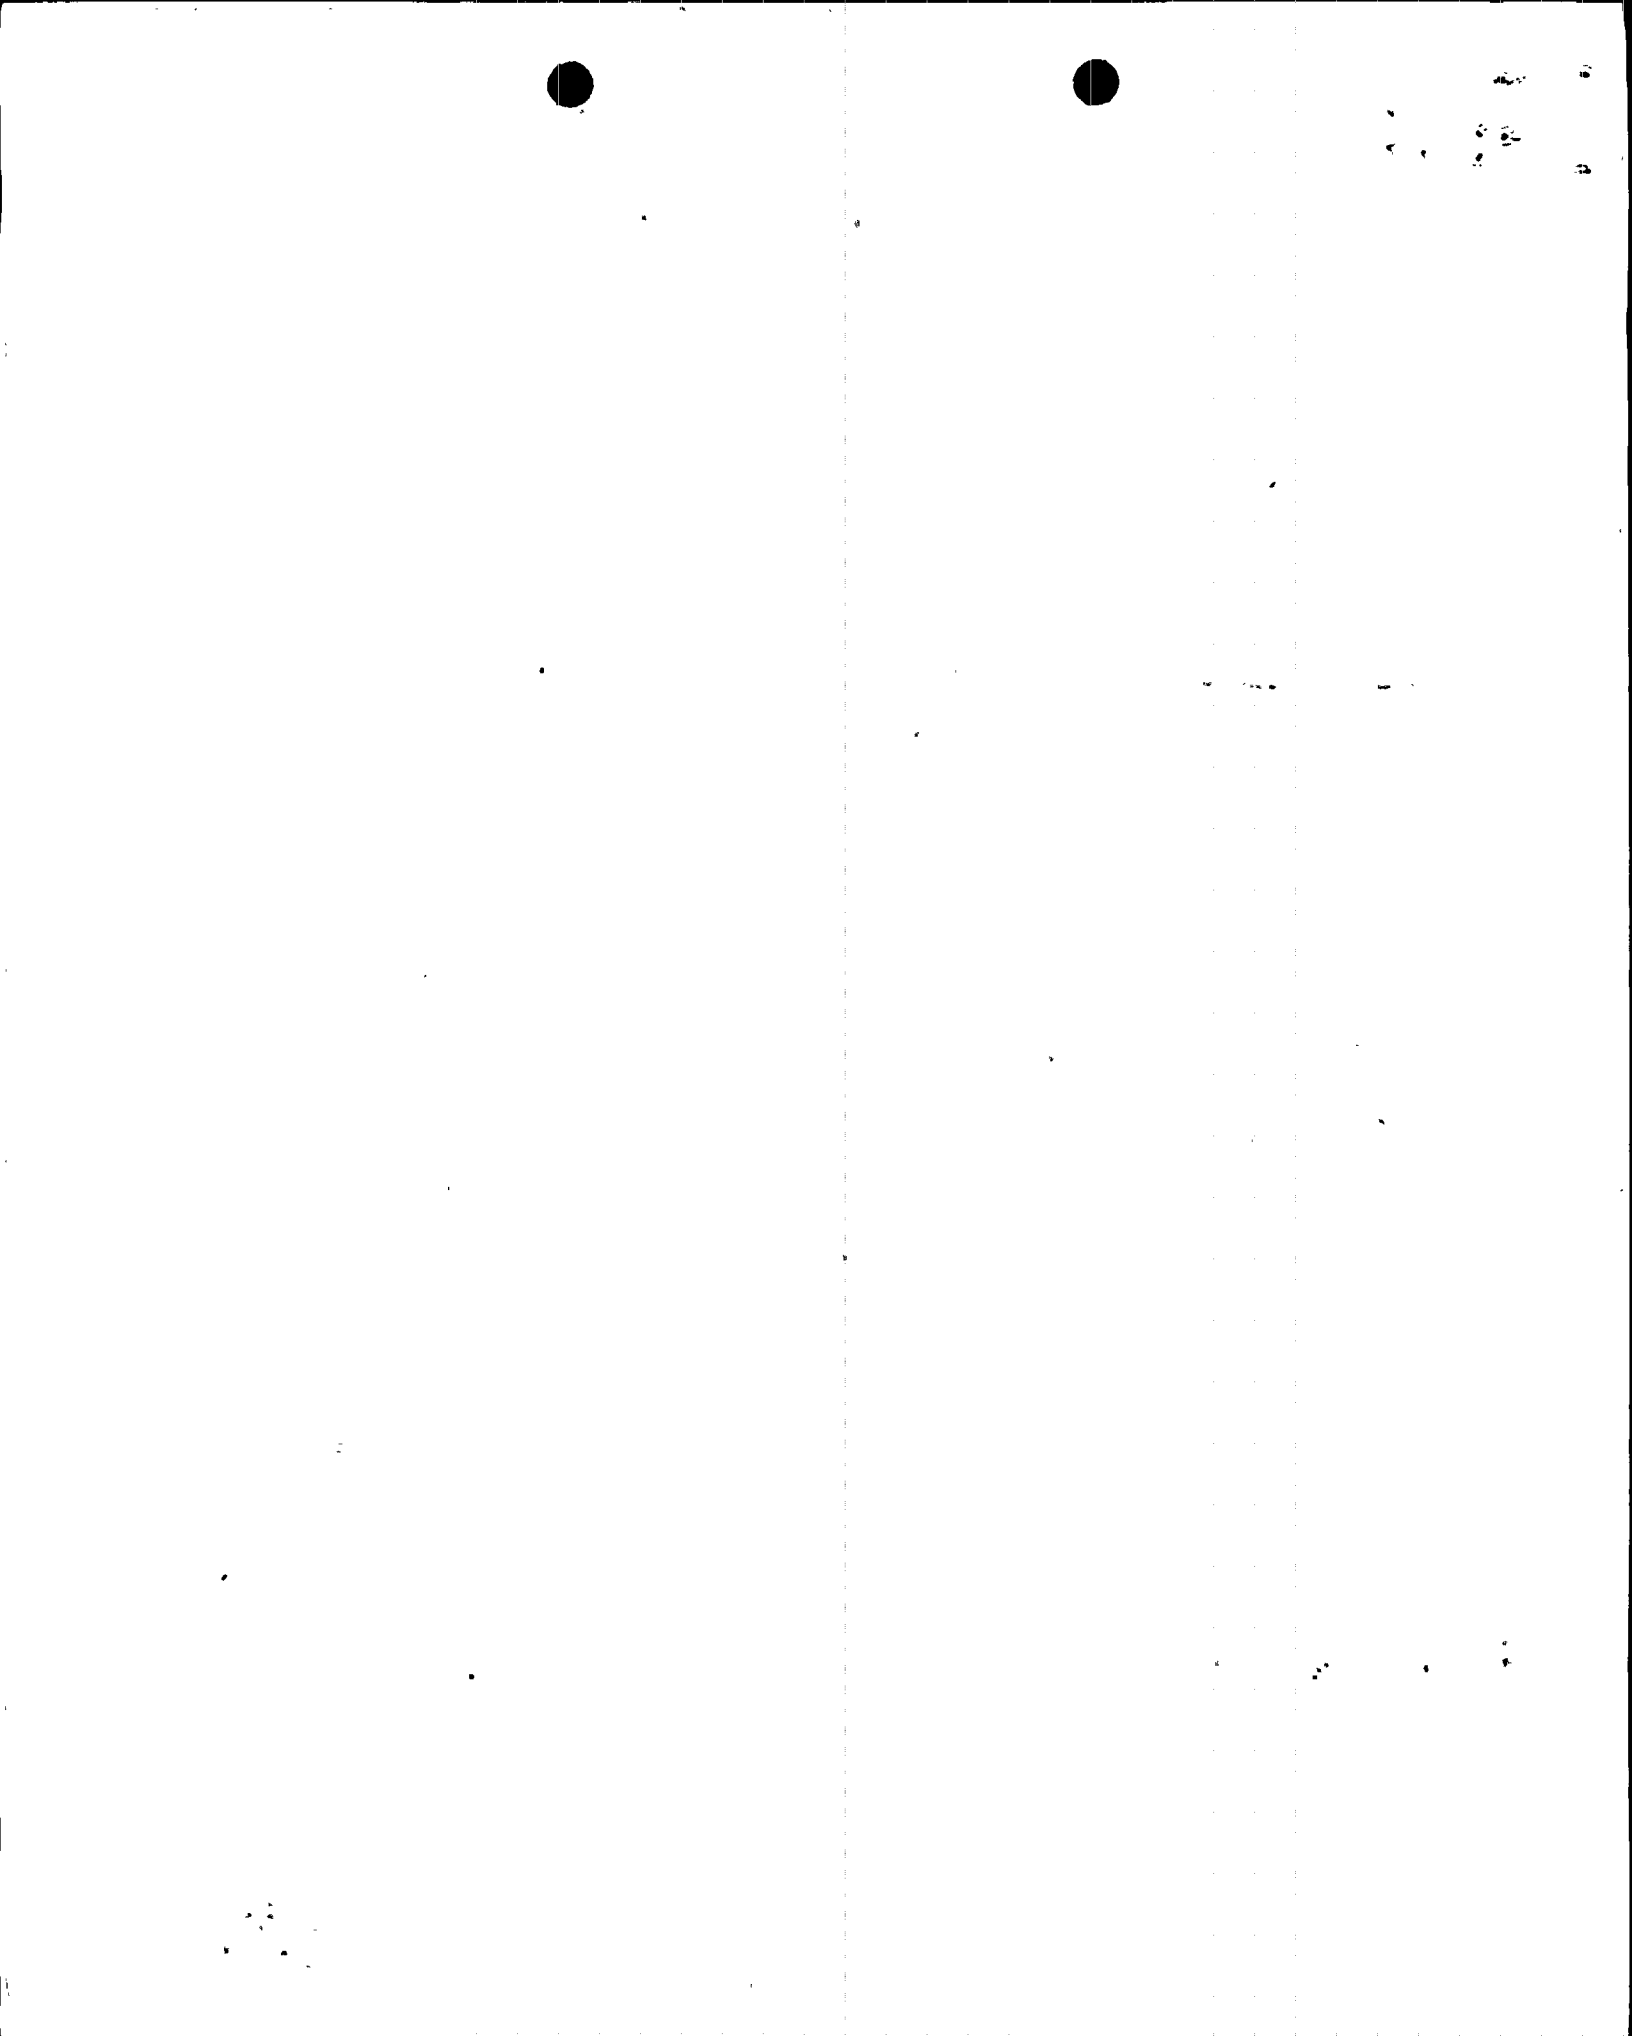

STATE OF ARIZONA     )  
                              ) ss.  
COUNTY OF MARICOPA. )

I, W. F. Conway, represent that I am Executive Vice President - Nuclear, that the foregoing document has been signed by me on behalf of Arizona Public Service Company with full authority to do so, that I have read such document and know its contents, and that to the best of my knowledge and belief, the statements made therein are true and correct.

W. F. Conway  
W. F. Conway

Sworn to before me this 2<sup>ND</sup> day of January, 1990.

Linda B. Spell  
Notary Public

My Commission Expires:

My Commission Expires June 5, 1992

