FOR INFORMATION ONLY

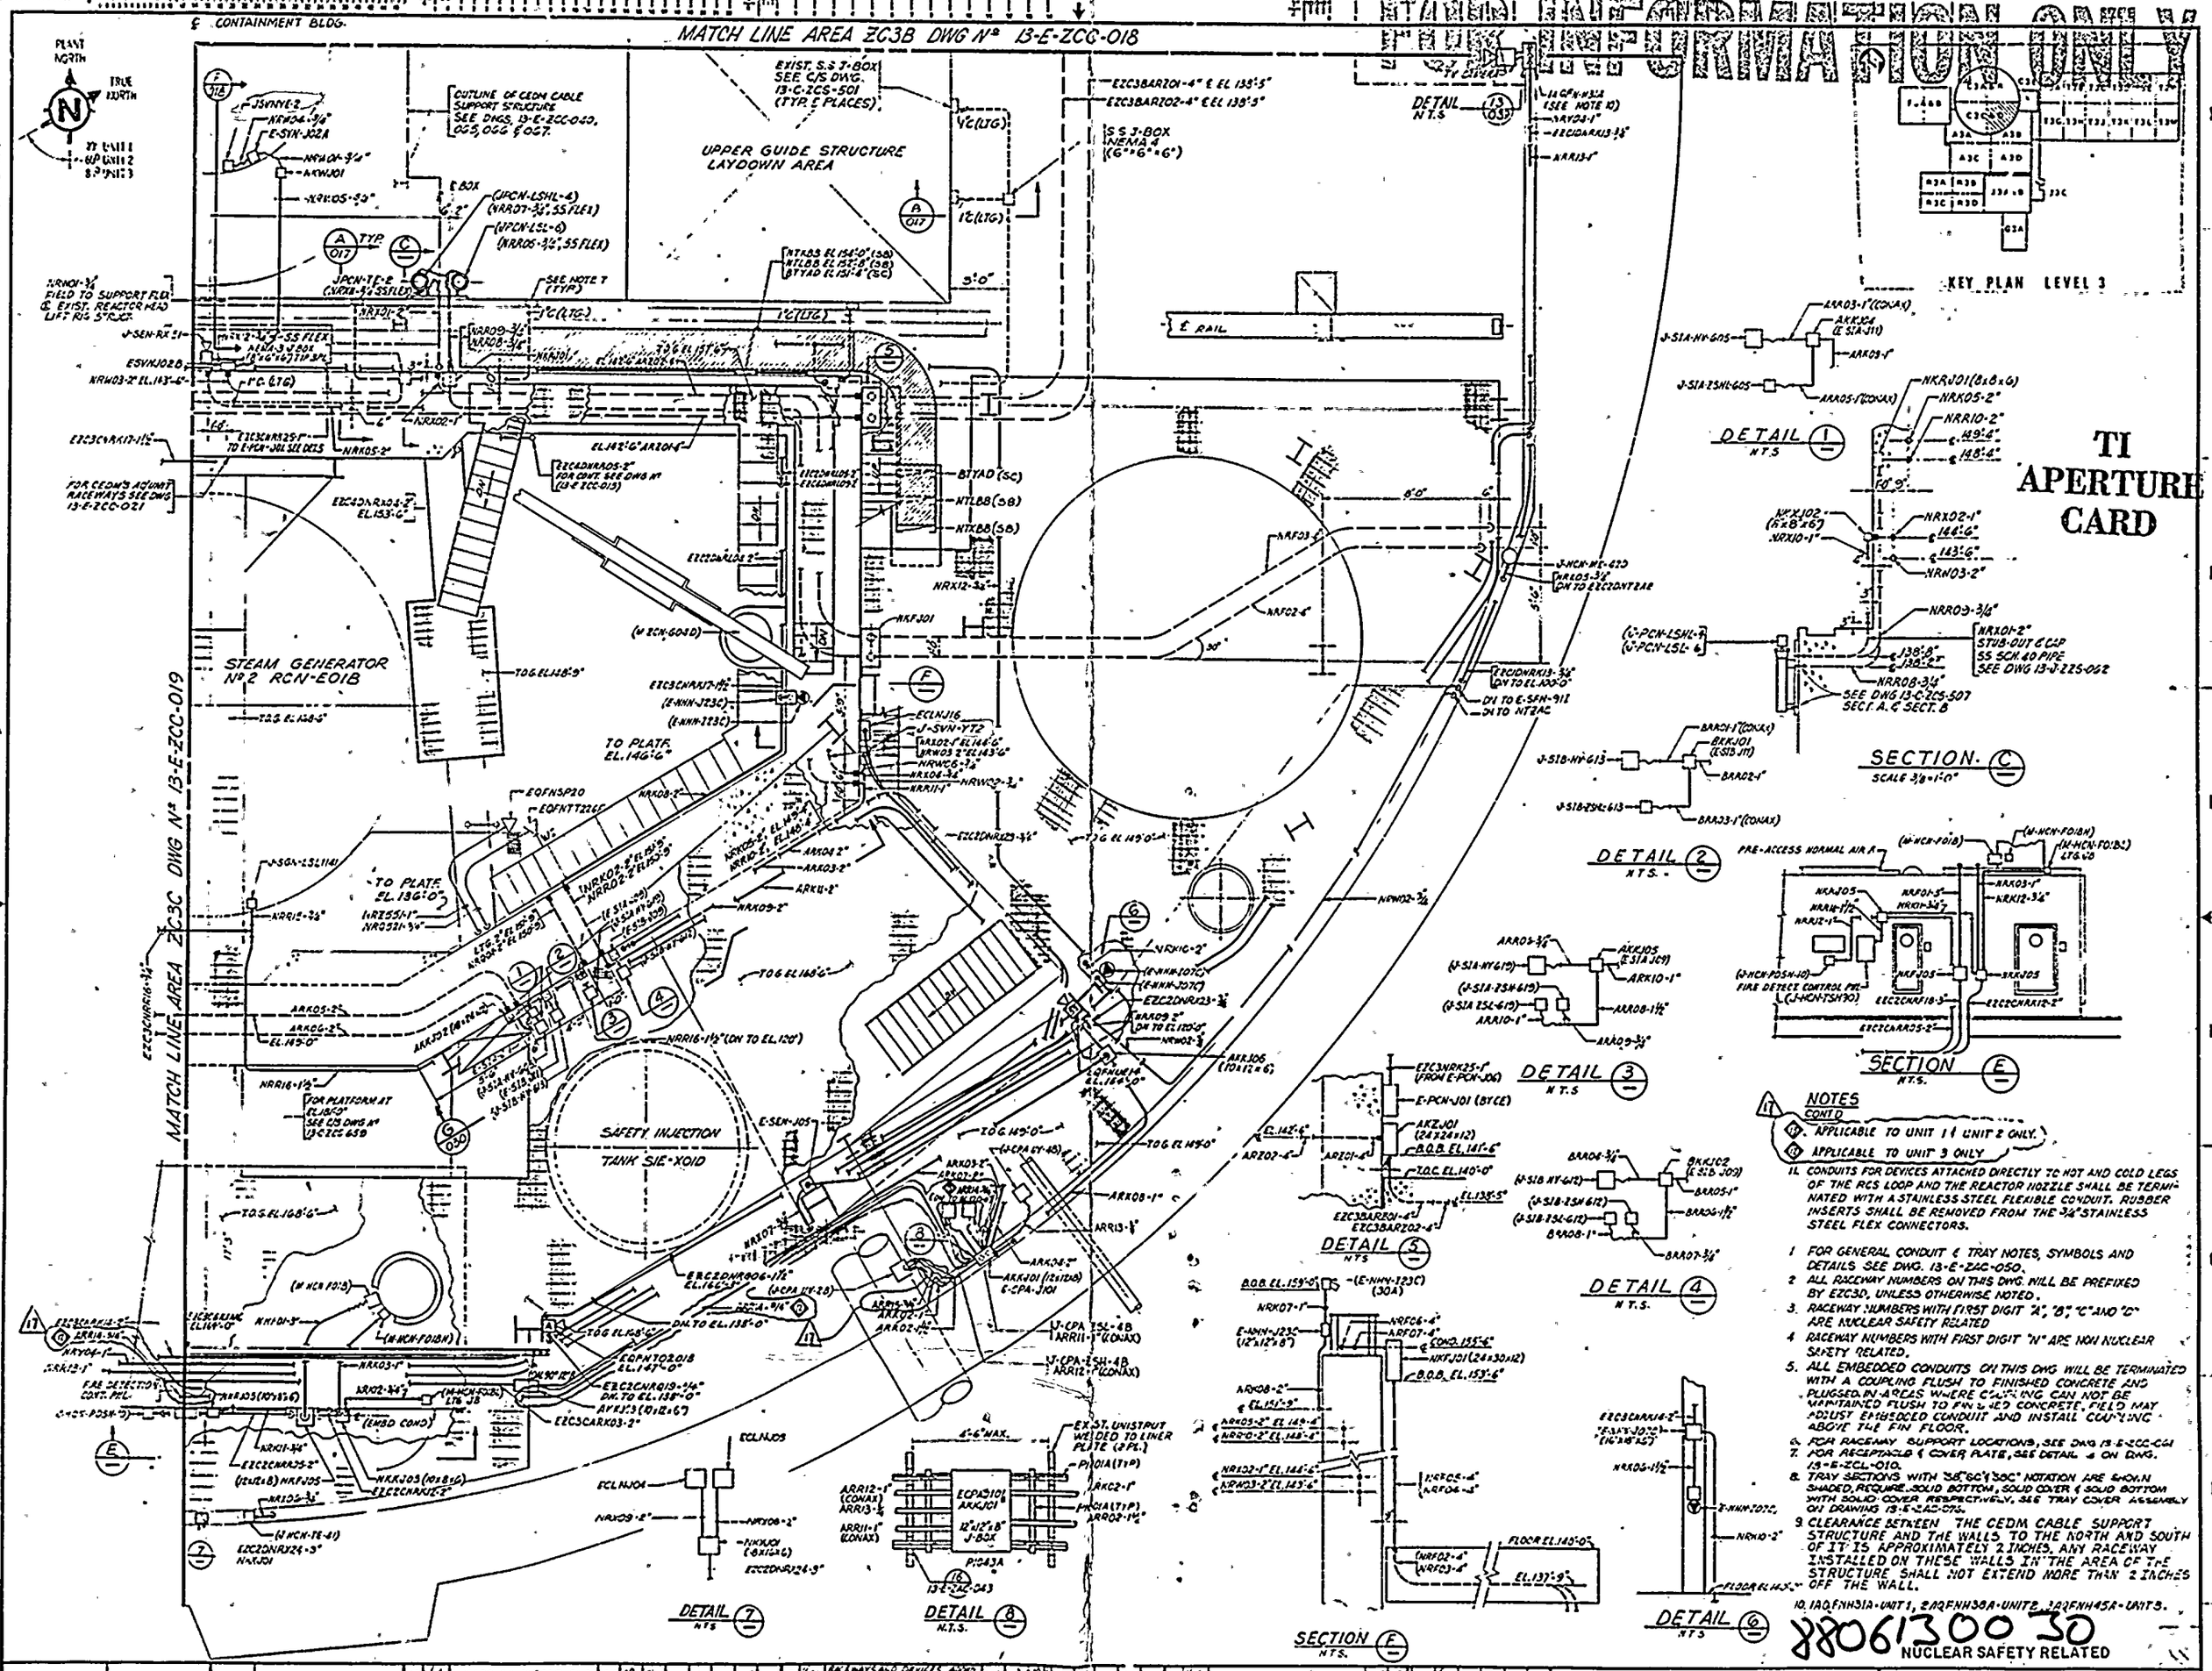

TI APERTURE CARD

NOTES CONT'D

12. APPLICABLE TO UNIT 1 & UNIT 2 ONLY.
13. APPLICABLE TO UNIT 3 ONLY

11. CONDUITS FOR DEVICES ATTACHED DIRECTLY TO HOT AND COLD LEGS OF THE RCS LOOP AND THE REACTOR NOZZLE SHALL BE TERMINATED WITH A STAINLESS STEEL FLEXIBLE CONDUIT. RUBBER INSERTS SHALL BE REMOVED FROM THE 3/4" STAINLESS STEEL FLEX CONNECTORS.

1. FOR GENERAL CONDUIT & TRAY NOTES, SYMBOLS AND DETAILS SEE DWG. 13-E-ZAC-050.
2. ALL RACEWAY NUMBERS ON THIS DWG. WILL BE PREFIXED BY EZC3D, UNLESS OTHERWISE NOTED.
3. RACEWAY NUMBERS WITH FIRST DIGIT "A", "B", "C" AND "D" ARE NUCLEAR SAFETY RELATED
4. RACEWAY NUMBERS WITH FIRST DIGIT "N" ARE NON NUCLEAR SAFETY RELATED.
5. ALL EMBEDDED CONDUITS ON THIS DWG WILL BE TERMINATED WITH A COUPLING FLUSH TO FINISHED CONCRETE AND PLUGGED IN AREAS WHERE COUPLING CAN NOT BE MAINTAINED FLUSH TO FINISHED CONCRETE. FIELD MAY ADJUST EMBEDDED CONDUIT AND INSTALL COUPLING ABOVE THE FIN FLOOR.
6. FOR RACEWAY SUPPORT LOCATIONS, SEE DWG 13-E-ZCC-041
7. FOR RECEPTACLE & COVER PLATE, SEE DETAIL 4 ON DWG. 13-E-ZCL-010.
8. TRAY SECTIONS WITH "SE" & "SC" NOTATION ARE SHOWN SHADED. REQUIRE SOLID BOTTOM, SOLID COVER & SOLID BOTTOM WITH SOLID COVER RESPECTIVELY. SEE TRAY COVER ASSEMBLY ON DRAWING 13-E-ZAC-036.
9. CLEARANCE BETWEEN THE CEDM CABLE SUPPORT STRUCTURE AND THE WALLS TO THE NORTH AND SOUTH OF IT IS APPROXIMATELY 2 INCHES. ANY RACEWAY INSTALLED ON THESE WALLS IN THE AREA OF THE STRUCTURE SHALL NOT EXTEND MORE THAN 2 INCHES OFF THE WALL.
10. 1A0FNH31A-UNIT 1, 2A0FNH38A-UNIT 2, 3A0FNH45A-UNIT 3.

8806130030

NUCLEAR SAFETY RELATED

NO.	DATE	REVISIONS	DR	CHK	DGS	ENG	CHF ENG	PRJ ENG
13	1/1	INCORP. DCN'S #28 THRU 32	AK			—		
12		INCORP. DCN'S #21 THRU 27				—		
11		INCORP. DCN'S #16 THRU 20				—		
10	1/1	INCORP. DCN'S #14 & 15				—		
9		INCORP DCN'S #10, 11, & 12				—		
8		RACEWAYS AND DEVICES ADDED AND MISC. CHANGES AS INDICATED				—		
7		INCORP DCN'S 9 AND MISC. CHANGES AS INDICATED				—		
6		[illegible]				—		
5		INCORP. DCN #1 & 8; ADDED PA COMM. SYSTEM				—		
4		[illegible]				—		
17		INCORP DCN #39 [illegible]				—		
16		[illegible]				—		
15		INCORP. DCN'S #37 & 38.				—		
14		INCORP. DCN'S #33 THRU 36.				—		
0		ISSUED FOR CONSTRUCTION EMBEDDED CONDUIT ONLY				—		

DWG. NO.	REFERENCE
REV 16 BY 11360	
REVIS BY 12245	
REV 14 SUBSEQUENT REVS. BY 14503	
REV 13 & SUBSEQUENT REVS. BY 8831	
REV 12 & SUBSEQUENT REVS. BY 7875	
REV 1 & SUBSEQUENT REVISIONS BY 7875	

BECHTEL
LOS ANGELES

ARIZONA NUCLEAR POWER PROJECT
PALO VERDE NUCLEAR GENERATING STATION

CONTAINMENT BLDG CONDUIT & TRAY PLAN AT EL. 140 FT LEVEL 3 ZC3D

SCALE 3/8"=1'-0"	JOB NO.	DRAWING NO.	REV.
ENGINEER	10407	13-E-ZCC-020	17

This drawing and the specific design depicted thereon for any purpose other than that related to the Arizona Nuclear Power Project is not authorized by the Owners. Use of this drawing by Bechtel and its parties, and by the PARTICIPANTS on the ARIZONA NUCLEAR POWER PROJECT is the property of the PARTICIPANTS.