

ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR:8904260357 DOC.DATE: 89/04/18 NOTARIZED: NO DOCKET #
 FACIL:STN-50-528 Palo Verde Nuclear Station, Unit 1, Arizona Publi 05000528
 STN-50-529 Palo Verde Nuclear Station, Unit 2, Arizona Publi 05000529
 STN-50-530 Palo Verde Nuclear Station, Unit 3, Arizona Publi 05000530

AUTH.NAME AUTHOR AFFILIATION
 KARNER,D.B. Arizona Nuclear Power Project (formerly Arizona Public Serv
 RECIPIENT AFFILIATION
 MURLEY,T.E. Office of Nuclear Reactor Regulation, Director (Post 870411

SUBJECT: Forwards status rept re implementation of TMI action plan items.

DISTRIBUTION CODE: A046D COPIES RECEIVED:LTR 1 ENCL 1 SIZE: 8
 TITLE: OR Submittal: TMI Action Plan Rgmt NUREG-0737 & NUREG-0660

NOTES:Standardized plant.
 Standardized plant.
 Standardized plant.

05000528/
 05000529
 05000530A

RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
PD5 LA	1 0	PD5 PD	5 5
CHAN,T	1 1	DAVIS,M	1 1
DAVIS,M.J.	1 1		
INTERNAL: ACRS	6 6	AEOD/DSP/TPAB	1 1
NRR/DEST/ADS 7E	1 0	NRR/DEST/MEB 9H	1 1
NRR/DREP/EPB 10	1 1	NRR/DREP/RPB 10	1 1
NUDOCS-ABSTRACT	1 1	OC/LEMB	1 0
OGC/HDS1	1 0	REG FILE 01	1 1
RES/DSIR/EIB	1 1	RES/DSR DEPY	1 1
EXTERNAL: LPDR	1 1	NRC PDR	1 1
NSIC	1 1		
NOTES:	1 1		

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,
 ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTTR 30 ENCL 26



Arizona Nuclear Power Project

P.O. BOX 52034 • PHOENIX, ARIZONA 85072-2034

161-01849-DBK/GEC

April 18, 1989

Docket Nos. STN 50-528/529/530

Mr. Thomas E. Murley, Director
Office of Nuclear Reactor Regulation
U. S. Nuclear Regulatory Commission
Mail Station 12 G18
Washington, D. C. 20555

References: (A) Letter from T. E. Murley, NRR, to
D. B. Karner, APS, dated April 14, 1989,
Subject: Request for Status of Implementation
of TMI Action Plan Items at PVNGS

Dear Sir:

Subject: Palo Verde Nuclear Generating Station (PVNGS)
Units 1, 2, and 3
Status of Implementation of TMI Action Plan Items
File: 89-A-056-026

In response to Reference (A), please find attached a report of the Status of Implementation of TMI Action Plan Items for PVNGS. The Licensee Implementation Status column of the attachment to Reference (A) has been completed in accordance with the instructions provided as part of the enclosure, to reflect the current status of each item to the best of my knowledge.

If you have any questions, please contact Mr. A. C. Rogers of my staff at (602) 371-4041.

Very truly yours,

D. B. Karner
Executive Vice President

DBK/GEC/jle

Attachment

cc: G. W. Knighton (all w/attachment)
M. L. Davis
T. L. Chan
J. B. Martin
T. J. Polich

8904260357 890418
PDR ADOCK 05000528
P PDC


A046
1/1

STATE OF ARIZONA)
) ss.
COUNTY OF MARICOPA)

I, Donald B. Karner, represent that I am Executive Vice President of Arizona Nuclear Power Project, that the foregoing document has been signed by me on behalf of Arizona Public Service Company with full authority to do so, that I have read such document and know its contents, and that to the best of my knowledge and belief, the statements made therein are true.


Donald B. Karner

Sworn to before me this 18 day of APRIL, 1989.


Notary Public

My Commission Expires:

My Commission Expires Jan. 23, 1991

THE
FEDERAL
BUREAU OF INVESTIGATION
UNITED STATES DEPARTMENT OF JUSTICE
WASHINGTON, D. C. 20535



STATUS OF IMPLEMENTATION OF TMI ACTION PLAN ITEMS FOR PVNGS

ISSUE NUMBER	MULTI-PLANT ACTION NO.	ISSUE TITLE	LICENSEE IMPLEMENTATION STATUS
I.A.1.1.1		SHIFT TECHNICAL ADVISOR - ON DUTY.....	C
*I.A.1.1.2		SHIFT TECHNICAL ADVISOR - TECH SPECS.....	N/A
*I.A.1.1.3	F001	SHIFT TECHNICAL ADVISOR - TRAINED PER LL CAT B.....	C
*I.A.1.1.4		SHIFT TECHNICAL ADVISOR - DESCRIBE LONG TERM PROGRAM.....	C
I.A.1.2		SHIFT SUPERVISOR RESPONSIBILITIES.....	C
I.A.1.3.1	F002	SHIFT MANNING - LIMIT OVERTIMES.....	C
I.A.1.3.2	F002	SHIFT MANNING - MIN SHIFT CREW.....	C
I.A.2.1.1		IMMEDIATE UPGRADING OF RO & SRO TRAINING AND QUAL. - SRO EXPER.....	C
I.A.2.1.2		IMMEDIATE UPGRADING OF RO & SRO TRAINING AND QUAL. - SRO'S BE RO'S 1YR.....	C
I.A.2.1.3		IMMEDIATE UPGRADING OF RO & SRO TRAINING AND QUAL. - 3 MO. TRAINING.....	C
I.A.2.1.4	F003	IMMEDIATE UPGRADING OF RO & SRO TRAINING AND QUAL. - MODIFY TRAINING.....	C
I.A.2.1.5		IMMEDIATE UPGRADING OF RO & SRO TRAINING AND QUAL. - FACILITY CERTIF.....	C
I.A.2.3		ADMINISTRATION OF TRAINING PROGRAMS.....	C
I.A.3.1.1		REVISE SCOPE & CRITERIA FOR LICENSING EXAMS - INCREASE SCOPE.....	C
I.A.3.1.2		REVISE SCOPE & CRITERIA FOR LICENSING EXAMS - INCREASE PASSING GRADE.....	C
I.A.3.1.3.A		REVISE SCOPE & CRIT. FOR LIC. EXAMS - SIMULATOR PLANTS WITH SIMULATORS.....	C
I.A.3.1.3.B		REVISE SCOPE & CRIT. FOR LIC. EXAMS - SIMULATOR - OTHER PLANTS.....	N/A
*I.B.1.2		EVALUATION OF ORGANIZATION & MANAGEMENT.....	C
I.C.1.1		SHORT-TERM ACCIDENT & PROCEDURES REVIEW - SB LOCA.....	C
I.C.1.2.A	F004	SHORT-TERM ACCID. & PROCEDURES REV. - INADEQ. CORE COOL. REANAL. GUIDELINES.....	C
I.C.1.2.B	F004	SHORT-TERM ACCID. & PROCEDURES REV. - INADEQ. CORE COOL. REVISE PROCEDURES.....	C
I.C.1.3.A	F005	SHORT-TERM ACCID. & PROCEDURES REV. - TRANSIENTS & ACCDTS. REANAL GUIDELINES (PROC. GEN. PKG.).....	C
I.C.1.3.B	F005	SHORT-TERM ACCID. & PROCEDURES REV. - TRANSIENTS & ACCDTS. REVISE PROCEDURES (UPGRADED EOP's).....	C
I.C.2		SHIFT & RELIEF TURNOVER PROCEDURES.....	C
I.C.3		SHIFT-SUPERVISOR RESPONSIBILITY.....	C
I.C.4		CONTROL-ROOM ACCESS.....	C
I.C.5	F006	FEEDBACK OF OPERATING EXPERIENCE.....	C
I.C.6	F007	VERIFY CORRECT PERFORMANCE OF OPERATING ACTIVITIES.....	C
*I.C.7.1		NSSS VENDOR REV. OF PROC - LOW POWER TEST PROGRAM.....	C
*I.C.7.2		NSSS VENDOR REV. OF PROC - POWER ASCENSION & ENGR. PROCS.....	C
*I.C.8		PILOT NON OF SELECTED EMERGENCY PROC FOR NTOLS.....	C
I.B.1	(See F008 & F071)	CONTROL-ROOM DESIGN REVIEWS (ENTER DATA FOR MPA F008 AND MPA F-071).....	C
I.B.2.1	F009	PLANT-SAFETY PARAMETER DISPLAY CONSOLE - DESCRIPTION.....	C

1684K/0060K

STATUS OF IMPLEMENTATION OF TMI ACTION PLAN ITEMS FOR PVNGS

ISSUE NUMBER	MULTI-PLANT ACTION NO.	ISSUE TITLE	LICENSEE IMPLEMENTATION STATUS
I.D.2.2	F009	PLANT-SAFETY PARAMETER DISPLAY CONSOLE - INSTALLED.....	C
I.D.2.3	F009	PLANT-SAFETY PARAMETER DISPLAY CONSOLE - FULLY IMPLEMENTED.....	C
*I.G.1.1		TRAINING DURING LOW-POWER TESTING - PURPOSE TESTS.....	C
*I.G.1.2		TRAINING DURING LOW-POWER TESTING - SUBMIT ANAL. & PROCS.....	C
*I.G.1.3		TRAINING DURING LOW-POWER TESTING - TRAINING & RESULTS.....	C
II.B.1.1		REACTOR-COOLANT SYSTEM VENTS - DESIGN VENTS.....	C
II.B.1.2	F010	REACTOR-COOLANT SYSTEM VENTS - INSTALL VENTS (LL CAT B).....	C
II.B.1.3	F010	REACTOR-COOLANT SYSTEM VENTS - PROCEDURES.....	C
II.B.2.1		PLANT SHIELDING - REVIEW DESIGNS.....	C
*II.B.2.2		PLANT SHIELDING - CORRECTIVE ACTIONS TO ASSURE ACCESS.....	C
*II.B.2.3	F011	PLANT SHIELDING - PLANT MODIFICATIONS (LL CAT B).....	C
*II.B.2.4		PLANT SHIELDING - EQUIPMENT QUALIFICATIONS - NOT TRACKED AS A TMI ACTION ITEM....	C
*II.B.3.1		POST ACCIDENT SAMPLING - INTERIM SYSTEM.....	C
*II.B.3.2		POST ACCIDENT SAMPLING - CORRECTIVE ACTIONS.....	C
*II.B.3.3		POST ACCIDENT SAMPLING - PROCEDURES.....	C
*II.B.3.4	F012	POST ACCIDENT SAMPLING - PLANT MODIFICATIONS (LL CAT B).....	C
II.B.4.1	F013	TRAINING FOR MITIGATING CORE DAMAGE - DEVELOP TRAINING PROGRAM.....	C
*II.B.4.2.A	F013	TRAINING FOR MITIGATING CORE DAMAGE - INITITAL.....	N/A
*II.B.4.2.B	F013	TRAINING FOR MITIGATING CORE DAMAGE - COMPLETE.....	C
II.D.1.1		RELIEF & SAFETY VALVE TEST REQUIREMENTS - SUBMIT PROGRAM.....	C
*II.D.1.2.A		RELIEF & SAFETY VALVE TEST REQUIREMENTS - COMPLETE TESTING.....	N/A
*II.D.1.2.B	F014	RELIEF & SAFETY VALVE TEST REQUIREMENTS - PLANT SPECIFIC REPORT.....	C (Note A)
II.D.1.3		RELIEF & SAFETY VALVE TEST REQUIREMENTS - BLOCK-VALVE TESTING.....	N/A
*II.D.3.1		VALVE POSITION INDICATION - INSTALL DIRECT INDICATIONS OF VALVE POS.....	C
*II.D.3.2		VALVE POSITION INDICATION - TECH SPECS.....	N/A
*II.E.1.1.1 (SEE NOTE 1)	F015	AFS EVALUATION-ANALYSIS.....	C
*II.E.1.1.2 (SEE NOTE 2)	F015	AFS EVALUATION-SHORT TERM MODS.....	C
II.E.1.1.3 (SEE NOTE 3)	F015	AFS-LONG TERM MODS.....	C

NOTE 1 - THE ITEM LISTED IS FROM NUREG-0737, ENCLOSURE 2 AND IS APPLICABLE TO NTOLS'S ONLY


NOTE 2 - THE ITEM LISTED IS FOR ALL PLANTS (OPERATING REACTORS AND NTOL'S)

NOTE 3 - THE ITEM LISTED IS FOR ALL PLANTS (OPERATING REACTORS AND NTOL'S)

NOTE A - THE SUBMITTAL OF THIS INFORMATION WAS DOCUMENTED IN SER SUPPLEMENT 5 (APS ACTIVITIES COMPLETE), HOWEVER, WE ARE UNABLE TO FURTHER DOCUMENT THE COMPLETION OF THE STAFF REVIEW OF THE PVNGS SUBMITAL

STATUS OF IMPLEMENTATION OF TMI ACTION PLAN ITEMS FOR PVNGS

ISSUE NUMBER	MULTI-PLANT ACTION NO.	ISSUE TITLE	LICENSEE IMPLEMENTATION STATUS
II.E.1.2.1.A		AFS INITIATION & FLOW-CONTROL GRADE.....	C
II.E.1.2.1.B	F016	AFS INITIATION & FLOW-SAFETY GRADE.....	C
II.E.1.2.2.A		AFS INITIATION & FLOW-FLOW INDICATION CONTROL GRADE.....	C
*II.E.1.2.2.B		AFS INITIATION & FLOW-LL CAT A TECH SPECS.....	N/A
*II.E.1.2.2.C	F017	AFS INITIATION & FLOW-SAFETY GRADE.....	C
*II.E.3.1.1		EMERGENCY POWER FOR PRESSURIZER HEATERS - UPGRADE POWER SUPPLY.....	C
*II.E.3.1.2		EMERGENCY POWER FOR PRESSURIZER HEATERS - TECH SPECS.....	N/A
II.E.4.1.1		DEDICATED HYDROGEN PENETRATIONS - DESIGN.....	C
*II.E.4.1.2		DEDICATED HYDROGEN PENETRATIONS - REVIEW & REVISE H2 CONTROL PROC.....	C
*II.E.4.1.3	F018	DEDICATED HYDROGEN PENETRATION - INSTALL.....	C
II.E.4.2.1-4		CONTAINMENT ISOLATION DEPENDABILITY - IMP. DIVERSE ISOLATION.....	C
*II.E.4.2.5.A		CONTAINMENT ISOLAT. DEPENDABILITY - CNTMT. PRESS. SETPT SPECIFY PRESS.....	N/A
*II.E.4.2.5.B		CONTAINMENT ISOLATION DEPENDABILITY - CNTMT PRESSURE SETPT MODS.....	C
II.E.4.2.6	F019	CONTAINMENT ISOLATION DEPENDABILITY - CNTMT PURGE VALVES.....	C
II.E.4.2.7	F019	CONTAINMENT ISOLATION DEPENDABILITY - RADIATION SIGNAL ON PURGE VALVES.....	C
*II.E.4.2.8		CONTAINMENT ISOLATION DEPENDABILITY - TECH SPECS.....	N/A
*II.F.1.1	F020	ACCIDENT - MONITORING - PROCEDURES.....	C
*II.F.1.2.A	F020	ACCIDENT - MONITORING - NOBLE GAS MONITOR.....	C
*II.F.1.2.B	F021	ACCIDENT - MONITORING - IODINE/PARTICULATE SAMPLING.....	C
*II.F.1.2.C	F022	ACCIDENT - MONITORING - CONTAINMENT HIGH-RANGE MONITOR.....	C
*II.F.1.2.D	F023	ACCIDENT - MONITORING - CONTAINMENT PRESSURE.....	C
*II.F.1.2.E	F024	ACCIDENT - MONITORING - CONTAINMENT WATER LEVEL.....	C
*II.F.1.2.F	F025	ACCIDENT - MONITORING - CONTAINMENT HYDROGEN.....	C
*II.F.2.1		INSTRUMENTATION FOR DETECT. OF INADEQUATE CORE COOLING - PROCEDURES.....	C
*II.F.2.2		INSTRUMENTATION FOR DETECT. OF INADEQUATE CORE COOLING - SUBCOOL METER.....	C
*II.F.2.3	F026	INSTRUMENTATION FOR DETECT. OF INADEQUATE CORE COOLING - DESC. OTHER.....	C
*II.F.2.4	F026	INSTRUMENTATION FOR DETECT. OF INADEQUATE CORE CLING INSTLL ADD'L INSTRUMENTATION	C
*II.G.1.1		POWER SUPP. FOR PRESSURIZER RELIEF, BLOCK VALVES & LEVEL IND. - UPGRADE.....	C
*II.G.1.2		POWER SUPP. FOR PRESSURIZER RELIEF, BLOCK VALVES & LEVEL IND. - TECH SP.....	N/A
II.K.1 (Oper. Reactors Only)		IE BULLETINS - 79-05, 79-06, 79-08.....	N/A

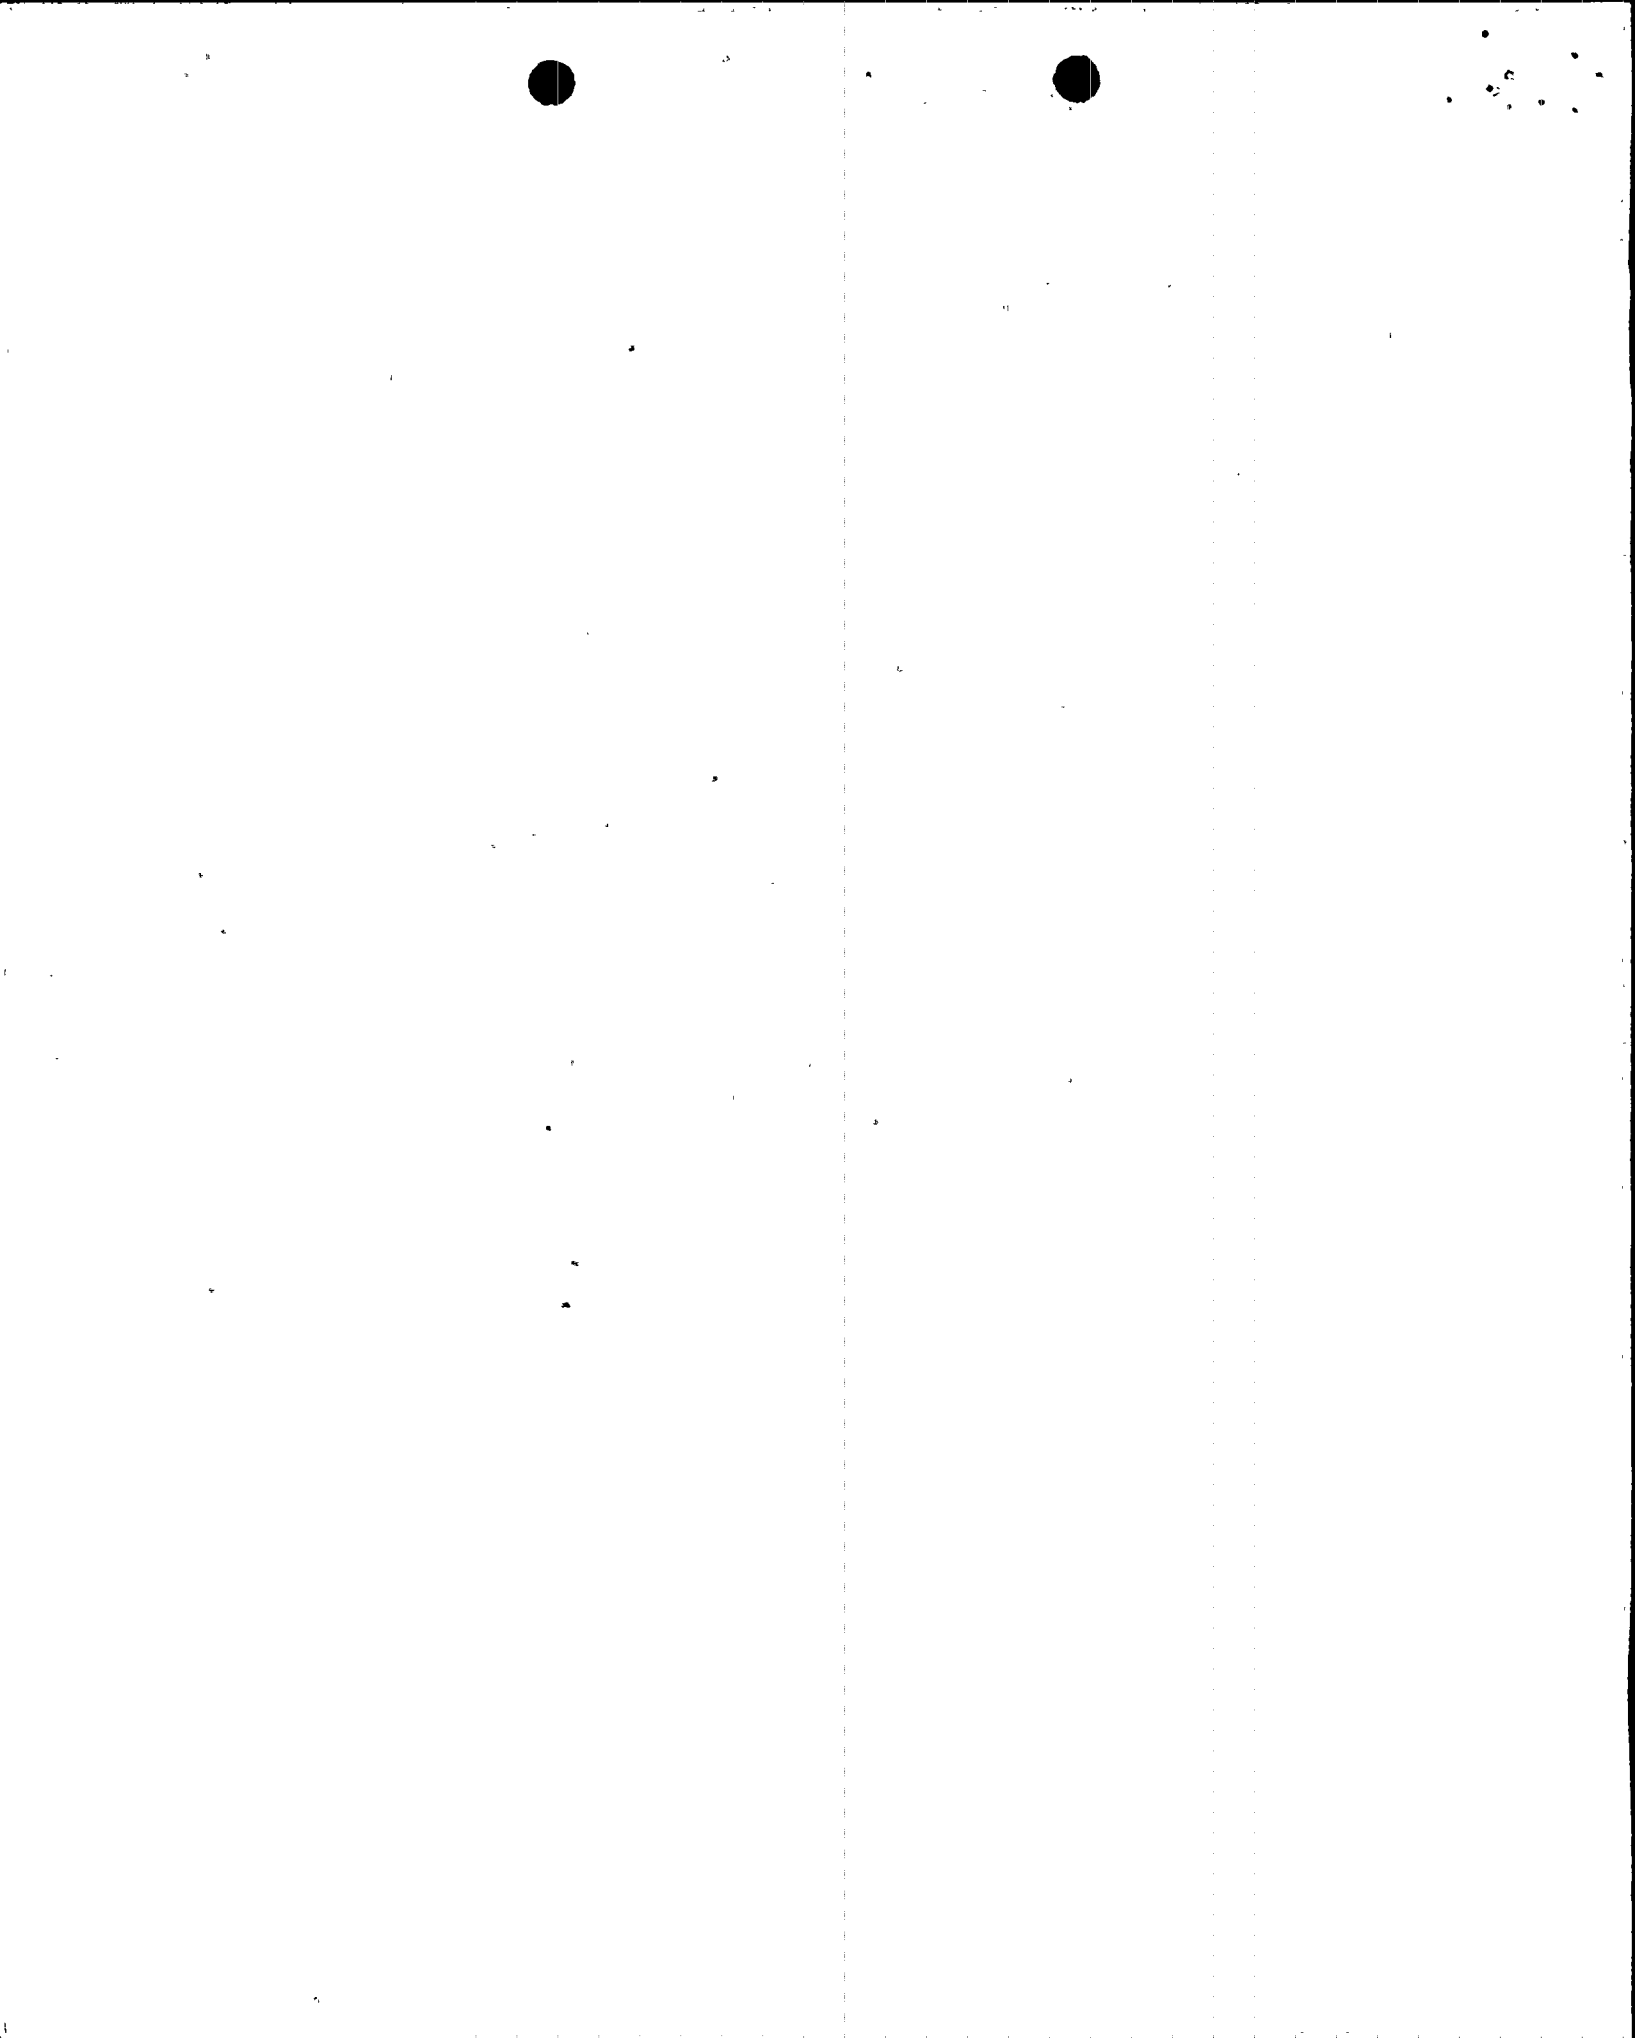

STATUS OF IMPLEMENTATION OF TMI ACTION PLAN ITEMS FOR PVNGS

MULTI-PLANT		ISSUE TITLE	LICENSEE IMPLEMENTATION STATUS
ISSUE NUMBER	ACTION NO.		
*II.K.1.5		IE BULLETINS - REVIEW ESF VALVES.....	C
*II.K.1.10		IE BULLETINS - OPERABILITY STATUS.....	C
*II.K.1.20		IE BULLETINS - PROMPT MANUAL REACTOR TRIP.....	N/A
*II.K.1.21		IE BULLETINS - AUTO SG ANTICIPATORY REACTOR TRIP.....	N/A
*II.K.1.22		IE BULLETINS - AUX. HEAT REM SYSTEM, PROC.....	N/A
*II.K.1.23		IE BULLETINS - RV LEVEL, PROCEDURES.....	N/A
*II.K.2.2		ORDERS ON B&W PLANTS - PROCEDURES TO CONTROL AFW IND OF ICS.....	N/A
*II.K.2.8		ORDERS ON B&W PLANTS - UPGRADE AFW SYSTEM.....	N/A
II.K.2.9	F027	ORDERS ON B&W PLANTS - FEMA ON ICS.....	N/A
II.K.2.10	F028	ORDERS ON B&W PLANTS - SAFETY-GRADE TRIP.....	N/A
*II.K.2.11	F029	ORDERS ON B&W PLANTS - OPERATOR TRAINING.....	N/A
II.K.2.13	F030	ORDERS ON B&W PLANTS - THERMAL MECHANICAL REPORT (CE & W PLANTS ALSO).....	C
II.K.2.14	F031	ORDERS ON B&W PLANTS - LIFT FREQUENCY OF PORV's & SV's.....	N/A
II.K.2.15		ORDERS ON B&W PLANTS - EFFECTS OF SLUG FLOW.....	N/A
II.K.2.16	F032	ORDERS ON B&W PLANTS - RCP SEAL DAMAGE.....	N/A
II.K.2.17	F033	ORDERS ON B&W PLANTS - VOIDING IN RCS (CE & W PLANTS ALSO).....	C
II.K.2.19		BENCHMARK ANALYSIS OF SEQUENTIAL AFW FLOW TO ONCE THROUGH STM GENERATOR.....	N/A
*II.K.2.20	F035	ORDERS ON B&W PLANTS - SYSTEM RESPONSE TO SB LOCA.....	N/A
*II.K.3.1.A	F036	B&O TASK FORCE - AUTOMATIC PORV ISOLATION DESIGN.....	N/A
*II.K.3.1.B		FINAL RECOMMENDATIONS, B&O TASK FORCE - AUTO PORV ISD TEST/INSTALL.....	N/A
II.K.3.2	F037	B&O TASK FORCE - REPORT OF PORV FAILURES.....	N/A
II.K.3.3	F038	B&O TASK FORCE - REPORTING SV & RV FAILURES AND CHALLENGES.....	0 (Note B)
II.K.3.5.A	F039	B&O TASK FORCE - AUTO TRIP OF RCP'S PROPOSED MODIFICATIONS.....	C
II.K.3.5.B	F039	B&O TASK FORCE - AUTO TRIP OF RCP'S MODIFICATIONS.....	C
II.K.3.7		B&O TASK FORCE - EVALUATION OF PORV OPENING PROBABILITIES.....	N/A
II.K.3.9	F040	B&O TASK FORCE - PID CONTROLLER MODIFICATION.....	N/A
II.K.3.10	F041	B&O TASK FORCE - PROPOSED ANTICIPATORY TRIP MODIFICATIONS.....	N/A
II.K.3.11		B&O TASK FORCE - JUSTIFY USE OF CERTAIN PORV.....	N/A
II.K.3.12.A		B&O TASK FORCE - ANTICIPATORY TRIP ON TURBINE TRIP PROPOSED MODS.....	N/A
II.K.3.12.B	F042	B&O TASK FORCE - ANTICIPATORY TRIP ON TURBINE TRIP INSTALL MODS.....	N/A
II.K.3.13.A	F043	B&O TASK FORCE - HPCI & RCIC SYSTEM INITIATION LEVELS ANALYSIS.....	N/A
II.K.3.13.B	F043	B&O TASK FORCE - HPCI & RCIC INITIATION LEVELS MODIFICATION.....	N/A

NOTE B - REPORTING OF SAFETY VALVE FAILURES NOT CURRENTLY PROCEDURALIZED (NO SAFETY VALVE FAILURES HAVE BEEN IDENTIFIED) - PROGRAM/PROCEDURE CHANGE REQUIRED

STATUS OF IMPLEMENTATION OF TMI ACTION PLAN ITEMS FOR PVNGS

ISSUE NUMBER	MULTI-PLANT ACTION NO.	ISSUE TITLE	LICENSEE IMPLEMENTATION STATUS
*II.K.3.14	F044	B&O TASK FORCE - ISO CONDENSER ISOLATION ON HIGH RAD.....	N/A
II.K.3.15	F045	B&O TASK FORCE - MODIFY HPCI & RCIC BRK DETECTION CIRCUITRY.....	N/A
II.K.3.16A	F046	B&O TASK FORCE - CHALLENGE & FAILURE OF RELIEF VALVES STUDY.....	N/A
II.K.3.16B	F046	B&O TASK FORCE - CHALLENGE & FAILURE OF RELIEF VALVES MODIFICATIONS.....	N/A
II.K.3.17	F047	B&O TASK FORCE - ECC SYSTEM OUTAGES.....	0 (Note C)
II.K.3.18.A	F048	B&O TASK FORCE - ADS ACTUATION STUDY.....	N/A
II.K.3.18.B	F048	B&O TASK FORCE - ADS ACTUATION PROPOSED MODIFICATIONS.....	N/A
II.K.3.18.C	F048	B&O TASK FORCE - ADS ACTUATION MODIFICATIONS.....	N/A
*II.K.3.19	F049	B&O TASK FORCE - INTERLOCK RECIRCULATORY PUMP MODIFICATIONS.....	N/A
*II.K.3.20		B&O TASK FORCE - LOSS OF SVS WATER AT BRP.....	N/A
II.K.3.21.A	F050	B&O TASK FORCE - RESTART OF CSS & LPCI LOGIC DESIGN.....	N/A
II.K.3.21.B	F050	B&O TASK FORCE - RESTART OF CSS & LPCI LOGIC DESIGN MODIFICATIONS.....	N/A
II.K.3.22.A	F051	B&O TASK FORCE - RCIC SUCTION VERIFICATION PROCEDURES.....	N/A
II.K.3.22.B	F051	B&O TASK FORCE - RCIC SUCTION MODIFICATION.....	N/A
II.K.3.24	F052	B&O TASK FORCE - SPACE COOLING FOR HPCI/RCI LOSS OF AC POWER.....	N/A
II.K.3.25.A		B&O TASK FORCE - POWER ON PUMP SEALS PROPOSED MODIFICATIONS.....	C
II.K.3.25.B	F053	B&O TASK FORCE - POWER ON PUMP SEALS MODIFICATIONS.....	C
II.K.3.27	F054	B&O TASK FORCE - COMMON REFERENCE LEVEL FOR BWRS.....	N/A
II.K.3.28	F055	B&O TASK FORCE - QUALIFICATION OF AOS ACCUMULATORS.....	N/A
*II.K.3.29	F056	B&O TASK FORCE - PERFORMANCE OF ISOLATION CONDENSERS.....	N/A
II.K.3.30.A		B&O TASK FORCE - SCHEDULE FOR OUTLINE OF SB LOCA MODEL.....	C
II.K.3.30.B	F057	B&O TASK FORCE - SB LOCA MODEL, JUSTIFICATION.....	C
II.K.3.30.C		B&O TASK FORCE - SB LOCA METHODS, NEW ANALYSES.....	C
II.K.3.31	F058	B&O TASK FORCE - COMPLIANCE WITH CFR 50.46.....	NC
*II.K.3.40		B&O TASK FORCE - RCP SEAL DAMAGE - COVERED BY II.K.2.16 AND II.K.3.25.....	N/A
*II.K.3.43		B&O TASK FORCE - EFFECTS OF SLUG FLOW - COVERED BY II.K.2.15.....	N/A
II.K.3.44	F059	B&O TASK FORCE - EVALUATE TRANSIENT WITH SINGLE FAILURE.....	N/A
II.K.3.45	F060	B&O TASK FORCE - ANALYSES TO SUPPORT.....	N/A
II.K.3.46	F061	RESPONSE TO LIST OF CONCERNS FROM ACRS CONSULTANT.....	N/A
*II.K.3.57	F062	IDENTIFY WATER SOURCES PRIOR TO MANUAL ACTIVATION OF ADS.....	N/A
III.A.1.1		EMERGENCY PREPAREDNESS, SHORT TERM.....	C

NOTE C - THE PROGRAM FOR TRENDING CUMULATIVE OUTAGE TIMES FOR ECC SYSTEMS HAS NOT BEEN FULLY
IMPLEMENTED - PROGRAM/PROCEDURE CHANGE REQUIRED

MULTI-PLANT		ISSUE TITLE	LICENSEE IMPLEMENTATION STATUS
ISSUE NUMBER	ACTION NO.		
III.A.1.2.1		UPGRADE EMERGENCY SUPPORT FACILITIES - INTERIM TSC OSC & EOF.....	C
III.A.1.2.2		UPGRADE EMERGENCY SUPPORT FACILITIES - DESIGN-INCORP. INTO F063/F064/F065.....	C
(SEE F063, F064, F065)			
III.A.1.2.3		UPGRADE EMER SUPPORT FACILITIES - MODS INCORPOR. INTO F063, F064 & F065.....	C
(SEE F063, F064, F065)			
III.A.2.1	F067	UPGRADE PREPAREDNESS - UPGRADE EMERGENCY PLANS TO APP. E 10 CFR 50.....	C
III.A.2.2	F068	UPGRADE PREPAREDNESS - METEOROLOGICAL DATA.....	C
*III.D.1.1.1		PRIMARY COOLANT OUTSIDE CONTAINMENT - LEAK REDUCTION.....	C
*III.D.1.1.2		PRIMARY COOLANT OUTSIDE CONTAINMENT - TECH SPECS.....	N/A
III.D.3.3.1		IMPLANT RAD. MONIT. - PROVIDE MEANS TO DETER. PRESENCE OF RADIOIODINE.....	C
III.D.3.3.2	F069	IMPLANT RADIATION MONIT. - MODIFICATIONS TO ACCURATELY MEAS. IODINE.....	C
III.D.3.4.1	F070	CONTROL ROOM HABITABILITY - REVIEW.....	C
*III.D.3.4.2	F070	CONTROL ROOM HABITABILITY - SCHEDULE MODIFICATIONS.....	C
*III.D.3.4.3		CONTROL ROOM HABITABILITY - IMPLEMENT MODIFICATIONS.....	C
MPA-F008	F008	I.D.1.1 DETAILED CONTROL ROOM DESIGN REVIEW PROGRAM PLAN.....	C
MPA-F063	F063	III.A.1.2 TECHNICAL SUPPORT CENTER.....	C
MPA-F064	F064	III.A.1.2 OPERATIONAL SUPPORT CENTER.....	C
MPA-F065	F065	III.A.1.2 EMERGENCY OPERATIONS FACILITY.....	C
MPA-F071	F071	I.D.1.2 DETAILED CONTROL ROOM REVIEW (FOLLOWUP TO F-8).....	C
MPA-B072	B072	NUREG-0737 TECH SPECS (GENERIC LETTERS 82-16 & 83-02).....	NC
MPA-B083	B083	TECH SPEC COVERED BY GENERIC LETTERS 83-26 & 83-37 FOR NUREG-0737.....	NC
67.4.1	G001	REACTOR COOLANT PUMP TRIP (GENERIC LETTER 85-12).....	N/A

