

ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8906070275 DOC. DATE: 89/05/30 NOTARIZED: NO DOCKET #
 FACIL: STN-50-528 Palo Verde Nuclear Station, Unit 1, Arizona Publi 05000528
 STN-50-529 Palo Verde Nuclear Station, Unit 2, Arizona Publi 05000529
 STN-50-530 Palo Verde Nuclear Station, Unit 3, Arizona Publi 05000530

AUTH. NAME AUTHOR AFFILIATION
 CONWAY, W.F. Arizona Nuclear Power Project (formerly Arizona Public Serv
 RECIPIENT NAME RECIPIENT AFFILIATION
 Document Control Branch (Document Control Desk)

SUBJECT: Confirms 890508 telcon re intention of util to use ASME Code
 Case N-416.

DISTRIBUTION CODE: A047D COPIES RECEIVED: LTR 1 ENCL 0 SIZE: 1
 TITLE: OR Submittal: Inservice Inspection/Testing/Relief from ASME Code


NOTES: Standardized plant. 05000528 /
 Standardized plant. 05000529
 Standardized plant. 05000530 A

	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
	PD5 LA	1 0	PD5 PD	5 5
	CHAN, T	1 1	DAVIS, M	1 1
	DAVIS, M.J.	1 1		
INTERNAL:	ACRS	6 6	AEOD/DSP/TPAB	1 1
	NRR/DEST/MEB 9H	1 1	NRR/DEST/MTB 9H	1 1
	NUDOCS-ABSTRACT	1 1	OC/LFMB	1 0
	OGC/HDS1	1 0	REG FILE 01	1 1
	RES/DSIR/EIB	1 1		
EXTERNAL:	EG&G BROWN, B	1 1	EG&G ROCKHOLD, H	1 1
	LPDR	1 1	NL 007 HEMMING	1 1
	NRC PDR	1 1	NSIC	1 1
NOTES:		1 1		

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,
 ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTTR 30 ENCL 27

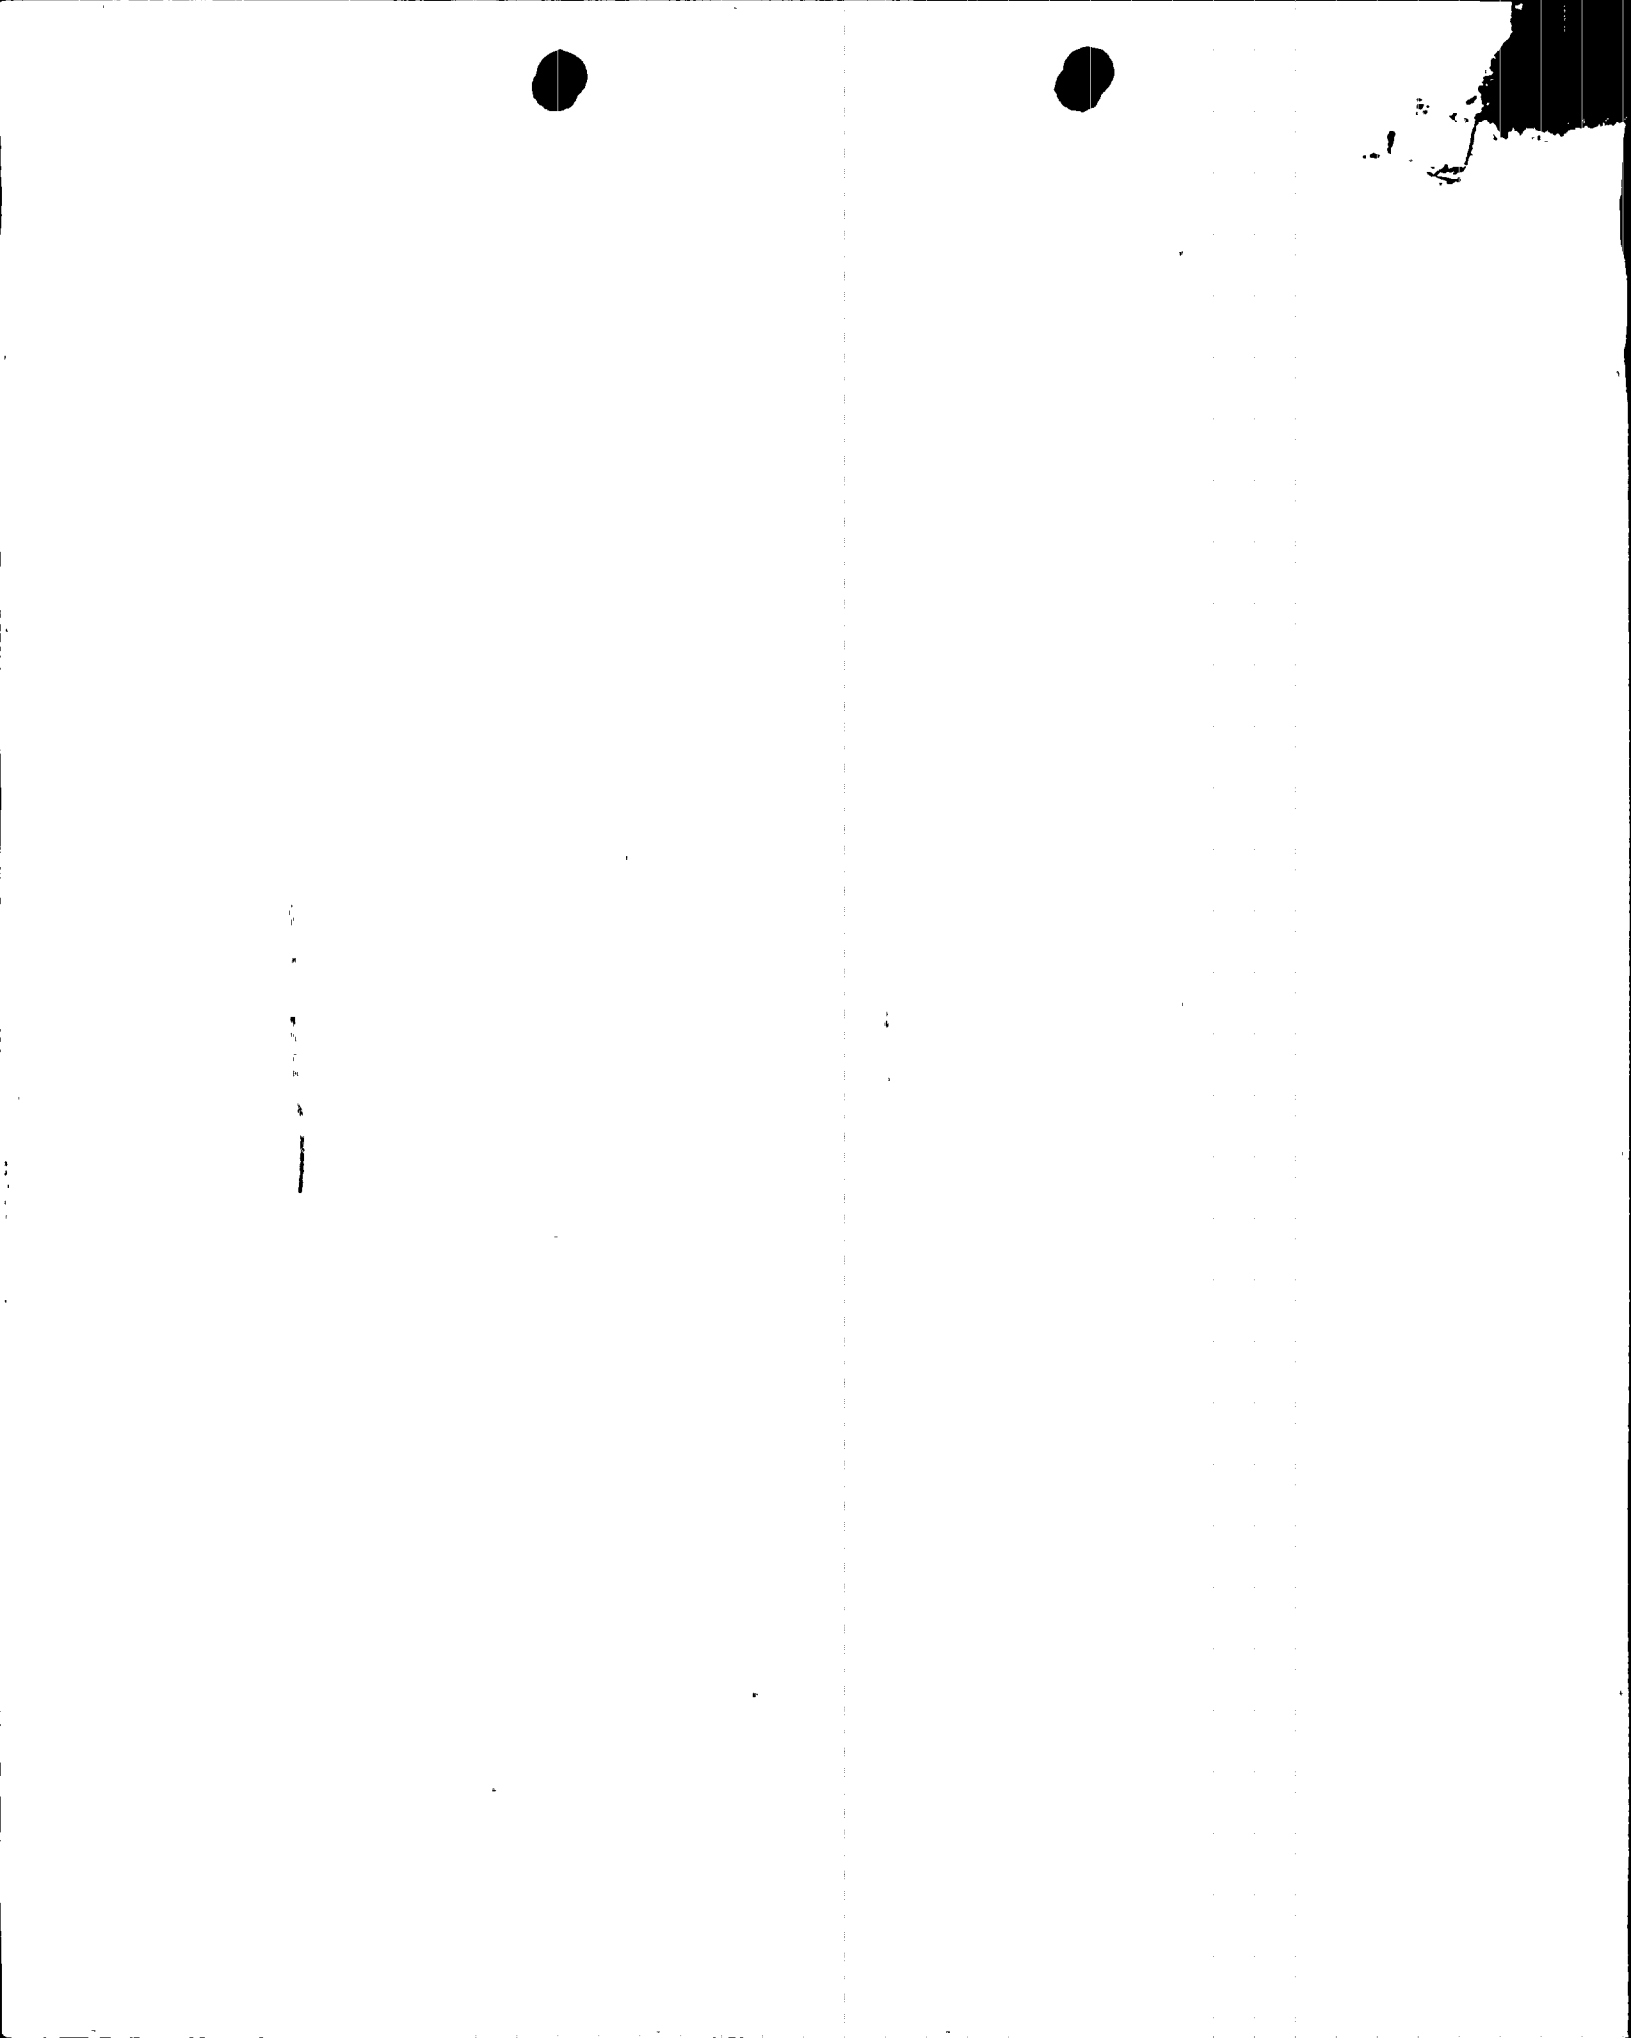



Arizona Nuclear Power Project

P.O. BOX 52034 • PHOENIX, ARIZONA 85072-2034

161-01979-WFC/JRP
May 30, 1989

Docket Nos. STN 50-528/529/530

Document Control Desk
U. S. Nuclear Regulatory Commission
Mail Station P1-137
Washington, D. C. 20555

Dear Sirs:

Subject: Palo Verde Nuclear Generating Station (PVNGS)
Units 1, 2 and 3
Use of ASME Code Case No. N-416
File: 89-A-005-419.05

The purpose of this letter is to confirm a telephone conversation between Messrs. T. L. Chan (NRC/NRR) and J. R. Provasoli, M. W. Lantrip and M. A. Melton (APS) on May 8, 1989. The call was made to inform the NRC of PVNGS intention of using ASME Code Case N-416, Alternative Rules for Hydrostatic Testing of Repair or Replacement of Class 2 Piping Section XI, Division 1. This Code Case is listed in Regulatory Guide 1.147, Revision 6 dated May 1988 as being approved for use in lieu of the Section XI requirements.

APS is herewith notifying the NRC that ASME Code Case No. N-416 is being implemented at PVNGS and that it is being integrated into the facility inservice inspection program.

Should you have any questions please call.

Very truly yours,


W. F. Conway
Executive Vice President

WFC/JRP/jle

cc: D. B. Karner
G. W. Knighton
T. L. Chan
M. J. Davis
J. B. Martin
T. J. Polich

8906070275 890530
PDR ADCK 05000528
PDC

A047
1/0

