

## ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR:8906300055 DOC.DATE: 89/06/19 NOTARIZED: NO DOCKET #  
 FACIL:STN-50-528 Palo Verde Nuclear Station, Unit 1, Arizona Publi 05000528  
 STN-50-529 Palo Verde Nuclear Station, Unit 2, Arizona Publi 05000529  
 STN-50-530 Palo Verde Nuclear Station, Unit 3, Arizona Publi 05000530

AUTH.NAME AUTHOR AFFILIATION  
 CONWAY,W.F. Arizona Public Service Co. (formerly Arizona Nuclear Power  
 RECIP.NAME RECIPIENT AFFILIATION  
 Office of Nuclear Reactor Regulation, Director (Post 870411

SUBJECT: Forwards response to NRC telcon multiple control Element  
 Assembly slippage experienced in unit 1 on 891210.

DISTRIBUTION CODE: A001D COPIES RECEIVED:LTR 1 ENCL 1 SIZE: 11-7-30  
 TITLE: OR Submittal: General Distribution


NOTES:Standardized plant. 05000528  
 Standardized plant. 05000529  
 Standardized plant. 05000530

RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
PD5 LA	1 1	PD5 PD	1 1
CHAN,T	5 5	DAVIS,M	5 5
DAVIS,M.	5 5		
INTERNAL: ACRS	6 6	NRR/DEST/ADS 7E	1 1
NRR/DEST/CEB 8H	1 1	NRR/DEST/ESB 8D	1 1
NRR/DEST/ICSB	1 1	NRR/DEST/MTB 9H	1 1
NRR/DEST/RSB 8E	1 1	NRR/DOEA/TSB 11	1 1
NUDOCS-ABSTRACT	1 1	OC/LFMB	1 0
OGC/HDS1	1 0	<u>REG FILE</u> 01	1 1
RES/DSIR/EIB	1 1		
EXTERNAL: LPDR	1 1	NRC PDR	1 1
NSIC	1 1		
NOTES:	1 1		

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,  
 ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION  
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTTR 39 ENCL 37

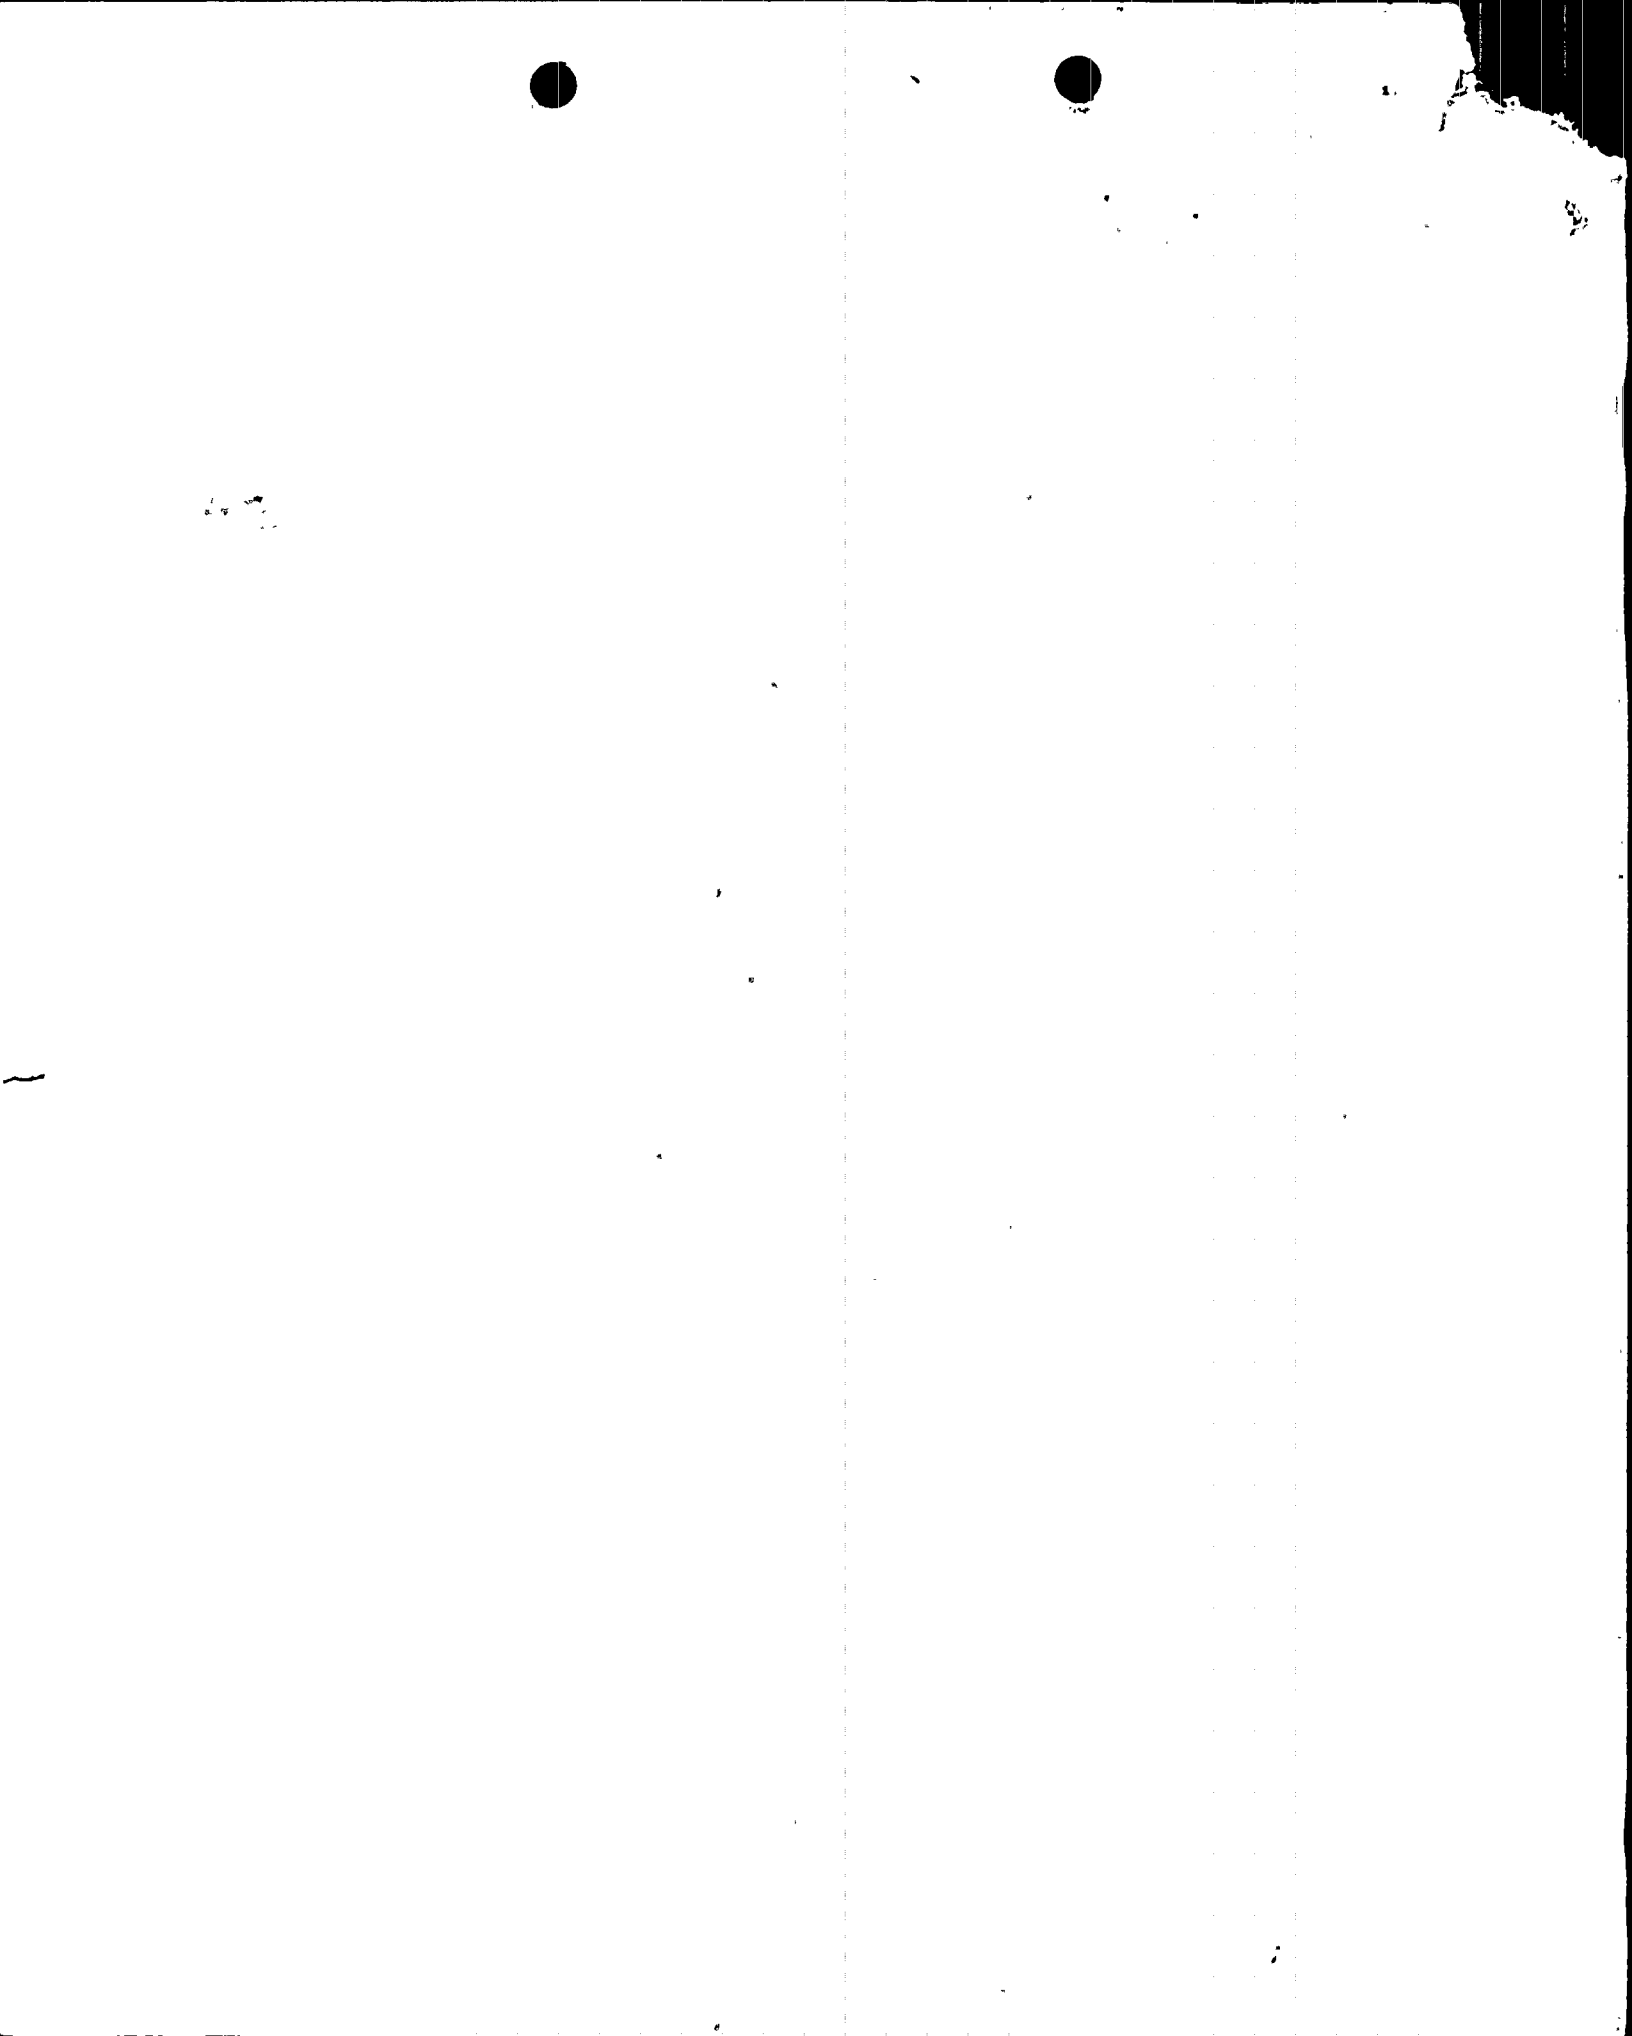

**Arizona Public Service Company**

P.O. BOX 53999 • PHOENIX, ARIZONA 85072-3999

**WILLIAM F. CONWAY**  
EXECUTIVE VICEPRESIDENT  
NUCLEAR

161-02037-WFC/RAB  
June 19, 1989

Docket Nos. STN 50-528/529/530

Document Control Desk  
U. S. Nuclear Regulatory Commission  
Mail Station P1-137  
Washington, D. C. 20555

Dear Sirs:

Subject: Palo Verde Nuclear Generating Station (PVNGS)  
Units 1, 2 and 3  
Justification for Continued Operation as a  
Result of CEA Drop Events  
File: 89-A-056-026

Attached please find the Justification for Continued Operation prepared as a result of the multiple Control Element Assembly (CEA) slippage experienced in Unit 1 on December 10, 1988. This document was prepared after an extensive test program to determine the cause of the event. Mr. Terence Chan requested that this report be forwarded to NRC, during phone conversations after the December 10, 1988 event.

If you have any further questions, please call Carter Rogers at (602) 371-4041.

Sincerely,



WFC/RAB/jle

Attachment

cc: J. B. Martin  
T. L. Chan  
M. J. Davis  
T. J. Polich  
A. C. Gehr

8906300055 890619  
PDR ADDCK 05000528  
P PNU

Acc  
1/1

