

# ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

## REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8906300230 DOC. DATE: 89/06/27 NOTARIZED: NO DOCKET #  
 FACIL: STN-50-528 Palo Verde Nuclear Station, Unit 1, Arizona Publi 05000528  
 AUTH. NAME AUTHOR AFFILIATION  
 CONWAY, W.F. Arizona Public Service Co. (formerly Arizona Nuclear Power  
 RECIP. NAME RECIPIENT AFFILIATION  
 Document Control Branch (Document Control Desk)

SUBJECT: Forwards revised reload analysis rept changes for Cycle 3.  
 Changes reflect early shutdown of Cycle 2.

DISTRIBUTION CODE: A001D COPIES RECEIVED: LTTR 1 ENCL 1 SIZE: 1+4  
 TITLE: OR Submittal: General Distribution

NOTES: Standardized plant. 05000528


	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
	PD5 LA	1 1	PD5 PD	1 1
	CHAN, T	5 5	DAVIS, M	5 5
INTERNAL:	ACRS	6 6	NRR/DEST/ADS 7E	1 1
	NRR/DEST/CEB 8H	1 1	NRR/DEST/ESB 8D	1 1
	NRR/DEST/ICSB	1 1	NRR/DEST/MTB 9H	1 1
	NRR/DEST/RSB 8E	1 1	NRR/DOEA/TSB 11	1 1
	NUDOCS-ABSTRACT	1 1	OC/LFMB	1 0
	OGC/HDS1	1 0	REG FILE 01	1 1
	RES/DSIR/EIB	1 1		
EXTERNAL:	LPDR	1 1	NRC PDR	1 1
	NSIC	1 1		
NOTES:		1 1		

### NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,  
 ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION  
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTTR 34 ENCL 32

R  
I  
D  
S  
/  
A  
D  
D  
S  
  
R  
I  
D  
S  
/  
A  
D  
D  
S

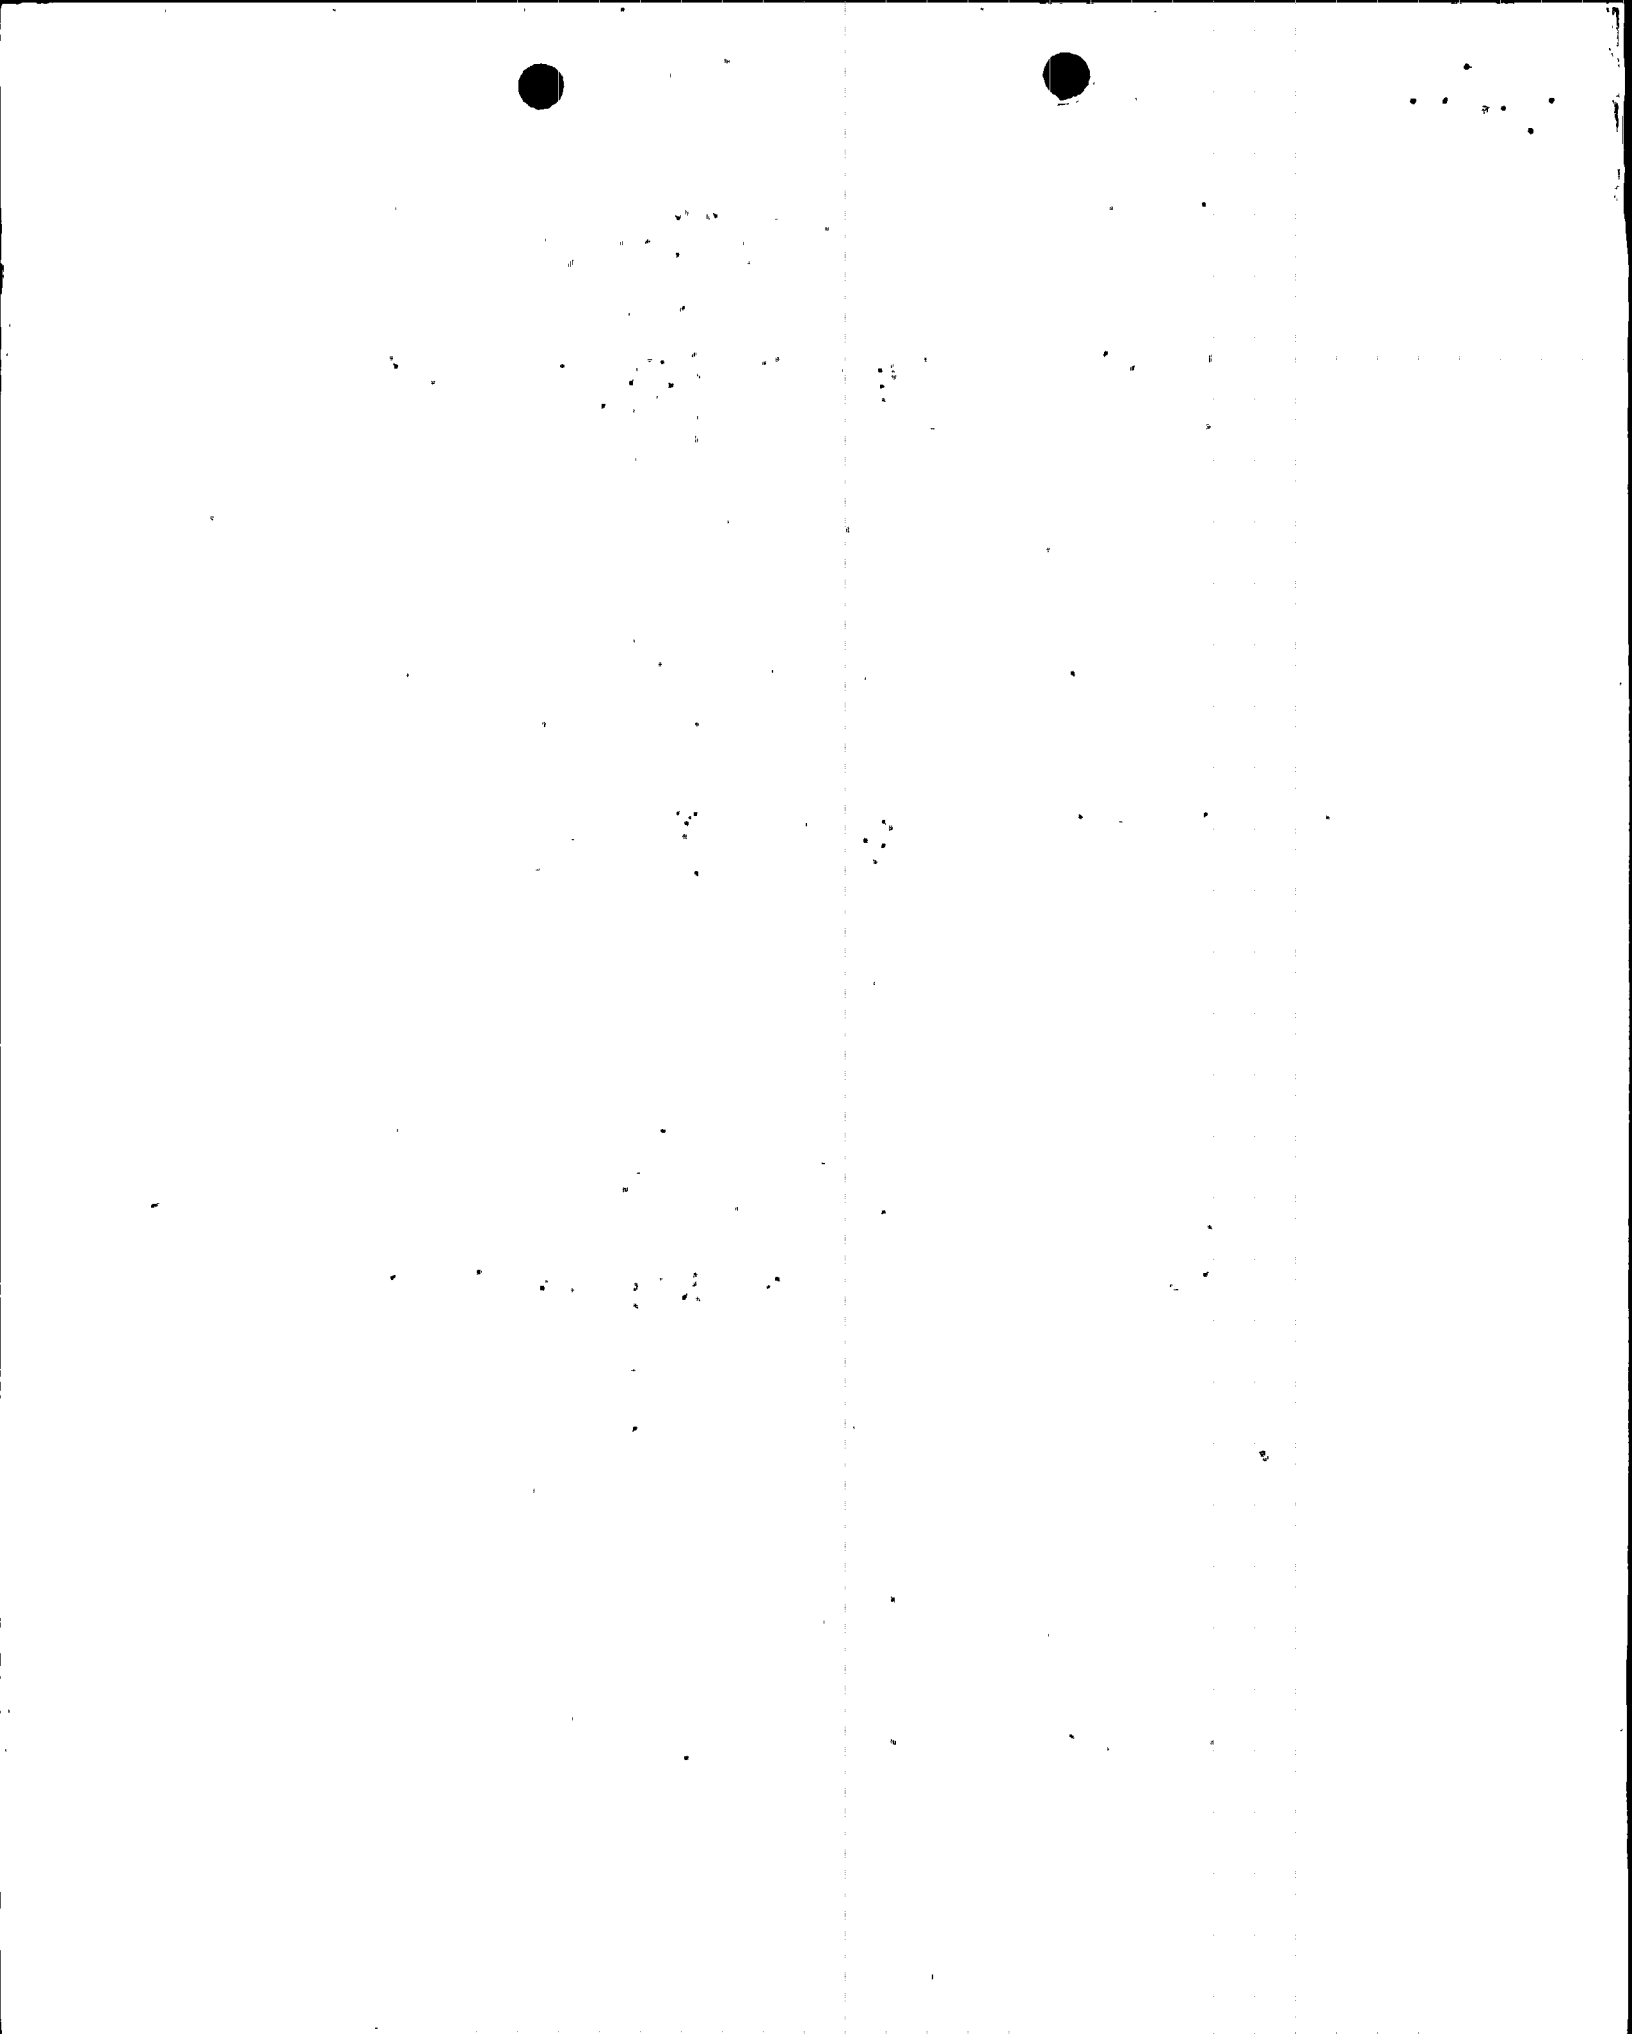

Arizona Public Service Company

P.O. BOX 53999 • PHOENIX, ARIZONA 85072-3999

WILLIAM F. CONWAY  
EXECUTIVE VICE PRESIDENT  
NUCLEAR

161-02064-WFC/KLMC  
June 27, 1989

Docket No. STN 50-528

Document Control Desk  
U. S. Nuclear Regulatory Commission  
Mail Station Pl-137  
Washington, D. C. 20555

Reference: Letter to the NRC from D. B. Karner, ANPP,  
dated January 18, 1989; Subject: PVNGS  
Unit 1 Reload Analysis for Unit 1, Cycle 3  
(161-01620)

Dear Sirs:


Subject: Palo Verde Nuclear Generating Station (PVNGS)  
Unit 1  
Revised Reload Analysis Report Change Pages -  
Unit 1, Cycle 3  
File: 89-E-056-026

Attached are the change pages for the Unit 1, Cycle 3 Reload Analysis Report (RAR) necessary to reflect the early shutdown of Cycle 2. The revised pages (1-1, 2-1 and 5-1) indicate the Cycle 2 termination burnup is assumed to be between 284 EFPD and 350 EFPD. In addition to the revisions required by the early shutdown, page 4-2 has been revised to include the relationship between FATES3A and FATES3.

These revisions represent the only licensing related changes required for the Unit 1, Cycle 3 analysis due to the early shutdown of the unit. At this time, no additional Unit 1, Cycle 3 Reload Technical Specification change requests are expected.

If you should have any questions concerning this matter, please contact Mr. A. C. Rogers of my staff at (602) 371-4041.

Sincerely,



WFC/KLMC/jle

Attachments

cc: G. W. Knighton (all w/attachments)  
M. J. Davis  
T. L. Chan  
T. J. Polich

8906300230 890627  
PDR ADOCK 05000528  
P PDC



5 A001  
1/1

