

ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR: 8910240237 DOC. DATE: 89/10/16 NOTARIZED: NO DOCKET #
FACIL: STN-50-528 Palo Verde Nuclear Station, Unit 1, Arizona Publi 05000528
STN-50-529 Palo Verde Nuclear Station, Unit 2, Arizona Publi 05000529
STN-50-530 Palo Verde Nuclear Station, Unit 3, Arizona Publi 05000530

AUTH. NAME AUTHOR AFFILIATION
BAILEY, J.N. Arizona Public Service Co. (formerly Arizona Nuclear Power
RECIP. NAME RECIPIENT AFFILIATION
MARTIN, J.B. Region 5, Ofc of the Director

SUBJECT: Forwards Rev 2 to "Atmospheric Dump Valve Engineering
Analysis Mar/Apr 1989."

DISTRIBUTION CODE: IE01D COPIES RECEIVED: LTR 1 ENCL 1 SIZE: 1 + 12 /
TITLE: General (50 Dkt)-Insp Rept/Notice of Violation Response

NOTES:

Standardized plant.
Standardized plant.


05000528
05000529
05000530

RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
PD5 PD	1 1	CHAN, T	1 1
DAVIS, M.	1 1		
INTERNAL: ACRS	2 2	AEOD	1 1
AEOD/DEIIB	1 1	AEOD/TPAD	1 1
DEDRO	1 1	NRR SHANKMAN, S	1 1
NRR/DEST DIR	1 1	NRR/DLPQ/PEB	1 1
NRR/DOEA DIR 11	1 1	NRR/DREP/EPB 10	1 1
NRR/DREP/RPB 10	2 2	NRR/PMAS/ILRB12	1 1
NUDOCS-ABSTRACT	1 1	OE LIEBERMAN, J	1 1
OGC/HDS1	1 1	REG FILE 02	1 1
RES MORISSEAU, D	1 1	RGN5 FILE 01	1 1
EXTERNAL: LPDR	1 1	NRC PDR	1 1
NSIC	1 1		
NOTES:	1 1		

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,
ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION
LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTTR 27 ENCL 27

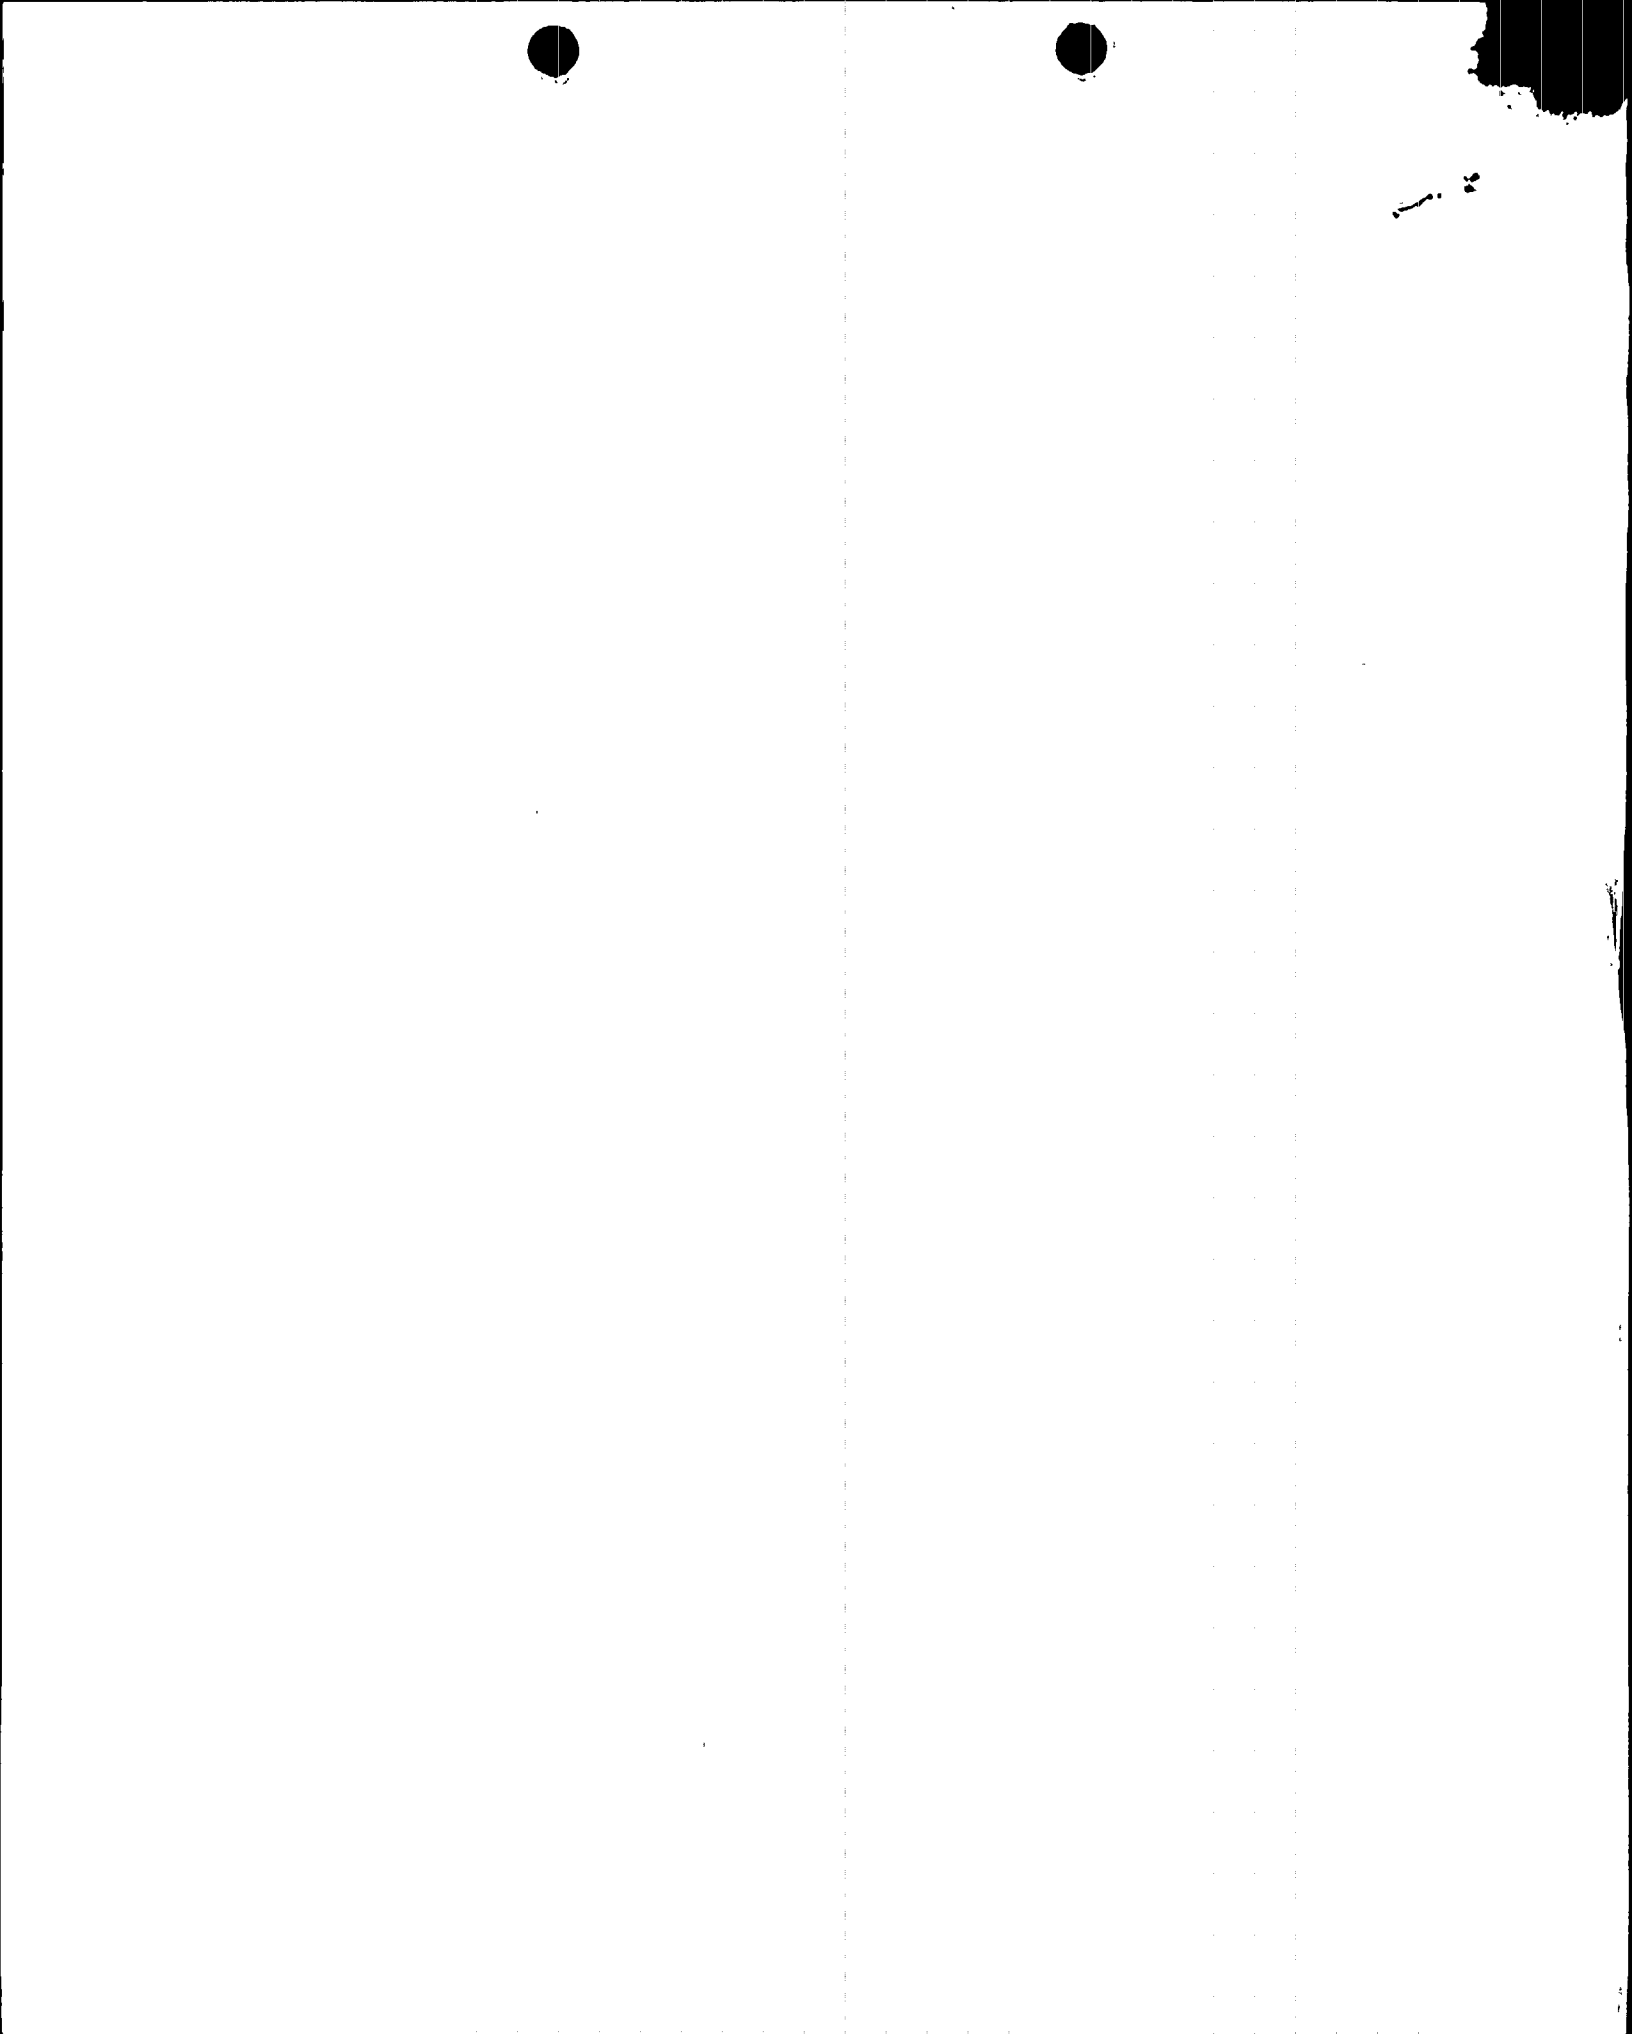

Arizona Public Service Company

P.O. BOX 53919 • PHOENIX ARIZONA 85072-3919

102-01473-JNB/TDS

October 16, 1989

RECEIVED
REC. N V

OCT 17 11:25

W. BAILEY
JNB
MAY 1989

Mr. John B. Martin, Regional Administrator
U. S. Nuclear Regulatory Commission
Region V
1450 Maria Lane, Suite 210
Walnut Creek, CA 94596-5368

Dear Sir:

Subject: Updated Technical Report Addressing Unit 3 Trip Concerns
File: 89-147-419

In response to a telephone conversation held between APS (T. D. Shriver) and NRC Region V (W. Ang), the attached report, Atmospheric Dump Valve Engineering Analysis Revision 2, is forwarded for your information. No future revisions to this report are anticipated.

If you have any questions concerning this report or require additional information, please contact me.

Very truly yours,



JNB/TDS/kj

Attachments

cc: Document Control Desk
T. J. Polich
W. F. Conway
M. J. Davis
T. L. Chan

8910240237 891016
PDR ADOCK 05000528
P PDC

11
IE-01

