

NRC MONTHLY OPERATING REPORT
***** AMENDED *****


DOCKET NO. 50-529
UNIT NAME PVNGS-2
DATE 05/09/90
COMPLETED BY K.F. Porter
TELEPHONE (602) 340-4187

OPERATING STATUS

1. Unit Name: Palo Verde Nuclear Generating Station, Unit 2
 2. Reporting Period: April 1990
 3. Licensed Thermal Power (MWt): 3800
 4. Nameplate Rating (Gross MWe): 1403
 5. Design Electrical Rating (Net MWe): 1270
 6. Maximum Dependable Capacity (Gross MWe): 1303
 7. Maximum Dependable Capacity (Net MWe): 1221
 8. If Changes Occur In Capacity Ratings (Item Numbers 3 Through 7)
Since Last Report, Give Reasons: N/A
 9. Power Level to Which Restricted, If Any (Net MWe): None
 10. Reasons For Restrictions, If Any: N/A
- | | <u>This Month</u> | <u>Yr.-to-Date</u> | <u>Cumulative</u> |
|--|-------------------|--------------------|-------------------|
| 11. Hours in Reporting Period | <u>720</u> | <u>2,880</u> | <u>31,680</u> |
| 12. Number of Hours Reactor
Was Critical | <u>0.0</u> | <u>1,295.0</u> | <u>20,546.1</u> |
| 13. Reactor Reserve Shutdown Hours | <u>0.0</u> | <u>0.0</u> | <u>0.0</u> |
| 14. Hours Generator On-Line | <u>0.0</u> | <u>1,295.0</u> | <u>20,042.2</u> |
| 15. Unit Reserve Shutdown Hours | <u>0.0</u> | <u>0.0</u> | <u>0.0</u> |
| 16. Gross Thermal Energy
Generated (MWH) | <u>0</u> | <u>4,870,700</u> | <u>73,499,053</u> |
| 17. Gross Electrical Energy
Generated (MWH) | <u>0</u> | <u>1,712,500</u> | <u>25,682,370</u> |
| 18. Net Electrical Energy
Generated (MWH) | <u>0</u> | <u>1,614,008</u> | <u>23,996,820</u> |
| 19. Unit Service Factor | <u>0.0%</u> | <u>45.0%</u> | <u>63.3%</u> |
| 20. Unit Availability Factor | <u>0.0%</u> | <u>45.0%</u> | <u>63.3%</u> |
| 21. Unit Capacity Factor
(Using MDC Net) | <u>0.0%</u> | <u>45.9%</u> | <u>62.0%</u> |
| 22. Unit Capacity Factor
(Using DER Net) | <u>0.0%</u> | <u>44.1%</u> | <u>59.6%</u> |
| 23. Unit Forced Outage Rate | <u>0.0%</u> | <u>0.0%</u> | <u>9.9%</u> |
| 24. Shutdowns Scheduled Over Next 6 Months (Type, Date and Duration of Each):
<u>N/A</u> | | | |
| 25. If Shutdown At End of Report Period, Estimated Date of Start-up:
<u>June 12, 1990</u> | | | |

	<u>Forecast</u>	<u>Achieved</u>
INITIAL CRITICALITY	<u>03/86</u>	<u>04/18/86</u>
INITIAL ELECTRICITY	<u>06/86</u>	<u>05/20/86</u>
COMMERCIAL OPERATION	<u>11/86</u>	<u>09/19/86</u>

9006050342 900531
PDR ADOCK 05000529
R PDC

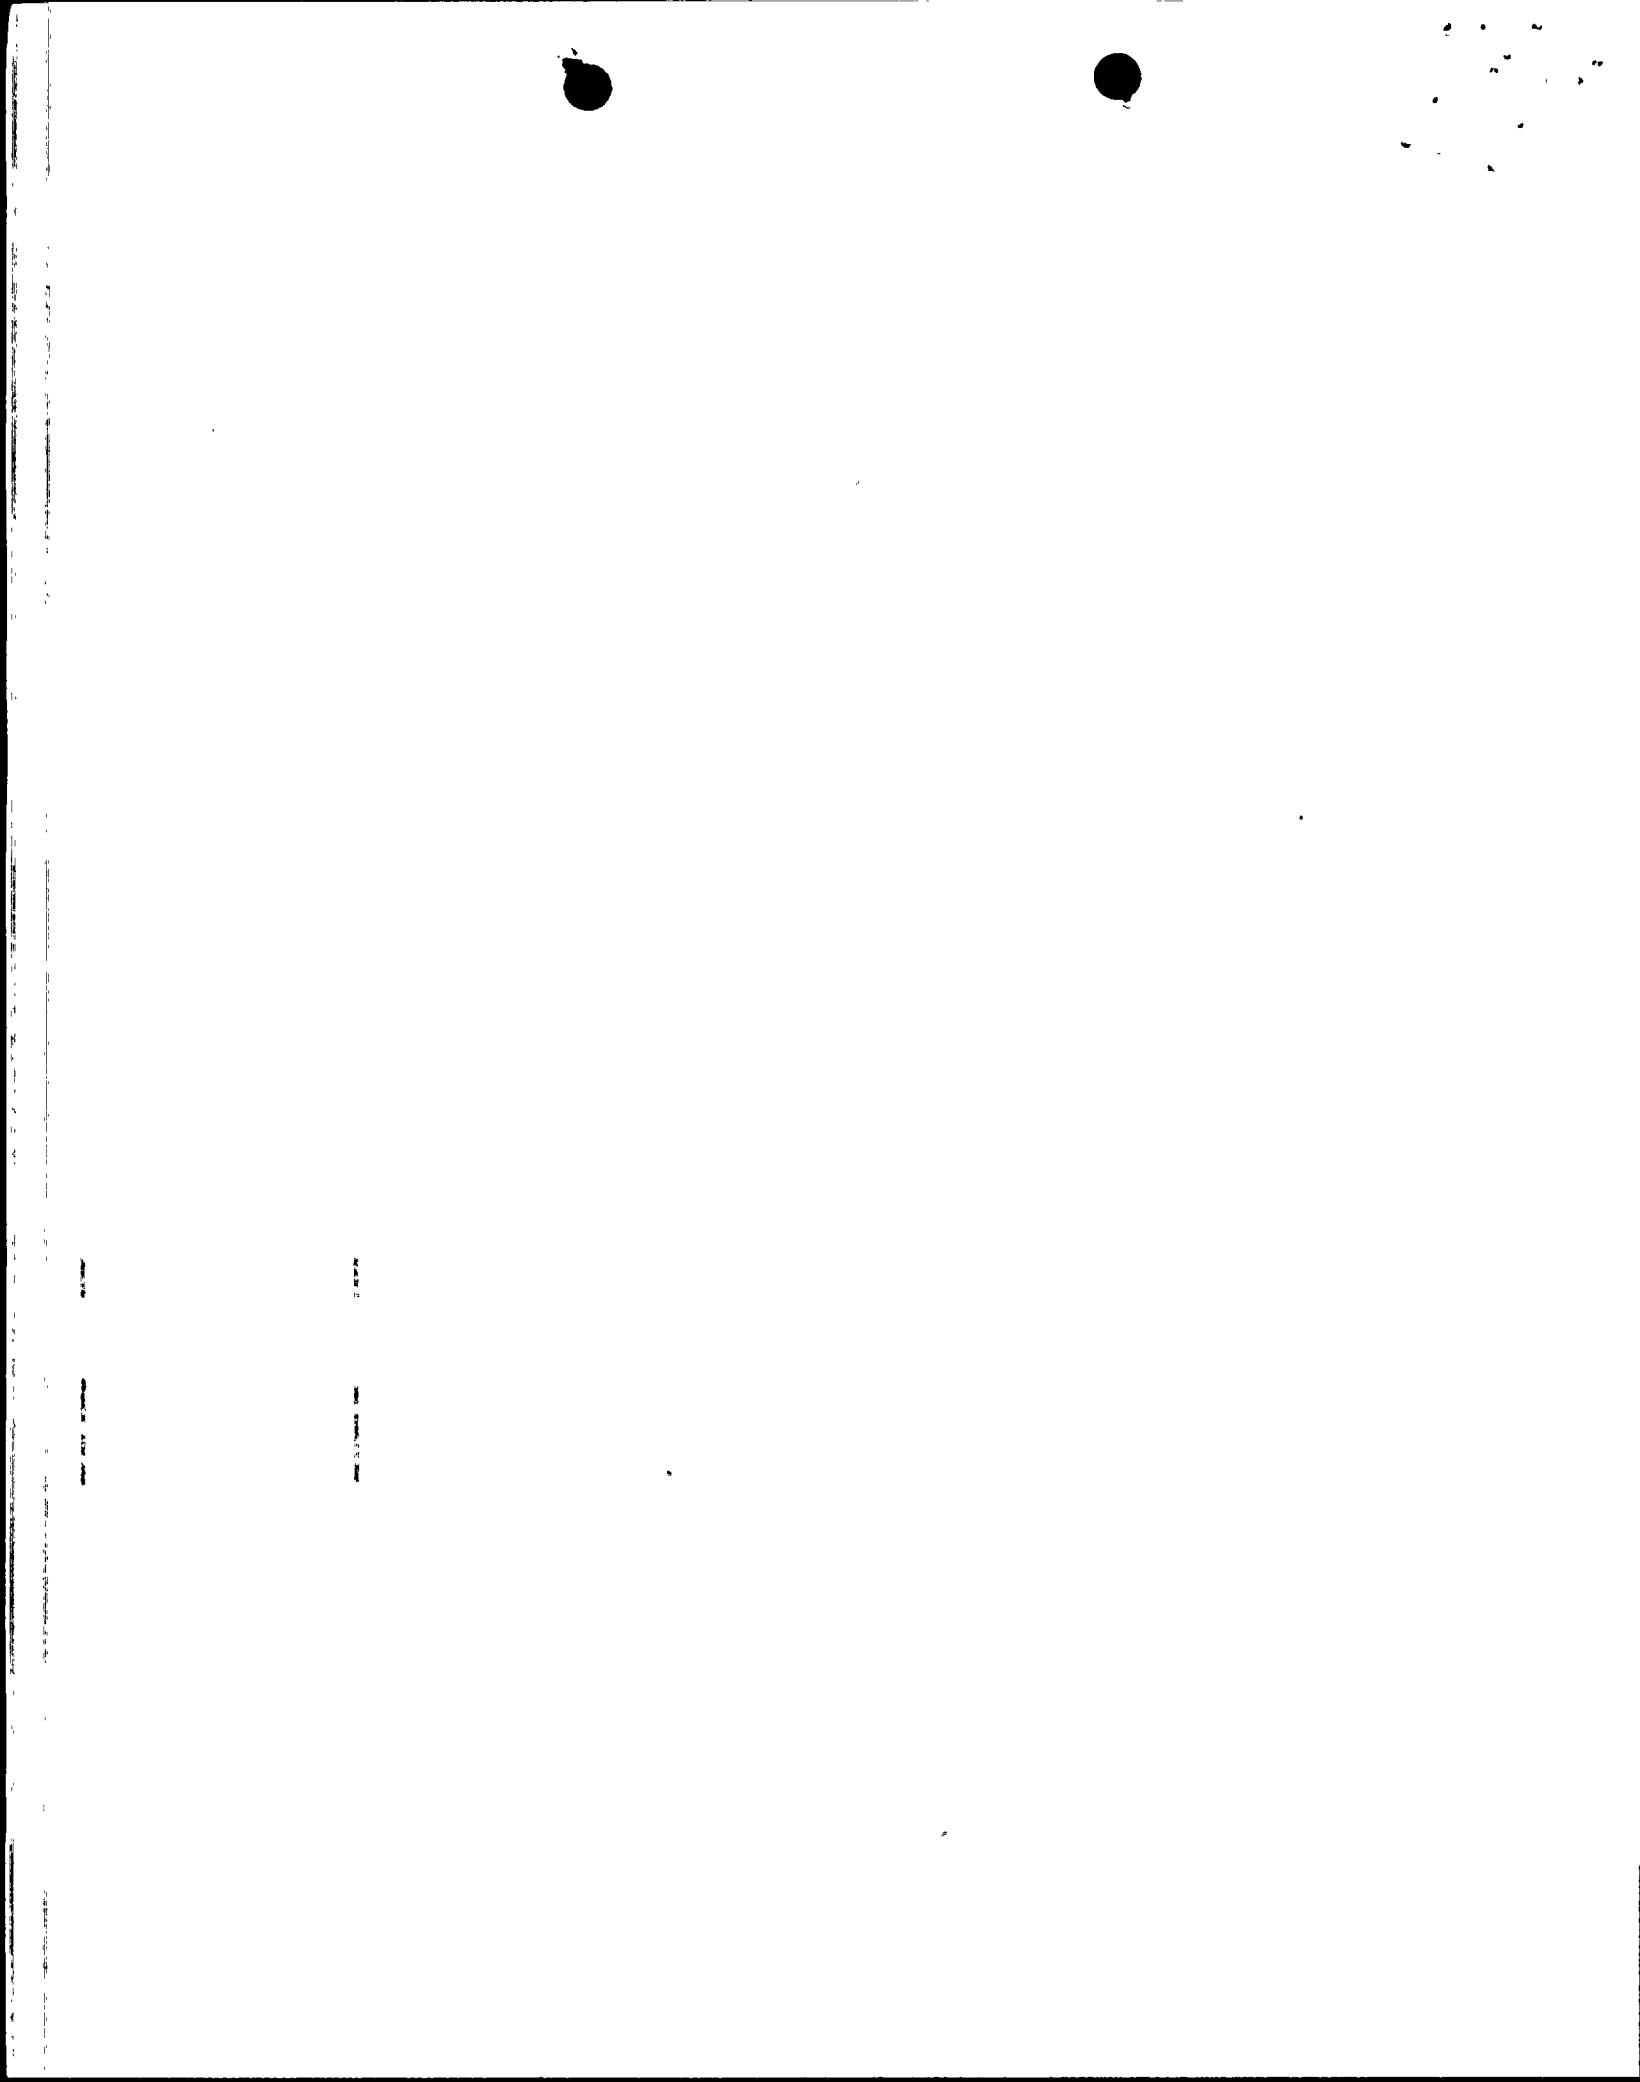

ATTACHMENT 2

The NET ELECTRICAL ENERGY GENERATED (MWH) for Unit 2 during February 1990 was reported as 693,616 megawatt-hours. It should have been reported as 683,616 megawatt-hours, a difference of 10,000 megawatt hours (1.5 percent). The February 1990 Monthly, Year-to-Date, and Cumulative NET ELECTRICAL ENERGY GENERATED and CAPACITY FACTORS have been adjusted to reflect this change. Likewise, the March 1990 and April 1990 Year-to-Date and Cumulative NET ELECTRICAL ENERGY GENERATED and CAPACITY FACTORS have been adjusted accordingly.

