

ACCELERATED DISTRIBUTION DEMONSTRATION SYSTEM

REGULATORY INFORMATION DISTRIBUTION SYSTEM (RIDS)

ACCESSION NBR:9010260070 DOC.DATE: 90/10/15 NOTARIZED: NO DOCKET #
 FACIL:STN-50-528 Palo Verde Nuclear Station, Unit 1, Arizona Publi 05000528
 STN-50-529 Palo Verde Nuclear Station, Unit 2, Arizona Publi 05000529
 STN-50-530 Palo Verde Nuclear Station, Unit 3, Arizona Publi 05000530

AUTH.NAME AUTHOR AFFILIATION
 CONWAY,W.F. Arizona Public Service Co. (formerly Arizona Nuclear Power
 RECIP.NAME RECIPIENT AFFILIATION
 Document Control Branch (Document Control Desk)

SUBJECT: Provides update on status of specific corrective actions
 discussed in 900221 ltr.

DISTRIBUTION CODE: IE01D COPIES RECEIVED:LTR 1 ENCL 0 SIZE: 4
 TITLE: General (50 Dkt)-Insp Rept/Notice of Violation Response

NOTES:STANDARDIZED PLANT 05000528
 Standardized plant. 05000529
 Standardized plant. 05000530


	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL	RECIPIENT ID CODE/NAME	COPIES LTTR ENCL
	PD5 PD	1	PETERSON, S.	1
	TRAMMELL, C.	1		
INTERNAL:	ACRS	2	AEOD	1
	AEOD/DEIIB	1	AEOD/TPAD	1
	DEDRO	1	NRR MORISSEAU, D	1
	NRR SHANKMAN, S	1	NRR/DLPQ/LPEB10	1
	NRR/DREP/PEPB9D	1	NRR/DRIS/DIR	1
	NRR/DST/DIR 8E2	1	NRR/PMAS/ILRB12	1
	NUDOCS-ABSTRACT	1	OE DIR	1
	OGC/HDSL	1	<u>REG FILE</u> 02	1
	RGN5 FILE 01	1		
EXTERNAL:	NRC PDR	1	NSIC	1
NOTES:		1		

NOTE TO ALL "RIDS" RECIPIENTS:

PLEASE HELP US TO REDUCE WASTE! CONTACT THE DOCUMENT CONTROL DESK,
 ROOM P1-37 (EXT. 20079) TO ELIMINATE YOUR NAME FROM DISTRIBUTION
 LISTS FOR DOCUMENTS YOU DON'T NEED!

TOTAL NUMBER OF COPIES REQUIRED: LTTR 24 ENCL ~~24~~

MA 4

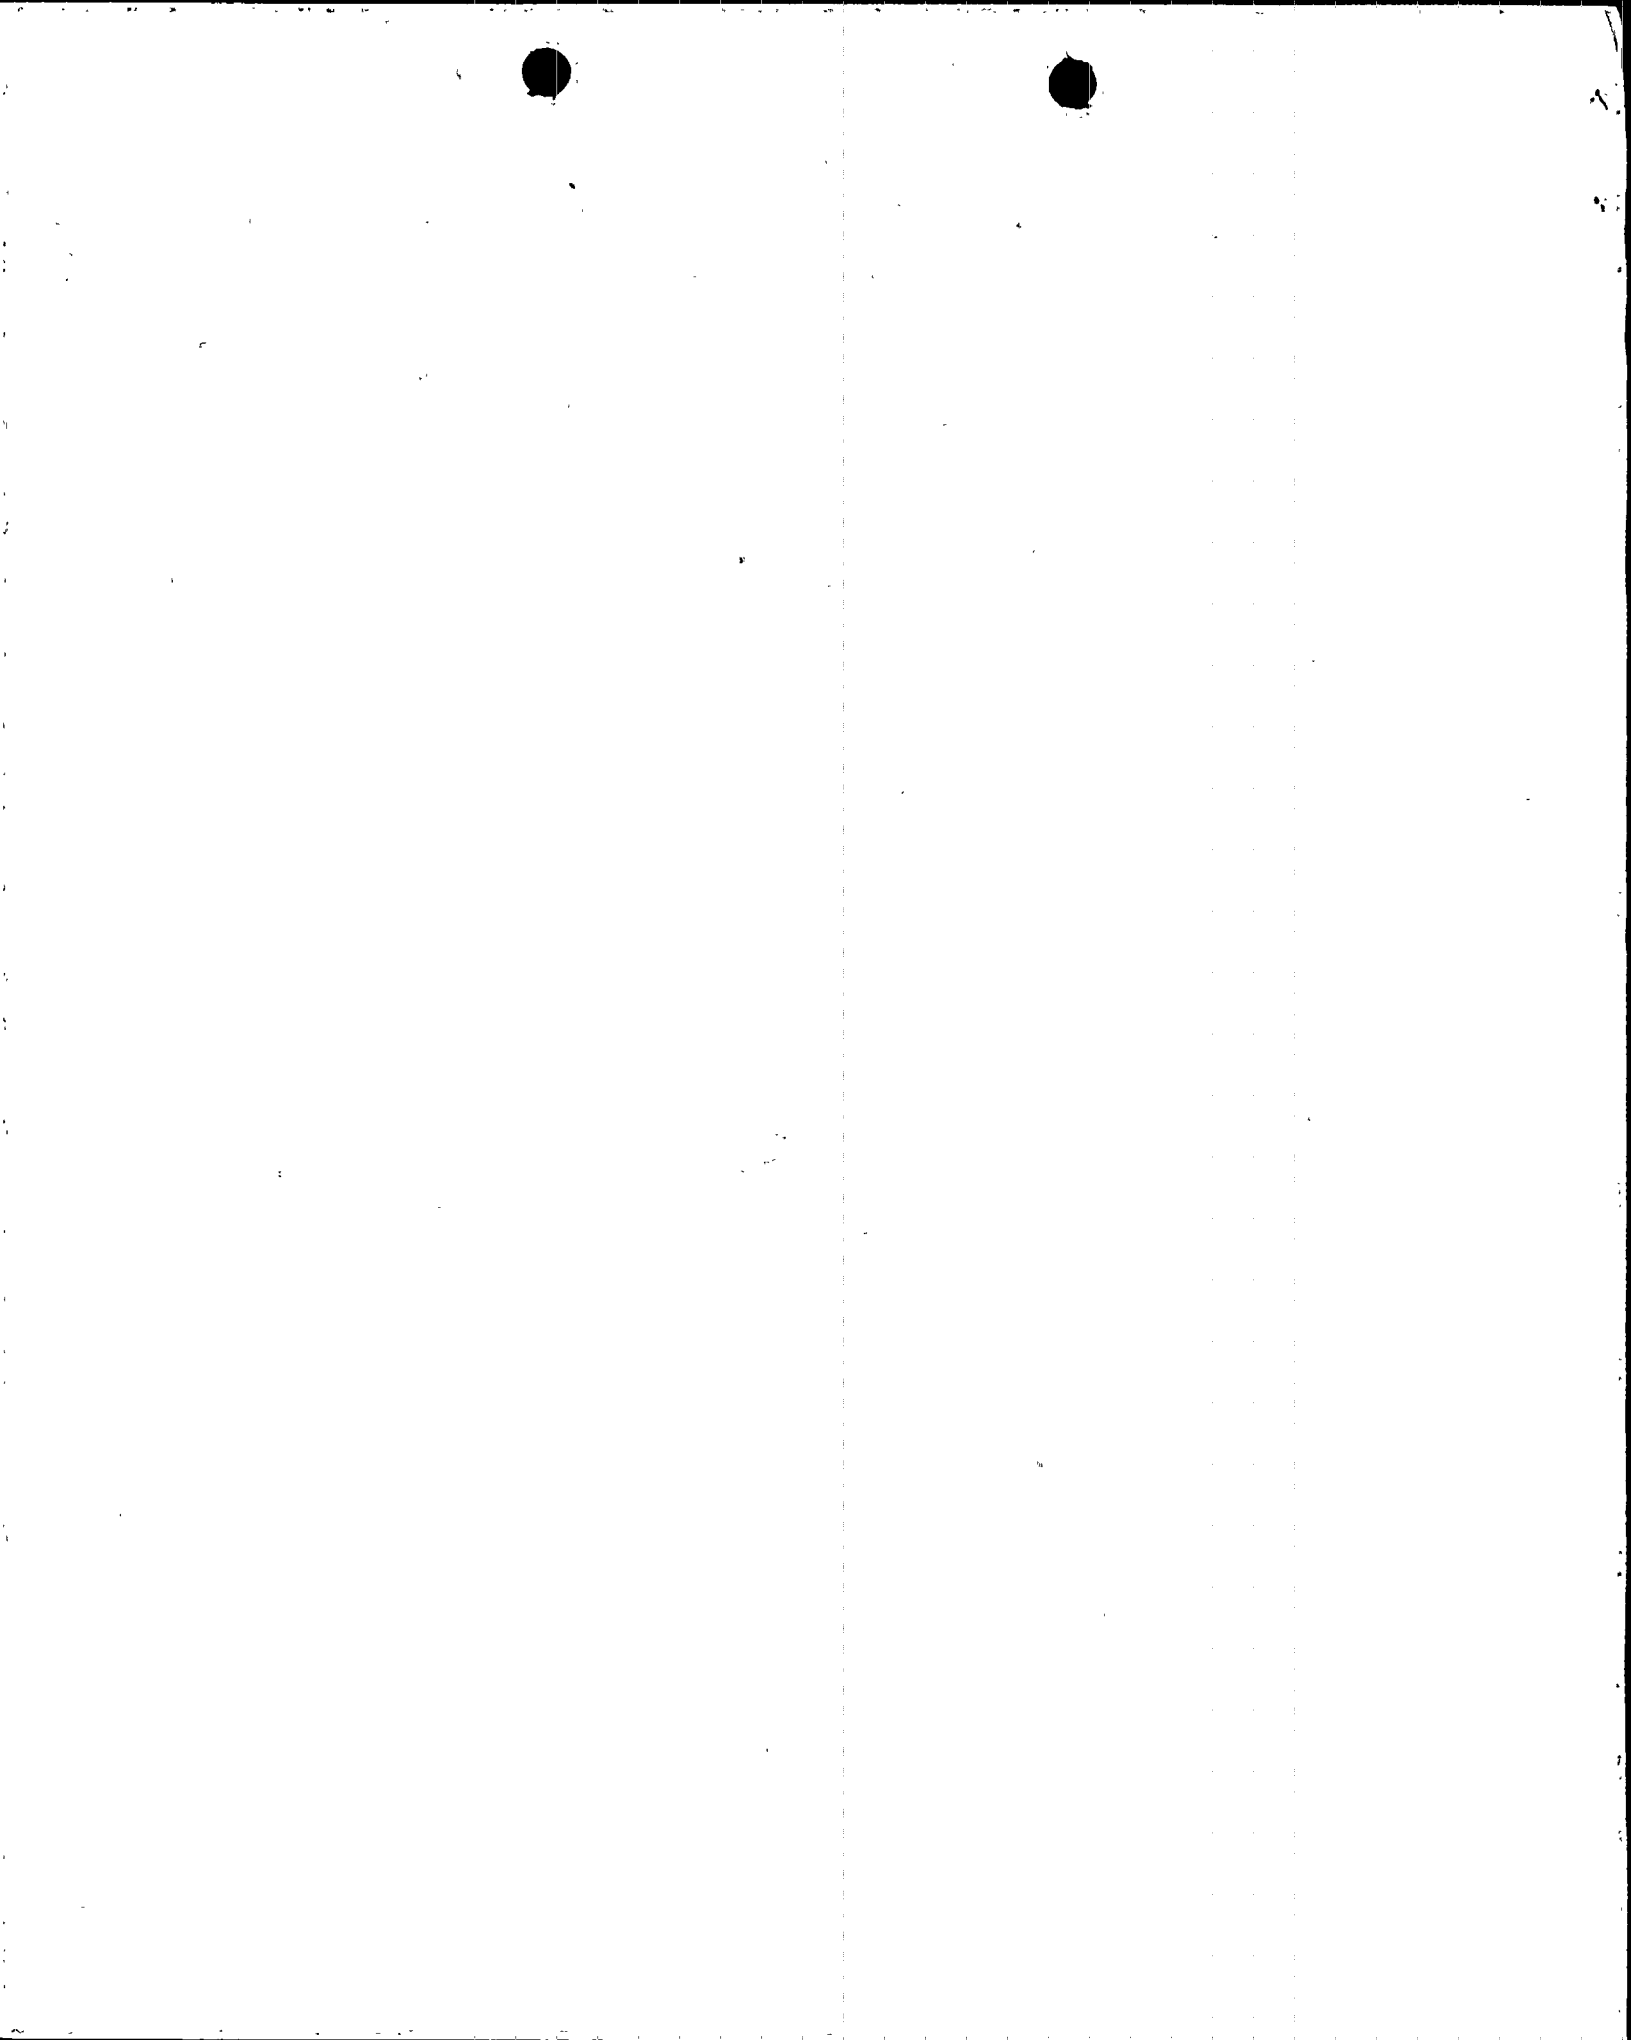

Arizona Public Service Company

P.O. BOX 53999 • PHOENIX, ARIZONA 85072-3999

WILLIAM F. CONWAY
EXECUTIVE VICE PRESIDENT
NUCLEAR

102-01873-WFC/TRB/JJN
October 15, 1990

U. S. Nuclear Regulatory Commission
Attn: Document Control Desk
Mail Station: P1-37
Washington, DC 20555

Reference: Letter from J. N. Bailey, Vice President, Nuclear Safety and
Licensing, Arizona Public Service, to U. S. Nuclear Regulatory
Commission, dated February 21, 1990.

Dear Sir:

Subject: Palo Verde Nuclear Generating Station (PVNGS)
Unit 1, 2, and 3
Docket No. STN 50-528 (License No. NPF-41)
STN 50-529 (License No. NPF-51)
STN 50-530 (License No. NPF-74)
Addendum to Reply to a Notice of Violation - 529/89-03-01
File: 90-070-026

This letter provides an update on the status of specific corrective actions discussed in the Referenced letter. These corrective actions involve:

1. The reorganization of Chemistry and Radiological Effluent Departments.
2. The revision of Radiological Effluent Program and implementing procedures, and
3. The development and implementation of training on the new Radiological Effluent Procedures.

REORGANIZATION

APS has completed the reorganization of the Radiation Protection, Chemistry, Radiological Effluent, and Radiological Waste Departments. This reorganization proceeded more slowly than anticipated and delayed the revision and implementation of the new radiological effluent program and procedures.


PROCEDURES

The Radiological Effluent Program and implementing procedures are being rewritten to provide detailed instruction and/or are being reformatted to facilitate use. The Surveillance Test Procedures (STPs) have been revised and approved. These STP revisions have substantially improved their quality. The remaining effluent procedures are being revised to reflect the completed reorganization. The Radiological Effluent Program and implementing procedures will be revised and approved by October 29, 1990, with an effective date no later than December 31, 1990.

20103

9010260070 901015
PDR ADOCK 0500052B
Q PNU

IE01
1/0

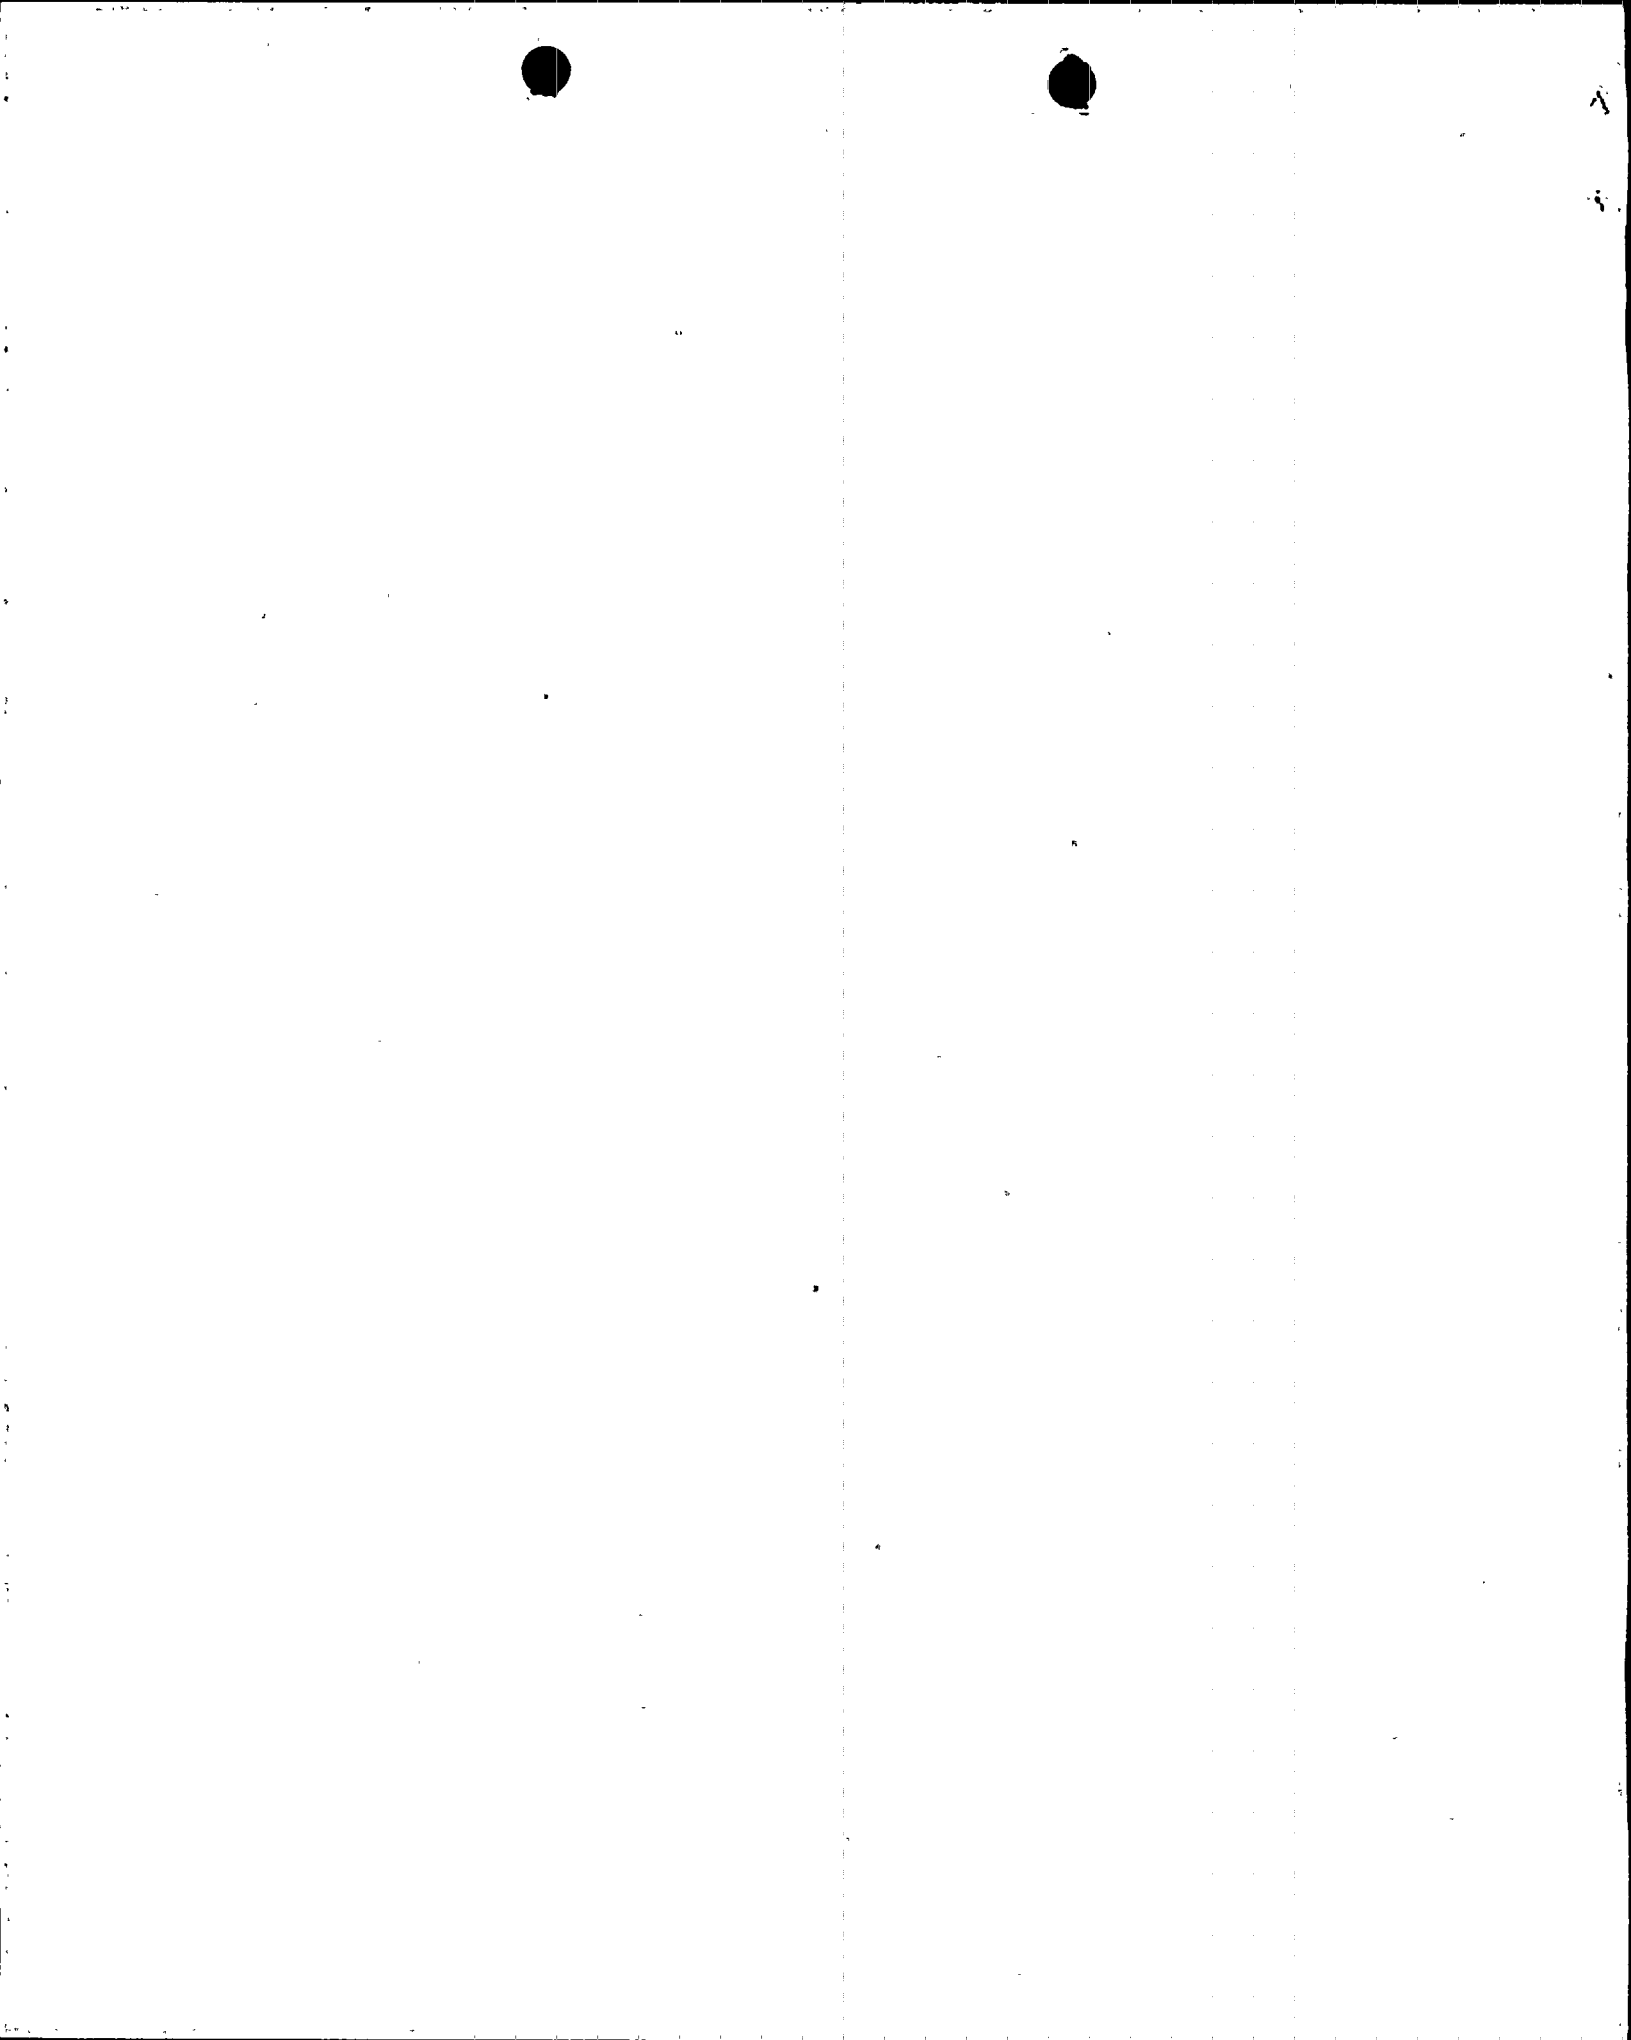

TRAINING

A comprehensive training program for the effluent technicians has been developed and is being implemented. Based on task analysis, training program descriptions have been written that define the training and qualification requirements. The job qualification standards were then developed/revised to reflect the on-the-job training requirements of these program descriptions. In addition to the on-the-job training, a thirteen week classroom initial training program has been developed. Implementation of the thirteen week classroom initial training started on September 11 and is scheduled for completion on December 21, 1990. A continuing training program has been implemented with presentations on dose assessment, effluent release permits, and industry events. In 1990, a total of 120 hours of continuing training has been provided to date.


If you have any questions, please contact me.

Very truly yours,



WFC/TRB/JJN/dmn


cc: J. B. Martin
D. H. Coe
A. H. Gutterman
A. C. Gehr

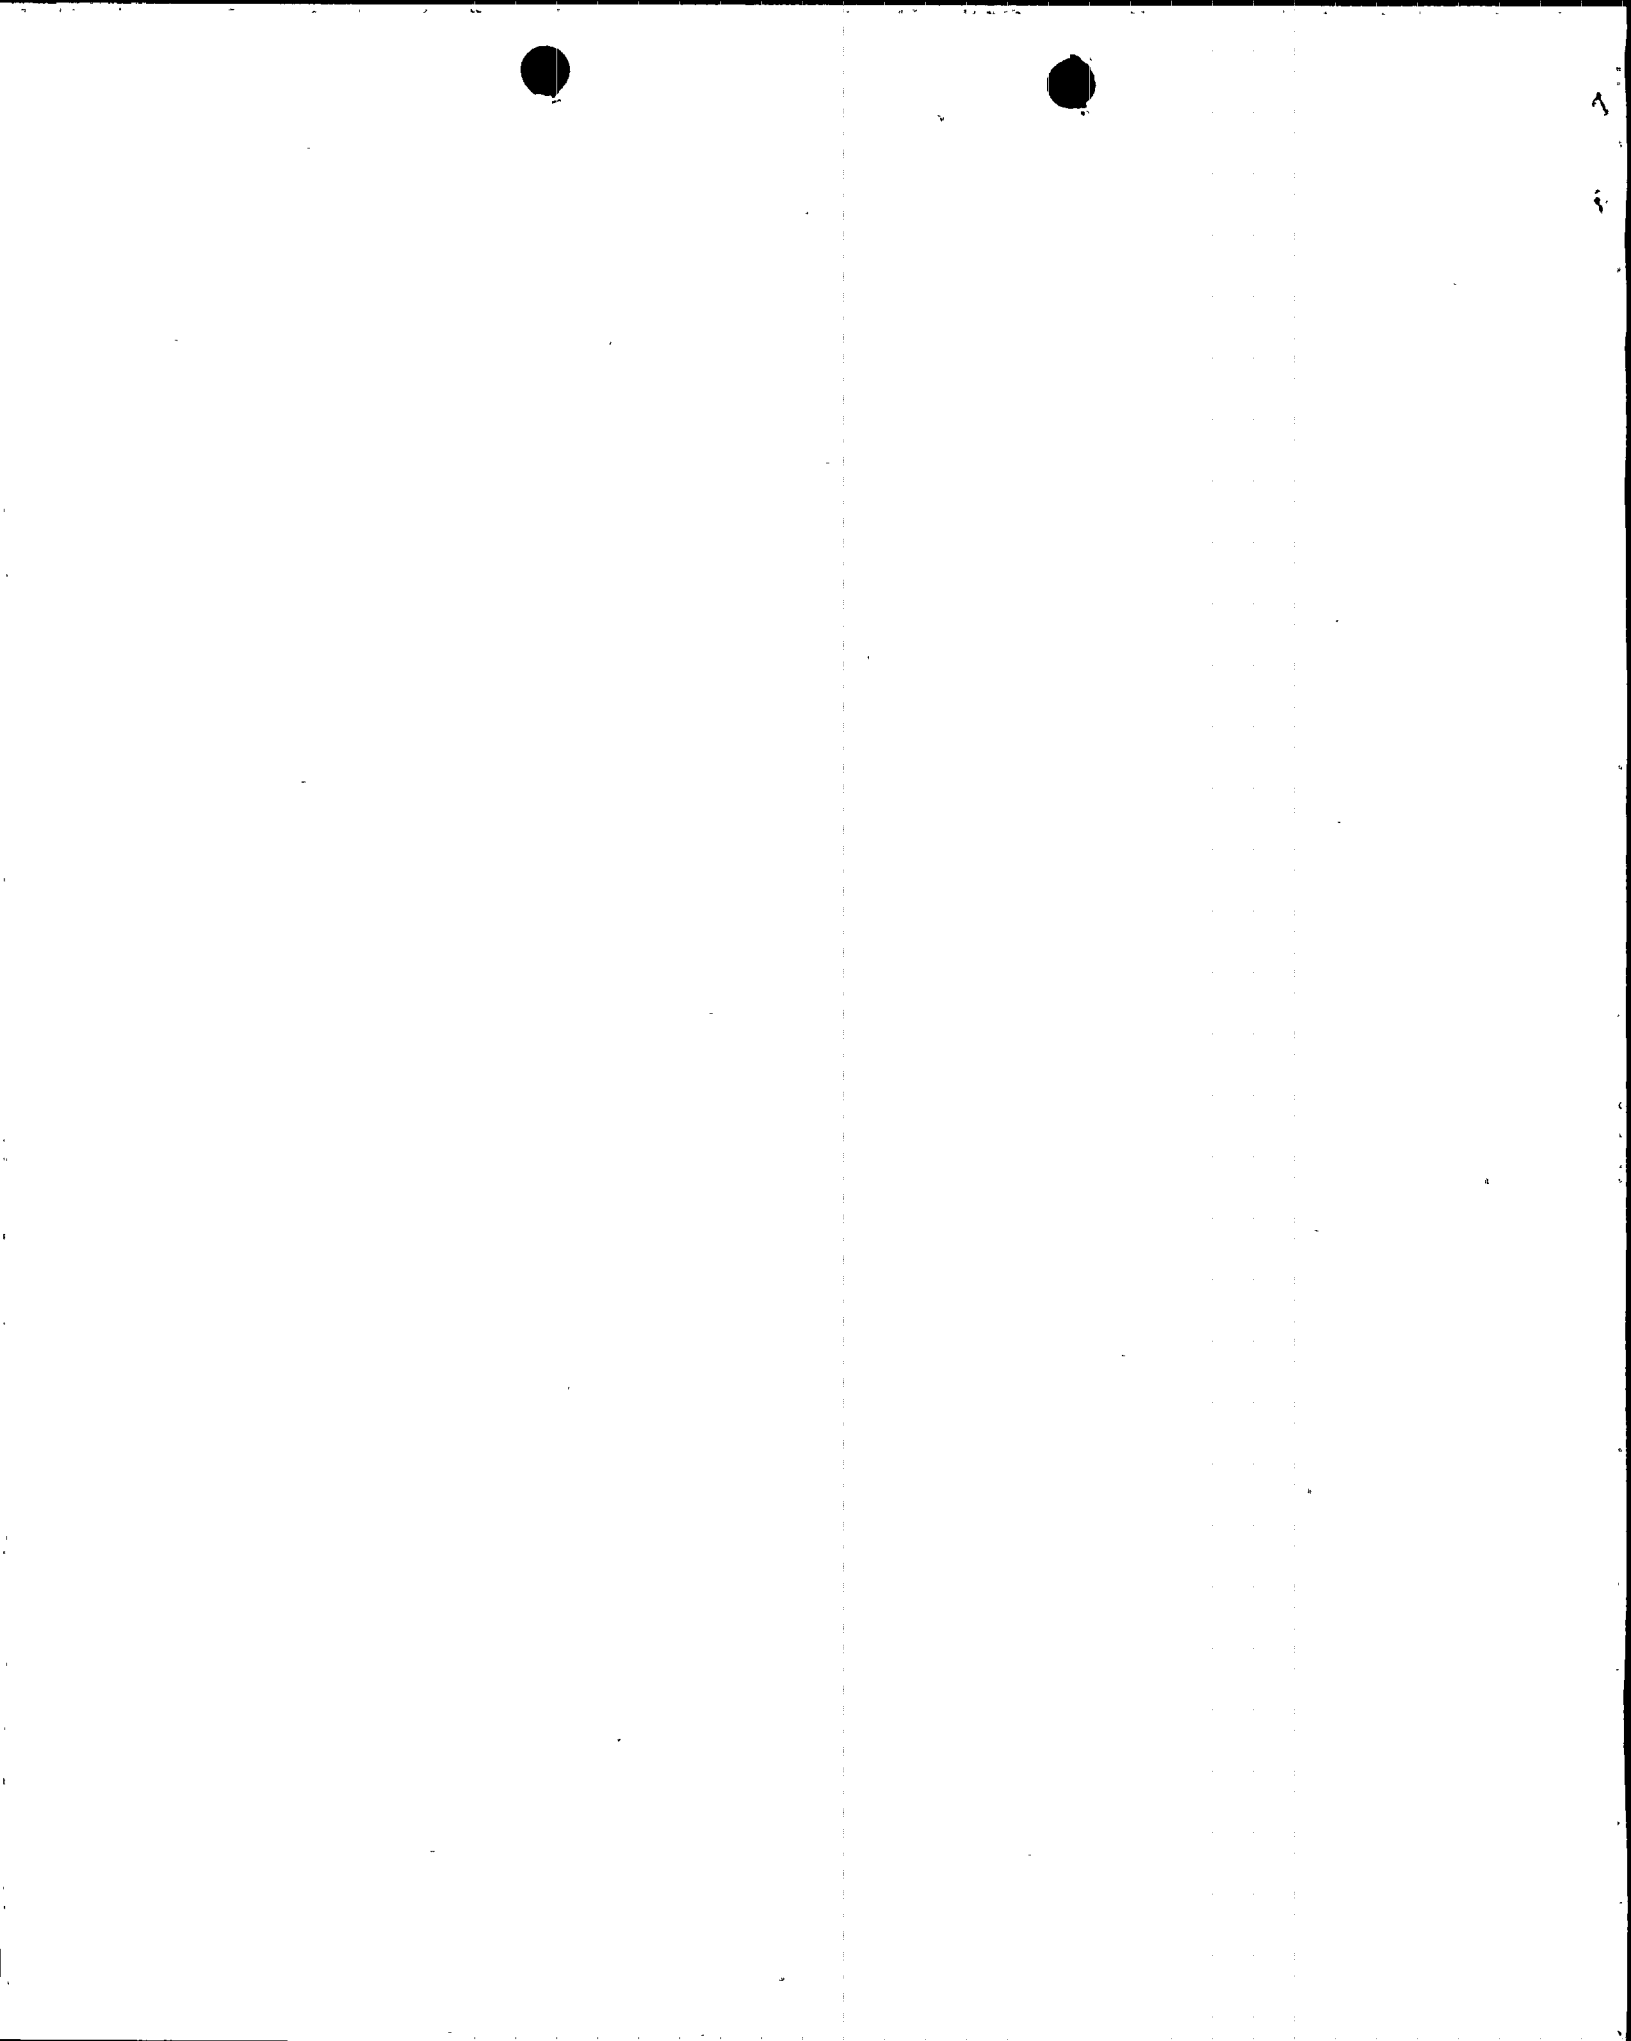

bcc:

J. M. Levine	6125
J. N. Bailey	1966
E. C. Simpson	1962
W. C. Marsh	6123
W. E. Ide	6923
R. K. Flood	7294
R. J. Adney	6915
R. F. Schaller	6932
T. D. Shriver	7294
J. A. Bailey	6915
G. R. Overbeck	7297
P. J. Caudell	6163
Source Document File	6715
B. E. Ballard	6128
W. F. Quinn	1502
E. E. Van Brunt	1922
E. G. Firth (Training)	6155
R. C. Fullmer	6795
G. T. Shell	6794
M. R. Oren (STA)	6079
D. N. Stover (NSD)	1536
J. R. LoCicero (ISEG)	6144
R. W. Page	1938
D. B. Andrews	6345
A. C. Rogers	1515
S. A. Gallinger	6934
P. J. Coffin	6148
B. A. Brown	6148
Responsible Department (required review):	
J. A. Scott	7395
R. D. Sorensen	7295
T. W. Murphy	6986
D. M. Fuller	6932
L. D. Johnson	4118
P. A. Gray	1186

Compliance Manager

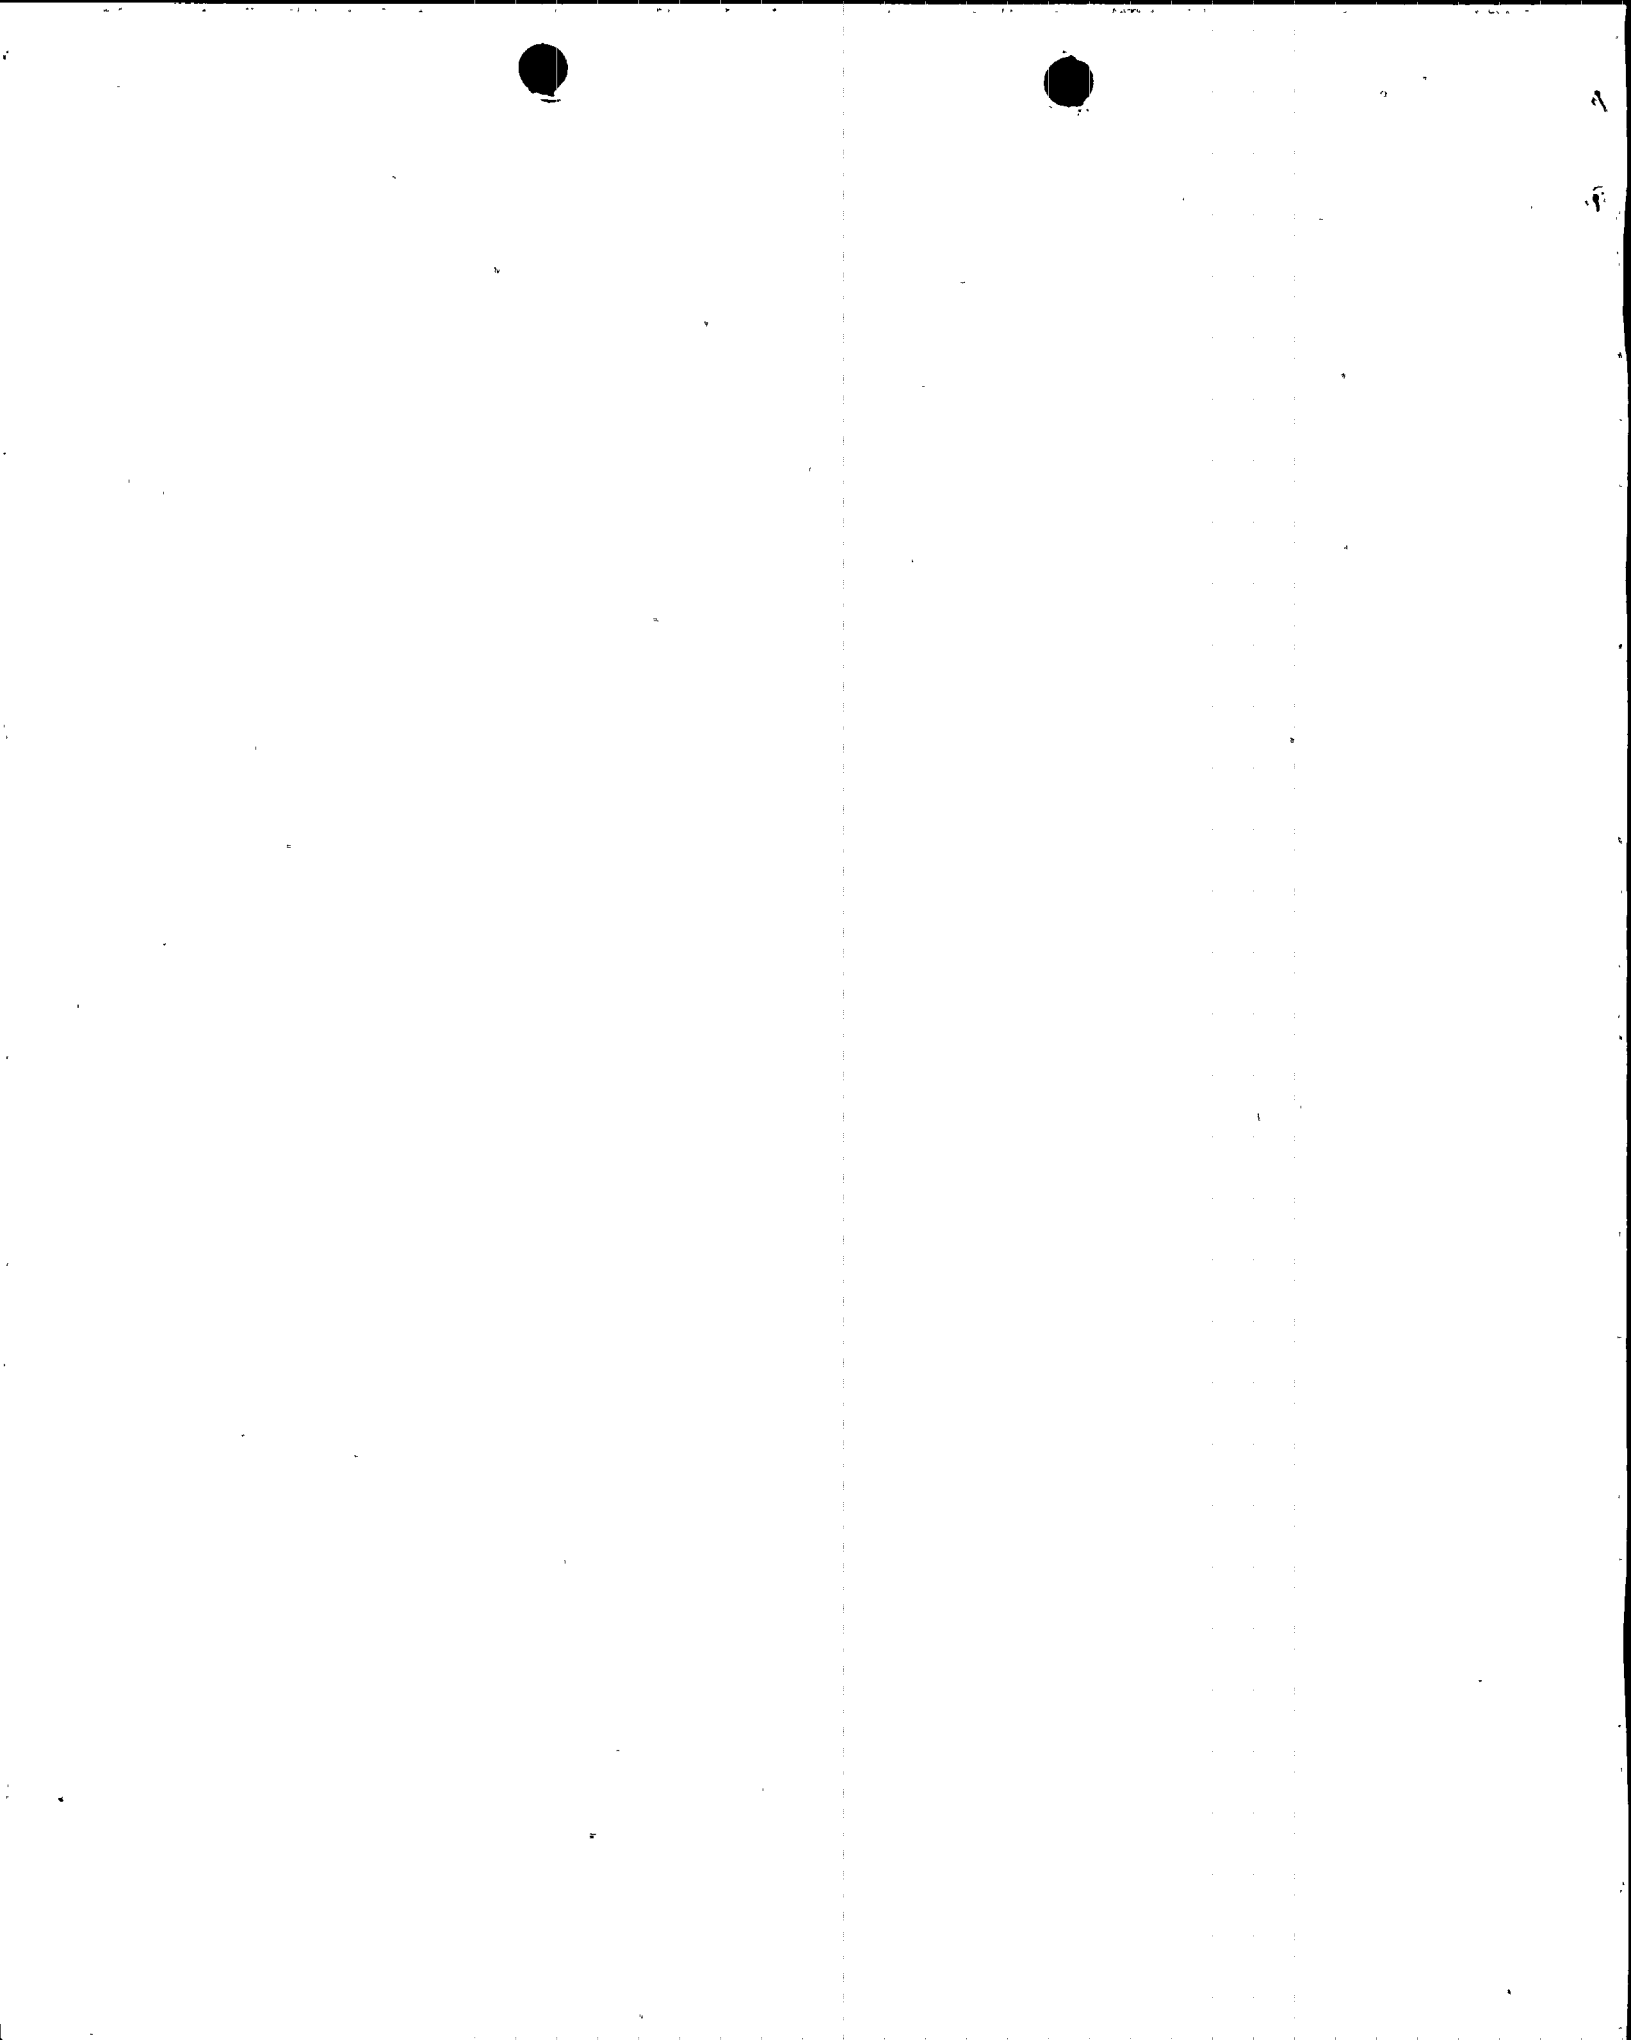

bcc:

J. M. Levine _____
J. N. Bailey _____
E. C. Simpson _____
W. C. Marsh _____
W. E. Ide _____
R. K. Flood _____
R. J. Adney _____
R. F. Schaller _____
T. D. Shriver _____
J. A. Bailey _____
G. R. Overbeck _____
P. J. Caudell _____
Source Document File _____
B. E. Ballard _____
W. F. Quinn _____
E. E. Van Brunt _____
E. G. Firth (Training) _____
R. C. Fullmer _____
G. T. Shell _____
M. R. Oren (STA) _____
D. N. Stover (NSD) _____
J. R. LoCicero (ISEG) _____
R. W. Page _____
D. B. Andrews _____
A. C. Rogers _____
S. A. Gallinger _____
P. J. Coffin _____
B. A. Brown _____
Responsible Department (required review):
J. A. Scott _____
R. D. Sorensen _____
T. W. Murphy _____
D. M. Fuller _____
L. D. Johnson _____
P. A. Gray _____
Compliance Manager _____

