

# FOR INFORMATION ONLY

## INDEX

### DEFINITIONS

<u>SECTION</u>	<u>PAGE</u>
<u>1.0 DEFINITIONS</u>	
1.1 ACTION.....	1-1
1.2 AXIAL SHAPE INDEX.....	1-1
1.3 AZIMUTHAL POWER TILT - $T_q$ .....	1-1
1.4 CHANNEL CALIBRATION.....	1-1
1.5 CHANNEL CHECK.....	1-1
1.6 CHANNEL FUNCTIONAL TEST.....	1-2
1.7 CONTAINMENT INTEGRITY.....	1-2
1.8 CONTROLLED LEAKAGE.....	1-2
1.9 CORE ALTERATION.....	1-2
1.10 DOSE EQUIVALENT I-131.....	1-3
1.11 E-AVERAGE DISINTEGRATION ENERGY.....	1-3
1.12 ENGINEERED SAFETY FEATURES RESPONSE TIME.....	1-3
1.13 FREQUENCY NOTATION.....	1-3
1.14 GASEOUS RADWASTE SYSTEM.....	1-3
1.15 IDENTIFIED LEAKAGE.....	1-3
1.16 $K_{N-1}$ .....	1-4
1.17 MEMBER(S) OF THE PUBLIC.....	1-4
1.18 OFFSITE DOSE CALCULATION MANUAL (ODCM).....	1-4
1.19 OPERABLE - OPERABILITY.....	1-4
1.20 OPERATIONAL MODE - MODE.....	1-4
1.21 PHYSICS TESTS.....	1-4 5
1.22 PLANAR RADIAL PEAKING FACTOR - $F_{xy}$ .....	1-4 5
1.23 PRESSURE BOUNDARY LEAKAGE.....	1-5
1.24 PROCESS CONTROL PROGRAM (PCP).....	1-5
1.25 PURGE - PURGING.....	1-5
1.26 RATED THERMAL POWER.....	1-5
1.27 REACTOR TRIP SYSTEM RESPONSE TIME.....	1-5
1.28 REPORTABLE EVENT.....	1-5 6
1.29 SHUTDOWN MARGIN.....	1-6
1.30 SITE BOUNDARY.....	1-6

9202250217 920214  
PDR ADDCK 05000528  
P PDR



INDEX

DEFINITIONS

<u>SECTION</u>	<u>PAGE</u>
1.31 SOFTWARE.....	1-6
<del>1.32 SOLIDIFICATION.....</del>	<del>1-6</del>
1.33 SOURCE CHECK.....	1-6.
1.34 STAGGERED TEST BASIS.....	1-6
1.35 THERMAL POWER.....	1-6
1.36 UNIDENTIFIED LEAKAGE.....	1-7
1.37 UNRESTRICTED AREA.....	1-7
1.38 VENTILATION EXHAUST TREATMENT SYSTEM.....	1-7
1.39 VENTING.....	1-7

1

2

3

4

5

6

7

8

9

10

11

12

13

14

15

16

17

18

19

20

21

22

23

24

25

26

27

28

29

30



# CONTROLLED BY USER

## INDEX

### LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

<u>SECTION</u>	<u>PAGE</u>
<u>3/4.2 POWER DISTRIBUTION LIMITS</u>	
3/4.2.1 LINEAR HEAT RATE.....	3/4 2-1
3/4.2.2 PLANAR RADIAL PEAKING FACTORS - $F_{xy}$ .....	3/4 2-2
3/4.2.3 AZIMUTHAL POWER TILT - $T_q$ .....	3/4 2-3
3/4.2.4 DNBR MARGIN.....	3/4 2-5
3/4.2.5 RCS FLOW RATE.....	3/4 2-8
3/4.2.6 REACTOR COOLANT COLD LEG TEMPERATURE.....	3/4 2-9
3/4.2.7 AXIAL SHAPE INDEX.....	3/4 2-11
3/4.2.8 PRESSURIZER PRESSURE.....	3/4 2-12
<u>3/4.3 INSTRUMENTATION</u>	
3/4.3.1 REACTOR PROTECTIVE INSTRUMENTATION.....	3/4 3-1
3/4.3.2 ENGINEERED SAFETY FEATURES ACTUATION SYSTEM INSTRUMENTATION.....	3/4 3-17
3/4.3.3 MONITORING INSTRUMENTATION	
RADIATION MONITORING INSTRUMENTATION.....	3/4 3-37
INCORE DETECTORS.....	3/4 3-41
SEISMIC INSTRUMENTATION.....	3/4 3-42
METEOROLOGICAL INSTRUMENTATION.....	3/4 3-45
REMOTE SHUTDOWN SYSTEM.....	3/4 3-48
POST-ACCIDENT MONITORING INSTRUMENTATION.....	3/4 3-57
LOOSE-PART DETECTION INSTRUMENTATION.....	3/4 3-61
<del>EXPLOSIVE GAS</del> <del>RADIOACTIVE GASEOUS EFFLUENT</del> MONITORING INSTRUMENTATION.....	3/4 3-63
<u>3/4.4 REACTOR COOLANT SYSTEM</u>	
3/4.4.1 REACTOR COOLANT LOOPS AND COOLANT CIRCULATION	
STARTUP AND POWER OPERATION.....	3/4 4-1
HOT STANDBY.....	3/4 4-2
HOT SHUTDOWN.....	3/4 4-3
COLD SHUTDOWN - LOOPS FILLED.....	3/4 4-5
COLD SHUTDOWN - LOOPS NOT FILLED.....	3/4 4-6



1944

# FOR INFORMATION ONLY

## INDEX

### LIMITING CONDITIONS FOR OPERATION AND SURVEILLANCE REQUIREMENTS

<u>SECTION</u>	<u>PAGE</u>
3/4.10.4 CEA POSITION, REGULATING CEA INSERTION LIMITS AND REACTOR COOLANT COLD-LEG TEMPERATURE.....	3/4 10-4
3/4.10.5 MINIMUM TEMPERATURE AND PRESSURE FOR CRITICALITY.....	3/4 10-5
3/4.10.6 SAFETY INJECTION TANKS.....	3/4 10-6
3/4.10.7 SPENT FUEL POOL LEVEL.....	3/4 10-7
3/4.10.8 SAFETY INJECTION TANK PRESSURE.....	3/4 10-8
3/4.10.9 SHUTDOWN MARGIN AND $K_{N-1}$ - CEDMS TESTING.....	3/4 10-9
<u>3/4.11 RADIOACTIVE EFFLUENTS</u>	
3/4.11.1 <del>LIQUID HOLDUP TANKS.....</del> <del>SECONDARY SYSTEM LIQUID WASTE DISCHARGES TO ONSITE</del> <del>EVAPORATION PONDS</del>	3/4 11-1
<del>CONCENTRATION.....</del>	<del>3/4 11-1</del>
<del>DOSE.....</del>	<del>3/4 11-5</del>
<del>LIQUID HOLDUP TANKS.....</del>	<del>3/4 11-6</del>
<del>3/4.11.2 GASEOUS EFFLUENTS</del>	
<del>DOSE RATE.....</del>	<del>3/4 11-7</del>
<del>DOSE - NOBLE GASES.....</del>	<del>3/4 11-11</del>
<del>DOSE - IODINE-131, IODINE-133, TRITIUM, AND</del> <del>RADIONUCLIDES IN PARTICULATE FORM.....</del>	<del>3/4 11-12</del>
<del>GASEOUS RADWASTE TREATMENT.....</del>	<del>3/4 11-13</del>
3/4.11.2 EXPLOSIVE GAS MIXTURE.....	3/4 11-14 2
3/4.11.3 GAS STORAGE TANKS.....	3/4 11-15 3
<del>3/4.11.3 SOLID RADIOACTIVE WASTE.....</del>	<del>3/4 11-16</del>
<del>3/4.11.4 TOTAL DOSE.....</del>	<del>3/4 11-18</del>
<u><del>3/4.12 RADIOLOGICAL ENVIRONMENTAL MONITORING</del></u>	
<del>3/4.12.1 MONITORING PROGRAM.....</del>	<del>3/4 12-1</del>
<del>3/4.12.2 LAND USE CENSUS.....</del>	<del>3/4 12-11</del>
<del>3/4.12.3 INTERLABORATORY COMPARISON PROGRAM.....</del>	<del>3/4 12-12</del>

1. The first part of the document is a list of names and addresses of the members of the committee.

2. The second part of the document is a list of names and addresses of the members of the committee.

3. The third part of the document is a list of names and addresses of the members of the committee.

4. The fourth part of the document is a list of names and addresses of the members of the committee.

5. The fifth part of the document is a list of names and addresses of the members of the committee.

6. The sixth part of the document is a list of names and addresses of the members of the committee.

7. The seventh part of the document is a list of names and addresses of the members of the committee.

8. The eighth part of the document is a list of names and addresses of the members of the committee.

9. The ninth part of the document is a list of names and addresses of the members of the committee.

10. The tenth part of the document is a list of names and addresses of the members of the committee.

11. The eleventh part of the document is a list of names and addresses of the members of the committee.

12. The twelfth part of the document is a list of names and addresses of the members of the committee.

13. The thirteenth part of the document is a list of names and addresses of the members of the committee.

14. The fourteenth part of the document is a list of names and addresses of the members of the committee.

15. The fifteenth part of the document is a list of names and addresses of the members of the committee.



INDEXBASES

<u>SECTION</u>	<u>PAGE</u>
3/4.9.7 CRANE TRAVEL - SPENT FUEL STORAGE POOL BUILDING.....	B 3/4 9-2
3/4.9.8 SHUTDOWN COOLING AND COOLANT CIRCULATION.....	B 3/4 9-2
3/4.9.9 CONTAINMENT PURGE VALVE ISOLATION SYSTEM.....	B 3/4 9-3
3/4.9.10 and 3/4.9.11 WATER LEVEL - REACTOR VESSEL and STORAGE POOL .....	B 3/4 9-3
3/4.9.12 FUEL BUILDING ESSENTIAL VENTILATION SYSTEM.....	B 3/4 9-3
<u>3/4.10 SPECIAL TEST EXCEPTIONS</u>	
3/4.10.1 SHUTDOWN MARGIN AND $K_{N-1}$ - CEA WORTH TESTS.....	B 3/4 10-1
3/4.10.2 MODERATOR TEMPERATURE COEFFICIENT, GROUP HEIGHT, INSERTION, AND POWER DISTRIBUTION LIMITS.....	B 3/4 10-1
3/4.10.3 REACTOR COOLANT LOOPS.....	B 3/4 10-1
3/4.10.4 CEA POSITION, REGULATING CEA INSERTION LIMITS AND REACTOR COOLANT COLD LEG TEMPERATURE.....	B 3/4 10-1
3/4.10.5 MINIMUM TEMPERATURE AND PRESSURE FOR CRITICALITY.....	B 3/4 10-1
3/4.10.6 SAFETY INJECTION TANKS.....	B 3/4 10-2
3/4.10.7 SPENT FUEL POOL LEVEL.....	B 3/4 10-2
3/4.10.8 SAFETY INJECTION TANK PRESSURE.....	B 3/4 10-2
3/4.10.9 SHUTDOWN MARGIN AND $K_{N-1}$ - CEDMS TESTING.....	B 3/4 10-2
<u>3/4.11 RADIOACTIVE EFFLUENTS</u>	
3/4.11.1 <del>LIQUID HOLDUP TANKS</del> <del>SECONDARY SYSTEM LIQUID WASTE DISCHARGES TO ONSITE</del> <del>EVAPORATION PONDS</del> .....	B 3/4 11-1
3/4.11.2 <del>EXPLOSIVE GAS MIXTURE</del> <del>GASEOUS EFFLUENTS</del> .....	B 3/4 11-2, 1
3/4.11.3 <del>GAS STORAGE TANKS</del> <del>SOLID RADIOACTIVE WASTE</del> .....	B 3/4 11-2, 1
<del>3/4.11.4 TOTAL DOSE</del> .....	<del>B 3/4 11-2</del>
<u><del>3/4.12 RADIOLOGICAL ENVIRONMENTAL MONITORING</del></u>	
<del>3/4.12.1 MONITORING PROGRAM</del> .....	<del>B 3/4 12-1</del>
<del>3/4.12.2 LAND USE CENSUS</del> .....	<del>B 3/4 12-2</del>
<del>3/4.12.3 INTERLABORATORY COMPARISON PROGRAM</del> .....	<del>B 3/4 12-2</del>

1941

1941

1941

1941

# CONTROLLED BY USER

## INDEX

### ADMINISTRATIVE CONTROLS

---

<u>SECTION</u>	<u>PAGE</u>
6.5.3 NUCLEAR SAFETY GROUP	
FUNCTION.....	6-10
COMPOSITION.....	6-10
CONSULTANTS.....	6-10
REVIEW.....	6-10
AUDITS.....	6-11
AUTHORITY.....	6-12
RECORDS.....	6-12
<u>6.6 REPORTABLE EVENT ACTION.....</u>	6-12
<u>6.7 SAFETY LIMIT VIOLATION.....</u>	6-13
<u>6.8 PROCEDURES AND PROGRAMS.....</u>	6-13
<u>6.9 REPORTING REQUIREMENTS</u>	
6.9.1 ROUTINE REPORTS.....	6-16 18
STARTUP REPORT.....	6-16 18
ANNUAL REPORTS.....	6-17 19
MONTHLY OPERATING REPORT.....	6-18 20
ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT.....	6-18 20
SEMIANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT.....	6-19 20
6.9.2 SPECIAL REPORTS.....	6-20 21
<u>6.10 RECORD RETENTION.....</u>	6-21
<u>6.11 RADIATION PROTECTION PROGRAM.....</u>	6-22
<u>6.12 HIGH RADIATION AREA.....</u>	6-22 23
<u>6.13 PROCESS CONTROL PROGRAM.....</u>	6-23 24



# FOR INFORMATION ONLY

## INDEX

### LIST OF TABLES

	<u>PAGE</u>
3.3-9C REMOTE SHUTDOWN CONTROL CIRCUITS.....	3/4 3-53
4.3-6 REMOTE SHUTDOWN INSTRUMENTATION SURVEILLANCE REQUIREMENTS.....	3/4 3-56
3.3-10 POST-ACCIDENT MONITORING INSTRUMENTATION.....	3/4 3-58
4.3-7 POST-ACCIDENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS.....	3/4 3-60
3.3-11 LOOSE PARTS SENSOR LOCATIONS.....	3/4 3-62
3.3-12 <del>RADIOACTIVE GASEOUS EFFLUENT</del> <sup>EXPLOSIVE GAS</sup> MONITORING INSTRUMENTATION.....	3/4 3-64
4.3-8 <del>RADIOACTIVE GASEOUS EFFLUENT</del> <sup>EXPLOSIVE GAS</sup> MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS.....	3/4 3- <del>64</del> <sup>65</sup>
4.4-1 MINIMUM NUMBER OF STEAM GENERATORS TO BE INSPECTED DURING INSERVICE INSPECTION.....	3/4 4-16
4.4-2 STEAM GENERATOR TUBE INSPECTION.....	3/4 4-17
3.4-1 REACTOR COOLANT SYSTEM PRESSURE ISOLATION VALVES.....	3/4 4-21
3.4-2 REACTOR COOLANT SYSTEM CHEMISTRY.....	3/4 4-23
4.4-3 REACTOR COOLANT SYSTEM CHEMISTRY LIMITS SURVEILLANCE REQUIREMENTS.....	3/4 4-24
4.4-4 PRIMARY COOLANT SPECIFIC ACTIVITY SAMPLE AND ANALYSIS PROGRAM.....	3/4 4-27
3.4-3 REACTOR COOLANT SYSTEM MAXIMUM ALLOWABLE HEATUP AND COOLDOWN RATES.....	3/4 4-28a
4.4-5 REACTOR VESSEL MATERIAL SURVEILLANCE PROGRAM WITHDRAWAL SCHEDULE.....	3/4 4-31
4.6-1 TENDON SURVEILLANCE - FIRST YEAR.....	3/4 6-12
4.6-2 TENDON LIFT-OFF FORCE - FIRST YEAR.....	3/4 6-13
3.6-1 CONTAINMENT ISOLATION VALVES.....	3/4 6-21
3.7-1 STEAM LINE SAFETY VALVES PER LOOPS.....	3/4 7-2

1945

1946

# CONTROLLED BY USER

## INDEX

### LIST OF TABLES

	<u>PAGE</u>
3.7-2 MAXIMUM ALLOWABLE STEADY STATE POWER LEVEL AND MAXIMUM VARIABLE OVERPOWER TRIP SETPOINT WITH INOPERABLE STEAM LINE SAFETY VALVES.....	3/4 7-3
4.7-1 SECONDARY COOLANT SYSTEM SPECIFIC ACTIVITY SAMPLE AND ANALYSIS PROGRAM.....	3/4 7-8
4.8-1 DIESEL GENERATOR TEST SCHEDULE.....	3/4 8-7
3.8-1 D.C. ELECTRICAL SOURCES.....	3/4 8-11
4.8-2 BATTERY SURVEILLANCE REQUIREMENTS.....	3/4 8-12
3.8-2 CONTAINMENT PENETRATION CONDUCTOR OVERCURRENT PROTECTIVE DEVICES.....	3/4 8-19
3.8-3 MOTOR-OPERATED VALVES THERMAL OVERLOAD PROTECTION AND/OR BYPASS DEVICES.....	3/4 8-41
<del>4.11-1 RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS PROGRAM..</del>	<del>3/4 11-2</del>
<del>4.11-2 RADIOACTIVE GASEOUS WASTE SAMPLING AND ANALYSIS PROGRAM.....</del>	<del>3/4 11-8</del>
<del>3.12-1 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM.....</del>	<del>3/4 12-3</del>
<del>3.12-2 REPORTING LEVELS FOR RADIOACTIVITY CONCENTRATIONS IN ENVIRONMENTAL SAMPLES.....</del>	<del>3/4 12-7</del>
<del>4.12-1 DETECTION CAPABILITIES FOR ENVIRONMENTAL SAMPLE ANALYSIS.....</del>	<del>3/4 12-8</del>
B 3/4.4-1 REACTOR VESSEL TOUGHNESS.....	B 3/4 4-8
5.7-1 COMPONENT CYCLIC OR TRANSIENT LIMITS.....	5-7
5.7-2 PRESSURIZER SPRAY NOZZLE USAGE FACTOR.....	5-9
6.2-1 MINIMUM SHIFT CREW COMPOSITION.....	6-5





DEFINITIONS

$K_{N-1}$

1.16  $K_{N-1}$  is the  $k$  effective calculated by considering the actual CEA configuration and assuming that the fully or partially inserted full-length CEA of the highest worth is fully withdrawn.

MEMBER(S) OF THE PUBLIC

1.17 MEMBER(S) OF THE PUBLIC shall include all persons who are not occupationally associated with the plant. This category does not include employees of the licensee, its contractors, or vendors. Also excluded from this category are persons who enter the site to service equipment or to make deliveries. This category does include persons who use portions of the site for recreational, occupational, or other purposes not associated with the plant.

OFFSITE DOSE CALCULATION MANUAL (ODCM) **INSERT 1**

1.18 ~~The OFFSITE DOSE CALCULATION MANUAL shall contain the current methodology and parameters used in the calculation of offsite doses due to radioactive gaseous and liquid effluents, in the calculation of gaseous and liquid effluent monitoring alarm/trip setpoints, and in the conduct of the environmental radiological monitoring program.~~

OPERABLE - OPERABILITY

1.19 A system, subsystem, train, component, or device shall be OPERABLE or have OPERABILITY when it is capable of performing its specified function(s), and when all necessary attendant instrumentation, controls, electrical power, cooling or seal water, lubrication or other auxiliary equipment that are required for the system, subsystem, train, component, or device to perform its function(s) are also capable of performing their related support function(s).

OPERATIONAL MODE - MODE

1.20 An OPERATIONAL MODE (i.e. MODE) shall correspond to any one inclusive combination of core reactivity condition, power level, and cold leg reactor coolant temperature specified in Table 1.2.

PHYSICS TESTS

1.21 PHYSICS TESTS shall be those tests performed to measure the fundamental nuclear characteristics of the reactor core and related instrumentation and (1) described in Chapter 14.0 of the FSAR, (2) authorized under the provisions of 10 CFR 50.59, or (3) otherwise approved by the Commission.

PLANAR RADIAL PEAKING FACTOR -  $F_{xy}$

1.22 The PLANAR RADIAL PEAKING FACTOR is the ratio of the peak to plane average power density of the individual fuel rods in a given horizontal plane, excluding the effects of azimuthal tilt.

move to  
page 1-5

100

100



100



INSERT 1

1.18 The OFFSITE DOSE CALCULATION MANUAL (ODCM) shall contain the methodology and parameters used in the calculation of offsite doses resulting from radioactive gaseous and liquid effluents, in the calculation of gaseous and liquid effluent monitoring Alarm/Trip Setpoints, and in the conduct of the Environmental Radiological Monitoring Program. The ODCM shall also contain (1) the Radioactive Effluent Controls and Radiological Environmental Monitoring Programs required by Section 6.8.4, and (2) descriptions of the information that should be included in the Annual Radiological Environmental Operating and Semiannual Radioactive Effluent Release Reports required by Specifications 6.9.1.7 and 6.9.1.8.

E

# CONTROLLED BY USER

## DEFINITIONS

### PRESSURE BOUNDARY LEAKAGE

1.23 PRESSURE BOUNDARY LEAKAGE shall be leakage (except steam generator tube leakage) through a nonisolable fault in a Reactor Coolant System component body, pipe wall, or vessel wall.

### PROCESS CONTROL PROGRAM (PCP)

INSERT 2

1.24 The PROCESS CONTROL PROGRAM shall contain the provisions to assure that the SOLIDIFICATION of wet radioactive wastes results in a waste form with properties that meet the requirements of 10 CFR Part 61 and of low level radioactive waste disposal sites. The PCP shall identify process parameters influencing SOLIDIFICATION such as pH, oil content, H<sub>2</sub>O content, solids content, ratio of solidification agent to waste and/or necessary additives for each type of anticipated waste, and the acceptable boundary conditions for the process parameters shall be identified for each waste type, based on laboratory scale and full-scale testing or experience. The PCP shall also include an identification of conditions that must be satisfied, based on full-scale testing, to assure that dewatering of bead resins, powdered resins, and filter sludges will result in volumes of free water, at the time of disposal, within the limits of 10 CFR Part 61 and of low level radioactive waste disposal sites.

### PURGE - PURGING

1.25 PURGE or PURGING shall be the controlled process of discharging air or gas from a confinement to maintain temperature, pressure, humidity, concentration, or other operating condition, in such a manner that replacement air or gas is required to purify the confinement.

### RATED THERMAL POWER

1.26 RATED THERMAL POWER shall be a total reactor core heat transfer rate to the reactor coolant of 3800 Mwt.

### REACTOR TRIP SYSTEM RESPONSE TIME

1.27 The REACTOR TRIP SYSTEM RESPONSE TIME shall be the time interval from when the monitored parameter exceeds its trip setpoint at the channel sensor until electrical power is interrupted to the CEA drive mechanism.

### REPORTABLE EVENT

1.28 A REPORTABLE EVENT shall be any of those conditions specified in Sections 50.72 and 50.73 to 10 CFR Part 50.

move to  
page 1-6

[illegible]

1. *Phragmites australis* (Cav.) Trin. ex Steud.



INSERT 2

1.24 The PROCESS CONTROL PROGRAM (PCP) shall contain the current formulas, sampling, analyses, test, and determinations to be made to ensure that processing and packaging of solid radioactive wastes based on demonstrated processing of actual or simulated wet solid wastes will be accomplished in such a way as to assure compliance with 10 CFR Parts 20, 61, and 71, State regulations, burial ground requirements, and other requirements governing the disposal of solid radioactive waste.





# CONTROLLED BY USER

## DEFINITIONS--

### SHUTDOWN MARGIN

1.29 SHUTDOWN MARGIN shall be the instantaneous amount of reactivity by which the reactor is subcritical or would be subcritical from its present condition assuming:

- a. No change in part-length control element assembly position, and
- b. All full-length control element assemblies (shutdown and regulating) are fully inserted except for the single assembly of highest reactivity worth which is assumed to be fully withdrawn.

### SITE BOUNDARY

1.30 The SITE BOUNDARY shall be that line beyond which the land is neither owned, nor leased, nor otherwise controlled by the licensee.

### SOFTWARE

1.31 The digital computer SOFTWARE for the reactor protection system shall be the program codes including their associated data, documentation, and procedures.

### SOLIDIFICATION

~~1.32 SOLIDIFICATION shall be the conversion of radioactive wastes from liquid systems to a homogeneous (uniformly distributed), monolithic, immobilized solid with definite volume and shape, bounded by a stable surface of distinct outline on all sides (free standing).~~

### SOURCE CHECK

<sup>2</sup>  
1.3~~2~~ A SOURCE CHECK shall be the qualitative assessment of channel response when the channel sensor is exposed to a source of increased radioactivity.

### STAGGERED TEST BASIS

- <sup>3</sup>  
1.3~~4~~ A STAGGERED TEST BASIS shall consist of:
- a. A test schedule for n systems, subsystems, trains, or other designated components obtained by dividing the specified test interval into n equal subintervals, and
  - b. The testing of one system, subsystem, train, or other designated component at the beginning of each subinterval.

### THERMAL POWER

<sup>4</sup>  
1.3~~5~~ THERMAL POWER shall be the total reactor core heat transfer rate to the reactor coolant.



# CONTROLLED BY USER

## DEFINITIONS

---

### UNIDENTIFIED LEAKAGE

<sup>35</sup>  
1.3~~5~~ UNIDENTIFIED LEAKAGE shall be all leakage which does not constitute either IDENTIFIED LEAKAGE or reactor coolant pump controlled bleed-off flow.

### UNRESTRICTED AREA

<sup>36</sup>  
1.3~~7~~ An UNRESTRICTED AREA shall be any area at or beyond the SITE BOUNDARY access to which is not controlled by the licensee for purposes of protection of individuals from exposure to radiation and radioactive materials, or any area within the SITE BOUNDARY used for residential quarters or for industrial, commercial, institutional, and/or recreational purposes.

### VENTILATION EXHAUST TREATMENT SYSTEM

<sup>37</sup>  
1.3~~8~~ A VENTILATION EXHAUST TREATMENT SYSTEM shall be any system designed and installed to reduce gaseous radioiodine or radioactive material in particulate form in effluents by passing ventilation or vent exhaust gases through charcoal adsorbers and/or HEPA filters for the purpose of removing iodines or particulates from the gaseous exhaust stream prior to the release to the environment. Such a system is not considered to have any effect on noble gas effluents. Engineered Safety Feature (ESF) atmospheric cleanup systems are not considered to be VENTILATION EXHAUST TREATMENT SYSTEM components.

### VENTING

<sup>38</sup>  
1.3~~9~~ VENTING shall be the controlled process of discharging air or gas from a confinement to maintain temperature, pressure, humidity, concentration, or other operating condition, in such a manner that replacement air or gas is not provided or required during VENTING. Vent, used in system names, does not imply a VENTING process.



170

INSTRUMENTATION

EXPLOSIVE GAS

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

LIMITING CONDITION FOR OPERATION

3.3.3.8 The <sup>explosive gas</sup> ~~radioactive gaseous effluent~~ monitoring instrumentation channels shown in Table 3.3-12 shall be OPERABLE with their alarm/trip setpoints set to ensure that the limits of Specification 3.11.2.1 are not exceeded. ~~The alarm/trip setpoints of these channels shall be determined and adjusted in accordance with the methodology and parameters in the ODCM.~~

APPLICABILITY: As shown in Table 3.3-12.

ACTION:

- a. With <sup>an explosive gas</sup> ~~a low range radioactive gaseous effluent~~ monitoring instrumentation channel alarm/trip setpoint less conservative than required by the above Specification, ~~immediately suspend the release of radioactive gaseous effluents monitored by the affected channel, or declare the channel inoperable, or change the setpoint so it is acceptably conservative.~~ <sup>and take the ACTION shown in Table 3.3-12.</sup>
- b. With less than the minimum number of <sup>explosive gas</sup> ~~radioactive gaseous effluent~~ monitoring instrumentation channels OPERABLE, take the ACTION shown in Table 3.3-12. Restore the inoperable instrumentation to OPERABLE status within 30 days and, if unsuccessful, ~~explain in the next Semi-annual Radioactive Effluent Release Report why this inoperability was not corrected within the time specified.~~ <sup>Prepare and submit a Special Report to the Commission pursuant to Specification 6.9.2 to explain in a timely manner.</sup>
- c. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

SURVEILLANCE REQUIREMENTS

4.3.3.8 Each <sup>explosive gas</sup> ~~radioactive gaseous effluent~~ monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, ~~SOURCE-CHECK, CHANNEL CALIBRATION, and CHANNEL FUNCTIONAL TEST~~ operations at the frequencies shown in Table 4.3-8.



TABLE 3.3-12

~~EXPLOSIVE GAS~~  
~~RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION~~

<u>INSTRUMENT</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABILITY</u>	<u>ACTION</u>
1. GASEOUS RADWASTE SYSTEM			
a. Noble Gas Activity Monitor - Providing Alarm and Automatic Termination of Release #RU-12	DELETE		
	1	#	35
b. Flow Rate Monitor	1	#	36
2. <del>GASEOUS RADWASTE SYSTEM</del> EXPLOSIVE GAS MONITORING SYSTEM			
a. Oxygen Monitor	2	**	39

## ACTION 39 -

With the number of channels OPERABLE one less than required by the Minimum Channels OPERABLE requirement, operation of the GASEOUS RADWASTE SYSTEM may continue provided grab samples are taken and analyzed daily. With both channels inoperable operation may continue provided grab samples are taken and analyzed (1) every 4 hours during degassing operations, and (2) daily during other operations.

\*\* DURING GASEOUS RADWASTE SYSTEM OPERATION.





TABLE 3.3-12 (Continued)

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

<u>INSTRUMENT</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABILITY</u>	<u>ACTION</u>
3. CONDENSER EVACUATION SYSTEM			
A. Low Range Monitors			
a. Noble Gas Activity Monitor #RU-141	1	1, 2, 3,*** 4***	37
b. Iodine Sampler	1	1, 2, 3,*** 4***	40
c. Particulate Sampler	1	1, 2, 3,*** 4***	40
d. Flow Rate Monitor	1	1, 2, 3,*** 4***	36
e. Sampler Flow Rate Measuring Device	1	1, 2, 3,*** 4***	36
B. High Range Monitors			
a. Noble Gas Activity Monitor #RU-142	1	1, 2, 3,*** 4***	42
b. Iodine Sampler	1	1, 2, 3,*** 4***	42
c. Particulate Sampler	1	1, 2, 3,*** 4***	42
d. Sampler Flow Rate Measuring Device	1	1, 2, 3,*** 4***	42
4. PLANT VENT SYSTEM			
A. Low Range Monitors			
a. Noble Gas Activity Monitor #RU-143	1	*	37
b. Iodine Sampler	1	*	40
c. Particulate Sampler	1	*	40
d. Flow Rate Monitor	1	*	36
e. Sampler Flow Rate Measuring Device	1	*	36

CONTROLLED BY USER

117258

TABLE 3.3-12 (Continued)

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

<u>INSTRUMENT</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABILITY</u>	<u>ACTION</u>
4. PLANT VENT SYSTEM (Continued)			
B. High Range Monitors			
a. Noble Gas Activity Monitor #RU-144	1	*	42
b. Iodine Sampler	1	*	42
c. Particulate Sampler	1	*	42
d. Sampler Flow Rate Measuring Device	1	*	42
5. FUEL BUILDING VENTILATION SYSTEM	DELETE		
A. Low Range Monitors			
a. Noble Gas Activity Monitor #RU-145	1	HH	37,41
b. Iodine Sampler	1	HH	40
c. Particulate Sampler	1	HH	40
d. Flow Rate Monitor	1	HH	36
e. Sampler Flow Rate Measuring Device	1	HH	36
B. High Range Monitors			
a. Noble Gas Activity Monitor #RU-146	1	HH	41,42
b. Iodine Sampler	1	HH	42
c. Particulate Sampler	1	HH	42
d. Sampler Flow Rate Measuring Device	1	HH	42

CONTROLLED BY USER



100-100000

100-100000

100-100000

# CONTROLLED BY USER

TABLE 3.3-12 (Continued)

## TABLE NOTATION

DELETE

- \* At all times.
- \*\* During GASEOUS RADWASTE SYSTEM operation.
- \*\*\* Whenever the condenser air removal system is in operation, or whenever turbine glands are being supplied with steam from sources other than the auxiliary boiler(s).
- # During waste gas release.
- ## In MODES 1, 2, 3, and 4 or when irradiated fuel is in the fuel storage pool.

ACTION 35 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, the contents of the tank(s) may be released to the environment provided that prior to initiating the release:

- a. At least two independent samples of the tank's contents are analyzed, and
- b. At least two technically qualified members of the facility staff independently verify the release rate calculations and discharge valve lineup;

Otherwise, suspend release of radioactive effluents via this pathway.

ACTION 36 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided the flow rate is estimated at least once per 4 hours.

ACTION 37 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided the actions of (a) or (b) or (c) are performed:

- a. Initiate the Preplanned Alternate Sampling Program to monitor the appropriate parameter(s).
- b. Place moveable air monitors in-line.
- c. Take grab samples at least once per 12 hours.

ACTION 38 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, immediately suspend PURGING of radioactive effluents via this pathway.

ACTION 39 - With the number of channels OPERABLE one less than required by the Minimum Channels OPERABLE requirement, operation of the GASEOUS RADWASTE SYSTEM may continue provided grab samples are taken and analyzed daily. With both channels inoperable operation may continue provided grab samples are taken and analyzed (1) every 4 hours during degassing operations, and (2) daily during other operations.

100

100

100

100

100

100



# CONTROLLED BY USER

TABLE 3.3-12 (Continued)

## TABLE NOTATION

- ACTION 40 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via the effected pathway may continue provided samples are continuously collected with auxiliary sampling equipment as required in Table 4.11-2 within one hour after the channel has been declared inoperable.
- ACTION 41 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirements, comply with the ACTION b of Specification 3.9.12 or operate the fuel building essential ventilation system while moving irradiated fuel.
- ACTION 42 - With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement restore the channel to OPERABLE status within 72 hours or:
- Initiate the Preplanned Alternate Sampling Program to monitor the appropriate parameter(s) when it is needed.
  - Prepare and submit a Special Report to the Commission pursuant to Specification 6.9.2 within 30 days following the event outlining the action(s) taken, the cause of the inoperability, and the plans and schedule for restoring the system to OPERABLE status.

DELETE

1  
2  
3  
4  
5

1  
2  
3  
4  
5





TABLE 4.3-8

EXPLOSIVE GAS  
RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT</u>	<u>CHANNEL CHECK</u>	<u>SOURCE CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>CHANNEL FUNCTIONAL TEST</u>	<u>MODES IN WHICH SURVEILLANCE IS REQUIRED</u>
1. GASEOUS RADWASTE SYSTEM					
a. Noble Gas Activity Monitor - Providing Alarm and Automatic Termination of Release RU-12	P	P(7)	R(3)	Q(1),(2),P###	#
b. Flow Rate Monitor	P	N.A.	R	Q,P###	#
2. GASEOUS RADWASTE SYSTEM EXPLOSIVE GAS MONITORING SYSTEM					
a. Oxygen Monitor (Surge tank)	D	N.A.	Q(4)	M	**
b. Oxygen Monitor (Waste gas header)	D	N.A.	Q(4)	M	**

(4) The CHANNEL CALIBRATION shall include the use of standard gas samples containing a nominal:

1. One volume percent oxygen, balance nitrogen, and
2. Four volume percent oxygen, balance nitrogen.

\*\* DURING GASEOUS RADWASTE SYSTEM OPERATION

100-100000

100-100000

100-100000

TABLE 4.3-8 (Continued)

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT</u>	<u>CHANNEL CHECK</u>	<u>SOURCE CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>CHANNEL FUNCTIONAL TEST</u>	<u>MODES IN WHICH SURVEILLANCE IS REQUIRED</u>
3. CONDENSER EVACUATION SYSTEM (RU-141 and RU-142)					
a. Noble Gas Activity Monitor	D(5)	M(7)	R(3)	Q(2)	1, 2, 3,*** 4***
b. Iodine Sampler	N.A.	N.A.	N.A.	N.A.	1, 2, 3,*** 4***
c. Particulate Sampler	N.A.	N.A.	N.A.	N.A.	1, 2, 3,*** 4***
d. Flow Rate Monitor	D(6)	N.A.	R	Q	1, 2, 3,*** 4***
e. Sampler Flow Rate Measuring Device	D(6)	N.A.	R	Q	1, 2, 3,*** 4***
DELETE					
4. PLANT VENT SYSTEM (RU-143 and RU-144)					
a. Noble Gas Activity Monitor	D(5)	M(7)	R(3)	Q(2)	*
b. Iodine Sampler	N.A.	N.A.	N.A.	N.A.	*
c. Particulate Sampler	N.A.	N.A.	N.A.	N.A.	*
d. Flow Rate Monitor	D(6)	N.A.	R	Q	*
e. Sampler Flow Rate Measuring Device	D(6)	N.A.	R	Q	*

PALO VERDE - UNIT 1

3/4 3-70

AMENDMENT NO. 56

FOR INFORMATION ONLY



11  
12  
13  
14  
15  
16  
17  
18  
19  
20  
21  
22  
23  
24  
25  
26  
27  
28  
29  
30  
31  
32  
33  
34  
35  
36  
37  
38  
39  
40  
41  
42  
43  
44  
45  
46  
47  
48  
49  
50  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65  
66  
67  
68  
69  
70  
71  
72  
73  
74  
75  
76  
77  
78  
79  
80  
81  
82  
83  
84  
85  
86  
87  
88  
89  
90  
91  
92  
93  
94  
95  
96  
97  
98  
99  
100

TABLE 4.3-8 (Continued)

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT</u>	<u>CHANNEL CHECK</u>	<u>SOURCE CHECK</u>	<u>CHANNEL CALIBRATION</u>	<u>CHANNEL FUNCTIONAL TEST</u>	<u>MODES IN WHICH SURVEILLANCE IS REQUIRED</u>
5. FUEL BUILDING VENTILATION SYSTEM (RU-145 and RU-146)					
a. Noble Gas Activity Monitor	D(5)	M(7)	R(3)	Q(2)	##
b. Iodine Sampler	N.A.	N.A.	N.A.	N.A.	##
c. Particulate Sampler	N.A.	N.A.	N.A.	N.A.	##
d. Flow Rate Monitor	D(6)	N.A.	R	Q	##
e. Sampler Flow Rate Measuring Device	D(6)	N.A.	R	Q	##

DELETE

PALO VERDE - UNIT 1

3/4 3-71

AMENDMENT NO. 56

FOR INFORMATION ONLY



# FOR INFORMATION ONLY

TABLE 4.3-8 (Continued)

## TABLE NOTATIONS

- \* At all times.
  - \*\* During GASEOUS RADWASTE SYSTEM operation.
  - \*\*\* Whenever the condenser air removal system is in operation, or whenever turbine glands are being supplied with steam from sources other than the auxiliary boiler(s).
  - # During waste gas release.
  - ## During MODES 1, 2, 3 or 4 or with irradiated fuel in the fuel storage pool.
  - ### Functional test should consist of, but not be limited to, a verification of system isolation capability by the insertion of a simulated alarm condition.
- (1) The CHANNEL FUNCTIONAL TEST shall also demonstrate that automatic isolation of this pathway occurs if the instrument indicates measured levels above the alarm/trip setpoint.
  - (2) The CHANNEL FUNCTIONAL TEST shall also demonstrate that control room alarm annunciation occurs if any of the following conditions exists:
    1. Instrument indicates measured levels above the alarm setpoint.
    2. Circuit failure.
    3. Instrument indicates a downscale failure.
    4. Instrument controls not set in operate mode.
  - (3) The initial CHANNEL CALIBRATION shall be performed using one or more of the reference standards certified by the National Bureau of Standards (NBS) or using standards that have been obtained from suppliers that participate in measurement assurance activities with NBS. These standards shall permit calibrating the system over its intended range of energy and measurement range. For subsequent CHANNEL CALIBRATION, sources that have been related to the initial calibration shall be used.
  - (4) The CHANNEL CALIBRATION shall include the use of standard gas samples containing a nominal:
    1. One volume percent oxygen, balance nitrogen, and
    2. Four volume percent oxygen, balance nitrogen.
  - (5) The channel check for channels in standby status shall consist of verification that the channel is "on-line and reachable."
  - (6) Daily channel check not required for flow monitors in standby status.
  - (7) LED may be utilized as the check source in lieu of a source of increased radioactivity.





# FOR INFORMATION ONLY

## 3/4.11 RADIOACTIVE EFFLUENTS

### 3/4.11.1 SECONDARY SYSTEM LIQUID WASTE DISCHARGES TO ONSITE EVAPORATION PONDS CONCENTRATION

#### LIMITING CONDITION FOR OPERATION

3.11.1.1 The concentration of radioactive material discharged from secondary system liquid waste to the onsite evaporation ponds shall be limited to the lower limit of detectability (LLD) defined as  $5 \times 10^{-7}$   $\mu\text{Ci/ml}$  for the principal gamma emitters or  $1 \times 10^{-6}$   $\mu\text{Ci/ml}$  for I-131.

APPLICABILITY: MODES 1, 2, 3, and 4.

#### ACTION:

When any secondary system liquid waste discharge pathway concentration determined in accordance with the surveillance requirements given below exceeds the specified LLD, divert that discharge pathway to the liquid radwaste system without delay or process the liquid wastes to meet the specified limits prior to release to the onsite evaporation ponds.

#### SURVEILLANCE REQUIREMENTS

4.11.1.1.1 Radioactive liquid wastes collected in the chemical waste neutralizer tank shall be sampled and analyzed prior to their batchwise discharge to the onsite evaporation pond in accordance with the sampling and analysis program specified in Table 4.11-1.

4.11.1.1.2 With the concentration of radioactive material in the chemical waste neutralizer tank exceeding the specified LLD, sample and analyze other secondary system discharge pathways in accordance with the sampling and analysis program specified in Table 4.11-1.

DELETE

(31070)

CONTROLLED BY USER

TABLE 4.11-1

RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS PROGRAM

SECONDARY SYSTEM LIQUID RELEASE PATHWAY	SAMPLING FREQUENCY	MINIMUM ANALYSIS FREQUENCY	TYPE OF ACTIVITY ANALYSIS	LOWER LIMIT OF DETECTION (LLD) <sup>a</sup> ( $\mu\text{Ci/mL}$ )
<b>A. Batch discharges<sup>b</sup></b>				
1. Chemical Waste Neutralizer Tank	P Each Batch	P Each Batch	Principal Gamma Emitters <sup>c</sup>	$5 \times 10^{-7}$
			I-131	$1 \times 10^{-6}$
2. Steam Generator Blowdown Low TDS Sump*	P Each Batch	P Each Batch	Principal Gamma Emitters <sup>c</sup>	$5 \times 10^{-7}$
			I-131	$1 \times 10^{-6}$
3. Condensate Polishing Low TDS Sump*	P Each Batch	P Each Batch	Principal Gamma Emitters <sup>c</sup>	$5 \times 10^{-7}$
			I-131	$1 \times 10^{-6}$
<b>B. Continuous Releases<sup>d</sup></b>				
1. Turbine Building Sump*	D Grab Sample	D Grab Sample	Principal Gamma Emitters <sup>c</sup>	$5 \times 10^{-7}$
			I-131	$1 \times 10^{-6}$
2. Condenser Area Sumps*	D Grab Sample	D Grab Sample	Principal Gamma Emitters <sup>c</sup>	$5 \times 10^{-7}$
			I-131	$1 \times 10^{-6}$

DELETE

\*Sampling and analysis for pathways 2 and 3 under batch discharges and 1 and 2 under continuous releases are required only when concentration for chemical waste neutralizer tank pathway exceeds the LLD.



# CONTROLLED BY USER

TABLE 4.11-1 (Continued)

## TABLE NOTATION

The LLD is defined, for purposes of these specifications, as the smallest concentration of radioactive material in a sample that will yield a net count, above system background, that will be detected with 95% probability with only 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system, which may include radiochemical separation:

$$LLD = \frac{4.66 s_b}{E \cdot V \cdot 2.22 \times 10^6 \cdot Y \cdot \exp(-\lambda \Delta t)}$$

Where:

LLD is the "a priori" lower limit of detection as defined above, as microcuries per unit mass or volume,

$s_b$  is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate, as counts per minute,

E is the counting efficiency, as counts per disintegration,

V is the sample size in units of mass or volume,

$2.22 \times 10^6$  is the number of disintegrations per minute per microcurie,

Y is the fractional radiochemical yield, when applicable,

$\lambda$  is the radioactive decay constant for the particular radionuclide, and

$\Delta t$  for plant effluents is the elapsed time between the midpoint of sample collection and time of counting.

Typical values of E, V, Y, and  $\Delta t$  should be used in the calculation.

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as an a posteriori (after the fact) limit for a particular measurement.

<sup>b</sup> A batch release is the discharge of liquid wastes of a discrete volume. Prior to sampling for analyses, each batch shall be isolated, and then thoroughly mixed to assure representative sampling.

DELETE

100

100

100

100

100

100

100

100

# CONTROLLED BY USER

TABLE 4.11-1 (Continued)

## TABLE NOTATION

<sup>c</sup>The principal gamma emitters for which the LLD specification applies include the following radionuclides: Mn-54, Fe-59, Co-58, Co-60, Zn-65, Mo-99, Cs-134, Cs-137 and Ce-141. Ce-144 shall also be measured, but with an LLD of  $5 \times 10^{-6}$ . This list does not mean that only these nuclides are to be considered. Other gamma peaks that are identifiable, together with those of the above nuclides, shall also be analyzed and reported in the Semiannual Radioactive Effluent Release Report pursuant to Specification 6.9.1.8.

<sup>d</sup>A continuous release is the discharge of liquid wastes of a nondiscrete volume, e.g., from a volume of a system that has an input flow during the continuous release.

DELETE

11

12

13

14

15

16

17

18





# CONTROLLED BY USER

## RADIOACTIVE EFFLUENTS

### DOSE

## LIMITING CONDITION FOR OPERATION

3.11.1.2 The dose or dose commitment to a MEMBER OF THE PUBLIC from radioactive materials in liquid effluents released, from each reactor unit, to areas at and beyond the SITE BOUNDARY (See Figure 5.1-1) shall be limited:

- a. During any calendar quarter to less than or equal to 1.5 mrems to the total body and to less than or equal to 5 mrems to any organ, and
- b. During any calendar year to less than or equal to 3 mrems to the total body and to less than or equal to 10 mrems to any organ.

APPLICABILITY: At all times.

### ACTION:

- a. With the calculated dose from the release of radioactive materials in liquid effluents exceeding any of the above limits, prepare and submit to the Commission within 30 days, pursuant to Specification 6.9.2, a Special Report that identifies the cause(s) for exceeding the limit(s) and defines the corrective actions that have been taken to reduce the releases and the proposed corrective actions to be taken to assure that subsequent releases will be in compliance with the above limits.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

## SURVEILLANCE REQUIREMENTS

4.11.1.2 Cumulative dose contributions from liquid effluents for the current calendar quarter and the current calendar year shall be determined in accordance with the methodology and parameters in the ODCM at least once per 31 days.

(17/11/1941)

# CONTROLLED BY USER

3/4.11 RADIOACTIVE EFFLUENTS

3/4.11.1 LIQUID HOLDUP TANKS

## LIMITING CONDITION FOR OPERATION

3.11.1.1. The quantity of radioactive material contained in each outside temporary tank and the reactor makeup water tank shall be limited to less than or equal to 60 curies, excluding tritium and dissolved or entrained noble gases.

APPLICABILITY: At all times.

### ACTION:

- a. With the quantity of radioactive material in any outside temporary tank or the reactor makeup water tank exceeding the above limit, immediately suspend all additions of radioactive material to the tank and within 48 hours reduce the tank contents to within the limit.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

## SURVEILLANCE REQUIREMENTS

4.11.1.1. The quantity of radioactive material contained in each outside temporary tank and the reactor makeup water tank shall be determined to be within the above limit by analyzing a representative sample of the tank's contents at least once per 7 days when radioactive materials are being added to the tank.

207

1

2

3

4

5

6

7

8

9

10

11



# CONTROLLED BY USER

## RADIOACTIVE EFFLUENTS

### 3/4.11.2 GASEOUS EFFLUENTS

#### DOSE RATE

#### LIMITING CONDITION FOR OPERATION

3.11.2.1 The dose rate due to radioactive materials released in gaseous effluents from the site (see Figures 5.1-1 and 5.1-3) shall be limited to the following:

- a. For noble gases: Less than or equal to 500 mrem/yr to the total body and less than or equal to 3000 mrem/yr to the skin, and
- b. For I-131 and I-133, for tritium, and for all radionuclides in particulate form with half-lives greater than 8 days: Less than or equal to 1500 mrem/yr to any organ.

APPLICABILITY: At all times.

DELETE

#### ACTION:

With the dose rate(s) exceeding the above limits, immediately decrease the release rate to within the above limit(s).

#### SURVEILLANCE REQUIREMENTS

4.11.2.1.1 The dose rate due to noble gases in gaseous effluents shall be determined to be within the above limits in accordance with the methods and procedures of the ODCM.

4.11.2.1.2 The dose rate due to I-131, I-133, Tritium and all radionuclides in particulate form with half-lives greater than 8 days in gaseous effluents shall be determined to be within the above limits in accordance with the methods and procedures of the ODCM by obtaining representative samples and performing analyses in accordance with the sampling and analysis program specified in Table 4.11-2.



100

TABLE 4.11-2  
RADIOACTIVE GASEOUS WASTE SAMPLING AND ANALYSIS PROGRAM

GASEOUS RELEASE TYPE	SAMPLING FREQUENCY	MINIMUM ANALYSIS FREQUENCY	TYPE OF ACTIVITY ANALYSIS	LOWER LIMIT OF DETECTION (LLD) ( $\mu\text{Ci/ml}$ ) <sup>a</sup>
A. Waste Gas Storage Tank	<sup>P</sup> Each Tank Grab Sample	<sup>P</sup> Each Tank	Principal Gamma Emitters <sup>g</sup>	$1 \times 10^{-4}$
B. Containment Purge	<sup>P</sup> Each Purge Grab Sample	<sup>P</sup> Each Purge <sup>b,c</sup>	Principal Gamma Emitters <sup>g</sup>	$1 \times 10^{-4}$
			H-3	$1 \times 10^{-6}$
C. 1. Condenser Vacuum Pump Exhaust	<sup>b,e</sup> <sup>M</sup> Grab Sample	<sup>b</sup> <sup>M</sup>	Principal Gamma Emitters <sup>g</sup>	$1 \times 10^{-4}$
2. Plant Vent	Grab Sample		H-3	$1 \times 10^{-6}$
3. Fuel Bldg. Exhaust	Continuous <sup>f</sup>	4/ <sup>M</sup> <sup>d</sup> Charcoal Sample	I-131 <b>DELETE</b>	$1 \times 10^{-12}$
	Continuous <sup>f</sup>	4/ <sup>M</sup> <sup>d</sup> Particulate Sample	I-133	$1 \times 10^{-10}$
	Continuous <sup>f</sup>	4/ <sup>M</sup> <sup>d</sup> Particulate Sample	Principal Gamma Emitters <sup>g</sup> (I-131, Others)	$1 \times 10^{-11}$
	Continuous <sup>f</sup>	<sup>M</sup> Composite Particulate Sample	Gross Alpha	$1 \times 10^{-11}$
	Continuous <sup>f</sup>	<sup>Q</sup> Composite Particulate Sample	Sr-89, Sr-90	$1 \times 10^{-11}$
D. All Radwaste Types as listed in A., B., and C. above.	Continuous <sup>f</sup>	Noble Gas Monitor	Noble Gases Gross Beta or Gamma	$1 \times 10^{-6}$





# CONTROLLED BY USER

TABLE 4.11-2 (Continued)

## TABLE NOTATION

<sup>a</sup>The LLD is the smallest concentration of radioactive material in a sample that will yield a net count above background that will be detected with 95% probability with 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system (which may include radiochemical separation):

$$LLD = \frac{4.66 s_b}{E \cdot V \cdot 2.22 \times 10^6 \cdot Y \cdot \exp(-\lambda \Delta t)}$$

Where:

LLD is the "a priori" lower limit of detection as defined above (as pCi per unit mass or volume). Current literature defines the LLD as the detection capability for the instrumentation, only and the MDC minimum detectable concentration, as the detection capability for a given instrument procedure and type of sample.

~~DELETE~~  
 $s_b$  is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (as counts per minute),

E is the counting efficiency (as counts per transformation),

V is the sample size (in units of mass or volume),

2.22 is the number of transformations per minute per picocurie,

Y is the fractional radiochemical yield (when applicable),

$\lambda$  is the radioactive decay constant for the particular radionuclide, and

$\Delta t$  is the elapsed time between the midpoint of sample collection and time of counting (for plant effluents, not environmental samples).

The value of  $s_b$  used in the calculation of the LLD for a detection system shall be based on the actual observed variance of the background counting rate or of the counting rate of the blank samples (as appropriate) rather than on an unverified theoretically predicted variance. In calculating the LLD for a radionuclide determined by gamma-ray spectrometry the background should include the typical contributions of other radionuclides normally present in the samples. Typical values of E, V, Y, and  $\Delta t$  should be used in the calculation.

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as a a posteriori (after the fact) limit for a particular measurement\*.

For a more complete discussion of the LLD, and other detection limits, see the following:

- (1) HASL Procedures Manual, HSAL-300 (revised annually).
- (2) Currie, L. A., "Limits for Qualitative Detection and Quantitative Determination - Application to Radiochemistry" Anal. Chem 40, 586-93 (1968).
- (3) Hartwell, J. K., "Detection Limits for Radioisotopic Counting Techniques," Atlantic Richfield Hanford Company Report (ARH-2537 (June 22, 1972).

10/1/77

10/1/77

10/1/77

10/1/77

10/1/77

# CONTROLLED BY USER

TABLE 4.11-2 (Continued)

## TABLE NOTATION

- <sup>b</sup> Analyses shall also be performed following SHUTDOWN, STARTUP, or a THERMAL POWER change exceeding 15% of the RATED THERMAL POWER within a 1-hour period if 1) analysis shows that the DOSE EQUIVALENT I-131 concentration in the primary coolant has increased more than a factor of 3; and 2) the noble gas activity monitor on the plant vent shows that effluent activity has increased by more than a factor of 3. If the associated noble gas vent monitor is inoperable, samples must be obtained as soon as possible. Analyses shall be performed within a four-hour period. This requirement does not apply to the Fuel Building Exhaust.
- <sup>c</sup> Sampling and analyses shall also be performed at least once per 31 days when purging time exceeds 30 days continuous.
- <sup>d</sup> Samples shall be changed at least 4 times a month and analyses shall be completed within 48 hours after changing (or after removal from sampler). When samples collected for 24 hours are analyzed, the corresponding LLDs may be increased by a factor of 10.
- <sup>e</sup> Tritium grab samples shall be taken at least monthly from the ventilation exhaust from the spent fuel pool area, whenever spent fuel is in the spent fuel pool.
- <sup>f</sup> The ratio of the sample flow rate to the sampled stream flow rate shall be known for the time period covered by each dose or dose rate calculation made in accordance with Specifications 3.11.2.1, 3.11.2.2, and 3.11.2.3.
- <sup>g</sup> The principal gamma emitters for which the LLD specification applies include the following radionuclides: Kr-87, Kr-88, Xe-133, Xe-133m, Xe-135, and Xe-138 for gaseous emissions and Mn-54, Fe-59, Co-58, Co-60, Zn-65, Mo-99, Cs-134, Cs-137, Ce-141 and Ce-144 for particulate emissions. This list does not mean that only these nuclides are to be detected and reported. Other peaks which are measureable and identifiable, together with the above nuclides, shall also be identified and reported in the Semiannual Radioactive Effluent Release Report.

DELETE

100

101

102

103

104

105

106

107

108

109

110

111

112

113

114

115

116

117

118

119

120

121

122

123

124

125



# CONTROLLED BY USER

## RADIOACTIVE EFFLUENTS

### DOSE - NOBLE GASES

#### LIMITING CONDITION FOR OPERATION

3.11.2.2 The air dose due to noble gases released in gaseous effluents, from each reactor unit, to areas at and beyond the SITE BOUNDARY (see Figures 5.1-1 and 5.1-3) shall be limited to the following:

- a. During any calendar quarter: Less than or equal to 5 mrad for gamma radiation and less than or equal to 10 mrad for beta radiation and,
- b. During any calendar year: Less than or equal to 10 mrad for gamma radiation and less than or equal to 20 mrad for beta radiation.

APPLICABILITY: At all times.

#### ACTION

DELETE

- a. With the calculated air dose from radioactive noble gases in gaseous effluents exceeding any of the above limits, prepare and submit to the Commission within 30 days, pursuant to Specification 6.9.2, a Special Report that identifies the cause(s) for exceeding the limit(s) and defines the corrective actions that have been taken to reduce the releases and the proposed corrective actions to be taken to assure that subsequent releases will be in compliance with the above limits.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

4.11.2.2 Cumulative dose contributions for the current calendar quarter and current calendar year for noble gases shall be determined in accordance with the methodology and parameters in the ODCM at least once per 31 days.

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100



# CONTROLLED BY USER

## RADIOACTIVE EFFLUENTS

DOSE - IODINE-131, IODINE-133, TRITIUM, AND RADIONUCLIDES IN PARTICULATE FORM

## LIMITING CONDITION FOR OPERATION

3.11.2.3 The dose to a MEMBER OF THE PUBLIC from iodine-131, iodine-133, tritium, and all radionuclides in particulate form with half-lives greater than 8 days in gaseous effluents released, from each reactor unit, to areas at and beyond the SITE BOUNDARY (see Figures 5.1-1 and 5.1-3) shall be limited to the following:

- a. During any calendar quarter: Less than or equal to 7.5 mrem to any organ and,
- b. During any calendar year: Less than or equal to 15 mrem to any organ.

APPLICABILITY: At all times.

## ACTION:

- a. With the calculated dose from the release of iodine-131, iodine-133, tritium, and radionuclides in particulate form with half-lives greater than 8 days, in gaseous effluents exceeding any of the above limits, prepare and submit to the Commission within 30 days, pursuant to Specification 6.9.2, a Special Report that identifies the cause(s) for exceeding the limit and defines the corrective actions that have been taken to reduce the releases and the proposed corrective actions to be taken to assure that subsequent releases will be in compliance with the above limits.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

## SURVEILLANCE REQUIREMENTS

4.11.2.3 Cumulative dose contributions for the current calendar quarter and current calendar year for iodine-131, iodine-133, tritium, and radionuclides in particulate form with half-lives greater than 8 days shall be determined in accordance with the methodology and parameters in the ODCM at least once per 31 days.





# CONTROLLED BY USER

## RADIOACTIVE EFFLUENTS

### GASEOUS RADWASTE TREATMENT

#### LIMITING CONDITION FOR OPERATION

3.11.2.4 The GASEOUS RADWASTE SYSTEM and the VENTILATION EXHAUST TREATMENT SYSTEM shall be used to reduce radioactive materials in gaseous waste prior to their discharge when the projected gaseous effluent air doses due to gaseous effluent releases, from each reactor unit, from the site (see Figures 5.1-1 and 5.1-3), when averaged over 31 days, would exceed 0.2 mrad for gamma radiation and 0.4 mrad for beta radiation. The VENTILATION EXHAUST TREATMENT SYSTEM shall be used to reduce radioactive materials in gaseous waste prior to their discharge when the projected doses due to gaseous effluent releases, from each reactor unit, to areas at and beyond the SITE BOUNDARY (see Figures 5.1-1 and 5.1-3) when averaged over 31 days would exceed 0.3 mrem to any organ of a MEMBER OF THE PUBLIC.

APPLICABILITY: At all times.

#### ACTION:

DELETE

- a. With radioactive gaseous waste being discharged without treatment and in excess of the above limits, prepare and submit to the Commission within 30 days, pursuant to Specification 6.9.2, a Special Report which includes the following information:
  1. Identification of the inoperable equipment or subsystems and the reason for inoperability,
  2. Action(s) taken to restore the inoperable equipment to OPERABLE status, and
  3. Summary description of action(s) taken to prevent a recurrence.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

4.11.2.4 Doses due to gaseous releases from the site shall be projected at least once per 31 days, in accordance with the methodology and parameters in the ODCM.

3

12

13

14

15

16

17

18

19

20

21

22

23

24

25

26

27

28

29

30

31



# CONTROLLED BY USER

## RADIOACTIVE EFFLUENTS

## EXPLOSIVE GAS MIXTURE

### LIMITING CONDITION FOR OPERATION

3.11.2.5 The concentration of oxygen in the waste gas holdup system shall be limited to less than or equal to 2% by volume.

APPLICABILITY: Whenever the waste gas holdup system is in service.

#### ACTION:

- a. With the concentration of oxygen in the waste gas holdup system greater than 2% by volume but less than or equal to 4% by volume, reduce the oxygen concentration to the above limit within 48 hours.
- b. With the concentration of oxygen in the waste gas holdup system greater than 4% by volume, immediately suspend all additions of waste gases to the system and reduce the concentration of oxygen to less than 4% by volume within 6 hours.
- c. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

### SURVEILLANCE REQUIREMENTS

4.11.2.5 The concentration of oxygen in the waste gas holdup system shall be determined to be within the above limits by continuously monitoring the waste gases in the waste gas holdup system with the oxygen monitors required OPERABLE by Table 3.3-12 of Specification 3.3.3.8.



# CONTROLLED BY USER

## RADIOACTIVE EFFLUENTS

### GAS STORAGE TANKS

#### LIMITING CONDITION FOR OPERATION

3.11.2.3 The quantity of radioactivity contained in each gas storage tank shall be limited to less than or equal to 170,000 curies noble gases (considered as Xe-133).

APPLICABILITY: At all times.

#### ACTION:

- a. With the quantity of radioactive material in any gas storage tank exceeding the above limit, immediately suspend all additions of radioactive material to the tank and within 48 hours reduce the tank contents to within the limit.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

4.11.2.3 The quantity of radioactive material contained in each gas storage tank shall be determined to be within the above limit at least once per 7 days when radioactive materials are being added to the tank and the quantity of radioactivity contained in the tank is less than or equal to one-half of the above limit; otherwise, determine the quantity of radioactive material contained in the tank at least once per 24 hours during addition.

154

155

156

157

158

159

160

161

162

163

164



# CONTROLLED BY USER

## RADIOACTIVE EFFLUENTS

### 3/4.11.3 SOLID RADIOACTIVE WASTE

#### LIMITING CONDITION FOR OPERATION

---

3.11.3 The solid radwaste system shall be OPERABLE and used, as applicable in accordance with a PROCESS CONTROL PROGRAM, for the SOLIDIFICATION and packaging of radioactive wastes to ensure meeting the requirements of 10 CFR Part 20 and of 10 CFR Part 71 prior to shipment of radioactive wastes from the site.

APPLICABILITY: At all times.

#### ACTION:

- a. With the packaging requirements of 10 CFR Part 20 and/or 10 CFR Part 71 not satisfied, suspend shipments of defectively packaged solid radioactive wastes from the site.
- b. With the solid radwaste system inoperable for more than 31 days, prepare and submit to the Commission within 30 days pursuant to Specification 6.9.2 a Special Report which includes the following information:

**DELETE**

  1. Identification of the inoperable equipment or subsystems and the reason for inoperability.
  2. Action(s) taken to restore the inoperable equipment to OPERABLE status,
  3. A description of the alternative used for SOLIDIFICATION and packaging of radioactive wastes, and
  4. Summary description of action(s) taken to prevent a recurrence.
- c. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

---

4.11.3.1 The solid radwaste system shall be demonstrated OPERABLE at least once per 92 days by:

- a. Operating the solid radwaste system at least once in the previous 92 days in accordance with the PROCESS CONTROL PROGRAM, or
- b. Verification of the existence of a valid contract for SOLIDIFICATION to be performed by a contractor in accordance with a PROCESS CONTROL PROGRAM.

10

11

12

13

14

15

16

17

18

19

20 21 22 23 24 25 26 27 28 29 30





# CONTROLLED BY USER

## RADIOACTIVE EFFLUENTS

### SURVEILLANCE REQUIREMENTS (Continued)

4.11.3.2 THE PROCESS CONTROL PROGRAM shall be used to verify the SOLIDIFICATION of at least one representative test specimen from at least every tenth batch of each type of wet radioactive waste (e.g., spent resins, evaporator bottoms, and boric acid solutions)

**DELETE**

- a. If any test specimen fails to verify SOLIDIFICATION, the SOLIDIFICATION of the batch under test shall be suspended until such time as additional test specimens can be obtained, alternative SOLIDIFICATION parameters can be determined in accordance with the PROCESS CONTROL PROGRAM, and a subsequent test verifies SOLIDIFICATION. SOLIDIFICATION of the batch may then be resumed using the alternative SOLIDIFICATION parameters determined by the PROCESS CONTROL PROGRAM.
- b. If the initial test specimen from a batch of waste fails to verify SOLIDIFICATION, the PROCESS CONTROL PROGRAM shall provide for the collection and testing of representative test specimens from each consecutive batch of the same type of wet waste until at least three consecutive initial test specimens demonstrate SOLIDIFICATION. The PROCESS CONTROL PROGRAM shall be modified as required, as provided in Specification 6.13, to assure SOLIDIFICATION of subsequent batches of waste.

07719

# CONTROLLED BY USER

## RADIOACTIVE EFFLUENTS

### 3/4.11.4 TOTAL DOSE

#### LIMITING CONDITION FOR OPERATION

3.11.4 The annual (calendar year) dose or dose commitment to any MEMBER OF THE PUBLIC due to releases of radioactivity and to radiation from uranium fuel cycle sources shall be limited to less than or equal to 25 mrems to the total body or any organ, except the thyroid, which shall be limited to less than or equal to 75 mrems.

APPLICABILITY: At all times.

#### ACTION:

DELETE

- a. With the calculated doses from the release of radioactive materials in liquid and gaseous effluents exceeding twice the limits of Specifications 3.11.1.2a., 3.11.1.2b., 3.11.2.2a., 3.11.2.2b., 3.11.2.3a., or 3.11.2.3b., calculations should be made including direct radiation contributions from the reactor units and from outside storage tanks to determine whether the above limits of Specification 3.11.4 have been exceeded. If such is the case, prepare and submit to the Commission within 30 days, pursuant to Specification 6.9.2, a Special Report that defines the corrective action to be taken to reduce subsequent releases to prevent recurrence of exceeding the above limits and includes the schedule for achieving conformance with the above limits. This Special Report, as defined in 10 CFR 20.405c, shall include an analysis that estimates the radiation exposure (dose) to a MEMBER OF THE PUBLIC from uranium fuel cycle sources, including all effluent pathways and direct radiation, for the calendar year that includes the release(s) covered by this report. It shall also describe levels of radiation and concentrations of radioactive material involved, and the cause of the exposure levels or concentrations. If the estimated dose(s) exceeds the above limits, and if the release condition resulting in violation of 40 CFR Part 190 has not already been corrected, the Special Report shall include a request for a variance in accordance with the provisions of 40 CFR Part 190. Submittal of the report is considered a timely request, and a variance is granted until staff action on the request is complete.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

4.11.4.1 Cumulative dose contributions from liquid and gaseous effluents shall be determined in accordance with Specifications 4.11.1.2, 4.11.2.2, and 4.11.2.3, and in accordance with the methodology and parameters in the ODCM.

4.11.4.2 Cumulative dose contributions from direct radiation from the reactor units and from radwaste storage tanks shall be determined in accordance with the methodology and parameters in the ODCM. This requirement is applicable only under conditions set forth in Specification 3.11.4a.

10.10.19

# CONTROLLED BY USER

## 3/4.12 RADIOLOGICAL ENVIRONMENTAL MONITORING

### 3/4.12.1 MONITORING PROGRAM

#### LIMITING CONDITION FOR OPERATION

3.12.1 The radiological environmental monitoring program shall be conducted as specified in Table 3.12-1.

APPLICABILITY: At all times.

#### ACTION:

- a. With the radiological environmental monitoring program not being conducted as specified in Table 3.12-1, prepare and submit to the Commission, in the Annual Radiological Environmental Operating Report required by Specification 6.9.1.7, a description of the reasons for not conducting the program as required and the plans for preventing a recurrence.
- b. With the level of radioactivity as the result of plant effluents in an environmental sampling medium at a specified location exceeding the reporting levels of Table 3.12-2 when averaged over any calendar quarter, prepare and submit to the Commission within 30 days, pursuant to Specification 6.9.2, a Special Report that identifies the cause(s) for exceeding the limit(s) and defines the corrective actions to be taken to reduce radioactive effluents so that the potential annual dose\* to A MEMBER OF THE PUBLIC is less than the calendar year limits of Specifications 3.11.1.2, 3.11.2.2, and 3.11.2.3. When more than one of the radionuclides in Table 3.12-2 are detected in the sampling medium, this report shall be submitted if:

$$\frac{\text{concentration (1)}}{\text{reporting level (1)}} + \frac{\text{concentration (2)}}{\text{reporting level (2)}} + \dots \geq 1.0$$

When radionuclides other than those in Table 3.12-2 are detected and are the result of plant effluents, this report shall be submitted if the potential annual dose\* to A MEMBER OF THE PUBLIC is equal to or greater than the calendar year limits of Specifications 3.11.1.2, 3.11.2.2, and 3.11.2.3. This report is not required if the measured level of radioactivity was not the result of plant effluents; however, in such an event, the condition shall be reported and described in the Annual Radiological Environmental Operating Report.

- c. With milk or fresh leafy vegetable samples unavailable from one or more of the sample locations required by Table 3.12-1, identify locations for obtaining replacement samples and add them to the radiological environmental monitoring program within 30 days. The specific

\*The methodology and parameters used to estimate the potential annual dose to a MEMBER OF THE PUBLIC shall be indicated in this report.

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100

100



# CONTROLLED BY USER

## RADIOLOGICAL ENVIRONMENTAL MONITORING

### LIMITING CONDITION FOR OPERATION (Continued)

#### ACTION: (Continued)

locations from which samples were unavailable may then be deleted from the monitoring program. Pursuant to Specification 6.9.1.8, identify the cause of the unavailability of samples and identify the new location(s) for obtaining replacement samples in the next Semiannual Radioactive Effluent Release Report and also include in the report a revised figure(s) and table for the ODCM reflecting the new location(s).

- d. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

### SURVEILLANCE REQUIREMENTS

4.12.1 The radiological environmental monitoring samples shall be collected pursuant to Table 3.12-1 from the specific locations given in the table and figure(s) in the ODCM, and shall be analyzed pursuant to the requirements of Table 3.12-1, and the detection capabilities required by Table 4.12-1.

DELETE

12

13

14

15

16

17

18

19

20

21





# CONTROLLED BY USER

TABLE 3.12-1

## RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

EXPOSURE PATHWAY AND/OR SAMPLE	NUMBER OF REPRESENTATIVE SAMPLES AND SAMPLE LOCATIONS <sup>a</sup>	SAMPLING AND COLLECTION FREQUENCY <sup>a</sup>	TYPE AND FREQUENCY OF ANALYSIS <sup>e</sup>
Airborne			
Radioiodine and partic- ulates	<p>Samples from 5 locations: 3 samples at or near the SITE BOUNDARIES (#14A, 15, 21) in different sectors of the highest calculated annual average ground level D/Q.*</p> <p>1 sample (#40) from areas of special interest, which is from the vicinity of a community having the highest calculated annual average D/Q.</p> <p>1 sample (#6) from a control location 15-30 km (10-20 mi) distant and in the least prevalent wind direction.</p>	Continuous sampling collected weekly, <sup>c</sup> or more frequently if required by dust loading	Gross beta weekly; <sup>d</sup> I-131 weekly; gamma isotopic analysis of composite (by location) quarterly
Direct radiation <sup>b</sup>	40 stations (#6-45) with two or more dosimeters for measuring dose rate continuously, placed as follows: an inner ring of stations at the site boundary and an outer ring in the 4-to-5 mi range from the site with a station in each sector of each ring, except the WNW sector, which is inaccessible (16 sectors x 2 rings minus 1 = 31 sta- tions). 7 additional stations are in local schools and population centers; 2 other stations are used as controls.	Quarterly	Gamma dose quarterly

DELETE

\*D/Q refers to average annual relative ground deposition rate.



# CONTROLLED BY USER

TABLE 3.12-1 (Continued)

## RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

EXPOSURE PATHWAY AND/OR SAMPLE	NUMBER OF REPRESENTATIVE SAMPLES AND SAMPLE LOCATIONS <sup>a</sup>	SAMPLING AND COLLECTION FREQUENCY <sup>a</sup>	TYPE AND FREQUENCY OF ANALYSIS <sup>e</sup>
Waterborne			
Surface	Water storage reservoir (#60) evaporation pond (#59)	Monthly composite of weekly grab sample	Gamma isotopic analysis monthly; tritium quarterly
Ground	2 onsite wells <sup>g</sup> (#57, 58)	Quarterly grab sample	Tritium and gamma isotopic analysis quarterly
Drinking (well)	3 wells from surrounding residences (#46, 48, 49) that would be affected by its discharge	Composite sample of weekly grab samples over 2-week period when I-131 analysis is performed, monthly composite of weekly grab samples otherwise	I-131 analysis on each composite when the dose calculated for the consumption of the water is greater than 1 mrem per year. <sup>h</sup> Composite for gross beta and gamma isotopic analyses monthly. Composite for tritium analysis quarterly.
Ingestion			
Milk	Samples from milking animals in 3 locations within 5 km distance having the highest dose potential. If there are none, 1 sample from milking animals in each of 3 areas (#50, 51, 53) between 5 and 8 km distant where doses are calculated to be greater than 1 mrem per year. <sup>h</sup>  One sample from milking animals at a control location (#56), 15 to 30 km distant and in the least prevalent wind direction.	Semimonthly for animals on pasture; other- wise, monthly	Gamma isotopic and I-131 analysis semi-monthly when animals are on pasture or monthly at other times

DELETE



# CONTROLLED BY USER

TABLE 3.12-1 (Continued)

## RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

EXPOSURE PATHWAY AND/OR SAMPLE	NUMBER OF REPRESENTATIVE SAMPLES AND SAMPLE LOCATIONS <sup>a</sup>	SAMPLING AND COLLECTION FREQUENCY <sup>a</sup>	TYPE AND FREQUENCY OF ANALYSIS <sup>e</sup>
Food products*	Samples (#47, 52) of 3 different kinds of broad leaf vegetation grown near- est each of two different offsite locations of highest predicted annual average ground-level D/Q if milk sampling is not performed	Monthly during growing season	Gamma isotopic and I-131 analysis.
	1 sample (#62) of each of the similar broad leaf vegetation grown 15-30 km distant in the least preva- lent wind direction if milk sampling is not performed	Monthly during growing season	Gamma isotopic and I-131 analysis.

DELETE

\*When broad leaf vegetation samples are not available, reports from 4 existing supplemental airborne radioiodine sample locations will be substituted.



# CONTROLLED BY USER

TABLE 3.12-1 (Continued)

## TABLE NOTATIONS

<sup>a</sup>The number, media, frequency, and location of sampling may vary from site to site. It is recognized that, at times, it may not be possible or practical to obtain samples of the media of choice at the most desired location or time. In these instances suitable alternative media and locations may be chosen for the particular pathway in question and submitted for acceptance. Actual locations (distance and direction) from the site shall be provided in Table 7-1 and Figure 7-1 in the ODCM. Refer to Regulatory Guide 4.1, "Programs for Monitoring Radioactivity in the Environs of Nuclear Power Plants."

<sup>b</sup>Regulatory Guide 4.13 provides guidance for thermoluminescence dosimetry (TLD) systems used for environmental monitoring. One or more instruments, such as a pressurized ion chamber, for measuring and recording dose rate continuously may be used in place of, or in addition to, integrating dosimeters. For the purposes of this table, a thermoluminescent dosimeter may be considered to be one phosphor, and two or more phosphors in a packet may be considered as two or more dosimeters. Film badges should not be used for measuring direct radiation.

DELETE

<sup>c</sup>Canisters for the collection of radiiodine in air are subject to channeling. These devices should be carefully checked before operation in the field or several should be mounted in series to prevent loss of iodine.

<sup>d</sup>Particulate sample filters shall be analyzed for gross beta 24 hours or more after sampling to allow for radon and thoron daughter decay. If gross beta activity in air or water is greater than 10 times the yearly mean of control samples for any medium, gamma isotopic analysis should be performed on the individual samples.

<sup>e</sup>Gamma isotopic analysis means the identification and quantification of gamma-emitting radionuclides that may be attributable to the effluents from the facility.

<sup>f</sup>The purpose of this sample is to obtain background information. If it is not practical to establish control locations in accordance with the distance and wind direction criteria, other sites that provide valid background data may be substituted.

<sup>g</sup>Groundwater samples should be taken when this source is tapped for drinking or irrigation purposes in areas where the hydraulic gradient or recharge properties are suitable for contamination.

<sup>h</sup>The dose shall be calculated for the maximum organ and age group, using the methodology and parameters in the ODCM.

100

100





TABLE 3.12-2

REPORTING LEVELS FOR RADIOACTIVITY CONCENTRATIONS IN ENVIRONMENTAL SAMPLES

## REPORTING LEVELS

ANALYSIS	WATER (pCi/l)	AIRBORNE PARTICULATE OR GASES (pCi/m <sup>3</sup> )	MILK (pCi/l)	FOOD PRODUCTS (pCi/kg, wet)
H-3	20,000*			
Mn-54	1,000			
Fe-59	400			
Co-58	1,000			
Co-60	300			
Zn-65	300			
Zr-Nb-95	400			
I-131	2**	0.9	3	100
Cs-134	30	10	60	1,000
Cs-137	50	20	70	2,000
Ba-La-140	200		300	

\*For drinking water samples. This is 40 CFR Part 141 value. If no drinking pathway exists, a value of 30,000 pCi/l may be used.

\*\*If no drinking pathway exists, a reporting level of 20 pCi/l may be used.

PALO VERDE - UNIT 1

3/4 12-7

CONTROLLED BY USER

CONTROLLED BY USER



TABLE 4.12-1

DETECTION CAPABILITIES FOR ENVIRONMENTAL SAMPLE ANALYSIS<sup>a</sup>LOWER LIMIT OF DETECTION (LLD)<sup>b</sup>

ANALYSIS	WATER (pCi/ℓ)	AIRBORNE PARTICULATE OR GAS (pCi/m <sup>3</sup> )	MILK (pCi/ℓ)	FOOD PRODUCTS (pCi/kg,wet)
Gross beta	4	0.01		
H-3	2000*			
Mn-54	15			
Fe-59	30			
Co-58,-60	15			
Zn-65	30			
Zr-95	30			
Nb-95	15			
I-131	1**	0.07	1	60
Cs-134	15	0.05	15	60
Cs-137	18	0.06	18	80
Ba-140	60		60	
La-140	15		15	

Note: This list does not mean that only these nuclides are to be detected and reported. Other peaks that are measureable and identifiable, together with the above nuclides, shall also be identified and reported.

\*If no drinking water pathway exists, a value of 3000 pCi/ℓ may be used.

\*\*If no drinking water pathway exists, a value of 15 pCi/ℓ may be used.

CONTROLLED BY USER

PALO VERDE - UNIT 1  
CONTROLLED BY USER

4

1

77

5

1

10

2

1  
2  
3  
4  
5

4  
5  
6

1

10

1

10



# CONTROLLED BY USER

TABLE 4.12-1 (Continued)

## TABLE NOTATION

a Guidance for detection capabilities for thermoluminescent dosimeters used for environmental measurements is given in Regulatory Guide 4.13.

b Table 4.12-1 indicates acceptable detection capabilities for radioactive materials in environmental samples. These detection capabilities are tabulated in terms of the lower limits of detection (LLDs). The LLD is defined, for purposes of this guide, as the smallest concentration of radioactive material in a sample that will yield a net count (above system background) that will be detected with 95% probability with only 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system (which may include radiochemical separation):

$$LLD = \frac{4.66 s_b}{E \cdot V \cdot 2.22 \cdot Y \cdot \exp(-\lambda \Delta t)}$$

*Delete*

Where:

LLD is the "a priori" lower limit of detection as defined above (as picocuries per unit mass or volume).

$s_b$  is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (as counts per minute)

E is the counting efficiency (as counts per disintegration)

V is the sample size (in units of mass or volume)

2.22 is the number of disintegrations per minute per picocurie

Y is the fractional radiochemical yield (when applicable)

$\lambda$  is the radioactive decay constant for the particular radionuclide

$\Delta t$  for environmental samples is the elapsed time between sample collection (or end of the sample collection period) and time of counting



# CONTROLLED BY USER

TABLE 4.12-1 (Continued)

## TABLE NOTATION

In calculating the LLD for a radionuclide determined by gamma-ray spectrometry the background should include the typical contributions of other radionuclides normally present in the samples (e.g., potassium-40 in milk samples). Typical values of E, V, Y, and  $\Delta t$  should be used in the calculation.

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as an a posteriori (after the fact) limit for a particular measurement. Analyses shall be performed in such a manner that the stated LLDs will be achieved under routine conditions. Occasionally background fluctuations, unavoidable small sample sizes, the presence of interfering nuclides, or other uncontrollable circumstances may render these LLDs unachievable. In such cases, the contributing factors shall be identified and described in the Annual Radiological Environmental Operating Report.

Delete

11

12

13

14

15

16

17

18

19

20

21

22

23

24

1944

1944

1944





# CONTROLLED BY USER

## RADIOLOGICAL ENVIRONMENTAL MONITORING

### 3/4.12.2 LAND USE CENSUS

#### LIMITING CONDITION FOR OPERATION

3.12.2 A land use census shall be conducted and shall identify within a distance of 8 km (5 miles) the location in each of the 16 meteorological sectors of the nearest milk animal, the nearest residence and the nearest garden\* of greater than 50 m<sup>2</sup> (500 ft<sup>2</sup>) producing broad leaf vegetation.

APPLICABILITY: At all times.

#### ACTION:

- Delete*
- With a land use census identifying a location(s) that yields a calculated dose or dose commitment greater than the values currently being calculated in Specification 4.11.2.3, identify the new location(s) in the next Semiannual Radioactive Effluent Release Report, pursuant to Specification 6.9.1.8.
  - With a land use census identifying a location(s) that yields a calculated dose or dose commitment (via the same exposure pathway) 20% greater than at a location from which samples are currently being obtained in accordance with Specification 3.12.1, add the new location(s) to the radiological environmental monitoring program within 30 days. The sampling location(s), excluding the control station location, having the lowest calculated dose or dose commitment(s), via the same exposure pathway, may be deleted from this monitoring program after (October 31) of the year in which this land use census was conducted. Pursuant to Specification 6.9.1.8, identify the new location(s) in the next Semiannual Radioactive Effluent Release Report and also include in the report a revised figure(s) and table for the ODCM reflecting the new location(s).
  - The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

4.12.2 The land use census shall be conducted during the growing season at least once per 12 months using that information that will provide the best results, such as by a door-to-door survey, aerial survey, or by consulting local agriculture authorities. The results of the land use census shall be included in the Annual Radiological Environmental Operating Report pursuant to Specification 6.9.1.7.

\*Broad leaf vegetation sampling of at least three different kinds of vegetation may be performed at the SITE BOUNDARY in each of two different direction sectors with the highest predicted D/Qs in lieu of the garden census. Specifications for broad leaf vegetation sampling in Table 3.12-1 shall be followed, including analysis of control samples.

1

2

3

4

5

6

7

8

9



# CONTROLLED BY USER

## RADIOLOGICAL ENVIRONMENTAL MONITORING

### 3/4.12.3 INTERLABORATORY COMPARISON PROGRAM

#### LIMITING CONDITION FOR OPERATION

---

3.12.3 Analyses shall be performed on radioactive materials supplied as part of an Interlaboratory Comparison Program that has been approved by the Commission that correspond to samples required by Table 3.12-1.

APPLICABILITY: At all times.

#### ACTION:

*Delete*

- a. With analyses not being performed as required above, report the corrective actions taken to prevent a recurrence to the Commission in the Annual Radiological Environmental Operating Report pursuant to Specification 6.9.1.7.
- b. The provisions of Specifications 3.0.3 and 3.0.4 are not applicable.

#### SURVEILLANCE REQUIREMENTS

---

4.12.3 The Interlaboratory Comparison Program shall be described in the ODCM. A summary of the results obtained as part of the above required Interlaboratory Comparison Program and in accordance with the methodology and parameters in the ODCM shall be included in the Annual Radiological Environmental Operating Report pursuant to Specification 6.9.1.7.



INSTRUMENTATION

BASES

POST ACCIDENT MONITORING INSTRUMENTATION (Continued)

In the event more than four sensors in a Reactor Vessel Level channel are inoperable, repairs may only be possible during the next refueling outage. This is because the sensors are accessible only after the missile shield and reactor vessel head are removed. It is not feasible to repair a channel except during a refueling outage when the missile shield and reactor vessel head are removed to refuel the core. If both channels are inoperable, the channels shall be restored to OPERABLE status in the nearest refueling outage. If only one channel is inoperable, it is intended that this channel be restored to OPERABLE status in a refueling outage as soon as reasonably possible.

3/4.3.3.7 LOOSE-PART DETECTION INSTRUMENTATION

The OPERABILITY of the loose-part detection instrumentation ensures that sufficient capability is available to detect loose metallic parts in the primary system and avoid or mitigate damage to primary system components. The allowable out-of-service times and surveillance requirements are consistent with the recommendations of Regulatory Guide 1.133, "Loose-Part Detection Program for the Primary System of Light-Water-Cooled Reactors," May 1981.

3/4.3.3.8 <sup>EXPLOSIVE GAS</sup> RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

The <sup>explosive gas</sup> ~~radioactive gaseous~~ effluent instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in gaseous effluents during actual or potential releases of gaseous effluents. The alarm/trip set-points for these instruments shall be calculated and adjusted in accordance with the methodology and parameters in the ODCM to ensure that the alarm/trip will occur prior to exceeding the limits of 10 CFR Part 20. This instrumentation also includes provisions for monitoring (and controlling) the concentrations of potentially explosive gas mixtures in the GASEOUS RADWASTE SYSTEM. The OPERABILITY and use of this instrumentation is consistent with the requirements of General Design Criteria 60, 63, and 64 of Appendix A to 10 CFR Part 50.

There are two separate radioactive gaseous effluent monitoring systems: the low range effluent monitors for normal plant radioactive gaseous effluents and the high range effluent monitors for post-accident plant radioactive gaseous effluents. The low range monitors operate at all times until the concentration of radioactivity in the effluent becomes too high during post-accident conditions. The high range monitors only operate when the concentration of radioactivity in the effluent is above the setpoint in the low range monitors.

2012

2

2012

2

2012

2012

2012

2012

2

2

2012

2012

2012



# CONTROLLED BY USER

## 3/4.11 RADIOACTIVE EFFLUENTS

### BASES

Delete

#### 3/4.11.1 SECONDARY SYSTEM LIQUID WASTE DISCHARGE TO ONSITE EVAPORATION PONDS

##### 3/4.11.1.1 CONCENTRATION

This specification is provided to ensure that at any time during the life of the nuclear station, the annual total body dose due to ground contamination of an UNRESTRICTED AREA, arising from transportation and deposition by wind of the accumulated activity discharged to the pond from the secondary system of the plant (if the pond gets dried up) on the UNRESTRICTED AREA, is within the guidelines of 10 CFR Part 20 for the above-mentioned postulated event.

Restricting the concentrations of the secondary liquid wastes discharged to the onsite evaporation ponds will restrict the quantity of radioactive material that can get accumulated in the ponds. This, in turn, provides assurance that in the event of an uncontrolled release of the pond's contents to an UNRESTRICTED AREA, the resulting total body annual exposure from ground contamination to a MEMBER OF THE PUBLIC at the nearest exclusion area boundary will be within 0.5 rem.

This specification applies to the secondary system liquid waste discharges of radioactive materials from all reactor units to the onsite evaporation ponds. Since the chemical neutralizer tank concentrations will bound concentrations in other secondary waste discharges, surveillance requirements stipulate that sampling and analysis of other secondary waste discharges need be performed only if the sampling and analysis of the contents of the chemical neutralizer tank shows that the neutralizer tank concentration exceeds the specified LLD.

The required detection capabilities for radioactive materials in the secondary liquid waste samples are tabulated in terms of the lower limits of detection (LLDs). Detailed discussion of the LLD, and other detection limits can be found in HASL Procedures Manual, HASL-300 (revised annually), Currie, L. A., "Limits for Qualitative Detection and Quantitative Determination - Application to Radiochemistry," Anal. Chem. 40, 586-93 (1968), and Hartwell, J. K., "Detection Limits for Radioanalytical Counting Techniques," Atlantic Richfield Hanford Company Report ARH-SA-215 (June 1975).

##### 3/4.11.1.2 DOSE

This specification is provided to implement the requirements of Sections II.A, III.A and IV.A of Appendix I, 10 CFR Part 50. The Limiting Condition for Operation implements the guides set forth in Section II.A of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive material in liquid effluents to UNRESTRICTED AREAS will be kept "as low as is reasonably achievable." Also, for fresh water sites with drinking water supplies that can be potentially affected by plant operations, there is reasonable assurance that the operation of the facility will not result in radionuclide concentrations in the finished drinking water that are in excess of the requirements of 40 CFR Part 141. The dose calculation methodology and parameters in the ODCM implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data, such that the actual exposure of a MEMBER OF THE PUBLIC through appropriate pathways is unlikely to be substantially underestimated. The equations specified in the ODCM for calculating the doses due to the actual release rates of radioactive materials in liquid effluents are consistent with





# CONTROLLED BY USER

## RADIOACTIVE EFFLUENTS

### BASES

Delete

~~the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I," Revision 1, October 1977 and Regulatory Guide 1.113, "Estimating Aquatic Dispersion of Effluents from Accidental and Routine Reactor Releases for the Purpose of Implementing Appendix I," April 1977.~~

~~This specification applies to the release of liquid effluents from each reactor at the site. For units with shared radwaste treatment systems, the liquid effluents from the shared system are proportioned among the units sharing that system.~~

### 3/4.11.1.3 LIQUID HOLDUP TANKS

The tanks referred to in this specification include all those outdoor radwaste tanks that are not surrounded by liners, dikes, or walls capable of holding the tank contents and that do not have tank overflows and surrounding area drains connected to the liquid radwaste treatment system.

Restricting the quantity of radioactive material contained in the specified tanks provides assurance that in the event of an uncontrolled release of the tanks' contents, the resulting concentrations would be less than the limits of 10 CFR Part 20, Appendix B, Table II, Column 2, at the nearest potable water supply and the nearest surface water supply in an UNRESTRICTED AREA.

The limit of 60 curies is based on the analyses given in Section 2.4 of the PVNGS FSAR and on the amount of soluble (not gaseous) radioactivity in the Refueling Water Tank in Table 2.4-26.

### 3/4.11.2 GASEOUS EFFLUENTS

#### 3/4.11.2.1 DOSE RATE

Delete

~~This specification is provided to ensure that the dose at any time at and beyond the SITE BOUNDARY from gaseous effluents from all units on the site will be within the annual dose limits of 10 CFR Part 20 to UNRESTRICTED AREAS. The annual dose limits are the doses associated with the concentrations of 10 CFR Part 20, Appendix B, Table II, Column 1. These limits provide reasonable assurance that radioactive material discharged in gaseous effluents will not result in the exposure of a MEMBER OF THE PUBLIC in an UNRESTRICTED AREA, either within or outside the SITE BOUNDARY, to annual average concentrations exceeding the limits specified in Appendix B, Table II of 10 CFR Part 20 (10 CFR Part 20.106(b)). For MEMBERS OF THE PUBLIC who may at times be within the SITE BOUNDARY, the occupancy of that MEMBER OF THE PUBLIC will usually be sufficiently low to compensate for any increase in the atmospheric diffusion factor above that for the SITE BOUNDARY. Examples of calculations for such MEMBERS OF THE PUBLIC, with the appropriate occupancy factors, shall be given in the ODCM. The specified release rate limits restrict, at all times, the corresponding gamma and beta dose rates above background to a MEMBER OF THE PUBLIC at or beyond the SITE BOUNDARY to less than or equal to 500 mrem/year~~



# CONTROLLED BY USER

## RADIOACTIVE EFFLUENTS

### BASES

#### DOSE RATE (Continued)

to the total body or to less than or equal to 3000 mrem/year to the skin. These release rate limits also restrict, at all times, the corresponding thyroid dose rate above background to a child via the inhalation pathway to less than or equal to 1500 mrem/year.

This specification applies to the release of radioactive materials in gaseous effluents from all reactor units at the site.

The required detection capabilities for radioactive materials in gaseous waste samples are tabulated in terms of the lower limits of detection (LLDs). Detailed discussion of the LLD, and other detection limits can be found in HASL Procedures Manual, HASL-300 (revised annually), Currie, L. A., "Limits for Qualitative Detection and Quantitative Determination - Application to Radiochemistry," Anal. Chem. 40, 586-93 (1968), and Hartwell, J. K., "Detection Limits for Radioanalytical Counting Techniques," Atlantic Richfield Hanford Company Report ARH-SA-215 (June 1975).

#### 3/4.11.2.2 DOSE - NOBLE GASES

Delete

This specification is provided to implement the requirements of Sections II.B, III.A and IV.A of Appendix I, 10 CFR Part 50. The Limiting Condition for Operation implements the guides set forth in Section II.B of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive material in gaseous effluents to UNRESTRICTED AREAS will be kept "as low as is reasonably achievable." The surveillance requirements implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data such that the actual exposure of a MEMBER OF THE PUBLIC through appropriate pathways is unlikely to be substantially underestimated. The dose calculation methodology and parameters established in the ODCM for calculating the doses due to the actual release rates of radioactive noble gases in gaseous effluents are consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I," Revision 1, October 1977 and Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water Cooled Reactors," Revision 1, July 1977. The ODCM equations provided for determining the air doses at and beyond the SITE BOUNDARY are based upon the historical average atmospheric conditions.

This specification applies to the release of radioactive materials in gaseous effluents from each reactor unit at the site.

1

2

3

4

5

6

7

8

9

10

11

12

13

14

15

16

17

18

19

20

21

22

# CONTROLLED BY USER

## RADIOACTIVE EFFLUENTS

### BASES

*Delete*

#### 3/4.11.2.3 DOSE - IODINE-131, IODINE-133, TRITIUM, AND RADIONUCLIDES IN PARTICULATE FORM

This specification is provided to implement the requirements of Sections II.C, III.A and IV.A of Appendix I, 10 CFR Part 50. The Limiting Conditions for Operation are the guides set forth in Section II.C of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive materials in gaseous effluents to UNRESTRICTED AREAS will be kept "as low as is reasonably achievable." The ODCM calculational methods specified in the surveillance requirements implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data, such that the actual exposure of a MEMBER OF THE PUBLIC through appropriate pathways is unlikely to be substantially underestimated. The ODCM calculational methodology and parameters for calculating the doses due to the actual release rates of the subject materials are consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I," Revision 1, October 1977 and Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water-Cooled Reactors," Revision 1, July 1977. These equations also provide for determining the actual doses based upon the historical average atmospheric conditions. The release rate specifications for iodine-131, iodine-133, tritium, and radionuclides in particulate form with half-lives greater than 8 days are dependent upon the existing radionuclide pathways to man, in the areas at and beyond the SITE BOUNDARY. The pathways that were examined in the development of these calculations were: (1) individual inhalation of airborne radionuclides, (2) deposition of radionuclides onto green leafy vegetation with subsequent consumption by man, (3) deposition onto grassy areas where milk animals and meat-producing animals graze with consumption of the milk and meat by man, and (4) deposition on the ground with subsequent exposure of man.

This specification applies to the release of radioactive materials in gaseous effluents from each reactor unit at the site.

#### 3/4.11.2.4 GASEOUS RADWASTE TREATMENT

The OPERABILITY of the GASEOUS RADWASTE SYSTEM and the VENTILATION EXHAUST TREATMENT SYSTEM ensures that the systems will be available for use whenever gaseous effluents require treatment prior to release to the environment. The requirement that the appropriate portions of these systems be used, when specified, provides reasonable assurance that the releases of radioactive materials in gaseous effluents will be kept "as low as is reasonably achievable." This specification implements the requirements of 10 CFR 50.36a, General Design Criterion 60 of Appendix A to 10 CFR Part 50, and the design objectives given in Section II.D of Appendix I to 10 CFR Part 50. The specified limits governing the use of appropriate portions of the systems were specified as a suitable fraction of the dose design objectives set forth in Sections II.B and II.C of Appendix I, 10 CFR Part 50, for gaseous effluents.



# CONTROLLED BY USER

## RADIOACTIVE EFFLUENTS

### BASES

*Delete*

### GASEOUS RADWASTE TREATMENT (Continued)

This specification applies to the release of radioactive materials in gaseous effluents from each reactor unit at the site.

The minimum analysis frequency of 4/M (i.e. at least 4 times per month at intervals no greater than 9 days and a minimum of 48 times a year) is used for certain radioactive gaseous waste sampling in Table 4.11-2. This will eliminate taking double samples when quarterly and weekly samples are required at the same time.

### 3/4.11.2.5 EXPLOSIVE GAS MIXTURE

This specification is provided to ensure that the concentration of potentially explosive gas mixtures contained in the waste gas holdup system is maintained below the flammability limits of hydrogen and oxygen. (Automatic control features are included in the system to prevent the hydrogen and oxygen concentrations from reaching these flammability limits. These automatic control features include isolation of the source of hydrogen and/or oxygen, or injection of dilutants to reduce the concentration below the flammability limits.) Maintaining the concentration of hydrogen and oxygen below their flammability limits provides assurance that the releases of radioactive materials will be controlled in conformance with the requirements of General Design Criterion 60 of Appendix A to 10 CFR Part 50.

### 3/4.11.2.5 GAS STORAGE TANKS

This specification considers postulated radioactive releases due to a waste gas system leak or failure, and limits the quantity of radioactivity contained in each pressurized gas storage tank in the GASEOUS RADWASTE SYSTEM to assure that a release would be substantially below the guidelines of 10 CFR Part 100 for a postulated event.

Restricting the quantity of radioactivity contained in each gas storage tank provides assurance that in the event of an uncontrolled release of the tank's contents, the resulting total body exposure to a MEMBER OF THE PUBLIC at the nearest exclusion area boundary will not exceed 0.5 rem. This is consistent with Standard Review Plan 11.3, Branch Technical Position ETSB 11-5, "Postulated Radioactive Releases Due to a Waste Gas System Leak or Failure," in NUREG-0800, July 1981.

### 3/4.11.3 SOLID RADIOACTIVE WASTE

This specification addresses the requirements of General Design Criterion 60 of Appendix A to 10 CFR Part 50. The process parameters included in establishing the PROCESS CONTROL PROGRAM may include, but are not limited to waste type, waste pH, waste/liquid/solidification agent/catalyst ratios, waste oil content, waste principal chemical constituents, and mixing and curing times.

### 3/4.11.4 TOTAL DOSE

This specification is provided to meet the dose limitations of 40 CFR Part 190 that have been incorporated into 10 CFR Part 20 by 46 FR 18525. The specification requires the preparation and submittal of a Special Report whenever the calculated doses from plant generated radioactive effluents and

*Delete*





# CONTROLLED BY USER

## RADIOACTIVE EFFLUENTS

BASES

*Delto*

### TOTAL DOSE (Continued)

direct radiation exceed 25 mrems to the total body or any organ, except the thyroid, which shall be limited to less than or equal to 75 mrems. For sites containing up to four reactors, it is highly unlikely that the resultant dose to a MEMBER OF THE PUBLIC will exceed the dose limits of 40 CFR Part 190 if the individual reactors remain within twice the dose design objectives of Appendix I, and if direct radiation doses from the reactor units and outside storage tanks are kept small. The Special Report will describe a course of action that should result in the limitation of the annual dose to a MEMBER OF THE PUBLIC to within the 40 CFR Part 190 limits. For the purposes of the Special Report, it may be assumed that the dose commitment to the MEMBER OF THE PUBLIC from other uranium fuel cycle sources is negligible, with the exception that dose contributions from other nuclear fuel cycle facilities at the same site or within a radius of 8 km must be considered. If the dose to any MEMBER OF THE PUBLIC is estimated to exceed the requirements of 40 CFR Part 190, the Special Report with a request for a variance (provided the release conditions resulting in violation of 40 CFR Part 190 have not already been corrected), in accordance with the provisions of 40 CFR Part 190.11 and 10 CFR Part 20.405c, is considered to be a timely request and fulfills the requirements of 40 CFR Part 190 until NRC staff action is completed. The variance only relates to the limits of 40 CFR Part 190, and does not apply in any way to the other requirements for dose limitation of 10 CFR Part 20, as addressed in Specifications 3.11.1.1 and 3.11.2.1. An individual is not considered a MEMBER OF THE PUBLIC during any period in which he/she is engaged in carrying out any operation that is part of the nuclear fuel cycle.



# CONTROLLED BY USER

## 3/4.12 RADIOLOGICAL ENVIRONMENTAL MONITORING

### BASES

#### 3/4.12.1 MONITORING PROGRAM

*Delete*

The radiological environmental monitoring program required by this specification provides representative measurements of radiation and of radioactive materials in those exposure pathways and for those radionuclides that lead to the highest potential radiation exposures of MEMBERS OF THE PUBLIC resulting from the station operation. This monitoring program implements Section IV.B.2 of Appendix I to 10 CFR Part 50 and thereby supplements the radiological effluent monitoring program by verifying that the measurable concentrations of radioactive materials and levels of radiation are not higher than expected on the basis of the effluent measurements and the modeling of the environmental exposure pathways. Guidance for this monitoring program is provided by the Radiological Assessment Branch Technical Position on Environmental Monitoring. The initially specified monitoring program will be effective for at least the first 3 years of commercial operation. Following this period, program changes may be initiated based on operational experience.

The required detection capabilities for environmental sample analyses are tabulated in terms of the lower limits of detection (LLDs). The LLDs required by Table 4.12-1 are considered optimum for routine environmental measurements in industrial laboratories. It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as an a posteriori (after the fact) limit for a particular measurement.

Detailed discussion of the LLD, and other detection limits, can be found in HASL Procedures Manual, HASL-300 (revised annually), Currie, L. A., "Limits for Qualitative Detection and Quantitative Determination - Application to Radiochemistry," Anal. Chem. 40, 586-93 (1968), and Hartwell, J. K., "Detection Limits for Radioanalytical Counting Techniques," Atlantic Richfield Hanford Company Report ARH-SA-215 (June 1975).



# CONTROLLED BY USER

## 3/4.12 RADIOLOGICAL ENVIRONMENTAL MONITORING

### BASES

*Delite*

### 3/4.12.2 LAND USE CENSUS

This specification is provided to ensure that changes in the use of areas at and beyond the SITE BOUNDARY are identified and that modifications to the radiological environmental monitoring program are made if required by the results of this census. The best information from the door-to-door survey, from aerial survey or from consulting with local agricultural authorities shall be used. This census satisfies the requirements of Section IV.B.3 of Appendix I to 10 CFR Part 50. Restricting the census to gardens of greater than 50 m<sup>2</sup> provides assurance that significant exposure pathways via leafy vegetables will be identified and monitored since a garden of this size is the minimum required to produce the quantity (26 kg/year) of leafy vegetables assumed in Regulatory Guide 1.109 for consumption by a child. To determine this minimum garden size, the following assumptions were made: (1) 20% of the garden was used for growing broad leaf vegetation (i.e., similar to lettuce and cabbage), and (2) a vegetation yield of 2 kg/m<sup>2</sup>.

### 3/4.12.3 INTERLABORATORY COMPARISON PROGRAM

The requirement for participation in an approved Interlaboratory Comparison Program is provided to ensure that independent checks on the precision and accuracy of the measurements of radioactive material in environmental sample matrices are performed as part of the quality assurance program for environmental monitoring in order to demonstrate that the results are valid for the purposes of Section IV.B.2 of Appendix I to 10 CFR Part 50.

11

12

13

14

15

16

17


18

19

20

21




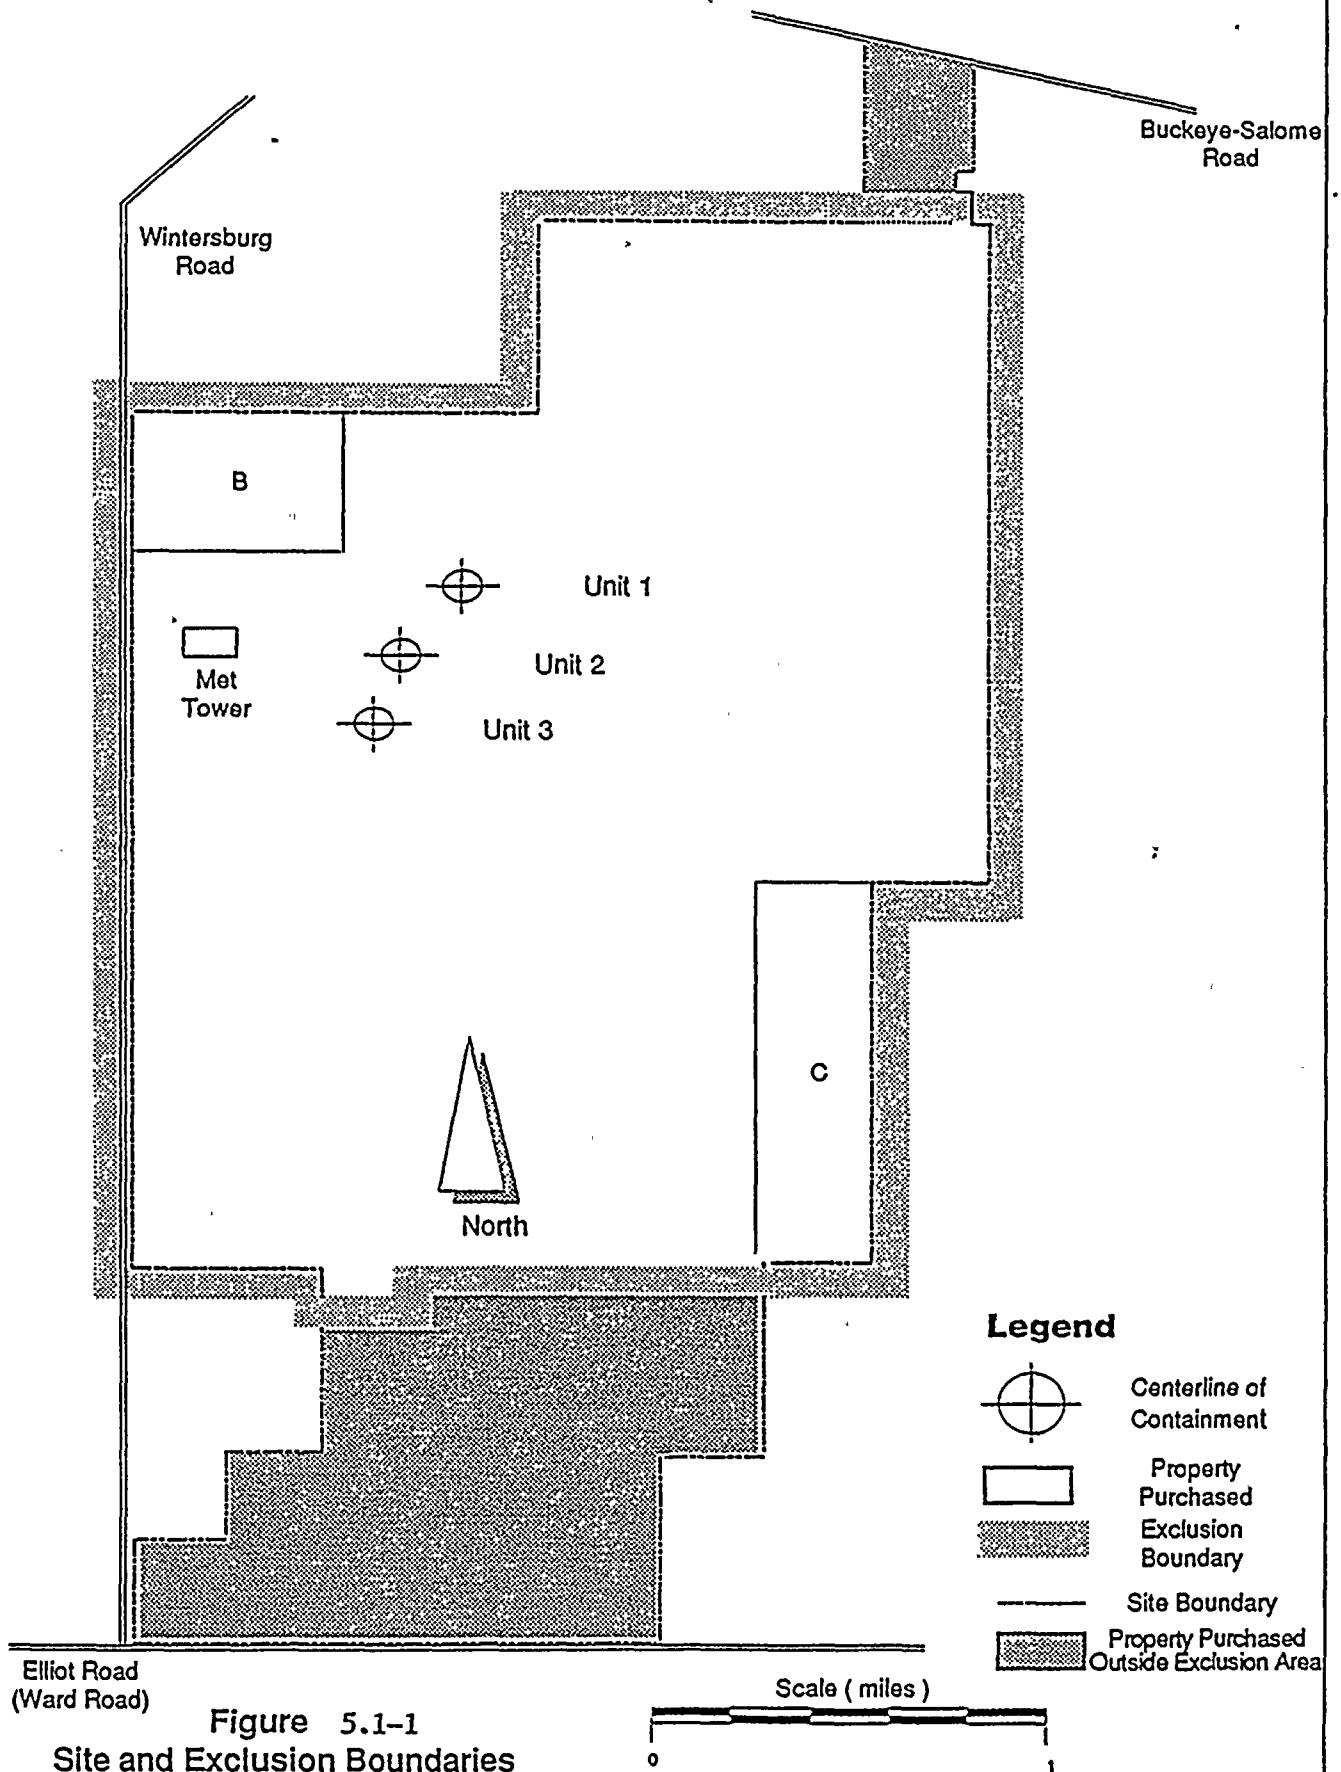





CONTROLLED BY USER

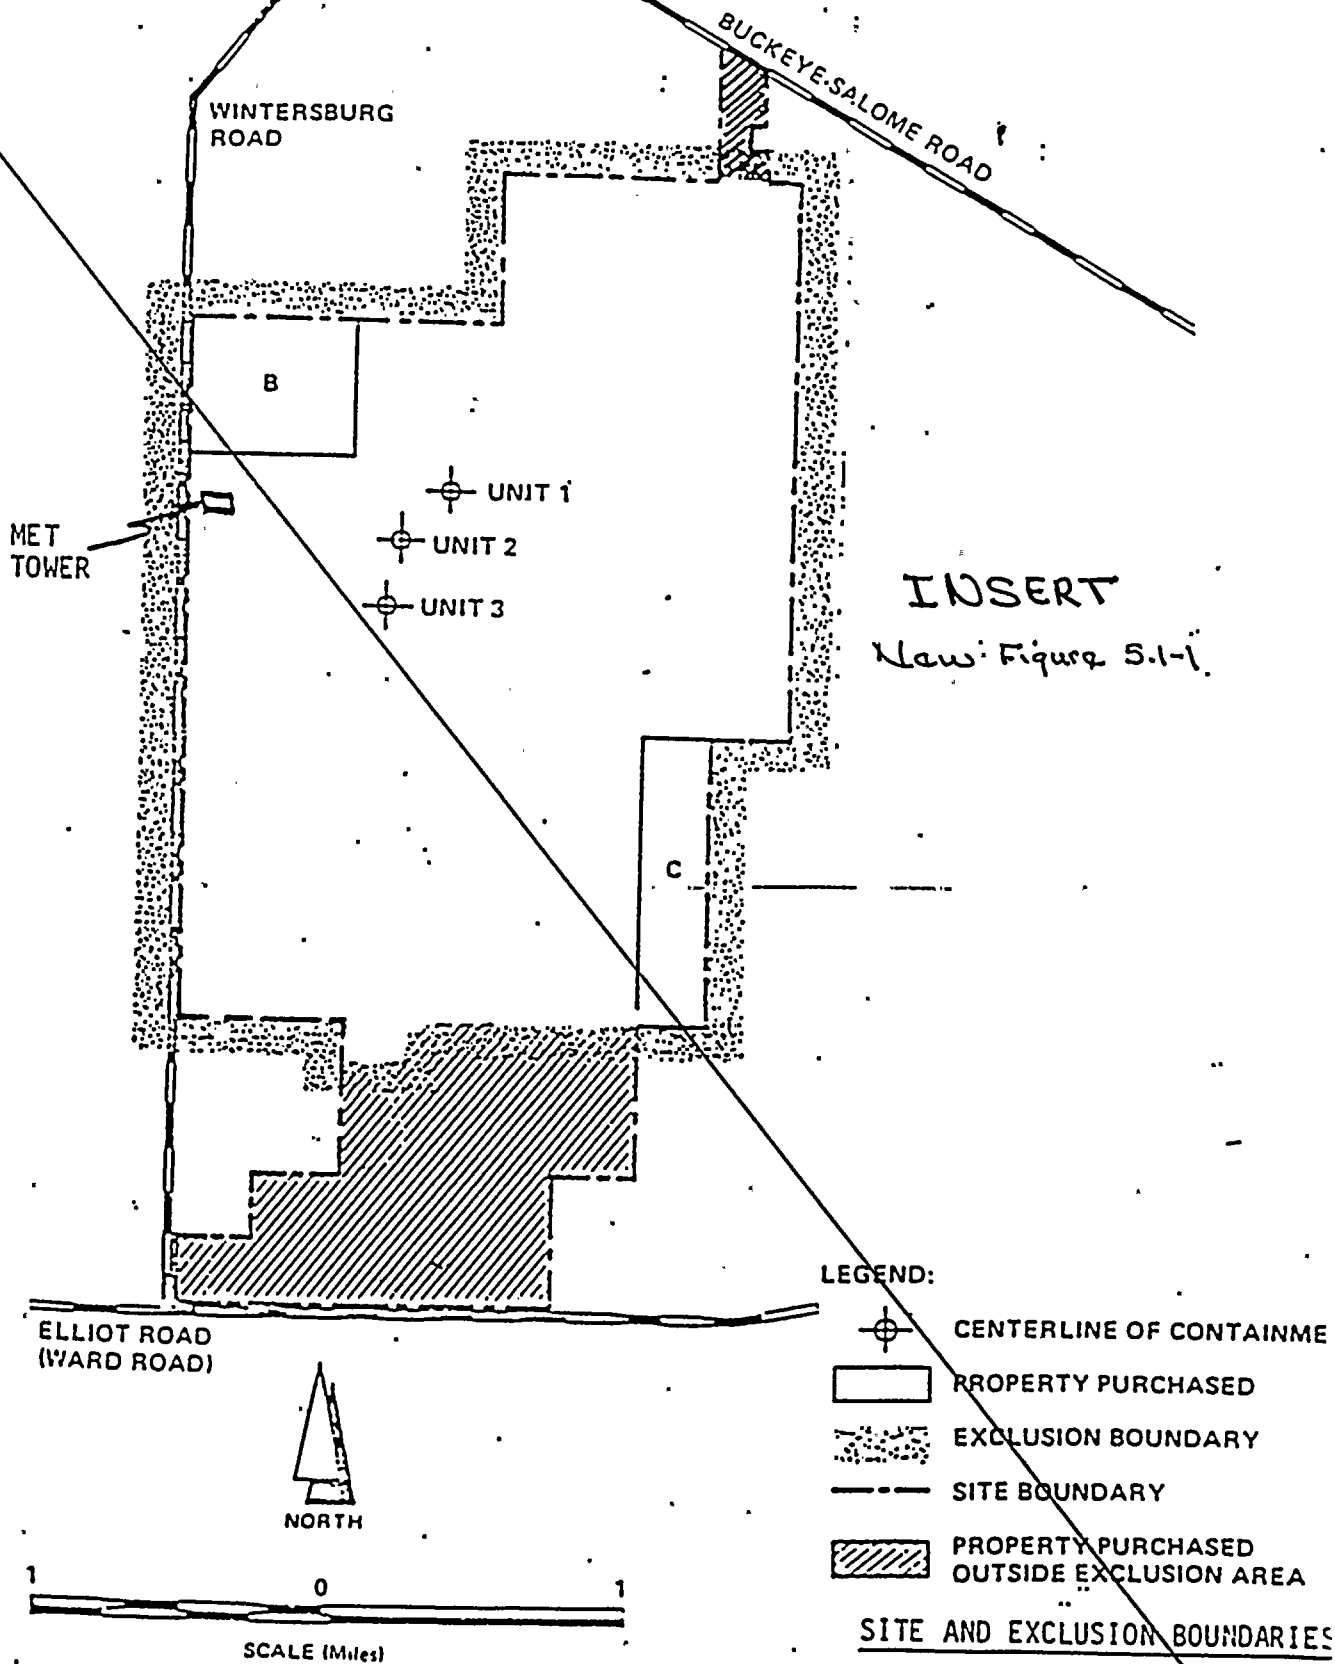

INSERT  
New Figure 5.1-1

FIGURE 5.1-1

CONTROLLED BY USER



13

14

15

16

17

18

19

20

21

22



CONTROLLED BY USER

LEGEND

- HARD SURFACE, HEAVY-DUTY ROAD
- - - HARD SURFACE, MEDIUM-DUTY ROAD
- - - IMPROVED LIGHT-DUTY ROAD
- ..... UNIMPROVED DIRT ROAD
- ..... TRAIL
- ..... RAILROAD SINGLE TRACK
- ..... RAILROAD MULTIPLE TRACK
- ..... BRIDGE
- ..... DRAINAGE
- ..... RIVER
- ..... FORTIFICATION
- ..... OVERPASS UNDERPASS
- ..... BUILDINGS
- ..... PLACE OF EMPLOYMENT
- .....



GRAPHIC SCALE IN MILES

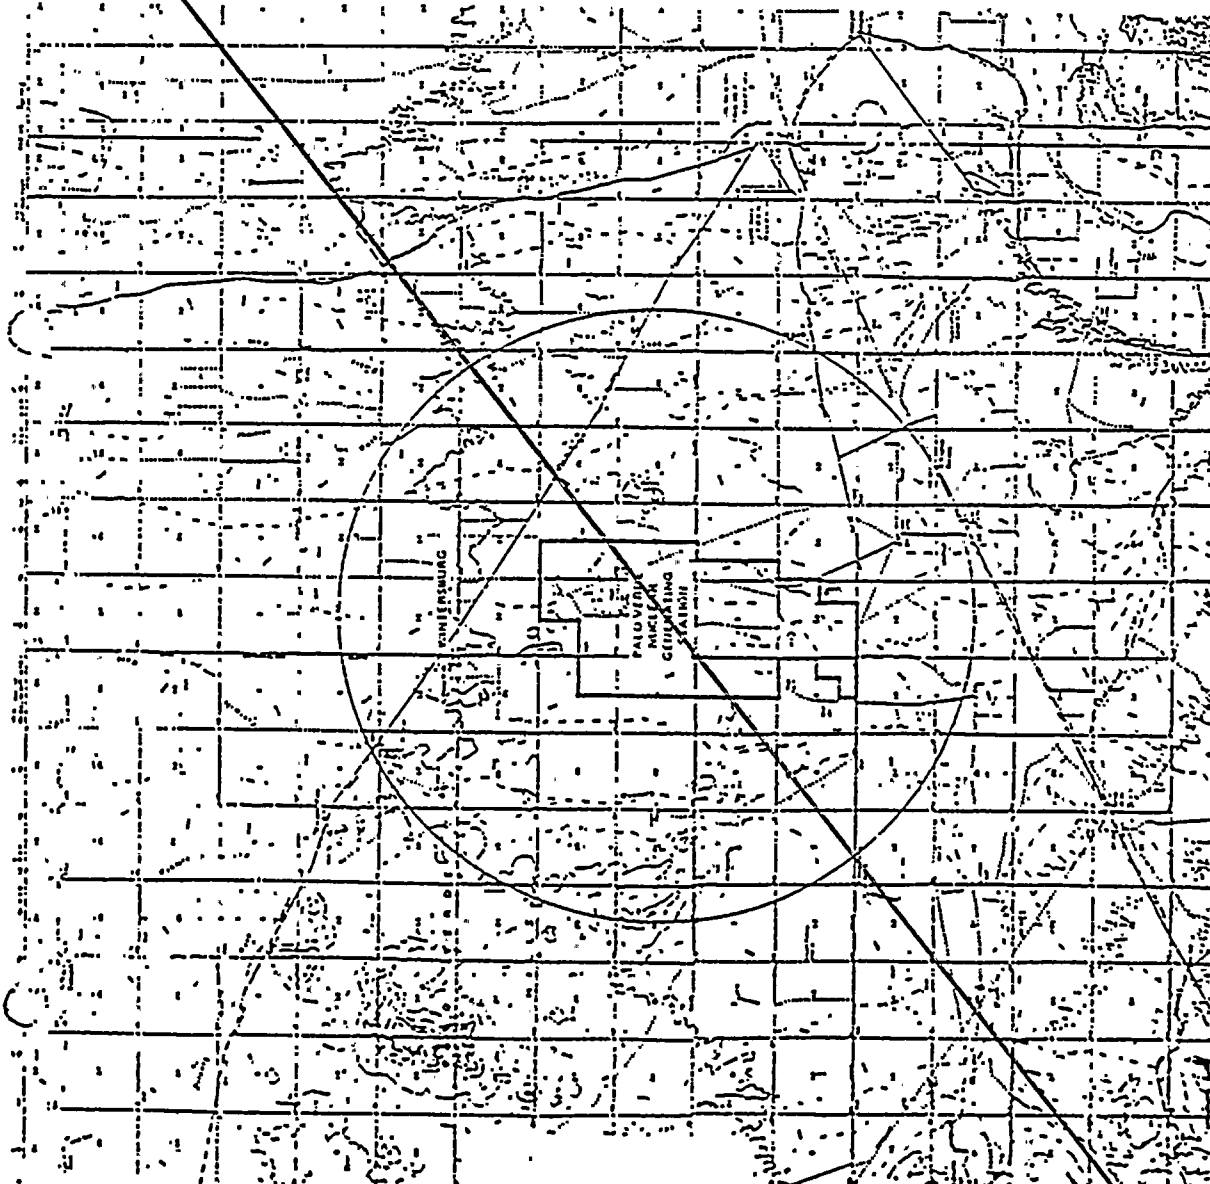

INSERT New Figure 5.1-2


LOW POPULATION ZONE  
PALO VERDE NUCLEAR GENERATING STATION

FIGURE 5.1-2

CONTROLLED BY USER



Graphic Scale in Miles

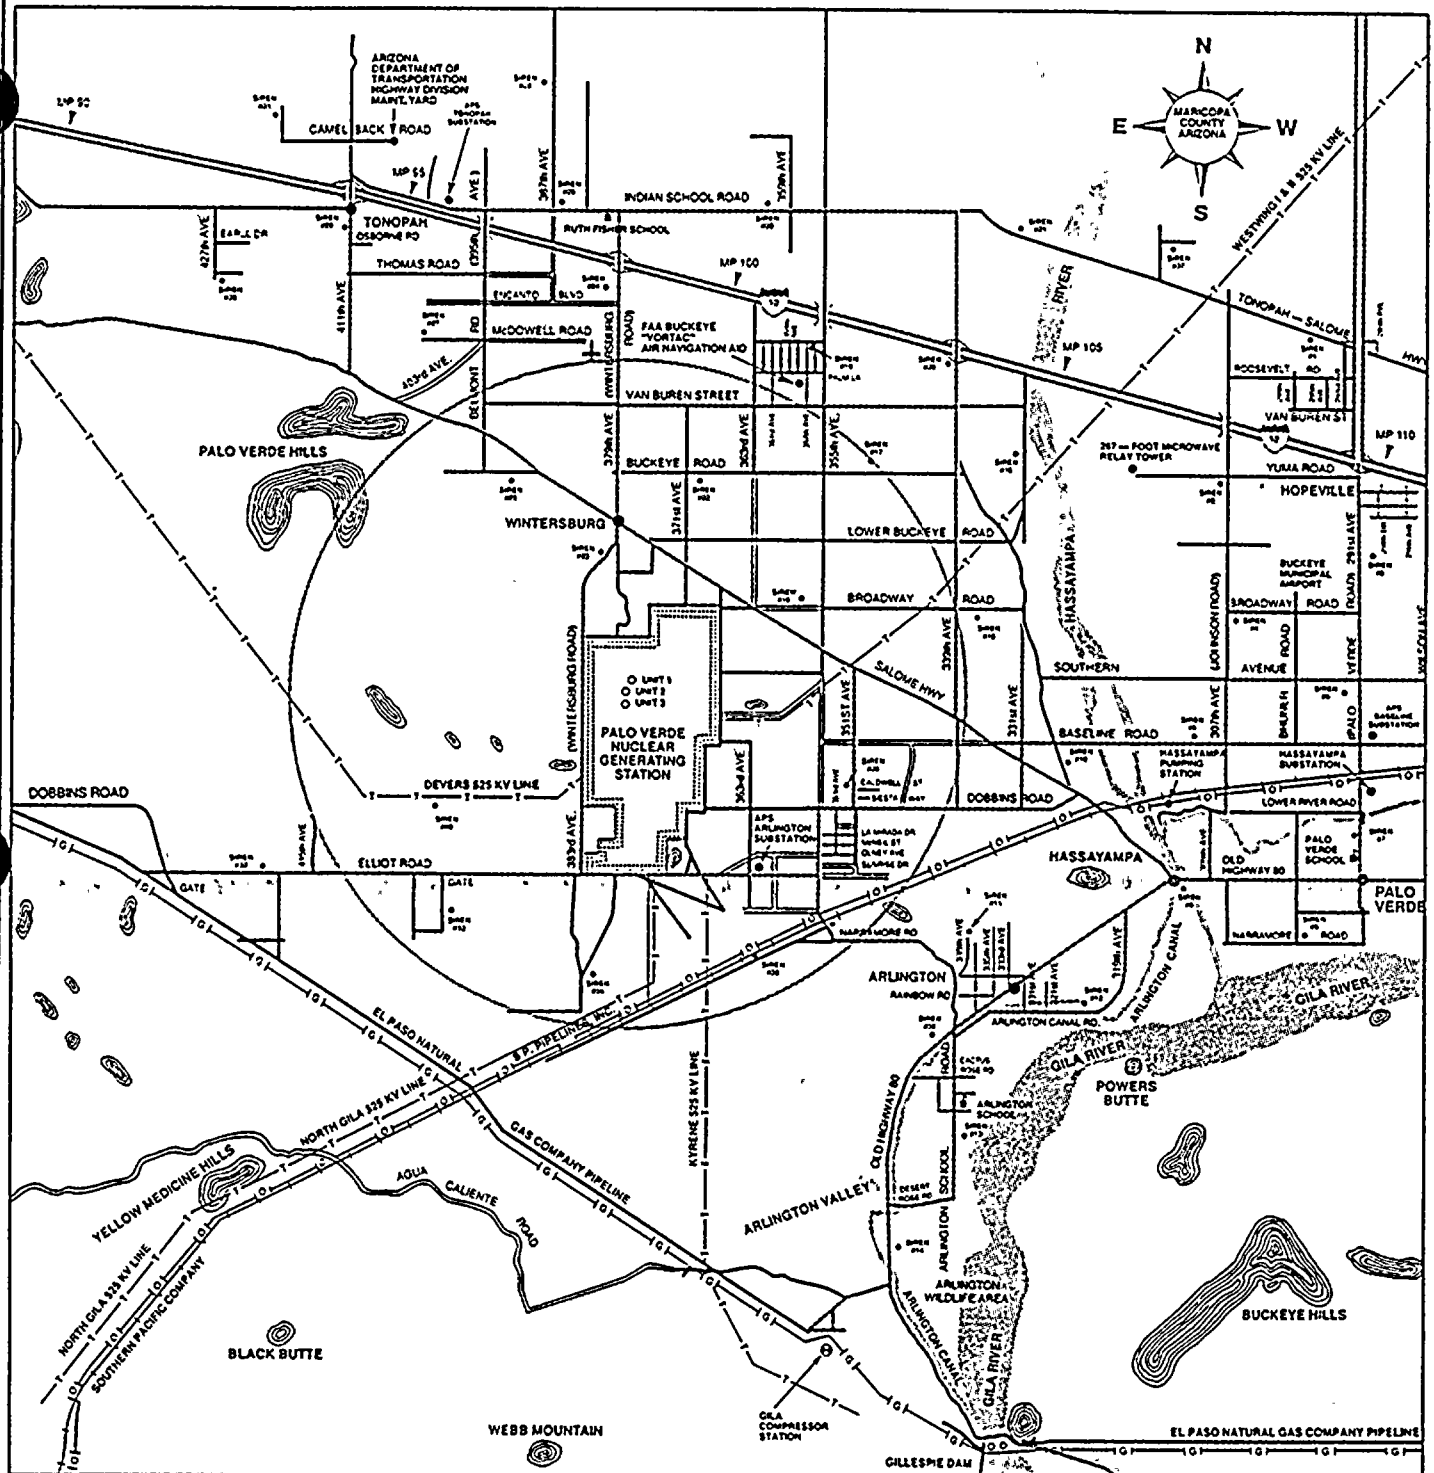

### KEY TO MAP

- |  |              |  |  |
|--|--------------|--|--|
|  | Paved Road   |  | Palo Verde Nuclear Generating Station Boundary |
|  | Unpaved Road |  | School   |
|  | 4WD Road     |  | Siren  |
|  | Gas Pipeline |  | Milepost                                       |
|  | Oil Pipeline |  |  |
|  | Power Line   |  |  |
|  | Railroad     |  |  |
|  | Airstrip     |  |  |

### Palo Verde Nuclear Generating Station LOW POPULATION ZONE

0-5 Miles

Figure 5.1-2




CONTROLLED BY USER


PALO VERDE - UNIT 1

CONTROLLED BY USER

5-4

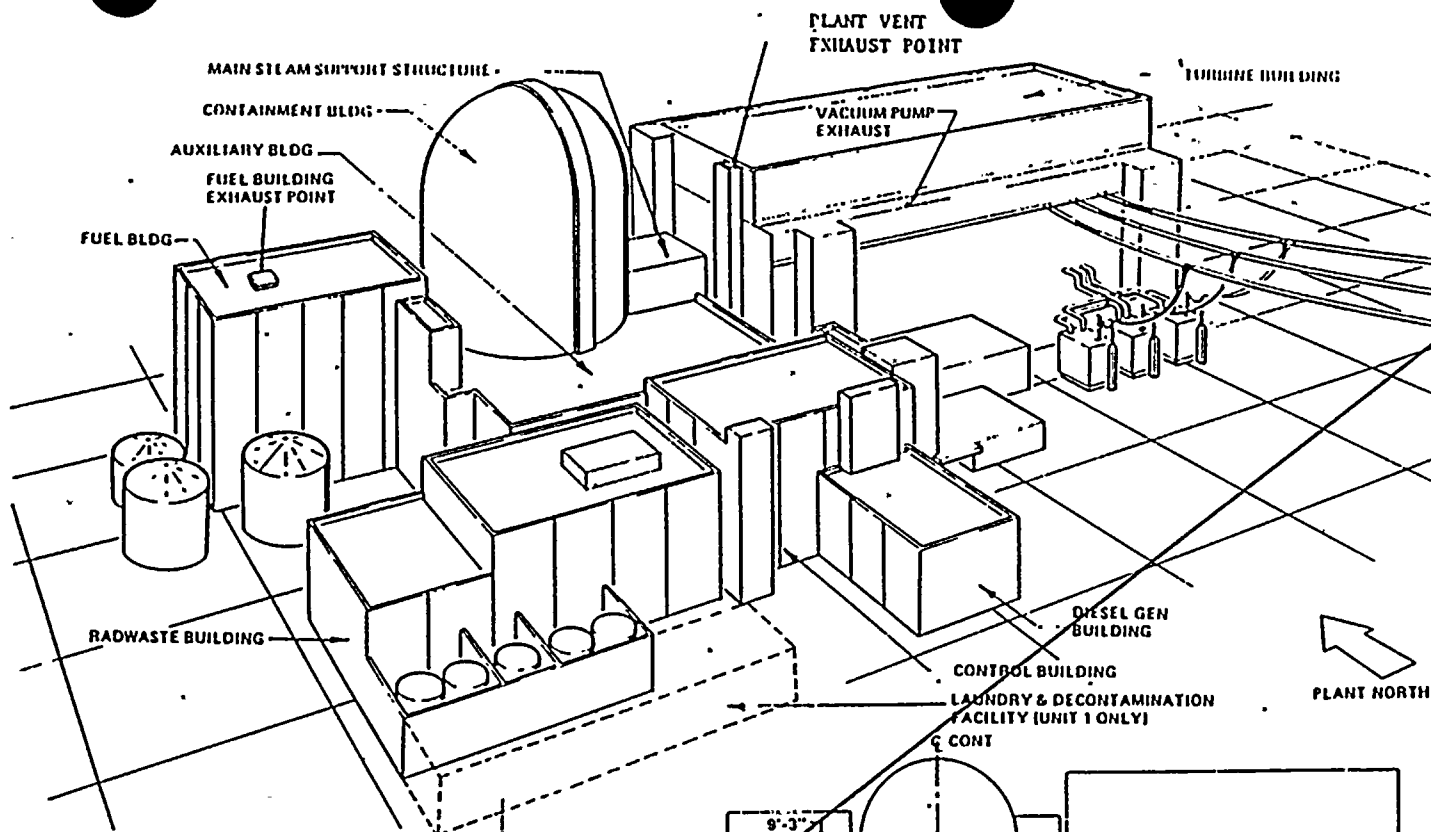

INSERT  
New Figure 5.1-3

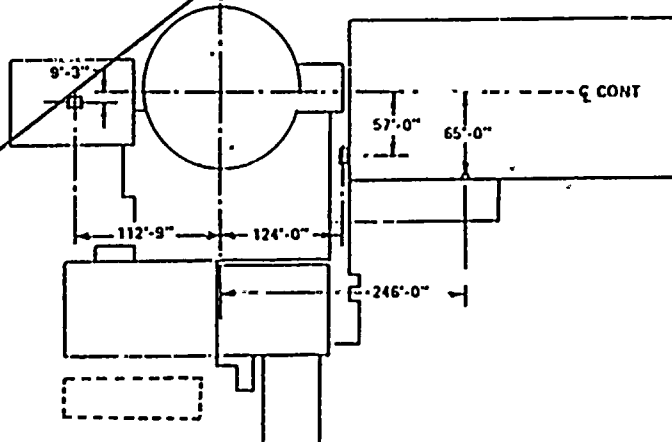


EXHAUST POINTS KEY PLAN

(elevation of exhaust point above grade)

Plant Vent	145'
Fuel Building	116'
Vacuum Pump	84'

GASEOUS RELEASE POINTS

FIGURE 5.1-3


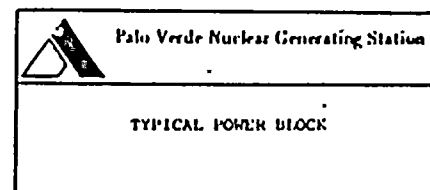


10-12-84





7-4

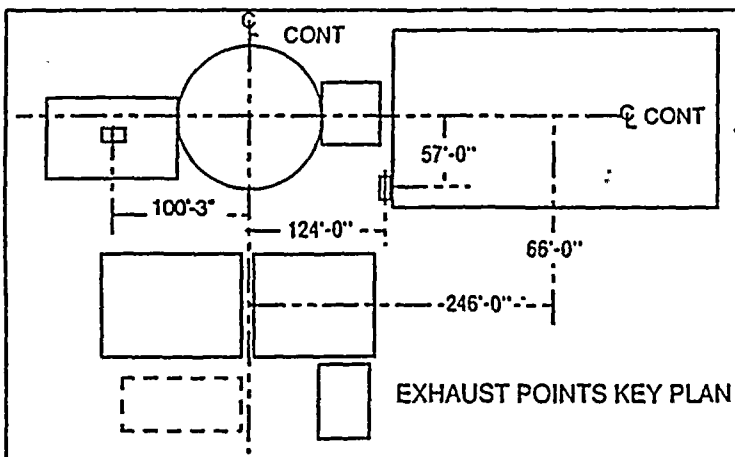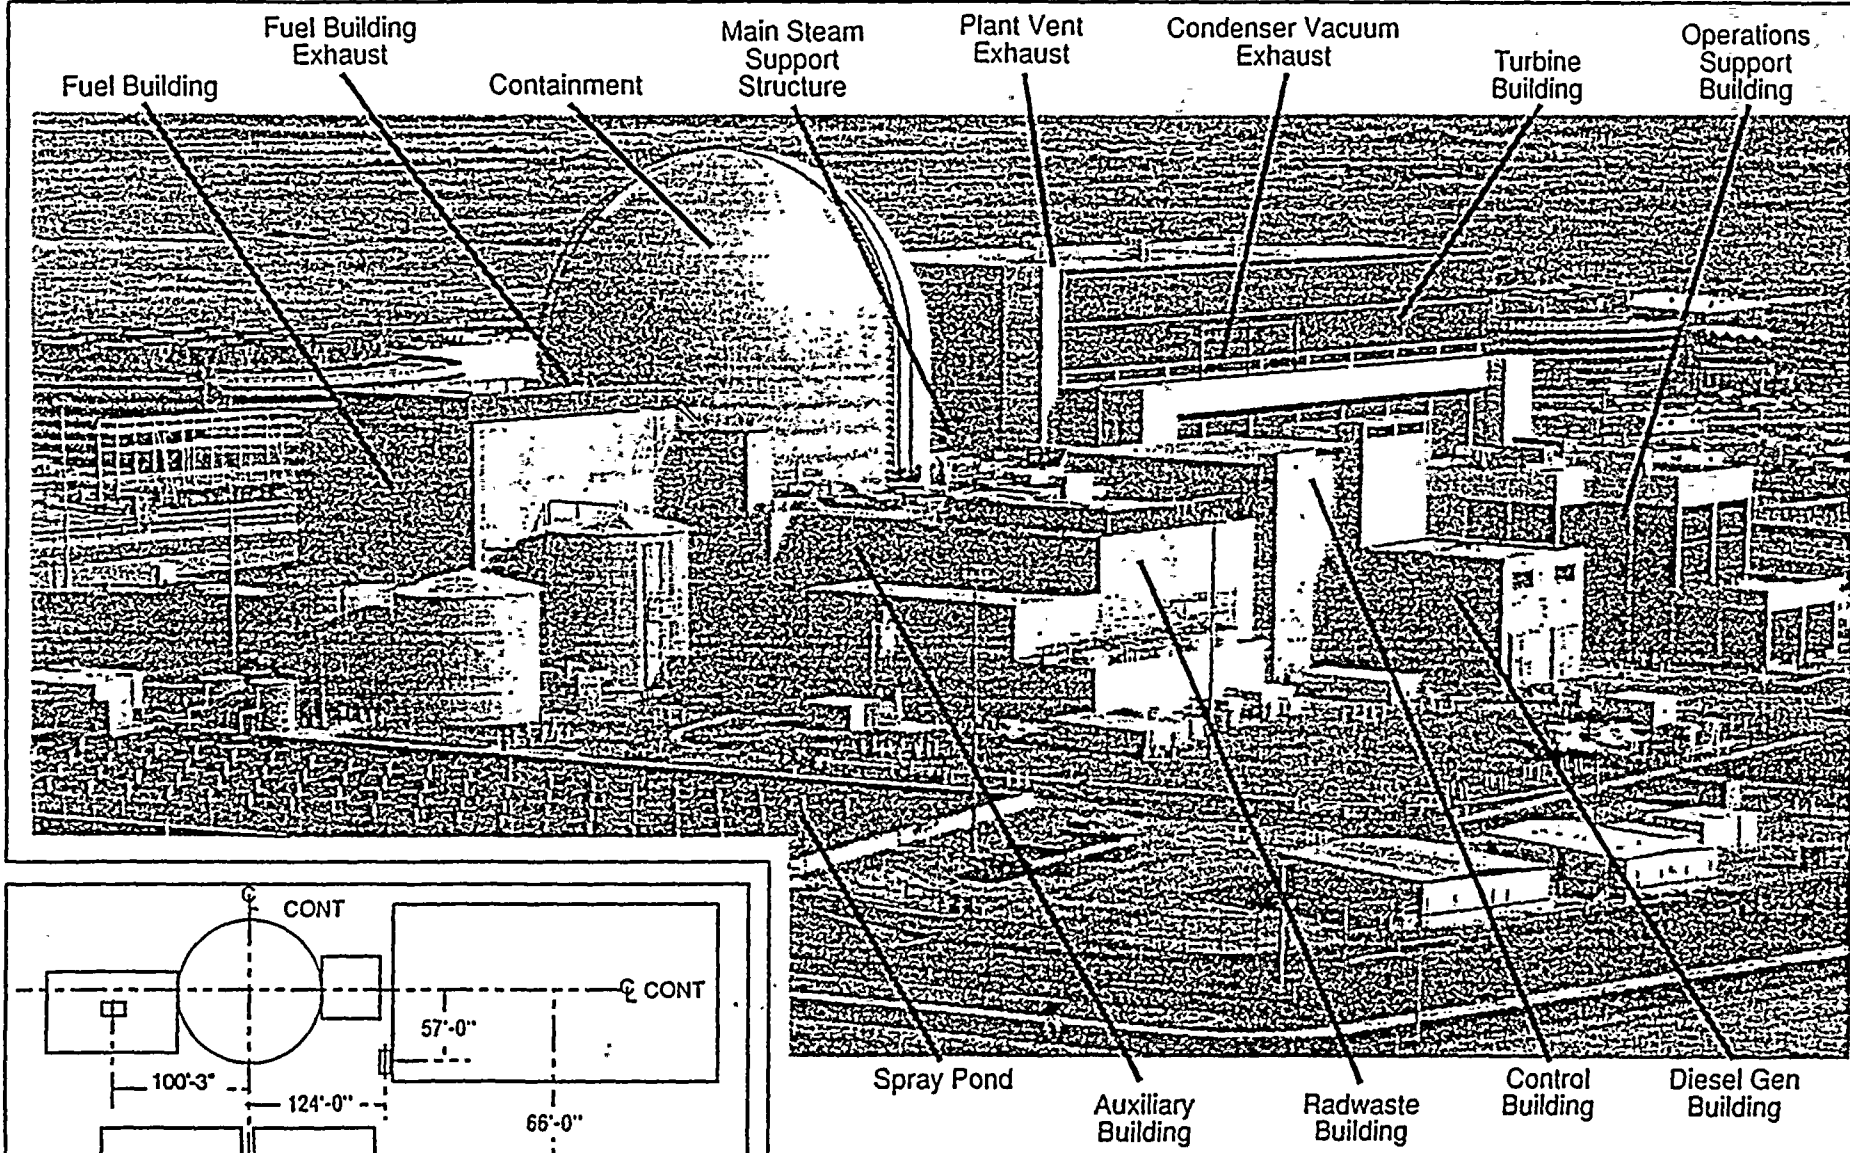

Elevation of Exhaust Point Above Grade	
Plant Vent	145'
Condenser Vacuum	109'-9"
Fuel Building	84'

**Palo Verde Nuclear Generating Station  
GASEOUS EFFLUENT RELEASE POINTS**

Fig. 5.1-3

11

12

13

14

15

16

17

18

19



# CONTROLLED BY USER

## ADMINISTRATIVE CONTROLS

### PROCEDURES AND PROGRAMS (Continued)

- (5) Procedures defining corrective actions for all off-control point chemistry conditions, and
- (6) A procedure identifying (a) the authority responsible for the interpretation of the data, and (b) the sequence and timing of administrative events required to initiate corrective action.

#### d. Backup Method for Determining Subcooling Margin

A program which will ensure the capability to accurately monitor the Reactor Coolant System subcooling margin. This program shall include the following:

- (1) Training of personnel, and
- (2) Procedures for monitoring.

#### e. Post-Accident Sampling

A program which will ensure the capability to obtain and analyze reactor coolant, radioactive iodines and particulates in plant gaseous effluents, and containment atmosphere samples under accident conditions. The program shall include the following:

- (1) Training of personnel,
- (2) Procedures for sampling and analysis,
- (3) Provisions for maintenance of sampling and analysis equipment.

#### f. Spray Pond Monitoring

A program which will identify and describe the parameters and activities used to control and monitor the Essential Spray Pond and Piping. The program shall be conducted in accordance with station manual procedures.

### 6.9 <sup>h.</sup> REPORTING REQUIREMENTS

#### ROUTINE REPORTS

6.9.1 In addition to the applicable reporting requirements of Title 10, Code of Federal Regulations, the following reports shall be submitted to the Regional Administrator of the Regional Office of the NRC unless otherwise noted.

#### STARTUP REPORT

6.9.1.1 A summary report of plant startup and power escalation testing shall be submitted following (1) receipt of an operating license, (2) amendment to the license involving a planned increase in power level, (3) installation of fuel that has a different design or has been manufactured by a different fuel

INSERT 3

g.

h.

move to  
page 6-18

1  
2  
3  
4  
5  
6  
7  
8  
9  
10  
11  
12  
13  
14  
15  
16  
17  
18  
19  
20  
21  
22  
23  
24  
25  
26  
27  
28  
29  
30  
31  
32  
33  
34  
35  
36  
37  
38  
39  
40  
41  
42  
43  
44  
45  
46  
47  
48  
49  
50  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65  
66  
67  
68  
69  
70  
71  
72  
73  
74  
75  
76  
77  
78  
79  
80  
81  
82  
83  
84  
85  
86  
87  
88  
89  
90  
91  
92  
93  
94  
95  
96  
97  
98  
99  
100

101

102

103

104

105

106

107

108

109

110

111

112

INSERT 3

g. Radioactive Effluent Controls Program

A program shall be provided conforming with 10 CFR 50.36a for the control of radioactive effluents and for maintaining the doses to MEMBERS OF THE PUBLIC from radioactive effluents as low as reasonably achievable. The program (1) shall be contained in the ODCM, (2) shall be implemented by operating procedures, and (3) shall include remedial actions to be taken whenever the program limits are exceeded. The program shall include the following elements:

- 1) Limitations on the operability of radioactive liquid and gaseous monitoring instrumentation including surveillance tests and setpoint determination in accordance with the methodology in the ODCM,
- 2) Limitations on the concentrations of radioactive material released in liquid effluents to UNRESTRICTED AREAS conforming to 10 CFR Part 20, Appendix B, Table 11, Column 2,
- 3) Monitoring, sampling, and analysis of radioactive liquid and gaseous effluents in accordance with 10 CFR 20.106 and with the methodology and parameters in the ODCM,
- 4) Limitations on the annual and quarterly doses or dose commitment to a MEMBER OF THE PUBLIC from radioactive materials in liquid effluents released from each unit to UNRESTRICTED AREAS conforming to Appendix I to 10 CFR Part 50,
- 5) Determination of cumulative and projected dose contributions from radioactive effluents for the current calendar quarter and current calendar year in accordance with the methodology and parameters in the ODCM at least every 31 days,
- 6) Limitations on the operability and use of the liquid and gaseous effluent treatment systems to ensure that the appropriate portions of these systems are used to reduce releases of radioactivity when the projected doses in a 31-day period would exceed 2 percent of the guidelines for the annual dose or dose commitment conforming to Appendix I to 10 CFR Part 50,
- 7) Limitations on the dose rate resulting from radioactive material released in gaseous effluents to areas beyond the SITE BOUNDARY conforming to the doses associated with 10 CFR Part 20, Appendix B, Table II, Column 1,

100

100

100

100

100

100

100



- 8) Limitations on the annual and quarterly air doses resulting from noble gases released in gaseous effluents from each unit to areas beyond the SITE BOUNDARY conforming to Appendix I to 10 CFR Part 50,
- 9) Limitations on the annual and quarterly doses to a MEMBER OF THE PUBLIC from Iodine-131, Iodine-133, tritium, and all radionuclides in particulate form with half-lives greater than 8 days in gaseous effluents released from each unit to areas beyond the SITE BOUNDARY conforming to Appendix I to 10 CFR Part 50,
- 10) Limitations on the annual dose or dose commitment to any MEMBER OF THE PUBLIC due to releases of radioactivity and to radiation from uranium fuel cycle sources conforming to 40 CFR Part 190.

h. Radiological Environmental Monitoring Program

A program shall be provided to monitor the radiation and radionuclides in the environs of the plant. The program shall provide (1) representative measurements of radioactivity in the highest potential exposure pathways, and (2) verification of the accuracy of the effluent monitoring program and modeling of environmental exposure pathways. The program shall (1) be contained in the ODCM, (2) conform to the guidance of Appendix I to 10 CFR Part 50, and (3) include the following:

- 1) Monitoring, sampling, analysis, and reporting of radiation and radionuclides in the environment in accordance with the methodology and parameters in the ODCM,
- 2) A Land Use Census to ensure that changes in the use of areas at and beyond the SITE BOUNDARY are identified and that modifications to the monitoring program are made if required by the results of this census, and
- 3) Participation in a Interlaboratory Comparison Program to ensure that independent checks on the precision and accuracy of the measurements of radioactive materials in environmental sample matrices are performed as part of the quality assurance program for environmental monitoring.

1  
2  
3  
4  
5  
6  
7  
8  
9  
10  
11  
12  
13  
14  
15  
16  
17  
18  
19  
20  
21  
22  
23  
24  
25  
26  
27  
28  
29  
30  
31  
32  
33  
34  
35  
36  
37  
38  
39  
40  
41  
42  
43  
44  
45  
46  
47  
48  
49  
50  
51  
52  
53  
54  
55  
56  
57  
58  
59  
60  
61  
62  
63  
64  
65  
66  
67  
68  
69  
70  
71  
72  
73  
74  
75  
76  
77  
78  
79  
80  
81  
82  
83  
84  
85  
86  
87  
88  
89  
90  
91  
92  
93  
94  
95  
96  
97  
98  
99  
100

101

102

103

104

105

106

107

108

109

110

111

112

113

114

115

116

117

118



## ADMINISTRATIVE CONTROLS

### REPORTING REQUIREMENTS (Continued)

supplier, and (4) modifications that may have significantly altered the nuclear, thermal, or hydraulic performance of the plant.

6.9.1.2 The Startup Report shall address each of the tests identified in the FSAR and shall include a description of the measured values of the operating conditions or characteristics obtained during the test program and a comparison of these values with design predictions and specifications. Any corrective actions that were required to obtain satisfactory operation shall also be described. Any additional specific details required in license conditions based on other commitments shall be included in this report.

6.9.1.3 Startup reports shall be submitted within (1) 90 days following completion of the startup test program, (2) 90 days following resumption or commencement of commercial power operation, or (3) 9 months following initial criticality, whichever is earliest. If the Startup Report does not cover all three events (i.e., initial criticality, completion of startup test program, and resumption or commencement of commercial operation) supplementary reports shall be submitted at least every 3 months until all three events have been completed.

### ANNUAL REPORTS\*

6.9.1.4 Annual reports covering the activities of the unit as described below for the previous calendar year shall be submitted within the first calendar quarter of each year. The initial report shall be submitted within the first calendar quarter of the year following initial criticality.

6.9.1.5 Reports required on an annual basis shall include a tabulation on an annual basis of the number of station, utility, and other personnel (including contractors) receiving exposures greater than 100 mrem/yr and their associated man-rem exposure according to work and job functions,\*\* e.g., reactor operations and surveillance, inservice inspection, routine maintenance, special maintenance (describe maintenance), waste processing, and refueling. The dose assignments to various duty functions may be estimated based on pocket dosimeter, TLD, or film badge measurements. Small exposures totalling less than 20% of the individual total dose need not be accounted for. In the aggregate, at least 80% of the total whole body dose received from external sources should be assigned to specific major work functions.

Annual reports shall also include the results of specific activity analysis in which the primary coolant exceeded the limits of Specification 3.4.7. The following information shall be included: (1) Reactor power history starting 48 hours prior to the first sample in which the limit was exceeded; (2) Results of the last isotopic analysis for radioiodine performed prior to exceeding the limit, results of analysis while limit was exceeded and results of one

---

\*A single submittal may be made for a multiple unit station. The submittal should combine those sections that are common to all units at the station.

\*\*This tabulation supplements the requirements of §20.407 of the 10 CFR Part 20.



# CONTROLLED BY USER

## ADMINISTRATIVE CONTROLS

### ANNUAL REPORTS (Continued)

analysis after the radioiodine activity was reduced to less than limit. Each result should include date and time of sampling and the radioiodine concentrations; (3) Clean-up system flow history starting 48 hours prior to the first sample in which the limit was exceeded; (4) Graph of the I-131 concentration and one other radioiodine isotope concentration in microcuries per gram as a function of time for the duration of the specific activity above the steady-state level; and (5) The time duration when the specific activity of the primary coolant exceeded the radioiodine limit.

### MONTHLY OPERATING REPORT

6.9.1.6 Routine reports of operating statistics and shutdown experience, including documentation of all challenges to the safety valves, shall be submitted on a monthly basis to the Director, Office of Resource Management, U.S. Nuclear Regulatory Commission, Washington, D.C. 20555, with a copy to the Regional Administrator of the Regional Office of the NRC, no later than the 15th of each month following the calendar month covered by the report.

### ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT\*

INSERT 4

6.9.1.7 Routine Annual Radiological Environmental Operating Reports covering the operation of the unit during the previous calendar year shall be submitted prior to May 1 of each year. The initial report shall be submitted prior to May 1 of the year following initial criticality.

The Annual Radiological Environmental Operating Reports shall include summaries, interpretations, and an analysis of trends of the results of the radiological environmental surveillance activities for the report period, including a comparison with preoperational studies, with operational controls as appropriate, and with previous environmental surveillance reports, and an assessment of the observed impacts of the plant operation on the environment. The reports shall also include the results of land use censuses required by Specification 3.12.2.

The Annual Radiological Environmental Operating Reports shall include the results of analysis of all radiological environmental samples and of all environmental radiation measurements taken during the period pursuant to the locations specified in the Table and Figures in the ODCM, as well as summarized and tabulated results of these analyses and measurements in the format of the table in the Radiological Assessment Branch Technical Position, Revision 1, November 1979. In the event that some individual results are not available for inclusion with the report, the report shall be submitted noting and explaining the reasons for the missing results. The missing data shall be submitted as soon as possible in a supplementary report.

~~The reports shall also include the following: a summary description of the radiological environmental monitoring program; at least two legible maps\*\*~~

~~\*A single submittal may be made for a multiple unit station.~~

~~\*\*One map shall cover stations near the SITE BOUNDARY; a second shall include the more distant stations.~~



INSERT 4

ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT \*

6.9.1.7 The Annual Radiological Environmental Operating Report covering the operation of the unit during the previous calendar year shall be submitted before May 1 of each year. The report shall include summaries, interpretations, and analysis of trends of the results of the Radiological Environmental Monitoring Program for the reporting period. The material provided shall be consistent with the objectives outlined in (1) the ODCM and (2) Sections IV.B.2, IV.B.3, and IV.C of Appendix I to 10 CFR Part 50.

\* A single submittal may be made for a multi-unit station.



# CONTROLLED BY USER

## ADMINISTRATIVE CONTROLS

### ANNUAL RADIOLOGICAL ENVIRONMENTAL OPERATING REPORT (Continued)

covering all sampling locations keyed to a table giving distances and directions from the centerline of one reactor; the results of licensee participation in the Interlaboratory Comparison Program, required by Specification 3.12.3; discussion of all deviations from the sampling schedule of Table 3.12-1; and discussion of all analyses in which the LLD required by Table 4.12-1 was not achievable.

### SEMIANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT\*

INSERT 5

6.9.1.8 Routine Semiannual Radioactive Effluent Release Reports covering the operation of the unit during the previous 6 months of operation shall be submitted within 60 days after January 1 and July 1 of each year. The period of the first report shall begin with the date of initial criticality.

The Semiannual Radioactive Effluent Release Reports shall include a summary of the quantities of radioactive liquid and gaseous effluents and solid waste released from the unit as outlined in Regulatory Guide 1.21, "Measuring, Evaluating, and Reporting Radioactivity in Solid Wastes and Release of Radioactive Materials in Liquid and Gaseous Effluents from Light-Water-Cooled Nuclear Power Plants," Revision 1, June 1974, with data summarized on a quarterly basis following the format of Appendix B thereof.

The Semiannual Radioactive Effluent Release Report to be submitted within 60 days after January 1 of each year shall include an annual summary of hourly meteorological data collected over the previous year. This annual summary may be either in the form of an hour-by-hour listing on magnetic tape of wind speed, wind direction, atmospheric stability, and precipitation (if measured), or in the form of joint frequency distributions of wind speed, wind direction, and atmospheric stability.\*\* This same report shall include an assessment of the radiation doses due to the radioactive liquid and gaseous effluents released from the unit or station during the previous calendar year. This same report shall also include an assessment of the radiation doses from radioactive liquid and gaseous effluents to MEMBERS OF THE PUBLIC due to their activities inside the SITE BOUNDARY (Figure 5.1-1) during the report period. All assumptions used in making these assessments, i.e., specific activity, exposure time and location, shall be included in these reports. The meteorological conditions concurrent with the time of release of radioactive materials in gaseous effluents, as determined by sampling frequency and measurement, shall be used for determining the gaseous pathway doses. The assessment of radiation doses shall be performed in accordance with the methodology and parameters in the OFFSITE DOSE CALCULATION MANUAL.

\*A single submittal may be made for a multiple unit station. The submittal should combine those sections that are common to all units at the station; however, for units with separate radwaste systems, the submittal shall specify the releases of radioactive material from each unit.

\*\*In lieu of submission with the first half year Semiannual Radioactive Effluent Release Report, the licensee has the option of retaining this summary of required meteorological data on site in a file that shall be provided to the NRC upon request.

1

(127-111-111)

1



INSERT 5

SEMIANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT \*\*

6.9.1.8 The Semiannual Radioactive Effluent Release Report covering the operation of the unit during the previous 6 months of operation shall be submitted within 60 days after January 1 and July 1 of each year. The report shall include a summary of the quantities of radioactive liquid and gaseous effluents and solid waste released from the unit. The material provided shall be (1) consistent with the objectives outlined in the ODCM and PCP and (2) in conformance with 10 CFR 50.36a and Section IV.B.1 of Appendix I to 10 CFR Part 50.

\*\* A single submittal may be made for a multiple unit station. The submittal should combine those sections that are common to all units at the station; however, for units with separate radwaste systems, the submittal shall specify the release of radioactive material from each unit.



ADMINISTRATIVE CONTROLS

SEMIANNUAL RADIOACTIVE EFFLUENT RELEASE REPORT (Continued)

The Semiannual Radioactive Effluent Release Report to be submitted 60 days after January 1 of each year shall also include an assessment of radiation doses to the likely most exposed MEMBER OF THE PUBLIC from reactor releases and other nearby uranium fuel cycle sources, including doses from primary effluent pathways and direct radiation, for the previous calendar year to show conformance with 40 CFR Part 190, Environmental Radiation Protection Standards for Nuclear Power Operation. Acceptable methods for calculating the dose contribution from liquid and gaseous effluents are given in Regulatory Guide 1.109, Rev. 1, October 1977.

The Semiannual Radioactive Effluent Release Reports shall include the following information for each class of solid waste (as defined by 10 CFR Part 61) shipped offsite during the report period:

- a. Container volume, ~~DELETE~~
- b. Total curie quantity (specify whether determined by measurement or estimate),
- c. Principal radionuclides (specify whether determined by measurement or estimate),
- d. Source of waste and processing employed (e.g., dewatered spent resin compacted dry waste, evaporator bottoms),
- e. Type of container (e.g., LSA, Type A, Type B, Large Quantity), and
- f. Solidification agent or absorbent (e.g., cement, urea formaldehyde).

The Semiannual Radioactive Effluent Release Reports shall include a list and description of unplanned releases from the site to UNRESTRICTED AREAS of radioactive materials in gaseous and liquid effluents made during the reporting period.

The Semiannual Radioactive Effluent Release Reports shall include any changes made during the reporting period to the PROCESS CONTROL PROGRAM and to the OFFSITE DOSE CALCULATION MANUAL, as well as a listing of new locations for dose calculations and/or environmental monitoring identified by the land use census pursuant to Specification 3.12.2.

SPECIAL REPORTS

6.9.2 Special reports shall be submitted to the Regional Administrator of the Regional Office of the NRC within the time period specified for each report.

6.9.3 Violations of the requirements of the fire protection program described in the Final Safety Analysis Report which would have adversely affected the ability to achieve and maintain safe shutdown in the event of a fire shall be reported in accordance with 10 CFR 50.73.

375/9

# CONTROLLED BY USER

## ADMINISTRATIVE CONTROLS

### RECORD RETENTION (Continued)

- i. Records of quality assurance activities required by the QA Manual not listed in Section 6.10.1.
- j. Records of reviews performed for changes made to procedures or equipment or reviews of tests and experiments pursuant to 10 CFR 50.59.
- k. Records of PRB meetings and of NSG activities.
- l. Records of the service lives of all hydraulic and mechanical snubbers required by Specification 3.7.9 including the date at which the service life commences and associated installation and maintenance records.
- m. Records of audits performed under the requirements of Specifications 6.5.3.5 and 6.8.4.
- n. Records of analyses required by the radiological environmental monitoring program that would permit evaluation of the accuracy of the analysis at a later date. This should include procedures effective at specified times and QA records showing that these procedures were followed.
- o. Meteorological data, summarized and reported in a format consistent with the recommendations of Regulatory Guides 1.21 and 1.23.
- p. Records of secondary water sampling and water quality.
- q. Records of reviews performed for changes made to the OFFSITE DOSE CALCULATION MANUAL and the PROCESS CONTROL PROGRAM.

### 6.11 RADIATION PROTECTION PROGRAM

6.11.1 Procedures for personnel radiation protection shall be prepared consistent with the requirements of 10 CFR Part 20 and shall be approved, maintained, and adhered to for all operations involving personnel radiation exposure.

### 6.12 HIGH RADIATION AREA

6.12.1 In lieu of the "control device" or "alarm signal" required by paragraph 20.203(c)(2) of 10 CFR Part 20, each high radiation area in which the intensity of radiation is greater than 100 mrem/hr but less than 1000 mrem/hr shall be barricaded and conspicuously posted as a high radiation area and entrance thereto shall be controlled by requiring issuance of a Radiation Exposure Permit (REP)\*. Any individual or group of individuals permitted to enter such areas shall be provided with or accompanied by one or more of the following:

\*Radiation Protection personnel or personnel escorted by Radiation Protection personnel shall be exempt from the REP issuance requirement during the performance of their assigned radiation protection duties, provided they are otherwise following plant radiation protection procedures for entry into high radiation areas.



# CONTROLLED BY USER

## ADMINISTRATIVE CONTROLS

### HIGH RADIATION AREA (Continued)

- a. A radiation monitoring device which continuously indicates the radiation dose rate in the area.
- b. A radiation monitoring device which continuously integrates the radiation dose rate in the area and alarms when a preset integrated dose is received. Entry into such areas with this monitoring device may be made after the dose rate level in the area has been established and personnel have been made knowledgeable of them.
- c. A radiation protection qualified individual (i.e., qualified in radiation protection procedures) with a radiation dose rate monitoring device who is responsible for providing positive control over the activities within the area and shall perform periodic radiation surveillance at the frequency specified by the facility Radiation Protection Supervisor or his designated alternate in the REP.

6.12.2 In addition to the requirements of Specification 6.12.1, areas accessible to personnel with radiation levels such that a major portion of the body could receive in 1 hour a dose greater than 1000 mrem shall be provided with locked doors to prevent unauthorized entry, and the keys shall be maintained under the administrative control of the Shift Supervisor on duty and/or radiation protection supervision. Doors shall remain locked except during periods of access by personnel under an approved REP which shall specify the dose rate levels in the immediate work area and the maximum allowable stay time for individuals in that area. For individual areas accessible to personnel with radiation levels such that a major portion of the body could receive in 1 hour a dose in excess of 1000 mrem\*, that are located within large areas, such as PWR containment, where no enclosure exists for purposes of locking, and no enclosure can be reasonably constructed around the individual areas, then that area shall be roped off, conspicuously posted and a flashing light shall be activated as a warning device. In lieu of the stay time specification of the REP, direct or remote (such as use of closed circuit TV cameras) continuous surveillance may be made by personnel qualified in radiation protection procedures to provide positive exposure control over the activities within the area.

### 6.13 PROCESS CONTROL PROGRAM (PCP) INSERT 6

6.13.1 The PCP shall be approved by the Commission prior to implementation.

6.13.2 Licensee-initiated changes to the PCP:

Shall be submitted to the Commission in the Semiannual Radioactive Effluent Release Report for the period in which the change(s) was made. This submittal shall contain:

\*Measurement made at 18 inches from source of radioactivity.

move to  
page  
6-24

100

100

100

100

100

100

100

100

100

100

100

100





INSERT 6

6.13 PROCESS CONTROL PROGRAM

Changes to the PCP:

- a. Shall be documented and records of reviews performed shall be retained as required by Specification 6.10.2.q. This documentation shall contain:
  - 1) Sufficient information to support the change together with the appropriate analysts or evaluations justifying the change(s) and
  - 2) A determination that the change will maintain the overall conformance of the solidified waste product to existing requirements of Federal, State, or other applicable regulations.
- b. Shall become effective after review and acceptance by the PRB and the approval of the Plant Manager.

INSERT 7

6.14 OFFSITE DOSE CALCULATION MANUAL (ODCM)

Changes to the ODCM:

- a. Shall be documented and records of reviews performed shall be retained as required by Specification 6.10.2.q. This documentation shall contain:
  - 1) Sufficient information to support the change together with the appropriate analyses or evaluations justifying the change(s) and
  - 2) A determination that the change will maintain the level of radioactive effluent control required by 10 CFR 20.106, 40 CFR Part 190, 10 CFR 50.36a, and Appendix I to 10 CFR Part 50 and not adversely impact the accuracy or reliability of effluent, dose, or setpoint calculations.
- b. Shall become effective after review and acceptance by the PRB and the approval of the Plant Manager.
- c. Shall be submitted to the Commission in the form of a complete, legible copy of the entire ODCM as a part of or concurrent with the Semiannual Radioactive Effluent Release Report for the period of the report in which any change to the ODCM was made. Each change shall be identified by markings in the margin of the affected pages, clearly indicating the area of the page that was changed, and shall indicate the date (e.g., month/year) the change was implemented.



ADMINISTRATIVE CONTROLS

PROCESS CONTROL PROGRAM (PCP) (Continued)

- 1) Sufficiently detailed information to totally support the rationale for the change without benefit of additional or supplemental information, and
- 2) A determination that the change did not reduce the overall conformance of the solidified waste product to existing criteria for solid wastes.

6.14 OFFSITE DOSE CALCULATION MANUAL (ODCM) INSERT 7

6.14.1 The ODCM shall be approved by the Commission prior to implementation.

6.14.2 Licensee-initiated changes to the ODCM:

Shall be submitted to the Commission in the Semiannual Radioactive Effluent Release Report for the period in which the change(s) was made effective. This submittal shall contain:

- 1) Sufficiently detailed information to totally support the rationale for the change without benefit of additional or supplemental information. Information submitted should consist of a package of those pages of the ODCM to be changed with each page numbered and provided with an approval and date box, together with appropriate analyses or evaluations justifying the change(s); and
- 2) A determination that the change will not reduce the accuracy or reliability of dose calculations or setpoint determinations.

6.15 MAJOR CHANGES TO RADIOACTIVE LIQUID, GASEOUS, AND SOLID WASTE TREATMENT SYSTEMS\*

6.15.1 Licensee-initiated major changes to the radioactive waste systems (liquid, gaseous, and solid):

Shall be reported to the Commission in the Semiannual Radioactive Effluent Release Report for the period in which the evaluation was reviewed by the PRB. The discussion of each change shall contain:

- 1) A summary of the evaluation that led to the determination that the change could be made in accordance with 10 CFR 50.59.
- 2) Sufficient detailed information to totally support the reason for the change without benefit of additional or supplemental information;

\*Licensees may chose to submit the information called for in this specification as part of the annual FSAR update.

